


REV	DESCRIPTION	DATE	CHK	DR	ENG	APPROVALS	REMARKS
1	REV PER SFC 80-184 ISSUED FOR CONSTRUCTION	10/1/80	LM	4.7	LM	4.7	10/1/80
0			LK	4.7	LK	4.7	10/1/80

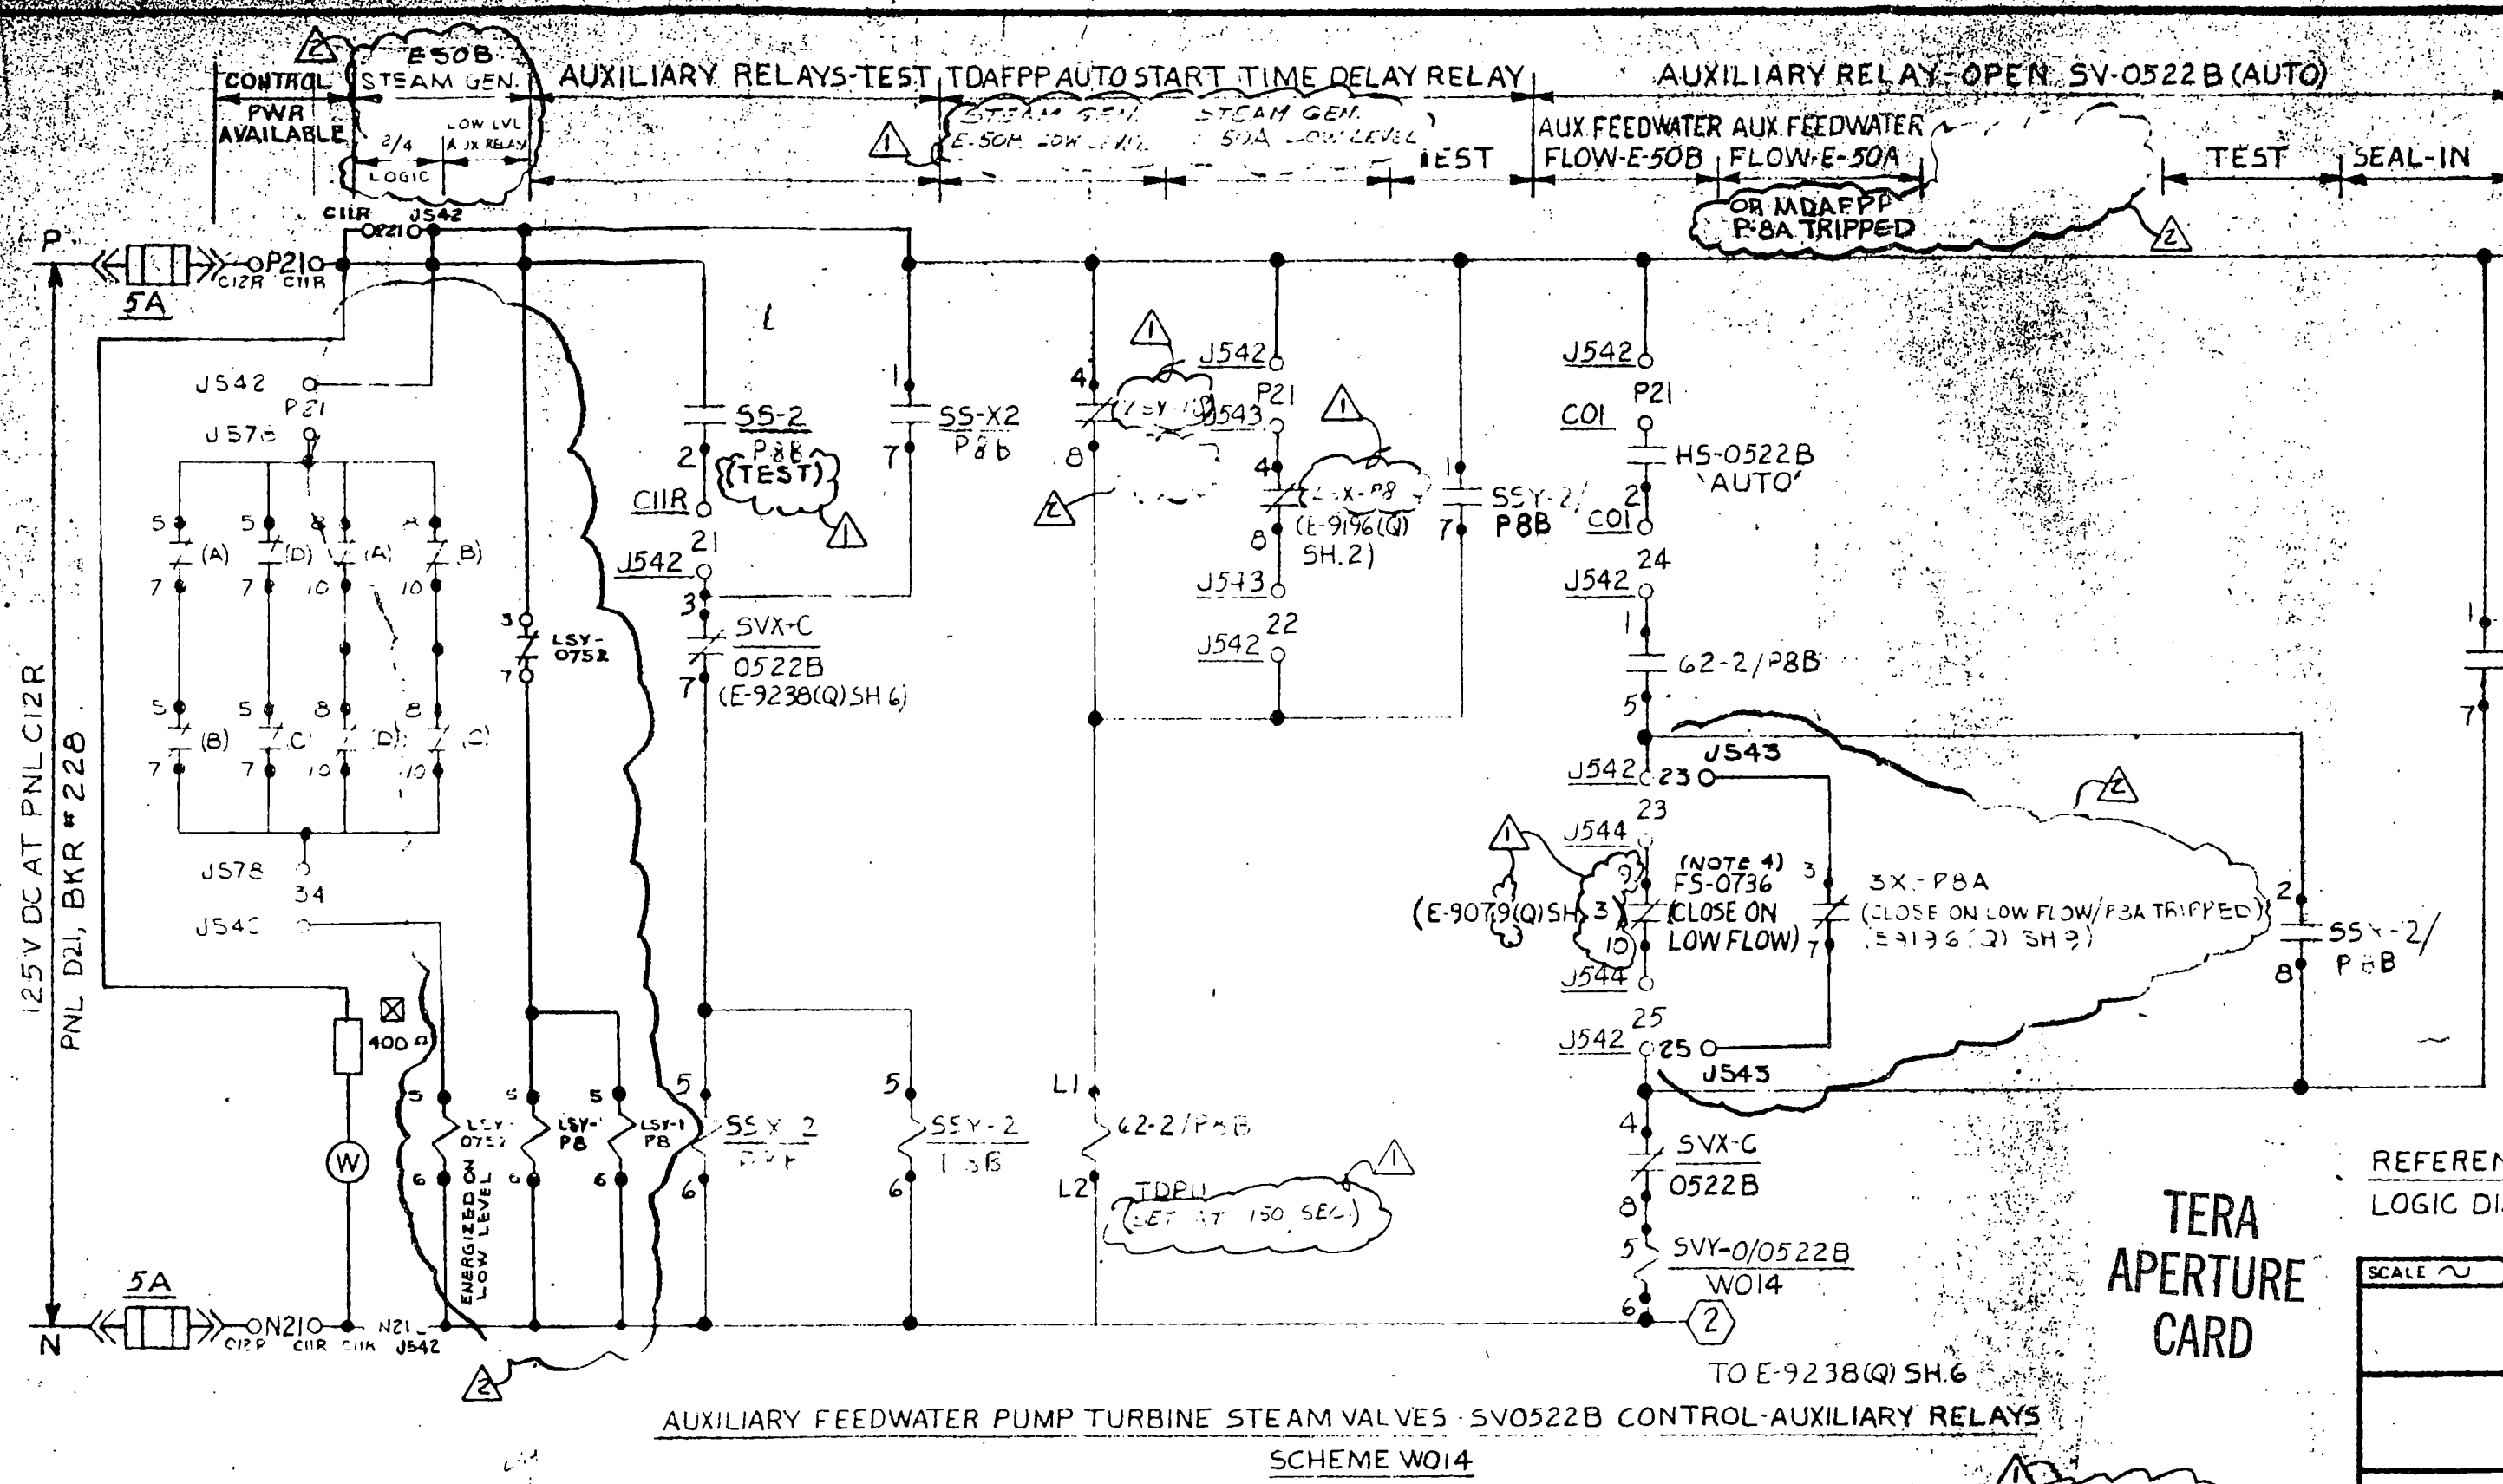

☐ - PART OF PHASE II MODIFICATIONS ALREADY DONE IN FIELD

TO E-9238(Q) SH.6

TDAFP - TURBINE DRIVEN AUX. FEEDWATER PUMP
MDAFP - MOTOR DRIVEN AUX. FEEDWATER PUMP
TDP - TIME DELAY ON PICK UP

REFERENCE DWGS. Deck # 60-255
Control # 811110771
LOGIC DIAG. SKE-JLG-96 Date 11-05-81 of Document 811110786 REGULATORY DOCKET FILE

SCALE	DESIGNED BY K. H. H. AM.	DRAWN W. VULKAN
BECHTEL COMPANY GWO 8428		
PALISADES PLANT CONSUMERS POWER COMPANY		
SCHEMATIC DIAGRAM MAIN STEAM ISOLATION VALVES		
JOB No.	DRAWING No.	REV
12447-039	AE-9238(Q) SH.5	2

NOTES

1. FOR BLOCK DIAGRAM SEE E-9238(Q) SH.6
2. FOR CONTACT DEVELOPMENT OF AUX. RELAYS
SS-X2 SS-X2A 62-2/P8B & SVY-0/0522B
W014 W014 W014 W014
SEE RELAY TABLE ON E-9238(Q) SH.8

3. FOR SWITCH DEVELOPMENT OF
SS-2 & HS-0522B, SEE E-9238(Q) SH.7
4. FS-0736A IS PART OF BAILEY RACK B
LOCATED IN J570 AND IS FIELD
WIRED TO J544.

NOTE GWO 8428
SYSTEMS MODIFICATION PER NUREG 0578

REGULATORY DOCKET FILE COPY