

The following pages are proposed changes to the Unit 1 Technical Specifications:

8011250302

6-2

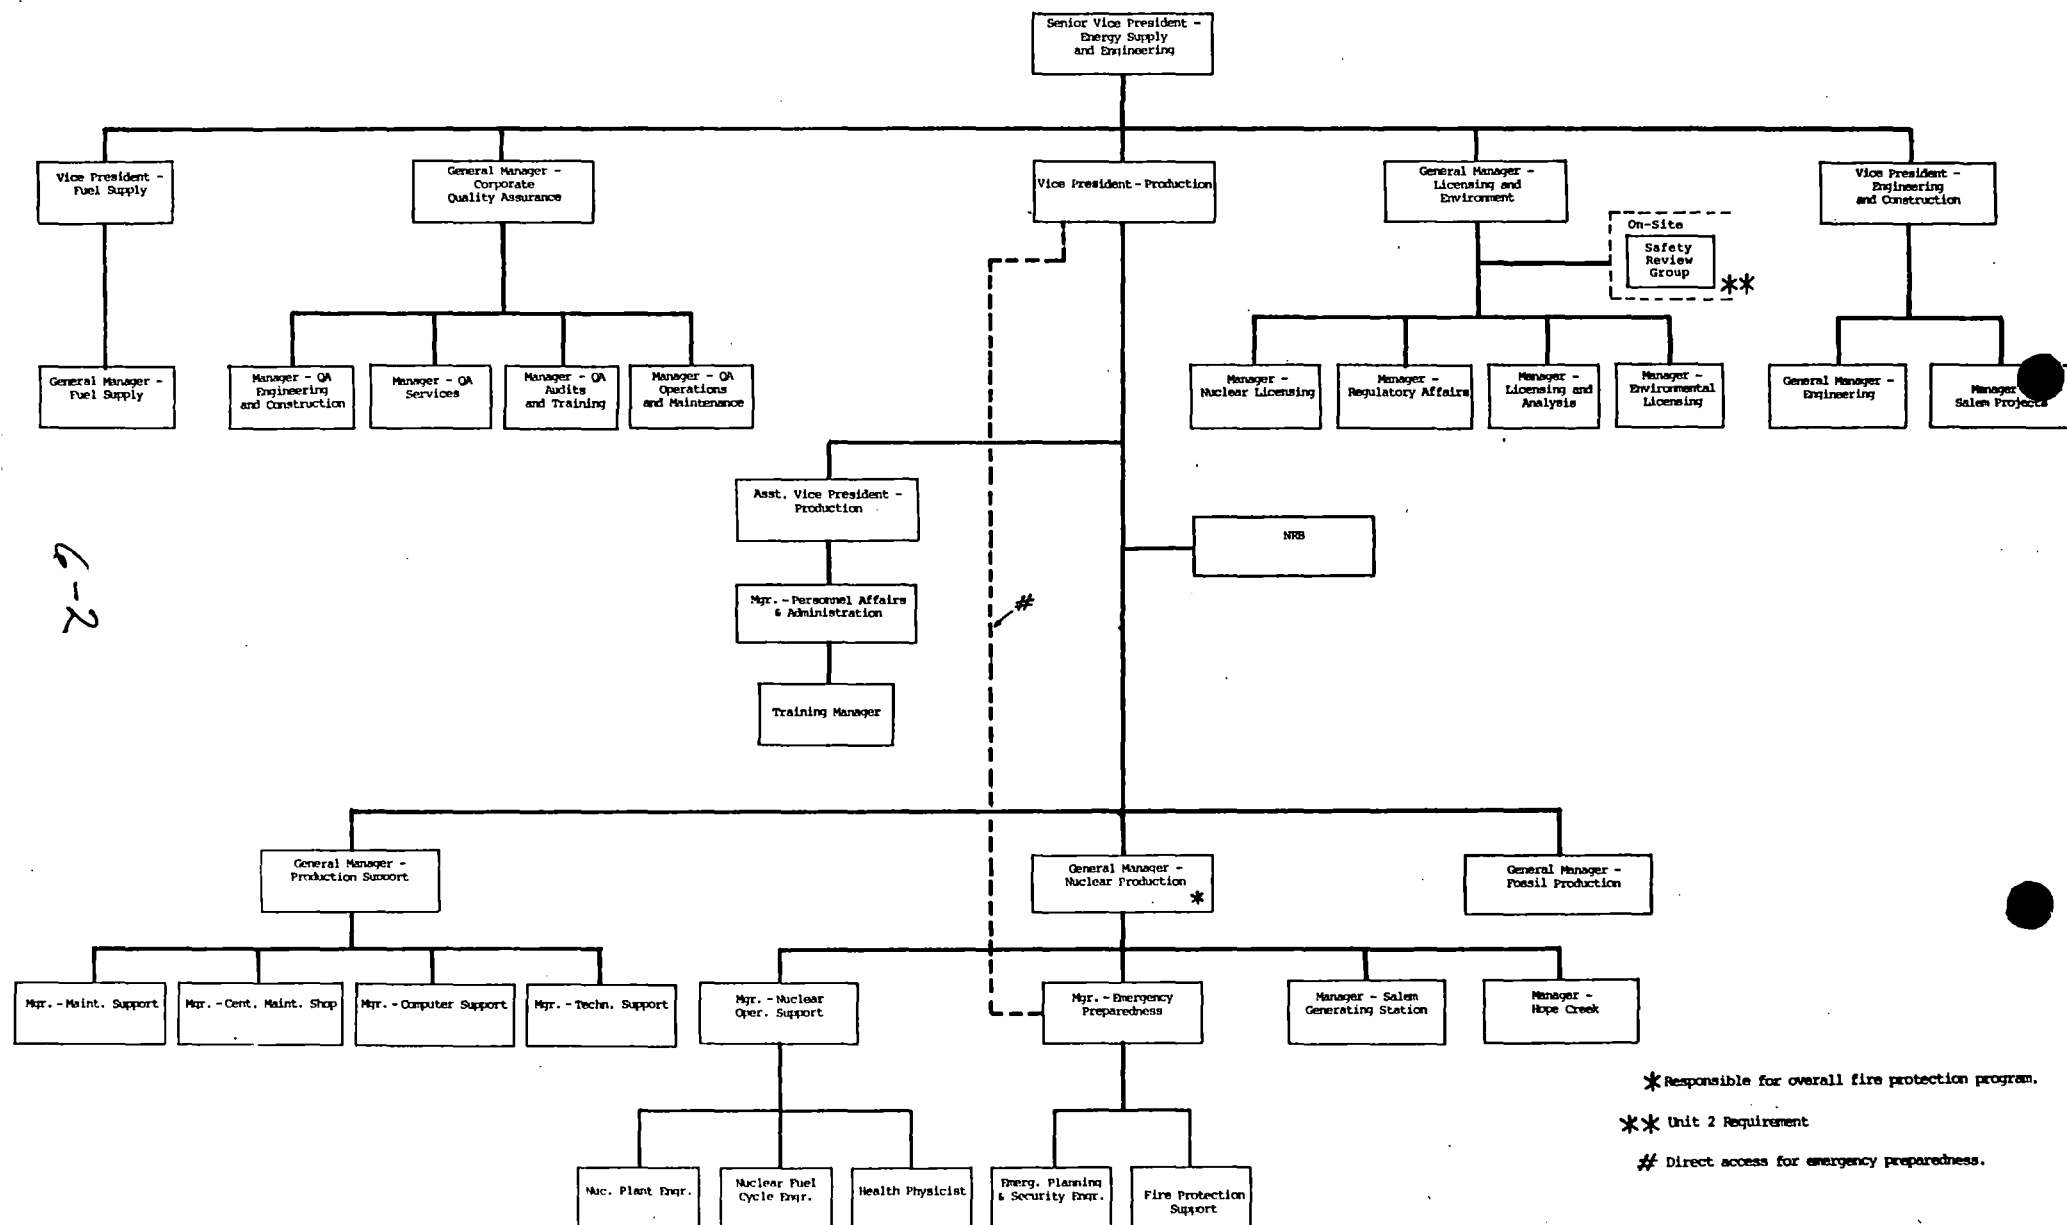


FIGURE 6.2-1 OFFSITE ORGANIZATION FOR FACILITY MANAGEMENT AND TECHNICAL SUPPORT

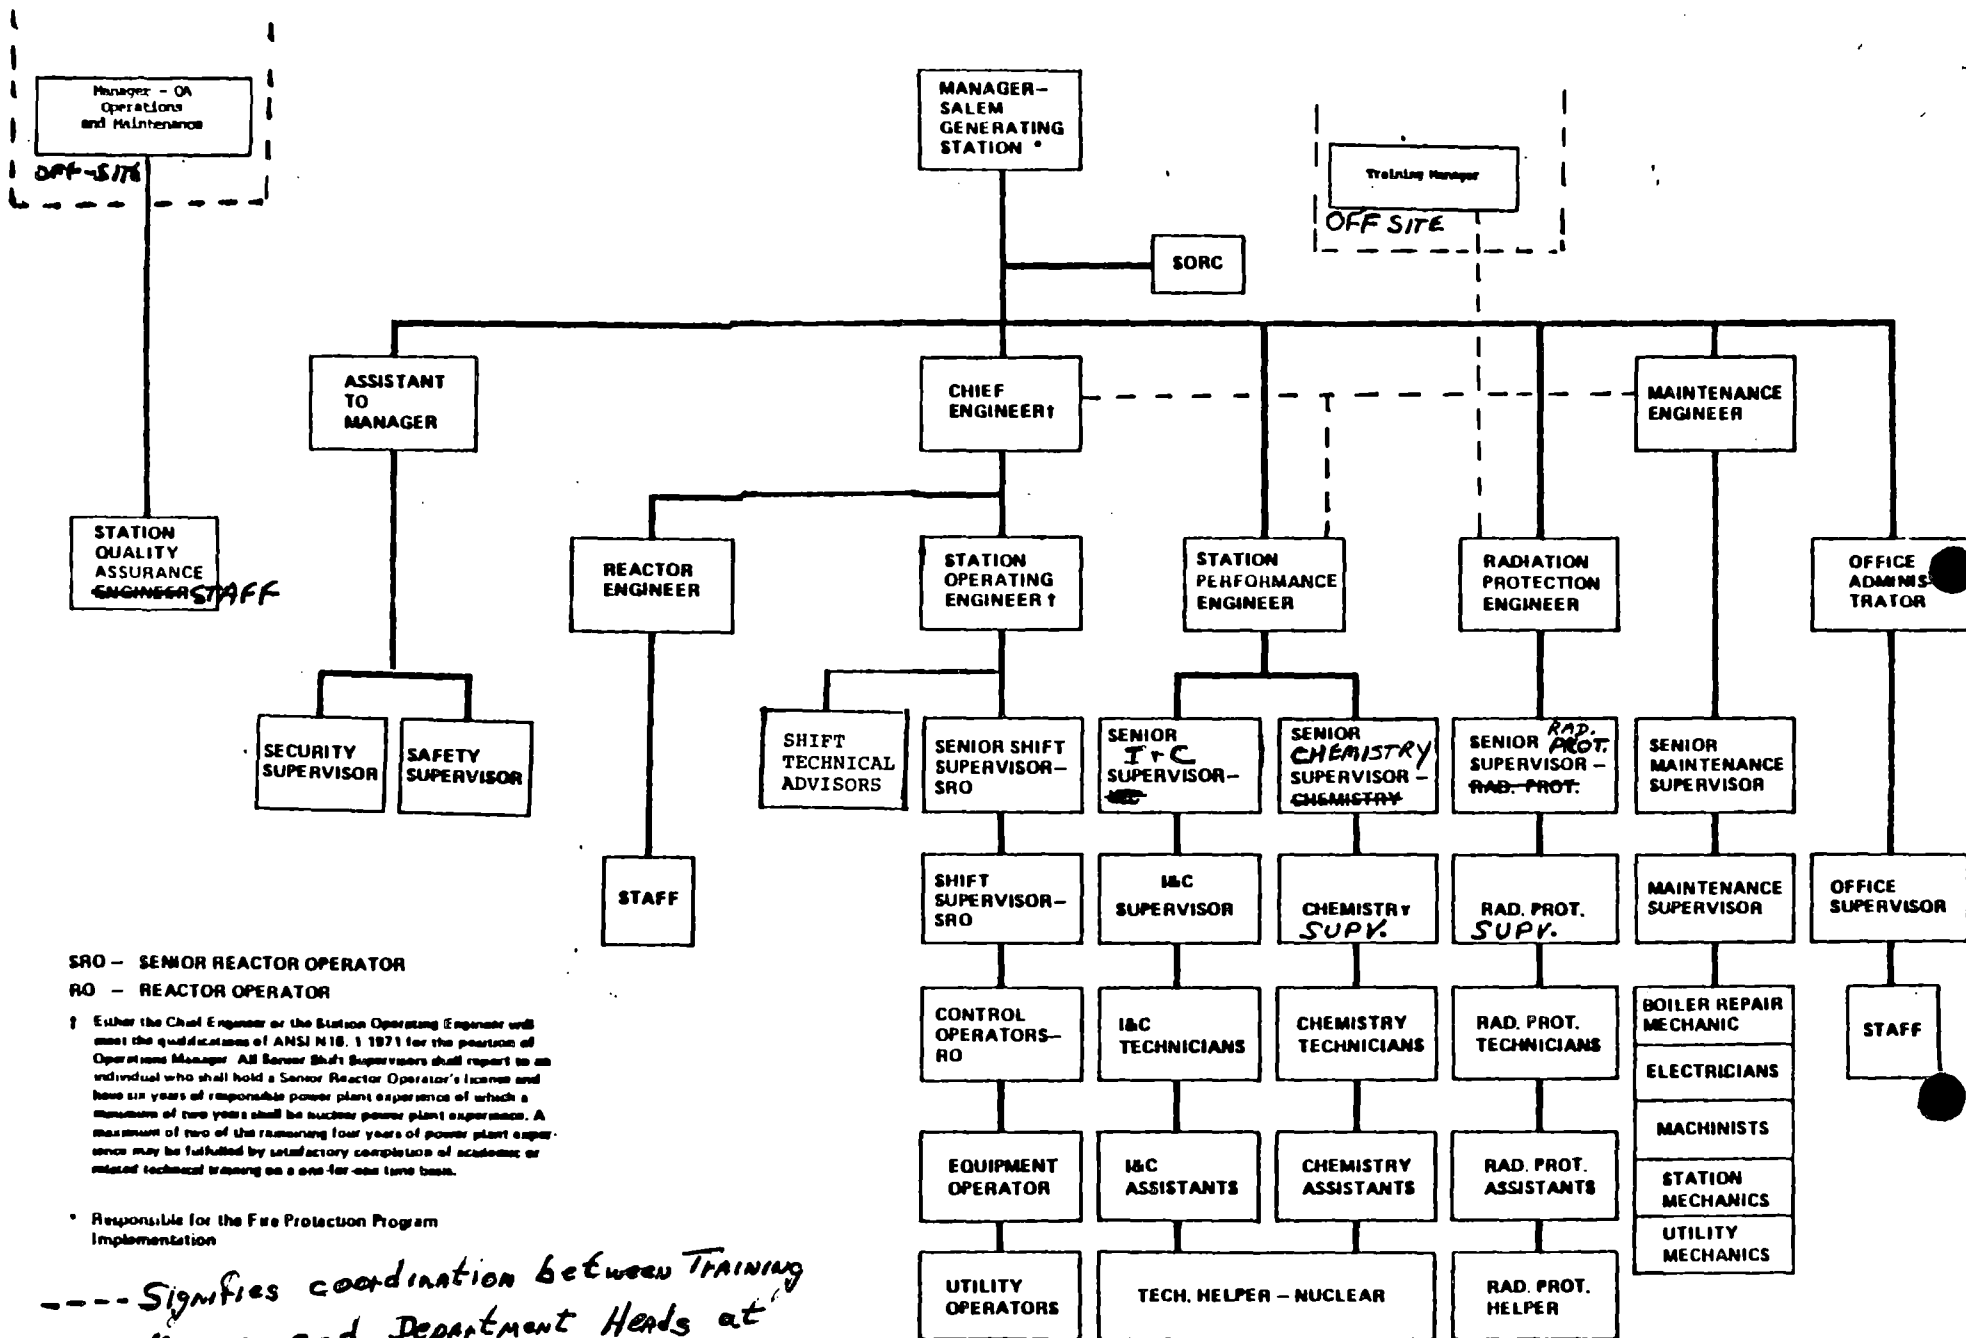


FIGURE 6.2.2 FACILITY ORGANIZATION - SALEM GENERATING STATION

## ADMINISTRATIVE CONTROLS

### 6.3 FACILITY STAFF QUALIFICATIONS

6.3.1 Each member of the facility staff shall meet or exceed the minimum qualifications of ANSI N18.1-1971 for comparable positions, except for the Senior Performance Supervisor - Chemistry/HP who shall meet or exceed the qualifications of Regulatory Guide 1.8, September 1975.

### 6.4 TRAINING

6.4.1 A retraining and replacement training program for the facility staff shall be coordinated by <sup>each functional level manager (department head) at the facility</sup> ~~the Assistant to Manager~~ and under the direction of the Training Engineer and shall meet or exceed the requirements and recommendations of Section 5.5 of ANSI N18.1-1971 and Appendix "A" of 10 CFR Part 55. <sub>Manager</sub>

6.4.2 A training program for the Fire Brigade shall be maintained under the direction of the Safety Supervisor and shall meet or exceed the requirements of Section 27 of the NFPA Code-1975, except for Fire Brigade training sessions which shall be held at least quarterly.

### 6.5 REVIEW AND AUDIT

#### 6.5.1 STATION OPERATIONS REVIEW COMMITTEE (SORC)

##### FUNCTION

6.5.1.1 The Station Operations Review Committee shall function to advise the Station Manager on all matters related to nuclear safety.

##### COMPOSITION

6.5.1.2 The Station Operations Review Committee shall be composed of the:

Chairman:	Chief Engineer
Vice Chairman:	Assistant to Manager
Member:	Station Operating Engineer
<del>Member:</del> Vice Chairman:	Station Performance Engineer
Member:	Reactor Engineer
Member:	Senior Shift Supervisor
Member:	Senior Performance Supervisor - <del>I&amp;C</del>
Member:	Senior <del>Performance</del> Supervisor - <del>Chemistry</del>
Member: Rad Protection Engineer	Senior Performance Supervisor - Rad Protection
Member:	Senior Maintenance Supervisor
<del>Member</del> Vice Chairman:	Maintenance Engineer

##### ALTERNATES

6.5.1.3 All alternate members shall be appointed in writing by the SORC Chairman to serve on a temporary basis; however, no more than two alternates shall participate as voting members in SORC activities at any one time.

## ADMINISTRATIVE CONTROLS

### MEETING FREQUENCY

6.5.1.4 The SORC shall meet at least once per calendar month and as convened by the SORC Chairman or his designated alternate.

### QUORUM

6.5.1.5 A quorum of the SORC shall consist of the Chairman or his designated alternate and four members including alternates.

### RESPONSIBILITIES

6.5.1.6 The Station Operations Review Committee shall be responsible for:

- a. Review of 1) all procedures required by Specification 6.8 and changes thereto, 2) any other proposed procedures or changes thereto as determined by the Station Manager to affect nuclear safety.
- b. Review of all proposed tests and experiments that affect nuclear safety.
- c. Review of all proposed changes to Appendix "A" Technical Specifications.
- d. Review of all proposed changes or modifications to plant systems or equipment that affect nuclear safety.
- e. Investigation of all violations of the Technical Specifications including the preparation and forwarding of reports covering evaluation and recommendations to prevent recurrence to the General Manager - ~~Electric~~ Production and to the Chairman of the Nuclear Review Board. *Nuclear*
- f. Review of events requiring 24 hour written notification to the Commission.
- g. Review of facility operations to detect potential nuclear safety hazards.
- h. Performance of special reviews, investigations or analyses and reports thereon as requested by the Chairman of the Nuclear Review Board.

## ADMINISTRATIVE CONTROLS

- i. Review of the Plant Security Plan and implementing procedures and shall submit recommended changes to the Chairman of the Nuclear Review Board.
- j. Review of the Emergency Plan and implementing procedures and shall submit recommended changes to the Chairman of the Nuclear Review Board.

## AUTHORITY

6.5.1.7 The Station Operations Review Committee shall:

- a. Recommend to the Station Manager written approval or disapproval of items considered under 6.5.1.6(a) through (d) above.
- b. Render determinations in writing with regard to whether or not each item considered under 6.5.1.6(a) through (e) above constitutes an unreviewed safety question.
- c. Provide written notification within 24 hours to the General Manager-~~Electric~~ <sup>Nuclear</sup> Production and the Nuclear Review Board of disagreement between the SORC and the Station Manager; however, the Station Manager shall have responsibility for resolution of such disagreements pursuant to 6.1.1 above.

## RECORDS

6.5.1.8 The Station Operations Review Committee shall maintain written minutes of each meeting and copies shall be provided to the General Manager-~~Electric~~ <sup>Nuclear</sup> Production and Chairman of the Nuclear Review Board.

## 6.5.2 NUCLEAR REVIEW BOARD (NRB)

### FUNCTION

6.5.2.1 The Nuclear Review Board shall function to provide independent review and audit of designated activities in the areas of:

- a. nuclear power plant operations
- b. nuclear engineering

## ADMINISTRATIVE CONTROLS

- c. chemistry and radiochemistry
- d. metallurgy
- e. instrumentation and control
- f. radiological safety
- g. mechanical and electrical engineering
- h. quality assurance practices

## COMPOSITION

6.5.2.2 The NRB shall be composed of the:

Chairman:	<del>General Manager Electric Production</del> <i>Assistant Vice President - Production</i>
Vice Chairman:	Assistant to General Manager-Fuel Supply
Member:	General Manager-Licensing and Environment
Member:	Manager-Nuclear Operations <i>Support</i>
Member:	<del>Manager-Quality Assurance</del> <i>General Manager - Corporate QA</i>
Member:	<del>Project Manager Hope Creek</del> <i>General Manager - Nuclear Production</i>
Member:	Manager-Salem Generating Station
Member:	Principal Engineer
Member:	Manager - Hope Creek Generating Station

## ALTERNATES

6.5.2.3 All alternate members shall be appointed in writing by the NRB Chairman to serve on a temporary basis; however, no more than two alternates shall participate as voting members in NRB activities at any one time.

## CONSULTANTS

6.5.2.4 Consultants shall be utilized as determined by the NRB Chairman to provide expert advice to the NRB.

## MEETING FREQUENCY

6.5.2.5 The NRB shall meet at least once per calendar quarter during the initial year of facility operation following fuel loading and at least once per six months thereafter.

## ADMINISTRATIVE CONTROLS

### RECORDS

6.5.2.10 Records of NRB activities shall be prepared, approved and distributed as indicated below:

- a. Minutes of each NRB meeting shall be prepared, approved and forwarded to the Vice President-Production within 14 days following each meeting.
- b. Reports of reviews encompassed by Section 6.5.2.7 above, shall be prepared, approved and forwarded to the Vice President-Production within 14 days following completion of the review.
- c. Audit reports encompassed by Section 6.5.2.8 above, shall be forwarded to the Vice President-Production and to the management positions responsible for the areas audited within 30 days after completion of the audit.

### 6.6 REPORTABLE OCCURRENCE ACTION

6.6.1 The following actions shall be taken for REPORTABLE OCCURRENCES:

- a. The Commission shall be notified and/or a report submitted pursuant to the requirements of Specification 6.9.
- b. Each REPORTABLE OCCURRENCE requiring 24 hour notification to the Commission shall be reviewed by the SORC and submitted to the NRB and the General Manager ~~Electric~~ Production.

*Nuclear*



## ADMINISTRATIVE CONTROLS

### 6.7 SAFETY LIMIT VIOLATION

6.7.1 The following actions shall be taken in the event a Safety Limit is violated:

- a. The facility shall be placed in at least HOT STANDBY within one hour.
- b. The Safety Limit violation shall be reported to the Commission, the General Manager-~~Electric~~ *Nuclear* Production and to the NRB within 24 hours.
- c. A Safety Limit Violation Report shall be prepared. The report shall be reviewed by the SORC. This report shall describe (1) applicable circumstances preceding the violation, (2) effects of the violation upon facility components, systems or structures, and (3) corrective action taken to prevent recurrence.
- d. The Safety Limit Violation Report shall be submitted to the Commission, the NRB and the General Manager-~~Electric~~ *Nuclear* Production within 14 days of the violation.

### 6.8 PROCEDURES

6.8.1 Written procedures shall be established, implemented and maintained covering the activities referenced below:

- a. The applicable procedures recommended in Appendix "A" of Regulatory Guide 1.33, November, 1972.
- b. Refueling operations.
- c. Surveillance and test activities of safety related equipment.
- d. Security Plan implementation.
- e. Emergency Plan implementation.
- f. Fire Protection Program implementation.

6.8.2 Each procedure and administrative policy of 6.8.1 above, and changes thereto, shall be reviewed by the SORC and approved by the Station Manager prior to implementation and reviewed periodically as set forth in administrative procedures.