



Westinghouse Electric Company
1000 Westinghouse Drive
Cranberry Township, Pennsylvania 16066
USA

U.S. Nuclear Regulatory Commission
Document Control Desk
11555 Rockville Pike
Rockville, MD 20852

Direct tel: (412) 374-5093
e-mail: harperzs@westinghouse.com

DCP_NRC_003331

March 28, 2018

Subject: Submittal of Slide Package for the April 2018 WCAP 17938 Revision 2, ACRS Full Committee (Non-Proprietary)

Enclosure 1 of this letter transmits the non-proprietary slide package for the ACRS Full Committee on Topical Report WCAP-17938 ("AP1000 In-Containment Cables and Non-Metallic Insulation Debris Integrated Assessment") Revision 2. The meeting will be held on April 5, 2018.

A handwritten signature in black ink, appearing to read 'Zachary S. Harper'.

Zachary S. Harper, Manager
AP1000 Regulatory Support, Mechanical & Structures

/Enclosures

1. APP-GW-GLY-153 Revision 0, "ACRS Full Committee on WCAP 17938 Revision," (Non-Proprietary)

cc: Donald Habib U.S. NRC

Westinghouse Non-Proprietary Class 3

ENCLOSURE 1 to DCP_NRC_003331

APP-GW-GLY-153, Revision 0
“ACRS Full Committee on WCAP 17938 Revision 2”

(Non-Proprietary)

This presentation is non-proprietary

AP1000® is a trademark or registered trademark of Westinghouse Electric Company LLC, its affiliates and/or its subsidiaries in the United States of America and may be registered in other countries throughout the world. All rights reserved. Unauthorized use is strictly prohibited. Other names may be trademarks of their respective owners.



WCAP 17938 Revision 2, ACRS Full Committee Meeting

April 5, 2018

Zachary Harper

Shayan Sinha



Background

AP1000 GSI 191 Design Bases

- **AP1000** design significantly reduces / eliminates debris sources that are typically found in Generation II plants
- Maximum allowable fibrous debris inside containment is 6.6 lbs
 - All fibrous debris is attributable to latent debris
 - There is no fibrous debris generated during a LOCA
- Metal reflective insulation (MRI) is extensively used in containment
- DCD/FSAR provides requirements that must be demonstrated if an alternative (fibrous) insulation to MRI is utilized
 - Insulation must be demonstrated to be a suitable equivalent insulation to MRI for the purposes of GSI 191
 - To qualify a suitable equivalent testing must be performed to demonstrate that debris will not be generated or transported
 - Suitable equivalent testing must be approved by the NRC



Background

WCAP 17938 Purpose

Purpose of WCAP 17938 is to obtain approval of the following:


1. Establish a zone of influence (ZOI) applicable to all **AP1000** plant in-containment cabling to demonstrate cabling will not generate LOCA debris
2. Gain approval that the non-metallic insulation (NMI) utilized in the reactor vessel insulation systems (RVIS) is a suitable equivalent to MRI for the purpose of GSI 191 as applied in **AP1000**
3. Gain approval to utilize the approved NEI 04-07 alternative methodology for defining debris generation break sizes for **AP1000**

Testing and analysis is complete to demonstrate that neither cabling nor NMI will contribute to post LOCA debris



Background WCAP 17938

- **AP1000** cabling may contain fibrous and other materials that were not considered in initial GSI 191 debris source term evaluations
 - Corrective actions included development of a test program to establish a ZOI for in-containment cabling
- NMI is required in RVIS because subcomponents of the RVIS perform functions in addition to insulation (such as shielding and in-vessel retention support)

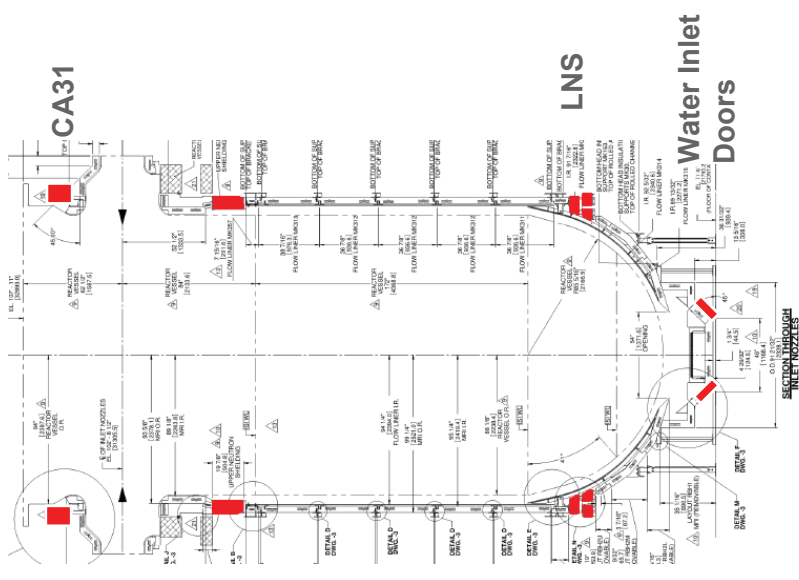

Summary of Results

- Extensive large scale jet impingement testing established a ZOI for in-containment cables of 4 L/D
 - Cabling ZOI design requirements were incorporated into the detailed design in advance of any cable or tray installation
- WCAP invokes the alternate evaluation methodology provided in NEI 04-07 to determine a limiting RCS break size in debris generation evaluation for certain **AP1000** components
- Insights from NMI jet impingement and submergence testing resulted in strengthening design for elements of the RVIS
 - Design was changed to use thicker and more robust encapsulation



WCAP justifies no new debris generation for AP1000 from cabling or NMI

Conclusions



Conclusions

- A ZOI radius of 4 IDs is applicable to the AP1000 in-containment cables bounded by testing and analysis
- Application of NEI 04-07 alternative break methodology is acceptable for **AP1000**
- Cabling does not contribute to **AP1000** post LOCA debris limits
- Encapsulated NMI applications utilized within the AP1000 RVIS will not produce debris when subjected to jet impingement from limiting line breaks
- Neither cabling nor NMI within the RVIS contribute to GSI 191 chemical debris limits
- NMI utilized as part of the RVIS is a suitable equivalent to MRI for the locations bounded by testing and analysis (for the purpose of GSI 191)



WCAP justifies no new debris generation for AP1000 from cabling or NMI