



Tennessee Valley Authority, Post Office Box 2000, Spring City, Tennessee 37381-2000

April 30, 2018

10 CFR 50.36a(a)(2)  
10 CFR 72.104(a)

U.S. Nuclear Regulatory Commission  
ATTN: Document Control Desk  
Washington, D.C. 20555-0001

Watts Bar Nuclear Plant, Unit 1 and Unit 2  
Facility Operating License Nos. NPF-90 and NPF-96  
NRC Docket Nos. 50-390, 50-391, and 72-1048

**Subject: Watts Bar Nuclear Plant 2017 Annual Radioactive Effluent Release Report**

The purpose of this letter is to provide the Tennessee Valley Authority (TVA) Watts Bar Nuclear Plant (WBN) Annual Radioactive Effluent Release Report (ARERR) for the period of January 1, 2017 to December 31, 2017. The enclosed annual report is being submitted to the Nuclear Regulatory Commission (NRC) in accordance with Title 10 of the *Code of Federal Regulations* (10 CFR) 50.36a and the Watts Bar Nuclear Plant (WBN), Unit 1 and Unit 2, Technical Specification (TS) 5.9.3, that requires the ARERR be submitted prior to May 1st of each year.


The enclosure provides the required effluent release data. This report includes information related to the Independent Spent Fuel Storage Installation (ISFSI) which went into service for the first time at WBN in October of 2016. Attachment 1 to the enclosure documents any deviations which have occurred from Offsite Dose Calculation Manual (ODCM) requirements. Attachment 2 addresses any radioactive effluent monitoring instrumentation which was inoperable for greater than 30 days. Attachment 3 of the enclosure provides corrections to previous annual reports. Attachment 4 of the enclosure provides a copy of Revision 1 the Two-Unit ODCM. This revision was in effect as of October 22, 2015, and is provided in accordance with Technical Specification 5.7.2.3.

Changes to the Process Control Program (PCP) are reported in conjunction with the ARERR in accordance with Section 2.4 of the PCP. No changes have been made to the PCP since the last annual report.

U.S. Nuclear Regulatory Commission  
Page 2  
April 30, 2018

There are no new regulatory commitments associated with this letter. Please direct any questions concerning this matter to Kim Hulvey, WBN Licensing Manager at (423) 365-7720.

Respectfully,

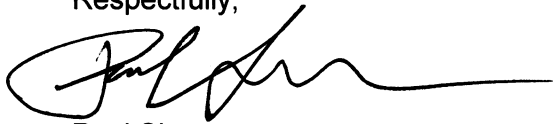A handwritten signature in black ink, appearing to read 'Paul Simmons', with a long horizontal flourish extending to the right.

Paul Simmons  
Site Vice President, Watts Bar Nuclear Plant

Enclosure: Watts Bar Nuclear Plant - 2017 Annual Radioactive Effluent Release  
Report

cc (Enclosure):

U.S. Nuclear Regulatory Commission, Region II  
NRC Senior Resident Inspector - Watts Bar Nuclear Plant  
NRC Project Manager - Watts Bar Nuclear Plant,

Enclosure

Watts Bar Nuclear Plant

2017 Annual Radioactive Effluent Release Report  
(Effluent and Waste Disposal Annual Report)

Attachments

Attachment 1 – Deviations from ODCM Controls / Surveillance Requirements

Attachment 2 – Radioactive Effluent Monitoring Instrumentation Inoperable for  
Greater than 30 days

Attachment 3 – Corrections to Previous ARERRs Revision

Attachment 4 – Two-Unit Offsite Dose Calculation Manual Revision 1

Enclosure

Watts Bar Nuclear Plant

Annual Radioactive Effluent Release Report - 2017

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

**1. Regulatory Limits**

**A. Gaseous Effluents**

1. Dose rates due to radioactivity released in gaseous effluents from the site to areas at and beyond the unrestricted area boundary shall be limited to the following:
  - a. Noble gases:
    - Less than or equal to 500 mrem/year to the total body.
    - Less than or equal to 3000 mrem/year to the skin.
  - b. Iodine-131, iodine-133, tritium, and all radionuclides in particulate form with half-lives greater than 8 days:
    - Less than or equal to 1500 mrem/year to any organ.
2. Air dose due to noble gases released in gaseous effluents to areas at and beyond the unrestricted area boundary shall be limited to the following:
  - a. Less than or equal to 5 mrad for gamma radiation and less than or equal to 10 mrad for beta radiation during any calendar quarter.
  - b. Less than or equal to 10 mrad for gamma radiation and less than or equal to 20 mrad for beta radiation during any calendar year.
3. Dose to a member of the public from iodine-131, iodine-133, tritium, and all radionuclides in particulate form with half-lives greater than eight days in gaseous effluents released to areas at and beyond the unrestricted area boundary shall be limited to the following:
  - a. Less than or equal to 7.5 mrem to any organ during any calendar quarter.
  - b. Less than or equal to 15 mrem to any organ during any calendar year.

**B. Liquid Effluents**

1. The concentration of radioactivity released in liquid effluents to unrestricted areas shall be limited to 10 times the concentrations specified in Title 10 of the Code of Federal Regulations, Part 20 (Standards for Protection against Radiation), Appendix B, Table 2, Column 2, for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the concentration shall be limited to 2.0 E-04  $\mu\text{Ci/ml}$  total activity.
2. The dose or dose commitment to a member of the public from radioactivity in liquid effluents released to unrestricted areas shall be limited to:
  - a. Less than or equal to 1.5 mrem to the total body and less than or equal to 5 mrem to any organ during any calendar quarter.
  - b. Less than or equal to 3 mrem to the total body and less than or equal to 10 mrem to any organ during any calendar year.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

**2. Effluent Concentration Limits**

**A. Liquids**

The Effluent Concentration Limits (ECL) for liquids are those listed in 10 CFR 20, Appendix B, Table 2, Column 2. For dissolved and entrained gases the ECL of  $2.0\text{E-}04 \mu\text{Ci/ml}$  is applied. This ECL is based on the Xe-135 concentration in air (submersion dose) converted to an equivalent concentration in water as discussed in the International Commission on Radiological Protection (ICRP), Publication 2.

**B. Gaseous**

Concentration limits for gaseous releases are met through compliance with the maximum permissible dose rates for gaseous releases as defined in plant Offsite Dose Calculation Manual (ODCM) and presented in Section 1.A.1 of this report.

**3. Average Energy**

Watts Bar Nuclear Plant's (WBN) ODCM limits the dose equivalent rates due to the release of noble gases to less than or equal to 500 mrem/year to the total body and less than or equal to 3000 mrem/year to the skin. Therefore, the average beta and gamma energies (E) for gaseous effluents as described in Regulatory Guide 1.21 Revision 1, "Measuring, Evaluation, and Reporting Radioactivity in Solid Wastes and Releases of Radioactive Materials in Liquid and Gaseous Effluents from Light-Water-Cooled Nuclear Power Plants," are not applicable.

**4. Measurements and Approximations of Total Radioactivity**

Radioactivity measurements performed in support of the WBN ODCM meet the Lower Limit of Detection requirements given in ODCM Tables 2.2-1 and 2.2-2.

**A. Liquid Effluents**

**Batch** (Radwaste and Condensate Demineralizer tanks)

Total gamma isotopic and tritium concentrations are determined on each Radwaste batch tank prior to release. The total activity of a batch release is obtained by determining the concentration of each nuclide and then multiplying by the volume discharged to arrive at the curie activity for each nuclide. The curies of each nuclide are then summed. Composite samples are maintained and analyzed monthly for gross alpha and quarterly for iron-55, strontium-89, and strontium-90. During periods of no significant identified primary to secondary leakage, composite samples are not maintained for batch releases from the Condensate Demineralizer Tank releases. During periods of no significant identified primary to secondary leakage or when the Condensate Demineralizer Tanks are discharged to the Turbine Building Station Sump, the feedwater tritium concentrations are used to determine the curies of tritium released from Condensate Demineralizer Tank.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

**Continuous Releases** (Turbine Building Station Sump (TBSS), Steam Generator Blowdowns (SGB), and Groundwater Sump (GWS))

During periods of no significant identified primary to secondary leakage, the volume released from the TBSS and SGB's are obtained. The TBSS tritium concentration is determined via weekly grab samples. The feedwater tritium concentrations are used to determine the curies of tritium released from SGB's. The GWS is sampled monthly and analyzed for gross gamma and tritium on a monthly basis and for Sr-89, Sr-90 and Ni-63 on a quarterly basis. The total activity released is obtained by determining the concentration of each nuclide and then multiplying by the volume discharged to arrive at the curie activity for each nuclide.

**Monitoring Wells**

Watts Bar has six (6) radiological environmental monitoring program (REMP) on-site groundwater monitoring wells and also 23 non-REMP monitoring wells to support monitoring the onsite groundwater plume for the presence or increase of radioactivity. WBN contracts ARCADIS to perform investigations of the impact tritium has on groundwater and to perform site characterizations, area of impact, and preliminary human health and ecological risk screening.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

**Monitoring Wells (Continued)**

The non-REMP monitoring wells are sampled at least semi-annually for gamma and tritium. These wells continue to exhibit a stable trend and a historical average decreasing with time. The tritium concentrations obtained in 2017 from these monitoring wells are listed below. Four new wells MW-11i, MW-11s, MW-12, and MW-13 were installed September 2017 and sampled during December 2017. More frequent sampling was performed to establish baseline conditions. Well K sample was also analyzed for Sr-89, Sr-90, Fe-55, and Ni-63, with no detectable results.

	4/4/2017	6/13/2017	9/13/2017	12/20/2017		
Well ID	Activity pCi/L	Activity pCi/L	Activity pCi/L	Activity pCi/L		
D	<218	N/A	<309	N/A		
E	<218	<234	<317	Dry		
G	<218	<227	<316	<252		
I	<218	N/A	494	N/A		
J	257	<222	513	412		
K	3617	3080	3110	4990		
L	720	739	727	538		
M	<221	<226	<302	<254		
O	300	N/A	250	N/A		
P	356	<222	<317	<253		
Q	<221	N/A	<296	N/A		
R	594	751	399	<250		
S	285	N/A	<314	N/A		
V	<221	<229	<307	<239		
MW-06	<218	<228	<315	<259		
MW-07	285	<228	<309	<235		
MW-08	<218	<223	<307	<252		
MW-10	236	<231	<311	<250		
MW-11i				<251		
MW-11s				<249		
MW-12				<248		
MW-13				<255		
	4/4/2017	6/13/2017	9/13/2017	10/26/17	11/19/17	12/20/2017
	Activity pCi/L	Activity pCi/L	Activity pCi/L	Activity pCi/L	Activity pCi/L	Activity pCi/L
MW-09	1516	754	650	1171	1009	1110

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

### Doses from I-131 Water Ingestion Pathway

The REMP specified in Table 3.12-1 from NUREG 1301, "Offsite Dose Calculation Manual Guidance: Standard Radiological Effluent Controls for Pressurized Water Reactors," April 1991, requires an I-131 specific analysis for drinking water pathway samples if the annual dose from I-131 is greater than 1 mrem. To evaluate the need for implementation of this additional analysis, the drinking water pathway dose from I-131 to the maximum organ and age group was evaluated.

Therefore, the evaluation confirms that the drinking water pathway dose from I-131 was less than the 1 mrem limit and that the performance of the I-131 specific analysis is not required for WBN REMP drinking water samples.

### Doses from I-131 Water Ingestion Pathway (Continued)

Quarter	1	2	3	4	Totals
I-131 Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Child/Thyroid (mrem)	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Population/Thyroid (mrem)	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00

## B. Gaseous Effluents

### Fission and Activation Gases

Airborne effluent gaseous activity is continuously monitored and recorded. Weekly grab samples from the Auxiliary Building and monthly grab samples from the Service Building are taken and analyzed to determine the quantity of noble gas activity released based on the total flows for the sample period. Also, noble gas samples are collected and evaluated following startup, shutdown, or rated thermal power change exceeding 15 percent within one hour. Sampling is only required if dose equivalent I-131 concentration in the primary coolant or if the noble gas activity monitor indicates that the containment activity has increased more than a factor of three.

The concentration of noble gases released through the Shield Building Exhausts due to purging containment is determined by using the purge monitor response in combination with containment air samples obtained prior to each purge. The quantity of activity released during the purge is determined using the duration, flowrate, and concentration of noble gases for each purge. Also, noble gas samples are collected and evaluated for ongoing containment purges following startup, shutdown, or rated thermal power change exceeding 15 percent within one hour. Sampling is only required if DEI concentration in the primary coolant or if the noble gas activity monitor shows that the containment activity has increased more than a factor of three.

The quantity of noble gases released through the Shield Building Exhausts due to the batch release of waste gas decay tanks are determined by sampling each tank prior to release. Total activity released is determined from total pressure change recorded of tank during the release.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

### **Iodines and Particulates in Gaseous Releases**

Iodine and particulate activity are continuously sampled. Weekly charcoal and particulate samples are taken from the Shield Building Exhausts and Auxiliary Building Exhaust and from the Condenser Vacuum Exhausts during periods of primary to secondary leakage. These samples are analyzed at least weekly to determine the total activity released from the plant based on the total vent flows recorded for the sampling period. Also, when a primary to secondary leak exists, particulate and charcoal samples are taken from the Shield Building Exhausts, Auxiliary Building Exhaust, and Condenser Vacuum Exhausts once per 24 hours for 7 days following startup, shutdown, or a rated thermal power change exceeding 15 percent within one hour if dose equivalent I-131 concentration in the primary coolant or the noble gas activity monitor shows that the containment activity has increased more than a factor of three.

### **Carbon-14 in Gaseous Releases**

The Carbon-14 production and effluent source term estimates were based on EPRI methodology provided in EPRI Report 1021106, "Estimation of Carbon-14 in Nuclear Power Plant Gaseous Effluents," dated December 2010. It was determined in 2017 that 14.6 curies of Carbon-14 was generated at WBN. However, only 98% is considered released as gas and only the carbon dioxide form (20%) of that is used in the gaseous dose calculations.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

**5. Batch Releases**

	Value		Units
	1st Half	2nd Half	
A. Liquid (Radwaste only)			
1. Number of releases	86	75	Each
2. Total time period of releases	17140	14270	Minutes
3. Maximum time period of release	500	365	Minutes
4. Average time period of releases	199	190	Minutes
5. Minimum time period for release	90	28	Minutes
6. Average dilution stream flow during release periods	27,237	23,945	CFS
B. Gaseous (Batches only - containment purges, and waste gas decay tanks)			
1. Number of releases	44	44	Each
2. Total time period of releases	85400	140666	Minutes
3. Maximum time period for release	24400	50800	Minutes
4. Average time period for releases	1941	3197	Minutes
5. Minimum time period for release	15	11	Minutes

**6. Abnormal Releases**

	Value		Units
	1st Half	2nd Half	
A. Liquid			
Number of Releases	0	0	
Total Activity Released	0.00E+00	0.00E+00	Ci
B. Gaseous			
Number of Releases	3*	4*	
Total Activity Released	1.10E-03	7.68E-04	Ci

\* Steam Generator PORV releases

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

**Release Type:** Gaseous (Steam)

**Release Point:** Unit 1 Steam Generator PORV's

**Date(s) of Release:** 03/18/2017 through 05/08/2017

This evaluation is for the release to the environment that occurred from the Unit 1 Steam Generator PORVs from the scheduled refuel outage and two unplanned manual trips. The PORV valves were opened and closed during periods of time.

3/18/17-4/30/17 was a planned manual shutdown for Refueling Outage from End of Cycle 14.

5/2/17-5/4/17 was an unplanned manual trip from RCP#3 breaker transfer.

5/4/17-5/8/17 was an unplanned manual trip from RCP#3 breaker transfer, loss of RCP.

The following is data used to show no dose impact of the release:

- While all the PORVs were not open continuously during this period, the evaluation assumed the release was continuous from all four PORVs.
- There have been no gamma emitting radionuclides identified in any Secondary Coolant samples.
- The feedwater tritium results obtained on 03/13/2017 indicated a tritium concentration of  $1.20\text{E-}06 \mu\text{Ci/ml}$ . This tritium concentration is assumed to have been the initial concentration with no additional tritium introduced into the steam generator(s) during the release period. All of the tritium initially present in the steam generator(s) was assumed to have been released through the PORVs during the date range listed above.

The volume of each steam generator was taken from Westinghouse Guidelines for Secondary Water Chemistry. The listed normal water level value of 4750 ft<sup>3</sup> was used as a conservative value. This calculation conservatively assumes that the total volume of all four generators was released and that all the tritium present in that initial volume was released. The calculation for the total tritium activity released is as follows:

$$\begin{aligned} 4750 \text{ ft}^3/\text{generator} * 2.832\text{E}+04 \text{ ml/ft}^3 * 4 \text{ generators} &= 5.38\text{E}+08 \text{ ml} \\ 1.20\text{E-}06 \mu\text{Ci/ml} * 5.38\text{E}+08 \text{ ml} &= 6.46\text{E}+02 \mu\text{Ci of H3 or } 6.46\text{E-}04 \text{ Ci of H3} \end{aligned}$$

The activity of  $6.46\text{E-}04$  curies was added to the 1st - 2nd Quarter Tables 4-A and 4-B, "Curies Released in Gaseous Ground Level Releases," and the 1st - 2nd Quarter doses in Table 6-A, "Doses from Airborne Effluents." The addition of the  $6.46\text{E-}04$  curies of tritium did not have any impact on changing the dose values for the 1st and 2nd quarters of 2017.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

**Unit 1 Steam Generator PORVs**  
03/18/2017 through 05/08/2017

**Individual Doses**

**First Quarter**

Pathway	Dose	Quarterly Limit	Percent of Limit	Location
<b>External</b>				
Gamma Air	0.00E+00 mrad	5 mrad	< 1%	N/1550 meters
Beta Air	0.00E+00 mrad	10 mrad	< 1%	N/1550 meters
<b>Submersion</b>				
Total Body	0.00E+00 mrad	N/A	N/A	N/4474 meters
Skin	0.00E+00 mrad	N/A	N/A	N/4474 meters
<b>Organ Doses</b>				
Child/Thyroid	6.10E-07 mrem	7.5 mrem	< 1%	SE/1409 meters
Child/Total Body	6.10E-07 mrem	7.5 mrem	< 1%	SE/1409 meters

**Population Doses**

Total Body Dose 2.98E-06 man-rem  
Maximum Organ Dose (Organ) 2.98E-06 man-rem (Thyroid, Liver, Bone, GIT, Lung, Kidney)

**Individual Doses**

**Second Quarter**

Pathway	Dose	Quarterly Limit	Percent of Limit	Location
<b>External</b>				
Gamma Air	0.00E+00 mrad	5 mrad	< 1%	N/1550 meters
Beta Air	0.00E+00 mrad	10 mrad	< 1%	N/1550 meters
<b>Submersion</b>				
Total Body	0.00E+00 mrad	N/A	N/A	N/4474 meters
Skin	0.00E+00 mrad	N/A	N/A	N/4474 meters
<b>Organ Doses</b>				
Child/Thyroid	8.29E-07 mrem	7.5 mrem	< 1%	SE/1409 meters
Child/Total Body	8.29E-07 mrem	7.5 mrem	< 1%	SE/1409 meters

**Population Doses**

Total Body Dose 3.62E-06 man-rem  
Maximum Organ Dose (Organ) 3.62E-06 man-rem (Thyroid, Liver, Bone, GIT, Lung, Kidney)

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

## UNPLANNED RELEASES

**Release Type:** Gaseous (Steam)

**Release Point:** Unit 2 Steam Generator PORV's

**Date(s) of Release:** 03/20/2017 through 12/5/2017

This evaluation is for the release to the environment that occurred from the Unit 2 Steam Generator PORV's after two unplanned manual trips, a manual shutdown to Mode 3, and a scheduled refuel outage. Dates are listed as follows:

3/20/17-3/22/17 was an unplanned manual trip for loss of Steam Generator levels. CR 1274595.  
3/23/17-7/23/17 was an unplanned manual trip from loss of Condenser Vacuum. CR 1275870.  
7/23/17-7/30/17 was a manual shutdown to Mode 3 loss of both Main Feed Pumps.  
10/28/17-12/05/17 was a planned manual shutdown for Refueling Outage from End of Cycle 1.

The following is data used to determine the curies and dose impacts as a result of the release:

- There have been no gamma emitting radionuclides identified in any Secondary Coolant samples.
- The averaged feedwater tritium results obtained from July 20-October 3 indicated a tritium concentration of  $9.38\text{E-}07$  &  $6.58\text{E-}07$   $\mu\text{Ci/ml}$ . There were no previous Unit 2 feedwater tritiums above detection limits prior to July. This tritium concentration is assumed to have been the initial concentration with no additional tritium introduced into the steam generator(s) during the release period. All of the tritium initially present in the steam generator(s) was assumed to have been released through the PORVs during the date range listed above.
- The steam generator results and feedwater result prior to 7/23/17-7/30/17 shutdown were all < LLD.

The volume of a steam generator was taken from Westinghouse Guidelines for Secondary Water Chemistry. The listed normal water level value of  $4250\text{ ft}^3$  was used as a conservative value. This calculation conservatively assumes that the total volume of four steam generators was released and that all the tritium present in that initial volume was released. The calculation for the total tritium activity released is as follows:

$$4250\text{ ft}^3/\text{generator} * 2.832\text{E+}04\text{ ml/ft}^3 * 4\text{ generators} = 4.81\text{E+}08\text{ ml}$$

$$9.38\text{E-}07\text{ }\mu\text{Ci/ml} * 4.81\text{E+}08\text{ ml} = 4.51\text{E+}02\text{ }\mu\text{Ci of H3 or }4.51\text{E-}04\text{ Ci of H3 for 1st -3rd Qtr.}$$

$$6.58\text{E-}07\text{ }\mu\text{Ci/ml} * 4.81\text{E+}08\text{ ml} = 3.17\text{E+}02\text{ }\mu\text{Ci of H3 or }3.17\text{E-}04\text{ Ci of H3 for 4th Qtr.}$$

The activities of  $4.51\text{E-}04$  and  $3.17\text{E-}04$  curies were added to 1st - 3rd, and 4th Quarter Tables 4A through 4-D, "Curies Released in Gaseous Ground Level Releases," and the 1st - 4th Quarter doses in Tables 6-A and 6-B, "Doses from Airborne Effluents." The addition of the total curies of tritium did not have any impact on changing the dose values for the 1st, 2nd, 3rd, or 4th quarters of 2017.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

**Unit 2 Steam Generator PORVs**  
03/20/2017 through 7/1/2017

**Individual Doses**

**First Quarter**

Pathway	Dose	Quarterly Limit	Percent of Limit	Location
<b>External</b>				
Gamma Air	0.00E+00 mrad	5 mrad	< 1%	N/1550 meters
Beta Air	0.00E+00 mrad	10 mrad	< 1%	N/1550 meters
<b>Submersion</b>				
Total Body	0.00E+00 mrad	N/A	N/A	N/4474 meters
Skin	0.00E+00 mrad	N/A	N/A	N/4474 meters
<b>Organ Doses</b>				
Child/Thyroid	4.26E-07 mrem	7.5 mrem	< 1%	SE/1409 meters
Child/Total Body	4.26E-07 mrem	7.5 mrem	< 1%	SE/1409 meters

**Population Doses**

Total Body Dose 2.08E-06 man-rem  
Maximum Organ Dose (Organ) 2.08E-06 man-rem (Thyroid, Liver, Bone, GIT, Lung, Kidney)

**Individual Doses**

**Second Quarter**

Pathway	Dose	Quarterly Limit	Percent of Limit	Location
<b>External</b>				
Gamma Air	0.00E+00 mrad	5 mrad	< 1%	N/1550 meters
Beta Air	0.00E+00 mrad	10 mrad	< 1%	N/1550 meters
<b>Submersion</b>				
Total Body	0.00E+00 mrad	N/A	N/A	N/4474 meters
Skin	0.00E+00 mrad	N/A	N/A	N/4474 meters
<b>Organ Doses</b>				
Child/Thyroid	5.79E-07 mrem	7.5 mrem	< 1%	SE/1409 meters
Child/Total Body	5.79E-07 mrem	7.5 mrem	< 1%	SE/1409 meters

**Population Doses**

Total Body Dose 2.53E-06 man-rem  
Maximum Organ Dose (Organ) 2.53E-06 man-rem (Thyroid, Liver, Bone, GIT, Lung, Kidney)

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

**Unit 2 Steam Generator PORVs**

7/01/17 through 7/23/17 &

10/28/17 through 12/05/17

**Individual Doses**

**Third Quarter**

Pathway	Dose	Quarterly Limit	Percent of Limit	Location
<b>External</b>				
Gamma Air	0.00E+00 mrad	5 mrad	< 1%	N/1550 meters
Beta Air	0.00E+00 mrad	10 mrad	< 1%	N/1550 meters
<b>Submersion</b>				
Total Body	0.00E+00 mrad	N/A	N/A	N/4474 meters
Skin	0.00E+00 mrad	N/A	N/A	N/4474 meters
<b>Organ Doses</b>				
Child/Thyroid	6.09E-07 mrem	7.5 mrem	< 1%	ENE/3072 meters
Child/Total Body	6.09E-07 mrem	7.5 mrem	< 1%	ENE/3072 meters

**Population Doses**

Total Body Dose 2.74E-06 man-rem

Maximum Organ Dose (Organ) 2.74E-06 man-rem (Thyroid, Liver, Bone, GIT, Lung, Kidney)

**Individual Doses**

**Fourth Quarter**

Pathway	Dose	Quarterly Limit	Percent of Limit	Location
<b>External</b>				
Gamma Air	0.00E+00 mrad	5 mrad	< 1%	N/1550 meters
Beta Air	0.00E+00 mrad	10 mrad	< 1%	N/1550 meters
<b>Submersion</b>				
Total Body	0.00E+00 mrad	N/A	N/A	N/4474 meters
Skin	0.00E+00 mrad	N/A	N/A	N/4474 meters
<b>Organ Doses</b>				
Child/Thyroid	4.40E-07 mrem	7.5 mrem	< 1%	SE/1409 meters
Child/Total Body	4.40E-07 mrem	7.5 mrem	< 1%	SE/1409 meters

**Population Doses**

Total Body Dose 1.70E-06 man-rem

Maximum Organ Dose (Organ) 1.70E-06 man-rem (Thyroid, Liver, Bone, GIT, Lung, Kidney)

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

TABLE 1-A  
Liquid Effluents - Summation of All Releases  
During the period  
Starting: 1-Jan-2017 Ending: 30-Jun-2017

Type Of Effluent	Units	Quarter 1	Quarter 2	Est. Tot Error %
<b>A. Fission &amp; Activation Products</b>				
1. Total Release (Not Including Tritium, Gases, Alpha)	Ci	4.80E-03	1.11E-02	25%
2. Average Diluted Concentration During Period	μCi/ml	8.53E-14	6.53E-09	
3. Percent Of Applicable Limit	%	*	*	
<b>B. Tritium</b>				
1. Total Release	Ci	1.39E+03	3.46E+02	18%
2. Average Diluted Concentration During Period	μCi/ml	2.46E-08	2.03E-04	
3. Percent Of Applicable Limit	%	*	*	
<b>C. Dissolved And Entrained Gases</b>				
1. Total Release	Ci	3.11E-03	2.06E-04	39%
2. Average Diluted Concentration During Period	μCi/ml	5.52E-14	1.21E-10	
3. Percent Of Applicable Limit	%	2.76E-08	6.05E-05	
<b>D. Gross Alpha Radioactivity</b>				
1. Total Release	Curies	0.000E+00	0.000E+00	N/A**
<b>E. Total Waste Volume Released (Pre-Dilution)</b>				
	Liters	4.52E+08	1.24E+08	2%
<b>F. Volume Of Dilution Water Used</b>				
	Liters	5.63E+13	1.70E+09	12%
<b>G. Radwaste Volume Released</b>				
	Liters	1.59E+06	1.95E+06	12%

Zeroes in this table indicate that no radioactivity was present at detectable levels.

\* Applicable limits are expressed in terms of dose. See Table 7-A of this report.

\*\* N/A - Errors in measurements are not reported for these values since none were identified during the reporting period.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

TABLE 1-B

Liquid Effluents - Summation of All Releases  
During the period  
Starting: 1-Jul-2017 Ending: 31-Dec-2017

Type Of Effluent	Units	Quarter 3	Quarter 4	Est. Tot Error %
<b>A. Fission &amp; Activation Products</b>				
1. Total Release (Not Including Tritium, Gases, Alpha)	Ci	4.44E-03	4.90E-03	25%
2. Average Diluted Concentration During Period	μCi/ml	6.47E-10	3.24E-10	
3. Percent Of Applicable Limit	%	*	*	
<b>B. Tritium</b>				
1. Total Release	Ci	1.61E+02	2.47E+02	18%
2. Average Diluted Concentration During Period	μCi/ml	2.35E-05	1.63E-05	
3. Percent Of Applicable Limit	%	*	*	
<b>C. Dissolved And Entrained Gases</b>				
1. Total Release	Ci	6.32E-05	6.02E-04	39%
2. Average Diluted Concentration During Period	μCi/ml	9.20E-12	3.99E-11	
3. Percent Of Applicable Limit	%	4.60E-06	2.00E-05	
<b>D. Gross Alpha Radioactivity</b>				
1. Total Release	Ci	0.00E+00	0.00E+00	N/A**
<b>E. Total Waste Volume Released (Pre-Dilution)</b>				
	Liters	3.13E+07	7.93E+07	2%
<b>F. Volume Of Dilution Water Used</b>				
	Liters	6.87E+09	1.51E+10	12%
<b>G. Radwaste Volume Released</b>				
	Liters	1.63E+06	1.52E+06	12%

Zeroes in this table indicate that no radioactivity was present at detectable levels.

\* Applicable limits are expressed in terms of dose. See Table 7-B of this report.

\*\* N/A - Errors in measurements are not reported for these values since none were identified during the reporting period.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

TABLE 2-A

Curies Released in Liquid Effluents  
During the period  
Starting: 1-Jan-2017 Ending: 31-Mar-2017

	<b>CONTINUOUS</b>	<b>BATCH</b>	<b>TOTAL</b>
<b>H-3</b>	8.54E-01	1.39E+03	1.39E+03
<b>FISSION &amp; ACTIVATION PRODUCTS</b>			
Cr-51	0.00E+00	1.08E-04	1.08E-04
Mn-54	0.00E+00	3.86E-05	3.86E-05
Fe-55	0.00E+00	1.36E-03	1.36E-03
Fe-59	0.00E+00	6.83E-06	6.83E-06
Co-57	0.00E+00	7.44E-07	7.44E-07
Co-58	0.00E+00	1.99E-03	1.99E-03
Co-60	0.00E+00	7.40E-04	7.40E-04
Zn-65	0.00E+00	6.16E-06	6.16E-06
Zn-69m	0.00E+00	9.60E-06	9.60E-06
Zr-95	0.00E+00	3.19E-05	3.19E-05
Nb-95	0.00E+00	2.11E-05	2.11E-05
Ag-110m	0.00E+00	2.18E-06	2.18E-06
Sn-113	0.00E+00	1.56E-05	1.56E-05
Sb-125	0.00E+00	4.19E-04	4.19E-04
Cs-137	0.00E+00	4.76E-05	4.76E-05
W-187	0.00E+00	8.32E-06	8.32E-06
<b>TOTALS</b>	0.00E+00	4.80E-03	4.80E-03
<b>DISSOLVED AND ENTRAINED GASES</b>			
XE-133	0.00E+00	3.08E-03	3.08E-03
XE-135	0.00E+00	3.31E-05	3.31E-05
<b>TOTALS</b>	0.00E+00	3.11E-03	3.11E-03

Zeroes in this table indicate that no radioactivity was present at detectable levels.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

TABLE 2-B

Curies Released in Liquid Effluents  
During the period  
Starting: 1-Apr-2017 Ending: 30-Jun-2017

	<b>CONTINUOUS</b>	<b>BATCH</b>	<b>TOTAL</b>
<b>H-3</b>	1.91E-01	3.45E+02	3.45E+02
<b>FISSION &amp; ACTIVATION PRODUCTS</b>			
Cr-51	0.00E+00	7.55E-04	7.55E-04
Mn-54	0.00E+00	1.76E-05	1.76E-05
Fe-59	0.00E+00	3.88E-06	3.88E-06
Co-57	0.00E+00	1.87E-06	1.87E-06
Co-58	0.00E+00	6.29E-03	6.29E-03
Co-60	0.00E+00	6.95E-04	6.95E-04
Ni-63	0.00E+00	3.12E-03	3.12E-03
Zn-65	0.00E+00	1.45E-05	1.45E-05
Zr-95	0.00E+00	7.48E-05	7.48E-05
Zr-97	0.00E+00	2.76E-06	2.76E-06
Nb-95	0.00E+00	1.17E-04	1.17E-04
Nb-97	0.00E+00	1.20E-06	1.20E-06
Ag-110m	0.00E+00	1.98E-06	1.98E-06
Sn-113	0.00E+00	6.30E-06	6.30E-06
Cs-134	0.00E+00	1.37E-06	1.37E-06
W-187	0.00E+00	8.00E-06	8.00E-06
<b>TOTALS</b>	0.00E+00	1.11E-02	1.11E-02
<b>DISSOLVED AND ENTRAINED GASES</b>			
XE-133	0.00E+00	2.06E-04	2.06E-04
<b>TOTALS</b>	0.00E+00	2.06E-04	2.06E-04

Zeroes in this table indicate that no radioactivity was present at detectable levels.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

TABLE 2-C

Curies Released in Liquid Effluents  
During the period  
Starting: 1-Jul-2017 Ending: 30-Sep-2017

	<b>CONTINUOUS</b>	<b>BATCH</b>	<b>TOTAL</b>
<b>H-3</b>	2.28E-02	1.61E+02	1.61E+02
<b>FISSION &amp; ACTIVATION PRODUCTS</b>			
Cr-51	0.00E+00	3.86E-05	3.86E-05
Mn-54	0.00E+00	6.50E-05	6.50E-05
Fe-55	0.00E+00	8.22E-04	8.22E-04
Fe-59	0.00E+00	5.13E-05	5.13E-05
Co-58	0.00E+00	2.02E-03	2.02E-03
Co-60	0.00E+00	6.94E-04	6.94E-04
Ni-63	0.00E+00	3.92E-04	3.92E-04
Zn-65	0.00E+00	4.72E-06	4.72E-06
Zn-69m	0.00E+00	1.20E-06	1.20E-06
Zr-95	0.00E+00	6.22E-05	6.22E-05
Zr-97	0.00E+00	1.84E-06	1.84E-06
Nb-95	0.00E+00	9.40E-05	9.40E-05
Ag-110m	0.00E+00	2.47E-06	2.47E-06
Sn-113	0.00E+00	1.48E-05	1.48E-05
Sb-125	0.00E+00	1.72E-04	1.72E-04
I-133	0.00E+00	1.40E-06	1.40E-06
<b>TOTALS</b>	0.00E+00	4.44E-03	4.44E-03
<b>DISSOLVED AND ENTRAINED GASES</b>			
Kr-87	0.00E+00	4.17E-06	4.17E-06
XE-133	0.00E+00	5.90E-05	5.90E-05
<b>TOTALS</b>	0.00E+00	6.32E-05	6.32E-05

Zeroes in this table indicate that no radioactivity was present at detectable levels.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

TABLE 2-D

Curies Released in Liquid Effluents  
During the period  
Starting: 1-Oct-2017 Ending: 31-Dec-2017

	<b>CONTINUOUS</b>	<b>BATCH</b>	<b>TOTAL</b>
<b>H-3</b>	1.11E-01	2.47E+02	2.47E+02
<b>FISSION &amp; ACTIVATION PRODUCTS</b>			
Cr-51	0.00E+00	1.22E-04	1.22E-04
Mn-54	0.00E+00	2.24E-05	2.24E-05
Fe-55	0.00E+00	1.37E-03	1.37E-03
Co-57	0.00E+00	2.49E-06	2.49E-06
Co-58	0.00E+00	2.36E-03	2.36E-03
Co-60	0.00E+00	3.20E-04	3.20E-04
Ni-63	0.00E+00	6.55E-04	6.55E-04
Zr-95	0.00E+00	1.10E-05	1.10E-05
Nb-95	0.00E+00	1.12E-05	1.12E-05
Sn-113	0.00E+00	1.52E-06	1.52E-06
Sb-124	0.00E+00	2.28E-06	2.28E-06
Sb-125	0.00E+00	2.45E-05	2.45E-05
W-187	0.00E+00	3.13E-06	3.13E-06
<b>TOTALS</b>	0.00E+00	4.90E-03	4.90E-03
<b>DISSOLVED AND ENTRAINED GASES</b>			
Kr-87	0.00E+00	5.18E-06	5.18E-06
XE-133	0.00E+00	5.86E-04	5.86E-04
XE-138	0.00E+00	1.15E-05	1.15E-05
<b>TOTALS</b>	0.00E+00	6.02E-04	6.02E-04

Zeroes in this table indicate that no radioactivity was present at detectable levels.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

TABLE 3-A

Gaseous Effluents - Summation of All Releases  
During the period  
Starting: 1-Jan-2017 Ending: 30-Jun-2017

Type Of Effluent	Units	Quarter 1	Quarter 2	Est. Tot Error %
<b>A. Fission &amp; Activation Products</b>				
1. Total Release	Ci	2.72E+00	1.81E+01	22%
2. Average Release Rate For Period	μCi/sec	3.50E-01	2.30E+00	
3. Percent Of Applicable Limit	%	*	*	
<b>B. Radioiodines</b>				
1. Total Release	Ci	7.58E-06	5.90E-06	N/A**
2. Average Release Rate For Period	μCi/sec	9.75E-07	7.50E-07	
3. Percent Of Applicable Limit	%	*	*	
<b>C. Particulates</b>				
1. Particulates (Half-Lives>8 Days)	Ci	3.47E-05	5.39E-07	15%
2. Average Release Rate For Period	μCi/sec	4.47E-06	6.86E-08	
3. Percent Of Applicable Limit	%	*	*	
4. Gross Alpha Radioactivity	Ci	0.00E+00	0.00E+00	N/A**
<b>D. Tritium</b>				
1. Total Release	Ci	1.99E+01	1.69E+01	11%
2. Average Release Rate For Period	μCi/sec	2.56E+00	2.15E+00	
3. Percent Of Applicable Limit	%	*	*	
<b>E. Carbon-14</b>				
1. Total Release	Ci	4.63E+00	1.51E+00	N/A
2. Average Release Rate For Period	μCi/sec	5.95E-01	1.92E-01	
3. Percent Of Applicable Limit	%	*	*	

Zeroes in this table indicate that no radioactivity was present at detectable levels.

\* Applicable limits are expressed in terms of dose. See Table 6A of this report.

\*\* N/A - Errors in measurements are not reported for these values since none were identified during the reporting period.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

TABLE 3-B

Gaseous Effluents - Summation of All Releases  
During the period  
Starting: 1-Jul-2017 Ending: 31-Dec-2017

Type Of Effluent	Units	Quarter 3	Quarter 4	Est. Tot Error %
<b>A. Fission &amp; Activation Products</b>				
1. Total Release	Ci	1.49E+01	1.95E-01	22%
2. Average Release Rate For Period	μCi/sec	1.87E+00	2.45E-02	
3. Percent Of Applicable Limit	%	*	*	
<b>B. Radioiodines</b>				
1. Total Release	Ci	1.99E-05	4.67E-06	12%
2. Average Release Rate For Period	μCi/sec	2.50E-06	5.88E-07	
3. Percent Of Applicable Limit	%	*	*	
<b>C. Particulates</b>				
1. Particulates (Half-Lives>8 Days)	Ci	0.00E+00	0.00E+00	15%
2. Average Release Rate For Period	μCi/sec	0.00E+00	0.00E+00	
3. Percent Of Applicable Limit	%	*	*	
4. Gross Alpha Radioactivity	Ci	5.77E-08	0.00E+00	N/A**
<b>D. Tritium</b>				
1. Total Release	Ci	2.71E+01	1.28E+01	11%
2. Average Release Rate For Period	μCi/sec	3.42E+00	1.61E+00	
3. Percent Of Applicable Limit	%	*	*	
<b>E. Carbon-14</b>				
1. Total Release	Ci	4.40E+00	4.11E+00	N/A
2. Average Release Rate For Period	μCi/sec	5.54E-01	5.17E-01	
3. Percent Of Applicable Limit	%	*	*	

Zeroes in this table indicate that no radioactivity was present at detectable levels.

\* Applicable limits are expressed in terms of dose. See Table 6B of this report.

\*\* N/A - Errors in measurements are not reported for these values since none were identified during the reporting period.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

TABLE 4-A

Curies Released in Gaseous Ground Level Releases

During the period  
Starting: 1-Jan-2017 Ending: 31-Mar-2017

	CONTINUOUS	BATCH	TOTAL
<b>FISSION GASES</b>			
Ar-41	0.00E+00	1.79E+00	1.79E+00
Kr-85	0.00E+00	9.81E-07	9.81E-07
Xe-131m	0.00E+00	8.52E-05	8.52E-05
Xe-133m	0.00E+00	2.40E-02	2.40E-02
Xe-133	0.00E+00	7.44E-01	7.44E-01
Xe-135	0.00E+00	1.65E-01	1.65E-01
<b>TOTALS</b>	0.00E+00	2.72E+00	2.72E+00
<b>IODINES &amp; HALOGENS</b>			
Br-82	3.26E-07	0.00E+00	3.26E-07
I-131	2.52E-06	0.00E+00	2.52E-06
I-133	4.73E-06	0.00E+00	4.73E-06
<b>TOTALS</b>	7.58E-06	0.00E+00	7.58E-06
<b>PARTICULTATES</b>			
CO-58	3.47E-05	0.00E+00	3.47E-05
<b>TOTALS</b>	3.47E-05	0.00E+00	3.47E-05
<b>H-3</b>	1.99E+01	0.00E+00	1.99E+01
<b>C-14 (Total)</b>	4.63E+00	0.00E+00	4.63E+00
<b>C-14 (CO2 Form)</b>	9.25E-01	0.00E+00	9.25E-01

Zeroes in this table indicate that no radioactivity was present at detectable levels.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

TABLE 4-B

Curies Released in Gaseous Ground Level Releases

During the period  
Starting: 1-Apr-2017 Ending: 30-Jun-2017

	CONTINUOUS	BATCH	TOTAL
<b>FISSION GASES</b>			
Ar-41	0.00E+00	1.81E+01	1.81E+01
XE-133	0.00E+00	1.42E-03	1.42E-03
XE-135	0.00E+00	2.47E-02	2.47E-02
<b>TOTALS</b>	0.00E+00	1.81E+01	1.81E+01
<b>IODINES &amp; HALOGENS</b>			
Br-82	5.05E-06	0.00E+00	5.05E-06
I-131	8.52E-07	0.00E+00	8.52E-07
<b>TOTALS</b>	5.90E-06	0.00E+00	5.90E-06
<b>PARTICULTATES</b>			
CO-57	0.00E+00	0.00E+00	0.00E+00
<b>TOTALS</b>	5.39E-07	0.00E+00	5.39E-07
<b>H-3</b>	1.69E+01	0.00E+00	1.69E+01
<b>C-14 (Total)</b>	1.51E+00	0.00E+00	1.51E+00
<b>C-14 (CO2 Form)</b>	3.01E-01	0.00E+00	3.01E-01

Zeroes in this table indicate that no radioactivity was present at detectable levels.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

TABLE 4-C

Curies Released in Gaseous Ground Level Releases

During the period  
Starting: 1-Jul-2017 Ending: 30-Sep-2017

	CONTINUOUS	BATCH	TOTAL
<b>FISSION GASES</b>			
Ar-41	9.92E-01	1.37E+01	1.47E+01
Kr-85m	0.00E+00	6.78E-05	6.78E-05
Kr-87	0.00E+00	1.99E-05	1.99E-05
Kr-88	0.00E+00	8.76E-05	8.76E-05
Xe-133m	0.00E+00	1.70E-04	1.70E-04
Xe-133	0.00E+00	2.09E-01	2.09E-01
Xe-135m	0.00E+00	3.19E-04	3.19E-04
Xe-135	0.00E+00	1.37E-03	1.37E-03
<b>TOTALS</b>	0.00E+00	1.39E+01	1.49E+01
<b>IODINES &amp; HALOGENS</b>			
Br-82	1.96E-05	0.00E+00	1.96E-05
I-131	2.60E-07	0.00E+00	2.60E-07
<b>TOTALS</b>	1.99E-05	0.00E+00	1.99E-05
<b>PARTICULTATES</b>	0.00E+00	0.00E+00	0.00E+00
<b>H-3</b>	2.71E+01	0.00E+00	2.71E+01
<b>Gross Alpha</b>	5.77E-08	0.00E+00	5.77E-08
<b>C-14 (Total)</b>	4.40E+00	0.00E+00	4.40E+00
<b>C-14 (CO2 Form)</b>	8.81E-01	0.00E+00	8.81E-01

Zeroes in this table indicate that no radioactivity was present at detectable levels.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

TABLE 4-D

Curies Released in Gaseous Ground Level Releases

During the period

Starting: 1-Oct-2017 Ending: 31-Dec-2017

	CONTINUOUS	BATCH	TOTAL
<b>FISSION GASES</b>			
Ar-41	0.00E+00	1.26E-01	1.26E-01
Kr-85m	0.00E+00	9.67E-05	9.67E-05
Kr-87	0.00E+00	5.10E-04	5.10E-04
Kr-88	0.00E+00	5.21E-03	5.21E-03
Xe-133m	0.00E+00	7.23E-04	7.23E-04
Xe-133	0.00E+00	5.34E-02	5.34E-02
Xe-135	0.00E+00	3.47E-03	3.47E-03
Xe-138	0.00E+00	5.07E-03	5.07E-03
<b>TOTALS</b>	0.00E+00	1.95E-01	1.95E-01
<b>IODINES</b>			
I-131	1.16E-06	0.00E+00	1.16E-06
I-133	3.52E-06	0.00E+00	3.52E-06
<b>TOTALS</b>	4.67E-06	0.00E+00	4.67E-06
<b>PARTICULTATES</b>	0.00E+00	0.00E+00	0.00E+00
<b>H-3</b>	1.28E+01	0.00E+00	1.28E+01
<b>C-14 (Total)</b>	4.11E+00	0.00E+00	4.11E+00
<b>C-14 (CO2 Form)</b>	8.21E-01	0.00E+00	8.21E-01

Zeroes in this table indicate that no radioactivity was present at detectable levels.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

TABLE 5-A  
SOLID WASTE (RADIOACTIVE SHIPMENTS)

**A. Solid Waste Shipped Offsite for Burial or Disposal (not Irradiated Fuel)**

<b>1. <u>Type of Waste</u></b>	<b><u>UNIT</u></b>	<b><u>12 Month Period</u></b>	<b><u>Est. (Ci) Error %</u></b>
<b>a.</b> Spent resins, filters, sludges, evaporator bottoms, etc.	m <sup>3</sup>	2.356E+01	N/A
	Ci	6.00E+02	+/- 25%
<b>b.</b> Dry Active Waste, Compressible Waste Contaminated Equipment, etc.	m <sup>3</sup>	9.155E+01	N/A
	Ci	4.739E-01	+/- 25%
<b>c.</b> Irradiated Components, Control Rods, etc.	m <sup>3</sup>	0.00	N/A
	Ci	0.00	N/A

**2. Estimate of Major Nuclide Composition  
(by type of waste)**

(percent cutoff = 1.0 percent)

<b>a.</b> Spent resins, filters, sludges, evaporator bottoms, etc. (nuclides determined by measurement)	<b><u>Nuclide</u></b>	<b><u>Percent</u></b>	<b><u>Ci</u></b>
	H-3	1.24%	7.44
	Cr-51	1.83%	10.98
	Mn-54	5.79%	34.74
	Fe-55	24.13%	144.8
	Co-58	48.65%	291.9
	Co-60	9.00%	54.0
	Ni-63	5.20%	31.2
	Nb-95	1.32%	7.92
<b>b.</b> Dry Active Waste, Compressible Waste Contaminated Equipment, etc. (nuclides determined by estimate)	<b><u>Nuclide</u></b>	<b><u>Percent</u></b>	<b><u>Ci</u></b>
	H-3	3.24%	0.0154
	Cr-51	5.07%	0.0204
	Mn-54	1.72%	0.0082
	Fe-55	39.37%	0.1866
	Co-58	22.38%	0.1061
	Fe-59	1.28%	0.0061
	Co-60	11.06%	0.0524
	Ni-63	4.67%	0.0221
	Nb-95	6.01%	0.0285
	Zr-95	3.24%	0.0154
<b>c.</b> Irradiated Components	None	N/A	N/A

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

TABLE 5-B  
SOLID WASTE (RADIOACTIVE SHIPMENTS)

**3. Solid Waste Disposition**

<u>Number of Shipments</u>	<u>Mode of Transportation</u>	<u>Destination</u>
6	Motor Freight	Energy Solutions Facility - Clive, UT
5	Motor Freight	Waste Control Specialist - Andrews, TX
9	Motor Freight	TOXCO - Oak Ridge, TN to Clive, UT

**4. Irradiated Fuel Shipments (Disposition)**

<u>Number of Shipments</u>	<u>Type Quantity</u>	<u>Mode of Transportation</u>	<u>Destination</u>
None	N/A	N/A	N/A

**5. Solidification of Waste**

Was solidification performed?           No          

If yes, solidification media:           N/A

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

## **Radiological Impact**

### **Introduction**

Potential doses to maximum individuals and the population around WBN are calculated for each quarter as required in Section 5.2 of the ODCM. Measured plant releases for the reporting period are used to estimate these doses. Dispersion of radioactive effluents in the environment is estimated using meteorological data and riverflow data measured during the period. In this report, the doses resulting from releases are described and compared to limits established for WBN.

### **Dose Limits**

The ODCM specifies limits for the release of radioactive effluents, as well as limits for doses to the general public, from the release of radioactive effluents. These limits are set well below the Technical Specification limits which govern the concentrations of radioactivity and doses permissible in unrestricted areas. This ensures that radioactive effluent releases are As Low As Reasonably Achievable.

### **Dose Calculations**

Estimated doses to the public are determined using computer models (the Gaseous Effluent Licensing Code, GELC, and the Quarterly Water Dose Assessment Code (QWATA)). These models are based on guidance provided by the NRC (in Regulatory Guides 1.109, 1.111 and 1.113) for determining the potential dose to individuals and populations living in the vicinity of the plant. The area around the plant is analyzed to determine the pathways through which the public may receive a dose. The doses calculated are a representation of the dose to a "maximum exposed individual." Some of the factors used in these calculations (such as ingestion rates) are maximum values. Many of these factors are obtained from NUREG/CR-1004. The values chosen will tend to overestimate the dose to this "maximum" person. The expected dose to actual individuals is lower. The calculated doses are presented in Tables 6-A, 6-B, 7-A, and 7-B.

### **Doses From Airborne Effluents**

For airborne effluents, the public can be exposed to radiation from several sources: direct radiation from the radioactivity in the air, direct radiation from radioactivity deposited on the ground, inhalation of airborne radioactivity, ingestion of vegetation which contains radioactivity deposited from the atmosphere, and ingestion of milk and beef which contains radioactivity deposited from the atmosphere onto vegetation and subsequently eaten by milk and beef animals.

### **Airborne Discharge Points**

All releases from WBN are considered ground-level releases. The ground-level Joint Frequency Distribution (JFD) is derived from wind speeds and directions measured 10 meters above ground and from the vertical temperature difference between 10 and 46 meters, as presented for each quarter on pages E-39 through E-66.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

**Radiological Impact**

Meteorological Data

Meteorological variables at WBN are measured continuously. Measurements collected include wind speed, wind direction, and temperature at heights of 10, 46, and 91 meters above the ground. Quarterly JFDs are calculated for each release point using the appropriate levels of meteorological data. A JFD provides the percentage of the time in a quarter that the wind is blowing out of a particular upwind compass sector in a particular range of wind speeds for a given stability class A through G. The wind speeds are divided into nine wind speed ranges. Calms are distributed by direction in proportion to the distribution of non-calm wind directions less than 0.7 m/s (1.5 mph). Stability classes are determined from the vertical temperature difference between two measurement levels.

External Exposure Dose

Dose estimates for maximum external air dose (gamma-air and beta-air doses) are made for points at and beyond the unrestricted area boundary as described in the WBN ODCM. The highest of these doses is then selected.

Submersion Dose

External doses to the skin and total body, due to submersion in a cloud of noble gases, are estimated for the nearest residence in each sector. The residence with the highest dose is then selected from all sectors.

Organ Dose

Doses to organs due to releases of airborne effluents are estimated for the inhalation, ground contamination, and ingestion pathways. The ingestion pathway is further divided into four possible contributing pathways: ingestion of cow milk, ingestion of beef, and ingestion of vegetables. Doses from applicable pathways are calculated for each real receptor location identified in the most recent land use survey. To determine the maximum organ dose, the doses from the pathways are summed for each receptor. For the ingestion dose, however, only those pathways that exist for each receptor are considered in the sum, i.e., milk ingestion doses are included only for locations where milk is consumed without commercial preparation and vegetable ingestion is included only for those locations where a garden is identified. Since specific data on beef animals were not available, the location of the highest beef dose for all receptors within an age group will be considered the beef dose for each receptor within that age group. For ground contamination, the dose added to the organ dose being calculated is the total body dose calculated for that location, i.e., it is assumed that the dose to an individual organ is equal to the total body dose.

Doses from airborne effluents are presented in Tables 6-A and 6-B.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

**Radiological Impact**

Land Use Survey

**2017 Land Use Survey**

Receptor Number	Receptor Type*	Sector	Distance (m)	GPS Coordinates		Terrain Adj. Factor
				N	W	
1	NR	N	4474	35.64275	84.79600	1.5
2	NR	NNE	3750	35.63226	84.77014	1.8
3	NR	NE	3399	35.62474	84.76412	2.3
4	NR	ENE	3072	35.61506	84.75984	1.9
5	NR	E	4388	35.59959	84.74191	1.6
6	NR	ESE	4654	35.58139	84.74604	1.8
7	NR	SE	1409	35.59439	84.77861	1.5
8	NR	SSE	1646	35.58963	84.78191	1.5
9	NR	S	1550	35.58879	84.79047	1.8
10	NR	SSW	1832	35.58690	84.79567	1.9
11	NR	SW	8100	N/A	N/A	1.7
12	NR	WSW	2422	35.59270	84.81403	1.7
13	NR	W	2901	35.60557	84.82218	1.1
14	NR	WNW	1448	35.60967	84.80387	2.5
15	NR	NW	2065	35.61308	84.80929	1.5
16	NR	NNW	4376	35.63792	84.81208	1.0
17	NG	N	6295	35.65835	84.80361	1.1
18	NG	NNE	5030	35.64057	84.75969	1.6
19	NG	NE	3661	35.62830	84.76470	2.2
20	NG	ENE	3072	35.61506	84.75984	1.9
21	NG	E	4656	35.60406	84.73881	1.6
22	NG	ESE	7297	35.58398	84.71296	1.7
23	NG	SE	1409	35.59439	84.77861	1.5
24	NG	SSE	1711	35.58799	84.78504	1.5
25	NG	S	2349	35.58178	84.79313	2.0
26	NG	SSW	2286	35.58312	84.49693	2.0
27	NG	SW	8100	N/A	N/A	1.7
28	NG	WSW	3080	35.59324	84.82214	1.7
29	NG	W	3138	35.60768	84.82446	1.1
30	NG	WNW	2956	35.61417	84.81982	2.2
31	NG	NW	2065	35.61308	84.80929	1.5
32	NG	NNW	4742	35.64449	84.80119	1.0
33	MC	ESE	6706	35.57698	84.72101	1.7
34	MC	SSW	2826	35.57806	84.79750	2.0

\* NR: Nearest Residence, NG: Nearest Garden, MC: Milk Cow

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

**Radiological Impact**

**Doses From Liquid Effluents**

For liquid effluents, the public can be exposed to radiation from three sources: the ingestion of water from the Tennessee River, the ingestion of fish caught in the Tennessee River, and direct exposure from radioactive material deposited on the river shoreline sediment (recreation).

The concentrations of radioactivity in the Tennessee River are estimated by a computer model which uses measured hydraulic data downstream of WBN. Parameters used to determine the doses are based on guidance given by the NRC (in Regulatory Guide 1.109) for maximum ingestion rates, exposure times, etc. Wherever possible, parameters used in the dose calculation are site specific use factors determined by TVA. The models that are used to estimate doses, as well as the parameters input to the models, are described in detail in the WBN ODCM.

**Liquid Release Points and River Data**

Radioactivity concentrations in the Tennessee River are calculated assuming that releases in liquid effluents are continuous. All routine liquid releases from WBN, located at Tennessee River Mile 528.5, are made through diffusers which extend into the Tennessee River. It is assumed that releases to the river through these diffusers will initially be entrained in one-tenth of the water which flows past the plant. The QWATA code makes the assumption that this mixing condition holds true until the water is completely mixed at Tennessee River Mile 510.0.

Doses are calculated for locations within a 50 mile radius downstream of the plant site. The maximum potential recreation dose is calculated for a location immediately downstream from the plant outfall. The maximum individual dose from ingestion of fish is assumed to be that calculated for the consumption of fish caught anywhere between the plant and the first downstream dam (Chickamauga Dam). The maximum individual dose from drinking water is assumed to be that calculated at the nearest downstream public water supply (Dayton, TN). This could be interpreted as indicating that the maximum individual, as assumed for liquid releases from WBN, is an individual who obtains all of his drinking water at Dayton, TN, consumes fish caught from the Tennessee River between WBN and Chickamauga Dam, and spends 500 hours per year on the shoreline just below the outfall from WBN. Dose estimates for the maximum individual due to liquid effluents for each quarter in the period are presented in Tables 7-A and 7-B, along with the average river flows past the plant site for the periods.

**Population Doses**

Population doses for highest exposed organ due to airborne effluents are calculated for a projected 2040 population distribution of 1,523,385 persons living within a 50-mile radius of the plant site. Doses from external pathways and inhalation are based on the 50-mile human population distribution. Ingestion population doses are calculated assuming that each individual consumes milk, vegetables, and meat produced within the sector annulus in which he resides. Doses from external pathways and inhalation are based on the 50-mile human population distribution.

Population doses for total body and the maximum exposed organ due to liquid effluents are calculated for the entire downstream Tennessee River Population. Water ingestion population doses are calculated using actual population figures for downstream public water supplies. Fish ingestion population doses are calculated assuming that all sport fish caught in the Tennessee River are consumed by the Tennessee River population. Recreation population doses are calculated using actual recreational data on the number of shoreline visits at downstream locations.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

Population dose estimates for airborne and liquid effluents are presented in Tables 6-A, 6-B, 7-A and 7-B.

## **Radiological Impact**

### **Direct Radiation**

External gamma radiation levels were measured by Landauer InLight (optically stimulated luminescence dosimeters (OSLDs) deployed around WBN as part of the offsite Radiological Environmental Monitoring Program. The quarterly gamma radiation levels determined from these dosimeters during this reporting period averaged 15.4 mR/quarter at onsite (at or near the site boundary) stations and 14.1 mR/quarter at offsite stations or 1.3 mR/quarter higher onsite than at offsite stations. This difference is consistent with levels measured for preoperation and construction phases of the WBN plant site where the average radiation levels onsite were generally 2-8 mR/quarter higher than the levels offsite. This may be attributable to natural variations in environmental radiation levels, earth moving activities onsite, the mass of concrete employed in the construction of the plants, or other undetermined influences. Fluctuations in natural background dose rates and in dosimeters readings tend to mask any small increments which may be due to plant operations. Thus, there was no identifiable increase in dose rate levels attributable to direct radiation from plant equipment and/or gaseous effluents.

### **Dose To A Member Of The Public Inside The Unrestricted Area Boundary**

As stated in the WBN ODCM, an evaluation of the dose to a member of the public inside the unrestricted area boundary is performed for a hypothetical TVA employee who works just outside the restricted area boundary for an entire work year (2000 hours). Results from onsite dosimeter measurements indicated that the highest annual dosimeter reading outside Radiological Control Area was 117 mrem. Using this value, subtracting an annual background value of approximately 61.5 mrem/year (see previous section), and multiplying by the ratio of the occupancy times (2000/8760), the highest external dose to a member of the public inside the unrestricted area boundary would be 12.3 mrem. The doses due to radioactive effluents released to the atmosphere calculated in this report would not add a significant amount to this measured dose. This dose is below the 10 CFR 20 annual limit of 100 mrem.

### **Total Dose**

To determine compliance with 40 CFR 190, annual total dose contributions to the maximum individual from WBN radioactive effluents and all other nearby uranium fuel cycle sources are considered.

The annual dose to any organ other than thyroid for the maximum individual is conservatively estimated by summing the following doses: the total body air submersion dose for each quarter, the critical organ dose (for any organ other than the thyroid) from airborne effluents for each quarter from ground contamination, inhalation and ingestion, the total body dose from liquid effluents for each quarter, the maximum organ dose (for any organ other than the thyroid) from liquid effluents for each quarter, and any identifiable increase in direct radiation dose levels as measured by the environmental monitoring program. This dose is compared to the 40 CFR 190 limit for total body or any organ dose (other than thyroid) to determine compliance.

The annual thyroid dose to the maximum individual is conservatively estimated by summing the following doses: the total body air submersion dose for each quarter, the thyroid dose from airborne effluents for each quarter, the total body dose from liquid effluents for each quarter, the thyroid dose from liquid effluents for each quarter, and any identifiable increase in direct radiation dose levels as measured by the environmental monitoring program. This dose is compared to the 40 CFR 190 limit for thyroid dose to determine compliance. Cumulative annual total doses are presented in Table 8.

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

TABLE 6-A  
Doses from Airborne Effluents

**First Quarter**

**Individual Doses**

Pathway	Dose	Quarterly Limit	Percent of Limit	Location	X/Q	D/Q
<b>External</b>						
Gamma Air	5.59E-03 mrad	5 mrad	< 1%	E/1280 meters	1.33E-05	1.21E-08
Beta Air	2.39E-03 mrad	10 mrad	< 1%	E/1280 meters	1.33E-05	1.21E-08
<b>Submersion</b>						
Total Body	1.73E-03 mrad	N/A	N/A	SE/1409 meters	4.24E-06	7.46E-09
Skin	2.60E-03 mrad	N/A	N/A	SE/1409 meters	4.24E-06	7.46E-09
<b>Organ Doses<sup>1</sup></b>						
(Max) Child/Bone	8.57E-01 mrem	7.5 mrem	11.43%	SE/1409 meters	4.24E-06	7.46E-09
Child/Thyroid	1.88E-01 mrem	7.5 mrem	2.51%	SE/1409 meters	4.24E-06	7.46E-09
Child/Total Body	1.88E-01 mrem	7.5 mrem	2.51%	SE/1409 meters	4.24E-06	7.46E-09

**Population Doses**

Total Body Dose 4.93E-01 man-rem  
Maximum Organ Dose (Organ) 2.10E+00 man-rem (Bone)

**Second Quarter**

**Individual Doses**

Pathway	Dose	Quarterly Limit	Percent of Limit	Location	X/Q	D/Q
<b>External</b>						
Gamma Air	7.56E-02 mrad	5 mrad	1.51%	ESE/1250 meters	1.89E-05	1.42E-08
Beta Air	2.67E-02 mrad	10 mrad	< 1%	ESE/1250 meters	1.89E-05	1.42E-08
<b>Submersion</b>						
Total Body	2.16E-02 mrad	N/A	N/A	SE/1409 meters	5.72E-06	5.65E-09
Skin	3.17E-02 mrad	N/A	N/A	SE/1409 meters	5.72E-06	5.65E-09
<b>Organ Doses<sup>1</sup></b>						
(Max) Child/Bone	4.17E-01 mrem	7.5 mrem	5.56%	SE/1409 meters	5.72E-06	5.65E-09
Child/Thyroid	1.18E-01 mrem	7.5 mrem	1.57%	SE/1409 meters	5.72E-06	5.65E-09
Child/Total Body	1.18E-01 mrem	7.5 mrem	1.57%	SE/1409 meters	5.72E-06	5.65E-09

**Population Doses**

Total Body Dose 2.60E-01 man-rem  
Maximum Organ Dose (Organ) 8.95E-01 man-rem (Bone)

*Population doses can be compared to the natural background dose for the entire 50-mile population of about 210,000 man-rem/year (based on 140 mrem/yr for natural background).*

<sup>1</sup>Organ Doses include contributions from Carbon 14 as carbon dioxide

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

TABLE 6-B  
Doses from Airborne Effluents

**Third Quarter**

**Individual Doses**

Pathway	Dose	Quarterly Limit	Percent of Limit	Location	X/Q	D/Q
<b>External</b>						
Gamma Air	8.00E-02 mrad	5 mrad	1.6%	E/1280 meters	2.47E-05	1.56E-08
Beta Air	2.84E-02 mrad	10 mrad	< 1%	E/1280 meters	2.47E-05	1.56E-08
<b>Submersion</b>						
Total Body	1.22E-02 mrad	N/A	N/A	ENE/3072 meters	5.82E-06	3.36E-09
Skin	1.79E-02 mrad	N/A	N/A	ENE/3072 meters	5.82E-06	3.36E-09
<b>Organ Doses<sup>1</sup></b>						
(Max) Child/Bone	1.26E+00 mrem	7.5 mrem	16.8%	ENE/3072 meters	5.82E-06	3.36E-09
Child/Thyroid	2.92E-01 mrem	7.5 mrem	3.89%	ENE/3072 meters	5.82E-06	3.36E-09
Child/Total Body	2.92E-01 mrem	7.5 mrem	3.89%	ENE/3072 meters	5.82E-06	3.36E-09

**Population Doses**

Total Body Dose 6.73E-01 man-rem  
Maximum Organ Dose (Organ) 2.68E+00 man-rem (Bone)

**Fourth Quarter**

**Individual Doses**

Pathway	Dose	Quarterly Limit	Percent of Limit	Location	X/Q	D/Q
<b>External</b>						
Gamma Air	6.43E-04 mrad	5 mrad	< 1%	ESE/1250 meters	2.04E-05	1.65E-08
Beta Air	2.59E-04 mrad	10 mrad	< 1%	ESE/1250 meters	2.04E-05	1.65E-08
<b>Submersion</b>						
Total Body	1.86E-04 mrad	N/A	N/A	SE/1409 meters	6.19E-06	8.38E-09
Skin	2.76E-04 mrad	N/A	N/A	SE/1409 meters	6.19E-06	8.38E-09
<b>Organ Doses<sup>1</sup></b>						
(Max) Child/Bone	1.12E+00 mrem	7.5 mrem	14.9%	SE/1409 meters	6.19E-06	8.38E-09
Child/Thyroid	2.38E-01 mrem	7.5 mrem	3.17%	SE/1409 meters	6.19E-06	8.38E-09
Child/Total Body	2.38E-01 mrem	7.5 mrem	3.17%	SE/1409 meters	6.19E-06	8.38E-09

**Population Doses**

Total Body Dose 4.82E-01 man-rem  
Maximum Organ Dose (Organ) 2.14E+00 man-rem (Bone)

*Population doses can be compared to the natural background dose for the entire 50-mile population of about 210,000 man-rem/year (based on 140 mrem/yr for natural background).*

<sup>1</sup>Organ Doses include contributions from Carbon 14 as carbon dioxide

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

TABLE 7-A  
Doses from Liquid Effluents

**First Quarter**

**Individual Doses (mrem)**

Age Group	Organ	Dose	Quarterly Limit	Percent of Limit
Child	Total Body	7.70E-03	1.5 mrem	< 1 %
Child	Bone	7.80E-03	5 mrem	< 1 %
Child	Thyroid	7.70E-03	5 mrem	< 1 %

Average Riverflow past WBN (cubic feet per second): 23,735 cfs

**Population Doses**

Total Body Dose 7.00E-01 man-rem  
Maximum Organ Dose (Organ) 7.00E-01 man-rem (Bone)

**Second Quarter**

**Individual Doses (mrem)**

Age Group	Organ	Dose	Quarterly Limit	Percent of Limit
Child	Total Body	1.60E-03	1.5 mrem	< 1 %
Child	Bone	2.00E-03	5 mrem	< 1 %
Child	Thyroid	1.50E-03	5 mrem	< 1 %

Average Riverflow past WBN (cubic feet per second): 30,765 cfs

**Population Doses**

Total Body Dose 1.30E-01 man-rem  
Maximum Organ Dose (Organ) 1.40E-01 man-rem (Bone)

*Population doses can be compared to the natural background dose for the entire 50-mile population of about 210,000 man-rem/year (based on 140 mrem/yr for natural background).*

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

TABLE 7-B  
Doses from Liquid Effluents

**Third Quarter**

**Individual Doses (mrem)**

Age Group	Organ	Dose	Quarterly Limit	Percent of Limit
Child	Total Body	1.10E-03	1.5 mrem	< 1 %
Child	GI	1.30E-03	5 mrem	< 1 %
Child	Thyroid	1.10E-03	5 mrem	< 1 %

Average Riverflow past WBN (cubic feet per second): 20,523 cfs

**Population Doses**

Total Body Dose 9.60E-02 man-rem  
Maximum Organ Dose (Organ) 9.70E-02 man-rem (GI)

**Fourth Quarter**

**Individual Doses (mrem)**

Age Group	Organ	Dose	Quarterly Limit	Percent of Limit
Child	Total Body	1.30E-03	1.5 mrem	< 1 %
Child	Bone	1.40E-03	5 mrem	< 1 %
Child	Thyroid	1.30E-03	5 mrem	< 1 %

Average Riverflow past WBN (cubic feet per second): 25,875 cfs

**Population Doses**

Total Body Dose 1.10E-01 man-rem  
Maximum Organ Dose (Organ) 1.10E-01 man-rem (Bone)

*Population doses can be compared to the natural background dose for the entire 50-mile population of about 210,000 man-rem/year (based on 140 mrem/yr for natural background).*

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

TABLE 8  
Total Dose from Fuel Cycle

Dose	First Quarter	Second Quarter	Third Quarter	Fourth Quarter	
<b>Total Body or any Organ (except thyroid)</b>					
Total body air (submersion)	1.73E-03	2.16E-02	1.22E-02	1.86E-04	
Critical organ dose (airborne)	8.57E-01	4.17E-01	1.26E+00	1.12E+00	
Total body dose (liquid)	7.70E-03	1.60E-03	1.10E-03	1.30E-03	
Maximum organ dose (liquid)	7.80E-03	2.00E-03	1.30E-03	1.40E-03	
Direct Radiation Dose	0.00E+00	0.00E+00	0.00E+00	0.00E+00	
<b>Total</b>	<b>8.74E-01</b>	<b>4.42E-01</b>	<b>1.27E+00</b>	<b>1.12E+00</b>	
<b>Cumulative Total Dose (mrem)</b>					<b>3.71E+00</b>
<b>Annual Dose Limit (mrem)</b>					<b>25</b>
<b>Percent of Limit</b>					<b>14.8%</b>
<b>Thyroid</b>					
Total body air (submersion)	1.73E-03	2.16E-02	1.22E-02	1.86E-04	
Thyroid dose (airborne)	1.88E-01	1.18E-01	2.92E-01	2.38E-01	
Total body dose (liquid)	7.70E-03	1.60E-03	1.10E-03	1.30E-03	
Thyroid dose (liquid)	7.70E-03	1.50E-03	1.10E-03	1.30E-03	
<b>Total</b>	<b>2.05E-01</b>	<b>1.43E-01</b>	<b>3.06E-01</b>	<b>2.41E-01</b>	
<b>Cumulative Total Dose (mrem)</b>					<b>8.95E-01</b>
<b>Annual Dose Limit (mrem)</b>					<b>75</b>
<b>Percent of Limit</b>					<b>1.19%</b>

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

Independent Spent Fuel Storage Installation

The Tennessee Valley Authority (TVA) selected the Holtec International Storage Module (HI-STORM) Flood/Wind (FW) Multi-Purpose Canister (MPC) Storage System for storage of spent fuel at the Watts Bar Nuclear (WBN) Plant Independent Spent Fuel Storage Installation (ISFSI). The HI-STORM FW MPC Storage System has been reviewed and approved by the Nuclear Regulatory Commission (NRC) and Certificate of Compliance (CoC) number 1032 Title 10 CFR 72.104, Criteria for radioactive materials in effluents and direct radiation from an ISFSI or Monitored Retrievable Storage Installation (MSRI), requires that the annual dose equivalent to any real individual, located beyond the controlled area, must not exceed 25 millirem (mrem) to the whole body, 75 mrem to the thyroid, and 25 mrem to any other critical organ, as a result of exposure to direct radiation from ISFSI operations.

WBN successfully placed its first loaded HI-STORM FW on the ISFSI pad on October 5, 2016. The TVA ISFSI storage pad is located within the plant's protected area. The storage pad is designed to adequately support both static and dynamic loads of 80 loaded Holtec HI-STORM FW MPC Storage Systems. Currently, the storage pad contains six canisters.

The off-site dose for normal operating conditions to a real individual beyond the controlled area boundary is limited by 10 CFR 72.104(a) to a maximum of 25 mrem/year whole body, 75 mrem/year thyroid, and 25 mrem/year for other critical organs, including contributions from all nuclear fuel cycle operations. For this report, total site releases include the WBN ISFSI as part of plant operations. By its design, there were no liquid or gaseous effluents from the operation of the ISFSI during 2017.

Radiological Environmental Monitoring Program assessment of direct radiation exposure by dosimeters at or near the site boundary is 5.2mrem/yr for onsite locations. As stated in the WBN ODCM and per this report, the dose to a member of the public inside the unrestricted boundary is then performed. Results from onsite dosimeter measurement and subtracting background indicated that the highest dosimeter reading at the boundary of the protected area was 10.6 mrem for the north fence location AR063.

Based on the above measurements performed during this reporting period, It can be concluded that the radiation exposure due to the ISFSI, combined with all other fuel cycle operations, will not exceed the regulatory requirements of 25 mrem/year in 10 CFR 72.104(a) and 40 CFR Part 190.

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS A (DELTA T<=-1.9 C/100 M)

WATTS BAR NUCLEAR PLANT

JAN 1, 2017 - MAR 31, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.000	0.000	0.000	0.093	0.324	0.463	0.000	0.000	0.000		0.880
NNE	0.000	0.000	0.093	0.278	0.232	0.278	0.000	0.000	0.000		0.880
NE	0.000	0.000	0.000	0.000	0.046	0.000	0.000	0.000	0.000		0.046
ENE	0.000	0.000	0.000	0.000	0.000	0.046	0.000	0.000	0.000		0.046
E	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
ESE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
SE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
SSE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
S	0.000	0.000	0.000	0.046	0.046	0.232	0.000	0.000	0.000		0.324
SSW	0.000	0.000	0.000	0.093	0.278	0.093	0.000	0.000	0.000		0.463
SW	0.000	0.000	0.000	0.046	0.185	0.046	0.000	0.000	0.000		0.278
WSW	0.000	0.000	0.046	0.000	0.046	0.000	0.000	0.000	0.000		0.093
W	0.000	0.000	0.000	0.000	0.000	0.093	0.000	0.000	0.000		0.093
WNW	0.000	0.000	0.000	0.000	0.046	0.324	0.000	0.000	0.000		0.371
NW	0.000	0.000	0.000	0.000	0.139	0.278	0.046	0.000	0.000		0.463
NNW	0.000	0.000	0.000	0.000	0.139	0.648	0.000	0.000	0.000		0.787
SUBTOTAL	0.000	0.000	0.139	0.556	1.482	2.501	0.046	0.000	0.000		4.724

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2159
TOTAL HOURS OF STABILITY CLASS A	102
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS A	102
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2159
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/05/05

MEAN WIND SPEED = 7.66

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS B      (-1.9< DELTA T<=-1.7 C/100 M)

WATTS BAR NUCLEAR PLANT

JAN 1, 2017 - MAR 31, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)		7.41-12.40	12.41-18.40	18.41-24.40	>=24.41	TOTAL
				3.41-5.40	5.41-7.40					
N	0.000	0.000	0.000	0.093	0.093	0.232	0.000	0.000	0.000	0.417
NNE	0.000	0.000	0.000	0.232	0.046	0.046	0.000	0.000	0.000	0.324
NE	0.000	0.000	0.046	0.139	0.093	0.000	0.000	0.000	0.000	0.278
ENE	0.000	0.000	0.093	0.000	0.000	0.000	0.000	0.000	0.000	0.093
E	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
ESE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
SE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
SSE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
S	0.000	0.000	0.000	0.000	0.093	0.232	0.000	0.000	0.000	0.324
SSW	0.000	0.000	0.000	0.139	0.556	0.185	0.000	0.000	0.000	0.880
SW	0.000	0.000	0.000	0.185	0.232	0.000	0.000	0.000	0.000	0.417
WSW	0.000	0.000	0.000	0.046	0.000	0.046	0.000	0.000	0.000	0.093
W	0.000	0.000	0.000	0.000	0.046	0.139	0.000	0.000	0.000	0.185
WNW	0.000	0.000	0.000	0.000	0.093	0.417	0.000	0.000	0.000	0.509
NW	0.000	0.000	0.000	0.000	0.093	0.093	0.000	0.000	0.000	0.185
NNW	0.000	0.000	0.000	0.139	0.046	0.232	0.000	0.000	0.000	0.417
SUBTOTAL	0.000	0.000	0.139	0.973	1.390	1.621	0.000	0.000	0.000	4.122

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2159
TOTAL HOURS OF STABILITY CLASS B	89
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS B	89
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2159
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/05/05

MEAN WIND SPEED = 6.84

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS C      (-1.7< DELTA T<=-1.5 C/100 M)

WATTS BAR NUCLEAR PLANT

JAN 1, 2017 - MAR 31, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.000	0.000	0.046	0.185	0.000	0.232	0.000	0.000	0.000		0.463
NNE	0.000	0.000	0.046	0.139	0.093	0.000	0.000	0.000	0.000		0.278
NE	0.000	0.000	0.046	0.093	0.046	0.000	0.000	0.000	0.000		0.185
ENE	0.000	0.000	0.000	0.093	0.046	0.000	0.000	0.000	0.000		0.139
E	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
ESE	0.000	0.000	0.000	0.093	0.000	0.000	0.000	0.000	0.000		0.093
SE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
SSE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
S	0.000	0.000	0.000	0.093	0.000	0.371	0.000	0.000	0.000		0.463
SSW	0.000	0.000	0.000	0.463	0.648	0.093	0.000	0.000	0.000		1.204
SW	0.000	0.000	0.000	0.602	0.046	0.000	0.000	0.000	0.000		0.648
WSW	0.000	0.000	0.000	0.278	0.046	0.000	0.000	0.000	0.000		0.324
W	0.000	0.000	0.093	0.093	0.139	0.093	0.000	0.000	0.000		0.417
WNW	0.000	0.000	0.000	0.046	0.046	0.232	0.000	0.000	0.000		0.324
NW	0.000	0.000	0.000	0.000	0.046	0.046	0.000	0.000	0.000		0.093
NNW	0.000	0.000	0.000	0.046	0.000	0.232	0.046	0.000	0.000		0.324
SUBTOTAL	0.000	0.000	0.232	2.223	1.158	1.297	0.046	0.000	0.000		4.956

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2159
TOTAL HOURS OF STABILITY CLASS C	107
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS C	107
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2159
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/05/05

MEAN WIND SPEED = 6.14

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS D      (-1.5< DELTA T<=-0.5 C/100 M)

WATTS BAR NUCLEAR PLANT

JAN 1, 2017 - MAR 31, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)		7.41-12.40	12.41-18.40	18.41-24.40	>=24.41	TOTAL
				3.41-5.40	5.41-7.40					
N	0.000	0.000	0.787	0.648	1.019	1.436	0.000	0.000	0.000	3.891
NNE	0.000	0.093	0.602	0.741	0.278	0.139	0.000	0.000	0.000	1.853
NE	0.000	0.046	0.509	0.741	0.093	0.139	0.000	0.000	0.000	1.528
ENE	0.000	0.093	0.602	0.463	0.093	0.000	0.000	0.000	0.000	1.251
E	0.000	0.000	0.463	0.139	0.000	0.046	0.000	0.000	0.000	0.648
ESE	0.000	0.093	0.232	0.046	0.000	0.000	0.000	0.000	0.000	0.371
SE	0.000	0.046	0.093	0.093	0.000	0.000	0.000	0.000	0.000	0.232
SSE	0.000	0.000	0.417	0.232	0.093	0.000	0.000	0.000	0.000	0.741
S	0.000	0.046	0.973	0.880	0.602	0.787	0.046	0.000	0.000	3.335
SSW	0.000	0.000	1.667	2.362	1.528	1.204	0.000	0.000	0.000	6.762
SW	0.000	0.232	0.741	1.251	0.324	0.000	0.000	0.000	0.000	2.547
WSW	0.000	0.000	0.602	0.509	0.185	0.046	0.000	0.000	0.000	1.343
W	0.000	0.185	0.556	0.741	0.232	0.093	0.000	0.000	0.000	1.806
WNW	0.000	0.046	0.556	0.602	0.463	0.371	0.000	0.000	0.000	2.038
NW	0.000	0.046	0.185	0.463	0.371	1.251	0.093	0.000	0.000	2.409
NNW	0.000	0.046	0.648	0.648	1.112	1.853	0.139	0.000	0.000	4.447
SUBTOTAL	0.000	0.973	9.634	10.560	6.392	7.365	0.278	0.000	0.000	35.201

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2159
TOTAL HOURS OF STABILITY CLASS D	760
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS D	760
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2159
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/05/05

MEAN WIND SPEED = 5.15

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS E      (-0.5< DELTA T<= 1.5 C/100 M)

WATTS BAR NUCLEAR PLANT

JAN 1, 2017 - MAR 31, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.002	0.185	0.509	0.509	0.324	0.324	0.000	0.000	0.000		1.855
NNE	0.001	0.000	0.371	0.139	0.046	0.000	0.000	0.000	0.000		0.557
NE	0.002	0.139	0.463	0.232	0.000	0.000	0.000	0.000	0.000		0.835
ENE	0.002	0.093	0.509	0.093	0.000	0.000	0.000	0.000	0.000		0.696
E	0.002	0.232	0.324	0.093	0.000	0.000	0.000	0.000	0.000		0.650
ESE	0.001	0.232	0.139	0.046	0.000	0.000	0.000	0.000	0.000		0.418
SE	0.000	0.093	0.046	0.093	0.000	0.046	0.000	0.000	0.000		0.278
SSE	0.001	0.046	0.324	0.093	0.046	0.000	0.000	0.000	0.000		0.511
S	0.004	0.371	0.926	0.463	0.463	0.232	0.000	0.000	0.000		2.458
SSW	0.010	0.463	3.011	1.853	0.741	0.093	0.000	0.000	0.000		6.170
SW	0.007	0.371	2.270	0.787	0.046	0.000	0.000	0.000	0.000		3.481
WSW	0.004	0.602	0.973	0.556	0.000	0.000	0.000	0.000	0.000		2.135
W	0.004	0.602	1.019	0.463	0.093	0.093	0.000	0.000	0.000		2.274
WNW	0.002	0.232	0.648	0.509	0.278	0.046	0.000	0.000	0.000		1.716
NW	0.003	0.417	0.787	0.371	0.278	0.232	0.000	0.000	0.000		2.088
NNW	0.001	0.046	0.371	0.834	0.880	0.324	0.046	0.000	0.000		2.502
SUBTOTAL	0.046	4.122	12.691	7.133	3.196	1.390	0.046	0.000	0.000		28.624

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2159
TOTAL HOURS OF STABILITY CLASS E	618
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS E	618
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2159
TOTAL HOURS CALM	1

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/05/05

MEAN WIND SPEED = 3.43

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS F ( 1.5< DELTA T<= 4.0 C/100 M)

WATTS BAR NUCLEAR PLANT

JAN 1, 2017 - MAR 31, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.000	0.093	0.232	0.046	0.000	0.000	0.000	0.000	0.000	0.000	0.371
NNE	0.000	0.093	0.093	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.185
NE	0.000	0.093	0.232	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.324
ENE	0.000	0.232	0.278	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.509
E	0.000	0.232	0.232	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.463
ESE	0.000	0.232	0.093	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.324
SE	0.000	0.278	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.278
SSE	0.000	0.371	0.046	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.417
S	0.000	0.232	0.093	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.324
SSW	0.000	0.463	0.278	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.741
SW	0.000	0.695	1.019	0.046	0.000	0.000	0.000	0.000	0.000	0.000	1.760
WSW	0.000	0.926	0.417	0.000	0.000	0.000	0.000	0.000	0.000	0.000	1.343
W	0.000	0.834	0.371	0.046	0.000	0.000	0.000	0.000	0.000	0.000	1.251
WNW	0.000	0.602	0.880	0.046	0.000	0.000	0.000	0.000	0.000	0.000	1.528
NW	0.000	0.463	0.139	0.139	0.000	0.000	0.000	0.000	0.000	0.000	0.741
NNW	0.000	0.093	0.185	0.046	0.000	0.000	0.000	0.000	0.000	0.000	0.324
SUBTOTAL	0.000	5.929	4.585	0.371	0.000	0.000	0.000	0.000	0.000	0.000	10.885

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2159
TOTAL HOURS OF STABILITY CLASS F	235
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS F	235
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2159
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/05/05

MEAN WIND SPEED = 1.62

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS G (DELTA T > 4.0 C/100 M)

WATTS BAR NUCLEAR PLANT

JAN 1, 2017 - MAR 31, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)		7.41-12.40	12.41-18.40	18.41-24.40	>=24.41	TOTAL
				3.41-5.40	5.41-7.40					
N	0.001	0.093	0.046	0.000	0.000	0.000	0.000	0.000	0.000	0.140
NNE	0.000	0.046	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.047
NE	0.002	0.139	0.139	0.000	0.000	0.000	0.000	0.000	0.000	0.280
ENE	0.003	0.278	0.046	0.000	0.000	0.000	0.000	0.000	0.000	0.327
E	0.004	0.324	0.139	0.000	0.000	0.000	0.000	0.000	0.000	0.467
ESE	0.002	0.185	0.093	0.000	0.000	0.000	0.000	0.000	0.000	0.280
SE	0.002	0.232	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.233
SSE	0.001	0.139	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.140
S	0.006	0.602	0.093	0.000	0.000	0.000	0.000	0.000	0.000	0.700
SSW	0.005	0.556	0.093	0.000	0.000	0.000	0.000	0.000	0.000	0.654
SW	0.012	1.112	0.371	0.000	0.000	0.000	0.000	0.000	0.000	1.494
WSW	0.016	1.667	0.324	0.000	0.000	0.000	0.000	0.000	0.000	2.008
W	0.021	2.177	0.417	0.000	0.000	0.000	0.000	0.000	0.000	2.615
WNW	0.011	1.019	0.371	0.000	0.000	0.000	0.000	0.000	0.000	1.401
NW	0.005	0.417	0.232	0.000	0.000	0.000	0.000	0.000	0.000	0.654
NNW	0.000	0.046	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.047
SUBTOTAL	0.093	9.032	2.362	0.000	0.000	0.000	0.000	0.000	0.000	11.487

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2159
TOTAL HOURS OF STABILITY CLASS G	248
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS G	248
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2159
TOTAL HOURS CALM	2

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/05/05

MEAN WIND SPEED = 1.19

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS A (DELTA T<=-1.9 C/100 M)

WATTS BAR NUCLEAR PLANT

APR 1, 2017 - JUN 30, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)		7.41-12.40	12.41-18.40	18.41-24.40	>=24.41	TOTAL
				3.41-5.40	5.41-7.40					
N	0.000	0.000	0.000	0.046	0.000	0.000	0.000	0.000	0.000	0.046
NNE	0.000	0.000	0.000	0.046	0.093	0.139	0.000	0.000	0.000	0.278
NE	0.000	0.000	0.000	0.000	0.046	0.000	0.000	0.000	0.000	0.046
ENE	0.000	0.000	0.000	0.000	0.046	0.000	0.000	0.000	0.000	0.046
E	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
ESE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
SE	0.000	0.000	0.046	0.000	0.000	0.000	0.000	0.000	0.000	0.046
SSE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
S	0.000	0.000	0.000	0.046	0.000	0.000	0.000	0.000	0.000	0.046
SSW	0.000	0.000	0.046	0.000	0.185	0.046	0.000	0.000	0.000	0.278
SW	0.000	0.000	0.000	0.093	0.046	0.000	0.000	0.000	0.000	0.139
WSW	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
W	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
WNW	0.000	0.000	0.000	0.000	0.000	0.046	0.000	0.000	0.000	0.046
NW	0.000	0.000	0.000	0.000	0.000	0.093	0.046	0.000	0.000	0.139
NNW	0.000	0.000	0.000	0.093	0.046	0.000	0.000	0.000	0.000	0.139
SUBTOTAL	0.000	0.000	0.093	0.324	0.463	0.324	0.046	0.000	0.000	1.250

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2160
TOTAL HOURS OF STABILITY CLASS A	27
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS A	27
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2160
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/08/18

MEAN WIND SPEED = 6.99

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS B      (-1.9< DELTA T<=-1.7 C/100 M)

WATTS BAR NUCLEAR PLANT

APR 1, 2017 - JUN 30, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.000	0.000	0.000	0.139	0.139	0.046	0.000	0.000	0.000		0.324
NNE	0.000	0.000	0.046	0.139	0.139	0.046	0.000	0.000	0.000		0.370
NE	0.000	0.000	0.000	0.000	0.139	0.000	0.000	0.000	0.000		0.139
ENE	0.000	0.000	0.000	0.093	0.046	0.000	0.000	0.000	0.000		0.139
E	0.000	0.000	0.000	0.046	0.000	0.000	0.000	0.000	0.000		0.046
ESE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
SE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
SSE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
S	0.000	0.000	0.000	0.139	0.278	0.093	0.000	0.000	0.000		0.509
SSW	0.000	0.000	0.000	0.324	0.556	0.093	0.000	0.000	0.000		0.972
SW	0.000	0.000	0.046	0.185	0.046	0.046	0.000	0.000	0.000		0.324
WSW	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
W	0.000	0.000	0.000	0.000	0.093	0.000	0.000	0.000	0.000		0.093
WNW	0.000	0.000	0.000	0.000	0.000	0.093	0.000	0.000	0.000		0.093
NW	0.000	0.000	0.000	0.000	0.000	0.093	0.000	0.000	0.000		0.093
NNW	0.000	0.000	0.000	0.093	0.046	0.000	0.000	0.000	0.000		0.139
SUBTOTAL	0.000	0.000	0.093	1.157	1.481	0.509	0.000	0.000	0.000		3.241

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2160
TOTAL HOURS OF STABILITY CLASS B	70
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS B	70
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2160
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/08/18

MEAN WIND SPEED = 6.01

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS C      (-1.7< DELTA T<=-1.5 C/100 M)

WATTS BAR NUCLEAR PLANT

APR 1, 2017 - JUN 30, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.000	0.000	0.000	0.139	0.093	0.000	0.000	0.000	0.000		0.231
NNE	0.000	0.000	0.000	0.185	0.231	0.093	0.000	0.000	0.000		0.509
NE	0.000	0.000	0.000	0.185	0.000	0.046	0.000	0.000	0.000		0.231
ENE	0.000	0.000	0.000	0.231	0.000	0.000	0.000	0.000	0.000		0.231
E	0.000	0.000	0.000	0.093	0.046	0.000	0.000	0.000	0.000		0.139
ESE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
SE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
SSE	0.000	0.000	0.000	0.000	0.093	0.000	0.000	0.000	0.000		0.093
S	0.000	0.000	0.000	0.185	0.231	0.046	0.000	0.000	0.000		0.463
SSW	0.000	0.000	0.046	0.741	0.231	0.093	0.000	0.000	0.000		1.111
SW	0.000	0.000	0.046	0.694	0.093	0.000	0.000	0.000	0.000		0.833
WSW	0.000	0.000	0.000	0.093	0.093	0.000	0.000	0.000	0.000		0.185
W	0.000	0.000	0.000	0.000	0.046	0.000	0.000	0.000	0.000		0.046
WNW	0.000	0.000	0.000	0.046	0.139	0.093	0.000	0.000	0.000		0.278
NW	0.000	0.000	0.000	0.139	0.046	0.093	0.000	0.000	0.000		0.278
NNW	0.000	0.000	0.000	0.046	0.000	0.000	0.000	0.000	0.000		0.046
SUBTOTAL	0.000	0.000	0.093	2.778	1.343	0.463	0.000	0.000	0.000		4.676

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2160
TOTAL HOURS OF STABILITY CLASS C	101
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS C	101
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2160
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/08/18

MEAN WIND SPEED = 5.38

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS D      (-1.5< DELTA T<=-0.5 C/100 M)

WATTS BAR NUCLEAR PLANT

APR 1, 2017 - JUN 30, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.000	0.000	0.509	0.833	0.463	0.000	0.000	0.000	0.000		1.806
NNE	0.000	0.000	0.417	1.111	0.556	0.185	0.000	0.000	0.000		2.269
NE	0.000	0.000	0.602	0.833	0.602	0.000	0.000	0.000	0.000		2.037
ENE	0.000	0.093	1.250	0.278	0.139	0.046	0.000	0.000	0.000		1.806
E	0.000	0.046	1.111	0.278	0.000	0.000	0.000	0.000	0.000		1.435
ESE	0.000	0.000	1.111	0.185	0.000	0.000	0.000	0.000	0.000		1.296
SE	0.000	0.231	0.972	0.185	0.000	0.000	0.000	0.000	0.000		1.389
SSE	0.000	0.046	1.481	0.741	0.046	0.000	0.000	0.000	0.000		2.315
S	0.000	0.324	2.361	2.176	0.463	0.556	0.000	0.000	0.000		5.880
SSW	0.000	0.093	3.102	3.056	0.833	0.139	0.000	0.000	0.000		7.222
SW	0.000	0.046	2.083	1.204	0.139	0.139	0.000	0.000	0.000		3.611
WSW	0.000	0.046	0.694	0.278	0.370	0.093	0.000	0.000	0.000		1.481
W	0.000	0.000	0.509	0.509	0.139	0.370	0.000	0.000	0.000		1.528
WNW	0.000	0.046	0.417	0.417	0.370	0.093	0.000	0.000	0.000		1.343
NW	0.000	0.093	0.231	0.231	0.370	0.139	0.000	0.000	0.000		1.065
NNW	0.000	0.000	0.324	0.370	0.093	0.185	0.000	0.000	0.000		0.972
SUBTOTAL	0.000	1.065	17.176	12.685	4.583	1.944	0.000	0.000	0.000		37.454

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2160
TOTAL HOURS OF STABILITY CLASS D	809
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS D	809
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2160
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/08/18

MEAN WIND SPEED = 3.88

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS E      (-0.5< DELTA T<= 1.5 C/100 M)

WATTS BAR NUCLEAR PLANT

APR 1, 2017 - JUN 30, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.000	0.000	0.370	0.417	0.231	0.000	0.000	0.000	0.000		1.019
NNE	0.000	0.046	0.231	0.278	0.093	0.000	0.000	0.000	0.000		0.648
NE	0.000	0.139	0.324	0.231	0.000	0.000	0.000	0.000	0.000		0.694
ENE	0.000	0.000	0.417	0.185	0.000	0.000	0.000	0.000	0.000		0.602
E	0.000	0.324	0.278	0.046	0.000	0.000	0.000	0.000	0.000		0.648
ESE	0.000	0.185	0.093	0.000	0.000	0.000	0.000	0.000	0.000		0.278
SE	0.000	0.509	0.278	0.000	0.046	0.000	0.000	0.000	0.000		0.833
SSE	0.000	0.556	0.648	0.093	0.000	0.000	0.000	0.000	0.000		1.296
S	0.000	0.926	2.222	1.019	0.231	0.231	0.000	0.000	0.000		4.630
SSW	0.000	1.065	3.704	0.648	0.093	0.000	0.000	0.000	0.000		5.509
SW	0.000	0.787	2.037	0.185	0.324	0.000	0.000	0.000	0.000		3.333
WSW	0.000	0.694	0.694	0.139	0.139	0.000	0.000	0.000	0.000		1.667
W	0.000	0.787	0.741	0.093	0.046	0.093	0.000	0.000	0.000		1.759
WNW	0.000	0.556	0.648	0.324	0.231	0.000	0.000	0.000	0.000		1.759
NW	0.000	0.185	0.741	0.139	0.000	0.000	0.000	0.000	0.000		1.065
NNW	0.000	0.093	0.741	0.231	0.093	0.046	0.000	0.000	0.000		1.204
SUBTOTAL	0.000	6.852	14.167	4.028	1.528	0.370	0.000	0.000	0.000		26.944

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2160
TOTAL HOURS OF STABILITY CLASS E	582
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS E	582
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2160
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/08/18

MEAN WIND SPEED = 2.62

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS F ( 1.5< DELTA T<= 4.0 C/100 M)

WATTS BAR NUCLEAR PLANT

APR 1, 2017 - JUN 30, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.000	0.000	0.046	0.000	0.000	0.000	0.000	0.000	0.000		0.046
NNE	0.000	0.046	0.093	0.000	0.000	0.000	0.000	0.000	0.000		0.139
NE	0.001	0.046	0.139	0.046	0.000	0.000	0.000	0.000	0.000		0.232
ENE	0.000	0.046	0.046	0.000	0.000	0.000	0.000	0.000	0.000		0.093
E	0.001	0.185	0.139	0.000	0.000	0.000	0.000	0.000	0.000		0.325
ESE	0.001	0.046	0.139	0.000	0.000	0.000	0.000	0.000	0.000		0.186
SE	0.000	0.139	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.139
SSE	0.001	0.278	0.093	0.000	0.000	0.000	0.000	0.000	0.000		0.372
S	0.002	0.278	0.185	0.000	0.000	0.000	0.000	0.000	0.000		0.465
SSW	0.005	0.741	0.648	0.000	0.000	0.000	0.000	0.000	0.000		1.394
SW	0.006	0.880	0.741	0.000	0.000	0.000	0.000	0.000	0.000		1.626
WSW	0.007	1.389	0.648	0.000	0.000	0.000	0.000	0.000	0.000		2.044
W	0.008	1.667	0.787	0.000	0.000	0.000	0.000	0.000	0.000		2.462
WNW	0.008	1.944	0.417	0.000	0.000	0.000	0.000	0.000	0.000		2.369
NW	0.005	0.926	0.417	0.046	0.000	0.000	0.000	0.000	0.000		1.394
NNW	0.001	0.139	0.139	0.046	0.046	0.000	0.000	0.000	0.000		0.371
SUBTOTAL	0.046	8.750	4.676	0.139	0.046	0.000	0.000	0.000	0.000		13.657

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2160
TOTAL HOURS OF STABILITY CLASS F	295
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS F	295
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2160
TOTAL HOURS CALM	1

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/08/18

MEAN WIND SPEED = 1.38

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS G (DELTA T > 4.0 C/100 M)

WATTS BAR NUCLEAR PLANT

APR 1, 2017 - JUN 30, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.002	0.093	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.094
NNE	0.001	0.046	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.047
NE	0.003	0.139	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.141
ENE	0.003	0.185	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.189
E	0.001	0.046	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.047
ESE	0.004	0.185	0.046	0.000	0.000	0.000	0.000	0.000	0.000		0.236
SE	0.004	0.231	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.236
SSE	0.003	0.185	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.189
S	0.003	0.139	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.141
SSW	0.005	0.231	0.046	0.000	0.000	0.000	0.000	0.000	0.000		0.283
SW	0.023	1.111	0.139	0.000	0.000	0.000	0.000	0.000	0.000		1.273
WSW	0.043	1.898	0.417	0.000	0.000	0.000	0.000	0.000	0.000		2.358
W	0.063	2.917	0.509	0.000	0.000	0.000	0.000	0.000	0.000		3.489
WNW	0.050	2.361	0.370	0.000	0.000	0.000	0.000	0.000	0.000		2.782
NW	0.018	0.741	0.231	0.000	0.000	0.000	0.000	0.000	0.000		0.990
NNW	0.005	0.231	0.046	0.000	0.000	0.000	0.000	0.000	0.000		0.283
SUBTOTAL	0.231	10.741	1.806	0.000	0.000	0.000	0.000	0.000	0.000		12.778

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2160
TOTAL HOURS OF STABILITY CLASS G	276
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS G	276
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2160
TOTAL HOURS CALM	5

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/08/18

MEAN WIND SPEED = 1.12

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR  
STABILITY CLASS A (DELTA T<=-1.9 C/100 M)

WATTS BAR NUCLEAR PLANT

JUL 1, 2017 - SEP 30, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.000	0.000	0.000	0.181	0.136	0.136	0.000	0.000	0.000		0.453
NNE	0.000	0.000	0.000	0.045	0.272	0.362	0.000	0.000	0.000		0.680
NE	0.000	0.000	0.000	0.045	0.000	0.000	0.000	0.000	0.000		0.045
ENE	0.000	0.000	0.091	0.000	0.045	0.045	0.000	0.000	0.000		0.181
E	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
ESE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
SE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
SSE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
S	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
SSW	0.000	0.000	0.000	0.045	0.000	0.000	0.000	0.000	0.000		0.045
SW	0.000	0.000	0.045	0.000	0.000	0.000	0.000	0.000	0.000		0.045
WSW	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
W	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
WNW	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
NW	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
NNW	0.000	0.000	0.000	0.000	0.227	0.136	0.000	0.000	0.000		0.362
SUBTOTAL	0.000	0.000	0.136	0.317	0.680	0.680	0.000	0.000	0.000		1.812

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2207
TOTAL HOURS OF STABILITY CLASS A	40
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS A	40
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2207
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/10/13

MEAN WIND SPEED = 6.61

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS B      (-1.9< DELTA T<=-1.7 C/100 M)

WATTS BAR NUCLEAR PLANT

JUL 1, 2017 - SEP 30, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.000	0.000	0.000	0.091	0.091	0.091	0.000	0.000	0.000		0.272
NNE	0.000	0.000	0.000	0.136	0.317	0.227	0.000	0.000	0.000		0.680
NE	0.000	0.000	0.000	0.045	0.045	0.000	0.000	0.000	0.000		0.091
ENE	0.000	0.000	0.000	0.091	0.045	0.091	0.000	0.000	0.000		0.227
E	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
ESE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
SE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
SSE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
S	0.000	0.000	0.000	0.181	0.000	0.000	0.000	0.000	0.000		0.181
SSW	0.000	0.000	0.000	0.227	0.000	0.000	0.000	0.000	0.000		0.227
SW	0.000	0.000	0.000	0.045	0.000	0.000	0.000	0.000	0.000		0.045
WSW	0.000	0.000	0.000	0.045	0.000	0.000	0.000	0.000	0.000		0.045
W	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
WNW	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
NW	0.000	0.000	0.000	0.000	0.045	0.000	0.000	0.000	0.000		0.045
NNW	0.000	0.000	0.045	0.227	0.091	0.045	0.000	0.000	0.000		0.408
SUBTOTAL	0.000	0.000	0.045	1.087	0.634	0.453	0.000	0.000	0.000		2.220

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2207
TOTAL HOURS OF STABILITY CLASS B	49
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS B	49
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2207
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/10/13

MEAN WIND SPEED = 5.84

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS C      (-1.7< DELTA T<=-1.5 C/100 M)

WATTS BAR NUCLEAR PLANT

JUL 1, 2017 - SEP 30, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.000	0.000	0.045	0.317	0.227	0.181	0.000	0.000	0.000		0.770
NNE	0.000	0.000	0.091	0.091	0.181	0.045	0.000	0.000	0.000		0.408
NE	0.000	0.000	0.000	0.136	0.045	0.000	0.000	0.000	0.000		0.181
ENE	0.000	0.000	0.000	0.091	0.000	0.000	0.000	0.000	0.000		0.091
E	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
ESE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
SE	0.000	0.000	0.000	0.045	0.000	0.000	0.000	0.000	0.000		0.045
SSE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
S	0.000	0.000	0.000	0.136	0.045	0.000	0.000	0.000	0.000		0.181
SSW	0.000	0.000	0.000	0.181	0.045	0.000	0.000	0.000	0.000		0.227
SW	0.000	0.000	0.181	0.136	0.000	0.000	0.000	0.000	0.000		0.317
WSW	0.000	0.000	0.045	0.000	0.000	0.000	0.000	0.000	0.000		0.045
W	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
WNW	0.000	0.000	0.000	0.000	0.181	0.000	0.000	0.000	0.000		0.181
NW	0.000	0.000	0.045	0.181	0.136	0.000	0.000	0.000	0.000		0.362
NNW	0.000	0.000	0.045	0.317	0.000	0.000	0.000	0.000	0.000		0.362
SUBTOTAL	0.000	0.000	0.453	1.631	0.861	0.227	0.000	0.000	0.000		3.172

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2207
TOTAL HOURS OF STABILITY CLASS C	70
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS C	70
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2207
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/10/13

MEAN WIND SPEED = 4.90

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS D      (-1.5< DELTA T<=-0.5 C/100 M)

WATTS BAR NUCLEAR PLANT

JUL 1, 2017 - SEP 30, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.000	0.045	0.544	0.589	0.091	0.408	0.045	0.000	0.000		1.722
NNE	0.000	0.045	0.906	0.725	0.680	0.227	0.091	0.000	0.000		2.673
NE	0.000	0.000	1.133	0.861	0.045	0.000	0.000	0.000	0.000		2.039
ENE	0.000	0.091	1.223	0.498	0.181	0.045	0.000	0.000	0.000		2.039
E	0.000	0.091	1.133	0.227	0.091	0.000	0.000	0.000	0.000		1.541
ESE	0.000	0.045	0.816	0.272	0.045	0.000	0.000	0.000	0.000		1.178
SE	0.000	0.136	1.087	0.136	0.000	0.000	0.000	0.000	0.000		1.359
SSE	0.000	0.227	2.130	0.498	0.000	0.000	0.000	0.000	0.000		2.855
S	0.000	0.272	3.489	1.767	0.136	0.272	0.000	0.000	0.000		5.936
SSW	0.000	0.181	2.673	1.722	0.091	0.091	0.000	0.000	0.000		4.758
SW	0.000	0.227	1.631	0.498	0.091	0.000	0.000	0.000	0.000		2.447
WSW	0.000	0.091	0.634	0.181	0.000	0.000	0.000	0.000	0.000		0.906
W	0.000	0.091	0.408	0.091	0.000	0.000	0.000	0.000	0.000		0.589
WNW	0.000	0.136	0.408	0.272	0.227	0.045	0.000	0.000	0.000		1.087
NW	0.000	0.000	0.453	0.227	0.272	0.045	0.000	0.000	0.000		0.997
NNW	0.000	0.000	0.816	0.589	0.453	0.136	0.000	0.000	0.000		1.994
SUBTOTAL	0.000	1.676	19.483	9.153	2.401	1.269	0.136	0.000	0.000		34.119

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2207
TOTAL HOURS OF STABILITY CLASS D	753
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS D	753
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2207
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/10/13

MEAN WIND SPEED = 3.51

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS E      (-0.5< DELTA T<= 1.5 C/100 M)

WATTS BAR NUCLEAR PLANT

JUL 1, 2017 - SEP 30, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.001	0.136	0.272	0.453	0.181	0.091	0.000	0.000	0.000		1.134
NNE	0.001	0.091	0.498	0.498	0.453	0.091	0.045	0.000	0.000		1.678
NE	0.001	0.000	0.634	0.770	0.045	0.136	0.000	0.000	0.000		1.587
ENE	0.002	0.091	0.997	0.680	0.000	0.181	0.000	0.000	0.000		1.950
E	0.001	0.136	0.272	0.317	0.136	0.000	0.000	0.000	0.000		0.862
ESE	0.001	0.181	0.136	0.091	0.000	0.000	0.000	0.000	0.000		0.408
SE	0.001	0.181	0.362	0.136	0.000	0.000	0.000	0.000	0.000		0.681
SSE	0.002	0.498	0.453	0.091	0.045	0.000	0.000	0.000	0.000		1.089
S	0.006	0.952	2.130	0.362	0.136	0.045	0.000	0.000	0.000		3.631
SSW	0.008	1.042	3.217	0.272	0.045	0.000	0.000	0.000	0.000		4.585
SW	0.006	1.314	1.903	0.227	0.000	0.000	0.000	0.000	0.000		3.450
WSW	0.005	1.858	0.906	0.181	0.000	0.000	0.000	0.000	0.000		2.950
W	0.004	1.359	0.952	0.045	0.000	0.000	0.000	0.000	0.000		2.361
WNW	0.003	0.680	0.952	0.272	0.000	0.000	0.000	0.000	0.000		1.906
NW	0.002	0.227	0.816	0.272	0.091	0.000	0.000	0.000	0.000		1.407
NNW	0.001	0.091	0.317	0.725	0.362	0.000	0.000	0.000	0.000		1.496
SUBTOTAL	0.045	8.836	14.816	5.392	1.495	0.544	0.045	0.000	0.000		31.174

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2207
TOTAL HOURS OF STABILITY CLASS E	688
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS E	688
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2207
TOTAL HOURS CALM	1

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/10/13

MEAN WIND SPEED = 2.56

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS F ( 1.5< DELTA T<= 4.0 C/100 M)

WATTS BAR NUCLEAR PLANT

JUL 1, 2017 - SEP 30, 2017

WIND		WIND SPEED(MPH)									
DIRECTION	CALM	0.60-1.40	1.41-3.40	3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41	TOTAL	
N	0.000	0.000	0.136	0.000	0.000	0.000	0.000	0.000	0.000	0.136	
NNE	0.000	0.091	0.045	0.000	0.000	0.000	0.000	0.000	0.000	0.136	
NE	0.000	0.136	0.045	0.000	0.000	0.000	0.000	0.000	0.000	0.182	
ENE	0.000	0.045	0.136	0.000	0.000	0.000	0.000	0.000	0.000	0.182	
E	0.001	0.136	0.317	0.045	0.000	0.000	0.000	0.000	0.000	0.500	
ESE	0.000	0.136	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.136	
SE	0.000	0.045	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.045	
SSE	0.001	0.181	0.045	0.045	0.000	0.000	0.000	0.000	0.000	0.272	
S	0.001	0.453	0.091	0.000	0.000	0.000	0.000	0.000	0.000	0.545	
SSW	0.003	0.952	0.272	0.000	0.000	0.000	0.000	0.000	0.000	1.226	
SW	0.005	1.586	0.362	0.000	0.000	0.000	0.000	0.000	0.000	1.953	
WSW	0.008	2.583	0.453	0.045	0.000	0.000	0.000	0.000	0.000	3.089	
W	0.013	4.622	0.680	0.000	0.000	0.000	0.000	0.000	0.000	5.315	
WNW	0.009	2.537	0.906	0.045	0.000	0.000	0.000	0.000	0.000	3.497	
NW	0.002	0.589	0.272	0.045	0.000	0.000	0.000	0.000	0.000	0.908	
NNW	0.001	0.091	0.227	0.000	0.000	0.000	0.000	0.000	0.000	0.318	
SUBTOTAL	0.045	14.182	3.987	0.227	0.000	0.000	0.000	0.000	0.000	18.441	

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2207
TOTAL HOURS OF STABILITY CLASS F	407
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS F	407
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2207
TOTAL HOURS CALM	1

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/10/13

MEAN WIND SPEED = 1.31

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS G (DELTA T > 4.0 C/100 M)

WATTS BAR NUCLEAR PLANT

JUL 1, 2017 - SEP 30, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
NNE	0.000	0.000	0.045	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.046
NE	0.000	0.000	0.045	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.046
ENE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
E	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
ESE	0.000	0.045	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.046
SE	0.000	0.091	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.091
SSE	0.000	0.045	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.046
S	0.001	0.181	0.045	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.228
SSW	0.001	0.272	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.273
SW	0.007	1.223	0.136	0.000	0.000	0.000	0.000	0.000	0.000	0.000	1.366
WSW	0.008	1.541	0.136	0.000	0.000	0.000	0.000	0.000	0.000	0.000	1.685
W	0.014	2.673	0.181	0.000	0.000	0.000	0.000	0.000	0.000	0.000	2.869
WNW	0.010	1.495	0.408	0.000	0.000	0.000	0.000	0.000	0.000	0.000	1.913
NW	0.002	0.272	0.045	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.319
NNW	0.001	0.091	0.045	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.137
SUBTOTAL	0.045	7.929	1.087	0.000	0.000	0.000	0.000	0.000	0.000	0.000	9.062

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2207
TOTAL HOURS OF STABILITY CLASS G	200
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS G	200
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2207
TOTAL HOURS CALM	1

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2017/10/13

MEAN WIND SPEED = 1.09

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS A (DELTA T<=-1.9 C/100 M)

WATTS BAR NUCLEAR PLANT

OCT 1, 2017 - DEC 31, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.000	0.000	0.000	0.093	0.140	0.047	0.000	0.000	0.000		0.280
NNE	0.000	0.000	0.000	0.000	0.000	0.233	0.000	0.000	0.000		0.233
NE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
ENE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
E	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
ESE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
SE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
SSE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
S	0.000	0.000	0.047	0.000	0.047	0.000	0.000	0.000	0.000		0.093
SSW	0.000	0.000	0.047	0.000	0.000	0.000	0.000	0.000	0.000		0.047
SW	0.000	0.000	0.000	0.093	0.000	0.000	0.000	0.000	0.000		0.093
WSW	0.000	0.000	0.047	0.000	0.047	0.000	0.000	0.000	0.000		0.093
W	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
WNW	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
NW	0.000	0.000	0.000	0.093	0.000	0.000	0.000	0.000	0.000		0.093
NNW	0.000	0.000	0.000	0.093	0.047	0.000	0.000	0.000	0.000		0.140
SUBTOTAL	0.000	0.000	0.140	0.373	0.280	0.280	0.000	0.000	0.000		1.074

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2203
TOTAL HOURS OF STABILITY CLASS A	23
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS A	23
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2142
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2018/02/20

MEAN WIND SPEED = 6.18

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS B      (-1.9< DELTA T<=-1.7 C/100 M)

WATTS BAR NUCLEAR PLANT

OCT 1, 2017 - DEC 31, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.000	0.000	0.047	0.047	0.140	0.233	0.000	0.000	0.000		0.467
NNE	0.000	0.000	0.000	0.140	0.047	0.047	0.000	0.000	0.000		0.233
NE	0.000	0.000	0.000	0.047	0.047	0.000	0.000	0.000	0.000		0.093
ENE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
E	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
ESE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
SE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
SSE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
S	0.000	0.000	0.000	0.000	0.280	0.000	0.000	0.000	0.000		0.280
SSW	0.000	0.000	0.047	0.233	0.233	0.047	0.000	0.000	0.000		0.560
SW	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
WSW	0.000	0.000	0.000	0.000	0.140	0.000	0.000	0.000	0.000		0.140
W	0.000	0.000	0.000	0.000	0.047	0.000	0.000	0.000	0.000		0.047
WNW	0.000	0.000	0.000	0.000	0.093	0.093	0.000	0.000	0.000		0.187
NW	0.000	0.000	0.000	0.000	0.093	0.000	0.000	0.000	0.000		0.093
NNW	0.000	0.000	0.000	0.093	0.047	0.047	0.000	0.000	0.000		0.187
SUBTOTAL	0.000	0.000	0.093	0.560	1.167	0.467	0.000	0.000	0.000		2.288

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2203
TOTAL HOURS OF STABILITY CLASS B	49
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS B	49
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2142
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2018/02/20

MEAN WIND SPEED = 6.33

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS C      (-1.7< DELTA T<=-1.5 C/100 M)

WATTS BAR NUCLEAR PLANT

OCT 1, 2017 - DEC 31, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.000	0.000	0.233	0.000	0.047	0.233	0.000	0.000	0.000		0.514
NNE	0.000	0.000	0.047	0.233	0.047	0.047	0.000	0.000	0.000		0.373
NE	0.000	0.000	0.047	0.000	0.000	0.000	0.000	0.000	0.000		0.047
ENE	0.000	0.000	0.000	0.093	0.093	0.000	0.000	0.000	0.000		0.187
E	0.000	0.000	0.000	0.093	0.047	0.000	0.000	0.000	0.000		0.140
ESE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
SE	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.000
SSE	0.000	0.000	0.000	0.000	0.000	0.047	0.000	0.000	0.000		0.047
S	0.000	0.000	0.000	0.233	0.140	0.047	0.000	0.000	0.000		0.420
SSW	0.000	0.000	0.000	0.794	0.233	0.000	0.000	0.000	0.000		1.027
SW	0.000	0.000	0.047	0.187	0.000	0.000	0.000	0.000	0.000		0.233
WSW	0.000	0.000	0.093	0.047	0.047	0.000	0.000	0.000	0.000		0.187
W	0.000	0.000	0.000	0.047	0.093	0.047	0.000	0.000	0.000		0.187
WNW	0.000	0.000	0.000	0.047	0.000	0.000	0.000	0.000	0.000		0.047
NW	0.000	0.000	0.000	0.047	0.000	0.000	0.000	0.000	0.000		0.047
NNW	0.000	0.000	0.000	0.140	0.047	0.140	0.000	0.000	0.000		0.327
SUBTOTAL	0.000	0.000	0.467	1.961	0.794	0.560	0.000	0.000	0.000		3.782

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2203
TOTAL HOURS OF STABILITY CLASS C	81
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS C	81
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2142
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2018/02/20

MEAN WIND SPEED = 5.11

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS D      (-1.5< DELTA T<=-0.5 C/100 M)

WATTS BAR NUCLEAR PLANT

OCT 1, 2017 - DEC 31, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.000	0.000	0.794	1.307	0.700	0.420	0.000	0.000	0.000		3.221
NNE	0.000	0.000	0.700	0.980	0.373	0.233	0.000	0.000	0.000		2.288
NE	0.000	0.000	1.307	1.447	0.093	0.000	0.000	0.000	0.000		2.848
ENE	0.000	0.047	0.934	0.700	0.187	0.000	0.000	0.000	0.000		1.867
E	0.000	0.140	0.140	0.280	0.047	0.000	0.000	0.000	0.000		0.607
ESE	0.000	0.047	0.280	0.140	0.047	0.047	0.000	0.000	0.000		0.560
SE	0.000	0.280	0.420	0.047	0.000	0.047	0.000	0.000	0.000		0.794
SSE	0.000	0.140	0.700	0.140	0.187	0.047	0.000	0.000	0.000		1.214
S	0.000	0.280	1.494	1.587	0.233	0.420	0.000	0.000	0.000		4.015
SSW	0.000	0.233	2.614	1.681	0.420	0.233	0.000	0.000	0.000		5.182
SW	0.000	0.093	1.587	0.794	0.047	0.047	0.000	0.000	0.000		2.568
WSW	0.000	0.233	0.747	0.467	0.187	0.093	0.000	0.000	0.000		1.727
W	0.000	0.093	0.420	0.233	0.373	0.187	0.000	0.000	0.000		1.307
WNW	0.000	0.000	0.794	0.373	0.560	0.327	0.047	0.000	0.000		2.101
NW	0.000	0.093	0.467	0.934	0.934	0.887	0.000	0.000	0.000		3.315
NNW	0.000	0.093	0.747	1.774	1.541	1.727	0.000	0.000	0.000		5.882
SUBTOTAL	0.000	1.774	14.146	12.885	5.929	4.715	0.047	0.000	0.000		39.496

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2203
TOTAL HOURS OF STABILITY CLASS D	851
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS D	846
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2142
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2018/02/20

MEAN WIND SPEED = 4.43

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS E      (-0.5< DELTA T<= 1.5 C/100 M)

WATTS BAR NUCLEAR PLANT

OCT 1, 2017 - DEC 31, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.000	0.187	0.233	0.560	0.093	0.047	0.000	0.000	0.000		1.120
NNE	0.000	0.140	0.420	0.093	0.093	0.000	0.000	0.000	0.000		0.747
NE	0.000	0.093	0.794	0.373	0.047	0.000	0.000	0.000	0.000		1.307
ENE	0.000	0.047	0.607	0.327	0.000	0.000	0.000	0.000	0.000		0.980
E	0.000	0.327	0.280	0.000	0.000	0.000	0.000	0.000	0.000		0.607
ESE	0.000	0.093	0.093	0.093	0.000	0.000	0.000	0.000	0.000		0.280
SE	0.000	0.093	0.280	0.047	0.047	0.000	0.000	0.000	0.000		0.467
SSE	0.000	0.233	0.233	0.140	0.047	0.000	0.000	0.000	0.000		0.654
S	0.000	0.747	1.727	0.467	0.233	0.187	0.000	0.000	0.000		3.361
SSW	0.000	0.840	2.381	1.120	0.280	0.047	0.000	0.000	0.000		4.669
SW	0.000	0.607	1.681	0.187	0.000	0.000	0.000	0.000	0.000		2.474
WSW	0.000	0.420	0.980	0.000	0.093	0.000	0.000	0.000	0.000		1.494
W	0.000	0.887	0.934	0.093	0.000	0.047	0.000	0.000	0.000		1.961
WNW	0.000	0.420	0.560	0.280	0.093	0.000	0.000	0.000	0.000		1.354
NW	0.000	0.280	0.514	0.467	0.187	0.140	0.000	0.000	0.000		1.587
NNW	0.000	0.140	0.654	0.840	0.514	0.233	0.000	0.000	0.000		2.381
SUBTOTAL	0.000	5.556	12.372	5.089	1.727	0.700	0.000	0.000	0.000		25.444

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2203
TOTAL HOURS OF STABILITY CLASS E	552
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS E	545
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2142
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2018/02/20

MEAN WIND SPEED = 2.83

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS F ( 1.5< DELTA T<= 4.0 C/100 M)

WATTS BAR NUCLEAR PLANT

OCT 1, 2017 - DEC 31, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)		7.41-12.40	12.41-18.40	18.41-24.40	>=24.41	TOTAL
				3.41-5.40	5.41-7.40					
N	0.000	0.140	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.140
NNE	0.000	0.187	0.140	0.000	0.000	0.000	0.000	0.000	0.000	0.327
NE	0.000	0.093	0.093	0.000	0.000	0.000	0.000	0.000	0.000	0.187
ENE	0.000	0.047	0.140	0.000	0.000	0.000	0.000	0.000	0.000	0.187
E	0.000	0.187	0.187	0.000	0.000	0.000	0.000	0.000	0.000	0.373
ESE	0.000	0.093	0.093	0.000	0.000	0.000	0.000	0.000	0.000	0.187
SE	0.000	0.047	0.093	0.047	0.000	0.000	0.000	0.000	0.000	0.187
SSE	0.000	0.187	0.140	0.000	0.000	0.000	0.000	0.000	0.000	0.327
S	0.000	0.280	0.187	0.000	0.000	0.000	0.000	0.000	0.000	0.467
SSW	0.000	0.187	0.140	0.000	0.000	0.000	0.000	0.000	0.000	0.327
SW	0.000	0.560	0.607	0.000	0.000	0.000	0.000	0.000	0.000	1.167
WSW	0.000	1.494	0.794	0.000	0.000	0.000	0.000	0.000	0.000	2.288
W	0.000	2.474	0.887	0.000	0.000	0.000	0.000	0.000	0.000	3.361
WNW	0.000	2.007	1.307	0.047	0.000	0.000	0.000	0.000	0.000	3.361
NW	0.000	0.467	0.327	0.000	0.000	0.000	0.000	0.000	0.000	0.794
NNW	0.000	0.140	0.420	0.000	0.047	0.000	0.000	0.000	0.000	0.607
SUBTOTAL	0.000	8.590	5.556	0.093	0.047	0.000	0.000	0.000	0.000	14.286

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2203
TOTAL HOURS OF STABILITY CLASS F	324
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS F	306
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2142
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2018/02/20

MEAN WIND SPEED = 1.52

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

# 2017 Watts Bar Nuclear Plant Effluent and Waste Disposal Annual Report

JOINT PERCENTAGE FREQUENCIES OF WIND SPEED BY WIND DIRECTION FOR

STABILITY CLASS G (DELTA T > 4.0 C/100 M)

WATTS BAR NUCLEAR PLANT

OCT 1, 2017 - DEC 31, 2017

WIND DIRECTION	CALM	0.60-1.40	1.41-3.40	WIND SPEED(MPH)							TOTAL
				3.41-5.40	5.41-7.40	7.41-12.40	12.41-18.40	18.41-24.40	>=24.41		
N	0.002	0.140	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.143
NNE	0.002	0.140	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.143
NE	0.001	0.000	0.047	0.000	0.000	0.000	0.000	0.000	0.000		0.048
ENE	0.002	0.140	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.143
E	0.002	0.047	0.047	0.000	0.000	0.000	0.000	0.000	0.000		0.095
ESE	0.001	0.047	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.048
SE	0.006	0.233	0.093	0.000	0.000	0.000	0.000	0.000	0.000		0.333
SSE	0.002	0.093	0.000	0.000	0.000	0.000	0.000	0.000	0.000		0.095
S	0.007	0.233	0.140	0.000	0.000	0.000	0.000	0.000	0.000		0.380
SSW	0.008	0.420	0.047	0.000	0.000	0.000	0.000	0.000	0.000		0.475
SW	0.018	0.700	0.327	0.000	0.000	0.000	0.000	0.000	0.000		1.045
WSW	0.031	1.307	0.467	0.000	0.000	0.000	0.000	0.000	0.000		1.805
W	0.062	2.568	0.980	0.000	0.000	0.000	0.000	0.000	0.000		3.610
WNW	0.052	2.428	0.560	0.000	0.000	0.000	0.000	0.000	0.000		3.040
NW	0.026	0.934	0.560	0.000	0.000	0.000	0.000	0.000	0.000		1.520
NNW	0.011	0.373	0.280	0.047	0.000	0.000	0.000	0.000	0.000		0.712
SUBTOTAL	0.233	9.804	3.548	0.047	0.000	0.000	0.000	0.000	0.000		13.632

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	2203
TOTAL HOURS OF STABILITY CLASS G	323
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS G	292
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	2142
TOTAL HOURS CALM	5

METEOROLOGICAL FACILITY: WATTS BAR NUCLEAR PLANT  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

DATE PRINTED: 2018/02/20

MEAN WIND SPEED = 1.23

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

ATTACHMENT 1

Deviations from ODCM Controls/Surveillance Requirements

1/1/2017	ODCM 1/2.1.1 Control 1.1.1 Table 1.1-1 Item 2.a	On 1/1/2017 at 5:44, 0-RM-90-140 was not restored, ERCW Radiation Monitor following 0-SI-67-901-B, ERCW Pump Quarterly Pump Performance Test. An assumption was made that the rad monitor was inoperable for a reason other than being taken out for the SI performance and therefore not restored. Additionally, the MCR staff did not question the lit annunciator and therefore did not realize that only the B train monitor was restored. No evidence indicating a radioloactive release based on bounding data and monitoring. Sample collected at the 16.5 hour point versus the required 12 hour. CR 1295168 & CR 1247016 were written to document.
----------	---	---

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

ATTACHMENT 2

Radioactive Effluent Monitoring Instrumentation Inoperable for Greater than 30 days

1/10/17	ODCM 1/2.1.2 Control 1.1.2 Table 1.1-2 Items 3.a - 3.c	On 1/10/17 at 10:32, 2-RM-90-400 was removed from service for the performance of Unit 2 (2-ODI-090-083, 18 Month Channel Calibration of Shield Building Vent Flow Monitor Loop 2-LPF-90-400), it was discovered that the control signal could not be calibrated at that time. A new 155 Adam had been installed but did not correct the issue. All Calibration per ODI was completed SAT. Work Orders 117547600, 117487962, and 118668702 initiated for troubleshooting. Kurz vendor in to troubleshoot and resolve. Portable compensatory equipment installed for monitoring any releases during this time. Monitor declared Operable on 8/26/17. CR 1261084 written to document.
---------	--	--

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

ATTACHMENT 3

Corrections to Previous ARERRs Revision Page

None

2017  
Watts Bar Nuclear Plant  
Effluent and Waste Disposal Annual Report

ATTACHMENT 4

Two-Unit Offsite Dose Calculation Manual Revision 01 (no revisions in 2017)

## **WATTS BAR NUCLEAR PLANT**

### **TWO-UNIT OFFSITE DOSE CALCULATION MANUAL (ODCM)**

Revision 1

Prepared by: Charles S. Denton  
Chemistry

Date: 09/24/2015

Submitted By: Terry W. Wilburn

Date: 09/24/2015

Approved By: Mitch Taggart  
PORC Chairman

Date: 09/24/2015

PORC Meeting No. : 4478

Plant Manager: Glen Pry

Effective Date: 10/22/2015

**REVISION LOG**  
Page 1 of 1

<b>REVISION NUMBER</b>	<b>EFFECTIVE DATE</b>	<b>AFFECTED PAGES</b>	<b>DESCRIPTION OF REVISION</b>
0	10/22/15	All	Initial issue of Watts Bar Nuclear Plant Two-Unit ODCM (WBN Two-Unit ODCM) to address operation of both units. The WBN Two-Unit ODCM, Revision 0 is based on Unit 0 ODCM, Revision 25 and recent changes to the monitored locations. The WBN Two-Unit ODCM will be the governing document for WBN Unit 1 and WBN Unit 2.
1	10/22/15	16 and 17	Changed Table 1.1-2 to delete Item 3d, Isokinetic Flow Control Equipment, and Applicability Notation 6 regarding isokinetic flow control operability and the requirement to restore isokinetic flow manually. ECP 65345A.

**LIST OF EFFECTIVE PAGES**

<u>PAGE NUMBER</u>	<u>REVISION NUMBER</u>	<u>PAGE NUMBER</u>	<u>REVISION NUMBER</u>
1	0	30	0
2	0	31	0
3	0	32	0
4	0	33	0
5	0	34	0
6	0	35	0
7	0	36	0
8	0	37	0
9	0	38	0
10	0	39	0
11	0	40	0
12	0	41	0
13	0	42	0
14	0	43	0
15	0	44	0
16	1	45	0
17	1	46	0
18	0	47	0
19	0	48	0
20	0	49	0
21	0	50	0
22	0	51	0
23	0	52	0
24	0	53	0
25	0	54	0
26	0	55	0
27	0	56	0
28	0	57	0
29	0	58	0

**LIST OF EFFECTIVE PAGES**

<b>PAGE NUMBER</b>	<b>REVISION NUMBER</b>	<b>PAGE NUMBER</b>	<b>REVISION NUMBER</b>
59	0	89	0
60	0	90	0
61	0	91	0
62	0	92	0
63	0	93	0
64	0	94	0
65	0	95	0
66	0	96	0
67	0	97	0
68	0	98	0
69	0	99	0
70	0	100	0
71	0	101	0
72	0	102	0
73	0	103	0
74	0	104	0
75	0	105	0
76	0	106	0
77	0	107	0
78	0	108	0
79	0	109	0
80	0	110	0
81	0	111	0
82	0	112	0
83	0	113	0
84	0	114	0
85	0	115	0
86	0	116	0
87	0	117	0
88	0	118	0

**LIST OF EFFECTIVE PAGES**

<b>PAGE NUMBER</b>	<b>REVISION NUMBER</b>	<b>PAGE NUMBER</b>	<b>REVISION NUMBER</b>
119	0	149	0
120	0	150	0
121	0	151	0
122	0	152	0
123	0	153	0
124	0	154	0
125	0	155	0
126	0	156	0
127	0	157	0
128	0	158	0
129	0	159	0
130	0	160	0
131	0	161	0
132	0	162	0
133	0	163	0
134	0	164	0
135	0	165	0
136	0	166	0
137	0	167	0
138	0	168	0
139	0	169	0
140	0	170	0
141	0	171	0
142	0	172	0
143	0	173	0
144	0	174	0
145	0	175	0
146	0	176	0
147	0	177	0
148	0	178	0

**LIST OF EFFECTIVE PAGES**

<u>PAGE NUMBER</u>	<u>REVISION NUMBER</u>	<u>PAGE NUMBER</u>	<u>REVISION NUMBER</u>
179	0		
180	0		
181	0		
182	0		
183	0		
184	0		
185	0		
186	0		
187	0		
188	0		
189	0		
190	0		
191	0		
192	0		
193	0		
194	0		
195	0		
196	0		
197	0		
198	0		
199	0		
200	0		
201	0		
202	0		
203	0		
204	0		
205	0		

# **TABLE OF CONTENTS**

(Page 1 of 2)

TABLE OF CONTENTS .....	6
LIST OF TABLES/FIGURES .....	7
1.0 INTRODUCTION.....	8
1.0/2.0 - CONTROLS AND SURVEILLANCE REQUIREMENTS.....	9
1/2.0 APPLICABILITY .....	9
1/2.1 INSTRUMENTATION.....	10
1/2.1.1 RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION .....	10
1/2.1.2 RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION .....	15
1/2.1.3 METEOROLOGICAL INSTRUMENTATION/DATA.....	21
1/2.2 RADIOACTIVE EFFLUENTS .....	23
1/2.2.1 LIQUID EFFLUENTS .....	23
1/2.2.1.1 CONCENTRATION.....	23
1/2.2.1.2 DOSE.....	27
1/2.2.1.3 LIQUID RADWASTE TREATMENT SYSTEM .....	28
1/2.2.2 GASEOUS EFFLUENTS.....	29
1/2.2.2.1 DOSE RATE .....	29
1/2.2.2.2 DOSE - NOBLE GASES .....	33
1/2.2.2.3 DOSE - I-131, I-133, C-14, TRITIUM, AND RADIONUCLIDES IN PARTICULATE FORM WITH HALF-LIVES GREATER THAN EIGHT DAYS.....	34
1/2.2.2.4 GASEOUS RADWASTE TREATMENT .....	35
1/2.2.3 TOTAL DOSE .....	36
1/2.3 RADIOLOGICAL ENVIRONMENTAL MONITORING .....	37
1/2.3.1 MONITORING PROGRAM .....	37
1/2.3.2 LAND USE CENSUS .....	47
1/2.3.3 INTERLABORATORY COMPARISON PROGRAM.....	48
BASES .....	50
3.0 DEFINITIONS .....	57
4.0 - (NOT USED).....	63
5.0 ADMINISTRATIVE CONTROLS .....	63
6.0 - LIQUID EFFLUENTS .....	67
7.0 - GASEOUS EFFLUENTS .....	104
8.0 - TOTAL DOSE .....	171
9.0 - RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM (REMP) .....	172
10.0 REFERENCES.....	184
11.0 SOURCE NOTES .....	186
APPENDIX A - NOTATION CONVENTIONS.....	188
LIST OF ACRONYMS .....	193
LIST OF UNITS.....	194
APPENDIX B - DEVIATIONS IN THE WBN ODCM CONTROLS/SURVEILLANCE REQUIREMENTS FROM THOSE GIVEN IN NUREG-1301 .....	195
APPENDIX C - WBN ODCM REVISION PROCESS.....	199

**TABLE OF CONTENTS**  
(Page 2 of 2)  
**LIST OF TABLES/FIGURES****TABLES**

1.1-1 - RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION .....	11
2.1-1 - RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION - SURVEILLANCE REQUIREMENTS.....	13
1.1-2 - RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION.....	16
2.1-2 - RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION - SURVEILLANCE REQUIREMENTS.....	19
1.1-3 - METEOROLOGICAL MONITORING INSTRUMENTATION.....	22
2.2-1 - RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM.....	24
2.2-2 - RADIOACTIVE GASEOUS WASTE MONITORING SAMPLING AND ANALYSIS PROGRAM.....	30
2.3-1 - MINIMUM REQUIRED RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM.....	39
2.3-2 - REPORTING LEVELS FOR RADIOACTIVITY CONCENTRATIONS IN ENVIRONMENTAL SAMPLES...	44
2.3-3 - DETECTION CAPABILITIES FOR ENVIRONMENTAL SAMPLE ANALYSIS - LLD.....	45
2.3-4 - DETECTION CAPABILITIES FOR GROUNDWATER HARD-TO-DETECT NUCLIDES - LLD.....	46
3.1 - FREQUENCY NOTATION.....	60
3.2 - OPERATIONAL MODES.....	61
6.1 - RECEPTORS FOR LIQUID DOSE CALCULATIONS.....	84
6.2 - RADIONUCLIDE DECAY AND STABLE ELEMENT TRANSFER DATA.....	85
6.3 - DOSE CALCULATION FACTORS.....	88
6.4 - INGESTION DOSE FACTORS.....	90
6.5 - BIOACCUMULATION FACTORS FOR FRESHWATER FISH.....	98
6.6 - EXTERNAL DOSE FACTORS FOR STANDING ON CONTAMINATED GROUND.....	99
7.1 - WBN - OFFSITE RECEPTOR LOCATION DATA.....	145
7.2 - JOINT PERCENTAGE FREQUENCIES OF WIND DIRECTION AND WIND SPEED FOR DIFFERENT STABILITY CLASSES.....	146
7.3 - ADJUSTED DISPERSION FACTORS.....	153
7.4 - DOSE FACTORS FOR SUBMERSION IN NOBLE GASES.....	154
7.5 - SECTOR ELEMENTS CONSIDERED FOR POPULATION DOSES.....	155
7.6 - POPULATION WITHIN EACH SECTOR ELEMENT.....	156
7.7 - INHALATION DOSE FACTORS.....	157
9.1 - REMP - MONITORING, SAMPLING, AND ANALYSIS.....	174
9.2 - REMP - SAMPLING LOCATIONS.....	179
9.3 - REMP - DOSIMETRY LOCATIONS .....	180

**FIGURES**

3.1 - WBN SITE AREA MAP.....	62
6.1 - LIQUID EFFLUENT RELEASE POINTS.....	101
6.2 - LIQUID RADWASTE SYSTEM.....	102
6.3 - STEAM GENERATOR BLOWDOWN/CONDENSATE DEMINERALIZER.....	103
7.1 - GASEOUS EFFLUENT RELEASE/DISCHARGE POINTS.....	165
7.2 - DETAIL OF GASEOUS RELEASE/DISCHARGE POINTS.....	166
7.3 - GASEOUS RADWASTE TREATMENT SYSTEM.....	167
7.4 - PLUME DEPLETION EFFECT FOR GROUND LEVEL RELEASES.....	168
7.5 - VERTICAL STANDARD DEVIATION OF MATERIAL IN A PLUME.....	169
7.6 - RELATIVE DEPOSITION FOR GROUND LEVEL RELEASES.....	170
9.1 - REMP LOCATIONS WITHIN ONE MILE OF THE PLANT.....	181
9.2 - REMP LOCATIONS FROM ONE TO FIVE MILES FROM THE PLANT.....	182
9.3 - REMP LOCATIONS GREATER THAN FIVE MILES FROM THE PLANT.....	183

## 1.0 INTRODUCTION

The Watts Bar Nuclear Plant (WBN) Units 1 and 2 Offsite Dose Calculation Manual (ODCM) is a supporting document of the WBN Technical Specifications (TS) required by WBN TS 5.7.2.3<sup>1</sup>. The ODCM is divided into two major parts: Controls (Sections 1 through 5) and program description (Sections 6 through 9). References are given in each section as applicable and are further described in Section 10.0.

The first part of the ODCM (Sections 1 through 5) contains:

- 1) Radioactive Effluent Controls required by Section 5.7.2.7 of the WBN TS;
- 2) Radiological Environmental Monitoring Controls required by 10 CFR Part 50, Appendix I, Section IV.B;
- 3) Controls for Meteorological Monitoring Instrumentation;
- 4) Descriptions of the information that should be included in the Annual Radiological Environmental Operating and Radioactive Effluent Release Reports required by WBN Technical Specifications 5.9.2 and 5.9.3; and
- 5) Administrative Controls for the ODCM requirements.

These sections of the document have been prepared using the guidance provided in NUREG-1301 (Reference 1) and draft Nuclear Regulatory Commission Generic Letter (Reference 2). Exceptions to this guidance have been documented in Appendix B to the ODCM.

The second part of the ODCM (Sections 6 through 9) contains the methodologies and parameters used to:

- 1) Calculate offsite doses resulting from radioactive gaseous and liquid effluents;
- 2) Calculate gaseous and liquid effluent monitor Alarm/Trip setpoints; and,
- 3) Conduct the Radiological Environmental Monitoring Program (REMP).

These methodologies and parameters were developed using the guidance in NUREG-0133 (Reference 3); Regulatory Guide 1.109 (Reference 4); Regulatory Guide 1.111 (Reference 5); Regulatory Guide 1.113 (Reference 6); Regulatory Guide 1.21 (Reference 7); and Radiological Assessment Branch Technical Position on Environmental Monitoring (Reference 8). Where any methodology or parameter differs from the guidance provided in the above documents, it has been documented in the text and references given for the source of the information.

---

<sup>1</sup> References to the WBN TS in this ODCM refer to both the Unit 1 and Unit 2 TS (Reference 30).

## 1.0/2.0 - CONTROLS AND SURVEILLANCE REQUIREMENTS

### 1/2.0 APPLICABILITY

#### CONTROLS

- 1.0.1 Controls shall be met during the MODES or other specified conditions in the Applicability, except as provided in Control 1.0.2.
- 1.0.2 Upon discovery of a failure to meet a Control, the Action(s) of the associated Conditions shall be met. If the Control is met or is no longer applicable prior to expiration of the Action(s), completion of the Action(s) is not required unless otherwise stated.

#### SURVEILLANCE REQUIREMENTS

- 2.0.1 Surveillance Requirements (SR) shall be met during MODES or other conditions in the Applicability for individual Controls, unless otherwise stated in the SR. Failure to meet the Control occurs when a surveillance is failed or when conditions occur between surveillances that would result in a failed surveillance if testing was performed. Failure to perform surveillance within the specified frequency shall be failure to meet the Control except as provided in SR 2.0.3. The time limits of the ACTION statements are applicable at the time it is identified that a Surveillance Requirement has not been performed. Surveillances do not have to be performed on inoperable equipment or variables outside specified limits.
- 2.0.2 The specified frequency for each SR is met if the surveillance is performed within 1.25 times the interval specified in the frequency, as measured from the previous performance or as measured from a time a specified condition of the frequency is met. However, the combined time interval for any three consecutive surveillance intervals shall not exceed 3.25 times the specified surveillance interval.
- For frequencies specified as "once," the above interval extension does not apply.
- If an Action requires periodic performance on a "once per..." basis, the above frequency extension applies to each performance after the initial performance.
- Exceptions to this SR control section are stated in the individual SRs.
- 2.0.3 If it is discovered that a surveillance was not performed within its specified frequency, then compliance with the requirement to declare the Control not met may be delayed, from the time of discovery, up to 24 hours or up to the limit of the specified frequency, whichever is less. This delay period is permitted to allow performance of the surveillance.
- If the surveillance is not performed within the delay period, the Control must immediately be declared not met, and the applicable Action(s) must be entered. The Action(s) begin immediately upon expiration of the delay period.
- When the surveillance is performed within the delay period and the surveillance is not met, the Control must immediately be entered. The Action(s) begin immediately upon failure to meet the surveillance.
- 2.0.4 Entry into a MODE or other specified condition in the Applicability of a Control shall not be made unless the Control's surveillances have been met within their specified frequency. This provision shall not prevent passage through to MODES or other specified conditions in compliance with Action(s).

## **1/2 CONTROLS AND SURVEILLANCE REQUIREMENTS**

### **1/2.1 INSTRUMENTATION**

#### **1/2.1.1 RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION**

##### **CONTROLS**

1.1.1 As required by WBN TS 5.7.2.7.a, the radioactive liquid effluent monitoring instrumentation channels shown in Table 1.1-1 shall be OPERABLE with their alarm/trip setpoints set to ensure that the limits of ODCM Control 1.2.1.1 are not exceeded. The alarm/trip setpoints of these channels shall be determined in accordance with the methodology and parameters in ODCM Section 6.2.

APPLICABILITY: This requirement is applicable as shown in Table 1.1-1.

##### **ACTION**:

- a. With a radioactive liquid effluent monitoring instrumentation channel alarm/trip setpoint less conservative than required by the above control, immediately suspend the release of radioactive liquid effluents monitored by the affected channel, or declare the channel inoperable, or change the setpoint so that it is acceptably conservative.
- b. With less than the minimum number of radioactive liquid effluent monitoring instrumentation channels OPERABLE, take the action shown in Table 1.1-1. Restore the inoperable instruments to OPERABLE status within 30 days and, if unsuccessful, explain in the next Annual Radioactive Effluent Release Report, pursuant to ODCM Administrative Control 5.2, why the inoperability was not corrected within 30 days.
- c. The provisions of SR 2.0.4 are not applicable. Report all deviations in the Annual Radioactive Effluent Release Report.

##### **SURVEILLANCE REQUIREMENTS**

2.1.1 Each radioactive liquid effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION, and CHANNEL OPERATIONAL TEST operations at the frequencies shown in Table 2.1-1.

**Table 1.1-1 - RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION**  
(Page 1 of 2)

INSTRUMENT	MINIMUM CHANNELS OPERABLE	ACTION	APPLICABILITY
<b>1. RADIOACTIVITY MONITORS PROVIDING ALARM AND AUTOMATIC TERMINATION OF RELEASE</b>			
a. Liquid Radwaste Effluent Line (0-RE-90-122)	1	A	(2)
b. Steam Generator Blowdown Effluent Line (1,2-RE-90-120 and -121)*	1	B	(3)
c. Condensate Demineralizer Regenerant Effluent Line (0-RE-90-225)	1	A	(2)
<b>2. RADIOACTIVITY MONITORS PROVIDING ALARM BUT NOT PROVIDING AUTOMATIC TERMINATION OF RELEASE</b>			
a. Essential Raw Cooling Water Effluent Header (0-RE-90-133,-134,-140,-141)	1/Discharge Header	C	(1)
b. Turbine Building Sump Effluent Line (0-RE-90-212)	1	C	(1)
<b>3. FLOW RATE MEASUREMENT DEVICES</b>			
a. Liquid Radwaste Effluent Line (0-FIT-77-5042)	1	D	(2)
b. Steam Generator Blowdown Effluent Line (1,2-FIT-15-42)	1	D	(3)
c. Condensate Demineralizer Effluent Line (0-FI-14-456)	1	D	(2)
d. Diffuser Discharge Effluent Line (0-LPF-27-98)	1	D	(2)

Applicability Notation:

(1) At all times.

(2) During releases via this pathway.

(3) During releases in MODES 1, 2, 3, and 4.

Notes:

\* The 1,2-RE-90-120 notation means that there are both a Unit 1 and a Unit 2 monitor with equipment numbers 1-RE-90-120 and 2-RE-90-120, respectively. This naming convention is used throughout this ODCM.

**Table 1.1-1 RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION**

(Page 2 of 2)  
TABLE NOTATION

ACTION A - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, the contents of the tank(s) may be released to the environment provided that prior to initiating the release:

- a. At least two independent samples of the tank's contents obtained by two technically qualified members of the facility staff are analyzed, and
- b. At least two technically qualified members of the facility staff independently verify the release rate calculations,
- c. At least two technically qualified members of the facility staff independently verify the discharge valve lineup;

Otherwise, suspend release of radioactive effluents via this pathway.

ACTION B - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided grab samples are analyzed for principal gamma emitters in accordance with ODCM SR 2.2.1.1.1 and 2.2.1.1.2.

- a. At least once per 12 hours when the specific activity of the secondary coolant is equal to or greater than  $0.01\mu\text{Ci/g}$  DOSE EQUIVALENT I-131, or
- b. At least once per 24 hours when the specific activity of the secondary coolant is less than  $0.01\mu\text{Ci/g}$  DOSE EQUIVALENT I-131.

ACTION C - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided that, at least once per 12 hours, grab samples are collected and analyzed for principal gamma emitters in accordance with ODCM SR 2.2.1.1.1 and 2.2.1.1.2.

ACTION D - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided the flow rate is estimated at least once per 4 hours during actual releases. Pump curves or the change in tank level indication, if applicable, may be used to estimate flow.

**Table 2.1-1 - RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION -  
SURVEILLANCE REQUIREMENTS\***

(Page 1 of 2)

INSTRUMENT	CHANNEL CHECK	SOURCE CHECK	CHANNEL CALIBRATION	CHANNEL OPERATIONAL TEST
<b>1. RADIOACTIVITY MONITORS PROVIDING ALARM AND AUTOMATIC TERMINATION OF RELEASE</b>				
a. Liquid Radwaste Effluent Line (0-RE-90-122)	D	P	R(3)	3Q(1)
b. Steam Generator Blowdown Effluent Line (1,2-RE-90-120 and -121)	D	M	R(3)	3Q(1, 7)
c. Condensate Demineralizer Regenerant Effluent Line (0-RE-90-225)	D	P/M**	R(3)	3Q(1)
<b>2. RADIOACTIVITY MONITORS PROVIDING ALARM BUT NOT PROVIDING AUTOMATIC TERMINATION OF RELEASE</b>				
a. Essential Raw Cooling Water Effluent Line (0-RE-90-133,-134,-140,-141)	D	M	R(3)	3Q(2)
b. Turbine Building Sump Effluent Line (0-RE-90-212)	D	M	R(3)	3Q(2)
<b>3. FLOW RATE MEASUREMENT DEVICES</b>				
a. Liquid Radwaste Effluent Line (0-FIT-77-5042)	D(4)	N/A	R	N/A
b. Steam Generator Blowdown Effluent Line (1,2-FIT-15-42)	D(4)	N/A	R***	N/A
c. Condensate Demineralizer Effluent Line (0-FI-14-456)	D(4)	N/A	R	N/A
d. Diffuser Discharge Effluent Line (0-LPF-27-98)	D(4)	N/A	Y	Q

\* See Table 3.1 (FREQUENCY NOTATION) for the surveillance frequency definitions.

\*\* The source check on the condensate demineralizer radiation monitor will be performed monthly during periods of no release, and prior to each batch release during release periods (when secondary coolant activity determination (principal gamma emitters) is greater than  $1 \times 10^{-6}$   $\mu\text{Ci/g}$ ).

\*\*\* 1-FIT-15-42 and 2-FIT-15-42 are programmable devices that have no calibration features. Therefore, a calibration verification satisfies the channel calibration requirement.

**Table 2.1-1 RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION  
SURVEILLANCE REQUIREMENTS**

(Page 2 of 2)

TABLE NOTATION

- (1) The CHANNEL OPERATIONAL TEST shall demonstrate that automatic isolation of this pathway occurs if the instrument indicates measured levels above the alarm/trip setpoint. The CHANNEL OPERATIONAL TEST also demonstrates control room annunciation occurs if any of the following conditions exist:
  1. Instrument indicates measured levels above the alarm setpoint, or
  2. Indication of downscale failure, or
  3. Instrumentation controls not set in operate mode, *or*
  4. Loss of sample flow.
- (2) The CHANNEL OPERATIONAL TEST shall demonstrate that control room alarm annunciation occurs if any of the following conditions exists:
  1. Instrument indicates measured levels above the alarm setpoint, or
  2. Indication of downscale failure, or
  3. Instrumentation controls not set in operate mode.
- (3) The initial CHANNEL CALIBRATION shall be performed using one or more of the reference standards certified by the National Institute of Standards and Technology (NIST) or using standards that have been obtained from suppliers that are traceable via measurement assurance activities with NIST. These standards shall permit calibrating the system over its intended range of energy and measurement range. For subsequent CHANNEL CALIBRATION, NIST traceable standards or sources that have been related to the initial calibration (transfer calibration sources) shall be used.
- (4) CHANNEL CHECK shall consist of verifying indication of flow during periods of release. CHANNEL CHECK shall be made at least once per 24 hours on days on which continuous, periodic or batch releases are made.
- (5) Reserved for future use.
- (6) Reserved for future use.
- (7) The CHANNEL OPERATIONAL TEST for Unit 2 monitors will be on a Quarterly (Q) basis.

## **1/2 CONTROLS AND SURVEILLANCE REQUIREMENTS**

### **1/2.1 INSTRUMENTATION**

#### **1/2.1.2 RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION**

##### **CONTROLS**

1.1.2 In accordance with WBN TS 5.7.2.7.a, the radioactive gaseous effluent monitoring instrumentation channels shown in Table 1.1-2 shall be OPERABLE with their alarm/trip setpoints set to ensure that the limits of ODCM Control 1.2.2.1 and Technical Specification 3.3.6 are not exceeded. The alarm/trip setpoints of these channels shall be determined and adjusted in accordance with the methodology and parameters in ODCM Section 7.1.

APPLICABILITY: As shown in Table 1.1-2.

##### **ACTION:**

- a. With a radioactive gaseous effluent monitoring instrumentation channel alarm/trip setpoint less conservative than required by the above Control, immediately suspend the release of radioactive gaseous effluents monitored by the affected channel, or declare the channel inoperable, or change the setpoint so it is acceptably conservative.
- b. With less than the minimum number of radioactive gaseous effluent monitoring instrumentation channels OPERABLE, take the ACTION shown in Table 1.1-2. Restore the inoperable instruments to OPERABLE status within 30 days and, if unsuccessful, explain in the next Annual Radioactive Effluent Release Report, per ODCM Administrative Control 5.2, why the inoperability was not corrected within 30 days.
- c. The provisions of SR 2.0.4 are not applicable. Report all deviations in the Annual Radioactive Effluent Release Report.

##### **SURVEILLANCE REQUIREMENTS**

2.1.2. Each radioactive gaseous effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION, and CHANNEL OPERATIONAL TEST at the frequencies shown in Table 2.1-2.

Table 1.1-2 - RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

(Page 1 of 3)

INSTRUMENT	MINIMUM CHANNELS OPERABLE	APPLICABILITY	ACTION
<b>1. WASTE GAS DISPOSAL SYSTEM</b>			
a. Noble Gas Activity Monitor (0-RE-90-118)	1	(9)	A
b. Pressure Measuring Device WGD T A 0-PIS-77-115 WGD T B 0-PIS-77-114 WGD T C 0-PIS-77-113 WGD T D 0-PIS-77-100 WGD T E 0-PIS-77-101 WGD T F 0-PIS-77-102 WGD T G 0-PIS-77-145 WGD T H 0-PIS-77-146 WGD T J 0-PIS-77-147	1	(9)(8)	J
<b>2. CONDENSER VACUUM EXHAUST SYSTEM</b>			
a. Noble Gas Activity Monitors (1,2-RE-90-119)	1	(3)	C
b. Reserved for future use.			
c. Flow Rate Monitor (1,2-FE-2-256)	1	(3)	B
d. Iodine/Particulate Sample Line Heat Trace [SOURCE NOTE 13]	1	(3)	K
<b>3. SHIELD BUILDING EXHAUST SYSTEM</b>			
a. Noble Gas Low Range Activity Monitor (1,2-RE-90-400A)	1	(2)	E
b. Iodine/Particulate Sampler and Sampler Flow Rate Measuring Device (1,2-RE-90-400 - Monitor Item 028)	1	(2)(5)	D
c. Effluent Flow Rate Measuring Device (1,2-FI-90-400)	1	(2)	B, E
d. Reserved for future use.			
e. Iodine/Particulate Sample Line Heat Trace [SOURCE NOTE 13]	1	(2)	G
f. Tritium flowrate measuring device (1,2-FIQ-90-801)	1	(11)	M
<b>4. AUXILIARY BUILDING VENTILATION SYSTEM AND FUEL HANDLING AREA VENTILATION SYSTEM</b>			
a. Noble Gas Activity Monitor (0-RE-90-101B)	1	(1)	C
b. Iodine/Particulate Sampler and Sampler Flow Rate Measuring Device (0-FIS-90-101C)	1	(1)(5)(7)	D
c. Effluent Flow Rate Measuring Device (0-FI-90-300/1B)	1	(1)	B, L
d. Isokinetic Flow Control Equipment [SOURCE NOTE 11]	1	(10)	H
e. Tritium flowrate measuring device (FIQ-90-800)	1	(11)	M
<b>5. SERVICE BUILDING VENTILATION SYSTEM</b>			
a. Noble Gas Activity Monitor (0-RE-90-132B)	1	(1)	C
b. Effluent Flow Rate Measuring System (0-FI-90-320/1B)	1	(1)	B
<b>6. CONTAINMENT PURGE AND EXHAUST SYSTEM</b>			
a. Noble Gas Activity Monitors (1,2-RE-90-130, 1,2-RE-90-131)	1	(4)	F

**Table 1.1-2 - RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION**

(Page 2 of 3)

**Applicability Notation:**

- (1) At all times.
- (2) At all times. Both Unit 1 and 2 Shield Building Exhaust System equipment must meet the minimum channel OPERABLE requirement even for single unit operation.. Operability of shield building noble gas activity monitor requires both flow rate and radiation inputs since the high radiation alarm is only on the effluent channel, which reads in  $\mu\text{Ci/s}$ .
- (3) In MODES 1 through 6 when Condenser Vacuum Exhaust System is in operation.
- (4) At all times in MODES 1, 2, 3, 4.
- (5) Applies to charcoal and particulate filters, does not apply to detection channels.
- (6) Reserved for future use.
- (7) Auxiliary Building Exhaust iodine/particulate sampler may be considered operable with the isokinetic flow control equipment inoperable.
- (8) The pressure indicator for the WGDT being released must be operable for the tank to be released.
- (9) At all times during periods of release.
- (10) Isokinetic sampling on the Auxiliary Building Exhaust is required when flow rate exceeds 160,000 SCFM. At lower flow rates, transmission factors will be used based on the measured flow rate.
- (11) At all times during periods of release when irradiated TPBARs are in the Reactor or in the Spent Fuel Pool.

**Compensatory Actions**

- ACTION A - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, the contents of the tank(s) may be released to the environment provided that prior to initiating the release:
- a. At least two independent samples of the tank's contents obtained by two technically qualified members of the facility staff are analyzed, and
  - b. At least two technically qualified members of the Facility Staff independently verify the release rate calculations, and
  - c. At least two technically qualified members of the Facility Staff independently verify the discharge valve lineup;
- Otherwise, suspend release of radioactive effluents via this pathway.
- ACTION B - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided the flow rate is estimated at least once per 4 hours during releases via this pathway.
- ACTION C - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided grab samples are taken at least once per 12 hours and these samples are analyzed for noble gases (gamma emitters) in accordance with plant procedures. Grab samples are required only during those periods when releases are being made.
- ACTION D - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via the affected pathway may continue provided that within 4 hours after the channel has been declared inoperable, samples are continuously collected with auxiliary sampling equipment as required in Table 2.2-2. Continuous sampling is required only during those periods when releases are being made.

**Table 1.1-2 - RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION**  
(Page 3 of 3)

**Compensatory Actions (Continued)**

- ACTION E - Flow Rate Channel Inoperable - With an inoperable flow element on a discharge pathway where a fan is operating (Purge A, Purge B, ABGTS, or EGTS), effluent release may continue provided: (a) "Low Rng" on 1, 2-RE-90-400 is selected instead of "Eff"; and (b) at least once per 12 hours associated instrument malfunction is verified not annunciated; and (c) a reading from "Low Rng" on 1, 2-RE-90-400 is obtained at least once per 24 hours during the release.  
Radiation Monitor Inoperable - With the "EFF" and "LOW RNG" channels inoperable, effluent releases may continue provided grab samples are taken at least once per 12 hours and these samples are analyzed for noble gases (gamma emitters) in accordance with plant procedures. Grab samples are required only during those periods when releases are being made.
- ACTION F - With the number of channels OPERABLE less than required by the Minimum Channel OPERABLE requirement, immediately suspend PURGING of radioactive effluents via this pathway.
- ACTION G - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, planned ongoing effluent releases via the affected pathway may continue provided that within 4 hours after the channel has been declared inoperable, the equipment is restored to OPERABLE.
- ACTION H - With the required equipment inoperable, effluent releases may continue via this pathway provided the sampler's transmission factor(s) are corrected for the loss of this equipment.
- ACTION J - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases from that WGDT must be discontinued until the channel is OPERABLE.
- ACTION K - With the heat trace inoperable and auxiliary sampling equipment required for iodine and particulate collection, effluent releases via the affected pathway may continue provided that steam generator activity is evaluated weekly to determine if a path exists for release of iodine or particulate activity, and any such activity being released is quantified in accordance with plant procedures.
- ACTION L - With the required equipment INOPERABLE due to the flowrate being greater than 0 and less than 100,000 scfm, manually adjust sample loop 0-LPF-90-300 flowrate to 20 scfm +/- 1 scfm within 4 hours to return the channel to operable status.  
  
In addition, if the flow rate is greater than 0 and less than 40,000 scfm, then verify at least one Auxiliary Building or Fuel Handling exhaust fan is running.
- ACTION M - With the required equipment inoperable, effluent releases may continue via the pathway provided that within 24 hours after the channel has been declared inoperable, samplers are replaced or tritium grab samples are taken once per 24 hours. Sampling is required only during those periods when applicability note (11) is met.

**Table 2.1-2 - RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION -  
SURVEILLANCE REQUIREMENTS\***

(Page 1 of 2)

INSTRUMENT	CHANNEL CHECK	SOURCE CHECK	CHANNEL CALIBRATION	CHANNEL OPERATIONAL TEST
<b>1. WASTE GAS DISPOSAL SYSTEM</b>				
a. Noble Gas Activity Monitor (0-RE-90-118)	P	P	R(3)	3Q(1)
b. Pressure Measuring Device	P	N/A	R	N/A
WGDT A 0-PIS-77-115				
WGDT B 0-PIS-77-114				
WGDT C 0-PIS-77-113				
WGDT D 0-PIS-77-100				
WGDT E 0-PIS-77-101				
WGDT F 0-PIS-77-102				
WGDT G 0-PIS-77-145				
WGDT H 0-PIS-77-146				
WGDT J 0-PIS-77-147				
<b>2. CONDENSER VACUUM EXHAUST SYSTEM</b>				
a. Noble Gas Activity Monitor (1,2-RE-90-119)	D	M	R(3)	3Q(2,4)
b. Reserved for future use.				
c. Effluent Flow Rate Measuring Device (1,2-FE-2-256)	D	N/A	R	N/A
d. Reserved for future use.				
e. Iodine/Particulate Sample Line Heat Trace [SOURCE NOTE 13]	N/A	N/A	N/A	Q
<b>3. SHIELD BUILDING EXHAUST SYSTEM</b>				
a. Noble Gas Low Range Activity Monitor (1,2-RE-90-400A)	D	M	R(3)	3Q(2,4)
b. Iodine and Particulate Sampler (1,2-RE-90-402)	N/A	N/A	N/A	N/A
c. Effluent Flow Rate Measuring Device (1,2-FI-90-400)	D	N/A	R	Q
d. Sampler Flow Rate Measuring Device (1,2-RE-90-400 - Monitor Item 028)	D	N/A	R	Q
e. Iodine/Particulate Sample Line Heat Trace [SOURCE NOTE 13]	N/A	N/A	N/A	Q
f. Tritium Flow Rate Measuring Device (1,2-FIQ-90-801)	D	N/A	Y	N/A
<b>4. AUXILIARY BUILDING VENTILATION AND FUEL HANDLING AREA VENTILATION SYSTEM</b>				
a. Noble Gas Activity Monitor (0-RE-90-101B)	D	M	R(3)	3Q(2)
b. Iodine and Particulate Sampler (0-RE-90-101)	N/A	N/A	N/A	N/A
c. Effluent Flow Rate Measuring Device (0-FI-90-300/1B)	D	N/A	R	Q
d. Sampler Flow Rate Measuring Device (0-FIS-90-101C)	D	N/A	R	Q
e. Tritium Flow Rate Measuring Device (FIQ-90-800)	D	N/A	Y	N/A
<b>5. SERVICE BUILDING VENTILATION SYSTEM</b>				
a. Noble Gas Activity Monitor (0-RE-90-132)	D	M	R(3)	3Q(2)
b. Effluent Flow Rate Measuring System (0-FI-90-320/1B)	D	N/A	R	Q
<b>6. CONTAINMENT PURGE AND EXHAUST SYSTEM</b>				
a. Noble Gas Activity Monitors (1,2-RE-90-130, 1,2-RE-90-131)	***	P	***(3)	***

\* See Table 3.1 (FREQUENCY NOTATION) for the surveillance frequency definitions.

\*\*\* See WBN TS SR 3.3.6.1, SR 3.3.6.7, and SR 3.3.6.4 for these requirements.

**Table 2.1-2 - RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION  
SURVEILLANCE REQUIREMENTS\***

(Page 2 of 2)

**TABLE NOTATION**

- (1) The CHANNEL OPERATIONAL TEST shall also demonstrate that automatic isolation of this pathway and control room alarm annunciation occurs if any of the following conditions exists:
  1. Instrument indicates measured levels above the alarm/trip setpoint, or
  2. Indication of downscale failure, or
  3. Instrumentation controls not set in operate mode.
- (2) The CHANNEL OPERATIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exists:
  1. Instrument indicates measured levels above the alarm setpoint, or
  2. Indication of downscale failure, or
  3. Instrumentation controls not set in operate mode.
- (3) The initial CHANNEL CALIBRATION shall be performed using one or more of the reference standards certified by the National Institute of Standards and Technology (NIST) or using standards that have been obtained from suppliers that are traceable via measurement assurance activities with NIST. These standards shall permit calibrating the system over its intended range of energy and measurement range. For subsequent CHANNEL CALIBRATION, NIST traceable standards or sources that have been related to the initial calibration (transfer calibration sources) shall be used.
- (4) The CHANNEL OPERATIONAL TEST for Unit 2 monitors will be on a Quarterly (Q) basis.

## **1/2 CONTROLS AND SURVEILLANCE REQUIREMENTS**

### **1/2.1 INSTRUMENTATION**

#### **1/2.1.3 METEOROLOGICAL INSTRUMENTATION/DATA**

##### **CONTROLS**

1.1.3 The meteorological monitoring instrumentation channels shown in Table 1.1-3 shall be OPERABLE.

APPLICABILITY: At all times.

##### **ACTION**:

With one or more required meteorological monitoring channels inoperable for more than 7 days, prepare and submit a Special Report to the NRC, pursuant to ODCM Administrative Control 5.4, within the next 10 days outlining the cause of the malfunction and the plans for restoring the channel(s) to OPERABLE status.

The provisions of SR 2.0.4 are not applicable.

##### **SURVEILLANCE REQUIREMENTS**

2.1.3 Each of the above meteorological instrumentation channels shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK at least once per 24 hours and the CHANNEL CALIBRATION at least once per 184 days.

**Table 1.1-3 - METEOROLOGICAL MONITORING INSTRUMENTATION**

Instrument	Location	Minimum OPERABLE
1. WIND SPEED		
Channel 1	Nominal Height 10 m	2 of 3
Channel 2	Nominal Height 46 m	
Channel 3	Nominal Height 91 m	
2. WIND DIRECTION		
Channel 1	Nominal Height 10 m	2 of 3
Channel 2	Nominal Height 46 m	
Channel 3	Nominal Height 91 m	
3. AIR TEMPERATURE - DELTA T		
Channel 1	Nominal Height 10 m to 46 m	1 of 3
Channel 2	Nominal Height 10 m to 91 m	
Channel 3	Nominal Height 46 m to 91 m	

## **1/2 CONTROLS AND SURVEILLANCE REQUIREMENTS**

### **1/2.2 RADIOACTIVE EFFLUENTS**

#### **1/2.2.1 LIQUID EFFLUENTS**

##### **1/2.2.1.1 CONCENTRATION**

###### **CONTROLS**

1.2.1.1 In accordance with WBN TS 5.7.2.7.b and c, the concentration of radioactive material released in liquid effluents to UNRESTRICTED AREAS (see Figure 3.1) shall be limited to 10 times the concentration values specified in Appendix B, Table 2, Column 2 to 10 CFR 20.1001-20.2402 for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the concentration shall be limited to  $2 \times 10^{-4}$   $\mu\text{Ci/ml}$  total activity.

APPLICABILITY: At all times.

###### ACTION:

With the concentration of radioactive material released in liquid effluents exceeding the above limits, immediately restore the concentration to within the above limits.

The provisions of SR 2.0.4 are not applicable. Report all deviations in the Annual Radioactive Effluent Release Report.

## **SURVEILLANCE REQUIREMENTS**

2.2.1.1.1 Radioactive liquid wastes shall be sampled and analyzed according to the sampling and analysis program of Table 2.2-1.

2.2.1.1.2 The results of the radioactivity analysis shall be used in accordance with the methodology and parameters in ODCM Section 6.1 to assure that the concentrations at the point of release are maintained within the limits of Control 1.2.1.1.

**Table 2.2-1 - RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM \***  
(Page 1 of 3)

Liquid Release Type	Minimum Sampling Frequency	Minimum Analysis Frequency	Type of Activity Analysis	Lower Limit of Detection (LLD) <sup>1</sup> (μCi/ml)
Batch Release Tanks <sup>2</sup> A. Radwaste System Tanks Waste Condensate A, B, & C Cask Decontamination Chemical Drain Monitor Laundry and Hot Shower A&B Tritiated Water Storage B. Condensate Demineralizer System Tanks <sup>6</sup> Waste Neutralization Non-Reclaimable Waste High Crud A&B	P Each Batch	P Each Batch	Principal Gamma Emitters <sup>3</sup>	5x10 <sup>-7</sup>
			I-131	1x10 <sup>-6</sup>
	P One Batch/M	M	Dissolved/ Entrained Noble Gases (Gamma Emitters)	1x10 <sup>-5</sup>
	P Each Batch	M Lab Composite <sup>4</sup>	H-3	1x10 <sup>-5</sup>
			Gross Alpha	1x10 <sup>-7</sup>
	P Each Batch	Q Lab Composite <sup>4</sup>	Sr-89, Sr-90	5x10 <sup>-8</sup>
			Fe-55	1x10 <sup>-6</sup>
Continuous Releases <sup>5</sup> C. Steam Generator Blowdown <sup>6</sup> D. Turbine Building Sump <sup>6</sup>  E. Groundwater Sump	D Grab Sample	D Each Grab Sample	Principal Gamma Emitters <sup>3</sup>	5x10 <sup>-7</sup>
			I-131	1x10 <sup>-6</sup>
	M Grab Sample	M	Dissolved/ Entrained Noble Gases (Gamma Emitters)	1x10 <sup>-5</sup>
	D Grab Sample	M Lab Composite <sup>4</sup>	H-3	1x10 <sup>-5</sup>
			Gross Alpha	1x10 <sup>-7</sup>
	D Grab Sample	Q Lab Composite <sup>4</sup>	Sr-89, Sr-90	5x10 <sup>-8</sup>
			Fe-55	1x10 <sup>-6</sup>
	M Grab Sample	M Each Grab Sample	Principal Gamma Emitters <sup>3</sup>	5x10 <sup>-7</sup>
			I-131	1x10 <sup>-6</sup>
			Dissolved/ Entrained Noble Gases (Gamma Emitters)	1x10 <sup>-5</sup>
			H-3	1x10 <sup>-5</sup>
	Q Grab Sample	Q Grab Sample	Sr-89, Sr-90	5x10 <sup>-8</sup>

\*See Table 3.1 (FREQUENCY NOTATION) for the surveillance frequency definitions.

Table 2.2-1 - RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM

(Page 2 of 3)  
TABLE NOTATION

<sup>1</sup> The LLD is defined for the purpose of these Controls as the smallest concentration of radioactive material in a sample that will yield a net count, above system background, that will be detected with 95% probability with only a 5% probability of falsely concluding that a blank observation represents a "real" signal. (Reference 8)

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{4.66s_b}{E V 2.22E6 Y \exp(-\lambda\Delta t)}$$

where:

LLD = the "a priori" lower limit of detection (microcurie per unit mass or volume).

$s_b$  = the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (counts per minute).

E = the counting efficiency (counts per disintegration).

V = the sample size (units of mass or volume).

$2.22 \times 10^6$  = the number of disintegrations per minute per microcurie.

Y = the fractional radiochemical yield, when applicable.

$\lambda$  = the radioactive decay constant for the particular radionuclide ( $s^{-1}$ ), and

Dt = the elapsed time between midpoint of sample collection and time of counting (s). The definition of Dt applies only to the calculation of the LLD. A more rigorous treatment of the buildup and decay during the sample collection and/or counting interval(s) may be applied to actual sample analysis if desired.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not an a posteriori (after the fact) limit for a particular measurement.

Typical values of E, V, Y, and  $\Delta t$  should be used in the calculation.

<sup>2</sup> A batch release is the discharge of liquid wastes of a discrete volume. Prior to sampling for analyses, each batch shall be isolated and then thoroughly mixed by the method described in appropriate plant procedures to assure representative sampling.

<sup>3</sup> The principal gamma emitters for which the LLD Control applies exclusively are the following radionuclides: Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, Ce-141. Ce-144 shall also be measured, but with an LLD of  $5 \times 10^{-6}$   $\mu\text{Ci/ml}$ . This list does not mean that only these nuclides are to be considered. Other gamma peaks which are identifiable, together with those of the above nuclides, shall also be analyzed and reported in the Annual Radioactive Effluent Release Report pursuant to ODCM Administrative Control 5.2, in the format outlined in Regulatory Guide 1.21, Appendix B, Revision 1, June 1974.

<sup>4</sup> A laboratory composite sample is one prepared by combining representative samples from each release into one well-mixed, homogeneous sample. The volume of sample added to the composite from each release shall be proportional to the release volume. The composite sample shall be preserved according to plant procedures as appropriate.

**Table 2.2-1 - RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM**

(Page 3 of 3)

**TABLE NOTATION**

<sup>5</sup> A continuous release is the discharge of liquid wastes of a nondiscrete volume; e.g., from a system that has an input flow during the continuous release.

<sup>6</sup> Not applicable when most recent Secondary Coolant System activity determination (principal gamma emitters) is less than or equal to  $1 \times 10^{-6}$   $\mu\text{Ci/g}$  and either of the following conditions exist: (1) the discharge radiation monitor setpoint is less than or equal to 2 times background or (2) compensatory requirements associated with applicable inoperable monitors are met.

## **1/2 CONTROLS AND SURVEILLANCE REQUIREMENTS**

### **1/2.2 RADIOACTIVE EFFLUENTS**

#### **1/2.2.1 LIQUID EFFLUENTS**

##### **1/2.2.1.2 DOSE**

##### **CONTROLS**

1.2.1.2 In accordance with WBN TS 5.7.2.7.d and e, the dose or dose commitment to a MEMBER OF THE PUBLIC from radioactive materials in liquid effluents discharged from each unit to UNRESTRICTED AREAS (see Figure 3.1) shall be limited:

- a. During any calendar quarter to less than or equal to 1.5 mrem to the total body and to less than or equal to 5 mrem to any organ, and
- b. During any calendar year to less than or equal to 3 mrem to the total body and to less than or equal to 10 mrem to any organ.

**APPLICABILITY:** At all times.

##### **ACTION:**

With the calculated dose from the release of radioactive materials in liquid effluents exceeding any of the above limits, prepare and submit to the NRC within 30 days, pursuant to ODCM Administrative Control 5.4, a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits. This Special Report shall also include: (1) the results of radiological analyses of drinking water sources and (2) the radiological impact on finished drinking water supplies with regard to the requirements of 40 CFR 141, Safe Drinking Water Act, (applicable only if drinking water supply is taken from the receiving water body within three miles downstream of the plant discharge).

The provisions of SR 2.0.4 are not applicable.

##### **SURVEILLANCE REQUIREMENTS**

2.2.1.2 Cumulative dose contributions from liquid effluents for the current calendar quarter and current calendar year shall be determined in accordance with the methodology and parameters in ODCM Section 6.3 at least once per 31 days.  
[SOURCE NOTE 5]

## **1/2 CONTROLS AND SURVEILLANCE REQUIREMENTS**

### **1/2.2 RADIOACTIVE EFFLUENTS**

#### **1/2.2.1 LIQUID EFFLUENTS**

##### **1/2.2.1.3 LIQUID RADWASTE TREATMENT SYSTEM**

### **CONTROLS**

1.2.1.3 In accordance with WBN TS 5.7.2.7.f, the Liquid Radwaste Treatment System (LRTS) shall be OPERABLE and appropriate portions of the system shall be used to reduce the radioactive materials in liquid wastes prior to their discharge when the projected doses due to the liquid effluent from each unit to UNRESTRICTED AREAS (see Figure 3.1) would exceed 0.06 mrem to the total body or 0.2 mrem to any organ in a 31-day period.

APPLICABILITY: At all times.

### **ACTION**:

With radioactive liquid waste being discharged without treatment and in excess of the above limits and any portion of the LRTS not in operation, prepare and submit to the NRC within 30 days, pursuant to ODCM Administrative Control 5.4, a Special Report which includes the following information:

1. Explanation of why liquid waste was being discharged without treatment, identification of the inoperable equipment or subsystems, and the reason for the inoperability,
2. Action(s) taken to restore the inoperable equipment to OPERABLE status, and
3. Summary description of action(s) taken to prevent a recurrence.

The provisions of SR 2.0.4 are not applicable.

### **SURVEILLANCE REQUIREMENTS**

2.2.1.3.1 Doses due to liquid releases from each unit to UNRESTRICTED AREAS shall be projected at least once per 31 days, in accordance with the methodology and parameters in ODCM Section 6.5 when the LRTS are not being fully utilized.  
[SOURCE NOTE 9]

2.2.1.3.2 The installed LRTS shall be considered OPERABLE by meeting ODCM Controls 1.2.1.1 and 1.2.1.2.

## **1/2 CONTROLS AND SURVEILLANCE REQUIREMENTS**

### **1/2.2 RADIOACTIVE EFFLUENTS**

#### **1/2.2.2 GASEOUS EFFLUENTS**

##### **1/2.2.2.1 DOSE RATE**

###### **CONTROLS**

1.2.2.1 In accordance with WBN TS 5.7.2.7.g, the dose rate due to radioactive materials released in gaseous effluents from the site to areas at and beyond the UNRESTRICTED AREA BOUNDARY (see Figure 3.1) shall be limited to the following:

- a. For noble gases: Less than or equal to a dose rate of 500 mrem/y to the total body and less than or equal to a dose rate of 3000 mrem/y to the skin, and
- b. For Iodine-131, Iodine-133, tritium, and for all radionuclides in particulate form with half-lives greater than 8 days: Less than or equal to a dose rate of 1500 mrem/y to any organ.

**APPLICABILITY:** At all times.

###### **ACTION:**

With dose rate(s) exceeding the above limits, immediately restore the release rate to within the above limit(s).

The provisions of SR 2.0.4 are not applicable. Report all deviations in the Annual Radioactive Effluent Release Report.

###### **SURVEILLANCE REQUIREMENTS**

2.2.2.1.1 The dose rate due to noble gases in gaseous effluents shall be determined to be within the above limits in accordance with the methodology and parameters in ODCM Section 7.2.2 by obtaining representative samples and performing analyses in accordance with the sampling and analysis program specified in Table 2.2-2.  
[SOURCE NOTE 7]

2.2.2.1.2 The dose rate due to Iodine-131, Iodine-133, tritium, and all radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents shall be determined to be within the above limits in accordance with the methodology and parameters in ODCM Section 7.2.3 by obtaining representative samples and performing analyses in accordance with the sampling and analysis program specified in Table 2.2-2.  
[SOURCE NOTE 7,1]

**Table 2.2-2-RADIOACTIVE GASEOUS WASTE MONITORING SAMPLING AND ANALYSIS PROGRAM\***  
(Page 1 of 3)

Gaseous Release Type	Minimum Sampling Frequency	Analysis Frequency	Type of Activity Analysis	Lower Limit of Detection (LLD) ( $\mu\text{Ci/ml}$ ) <sup>1</sup>
A. Waste Gas Decay Tank	P Each Tank Grab Sample	P Each Tank	Noble Gases <sup>2</sup> (Gamma Emitters)	$1 \times 10^{-4}$
			H-3 (oxide)	$1 \times 10^{-6}$
B. Containment PURGE <sup>3</sup>	p <sup>8</sup> Each PURGE Grab Sample	P Each Purge	Noble Gases <sup>2</sup> (Gamma Emitters)	$1 \times 10^{-4}$
C. Incore Instrument Room PURGE <sup>3</sup>	Each PURGE <sup>9</sup> Grab Sample	Each Purge	Noble Gases <sup>2</sup> (Gamma Emitters)	$1 \times 10^{-4}$
D. Reserved for future use.				
E. Auxiliary Building Exh. <sup>3,10</sup> F. Condenser Vacuum Exh. <sup>11</sup> G. Service Building Exh.	M Grab Sample	M	Noble Gases <sup>2</sup> (Gamma Emitters)	$1 \times 10^{-4}$
H. Reserved for future use. I. Reserved for future use. J. Reserved for future use.				
K. Auxiliary Building Exh. L. Shield Building Exh. M. Condenser Vacuum Exh. <sup>11,12</sup>	Continuous <sup>6</sup> Tritium Sample	W	H-3 (oxide)	$1 \times 10^{-6}$
	Continuous <sup>6</sup> Charcoal Sample	W <sup>7</sup>	I-131 I-133	$1 \times 10^{-12}$ $1 \times 10^{-10}$
	Continuous <sup>6</sup> Particulate Sample	W <sup>7</sup>	Principal Gamma Emitters <sup>2</sup>	$1 \times 10^{-11}$
	Continuous <sup>6</sup> Composite Particulate Sample	M	Gross Alpha	$1 \times 10^{-11}$
		Q	Sr-89, Sr-90	$1 \times 10^{-11}$

\* See Table 3.1 (FREQUENCY NOTATION) for the surveillance frequency definitions.

**Table 2.2-2-RADIOACTIVE GASEOUS WASTE MONITORING SAMPLING AND ANALYSIS PROGRAM**  
(Page 2 of 3)  
TABLE NOTATION

- <sup>1</sup> The LLD is defined in Note 1 of Table 2.2-1.
- <sup>2</sup> The principal gamma emitters for which the LLD Control applies include the following radionuclides: Kr-87, Kr-88, Xe-133, Xe-133m, Xe-135, and Xe-138 in noble gas releases and Mn-54, Fe-59, I-131, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, Ce-141 and Ce-144 in Iodine and particulate releases. This list does not mean that only these nuclides are to be considered. Other gamma peaks that are identifiable, together with the above nuclides, shall also be analyzed and reported in the Annual Radioactive Effluent Release Report pursuant to ODCM Administrative Control 5.2, in the format outlined in Regulatory Guide 1.21, Appendix B, Revision 1, June 1974.
- <sup>3</sup> Sampling and analysis for containment purges, incore instrument room purges, and the Auxiliary Building Exhaust shall also be performed following shutdown, startup, or a thermal power change exceeding 15% of RATED THERMAL POWER within a 1 hour period unless (a) analysis shows that the DOSE EQUIVALENT I-131 concentration in the reactor coolant has not increased more than a factor of 3 and (b) the containment noble gas activity monitor (0-RE-90-106 or 0-RE-90-112) or latest grab sample obtained as compensatory requirement associated with applicable inoperable monitor shows that the radioactivity has not increased by more than a factor of 3.
- <sup>4</sup> Reserved for future use.
- <sup>5</sup> Reserved for future use.
- <sup>6</sup> The ratio of the sample flow rate to the sampled stream flow rate shall be known for the time period covered by each dose or dose rate calculation made in accordance with ODCM Controls 1.2.2.1, 1.2.2.2, and 1.2.2.3.
- <sup>7</sup> Samples shall be changed at least once per 7 days. Analyses shall be completed within 48 hours after changing, or after removal from sampler for those release points that had a discharge during the sampling period. Sampling shall also be performed at least once per 24 hours for at least 7 days following each shutdown, startup, or THERMAL POWER change exceeding 15% of RATED THERMAL POWER within a one hour period for those release points that had a discharge during the sampling period. Analyses of samples shall be completed within 48 hours of changing. When samples collected for 24 hours are analyzed, the corresponding LLDs may be increased by a factor of 10. This daily sampling and analysis requirement does not apply if: (1) analysis shows that the DOSE EQUIVALENT I-131 concentration in the reactor coolant has not increased by more than a factor of 3; and (2) the containment noble gas monitor aligned to lower containment (1,2-RE-90-106 or 1,2-RE-90-112) or latest grab sample obtained as compensatory requirement associated with applicable inoperable monitor shows that the radioactivity has not increased by more than a factor of 3.
- <sup>8</sup> In all MODES, the compartment(s) of the containment to be purged shall be sampled for noble gas prior to PURGING.
- <sup>9</sup> The incore instrument room PURGE sample shall be obtained at the shield building monitor between 5 and 20 minutes following initiation of the incore instrument room PURGE.

**Table 2.2-2-RADIOACTIVE GASEOUS WASTE MONITORING SAMPLING AND ANALYSIS PROGRAM**

(Page 3 of 3)

TABLE NOTATION

- <sup>10</sup> Applicable in MODES 1, 2, 3, and 4, the containment will be VENTED to the containment annulus and then to the auxiliary building via containment annulus fans. The lower containment noble gas monitor (1,2-RE-90-106 or -112) response will be recorded daily when VENTING is occurring to monitor the radioactivity being discharged. The Auxiliary Building Exhaust will be re-sampled when the reading on the lower containment radiation monitor (1,2-RE-90-106 or -112) increases by 50% from the initial value. If the lower containment noble gas monitor (1,2-RE-90-106 or -112) is inoperable, noble gas grab samples may be used to perform this comparison.
- <sup>11</sup> Not applicable when the most recent Secondary Coolant System radioactivity determination (principal gamma emitters) is less than or equal to  $1 \times 10^{-6} \mu\text{Ci/g}$  and either of the following conditions exist:  
(1) the discharge radiation monitor setpoint is less than or equal to 2 times background or  
(2) compensatory requirements associated with applicable inoperable monitors are met.
- <sup>12</sup> Continuous tritium sample collection not applicable.

## **1/2 CONTROLS AND SURVEILLANCE REQUIREMENTS**

### **1/2.2 RADIOACTIVE EFFLUENTS**

#### **1/2.2.2 GASEOUS EFFLUENTS**

##### **1/2.2.2.2 DOSE - NOBLE GASES**

### **CONTROLS**

1.2.2.2 In accordance with WBN TS 5.7.2.7.h, the air dose due to noble gases released in gaseous effluents from each unit to areas at and beyond the UNRESTRICTED AREA BOUNDARY (see Figure 3.1) shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 5 mrad for gamma radiation and less than or equal to 10 mrad for beta radiation, and
- b. During any calendar year: Less than or equal to 10 mrad for gamma radiation and less than or equal to 20 mrad for beta radiation.

**APPLICABILITY:** At all times.

### **ACTION:**

With the calculated air dose from radioactive noble gases in gaseous effluents exceeding any of the above limits, prepare and submit to the NRC within 30 days, pursuant to ODCM Administrative Control 5.4, a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits.

The provisions of SR 2.0.4 are not applicable.

### **SURVEILLANCE REQUIREMENTS**

2.2.2.2 Cumulative dose contributions for the current calendar quarter and current calendar year for noble gases shall be determined in accordance with the methodology and parameters in ODCM Section 7.3 at least once per 31 days.  
[SOURCE NOTE 5]

## **1/2 CONTROLS AND SURVEILLANCE REQUIREMENTS**

### **1/2.2 RADIOACTIVE EFFLUENTS**

#### **1/2.2.2 GASEOUS EFFLUENTS**

##### **1/2.2.2.3 DOSE - I-131, I-133, C-14, TRITIUM, AND RADIONUCLIDES IN PARTICULATE FORM WITH HALF-LIVES GREATER THAN EIGHT DAYS**

### **CONTROLS**

1.2.2.3 In accordance with WBN TS 5.7.2.7.i, the dose to a MEMBER OF THE PUBLIC from I-131, I-133, C-14, tritium, and all radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents released from each unit to areas at and beyond the UNRESTRICTED AREA BOUNDARY (see Figure 3.1) shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 7.5 mrem to any organ and,
- b. During any calendar year: Less than or equal to 15 mrem to any organ.

**APPLICABILITY:** At all times.

### **ACTION:**

With the calculated dose from the release of I-131, I-133, C-14, tritium, and all radionuclides in particulate form with half-lives greater than 8 days, in gaseous effluents exceeding any of the above limits, prepare and submit to the NRC within 30 days, pursuant to ODCM Administrative Control 5.4, a Special Report which identifies the cause(s) for exceeding the limit(s) and defines the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits.

The provisions of SR 2.0.4 are not applicable.

### **SURVEILLANCE REQUIREMENTS**

2.2.2.3 Cumulative dose contributions for the current calendar quarter and current calendar year for I-131, I-133, C-14, tritium, and all radionuclides in particulate form with half-lives greater than 8 days shall be determined in accordance with the methodology and parameters in ODCM Section 7.4 at least once per 31 days.  
[SOURCE NOTE 5]

## **1/2 CONTROLS AND SURVEILLANCE REQUIREMENTS**

### **1/2.2 RADIOACTIVE EFFLUENTS**

#### **1/2.2.2 GASEOUS EFFLUENTS**

##### **1/2.2.2.4 GASEOUS RADWASTE TREATMENT**

### **CONTROLS**

1.2.2.4 In accordance with WBN TS 5.7.2.7.f, the VENTILATION EXHAUST TREATMENT SYSTEM and the WASTE GAS HOLDUP SYSTEM shall be OPERABLE and appropriate portions of these systems shall be used to reduce releases of radioactivity when the projected doses in 31 days due to gaseous effluent releases from each unit to areas at and beyond the UNRESTRICTED AREA BOUNDARY (See Figure 3.1) would exceed:

- a. 0.2 mrad to air from gamma radiation, or
- b. 0.4 mrad to air from beta radiation, or
- c. 0.3 mrem to any organ of a MEMBER OF THE PUBLIC.

**APPLICABILITY:** At all times.

### **ACTION:**

With the radioactive gaseous waste being discharged without treatment and in excess of the above limits, prepare and submit to the NRC within 30 days, pursuant to ODCM Administrative Control 5.4, a Special Report that includes the following information:

- 1. Identification of the inoperable equipment or subsystems and the reason for inoperability.
- 2. Action(s) taken to restore the inoperable equipment to OPERABLE status, and
- 3. Summary description of action(s) taken to prevent a recurrence.

The provisions of SR 2.0.4 are not applicable.

### **SURVEILLANCE REQUIREMENTS**

2.2.2.4.1 Doses due to gaseous releases from each unit to areas at and beyond the UNRESTRICTED AREA BOUNDARY shall be projected at least once per 31 days, in accordance with the methodology and parameters in ODCM Section 7.5 when the VENTILATION EXHAUST TREATMENT SYSTEMS and WASTE GAS HOLDUP SYSTEMS are not being fully utilized.  
[SOURCE NOTE 9]

2.2.2.4.2 The installed VENTILATION EXHAUST TREATMENT SYSTEMS and WASTE GAS HOLDUP SYSTEM shall be considered OPERABLE by meeting the requirements in ODCM Controls 1.2.2.1, 1.2.2.2, and 1.2.2.3.

## 1/2 CONTROLS AND SURVEILLANCE REQUIREMENTS

### 1/2.2 RADIOACTIVE EFFLUENTS

#### 1/2.2.3 TOTAL DOSE

##### CONTROLS

- 1.2.3 In accordance with WBN TS 5.7.2.7.j, the annual (calendar year) dose or dose commitment to any MEMBER OF THE PUBLIC, due to releases of radioactivity and to direct radiation from uranium fuel cycle sources, shall be limited to less than or equal to 25 mrem to the total body or any organ, except the thyroid, which shall be limited to less than or equal to 75 mrem.

APPLICABILITY: At all times.

##### ACTION:

- a. With the calculated doses from the release of radioactive materials in liquid or gaseous effluents exceeding twice the limits of ODCM Control 1.2.1.2, 1.2.2.2, or 1.2.2.3, calculations shall be made in accordance with ODCM Section 8.1 including direct radiation contributions from the reactor units and from outside storage tanks to determine whether the above limits have been exceeded. If such is the case, prepare and submit to the NRC within 30 days, pursuant to ODCM Administrative Control 5.4, a Special Report that defines the corrective action to be taken to reduce subsequent releases to prevent recurrence of exceeding the above limits and includes the schedule for achieving conformance with the above limits. This Special Report, as defined in 10 CFR 20.2203(a)(4), shall include an analysis that estimates the radiation exposure (dose) to a MEMBER OF THE PUBLIC from uranium fuel cycle sources, including all effluent pathways and direct radiation, for the calendar year that includes the release(s) covered by this report. It shall also describe levels of radiation and concentrations of radioactive materials involved, and the cause of the exposure levels or concentrations. If the estimated dose(s) exceeds the above limits, and if the release condition resulting in violation of 40 CFR 190 has not already been corrected, the Special Report shall include a request for a variance in accordance with the provisions of 40 CFR 190. Submittal of the report is considered a timely request, and a variance is granted until the staff action on the request is complete.
- b. With the estimated doses exceeding the 40 CFR 190 dose limits, a separate determination must be made, in accordance with the requirements of 40 CFR 302.5, regarding the reportable quantities for radionuclide releases given in 40 CFR 302.4. Any required notifications will be made in accordance with ODCM Administrative Control 5.5.
- c. The provisions of SR 2.0.4 are not applicable.

##### SURVEILLANCE REQUIREMENTS

- 2.2.3.1 Cumulative dose contributions from liquid and gaseous effluents shall be determined in accordance with ODCM Surveillance Requirements 2.2.1.2, 2.2.2.2, and 2.2.2.3 and in accordance with the methodology and parameters in ODCM Sections 6.3, 7.3, and 7.4.
- 2.2.3.2 Cumulative dose contributions from direct radiation from the units and from radwaste storage tanks shall be obtained from the REMP described in ODCM Section 9.1. This requirement is applicable only under conditions set forth in the action above.

**1/2 CONTROLS AND SURVEILLANCE REQUIREMENTS****1/2.3 RADIOLOGICAL ENVIRONMENTAL MONITORING****1/2.3.1 MONITORING PROGRAM****CONTROLS**

1.3.1 As required by 10 CFR Part 50, Appendix I, Section IV.B, the Radiological Environmental Monitoring Program (REMP) shall be conducted as specified in Table 2.3-1.

**APPLICABILITY:** At all times.

**ACTION:**

- a. With the REMP not being conducted as specified in Table 2.3-1, prepare and submit to the NRC, in the Annual Radiological Environmental Operating Report described in ODCM Administrative Control 5.1, a description of the reasons for not conducting the program as required and the plan for preventing a recurrence.
- b. With the level of radioactivity as a result of plant effluents in an environmental sampling medium at a specified location exceeding the reporting levels of Table 2.3-2, when averaged over any calendar quarter, prepare and submit to the NRC within 30 days from the end of the affected quarter, pursuant to ODCM Administrative Control 5.4, a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions to be taken to reduce radioactive effluents so that the potential annual dose\* to a MEMBER OF THE PUBLIC is less than the calendar year limits of ODCM Controls 1.2.1.2, 1.2.2.2 and 1.2.2.3. When more than one of the radionuclides in Table 2.3-2 are detected in the sampling medium, this report shall be submitted if:

$$\frac{\text{concentration}(i)}{\text{lim itlevel}(i)} + \frac{\text{concentration}(i+1)}{\text{lim itlevel}(i+1)} + \dots \geq 1$$

When radionuclides other than those in Table 2.3-2 are detected and are the result of plant effluents, this report shall be submitted if the potential annual dose\* to a MEMBER OF THE PUBLIC from all radionuclides is equal to or greater than the calendar year limits of ODCM Controls 1.2.1.2, 1.2.2.2, and 1.2.2.3. This report is not required if the measured level of radioactivity was not the result of plant effluents; however, in such an event, the condition shall be reported and described in the Annual Radiological Environmental Operating Report described in ODCM Administrative Control 5.1.

\* The methodology and parameters used to determine the potential annual dose to a MEMBER OF THE PUBLIC shall be indicated in this report.

## **1/2 CONTROLS AND SURVEILLANCE REQUIREMENTS**

### **1/2.3 RADIOLOGICAL ENVIRONMENTAL MONITORING**

#### **1/2.3.1 MONITORING PROGRAM**

##### **ACTION (CONTINUED):**

- c. With milk or fresh leafy vegetation samples unavailable from one or more of the sample locations required by Table 2.3-1, identify specific locations for obtaining replacement samples and add them within 30 days to the REMP described in ODCM Section 9.0 (excluding short term or temporary unavailability). The specified locations from which samples were unavailable may then be deleted from the monitoring program.

Pursuant to ODCM Administrative Controls 5.2 and 5.3, submit in the next Effluent Release Report documentation for a change in the ODCM, with supporting information identifying the cause of the unavailability of samples and justifying the selection of the new location(s) for obtaining samples.

The provisions of SR 2.0.4 are not applicable.

##### **SURVEILLANCE REQUIREMENTS**

- 2.3.1 The radiological environmental monitoring samples shall be collected pursuant to Table 2.3-1 from the specific locations given in the tables and figures in ODCM Section 9.0 and shall be analyzed pursuant to the requirements of Table 2.3-1 and the detection capabilities required by Table 2.3-3 and 2.3-4.

[SOURCE NOTE 6]

Table 2.3-1 - MINIMUM REQUIRED RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM  
(Page 1 of 5)

Exposure Pathway and/or Sample	Number of Samples and Sample Locations <sup>1</sup>	Sampling and Collection Frequency	Type and Frequency of Analyses
<b>1. DIRECT RADIATION</b>			
	<p>Forty routine monitoring stations either with two or more dosimeters or with one instrument for measuring and recording dose rate continuously, placed as follows:</p> <p>An inner ring of stations, one in each meteorological sector in the general area of the UNRESTRICTED AREA BOUNDARY; and An outer ring of stations, one in each meteorological sector in the 6- to 8-km range from the site; and</p> <p>The balance of the stations to be placed in special interest areas such as population centers, nearby residences, schools, and in one or two areas to serve as control stations.</p>	Quarterly	Gamma dose quarterly
<b>2. AIRBORNE</b>			
Radioiodine and Particulates	<p>Samples from five locations:</p> <p>Three samples from close to the three UNRESTRICTED AREA BOUNDARY locations in different sectors of the highest calculated annual average ground-level D/Q;</p> <p>One sample from the vicinity of a community having the highest calculated annual average ground level D/Q; and</p> <p>One sample from a control location, as for example 15 - 30 km distant and in the least prevalent wind direction<sup>3</sup></p>	Continuous sampler operation with sample collection weekly, or more frequently if required by dust loading.	<p>Radioiodine canister: I-131 analysis weekly</p> <p>Particulate sampler: Gross beta radioactivity analysis following filter change<sup>4</sup> and gamma isotopic analysis<sup>5</sup> of composite (by location quarterly)</p>

**Table 2.3-1 - MINIMUM REQUIRED RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM**  
(Page 2 of 5)

Exposure Pathway and/or Sample	Number of Samples and Sample Locations <sup>1</sup>	Sampling and Collection Frequency	Type and Frequency of Analyses
<b>3. WATERBORNE</b>			
Surface <sup>6</sup>	One sample upstream. One sample downstream.	Composite sample over a 1-month period. <sup>7</sup>	Gamma isotopic analysis <sup>5</sup> monthly; composite for tritium analysis quarterly.
Ground	Samples from one or two sources only if likely to be affected <sup>8</sup>	At least once per 92 days	Gamma isotopic <sup>5</sup> and tritium analysis quarterly.
Drinking	One sample of each of one to three of the nearest water supplies that could be affected by the discharge <sup>9</sup>	Composite sample over a one month period. <sup>7</sup>	Gross beta and gamma isotopic analyses <sup>5</sup> monthly. Composite for tritium analysis quarterly.
Shoreline Sediment	One Sample from downstream area with existing or potential recreational value	Semiannually	Gamma isotopic <sup>5</sup> analysis semiannually
Holding Pond Sediment	Samples from at least three locations in the Yard Holding Pond	Annually	Gamma isotopic analysis <sup>5</sup> annually
<b>4. INGESTION</b>			
Milk	Samples from milking animals in three locations within 5 km distance having the highest dose potential. If there are none, then one additional sample from milking animals in each of one to three areas between 5 to 8 km distant where doses are calculated to be greater than 1 mrem/yr <sup>10</sup> One sample from milking animals at a control location 15-30 km distant and in the least prevalent wind direction. <sup>3</sup>	Semimonthly when animals are on pasture; monthly at other times.	Gamma isotopic <sup>5</sup> and I-131 analysis semi-monthly when animals are on pasture; monthly at other times.

**Table 2.3-1 MINIMUM REQUIRED RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM**  
(Page 3 of 5)

Exposure Pathway and/or Sample	Number of Samples and Sample Locations <sup>1</sup>	Sampling and Collection Frequency	Type and Frequency of Analyses
<b>INGESTION</b> (continued)			
Fish	One sample of commercially important species and one sample of recreationally important species in vicinity of plant discharge area and the Chickamagua Reservoir. One sample of same species in areas not influenced by plant discharge.	Sample in season, or semiannually if they are not seasonal	Gamma isotopic analysis <sup>5</sup> on edible portions.
Food Products	One sample of each principal class of food products from any area within 5 miles of the plant that is irrigated by water in which liquid plant wastes have been discharged. Samples of three different kinds of available broad leaf vegetation grown nearest each of two different offsite locations of highest predicted annual average ground-level D/Q if milk sampling is not performed as outlined in 4.a. above. One sample of each of the similar broad leaf vegetation grown 15-30 km distant in the least prevalent wind direction if milk sampling is not performed as outlined in 4.a. above. <sup>3</sup>	At time of harvest <sup>11</sup>	Gamma isotopic analysis <sup>5</sup> on edible portion.

**Table 2.3-1 - MINIMUM REQUIRED RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM**(Page 4 of 5)  
TABLE NOTATION

- <sup>1</sup> Specific parameters of distance and direction sector from the centerline of the Unit 1 Shield Building stack, and additional description where pertinent, shall be provided for each and every sample location in Table 2.3-1 in a table(s) and figure(s) in ODCM Section 9.0. Refer to NUREG-1301, "Offsite Dose Calculation Manual Guidance: Standard Effluent Controls for Pressurized Water Reactors, Generic Letter 89-01, Supplement 1," April 1991. Deviations are permitted from the required sampling schedule if specimens are unobtainable due to hazardous conditions, seasonal unavailability, malfunction of automatic sampling equipment and other legitimate reasons. If specimens are unobtainable due to sampling equipment malfunction, every effort shall be made to complete corrective action prior to the end of the next sampling period. All deviations from the sampling schedule shall be documented in the Annual Radiological Environmental Operating Report pursuant to ODCM Administrative Control 5.1. It is recognized that, at times, it may not be possible or practicable to continue to obtain samples of the media of choice at the most desired location or time. In these instances suitable specific alternative media and locations may be chosen for the particular pathway in question and appropriate substitutions made within 30 days in the Radiological Environmental Monitoring Program given in ODCM Section 9.0. Pursuant to ODCM Administrative Controls 5.2 and 5.3, submit in the next Annual Radioactive Effluent Release Report documentation for a change in ODCM Section 9.0, including a revised figure(s) and table reflecting the new location(s) with supporting information identifying the cause of the unavailability of samples for that pathway and justifying the selection of the new location(s) for obtaining samples.
- <sup>2</sup> Reserved for future use.
- <sup>3</sup> The purpose of this sample is to obtain background information. If it is not practical to establish control locations in accordance with the distance and wind direction criteria, other sites that provide valid background data may be substituted.
- <sup>4</sup> Airborne particulate sample filters shall be analyzed for gross beta radioactivity 24 hours or more after sampling to allow for radon and thoron daughter decay. If gross beta activity in air particulate samples is greater than 10 times that of control samples, gamma isotopic analysis shall be performed on the individual samples.
- <sup>5</sup> Gamma isotopic analysis means the identification and quantification of gamma-emitting radionuclides that may be attributable to the effluents from the WBN plant.
- <sup>6</sup> The "upstream sample" shall be taken at a distance beyond significant influence of the discharge. The "downstream sample" shall be taken in an area beyond but near the mixing zone.

**Table 2.3-1- MINIMUM REQUIRED RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM**

(Page 5 of 5)  
TABLE NOTATION

- <sup>7</sup> A composite sample is one in which the quantity (aliquot) of liquid sampled is proportional to the quantity of flowing liquid and in which the method of sampling employed results in a specimen that is representative of the liquid flow. In this program composite sample aliquots shall be collected at time intervals that are very short (e.g., hourly) relative to the compositing period (e.g., monthly) in order to assure obtaining a representative sample. The composite sample shall be preserved according to plant procedures as appropriate.
- <sup>8</sup> Groundwater samples shall be taken when this source is tapped for drinking or irrigation purposes in areas where the hydraulic gradient or recharge properties are suitable for contamination. Groundwater flow in the area of WBN has been shown to be toward Chickamauga Reservoir (Reference 9). There are no sources tapped for drinking or irrigation purposes between the plant and the reservoir. Therefore, sampling of the medium is not required. However, sampling is being performed as specified in Table 9.1.
- <sup>9</sup> The surface water control shall be considered a control for the drinking water samples.
- <sup>10</sup> The dose shall be calculated for the maximum organ and age group, using the methodology and parameters in ODCM Section 7.4.
- <sup>11</sup> If harvest occurs more than once a year, sampling shall be performed during each discrete harvest. If harvest occurs continuously, sampling shall be monthly. Attention shall be paid to including samples of tuberous and root food products.

**Table 2.3-2 - REPORTING LEVELS FOR RADIOACTIVITY CONCENTRATIONS IN ENVIRONMENTAL SAMPLES**

Analysis	Water (pCi/L) <sup>3</sup>	Airborne Particulate or gases (pCi/m <sup>3</sup> ) <sup>5</sup>	Fish (pCi/Kg, wet) <sup>4</sup>	Milk (pCi/L) <sup>3</sup>	Food Products (pCi/Kg, wet) <sup>4</sup>
H-3	20,000	N/A	N/A	N/A	N/A
Mn-54	1,000	N/A	30,000	N/A	N/A
Fe-59	400	N/A	10,000	N/A	N/A
Co-58	1,000	N/A	30,000	N/A	N/A
Co-60	300	N/A	10,000	N/A	N/A
Zn-65	300	N/A	20,000	N/A	N/A
Zr-Nb-95	400	N/A	N/A	N/A	N/A
I-131	2 <sup>2</sup>	0.9	N/A	3	100
Cs-134	30	10	1,000	60	1,000
Cs-137	50	20	2,000	70	2,000
Ba-La-140	200	N/A	N/A	300	N/A

<sup>1</sup> Reserved for future use.

<sup>2</sup> For drinking water samples. If no drinking water pathway exists, value of 20 pCi/L may be used.

<sup>3</sup> Multiply the values in this column by 10<sup>-9</sup> to convert to units of µCi/ml.

<sup>4</sup> Multiply the values in this column by 10<sup>-9</sup> to convert to units of µCi/g (wet).

<sup>5</sup> Multiply the values in this column by 10<sup>-12</sup> to convert to units of µCi/cc.

**Table 2.3-3 - DETECTION CAPABILITIES FOR ENVIRONMENTAL SAMPLE ANALYSIS<sup>1,2</sup> - LOWER LIMITS OF DETECTION (LLD)<sup>3</sup>**

(Page 1 of 2)

Analysis	Water (pCi/L) <sup>6</sup>	Airborne Particulate or Gases (pCi/m <sup>3</sup> ) <sup>8</sup>	Fish (pCi/Kg, wet) <sup>7</sup>	Milk (pCi/L) <sup>6</sup>	Food Products (pCi/Kg, wet) <sup>7</sup>	Sediment (pCi/Kg, dry) <sup>7</sup>
gross beta	4	0.01	N/A	N/A	N/A	N/A
H-3	2000 <sup>4</sup>	N/A	N/A	N/A	N/A	N/A
Mn-54	15	N/A	130	N/A	N/A	N/A
Fe-59	30	N/A	260	N/A	N/A	N/A
Co-58, 60	15	N/A	130	N/A	N/A	N/A
Zn-65	30	N/A	260	N/A	N/A	N/A
Zr-95	30	N/A	N/A	N/A	N/A	N/A
Nb-95	15	N/A	N/A	N/A	N/A	N/A
I-131	1 <sup>5</sup>	0.07	N/A	1	60	N/A
Cs-134	15	0.05	130	15	60	150
Cs-137	18	0.06	150	18	80	180
Ba-140	60	N/A	N/A	60	N/A	N/A
La-140	15	N/A	N/A	15	N/A	N/A

## TABLE NOTATION

- <sup>1</sup> This list does not mean that only these nuclides are to be considered. Other nuclides that are identifiable, together with those of the above nuclides, shall also be analyzed and reported in the Annual Radiological Environmental Operating Report pursuant to Administrative Control 5.1.
- <sup>2</sup> Required detection capabilities for DOSIMETERS used for environmental measurements shall be in accordance with the recommendations of Regulatory Guide 4.13.
- <sup>3</sup> The LLD is defined, for the purpose of these specifications, as the smallest concentration of radioactive material in a sample that will yield a net count, above system background, that will be detected with 95% probability with only a 5% probability of falsely concluding that a blank observation represents a "real" signal. (Reference 8)

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{4.66 s_b}{E V 2.22 Y \exp(-\lambda \Delta t)}$$

Where:

LLD = the "a priori" lower limit of detection (pCi per unit mass or volume)

$s_b$  = the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (counts per minute)

E = the counting efficiency (counts per disintegration)

V = the sample size (units of mass or volume)

2.22 = the number of disintegrations per minute per picocurie

**Table 2.3-3 - DETECTION CAPABILITIES FOR ENVIRONMENTAL SAMPLE ANALYSIS<sup>1,2</sup>- LOWER LIMITS OF DETECTION (LLD)<sup>3</sup>**  
(Page 2 of 2)

- Y = the fractional radiochemical yield, when applicable  
 $\lambda$  = the radioactive decay constant for the particular radionuclide ( $s^{-1}$ )  
 $\Delta t$  = the elapsed time between midpoint of environmental sample collection and time of counting (s).

Typical values of E, V, Y, and  $\Delta t$  should be used in the calculation.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not an a posteriori (after the fact) limit for a particular measurement. Analysis will be performed in such a manner that the stated LLDs will be achieved under routine conditions. Occasionally background fluctuations, unavoidable small sample sizes, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLDs unachievable. In such cases, the contributing factors shall be identified and described in the Annual Radiological Environmental Operating Report pursuant to ODCM Administrative Control 5.2.

<sup>4</sup> If no drinking water pathway exists, a value of 3,000 pCi/L may be used.

<sup>5</sup> If no drinking water pathway exists, a value of 15 pCi/L may be used.

<sup>6</sup> Multiply the values in this column by  $10^{-9}$  to convert to units of  $\mu\text{Ci/ml}$ .

<sup>7</sup> Multiply the values in this column by  $10^{-9}$  to convert to units of  $\mu\text{Ci/g(wet)}$ .

<sup>8</sup> Multiply the values in this column by  $10^{-12}$  to convert to units of  $\mu\text{Ci/cc}$ .

**Table 2.3-4 - DETECTION CAPABILITIES FOR GROUNDWATER HARD-TO-DETECT NUCLIDES - LOWER LIMITS OF DETECTION (LLD)**

ANALYSIS	WATER (pCi/L) <sup>1</sup>
Fe-55	200
Ni-63	30
Sr-89	5
Sr-90	1
Gross Alpha	4

<sup>1</sup> Multiply the values in this column by  $10^{-9}$  to convert to units of  $\mu\text{Ci/ml}$ .

## **1/2 CONTROLS AND SURVEILLANCE REQUIREMENTS**

### **1/2.3 RADIOLOGICAL ENVIRONMENTAL MONITORING**

#### **1/2.3.2 LAND USE CENSUS**

##### **CONTROLS**

1.3.2 A Land Use Census shall be conducted and shall identify within a distance of 8 km (5 miles) the location in each of the 16 meteorological sectors of the nearest milk animal, the nearest residence, and the nearest garden\* of greater than 50 m<sup>2</sup> (500 ft<sup>2</sup>) producing fresh leafy vegetation.

\* Broad leaf vegetation sampling of at least three different kinds of vegetation may be performed at the UNRESTRICTED AREA BOUNDARY in each of two different direction sectors with the highest predicted D/Qs in lieu of the garden census. Controls for broad leaf vegetation sampling in Table 2.3-1 Part 4.c., shall be followed, including analysis of control samples.

**APPLICABILITY:** At all times.

##### **ACTION:**

- a. With a Land Use Survey identifying a location(s) that yields a calculated dose or dose commitment greater than the values currently being calculated in Control 2.2.2.3, pursuant to ODCM Administrative Controls 5.1 and 5.2, identify the new location(s) in the next Annual Radioactive Effluent Release Report.
- b. With a Land Use Census identifying a location(s) that yields a calculated dose or dose commitment (via the same exposure pathway) 20% greater than at a location from which samples are currently being obtained in accordance with the requirements of ODCM Control 1.3.1, add the new location(s) within 30 days to the radiological environmental monitoring program given in ODCM Section 9.0, if samples are available. The sampling location(s), excluding the control station location, having the lowest calculated dose or dose commitment(s), via the same exposure pathway, may be deleted from this monitoring program after October 31 of the year in which this Land Use Census was conducted. Pursuant to ODCM Administrative Controls 5.2 and 5.3, submit in the next Annual Radioactive Effluent Release Report documentation for a change in the ODCM reflecting the new location(s) with the information supporting the change in sampling locations.
- c. The provisions of SR 2.0.4 are not applicable.

##### **SURVEILLANCE REQUIREMENTS**

2.3.2 The Land Use Census shall be conducted during the growing season at least once per 12 months using that information that will provide the best results, such as by a door-to-door survey, mail survey, telephone survey, aerial survey, or by consulting local agricultural authorities. The results of the Land Use Census shall be included in the Annual Radiological Environmental Operating Report pursuant to ODCM Administrative Control 5.1.

## **1/2 CONTROLS AND SURVEILLANCE REQUIREMENTS**

### **1/2.3 RADIOLOGICAL ENVIRONMENTAL MONITORING**

#### **1/2.3.3 INTERLABORATORY COMPARISON PROGRAM**

##### **CONTROLS**

1.3.3 Analyses shall be performed on all radioactive materials, supplied as part of an Interlaboratory Comparison Program which has been approved by the NRC, that correspond to samples required by Table 2.3-1.

APPLICABILITY: At all times.

##### **ACTION**:

With analyses not being performed as required above, report the corrective actions being taken to prevent a recurrence to the NRC in the Annual Radiological Environmental Operating Report pursuant to ODCM Administrative Control 5.1.

The provisions of SR 2.0.4 are not applicable.

##### **SURVEILLANCE REQUIREMENTS**

2.3.3 The Interlaboratory Comparison Program shall be described in ODCM Section 9.4. A summary of the results obtained as a part of the above required Interlaboratory Comparison Program shall be included in the Annual Radiological Environmental Operating Report pursuant to ODCM Administrative Control 5.1.

**BASES FOR SECTIONS 1.0 AND 2.0**  
**CONTROLS AND SURVEILLANCE REQUIREMENTS**

NOTE

The BASES contained in succeeding pages summarize the reasons for the Controls in Sections 1.0 and 2.0, but are not part of these Controls.

**BASES FOR SECTIONS 1.0 AND 2.0 - CONTROLS AND SURVEILLANCE REQUIREMENTS****1/2.1 INSTRUMENTATION****1/2.1.1 RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION**

The radioactive liquid effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in liquid effluents during actual and potential releases of liquid effluents. The alarm/trip setpoints for these instruments shall be calculated and adjusted in accordance with the methodology and parameters in ODCM Section 6.2 to ensure that the alarm/trip will occur prior to exceeding ten times the concentration limits of 10 CFR 20. The OPERABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63, and 64 of Appendix A to 10 CFR 50.

**1/2.1.2 RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION**

The radioactive gaseous effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in gaseous effluents during actual and potential releases of gaseous effluents. The radiation monitor alarm/trip setpoints for each release point are based on the radioactive noble gases in gaseous effluents. It is not considered practical to apply the instantaneous alarm/trip setpoints to integrating radiation monitors sensitive to radioiodines, radioactive materials in particulate form, and radionuclides other than noble gases. The alarm/trip setpoints for these instruments shall be calculated and adjusted in accordance with the methodology and parameters in ODCM Section 7.1 to ensure that the alarm/trip will occur prior to exceeding the dose rate limits of ODCM Control 1.2.2.1. The OPERABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63, and 64 of Appendix A to 10 CFR 50.

**1/2.1.3 METEOROLOGICAL INSTRUMENTATION/DATA**

The OPERABILITY of the meteorological instrumentation ensures that sufficient meteorological data is available for estimating potential radiation doses to the public as a result of routine or accidental release of radioactive materials to the atmosphere. This capability is required to evaluate the need for initiating protective measures to protect the health and safety of the public and is consistent with the recommendations of Regulatory Guide 1.23, "Onsite Meteorological Programs," February 1972, ANSI/ANS-3.11-2000, "Standard for Determining Meteorological Information at Nuclear Power Sites," 2000, Regulatory Guide 1.97, "Instrumentation for Light-Water-Cooled Nuclear Power Plants to Assess Plant and Environs Conditions During and Following an Accident," May 1983, and Supplement 1 to NUREG-0737, "Requirements for Emergency Response Capability (Generic Letter 82-33)," December 1982.

The interval for the sensor calibration portion of the CHANNEL CALIBRATION is based on the length of time a sensor has been in service (i.e., non-service or "shelf" time, not to exceed six months, is not included).

NUREG-0452, "Standard Technical Specifications for Westinghouse Pressurized Water Reactors," contained meteorological monitoring instrumentation requirements. As part of the Technical Specification Improvement Program, these requirements have been split out of the Standard Technical Specifications. Therefore, the meteorological monitoring Control has been included in the ODCM.

## 1/2.2 RADIOACTIVE EFFLUENTS

### 1/2.2.1 LIQUID EFFLUENTS

#### 1/2.2.1.1 CONCENTRATION

This Control is provided to ensure that the concentration of radioactive materials released in liquid waste effluents to UNRESTRICTED AREAS will be less than 10 times the concentration values specified in Appendix B, Table 2, Column 2 to 10 CFR 20.1001-20.2402. It provides operational flexibility for releasing liquid effluents in concentrations to follow the Section II.A and II.C design objectives of Appendix I to 10 CFR 50. This limitation provides reasonable assurance that the levels of radioactive materials in bodies of water in UNRESTRICTED AREAS will result in exposures within (1) the Section II.A design objectives of Appendix I, 10 CFR 50, to a MEMBER OF THE PUBLIC, and (2) restrictions authorized by 10 CFR 20.1301(e). The concentration limit for dissolved or entrained noble gases is based upon the assumption that Xe-135 is the controlling radioisotope and its concentration in air (submersion) was converted to an equivalent concentration in water. This specification does not affect the requirement to comply with the annual limitations of 10 CFR 20.1301(a).

This Control applies to the release of radioactive materials in liquid effluents from all reactors at the site.

The required detection capabilities for radioactive materials in liquid waste samples are tabulated in terms of the lower limits of detection (LLDs). Detailed description of the LLD, and other detection limits can be found in HASL Procedures Manual, HASL-300, Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry," Anal. Chem. **40**, 586-93 (1968), and Hartwell, J. K., "Detection Limits for Radioanalytical Counting Techniques," Atlantic Richfield Hanford Company Report ARH-SA-215 (June 1975).

#### 1/2.2.1.2 DOSE

This Control is provided to implement the requirements of Sections II.A, III.A, and IV.A of Appendix I, 10 CFR 50. The Control implements the guides set forth in Section II.A of Appendix I. Compliance with this Control will be considered to demonstrate compliance with the 0.1 rem limit of 10 CFR 20.1301(a)(1) per 56 FR 23374. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive materials in liquid effluents to UNRESTRICTED AREAS will be kept "as low as reasonable achievable." Also, for fresh water sites with drinking water supplies which can be potentially affected by plant operations, there is reasonable assurance that the operation of the facility will not result in radionuclide concentrations in the finished drinking water that are in excess of the requirements of 40 CFR 141. The dose calculation methodology and parameters in the ODCM implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated. The equations specified in the ODCM section for calculating the doses due to the actual release rates of radioactive materials in liquid effluents are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purposes of Evaluating Compliance with 10 CFR Part 50 Appendix I," Revision 1, October 1977 and Regulatory Guide 1.113, "Estimating Aquatic Dispersion of Effluents from Accidental and Routine Reactor Releases for the Purpose of Implementing Appendix I," April 1977.

This Control applies to the release of radioactive materials in liquid effluents from each unit at the site. When shared Radwaste Treatment Systems are used by more than one unit on a site, the wastes from all units are mixed for shared treatment; by such mixing, the effluent releases cannot accurately be ascribed to a specific unit. An estimate should be made of the contributions from each unit based on input conditions, e.g., flow to each of the radioactive producing units sharing the Radwaste Treatment System.

For determining conformance to controls, these allocations from shared Radwaste Treatment Systems are to be added to the releases specifically attributed to each unit to obtain the total release per site.

For those nuclides whose activities are determined from composite samples (as noted in Table 2.2-1), the concentrations for the previous composite period will be assumed as the concentration for the next period to perform the calculations in ODCM Sections 6.1 and 6.3.

### **1/2.2.1.3 LIQUID RADWASTE TREATMENT SYSTEM**

The OPERABILITY of the LRTS ensures that this system will be available for use whenever liquid effluents require treatment prior to release to the environment. The Control that the appropriate portions of this system be used when specified provides assurance that the releases of radioactive materials in liquid effluents will be kept "as low as reasonably achievable." This requirement implements the requirements of 10 CFR 50.36a, General Design Criteria 60 of Appendix A to 10 CFR 50 and the design objective given in Section II.D of Appendix I to 10 CFR 50. The specified limits governing the use of appropriate portions of the liquid radwaste system were specified as a suitable fraction of the dose design objectives set forth in Section II.A of Appendix I, 10 CFR 50, for liquid effluents.

This Control applies to the release of radioactive materials in liquid effluents from each unit at the site. When shared LRTS are used by more than one unit on a site, the wastes from all units are mixed for shared treatment; by such mixing, the effluent releases cannot accurately be ascribed to a specific unit. An estimate should be made of the contributions from each unit based on input conditions, e.g., flow rates and radioactivity concentrations, or, if not practicable, the treated effluent releases be allocated equally to each of the radioactive producing units sharing the LRTS. For determining conformance to controls, these allocations from shared LRTS are to be added to the releases specifically attributed to each unit to obtain the total release per site.

### **1/2.2.2 GASEOUS EFFLUENTS**

#### **1/2.2.2.1 DOSE RATE**

This Control provides reasonable assurance that radioactive material discharged in gaseous effluents will not result in the exposure of a MEMBER OF THE PUBLIC in an UNRESTRICTED AREA in excess of the design objectives of Appendix I to 10 CFR 50. This Control is provided to ensure that gaseous effluents from all units on the site will be appropriately controlled. It provides operational flexibility for releasing gaseous effluents to satisfy the Section II.A and II.C design objectives of Appendix I to 10 CFR 50. For MEMBERS OF THE PUBLIC who may at times be within the CONTROLLED or RESTRICTED AREAS, the occupancy of that MEMBER OF THE PUBLIC will usually be sufficiently low to compensate for the reduced atmospheric dispersion relative to that for the UNRESTRICTED AREA BOUNDARY. Examples of calculations for such MEMBERS OF THE PUBLIC, with the appropriate occupancy factors, shall be given in the ODCM. The specified release rate limits restrict, at all times, the corresponding gamma and beta dose rates above background to a MEMBER OF THE PUBLIC at or beyond the UNRESTRICTED AREA BOUNDARY to  $\leq 500$  mrem/y to the total body or to  $\leq 3000$  mrem/y to the skin. These limits also restrict, at all times, the corresponding thyroid dose rate above background to a child via the inhalation pathway to  $\leq 1500$  mrem/y. This Control does not affect the requirement to comply with the annual limitations of 10 CFR 20.1301(a).

This requirement applies to the release of radioactive material in gaseous effluents from all reactors at the site.

The required detection capabilities for radioactive materials in gaseous waste samples are tabulated in terms of the lower limits of detection (LLDs). Detailed description of the LLD, and other detection limits can be found in HASL Procedures Manual, HASL-300, Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry," Anal. Chem. 40, 586-93 (1968), and

Hartwell, J. K., "Detection Limits for Radioanalytical Counting Techniques," Atlantic Richfield Hanford Company Report ARH-SA-215 (June 1975).

For those nuclides whose activities are determined from composite samples (as noted in Table 1.2-1), the concentrations for the previous composite period will be assumed as the concentration for the next period to perform the calculations in ODCM Sections 7.2.

#### **1/2.2.2.2 DOSE - NOBLE GASES**

This Control is provided to implement the requirements of Sections II.B, III.A and IV.A of Appendix I, 10 CFR 50. The requirement implements the guides set forth in Section I.B of Appendix I. Compliance with this control will be considered to demonstrate compliance with the 0.1 rem limit of 10 CFR 20.1301(a)(1) per 56 FR 23374. The ACTIONS to be taken provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in gaseous effluents to UNRESTRICTED AREAS will be kept "as low as reasonably achievable." The surveillance implements the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data such that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated. The dose calculation methodology and parameters established in ODCM Section 7.3 for calculating the doses due to the actual release rates of radioactive noble gases in gaseous effluents are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purposes of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water Cooled Reactors," Revision 1, July 1977. The equations provided for determining the air doses at and beyond the UNRESTRICTED AREA BOUNDARY are based upon the historical average atmospheric conditions.

This Control applies to the release of gaseous effluents from each reactor at the site. When shared Radwaste Treatment Systems are used by more than one unit on a site, the wastes from all units are mixed for shared treatment; by such mixing, the effluent releases cannot accurately be ascribed to a specific unit. An estimate should be made of the contributions from each unit based on input conditions, e.g., flow rates and radioactivity concentrations, or, if not practicable, the treated effluent releases be allocated equally to each of the radioactive producing units sharing the Radwaste Treatment System. For determining conformance to requirements, these allocations from shared Radwaste Treatment Systems are to be added to the releases specifically attributed to each unit to obtain the total release per site.

#### **1/2.2.2.3 DOSE - IODINE-131, IODINE-133, C-14, TRITIUM, AND RADIONUCLIDES IN PARTICULATE FORM WITH HALF-LIVES GREATER THAN EIGHT DAYS**

This Control is provided to implement the requirements of Sections II.C, III.A and IV.A of Appendix I, 10 CFR 50. The Control implements the guides set forth in Section II.C of Appendix I. Compliance with this control will be considered to demonstrate compliance with the 0.1 rem limit of 10 CFR 20.1301(a)(1) per 56 FR 23374. The ACTION to be taken provides the required operating flexibility and at the same time implements the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in gaseous effluents will be kept "as low as reasonably achievable." ODCM Section 7.4 calculational methods specified in the Surveillance Requirement implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data such that the actual exposure of a MEMBER OF THE PUBLIC through appropriately modeled pathways is unlikely to be substantially underestimated. ODCM Section 7.4 calculational methodology and parameters for calculating the doses due to the actual release rates of the subject materials are consistent with the methodologies provided in NUREG/CR-1004, "A Statistical Analysis of Selected Parameters for Predicting Food Chain Transport and Internal Dose of Radionuclides," October 1979 and Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purposes of Evaluating Compliance with 10 CFR Part 50,

Appendix I," Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water Cooled Reactors," Revision 1, July 1977. These equations also provide for determining the actual doses based upon the historical average atmospheric conditions. The release rate controls for I-131, I-133, C-14, tritium and particulate radionuclides with half-lives greater than eight days are dependent upon the existing radionuclide pathways to man in the areas at and beyond the UNRESTRICTED AREA BOUNDARY. The pathways that were examined in the development of the calculations were: (1) individual inhalation of airborne radionuclides, (2) deposition of radionuclides onto green leafy vegetation with subsequent consumption by man, (3) deposition onto grassy areas where milk animals and beef producing animals graze with consumption of the milk and beef by man, and (4) deposition on the ground with subsequent exposure of man.

For those nuclides whose activities are determined from composite samples, the concentrations for the previous composite period will be assumed as the concentration for the next period to perform the calculations in ODCM Section 7.4.

#### 1/2.2.2.4 GASEOUS RADWASTE TREATMENT SYSTEM

The OPERABILITY of the WASTE GAS HOLDUP SYSTEM and the VENTILATION EXHAUST TREATMENT SYSTEM ensures that the systems will be available for use whenever gaseous effluents require treatment prior to release to the environment. The Control that the appropriate portions of these systems be used when specified provides reasonable assurance that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable." This requirement implements the requirements of 10 CFR 50.36a, General Design Criteria 60 of Appendix A to 10 CFR 50, and the design objectives given in Section II.D of Appendix I to 10 CFR 50. The specified limits governing the use of appropriate portions of the systems were specified as a suitable fraction of the dose design objectives set forth in Section II.B and II.C of Appendix I, 10 CFR 50, for gaseous effluents.

This Control applies to the release of radioactive materials in gaseous effluents from each unit at the site. When shared Radwaste Treatment Systems are used by more than one unit on a site, the wastes from all units are mixed for shared treatment; by such mixing, the effluent releases cannot accurately be ascribed to a specific unit. An estimate should be made of the contributions from each unit based on input conditions, e.g., flow rates and radioactivity concentrations, or, if not practicable, the treated effluent releases be allocated equally to each of the radioactive producing units sharing the Radwaste Treatment System. For determining conformance to Controls, these allocations from shared Radwaste Treatment Systems are to be added to the releases specifically attributed to each unit to obtain the total release per site.

#### 1/2.2.3 TOTAL DOSE

This Control is provided to meet the dose limitations of 40 CFR 190 that have been incorporated into 10 CFR 20.1301(d). The Control requires the preparation and submittal of a Special Report whenever the calculated doses due to releases of radioactivity and to radiation from uranium fuel cycle sources exceed 25 mrem to the total body or any other organ, except the thyroid, which shall be limited to less than or equal to 75 mrem. For sites containing up to 4 reactors, it is highly unlikely that the resultant dose to a MEMBER OF THE PUBLIC will exceed the dose limits of 40 CFR 190 if the individual reactors remain within twice the dose design objectives of Appendix I and if direct radiation doses from the units and from outside storage tanks are kept small. The Special Report will describe a course of action that should result in the limitation of annual dose to a MEMBER OF THE PUBLIC to within the 40 CFR 190 limits. For the purposes of the Special Report, it may be assumed that the dose commitment to the MEMBER OF THE PUBLIC from other uranium fuel cycle sources is negligible, with the exception that dose contributions from other nuclear fuel cycle facilities at the same site or within a radius of 8 km must be considered. If the dose to any MEMBER OF THE PUBLIC is estimated to exceed the requirements of 40 CFR Part 190, the Special Report with a request for a variance (provided the release conditions resulting in violation of 40 CFR 190 have not already been corrected), in accordance with the provisions

of 40 CFR 190.11 and 10 CFR 20.2203(a)(4), is considered to be a timely request and fulfills the requirements of 40 CFR 190 until NRC staff action is completed. The variance only relates to the limits of 40 CFR 190, and does not apply in any way to the other requirements for dose limitation of 10 CFR 20, as addressed in ODCM Controls 1.2.1.1 and 1.2.2.1. An individual is not considered a MEMBER OF THE PUBLIC during any period in which he/she is engaged in carrying out any operation that is part of the nuclear fuel cycle. Demonstration of compliance with the limits of 40 CFR 190 or with the design objectives of Appendix I to 10 CFR 50 will be considered to demonstrate compliance with the 0.1 rem limit of 10 CFR 20.1301.

The requirements for evaluating compliance with 40 CFR 302 are added to ensure compliance with these limits. The regulation states that federally permitted releases do not have to determine compliance with the reportable quantities unless the permitted release allowance is exceeded.

### 1/2.3 RADIOLOGICAL ENVIRONMENTAL MONITORING

#### 1/2.3.1 MONITORING PROGRAM

The Radiological Environmental Monitoring Program required by this Control provides representative measurements of radiation and of radioactive materials in those exposure pathways and for those radionuclides that lead to the highest potential radiation exposures of MEMBERS OF THE PUBLIC resulting from the plant operation. This monitoring program implements Section IV.B.2 of Appendix I to 10 CFR 50 and thereby supplements the Radiological Effluent Monitoring Program by verifying that the measurable concentration of radioactive materials and levels of radiation are not higher than expected on the basis of the effluent measurements and modeling of the environmental exposure pathways. Guidance for this monitoring program is provided by the Radiological Assessment Branch Technical Position on Environmental Monitoring, Revision 1, November 1979. The initially specified monitoring program will be effective for at least the first three years of commercial operation. Following this period, program changes may be initiated based on operational experience.

The required detection capabilities for environmental sample analyses are tabulated in terms of the lower limits of detection (LLDs). The LLDs required by Table 2.3-3 are considered optimum for routine environmental measurements in industrial laboratories. It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as a posteriori (after the fact) limit for a particular measurement.

Detailed description of the LLD, and other detection limits can be found in HASL Procedures Manual, HASL-300, Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry," Anal. Chem. 40, 586-93 (1968), and Hartwell, J. K., "Detection Limits for Radioanalytical Counting Techniques," Atlantic Richfield Hanford Company Report ARH-SA-215 (June 1975).

#### 1/2.3.2 LAND USE CENSUS

This Control is provided to ensure that changes in the use of areas at and beyond the UNRESTRICTED AREA BOUNDARY are identified and that modifications to the monitoring program are made if required by the results of that census. The best information from the door-to-door survey, mail survey, telephone survey, aerial survey, or by consulting with local agricultural authorities shall be used. This census satisfies the requirements of Section IV.B.3 of Appendix I to 10 CFR 50. Restricting the census to gardens of greater than 50 m<sup>2</sup> provides assurance that significant exposure pathways via leafy vegetables will be identified and monitored since a garden of this size is the minimum required to provide the quantity (26 kg/y) of leafy vegetables assumed in Regulatory Guide 1.109 for consumption by a child. To determine this minimum garden size, the following assumptions were used, 1) that 20% of the garden was used for growing broad leaf vegetation (i.e., similar to lettuce and cabbage), and 2) a vegetation yield of 2 kg/m<sup>2</sup>.

### **1/2.3.3 INTERLABORATORY COMPARISON**

The Control for participation in an approved Interlaboratory Comparison Program is provided to ensure that independent checks on the precision and accuracy of the measurements of radioactive material in environmental sample matrices are performed as part of the quality assurance program for environmental monitoring in order to demonstrate that the results are valid for the purposes of Section IV.B.2 of Appendix I to 10 CFR 50.

### 3.0 DEFINITIONS

The defined terms in this section appear in capitalized type in the text and are applicable throughout these Controls and Bases.

#### 3.1 ACTION

ACTION shall be that part of a Control that prescribes remedial measures required under designated conditions.

#### 3.2 CHANNEL CALIBRATION

A CHANNEL CALIBRATION shall be the adjustment, as necessary, of the channel such that it responds within the necessary range and accuracy to known values of input. The CHANNEL CALIBRATION shall encompass the entire channel including the sensor and alarm, interlock, display, and/or trip functions. Calibration of instrument channels with resistance temperature detector or thermocouple sensors shall consist of an in place cross calibration of the remaining adjustable devices in the channel. Whenever a sensing element is replaced, the next required in place cross calibration consists of comparing the other sensing elements with the recently installed sensing element. The CHANNEL CALIBRATION may be performed by any series of sequential, overlapping channel calibrations or total channel steps such that the entire channel is calibrated.

#### 3.3 CHANNEL CHECK

A CHANNEL CHECK shall be the qualitative assessment, by observation, of channel behavior during operation. This determination shall include, where possible, comparison of the channel indication and status to other indications or status derived from independent instrument channels measuring the same parameter.

#### 3.4 CHANNEL OPERATIONAL TEST

A CHANNEL OPERATIONAL TEST shall be the injection of a simulated signal or actual signal into the channel as close to the sensor as practicable to verify OPERABILITY of alarm, interlock, and/or trip functions. The CHANNEL OPERATIONAL TEST shall include adjustments, as necessary, of the required alarm, interlock, and/or trip setpoints such that the setpoints are within the required range and accuracy.

#### 3.5 CONTROLLED AREA

A CONTROLLED AREA, as defined in 10 CFR 20, is the area outside the RESTRICTED AREA but inside the 10 CFR 20 defined SITE BOUNDARY, access to which can be limited by the licensee for any reason (see Figure 3.1).

#### 3.6 DOSE EQUIVALENT I-131

DOSE EQUIVALENT I-131 shall be that concentration of I-131 ( $\mu\text{Ci/g}$ ) that alone would produce the same thyroid dose as the quantity and isotopic mixture of I-131, I-132, I-133, I-134, and I-135 actually present. The thyroid dose conversion factors used for this calculation shall be those listed in Table E-7 of NRC Regulatory Guide 1.109, Revision 1, October 1977.

### **3.0 DEFINITIONS**

#### **3.7 FREQUENCY NOTATION**

The FREQUENCY NOTATION specified for the performance of Surveillance Requirements shall correspond to the intervals defined in Table 3.1.

#### **3.8 MEMBER(S) OF THE PUBLIC**

MEMBER(S) OF THE PUBLIC, as defined in 10 CFR 20, is any individual except when that individual is receiving an occupational dose.

#### **3.9 MODE**

A MODE shall correspond to any one inclusive combination of core reactivity condition, power level, and average reactor coolant temperature specified in Table 3.2 with fuel in the reactor vessel and reactor vessel head closure bolt tensioning.

#### **3.10 OPERABLE - OPERABILITY**

A system, subsystem, train, component, or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified function(s), and when all necessary attendant instrumentation, controls, normal or emergency electrical power, cooling and seal water, lubrication and other auxiliary equipment that are required for the system, subsystem, train, component, or device to perform its specified function(s) are also capable of performing their related support function(s).

#### **3.11 PURGE - PURGING**

PURGE or PURGING shall be any controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration or other operating condition, in such a manner that replacement air or gas is required to purify the confinement.

#### **3.12 RATED THERMAL POWER**

RATED THERMAL POWER shall be a total reactor core heat transfer rate to the reactor coolant of 3459 MWt for Unit 1 and 3411 MWt for Unit 2.

#### **3.13 REPORTABLE EVENT**

A REPORTABLE EVENT shall be any of those conditions specified in Section 50.73 of 10 CFR 50.

#### **3.14 RESTRICTED AREA/RESTRICTED AREA BOUNDARY**

The RESTRICTED AREA, as defined in 10 CFR 20, is that area, access to which is limited by the licensee for the purposes of protecting individuals against undue risks from exposure to radiation and radioactive materials. RESTRICTED AREA does not include areas used as residential quarters, but separate rooms in a residential building may be set apart as a RESTRICTED AREA (see Figure 3.1).

### **3.0 DEFINITIONS**

#### **3.15 SITE BOUNDARY**

The SITE BOUNDARY is defined in 10 CFR 20 as that line beyond which the land or property is not owned, leased, or otherwise controlled by the licensee (see Figure 3.1). For WBN ODCM purposes, the SITE BOUNDARY and the UNRESTRICTED AREA BOUNDARY are identical.

#### **3.16 SOURCE CHECK**

A SOURCE CHECK shall be the qualitative assessment of channel response when the channel sensor is exposed to a radioactive source or other channel sensor internal test circuits.

#### **3.17 UNRESTRICTED AREA/UNRESTRICTED AREA BOUNDARY**

An UNRESTRICTED AREA, as defined in 10 CFR 20, shall be any area, access to which is not controlled by the licensee for the purposes of protection of individuals from exposure to radiation and radioactive materials, or any area within the SITE BOUNDARY used for residential quarters or for industrial, commercial, institutional, and/or recreational purposes. For WBN ODCM purposes, the SITE BOUNDARY and the UNRESTRICTED AREA BOUNDARY are identical.

#### **3.18 VENTILATION EXHAUST TREATMENT SYSTEM**

A VENTILATION EXHAUST TREATMENT SYSTEM is any system designed and installed to reduce gaseous radioiodine or radioactive material in particulate form in effluents by passing ventilation or vent exhaust gases through charcoal adsorbers and/or HEPA filters for the purpose of removing iodines or particulates from the gaseous exhaust stream prior to the release to the environment (such a system is not considered to have any effect on noble gas effluents). Engineered Safety Feature (ESF) atmospheric cleanup systems are not considered to be VENTILATION EXHAUST TREATMENT SYSTEM components.

#### **3.19 WASTE GAS HOLDUP SYSTEM**

A WASTE GAS HOLDUP SYSTEM is any system designed and installed to reduce radioactive gaseous effluents by collecting Reactor Coolant System offgases from the Reactor Coolant System and providing for delay or holdup for the purpose of reducing the total radioactivity prior to release to the environment.

**Table 3.1 - FREQUENCY NOTATION**

NOTATION FREQUENCY

S	At least once per 12 hours.
D	At least once per 24 hours.
W	At least once per 7 days.
M	At least once per 31 days.
Q	At least once per 92 days.
SA	At least once per 184 days.
3Q	At least once per 276 days.
Y	At least once per 365 days.
R	At least once per 18 months.
N/A	Not applicable.
P	Completed prior to each release.

Table 3.2 - OPERATIONAL MODES

MODE	REACTIVITY CONDITION, $K_{eff}$	% RATED THERMAL POWER*	AVERAGE COOLANT TEMPERATURE
1. Power Operation	$\geq 0.99$	$> 5\%$	N/A
2. Startup	$\geq 0.99$	$\leq 5\%$	N/A
3. Hot Standby	$< 0.99$	N/A	$\geq 350^{\circ}\text{F}$
4. Hot Shutdown**	$< 0.99$	N/A	$350^{\circ}\text{F} > T_{avg} > 200^{\circ}\text{F}$
5. Cold Shutdown**	$< 0.99$	N/A	$\leq 200^{\circ}\text{F}$
6. Refueling***	N/A	N/A	N/A

\* Excluding decay heat.

\*\* All reactor vessel head closure bolts fully tensioned.

\*\*\* One or more reactor vessel head closure bolts less than fully tensioned.

## WATTS BAR NUCLEAR PLANT

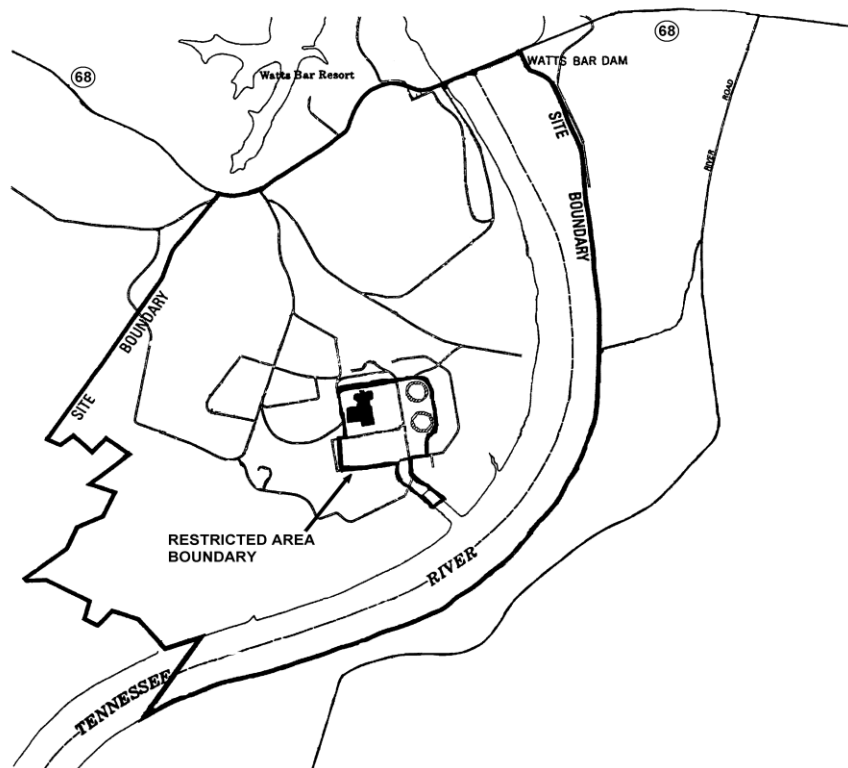


Figure 3.1 WBN Site Area Map

#### **4.0 - (NOT USED)**

### **5.0 ADMINISTRATIVE CONTROLS**

#### **5.1 ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT**

As required by WBN TS 5.9.2, Routine Annual Radiological Environmental Operating Reports covering the operation of both units during the previous calendar year shall be submitted prior to May 15 of each year.

The annual radiological environmental operating reports shall include summaries, interpretations, and an analysis of trends of the results of the radiological environmental surveillance activities for the report period, including a comparison with preoperational studies, with operational controls, and with previous environmental surveillance reports and an assessment of the observed impacts of the plant operation on the environment. The reports shall also include the results of land use censuses required by ODCM Control 1.3.2.

The annual radiological environmental operating reports shall include summarized and tabulated results of these analyses and measurements in the format of the table in the Radiological Assessment Branch Technical Position, Revision 1, November 1979. In the event that some results are not available for inclusion with the report, the report shall be submitted noting and explaining the reasons for the missing results. The missing data shall be submitted as soon as possible in a supplementary report.

The reports shall also include the following: a summary description of the radiological environmental monitoring program; at least two legible maps (one map shall cover stations near the UNRESTRICTED AREA BOUNDARY, a second shall include the more distant stations) covering all sampling locations keyed to a table giving distances and directions from the centerline of one reactor; and the results of licensee participation in the Interlaboratory Comparison Program and the corrective actions being taken if the specified program is not being performed as required by ODCM Control 1.3.1; discussion of all deviations from the sampling schedule of Table 2.3-1; reasons for not conducting the radiological environmental monitoring program as required by ODCM Control 1.3.1 and discussions of environmental sample measurements that exceed the reporting levels of Table 2.3-2 but are not the result of plant effluents, pursuant to action b. of ODCM Control 1.3.1; and discussion of all analyses in which the LLD required by Table 2.3-3 was not achievable.

#### **5.2 ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT**

As required by WBN TS 5.9.3, a Radioactive Effluent Release Report covering the operation of both units during the previous year shall be submitted prior to May 1 of each year. The period of the first report shall begin with the date of initial criticality.

The Annual Radioactive Effluent Release Report shall include a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the units as outlined in Regulatory Guide 1.21, "Measuring, Evaluating, and Reporting Radioactivity in Solid Wastes and Releases of Radioactive Materials in Liquid and Gaseous Effluents from Light-Water-Cooled Nuclear Power Plants," Revision 1, June 1974, with data summarized on a quarterly basis following the format of Appendix B thereof, as applicable. Additional requirements for reporting solid waste are specified in the Process Control Program.

The radioactive effluent release reports shall include a list and description of unplanned releases from the site to UNRESTRICTED AREAS of radioactive materials in gaseous and liquid effluents made during the reporting period.

The radioactive effluent release reports shall include any changes made during the reporting period to the Process Control Program, and to the ODCM pursuant to ODCM Administrative Control 5.3, as well as any major changes to Liquid, Gaseous, or Solid Radwaste Treatment Systems, pursuant to WBN Technical

Specifications. It shall also include a listing of new location for dose calculations and/or environmental monitoring identified by the Land Use Census pursuant to ODCM Control 1.3.2.

The radioactive effluent release reports shall also include the following: an explanation as to why the inoperability of liquid or gaseous effluent monitoring instrumentation was not corrected within the time specified in ODCM Controls 1.1.1 or 1.1.2, respectively.

The radioactive effluent release report shall include an annual summary of hourly meteorological data collected over the previous year. This annual summary may be either in the form of an hour-by-hour listing on magnetic tape of wind speed, wind direction, atmospheric stability, and precipitation (if measured), or in the form of joint frequency distributions of wind speed, wind direction, and atmospheric stability. In lieu of submission with the radioactive effluent release report, this summary of required meteorological data may be retained on site in a file that shall be provided to NRC upon request. This same report shall include an assessment of the radiation doses due to radioactive liquid and gaseous effluents released from the unit or station during the previous calendar year. This same report shall also include an assessment of the radiation doses from radioactive liquid and gaseous effluents to MEMBERS OF THE PUBLIC due to their activities inside the UNRESTRICTED AREA BOUNDARY during the report period. All assumptions used in making these assessments (i.e., specific activity, exposure time, and location) shall be included in these reports. The meteorological conditions concurrent with the time of release of radioactive materials in gaseous effluents, as determined by sampling frequency and measurement, shall be used for determining the gaseous pathway doses. The assessment of radiation doses shall be performed in accordance with Sections 6.6 and 7.7. [SOURCE NOTE 8]

The radioactive effluent release report shall also include an assessment of radiation doses to the likely most exposed MEMBER OF THE PUBLIC from reactor releases and other nearby uranium fuel cycle sources, including doses from primary effluents and direct radiation, for the previous calendar year to show conformance with 40 CFR 190, in accordance with ODCM Section 8.1.

The radioactive effluent release report shall include results from any groundwater samples obtained during the reporting period that are not described in the ODCM.

The radioactive effluent release report shall include any onsite radioactive spills or leaks, and their assigned doses that occurred during the reporting period.

### **5.3 OFFSITE DOSE CALCULATION MANUAL CHANGES**

As required by WBN TS 5.7.2.3, changes to the ODCM:

1. Shall be documented and records of reviews performed shall be retained. This documentation shall contain:
  - a. Sufficient information to support the change together with the appropriate analyses or evaluations justifying the change(s) and
  - b. A determination that the change will maintain the level of radioactive effluent control required by 10 CFR 20.1302, 40 CFR 190, 10 CFR 50.36a, and Appendix I to 10 CFR 50 and not adversely impact the accuracy or reliability of effluent, dose, or setpoint calculations.
2. Shall become effective after review and acceptance by the PORC and the approval of the Plant Manager.
3. Shall be submitted to the NRC in the form of a complete, legible copy of the entire ODCM as a part of or concurrent with the Annual Radioactive Effluent Release Report for the period of the report in which any change to the ODCM was made. Each change shall be identified by markings in the margin of the affected pages, clearly indicating the area of the page that was changed, and shall indicate the date (i.e., month/year) the change was implemented.

Changes to the ODCM shall be performed in accordance with the requirements of Appendix C.

### **5.4 SPECIAL REPORTS**

Special Reports shall be submitted in accordance with 10 CFR Part 50.4. [SOURCE NOTE 16]

### **5.5 40 CFR 302 REPORTING**

Any releases of radioactivity exceeding both the 40 CFR 190 dose limits and 40 CFR 302.4 reportable quantities, shall be reported immediately to the National Response Center in accordance with the requirements given in 40 CFR 302.6.

**5.6 CHANGES TO RADWASTE TREATMENT SYSTEM**

Licensee-initiated major changes to the Radwaste Treatment Systems (liquid and gaseous) shall be reported to the Commission in the Annual Radioactive Effluent Release Report for the period in which the evaluation was reviewed by the Plant Operations Review Committee (PORC). The discussion of each change shall contain:

1. A summary of the evaluation that led to the determination that the change could be made in accordance with 10 CFR 50.59;
2. Sufficient detailed information to totally support the reason for the change without benefit of additional or supplemental information;
3. A detailed description of the equipment, components, and processes involved and the interfaces with other plant systems;
4. An evaluation of the change, which shows the predicted releases of radioactive materials in liquid and gaseous effluents that differ from those previously evaluated in the Final Safety Analysis Report;
5. An evaluation of the change, which shows that the expected maximum exposures to a MEMBER OF THE PUBLIC in the UNRESTRICTED AREA and to the general population that differ from those previously estimated in the Final Safety Analysis Report;
6. A comparison of the predicted releases of radioactive materials, in liquid and gaseous effluents, to the actual releases for the period prior to when the changes are to be made;
7. An estimate of the exposure to plant operating personnel as a result of the change;
8. Documentation of the fact that the change was reviewed and found acceptable by the PORC.

## 6.0 - LIQUID EFFLUENTS INTRODUCTION

Radioactive liquid effluents from WBN enter the UNRESTRICTED AREA through the diffusers into the Tennessee River. There are four plant systems from which radioactive effluents are released. These are the Liquid Radwaste Treatment System (LRTS), the Condensate Demineralizer System, the Turbine Building Sump (TBS), and the Units 1 and 2 Steam Generator Blowdown (SGBD). Figure 6.1 provides an outline of these liquid release paths with associated radiation monitors.

The LRTS, the Condensate Demineralizer System and the SGBDs flow into the Cooling Tower Blowdown (CTBD) for dilution. Each of these release paths is also monitored by a radiation monitor. These monitors perform two main functions: to identify any unexpected radioactivity releases, and to ensure that the concentration limits of ODCM Control 1.2.1.1 are not exceeded. Each monitor has an alarm/trip setpoint which will alarm if the monitor's setpoint is exceeded. Alarm and trip functions are not provided by separate devices, therefore the alarm/trip setpoint is a single calculated value. The monitors on the Radwaste, Condensate Demineralizer, and SGBD systems will alarm and isolate any release which exceeds the alarm/trip setpoint. The TBS radiation monitor will alarm if the setpoint is exceeded, but this monitor does not have an isolation function.

Releases are made as either a batch or continuous release. Releases from Radwaste Tanks (see Figure 6.2) and the Condensate Demineralizer tanks (see Figure 6.3) are made as batch releases. The TBS, SGBD, and groundwater sump are continuous releases when flow exists.

For batch releases, any tank to be released is sampled for radioactivity, as described in ODCM Section 6.1.1. The tank contents are analyzed to determine the maximum allowable release flow rates to ensure compliance with the concentration limits of ODCM Control 1.2.1.1 as described in ODCM Section 6.1.2. The sampling results are also used to determine a setpoint for the associated radiation monitor for the release in accordance with ODCM Section 6.2.3.

For continuous releases, the pathways are sampled for radioactivity periodically, as described in ODCM Section 6.1.1. The samples are analyzed to ensure compliance with the concentration limits of ODCM Control 1.2.1.1, as described in ODCM Section 6.1.2. The sampling results are also used to determine a setpoint for the associated radiation monitor for the release in accordance with ODCM Section 6.2.3.

Dose calculations are performed for each sampling period, or release, as applicable, to determine compliance with ODCM Control 1.2.1.2 as detailed in ODCM Sections 6.3 and 6.4. Once per month, the projected dose is calculated, as outlined in Section 6.5, to determine compliance with ODCM Control 1.2.1.3. The calculational methodologies are based on the guidance provided in NUREG-0133 (Reference 3) and Regulatory Guide 1.109 (Reference 4).

The quantities of each radionuclide identified and released are input into a more rigorous calculation methodology, described in ODCM Section 6.6, to determine the individual and population doses to be reported to the NRC in the Annual Radioactive Effluent Release Report. These dose methodologies are based on the guidance provided in Regulatory Guide 1.109 (Reference 4).

## RELEASE POINTS

### Liquid Radwaste Treatment System

The LRTS processes liquid from the Reactor Building and Auxiliary Building Floor Drains, the CVCS Holdup Tanks, the Laundry/Hot Shower Tanks, the Waste Condensate Tanks and Chemical Drain Tank. Figure 6.2 provides a schematic of the Liquid Radwaste System, showing the flow pathways and flow rates. The LRTS has individual release points for each of the tanks. The routine release points for liquid radwaste are the Monitor Tank and the Cask Decontamination Collector Tank (CDCT) and the Tritiated Water Storage Tank (TWST). The Monitor Tank has a capacity of 20,462 gal and can be released at a maximum design flow rate of 150 gpm. The CDCT has a capacity of 15,000 gal and can be released at a maximum design flow rate of 100 gpm. The TWST has a capacity of 500,000 gal and can be released at a maximum design flow rate of 140 gpm. The Monitor Tank, CDCT, and TWST discharge to the Cooling Tower Blowdown line as a batch release and are monitored by radiation monitor 0-RE-90-122. There is a flow interlock on the CTBD which suspends the release if the flow is less than 20,000 gpm.

### Condensate Demineralizer System

The Condensate Demineralizer System liquid wastes are released from the High Crud Tanks (HCT-A and -B), the Neutralization Tank, and the Non-Reclaimable Waste Tank (NRWT). Figure 6.3 provides a schematic of the Condensate Demineralizer System, showing the flow pathways and flow rates. The HCTs have a capacity of 20,000 gal and a maximum design discharge flow rate of 150 gpm. The Neutralization Tank has a capacity of 20,000 gal and a maximum design discharge flow rate of 100 gpm. The NRWT has a capacity of 11,000 gal and a maximum design discharge flow rate of 115 gpm. Each of these tanks is defined as a release point for the system. When tank contents are required to be permitted for radioactivity, the Condensate Demineralizer System waste is released to the CTBD line and is monitored by radiation monitor 0-RE-90-225. There is a flow interlock on the CTBD which suspends the release if the flow is less than 20,000 gpm. The low flow interlock may be bypassed and releases made from the Condensate Demineralizer System with less than 20,000 gpm CTBD flow provided the sum of the ratios of the ECLs for all release points is  $\leq 10$ .

### Turbine Building Sump

The TBS normally releases to the Low Volume Waste Treatment Pond, but can be released to either the Metal Waste Cleaning Ponds or the 35 acre Yard Holding Pond. The TBS has a capacity of 57,783 gal and a design discharge release rate of 2,000 gpm per pump. The TBS is monitored by radiation monitor 0-RE-90-212.

### Steam Generator Blowdown

The SGBD is processed in the Steam Generator Blowdown Flash Tanks or SGBD Heat Exchangers. Figure 6.3 provides a schematic of the SGBD System, showing the flow pathways and flow rates. The SGBD discharge has a maximum design flow rate of 65.5 gpm per steam generator when discharging to the Cooling Tower Blowdown. SGBD is recycled or is released to the CTBD line and monitored by radiation monitors 1,2-RE-90-120 and 1,2-RE-90-121. There is a flow interlock on the CTBD which suspends the release if the flow is less than 20,000 gpm. The low flow interlock may be bypassed and releases made from the Steam Generator Blowdown System with less than 20,000 gpm CTBD flow provided the sum of the ratios of the ECLs for all release points is  $\leq 10$ .

### Groundwater Sump

The Groundwater Sump (GWS) normally releases to the 35 acre Yard Holding Pond via the storm drains. The GWS has a design discharge release rate of 300 gpm per pump. The GWS is not monitored by a radiation monitor.

## 6.1 LIQUID RELEASES

### 6.1.1 Pre-Release Analysis

Radwaste and Condensate Demineralizer tanks will be mixed for a period of time (specified in plant procedures) prior to sampling to ensure that a representative sample is obtained. Recirculation times to ensure adequate mixing will be established by testing. Periodically, checks will be made to ensure a representative mixing of tank contents. Prior to any batch release, a grab sample will be taken and analyzed in accordance with Table 2.2-1.

Releases from the steam generator blowdown, turbine building sump, and groundwater sump are considered continuous. For continuous releases, daily grab or composite samples will be taken on days when releases are being made and analyzed in accordance with Table 2.2-1.

Composite samples are maintained during periods of radioactive discharge from all pathways (as required by Table 2.2-1) to determine the concentration of certain nuclides (H-3, Fe-55, Sr-89, Sr-90, and gross alpha). For those nuclides whose activities are determined from composite samples, the concentrations for the previous composite period can be assumed as the concentration for the next period to perform the calculations in Sections 6.3 and 6.5. The actual measured concentrations will be used for the dose calculations described in Section 6.6.

A maximum allowable waste flow rate, which will ensure compliance with ODCM Control 1.2.1.1, will be determined using Equations 6.1 and 6.2. Setpoints for the release are determined as described in Section 6.2. Dose calculations are performed in accordance with Section 6.3

### 6.1.2 Effluent Concentration Limits (ECL)-Sum of the Ratios

To determine release parameters to ensure compliance with ODCM Control 1.2.1.1, a sum of the ratios calculation is performed. The sum of the ratios (R) for each release point will be calculated by the following relationship.

$$R = \sum_i \frac{C_i}{ECL_i} \quad (6.1)$$

where:

R = the sum of the ratios for the release point.

ECL<sub>i</sub> = the ECL of radionuclide i,  $\mu\text{Ci/ml}$ , from 10 CFR 20, Appendix B, Table 2, Column 2.

C<sub>i</sub> = concentration of radionuclide i,  $\mu\text{Ci/ml}$ .

The sum of the ECL ratios must be  $\leq 10$  following dilution due to the releases from any or all of the release points described above. The ECL ratios for releases from either the Turbine Building Sump or the Groundwater Sump will be  $\leq 10$  at the sump.

The following relationship is used to ensure that this criterion is met:

$$R_{GWS} + R_{TBS} + \frac{f_1 R_1 + f_2 R_2 + f_3 R_3 + f_4 R_4}{F} \leq 10.0 \quad (6.2)$$

where:

$R_{GWS}$  = sum of the ECL ratios of the groundwater sump as determined by equation 6.1.

$R_{TBS}$  = sum of the ECL ratios of the turbine building sump as determined by equation 6.1.

$f_{1,2,3,4}$  = effluent flow rate for radwaste, condensate demineralizer system and the steam generator blowdowns, respectively, gpm.

$R_{1,2,3,4}$  = sum of ECL ratios for radwaste, condensate demineralizer system and the steam generator blowdowns, respectively, as determined by equation 6.1.

$F$  = dilution flow rate for CTBD. The minimum assumed flow of 20,000 gpm will be used for radwaste pre-release calculations.

### 6.1.3 Post-Release Analysis

A post-release evaluation will be done using actual release data to ensure that the limits specified in ODCM Control 1.2.1.1 were not exceeded.

A composite list of concentrations ( $C_i$ ), by nuclide, will be used with the actual waste flow ( $f$ ) and dilution ( $F$ ) flow rates (or volumes) during the release. The data will be evaluated to demonstrate compliance with the limits in ODCM Control 1.2.1.1. [SOURCE NOTE 10]

## 6.2 INSTRUMENT SETPOINTS

Liquid effluent monitor setpoints are determined to ensure that the concentration of radioactive material released at any time from the site to UNRESTRICTED AREAS does not exceed ten times the ECL limits referenced in ODCM Control 1.2.1.1 and to identify any unplanned releases.

The liquid effluent radiation monitors and their setpoint information are outlined below:

Pathway	Monitor	Default Setpoint	Setpoint Limit	ODCM Section
ERCW	0-RE-90-133 0-RE-90-134 0-RE-90-140 0-RE-90-141	Section 6.2.1	N/A	6.2.1
Radwaste	0-RE-90-122	Section 6.2.2	$S_{max}$	6.2.2
Condensate Demineralizer	0-RE-90-225	Section 6.2.2	$S_{max}$	6.2.2
TBS	0-RE-90-212	Section 6.2.2	$S_{max}$	6.2.2
SGBD	1-RE-90-120 2-RE-90-120 1-RE-90-121 2-RE-90-121	Section 6.2.2	$S_{max}$	6.2.2

### 6.2.1 Process Discharge Point Monitor Setpoints (0-RE-90-133,-134,-140,-141)

The setpoints for the ERCW monitors (0-RE-90-133,-134,-140,-141) must ensure that the concentration of radioactive materials released at any time from the site do not exceed the limits given in ODCM Control 1.2.1.1. Since this effluent stream will not routinely contain radioactivity, the setpoints for these monitors will be set at two times background to ensure that any radioactivity is identified. Site procedures will document and control this value.

### 6.2.2 Release Point Monitor Setpoints (0-RE-90-122; 0-RE-90-225; 0-RE-90-212; 1,2-RE-90-120,-121)

The radiation monitor for batch release points, the Liquid Radwaste System and the Condensate Demineralizer System, monitors the undiluted waste stream as it comes out of a tank. The purpose of the monitor setpoints for these batch releases is to identify any gamma-emitting release that is larger than expected and would have the potential to exceed the limits after dilution. Setpoints are calculated as described by equations 6.3, 6.4, and 6.5 and may be set at a default value. Site procedures will document and control this value.

The continuous release points, the Steam Generator Blowdowns, and the Turbine Building Sump, will not be releasing gamma-emitting radioactivity unless there is or has been a primary to secondary leak. If this is the case, the continuous release points are monitored to identify any gamma-emitting release that is larger than expected and would have the potential to exceed the ODCM Control 1.2.1.1 concentration limits after dilution. The monitor setpoints are calculated using Equations 6.3, 6.4, and 6.5 when this is the case. When these release points are being treated in this manner, a single release is defined as all effluent released through this point on a continuous bases for a period of time (usually one week). During periods when there is no identified primary to secondary leak, these monitors are set to  $\leq 2$  times background. Site procedures will document and control these setpoint values.

For each release from a release point, two setpoints are calculated: one based on the monitor response to the contents of the effluent stream (as described below in Equation 6.4); and another based on the predicted response of the monitor to the activity in the release stream if it were large enough to exceed ten times the 10 CFR 20 limits after dilution (as described below in Equation 6.5). A comparison is made between these two calculated setpoints and the lower of the two is used for the release. If default setpoints are used then a comparison is made between the two calculated setpoints and the default setpoint as described below to choose the appropriate setpoint for the monitor during the release (after the release, the monitor is normally returned to the default setpoint).

- |  |                          |
|--|--------------------------|
| 1. If $S_{ER} < S_{default} < S_{max}$ | Reported = $S_{default}$ |
| 2. If $S_{ER} < S_{max} < S_{default}$ | Reported = $S_{ER}$      |
| 3. If $S_{ER} \geq S_{max}$            | Reported = $S_{max}$     |

#### 6.2.2.1 Expected Response

An expected response (ER) is calculated for the monitor for each release:

$$ER = BKG + \sum_i (E_i C_i) \quad (6.3)$$

where:

BKG = monitor background, cpm. The monitor's background is controlled at an appropriate limit to ensure adequate sensitivity in accordance with site procedures.

$E_i$  = monitor efficiency for nuclide i, cpm per  $\mu\text{Ci/ml}$ . This term may also be referred to as a response or calibration factor.

$C_i$  = tank concentration of nuclide i,  $\mu\text{Ci/ml}$ .

**6.2.2.2 Expected Response Setpoint**

An expected response setpoint  $S_{ER}$  is calculated for the monitor for each release:

$$S_{ER} = X \sum_i E_i C_i + X BKG \quad (6.4)$$

where:

$X$  = administrative factors designed to account for expected variations in monitor response and background (as defined in plant procedures). The ranges of values are:  $0 < X \leq 2.0$ .

**6.2.2.3 Calculated Maximum Monitor Setpoint**

A second setpoint is calculated for the release based on the predicted response of the monitor to the gamma-emitting activity in the release stream if it were large enough to exceed ODCM Control 1.2.1.1 limits after dilution. This setpoint ensures that the release will be stopped if it exceeds this limit. The maximum calculated setpoint calculation must satisfy the following relationship from NUREG-0133:

$$\frac{s f}{(F + f)} \leq C$$

where:

$C$  = the effluent concentration limit from 10 CFR 20 Appendix B, Table 2, Column 2, in  $\mu\text{Ci/ml}$ , represented by a value of 1.

$s$  = the setpoint, in  $\mu\text{Ci/ml}$ , of the monitor measuring the radioactivity concentration in the effluent line prior to dilution and subsequent release. The setpoint, which is proportional to the volumetric flow of the effluent line and inversely proportional to the volumetric flow of the dilution stream, represents a value which, if exceeded, would result in release concentrations exceeding the limits of ODCM Control 1.2.1.1 when the effluent enters the Tennessee River.

$f$  = the flow rate of the waste stream, gpm.

$F$  = the dilution flow rate, gpm.

To determine the setpoint in cpm, If no dilution is available, then  $s \leq C$ .

Since  $C$  in the above equation represents the concentration equal to the limit, the setpoint  $s$  can be replaced by:

$$s = c_a D_{req}$$

where

$c_a$  = the actual effluent concentration,  $\mu\text{Ci/ml}$ .

$D_{req}$  = the required dilution factor.

The required dilution can be defined as:

$$D_{\text{req}} = \frac{R}{10 \text{ SF}}$$

where:

R = the sum of the ratios for gamma-emitting radionuclides, as determined by equation 6.1.

10 = a value which implements the concentration limits of ODCM Control 1.2.1.1.

SF = a safety factor. The range of values for SF is:  $0 < \text{SF} \leq 1$ .

Substituting  $c_a D_{\text{req}}$  into the above equation for s, substituting 1 for C, and solving for  $c_a$ :

$$c_a \leq \frac{10 \text{ SF} (F + f)}{f R}$$

This value represents the amount that the expected response setpoint would be adjusted upward to account for the downstream dilution. For WBN, a portion of the total dilution flow is allocated to each release point using an allocation factor (AF). To determine the maximum calculated monitor setpoint,  $S_{\text{max}}$ , in cpm for a release point, the following equation is used:

$$S_{\text{max}} = \left\{ \frac{10 \text{ SF} (f + (AF \times F))}{f R} \right\} (ER - \text{BKG}) + \text{BKG} \quad (6.5)$$

where:

AF = fraction of dilution flow allocated to this release point. For the TBS, AF = 0. The fractions for the remaining 4 release points are normally defined as the ratio of the allocated CTBD flow for that release point to the total CTBD flow. The CTBD flow allocation fractions for these release points are routinely:

Radwaste	0.6
Condensate demineralizer	0.2
Steam Generator Blowdown (U1)	0.1
Steam Generator Blowdown (U2)	0.1

These allocation factors may be adjusted for a particular release if it is known that there are no releases being made through other release points into the CTBD. For example, if there are no releases being made through the Condensate Demineralizer or either SGBD, the AF for the Radwaste System may be set equal to one.

ER = expected monitor response, cpm, as calculated in Equation 6.3.

BKG = background, cpm.

### 6.3 CUMULATIVE LIQUID EFFLUENT DOSE CALCULATIONS

Doses due to liquid effluents are calculated for each release for the following age groups: adult (17 years and older), teen (11-17 years), child (1-11 years), infant (0-1 years) (Reference 4); and the following organs: bone, liver, total body, thyroid, skin, kidney, lung, and GI tract.

Using the methodology presented in NUREG-0133, Section 4.3, doses due to liquid effluents are calculated for the ingestion of drinking water and freshwater fish consumption. Due to the amount of recreation along the Tennessee River, a dose for shoreline recreation is also calculated. This recreation dose is calculated by deriving a dose factor for use in the dose equation for the recreation pathway using equations A-4 and A-6 in Regulatory Guide 1.109. Dose factors for these three pathways are calculated as described in Section 6.7. For pathways with no age or organ specific dose factors (i.e., shoreline recreation), the total body dose will be added to the internal organ doses for all age groups. The consumption of freshwater invertebrates and consumption of food crops irrigated with Tennessee River water are not considered significant pathways for the area surrounding WBN (References 9 and 10), so they are not considered in the dose calculations.

The maximum individual dose from drinking water is assumed to be that calculated at the location immediately downstream from the diffuser. The maximum individual dose from fish ingestion is assumed to be that calculated for the consumption of fish caught anywhere between the plant and the 100% mixing point downstream (Table 6.1). The maximum potential recreation dose is calculated for a location immediately downstream of the plant outfall.

The general equation for the dose to an organ  $j$  is:

$$D_j = \sum_i A_{ij} T C_i D \quad (6.6)$$

where:

$A_{ij}$  = the total dose factor to the total body or any organ  $j$  for nuclide  $i$ , mrem/h per  $\mu\text{Ci/ml}$ . The total dose factor is the sum of the dose factors for water ingestion, fish ingestion, and shoreline recreation, as defined in Section 6.7.

$T$  = the length of time period over which the concentrations and the flows are averaged, h.

$C_i$  = the average concentration of radionuclide  $i$ , in undiluted liquid effluent during the time period  $T$  from any liquid release,  $\mu\text{Ci/ml}$ .

$D$  = the near field average dilution factor for  $C_i$  during any effluent release.  $D$  is calculated by the following equation:

$$D = \frac{f}{0.10 \times \text{RF}} \quad (6.7)$$

where:

$f$  = maximum undiluted liquid waste flow during the release, cfs. For TBS releases, this term is the waste flow into the pond.

$0.10$  = mixing fraction of effluent in river, defined as the fraction of the riverflow which is available for dilution of the release (Reference 11).

$\text{RF}$  = default riverflow, cfs. For each release, this value is set to 25,657 cfs (the average quarterly riverflow recorded from the period 1985-94).

From the four age groups considered, the maximum organ dose is determined by comparing all organ doses for all age groups. The age group with the highest single organ dose is selected as the critical age group. The total body and maximum organ doses for the critical age group are used in the calculation of the cumulative doses described in Section 6.3.1.

### 6.3.1 Cumulative Doses

Cumulative quarterly and annual sums of all doses are determined for each release to compare to the limits given in ODCM Control 1.2.1.2. These quarterly and annual sums will be the sum of the doses for each release which occurred in that quarter or year. These doses will be used in the comparison to the limits.

### 6.3.2 Comparison to Limits

The cumulative calendar quarter and calendar year doses are compared to the limits in ODCM Control 1.2.1.2 at least once per 31 days to determine compliance.

## 6.4 LIQUID WASTE TREATMENT SYSTEM

The LRTS described in the WBN FSAR shall be maintained and operated to keep releases ALARA. A flow diagram for the LRTS is given in Figure 6.2.

## 6.5 DOSE PROJECTIONS

In accordance with ODCM Surveillance Requirements 2.2.1.3.1 and 2.2.1.3.2, dose projections will be performed at least once per 31 days using the equation below:

$$D = \left\{ \frac{(a + b)}{d} \times 31 \right\} + c \quad (6.8)$$

where:

- D = the 31-day dose projection, mrem.
- a = the cumulative dose for the quarter, mrem.
- b = the projected dose for this release, mrem.
- c = any anticipated additional dose in the next month from other sources, mrem.
- d = current number of days into the quarter up to the time of the release under consideration.

## 6.6 DOSE CALCULATIONS FOR REPORTING

A complete dose analysis utilizing the total estimated liquid releases for each calendar quarter will be performed and reported as required in ODCM Administrative Control 5.2. Methodology for this analysis is based on the methodology presented in Regulatory Guide 1.109 and is described in this section. The releases are assumed, for this calculation, to be continuous over the 90 day period.

The near-field dilution factor,  $D_{NF}$ , used for the quarterly calculations is:

$$D_{NF} = \frac{1}{0.10 \text{ RF}} \quad (\text{for receptors upstream of Tennessee River Mile 510.0}) \quad (6.9)$$

and

$$D_{NF} = \frac{1}{\text{RF}} \quad (\text{for receptors downstream of Tennessee River Mile 510.0}) \quad (6.10)$$

where:

RF = the average actual riverflow for the location at which the dose is being determined, cfs.

0.10 = the fraction of the riverflow available for dilution in the near field, dimensionless (Reference 11).

Note: TRM 510.0 is the point at which the effluent is considered to be fully mixed with the riverflow (Reference 11).

### 6.6.1 Water Ingestion

Water ingestion doses are calculated for each water supply identified within a 50 mile radius downstream of WBN (Table 6.1). The water ingestion dose equation is based on Regulatory Guide 1.109, Equation 1:

$$D = k \left( \frac{U_{ap} M_p}{F} \right) \sum_i q_i A_{wai} \exp(-\lambda_i t_d)$$

For WBN, the dilution factor ( $M_p/F$ ) is replaced by the near field dilution factor ( $D_{NF}$ ) described by Equations 6.9 and 6.10, and the usage factor ( $U_{ap}$ ) and dose conversion factors ( $A_{wai}$ ) are incorporated into the dose factor (as described in Section 6.7.1). The resulting equation for the water ingestion dose,  $D_j$ , in mrem, to organ j is:

$$D_j = 10^6 (9.80 \text{E-} 09) \sum_i A_{waij} q_i D_{NF} \exp(-8.64 \text{E} 04 \lambda_i t_d) \quad (6.11)$$

where:

$10^6$  = conversion factor,  $\mu\text{Ci}/\text{Ci}$ .

$9.80 \text{E-} 09$  = conversion factor, cfs per ml/h.

$A_{waij}$  = dose factor for water ingestion for age group a, nuclide i, and organ j, mrem/h per  $\mu\text{Ci}/\text{ml}$ , as calculated in Section 6.7.1.

$q_i$  = quantity of nuclide i released during the quarter, Ci.

$D_{NF}$  = dilution factor, as described above,  $\text{cfs}^{-1}$ .

$\lambda_i$  = radiological decay constant of nuclide i,  $\text{s}^{-1}$  (Table 6.2).

$t_d$  = decay time for water ingestion, equal to the travel time from the plant to the water supply plus one day to account for the time of processing at the water supply (per Regulatory Guide 1.109), d.

$8.64 \text{E} + 04$  = conversion factor, s/d.

### 6.6.2 Fish Ingestion

Fish ingestion doses are calculated for each identified reach within a 50 mile radius downstream of WBN (Table 6.1). The fish ingestion dose equation is based on Regulatory Guide 1.109, Equation 2:

$$D = k \left( \frac{U_{ap} M_p}{F} \right) \sum_i q_i B_i A_{Faij} \exp(-\lambda_i t_d)$$

For WBN, the dilution factor ( $M_p/F$ ) is replaced by the near field dilution factor ( $D_{NF}$ ) described by Equations 6.9 and 6.10, and the usage factor ( $U_{ap}$ ), bioaccumulation factor ( $B_i$ ), and dose conversion factors ( $A_{Faij}$ ) are incorporated into the dose factor (as described in Section 6.7.2). The resulting equation for the fish ingestion dose  $D_j$ , in mrem, to organ j is:

$$D_j = 10^6 (9.80 \text{E-} 09) \sum_i A_{Faij} q_i D_{NF} \exp(-8.64 \text{E} 04 \lambda_i t_d) \quad (6.12)$$

where:

$10^6$  = conversion factor,  $\mu\text{Ci}/\text{Ci}$ .

$9.80 \text{E-} 09$  = conversion factor, cfs per ml/h.

$A_{Faij}$  = dose factor for fish ingestion for nuclide i, age group a, organ j, mrem/h per  $\mu\text{Ci}/\text{ml}$ , as calculated in Section 6.7.2.

$q_i$  = quantity of nuclide i released during the quarter, Ci.

$D_{NF}$  = dilution factor, as described above,  $\text{cfs}^{-1}$ .

$\lambda_i$  = radiological decay constant of nuclide i,  $s^{-1}$  (Table 6.2).  
 $t_d$  = decay time for fish ingestion, equal to the travel time from the plant to the center of the reach plus one day to account for transit through the food chain and food preparation time (per Regulatory Guide 1.109), d.  
 $8.64E+04$  = conversion factor, s/d.

### 6.6.3 Shoreline Recreation

Recreation doses are calculated for each identified reach within a 50 mile radius downstream of WBN (Table 6.1). It is assumed that the maximum exposed individual spends 500 hours per year on the shoreline at a location immediately downstream from the diffusers. This is a more conservative usage factor than that provided in Regulatory Guide 1.109. It assumes that an individual visits the shoreline for an average of 10 hours per week for 50 weeks per year. The shoreline recreation dose equation is based on Regulatory Guide 1.109, Equation 3:

For WBN, the dilution factor  $M_p/F$  is replaced by the near field dilution factor ( $D_{NF}$ ) described by Equations 6.9 and 6.10, and the usage factor ( $U_{ap}$ ), shoreline width factor (SWF), radioactive half-life ( $T_i$ ), dose conversion factor ( $A_{Raij}$ ) and the second exponential term are incorporated into the dose factor (as described in Section 6.7.3). The resulting equation for the shoreline recreation dose  $D_j$ , in mrem, to organ j is:

$$D_j = 10^6 (9.80E-09) \sum_i A_{Raij} q_i D_{NF} \exp(-8.64E04 \lambda_i t_d) \quad (6.13)$$

where:

$10^6$  = conversion factor,  $\mu Ci/Ci$ .  
 $9.80E-09$  = conversion factor, cfs per ml/h.  
 $A_{Raij}$  = dose factor for shoreline recreation for nuclide i, age group a, organ j, mrem/h per  $\mu Ci/ml$ , as calculated in Section 6.7.3.  
 $q_i$  = quantity of nuclide i released during the quarter, Ci.  
 $D_{NF}$  = dilution factor, as described above,  $cfs^{-1}$   
 $\lambda_i$  = radiological decay constant of nuclide i,  $s^{-1}$  (Table 6.2).  
 $t_d$  = decay time for recreation, equal to the travel time from the plant to the center of the reach, d.  
 $8.64E+04$  = conversion factor, s/d.

#### 6.6.4 Total Maximum Individual Dose

The total maximum individual quarterly total body dose for each age group  $a$ ,  $D(tb)_a$ , is obtained using the following equation:

$$D(tb)_a = D_W + D_F + D_R \quad (6.14)$$

where:

$D_W$  = the highest total body water ingestion dose for age group  $a$  from among all the public water supplies

$D_F$  = the highest total body fish ingestion dose for age group  $a$  from among all the reaches

$D_R$  = the total body maximum shoreline recreation dose.

The total maximum individual quarterly organ dose for each age group  $a$  and each organ  $j$ ,  $D(org)_{aj}$ , is obtained using the following equation:

$$D(org)_{aj} = D_W + D_F + D_R \quad (6.15)$$

where:

$D_W$  = the highest water ingestion dose for age group  $a$  and organ  $j$  from among all the public water supplies

$D_F$  = the highest fish ingestion dose for age group  $a$  and organ  $j$  from among all the reaches

$D_R$  = the maximum shoreline recreation dose for organ  $j$ . The total body dose is used for all organs except skin.

The doses reported are the highest total body dose (selected from all age groups) and the highest maximum organ dose (selected from all remaining organs and all age groups).

### 6.6.5 Population Doses

For determining population doses to the 50-mile population around the plant, an average dose is calculated for each age group and each pathway and then multiplied by the population and the fraction of the population in each age group. The population dose is determined using equation D-1 from Regulatory Guide 1.109:

$$D = k \sum_m \text{POP}_m \sum_a D_{jma} fP_a$$

For WBN, the average individual doses ( $D_{jma}$ ) are determined by obtaining the ratio of the average consumption rate to the maximum consumption rate and multiplying this by the maximum individual dose. For water ingestion, the general equation used for calculating the population doses, POPWTR, in person-rem for a given Public Water Supply (PWS) is:

$$\text{POPWTR}_j = 10^{-3} \sum_{m=1}^4 \text{POP}_m \sum_{a=1}^4 fP_a \text{ATMW}_a \text{TWDOS}_{amj} \quad (6.16)$$

where:

$\text{POPWTR}_j$  = water ingestion population dose to organ j, person-rem.

$fP_a$  = fraction of population in each age group a (from NUREG CR-1004, table 3.39).

Adult = 0.665

Child = 0.167

Infant = 0.015

Teen = 0.153

$\text{POP}_m$  = population at PWS m. The 4 PWSs and their populations are listed in Table 6.1.

$\text{ATMW}_a$  = ratio of average to maximum water ingestion rates for each age group a. The values for maximum water ingestion rates are given as  $U_{wa}$  in Table 6.3. Average water ingestion rates, in L/y, (from Reference 4, Table E-4) are:

Adult = 370

Child = 260

Infant = 260

Teen = 260

$\text{TWDOS}_{amj}$  = total individual water ingestion dose to organ j at PWS m, to the age group a (calculated as described in Section 6.6.1), mrem.

$10^{-3}$  = conversion factor for rem/mrem.

For population doses resulting from fish ingestion the calculation assumes that all fish caught within a 50-mile radius downstream of WBN are consumed by local population. The total fish harvest is calculated by multiplying the average fish harvest for the Tennessee River (HVST) by the size of the river reach under consideration (APR). These terms replace  $\text{POP}_m$ . The general equation for calculating population doses, POPF, in person-rem from fish ingestion of all fish caught within a 50-mile radius downstream is:

$$\text{POPF}_j = 10^{-3} 10^{-3} 453.6 \text{HVST APR} \sum_{r=1}^4 \sum_{a=1}^4 \frac{\text{TFDOS}_{arj} fP_a}{\text{FISH}_a fP_a} \quad (6.17)$$

where:

$\text{POPF}_j$  = total fish ingestion population dose to organ j, person-rem.

HVST = fish harvest for the Tennessee River, 3.77 lbs/acre/y edible weight (Reference 12).

APR = size of reach, acres (Table 6.1).

$\text{TFDOS}_{arj}$  = total fish ingestion dose to organ j for reach r, for the age group a, (calculated as described in Section 6.6.2), mrem.

$fP_a$  = fraction of population in each age group a, as given above.

$\text{FISH}_a$  = amount of fish ingested by each age group a, kg/y. Average fish ingestion rates, kg/y (Reference 4, Table E-4) are:

Adult = 6.9  
 Child = 2.2  
 Teen = 5.2  
 Infant = 0.0  
 453.6 = conversion factor, g/lb.  
 $10^{-3}$  = conversion factor, rem/mrem.  
 $10^{-3}$  = conversion factor, kg/g.

For shoreline recreation, the total recreation dose is determined by multiplying the average dose rate (TSHDOS) to an individual by the number of visits to that river reach (SHVIS) and the length of the average visit (HRSVIS). The general equation used for calculating the population doses, POPR, in person-rem is:

$$POPR_j = \frac{1}{10^3 8760} \sum_{r=1}^4 TSHDOS_{ij} SHVIS_r HRSVIS_r \quad (6.18)$$

where:

POPR<sub>j</sub> = total recreation population dose for all reaches to organ j, person-rem.  
 TSHDOS<sub>ij</sub> = total shoreline dose rate for organ j, in reach r, mrem/h.  
 SHVIS<sub>r</sub> = shoreline visits per year at each reach r, (Table 6.1).  
 HRSVIS<sub>r</sub> = length of average shoreline recreation visit at reach r, 5 hours.  
 $10^3$  = conversion factor, mrem/rem.  
 8760 = conversion factor, h/y.

## 6.7 LIQUID DOSE FACTOR EQUATIONS

The general form of the liquid dose factor equation from NUREG-0133 is:

$$A_{ij} = k_0 \left( \frac{U_w}{D_w} + U_F BF_i + U_I BF_i \right) DF_i$$

where:

$k_0$  = conversion factors.

$U_w$  = water consumption rate, L/y.

$D_w$  = dilution factor from the near field area within one-quarter mile of the release point to the potable water intake for water consumption, dimensionless.

$U_F$  = fish consumption rate, kg/y.

$BF_i$  = bioaccumulation factor for nuclide i in freshwater fish, pCi/kg per pCi/L.

$U_I$  = invertebrate consumption rate, kg/y.

$DF_i$  = ingestion dose conversion factor, mrem/pCi.

Since the value of the term  $U_I$  is negligible, WBN will not be considering the dose from invertebrate ingestion and that portion of the equation is dropped. In addition, a term is added to account for recreation. The near-field dilution factor is assigned a value of 1 in the water ingestion portion of the equation and is not used for WBN due to the use of riverflow as the dilution factor in the dose calculation. The resulting general dose factor equation is:

$$A_{ij} = k_0 (U_w + U_F BF_i) DF_i + k_1 U_R C_s DFG_i$$

where:

$k_{0,1}$  = conversion factors.

$U_R$  = recreation usage factor, h/y.

$C_s$  = accumulation factor for buildup of activity in sediment, pCi/m<sup>2</sup> per pCi/L.

$DFG_i$  = dose factor for standing on contaminated ground, mrem/h per pCi/m<sup>2</sup>.

The equations for each of the individual pathway dose factors are presented in the following sections.

### 6.7.1 Water Ingestion Dose Factor - $A_{waij}$

(mrem/h per  $\mu$ Ci/ml)

$$A_{waij} = \frac{10^6 10^3 DF_{aij} U_{wa}}{8760} \quad (6.19)$$

where:

$DF_{aij}$  = ingestion dose conversion factor for nuclide i, age a, organ j, mrem/pCi, (Table 6.4).

$U_{wa}$  = water consumption rate for age group a, L/y, (Table 6.3).

$10^6$  = conversion factor, pCi/ $\mu$ Ci.

$10^3$  = conversion factor, mL/L.

8760 = conversion factor, h/y.

### 6.7.2 Fish Ingestion Dose Factor - $A_{Faij}$

(mrem/h per  $\mu\text{Ci/ml}$ )

$$A_{Faij} = \frac{10^6 10^3 DF_{aij} U_{fa} B_i}{8760} \quad (6.20)$$

where:

$DF_{aij}$  = ingestion dose conversion factor for nuclide i, age a, organ j, mrem/pCi, (Table 6.4).

$U_{fa}$  = fish consumption rate for age group a, kg/y, (Table 6.3).

$B_i$  = bioaccumulation factor for nuclide i, pCi/kg per pCi/L, (Table 6.5).

$10^6$  = conversion factor, pCi/ $\mu\text{Ci}$ .

$10^3$  = conversion factor, ml/L.

8760 = conversion factor, h/y.

### 6.7.3 Shoreline Recreation Dose Factor - $A_{Raij}$

(mrem/h per  $\mu\text{Ci/ml}$ )

Equation A-6 in Regulatory Guide 1.109 provides a methodology for calculating the dose due to shoreline recreation along a water body:

$$\text{Dose} = k K_c U_{SWF} \sum_i C_{iW} T_i DFG_{ij} [1 - \exp(-\lambda_i t_b)]$$

Since the terms  $C_{iW}$  and  $T$  are part of the dose equation (Equation 6.6), the equation for the dose factor becomes:

$$A_{Raij} = \left\{ \frac{(10^3 10^6 DFG_{ij} K_c M_{SWF} U_R)}{8760 \cdot 3600 \lambda_i} \right\} [1 - \exp(-\lambda_i t_b)] \quad (6.21)$$

where:

$DFG_{ij}$  = dose conversion factor for standing on contaminated ground for nuclide i and organ j (total body and skin), mrem/h per pCi/m<sup>2</sup>, (Table 6.6).

$K_c$  = transfer coefficient from water to shoreline sediment, L/kg-h, (Table 6.3).

$M$  = mass density of sediment, kg/m<sup>2</sup>, (Table 6.3).

$SWF$  = shoreline width factor, dimensionless, (Table 6.3).

$10^3$  = conversion factor, ml/L.

$10^6$  = conversion factor, pCi/ $\mu\text{Ci}$ .

3600 = conversion factor, s/h.

$\lambda_i$  = decay constant for nuclide i, s<sup>-1</sup>, (Table 6.2).

$t_b$  = time shoreline is exposed to the concentration of the water, s, (Table 6.3).

$U_R$  = recreation usage factor, 500 h/y.

8760 = conversion factor, h/y.

**Table 6.1 - RECEPTORS FOR LIQUID DOSE CALCULATIONS**

**Tennessee River Reaches Within 50 Mile Radius Downstream of WBN**

<b>Name</b>	<b>Beginning TRM</b>	<b>Ending TRM</b>	<b>Size<sup>1</sup> (acres)</b>	<b>Recreation<sup>2</sup> visits/y</b>
Chickamauga Lake (from WBN to 100% mixing point)	528	510 <sup>3</sup>	4799	120,986
Chickamauga Lake (from 100% mixing point to Sequoyah Nuclear Plant)	510 <sup>3</sup>	484	22101	1,297,880
Chickamauga Lake (from Sequoyah Nuclear Plant to Chickamauga Dam)	484	471	9889	7,421,905
Nickajack Lake (from Chickamauga Dam to WBN 50-mile radius)	471	460	1799	284,000

TRM - Tennessee River Mile.

<sup>1</sup> Reference 13.

<sup>2</sup> Reference 14.

<sup>3</sup> 100% Mixing Point (Reference 11).

**Public Water Supplies Within 50 Mile Radius Downstream of WBN**

<b>Name</b>	<b>TRM</b>	<b>Estimated 2040 Population</b>
Dayton, TN	504	19,170
Soddy-Daisy/Falling Water Utility District	487	11,452
East Side Utility, TN	473	49,700
Chattanooga, TN	465	237,048

**NOTE:** Tennessee river mile locations are rounded to the nearest mile for dose calculation purposes.

**Table 6.2 - RADIONUCLIDE DECAY AND STABLE ELEMENT TRANSFER DATA**  
(Page 1 of 3)

Nuclide	Half-Life (minutes)	$\lambda$ (s <sup>-1</sup> )	B <sub>iv</sub>	F <sub>mi</sub> (cow)	F <sub>mi</sub> (goat)	F <sub>fi</sub> (beef)
H-3	6.46E+06	1.79E-09	4.80E+00	1.00E-02	1.70E-01	1.20E-02
C-14	3.01E+09	3.84E-12	5.50E+00	1.20E-02	1.00E-01	3.10E-02
Na-24	9.00E+02	1.28E-05	5.20E-02	4.00E-02	4.00E-02	3.00E-02
P-32	2.06E+04	5.61E-07	1.10E+00	2.50E-02	2.50E-01	4.60E-02
Cr-51	3.99E+04	2.90E-07	2.50E-04	2.20E-03	2.20E-03	2.40E-03
Mn-54	4.50E+05	2.57E-08	2.90E-02	2.50E-04	2.50E-04	8.00E-04
Mn-56	1.55E+02	7.45E-05	2.90E-02	2.50E-04	2.50E-04	8.00E-04
Fe-55	1.42E+06	8.13E-09	6.60E-04	1.20E-03	1.30E-04	1.20E-02
Fe-59	6.43E+04	1.80E-07	6.60E-04	1.20E-03	1.30E-04	1.20E-02
Co-57	3.90E+05	2.96E-08	9.40E-03	1.00E-03	1.00E-03	1.30E-02
Co-58	1.02E+05	1.13E-07	9.40E-03	1.00E-03	1.00E-03	1.30E-02
Co-60	2.77E+06	4.17E-09	9.40E-03	1.00E-03	1.00E-03	1.30E-02
Ni-63	5.27E+07	2.19E-10	1.90E-02	6.70E-03	6.70E-03	5.30E-02
Ni-65	1.51E+02	7.65E-05	1.90E-02	6.70E-03	6.70E-03	5.30E-02
Cu-64	7.62E+02	1.52E-05	1.20E-01	1.40E-02	1.30E-02	9.70E-04
Zn-65	3.52E+05	3.28E-08	4.00E-01	3.90E-02	3.90E-02	3.00E-02
Zn-69m	8.26E+02	1.40E-05	4.00E-01	3.90E-02	3.90E-02	3.00E-02
Zn-69	5.56E+01	2.08E-04	4.00E-01	3.90E-02	3.90E-02	3.00E-02
Br-82	2.12E+03	5.45E-06	7.60E-01	5.00E-02	5.00E-02	2.60E-02
Br-83	1.43E+02	8.08E-05	7.60E-01	5.00E-02	5.00E-02	2.60E-02
Br-84	3.18E+01	3.63E-04	7.60E-01	5.00E-02	5.00E-02	2.60E-02
Br-85	2.87E+00	4.02E-03	7.60E-01	5.00E-02	5.00E-02	2.60E-02
Rb-86	2.69E+04	4.29E-07	1.30E-01	3.00E-02	3.00E-02	3.10E-02
Rb-88	1.78E+01	6.49E-04	1.30E-01	3.00E-02	3.00E-02	3.10E-02
Rb-89	1.54E+01	7.50E-04	1.30E-01	3.00E-02	3.00E-02	3.10E-02
Sr-89	7.28E+04	1.59E-07	1.70E-02	1.40E-03	1.40E-02	6.00E-04
Sr-90	1.50E+07	7.70E-10	1.70E-02	1.40E-03	1.40E-02	6.00E-04
Sr-91	5.70E+02	2.03E-05	1.70E-02	1.40E-03	1.40E-02	6.00E-04
Sr-92	1.63E+02	7.09E-05	1.70E-02	1.40E-03	1.40E-02	6.00E-04
Y-90	3.85E+03	3.00E-06	2.60E-03	1.00E-05	1.00E-05	4.60E-03
Y-91m	4.97E+01	2.32E-04	2.60E-03	1.00E-05	1.00E-05	4.60E-03
Y-91	8.43E+04	1.37E-07	2.60E-03	1.00E-05	1.00E-05	4.60E-03
Y-92	2.12E+02	5.45E-05	2.60E-03	1.00E-05	1.00E-05	4.60E-03
Y-93	6.06E+02	1.91E-05	2.60E-03	1.00E-05	1.00E-05	4.60E-03
Zr-95	9.22E+04	1.25E-07	1.70E-04	5.00E-06	5.00E-06	3.40E-02
Zr-97	1.01E+03	1.14E-05	1.70E-04	5.00E-06	5.00E-06	3.40E-02
Nb-95	5.05E+04	2.29E-07	9.40E-03	2.50E-03	2.50E-03	2.80E-01
Nb-97	7.21E+01	1.60E-04	9.40E-03	2.50E-03	2.50E-03	2.80E-01
Mo-99	3.96E+03	2.92E-06	1.20E-01	7.50E-03	7.50E-03	1.10E-03
Tc-99m	3.61E+02	3.20E-05	2.50E-01	2.50E-02	2.50E-02	4.00E-01
Tc-101	1.42E+01	8.13E-04	2.50E-01	2.50E-02	2.50E-02	4.00E-01
Ru-103	5.67E+04	2.04E-07	5.00E-02	1.00E-06	1.00E-06	4.00E-01

Table 6.2 - RADIONUCLIDE DECAY AND STABLE ELEMENT TRANSFER DATA

(Page 2 of 3)

Nuclide	Half-Life (minutes)	$\lambda$ (s <sup>-1</sup> )	B <sub>iv</sub>	F <sub>mi</sub> (cow)	F <sub>mi</sub> (goat)	F <sub>fi</sub> (beef)
Ru-105	2.66E+02	4.34E-05	5.00E-02	1.00E-06	1.00E-06	4.00E-01
Ru-106	5.30E+05	2.18E-08	5.00E-02	1.00E-06	1.00E-06	4.00E-01
Ag-110m	3.60E+05	3.21E-08	1.50E-01	5.00E-02	5.00E-02	1.70E-02
Sb-124	8.67E+04	1.33E-07	N/A	1.50E-03	1.50E-03	N/A
Sb-125	1.46E+06	7.91E-09	N/A	1.50E-03	1.50E-03	N/A
Te-125m	8.35E+04	1.38E-07	1.30E+00	1.00E-03	1.00E-03	7.70E-02
Te-127m	1.57E+05	7.36E-08	1.30E+00	1.00E-03	1.00E-03	7.70E-02
Te-127	5.61E+02	2.06E-05	1.30E+00	1.00E-03	1.00E-03	7.70E-02
Te-129m	4.84E+04	2.39E-07	1.30E+00	1.00E-03	1.00E-03	7.70E-02
Te-129	6.96E+01	1.66E-04	1.30E+00	1.00E-03	1.00E-03	7.70E-02
Te-131m	1.80E+03	6.42E-06	1.30E+00	1.00E-03	1.00E-03	7.70E-02
Te-131	2.50E+01	4.62E-04	1.30E+00	1.00E-03	1.00E-03	7.70E-02
Te-132	4.69E+03	2.46E-06	1.30E+00	1.00E-03	1.00E-03	7.70E-02
I-130	7.42E+02	1.56E-05	2.00E-02	1.20E-02	4.30E-01	2.90E-03
I-131	1.16E+04	9.96E-07	2.00E-02	1.20E-02	4.30E-01	2.90E-03
I-132	1.38E+02	8.37E-05	2.00E-02	1.20E-02	4.30E-01	2.90E-03
I-133	1.25E+03	9.24E-06	2.00E-02	1.20E-02	4.30E-01	2.90E-03
I-134	5.26E+01	2.20E-04	2.00E-02	1.20E-02	4.30E-01	2.90E-03
I-135	3.97E+02	2.91E-05	2.00E-02	1.20E-02	4.30E-01	2.90E-03
Cs-134	1.08E+06	1.06E-08	1.00E-02	8.00E-03	3.00E-01	1.50E-02
Cs-136	1.90E+04	6.08E-07	1.00E-02	8.00E-03	3.00E-01	1.50E-02
Cs-137	1.59E+07	7.26E-10	1.00E-02	8.00E-03	3.00E-01	1.50E-02
Cs-138	3.22E+01	3.59E-04	1.00E-02	8.00E-03	3.00E-01	1.50E-02
Ba-139	8.31E+01	1.39E-04	5.00E-03	4.00E-04	4.00E-04	3.20E-03
Ba-140	1.84E+04	6.28E-07	5.00E-03	4.00E-04	4.00E-04	3.20E-03
Ba-141	1.83E+01	6.31E-04	5.00E-03	4.00E-04	4.00E-04	3.20E-03
Ba-142	1.07E+01	1.08E-03	5.00E-03	4.00E-04	4.00E-04	3.20E-03
La-140	2.41E+03	4.79E-06	2.50E-03	5.00E-06	5.00E-06	2.00E-04
La-142	9.54E+01	1.21E-04	2.50E-03	5.00E-06	5.00E-06	2.00E-04
Ce-141	4.68E+04	2.47E-07	2.50E-03	1.00E-04	1.00E-04	1.20E-03
Ce-143	1.98E+03	5.83E-06	2.50E-03	1.00E-04	1.00E-04	1.20E-03
Ce-144	4.09E+05	2.82E-08	2.50E-03	1.00E-04	1.00E-04	1.20E-03
Pr-143	1.95E+04	5.92E-07	2.50E-03	5.00E-06	5.00E-06	4.70E-03
Pr-144	1.73E+01	6.68E-04	2.50E-03	5.00E-06	5.00E-06	4.70E-03
Nd-147	1.58E+04	7.31E-07	2.40E-03	5.00E-06	5.00E-06	3.30E-03
W-187	1.43E+03	8.08E-06	1.80E-02	5.00E-04	5.00E-04	1.30E-03
Np-239	3.39E+03	3.41E-06	2.50E-03	5.00E-06	5.00E-06	2.00E-04
Ar-41	1.10E+02	1.05E-04	N/A	N/A	N/A	N/A
Kr-83m	1.10E+02	1.05E-04	N/A	N/A	N/A	N/A
Kr-85m	2.69E+02	4.29E-05	N/A	N/A	N/A	N/A
Kr-85	5.64E+06	2.05E-09	N/A	N/A	N/A	N/A
Kr-87	7.63E+01	1.51E-04	N/A	N/A	N/A	N/A

**Table 6.2 - RADIONUCLIDE DECAY AND STABLE ELEMENT TRANSFER DATA**  
(Page 3 of 3)

Nuclide	Half-Life (minutes)	$\lambda$ (s <sup>-1</sup> )	B <sub>iv</sub>	F <sub>mi</sub> (cow)	F <sub>mi</sub> (goat)	F <sub>fi</sub> (beef)
Kr-88	1.70E+02	6.79E-05	N/A	N/A	N/A	N/A
Kr-89	3.16E+00	3.66E-03	N/A	N/A	N/A	N/A
Kr-90	5.39E-01	2.14E-02	N/A	N/A	N/A	N/A
Xe-131m	1.70E+04	6.79E-07	N/A	N/A	N/A	N/A
Xe-133m	3.15E+03	3.67E-06	N/A	N/A	N/A	N/A
Xe-133	7.55E+03	1.53E-06	N/A	N/A	N/A	N/A
Xe-135m	1.54E+01	7.50E-04	N/A	N/A	N/A	N/A
Xe-135	5.47E+02	2.11E-05	N/A	N/A	N/A	N/A
Xe-137	3.83E+00	3.02E-03	N/A	N/A	N/A	N/A
Xe-138	1.41E+01	8.19E-04	N/A	N/A	N/A	N/A

References:

All nuclides half-lives from: Reference 15.

Transfer factors for Sb- isotopes: Reference 16 Table 2-7.

Cow-milk transfer factors for I, Sr, and Cs nuclides are from Reference 21, Table 3.17.

Goat-milk transfer factors for I nuclides are from Reference 21, Table 3.17.

Beef transfer factors for Fe, Cu, Mo, and Cs nuclides are from Reference 21, Table 3.18.

All other nuclides transfer factors are from Reference 4, Tables E-1 and E-2.

Table 6.3 - DOSE CALCULATION FACTORS

(Page 1 of 2)

Factor	Value	Units	Reference
BR <sub>a</sub> (infant)	1400	m <sup>3</sup> /y	Reference 20
BR <sub>a</sub> (child)	5500	m <sup>3</sup> /y	Reference 20
BR <sub>a</sub> (teen)	8000	m <sup>3</sup> /y	Reference 20
BR <sub>a</sub> (adult)	8100	m <sup>3</sup> /y	Reference 20
f <sub>g</sub>	1		Conservatively assumes all stored vegetables are grown locally.
f <sub>L</sub>	1		Reference 4 (Table E-15)
f <sub>p</sub>	1		See Note
f <sub>s</sub>	0		See Note
H	9	g/m <sup>3</sup>	TVA Value
K <sub>C</sub>	0.072	L/kg-h	Reference 4 (Section 2.C.)
M	40	kg/m <sup>2</sup>	Reference 4 (Section 2.C.)
P	240	kg/m <sup>2</sup>	Reference 4 (Table E-15)
Q <sub>f</sub> (cow)	64	kg/day	Reference 21 (Sect. 3.4)
Q <sub>f</sub> (goat)	08	kg/day	Reference 21 (Sect. 3.4)
r	0.47		Reference 21 (Sect. 3.2)
t <sub>b</sub>	4.73E+08 (15 y)	s	Reference 4 (Table E-15)
t <sub>cb</sub>	7.78E+06 (90 d)	s	Reference 10, Section 11.3.10.1
t <sub>csf</sub>	1.56E+07 (180 d)	s	Reference 10, Section 11.3.10.1
t <sub>e</sub>	5.18E+06 (60 d)	s	Reference 4 (Table E-15)
t <sub>ep</sub>	2.59E+06 (30 d)	s	Reference 4 (Table E-15)
t <sub>esf</sub>	7.78E+06 (90 d)	s	Reference 4 (Table E-15)
t <sub>fm</sub>	8.64E+04 (1 d)	s	Reference 10, Section 11.3.10.1
t <sub>hc</sub>	8.64E+04 (1 d)	s	Reference 21, Table 3.40
t <sub>s</sub>	1.12E+06(13 d)	s	Reference 21, Table 3.40
t <sub>sv</sub>	2.38E+07(275 d)	s	Reference 10, Section 11.3.10.1
U <sub>am</sub> (infant)	0	kg/y	Reference 4 (Table E-5)
U <sub>am</sub> (child)	41	kg/y	Reference 4 (Table E-5)
U <sub>am</sub> (teen)	65	kg/y	Reference 4 (Table E-5)
U <sub>am</sub> (adult)	110	kg/y	Reference 4 (Table E-5)

Note: Calculations for release permits use the conservative value given in the table for these parameters. The calculations performed for reporting purposes (as described in Section 7.7) use actual grazing percentages identified in the land use census.

Table 6.3 - DOSE CALCULATION FACTORS  
(Page 2 of 2)

Factor	Value	Units	Reference
$U_{ap}$ (infant)	330	L/y	Reference 4 (Table E-5)
$U_{ap}$ (child)	330	L/y	Reference 4 (Table E-5)
$U_{ap}$ (teen)	400	L/y	Reference 4 (Table E-5)
$U_{ap}$ (adult)	310	L/y	Reference 4 (Table E-5)
$U_{fa}$ (infant)	0	kg/y	Reference 4 (Table E-5)
$U_{fa}$ (child)	6.9	kg/y	Reference 4 (Table E-5)
$U_{fa}$ (teen)	16	kg/y	Reference 4 (Table E-5)
$U_{fa}$ (adult)	21	kg/y	Reference 4 (Table E-5)
$U_{FLa}$ (infant)	0	kg/y	Reference 4 (Table E-5)
$U_{FLa}$ (child)	26	kg/y	Reference 4 (Table E-5)
$U_{FLa}$ (teen)	42	kg/y	Reference 4 (Table E-5)
$U_{FLa}$ (adult)	64	kg/y	Reference 4 (Table E-5)
$U_{Sa}$ (infant)	0	kg/y	Reference 4 (Table E-5)
$U_{Sa}$ (child)	520	kg/y	Reference 4 (Table E-5)
$U_{Sa}$ (teen)	630	kg/y	Reference 4 (Table E-5)
$U_{Sa}$ (adult)	520	kg/y	Reference 4 (Table E-5)
$U_{Wa}$ (infant)	330	L/y	Reference 4 (Table E-5)
$U_{Wa}$ (child)	510	L/y	Reference 4 (Table E-5)
$U_{Wa}$ (teen)	510	L/y	Reference 4 (Table E-5)
$U_{Wa}$ (adult)	730	L/y	Reference 4 (Table E-5)
SWF	0.2	none	Reference 4 (Table A-2)
$Y_f$	1.85	kg/m <sup>2</sup>	Reference 21 (Table 3.4)
$Y_p$	1.18	kg/m <sup>2</sup>	Reference 21 (Table 3.3)
$Y_{sf}$	0.64	kg/m <sup>2</sup>	Reference 21 (Table 3.3)
$Y_{sv}$	0.57	kg/m <sup>2</sup>	Reference 21 (Table 3.4) (value selected is for non-leafy vegetables)
$\lambda_W$ (iodines)	7.71E-07 (15.4 d half-life)	s <sup>-1</sup>	Reference 21 (Table 3.10)
$\lambda_W$ (particulates)	5.21E-07 (10.4 d half-life)	s <sup>-1</sup>	Reference 21 (Table 3.10)

**Table 6.4 - INGESTION DOSE FACTORS -  $DF_{aij}$**   
(mrem/pCi ingested) (Page 1 of 8)  
ADULT

Nuclide	bone	liver	total body	thyroid	kidney	lung	GI-LLI
H-3	1.05E-07	1.05E-07	1.05E-07	1.05E-07	1.05E-07	1.05E-07	1.05E-07
C-14	2.84E-06	5.68E-07	5.68E-07	5.68E-07	5.68E-07	5.68E-07	5.68E-07
Na-24	1.70E-06	1.70E-06	1.70E-06	1.70E-06	1.70E-06	1.70E-06	1.70E-06
P-32	1.93E-04	1.20E-05	7.46E-06	0.00E+00	0.00E+00	0.00E+00	2.17E-05
Cr-51	0.00E+00	0.00E+00	2.66E-09	1.59E-09	5.86E-10	3.53E-09	6.69E-07
Mn-54	0.00E+00	4.57E-06	8.72E-07	0.00E+00	1.36E-06	0.00E+00	1.40E-05
Mn-56	0.00E+00	1.15E-07	2.04E-08	0.00E+00	1.46E-07	0.00E+00	3.67E-06
Fe-55	2.75E-06	1.90E-06	4.43E-07	0.00E+00	0.00E+00	1.06E-06	1.09E-06
Fe-59	4.34E-06	1.02E-05	3.91E-06	0.00E+00	0.00E+00	2.85E-06	3.40E-05
Co-57	0.00E+00	1.75E-07	2.91E-07	0.00E+00	0.00E+00	0.00E+00	4.44E-06
Co-58	0.00E+00	7.45E-07	1.67E-06	0.00E+00	0.00E+00	0.00E+00	1.51E-05
Co-60	0.00E+00	2.14E-06	4.72E-06	0.00E+00	0.00E+00	0.00E+00	4.02E-05
Ni-63	1.30E-04	9.01E-06	4.36E-06	0.00E+00	0.00E+00	0.00E+00	1.88E-06
Ni-65	5.28E-07	6.86E-08	3.13E-08	0.00E+00	0.00E+00	0.00E+00	1.74E-06
Cu-64	0.00E+00	8.33E-08	3.91E-08	0.00E+00	2.10E-07	0.00E+00	7.10E-06
Zn-65	4.84E-06	1.54E-05	6.96E-06	0.00E+00	1.03E-05	0.00E+00	9.70E-06
Zn-69	1.03E-08	1.97E-08	1.37E-09	0.00E+00	1.28E-08	0.00E+00	2.96E-09
Zn-69m	1.70E-07	4.08E-07	3.73E-08	0.00E+00	2.47E-07	0.00E+00	2.49E-05
Br-82	0.00E+00	0.00E+00	2.26E-06	0.00E+00	0.00E+00	0.00E+00	2.59E-06
Br-83	0.00E+00	0.00E+00	4.02E-08	0.00E+00	0.00E+00	0.00E+00	5.79E-08
Br-84	0.00E+00	0.00E+00	5.21E-08	0.00E+00	0.00E+00	0.00E+00	4.09E-13
Br-85	0.00E+00	0.00E+00	2.14E-09	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Rb-86	0.00E+00	2.11E-05	9.83E-06	0.00E+00	0.00E+00	0.00E+00	4.16E-06
Rb-88	0.00E+00	6.05E-08	3.21E-08	0.00E+00	0.00E+00	0.00E+00	8.36E-19
Rb-89	0.00E+00	4.01E-08	2.82E-08	0.00E+00	0.00E+00	0.00E+00	2.33E-21
Sr-89	3.08E-04	0.00E+00	8.84E-06	0.00E+00	0.00E+00	0.00E+00	4.94E-05
Sr-90	7.58E-03	0.00E+00	1.86E-03	0.00E+00	0.00E+00	0.00E+00	2.19E-04
Sr-91	5.67E-06	0.00E+00	2.29E-07	0.00E+00	0.00E+00	0.00E+00	2.70E-05
Sr-92	2.15E-06	0.00E+00	9.30E-08	0.00E+00	0.00E+00	0.00E+00	4.26E-05
Y-90	9.62E-09	0.00E+00	2.58E-10	0.00E+00	0.00E+00	0.00E+00	1.02E-04
Y-91m	9.09E-11	0.00E+00	3.52E-12	0.00E+00	0.00E+00	0.00E+00	2.67E-10
Y-91	1.41E-07	0.00E+00	3.77E-09	0.00E+00	0.00E+00	0.00E+00	7.76E-05
Y-92	8.45E-10	0.00E+00	2.47E-11	0.00E+00	0.00E+00	0.00E+00	1.48E-05
Y-93	2.68E-09	0.00E+00	7.40E-11	0.00E+00	0.00E+00	0.00E+00	8.50E-05
Zr-95	3.04E-08	9.75E-09	6.60E-09	0.00E+00	1.53E-08	0.00E+00	3.09E-05
Zr-97	1.68E-09	3.39E-10	1.55E-10	0.00E+00	5.12E-10	0.00E+00	1.05E-04
Nb-95	6.22E-09	3.46E-09	1.86E-09	0.00E+00	3.42E-09	0.00E+00	2.10E-05
Nb-97	5.22E-11	1.32E-11	4.82E-12	0.00E+00	1.54E-11	0.00E+00	4.87E-08
Mo-99	0.00E+00	4.31E-06	8.20E-07	0.00E+00	9.76E-06	0.00E+00	9.99E-06
Tc-99m	2.47E-10	6.98E-10	8.89E-09	0.00E+00	1.06E-08	3.42E-10	4.13E-07
Tc-101	2.54E-10	3.66E-10	3.59E-09	0.00E+00	6.59E-09	1.87E-10	1.10E-21
Ru-103	1.85E-07	0.00E+00	7.97E-08	0.00E+00	7.06E-07	0.00E+00	2.16E-05
Ru-105	1.54E-08	0.00E+00	6.08E-09	0.00E+00	1.99E-07	0.00E+00	9.42E-06
Ru-106	2.75E-06	0.00E+00	3.48E-07	0.00E+00	5.31E-06	0.00E+00	1.78E-04

**Table 6.4 - INGESTION DOSE FACTORS -  $DF_{aij}$**   
(mrem/pCi ingested) (Page 2 of 8)  
ADULT

Nuclide	bone	liver	total body	thyroid	kidney	lung	GI-LLI
Ag-110m	1.60E-07	1.48E-07	8.79E-08	0.00E+00	2.91E-07	0.00E+00	6.04E-05
Sb-124	2.80E-06	5.29E-08	1.11E-06	6.79E-09	0.00E-00	2.18E-06	7.95E-05
Sb-125	1.79E-06	2.00E-08	4.26E-07	1.82E-09	0.00E-00	1.38E-06	1.97E-05
Te-125m	2.68E-06	9.71E-07	3.59E-07	8.06E-07	1.09E-05	0.00E+00	1.07E-05
Te-127m	6.77E-06	2.42E-06	8.25E-07	1.73E-06	2.75E-05	0.00E+00	2.27E-05
Te-127	1.10E-07	3.95E-08	2.38E-08	8.15E-08	4.48E-07	0.00E+00	8.68E-06
Te-129m	1.15E-05	4.29E-06	1.82E-06	3.95E-06	4.80E-05	0.00E+00	5.79E-05
Te-129	3.14E-08	1.18E-08	7.65E-09	2.41E-08	1.32E-07	0.00E+00	2.37E-08
Te-131m	1.73E-06	8.46E-07	7.05E-07	1.34E-06	8.57E-06	0.00E+00	8.40E-05
Te-131	1.97E-08	8.23E-09	6.22E-09	1.62E-08	8.63E-08	0.00E+00	2.79E-09
Te-132	2.52E-06	1.63E-06	1.53E-06	1.80E-06	1.57E-05	0.00E+00	7.71E-05
I-130	7.56E-07	2.23E-06	8.80E-07	1.89E-04	3.48E-06	0.00E+00	1.92E-06
I-131	4.16E-06	5.95E-06	3.41E-06	1.95E-03	1.02E-05	0.00E+00	1.57E-06
I-132	2.03E-07	5.43E-07	1.90E-07	1.90E-05	8.65E-07	0.00E+00	1.02E-07
I-133	1.42E-06	2.47E-06	7.53E-07	3.63E-04	4.31E-06	0.00E+00	2.22E-06
I-134	1.06E-07	2.88E-07	1.03E-07	4.99E-06	4.58E-07	0.00E+00	2.51E-10
I-135	4.43E-07	1.16E-06	4.28E-07	7.65E-05	1.86E-06	0.00E+00	1.31E-06
Cs-134	6.22E-05	1.48E-04	1.21E-04	0.00E+00	4.79E-05	1.59E-05	2.59E-06
Cs-136	6.51E-06	2.57E-05	1.85E-05	0.00E+00	1.43E-05	1.96E-06	2.92E-06
Cs-137	7.97E-05	1.09E-04	7.14E-05	0.00E+00	3.70E-05	1.23E-05	2.11E-06
Cs-138	5.52E-08	1.09E-07	5.40E-08	0.00E+00	8.01E-08	7.91E-09	4.65E-13
Ba-139	9.70E-08	6.91E-11	2.84E-09	0.00E+00	6.46E-11	3.92E-11	1.72E-07
Ba-140	2.03E-05	2.55E-08	1.33E-06	0.00E+00	8.67E-09	1.46E-08	4.18E-05
Ba-141	4.71E-08	3.56E-11	1.59E-09	0.00E+00	3.31E-11	2.02E-11	2.22E-17
Ba-142	2.13E-08	2.19E-11	1.34E-09	0.00E+00	1.85E-11	1.24E-11	3.00E-26
La-140	2.50E-09	1.26E-09	3.33E-10	0.00E+00	0.00E+00	0.00E+00	9.25E-05
La-142	1.28E-10	5.82E-11	1.45E-11	0.00E+00	0.00E+00	0.00E+00	4.25E-07
Ce-141	9.36E-09	6.33E-09	7.18E-10	0.00E+00	2.94E-09	0.00E+00	2.42E-05
Ce-143	1.65E-09	1.22E-06	1.35E-10	0.00E+00	5.37E-10	0.00E+00	4.56E-05
Ce-144	4.88E-07	2.04E-07	2.62E-08	0.00E+00	1.21E-07	0.00E+00	1.65E-04
Pr-143	9.20E-09	3.69E-09	4.56E-10	0.00E+00	2.13E-09	0.00E+00	4.03E-05
Pr-144	3.01E-11	1.25E-11	1.53E-12	0.00E+00	7.05E-12	0.00E+00	4.33E-18
Nd-147	6.29E-09	7.27E-09	4.35E-10	0.00E+00	4.25E-09	0.00E+00	3.49E-05
W-187	1.03E-07	8.61E-08	3.01E-08	0.00E+00	0.00E+00	0.00E+00	2.82E-05
Np-239	1.19E-09	1.17E-10	6.45E-11	0.00E+00	3.65E-10	0.00E+00	2.40E-05

## References:

Dose Factors for Co-57, Zn-69m, Br-82, Nb-97, Sb-124, Sb-125 are from Reference 17, Table 4. All others are from Reference 4, Table E-11.

NOTE: The tritium dose factor for bone is assumed to be equal to the total body dose factor. This assumes that tritium will act similarly in all organs (Reference 24).

**Table 6.4 - INGESTION DOSE FACTORS -  $DF_{aij}$**   
(mrem/pCi ingested) (Page 3 of 8)  
TEEN

Nuclide	bone	liver	total body	thyroid	kidney	lung	GI-LLI
H-3	1.06E-07	1.06E-07	1.06E-07	1.06E-07	1.06E-07	1.06E-07	1.06E-07
C-14	4.06E-06	8.12E-07	8.12E-07	8.12E-07	8.12E-07	8.12E-07	8.12E-07
Na-24	2.30E-06	2.30E-06	2.30E-06	2.30E-06	2.30E-06	2.30E-06	2.30E-06
P-32	2.76E-04	1.71E-05	1.07E-05	0.00E+00	0.00E+00	0.00E+00	2.32E-05
Cr-51	0.00E+00	0.00E+00	3.60E-09	2.00E-09	7.89E-10	5.14E-09	6.05E-07
Mn-54	0.00E+00	5.90E-06	1.17E-06	0.00E+00	1.76E-06	0.00E+00	1.21E-05
Mn-56	0.00E+00	1.58E-07	2.81E-08	0.00E+00	2.00E-07	0.00E+00	1.04E-05
Fe-55	3.78E-06	2.68E-06	6.25E-07	0.00E+00	0.00E+00	1.70E-06	1.16E-06
Fe-59	5.87E-06	1.37E-05	5.29E-06	0.00E+00	0.00E+00	4.32E-06	3.24E-05
Co-57	0.00E+00	2.38E-07	3.99E-07	0.00E+00	0.00E+00	0.00E+00	4.44E-06
Co-58	0.00E+00	9.72E-07	2.24E-06	0.00E+00	0.00E+00	0.00E+00	1.34E-05
Co-60	0.00E+00	2.81E-06	6.33E-06	0.00E+00	0.00E+00	0.00E+00	3.66E-05
Ni-63	1.77E-04	1.25E-05	6.00E-06	0.00E+00	0.00E+00	0.00E+00	1.99E-06
Ni-65	7.49E-07	9.57E-08	4.36E-08	0.00E+00	0.00E+00	0.00E+00	5.19E-06
Cu-64	0.00E+00	1.15E-07	5.41E-08	0.00E+00	2.91E-07	0.00E+00	8.92E-06
Zn-65	5.76E-06	2.00E-05	9.33E-06	0.00E+00	1.28E-05	0.00E+00	8.47E-06
Zn-69	1.47E-08	2.80E-08	1.96E-09	0.00E+00	1.83E-08	0.00E+00	5.16E-08
Zn-69m	2.40E-07	5.66E-07	5.19E-08	0.00E+00	3.44E-07	0.00E+00	3.11E-05
Br-82	0.00E+00	0.00E+00	3.04E-06	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Br-83	0.00E+00	0.00E+00	5.74E-08	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Br-84	0.00E+00	0.00E+00	7.22E-08	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Br-85	0.00E+00	0.00E+00	3.05E-09	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Rb-86	0.00E+00	2.98E-05	1.40E-05	0.00E+00	0.00E+00	0.00E+00	4.41E-06
Rb-88	0.00E+00	8.52E-08	4.54E-08	0.00E+00	0.00E+00	0.00E+00	7.30E-15
Rb-89	0.00E+00	5.50E-08	3.89E-08	0.00E+00	0.00E+00	0.00E+00	8.43E-17
Sr-89	4.40E-04	0.00E+00	1.26E-05	0.00E+00	0.00E+00	0.00E+00	5.24E-05
Sr-90	8.30E-03	0.00E+00	2.05E-03	0.00E+00	0.00E+00	0.00E+00	2.33E-04
Sr-91	8.07E-06	0.00E+00	3.21E-07	0.00E+00	0.00E+00	0.00E+00	3.66E-05
Sr-92	3.05E-06	0.00E+00	1.30E-07	0.00E+00	0.00E+00	0.00E+00	7.77E-05
Y-90	1.37E-08	0.00E+00	3.69E-10	0.00E+00	0.00E+00	0.00E+00	1.13E-04
Y-91m	1.29E-10	0.00E+00	4.93E-12	0.00E+00	0.00E+00	0.00E+00	6.09E-09
Y-91	2.01E-07	0.00E+00	5.39E-09	0.00E+00	0.00E+00	0.00E+00	8.24E-05
Y-92	1.21E-09	0.00E+00	3.50E-11	0.00E+00	0.00E+00	0.00E+00	3.32E-05
Y-93	3.83E-09	0.00E+00	1.05E-10	0.00E+00	0.00E+00	0.00E+00	1.17E-04
Zr-95	4.12E-08	1.30E-08	8.94E-09	0.00E+00	1.91E-08	0.00E+00	3.00E-05
Zr-97	2.37E-09	4.69E-10	2.16E-10	0.00E+00	7.11E-10	0.00E+00	1.27E-04
Nb-95	8.22E-09	4.56E-09	2.51E-09	0.00E+00	4.42E-09	0.00E+00	1.95E-05
Nb-97	7.37E-11	1.83E-11	6.68E-12	0.00E+00	2.14E-11	0.00E+00	4.37E-07
Mo-99	0.00E+00	6.03E-06	1.15E-06	0.00E+00	1.38E-05	0.00E+00	1.08E-05
Tc-99m	3.32E-10	9.26E-10	1.20E-08	0.00E+00	1.38E-08	5.14E-10	6.08E-07
Tc-101	3.60E-10	5.12E-10	5.03E-09	0.00E+00	9.26E-09	3.12E-10	8.75E-17
Ru-103	2.55E-07	0.00E+00	1.09E-07	0.00E+00	8.99E-07	0.00E+00	2.13E-05
Ru-105	2.18E-08	0.00E+00	8.46E-09	0.00E+00	2.75E-07	0.00E+00	1.76E-05
Ru-106	3.92E-06	0.00E+00	4.94E-07	0.00E+00	7.56E-06	0.00E+00	1.88E-04

**Table 6.4 - INGESTION DOSE FACTORS -  $DF_{aij}$**   
(mrem/pCi ingested) (Page 4 of 8)  
TEEN

Nuclide	bone	liver	total body	thyroid	kidney	lung	GI-LLI
Ag-110m	2.05E-07	1.94E-07	1.18E-07	0.00E+00	3.70E-07	0.00E+00	5.45E-05
Sb-124	3.87E-06	7.13E-08	1.51E-06	8.78E-09	0.00E-00	3.38E-06	7.80E-05
Sb-125	2.48E-06	2.71E-08	5.80E-07	2.37E-09	0.00E+00	2.18E-06	1.93E-05
Te-125m	3.83E-06	1.38E-06	5.12E-07	1.07E-06	0.00E+00	0.00E+00	1.13E-05
Te-127m	9.67E-06	3.43E-06	1.15E-06	2.30E-06	3.92E-05	0.00E+00	2.41E-05
Te-127	1.58E-07	5.60E-08	3.40E-08	1.09E-07	6.40E-07	0.00E+00	1.22E-05
Te-129m	1.63E-05	6.05E-06	2.58E-06	5.26E-06	6.82E-05	0.00E+00	6.12E-05
Te-129	4.48E-08	1.67E-08	1.09E-08	3.20E-08	1.88E-07	0.00E+00	2.45E-07
Te-131m	2.44E-06	1.17E-06	9.76E-07	1.76E-06	1.22E-05	0.00E+00	9.39E-05
Te-131	2.79E-08	1.15E-08	8.72E-09	2.15E-08	1.22E-07	0.00E+00	2.29E-09
Te-132	3.49E-06	2.21E-06	2.08E-06	2.33E-06	2.12E-05	0.00E+00	7.00E-05
I-130	1.03E-06	2.98E-06	1.19E-06	2.43E-04	4.59E-06	0.00E+00	2.29E-06
I-131	5.85E-06	8.19E-06	4.40E-06	2.39E-03	1.41E-05	0.00E+00	1.62E-06
I-132	2.79E-07	7.30E-07	2.62E-07	2.46E-05	1.15E-06	0.00E+00	3.18E-07
I-133	2.01E-06	3.41E-06	1.04E-06	4.76E-04	5.98E-06	0.00E+00	2.58E-06
I-134	1.46E-07	3.87E-07	1.39E-07	6.45E-06	6.10E-07	0.00E+00	5.10E-09
I-135	6.10E-07	1.57E-06	5.82E-07	1.01E-04	2.48E-06	0.00E+00	1.74E-06
Cs-134	8.37E-05	1.97E-04	9.14E-05	0.00E+00	6.26E-05	2.39E-05	2.45E-06
Cs-136	8.59E-06	3.38E-05	2.27E-05	0.00E+00	1.84E-05	2.90E-06	2.72E-06
Cs-137	1.12E-04	1.49E-04	5.19E-05	0.00E+00	5.07E-05	1.97E-05	2.12E-06
Cs-138	7.76E-08	1.49E-07	7.45E-08	0.00E+00	1.10E-07	1.28E-08	6.76E-11
Ba-139	1.39E-07	9.78E-11	4.05E-09	0.00E+00	9.22E-11	6.74E-11	1.24E-06
Ba-140	2.84E-05	3.48E-08	1.83E-06	0.00E+00	1.18E-08	2.34E-08	4.38E-05
Ba-141	6.71E-08	5.01E-11	2.24E-09	0.00E+00	4.65E-11	3.43E-11	1.43E-13
Ba-142	2.99E-08	2.99E-11	1.84E-09	0.00E+00	2.53E-11	1.99E-11	9.18E-20
La-140	3.48E-09	1.71E-09	4.55E-10	0.00E+00	0.00E+00	0.00E+00	9.82E-05
La-142	1.79E-10	7.95E-11	1.98E-11	0.00E+00	0.00E+00	0.00E+00	2.42E-06
Ce-141	1.33E-08	8.88E-09	1.02E-09	0.00E+00	4.18E-09	0.00E+00	2.54E-05
Ce-143	2.35E-09	1.71E-06	1.91E-10	0.00E+00	7.67E-10	0.00E+00	5.14E-05
Ce-144	6.96E-07	2.88E-07	3.74E-08	0.00E+00	1.72E-07	0.00E+00	1.75E-04
Pr-143	1.31E-08	5.23E-09	6.52E-10	0.00E+00	3.04E-09	0.00E+00	4.31E-05
Pr-144	4.30E-11	1.76E-11	2.18E-12	0.00E+00	1.01E-11	0.00E+00	4.74E-14
Nd-147	9.38E-09	1.02E-08	6.11E-10	0.00E+00	5.99E-09	0.00E+00	3.68E-05
W-187	1.46E-07	1.19E-07	4.17E-08	0.00E+00	0.00E+00	0.00E+00	3.22E-05
Np-239	1.76E-09	1.66E-10	9.22E-11	0.00E+00	5.21E-10	0.00E+00	2.67E-05

## References:

Dose Factors for Co-57, Zn-69m, Br-82, Nb-97, Sb-124, Sb-125 are from Reference 17, Table 3.  
All others are from Reference 4, Table E-12.

NOTE: The tritium dose factor for bone is assumed to be equal to the total body dose factor. This assumes that tritium will act similarly in all organs (Reference 24).

**Table 6.4 - INGESTION DOSE FACTORS -  $DF_{aij}$**   
(mrem/pCi ingested) (Page 5 of 8)  
CHILD

Nuclide	bone	liver	total body	thyroid	kidney	lung	GI-LLI
H-3	2.03E-07	2.03E-07	2.03E-07	2.03E-07	2.03E-07	2.03E-07	2.03E-07
C-14	1.21E-05	2.42E-06	2.42E-06	2.42E-06	2.42E-06	2.42E-06	2.42E-06
Na-24	5.80E-06	5.80E-06	5.80E-06	5.80E-06	5.80E-06	5.80E-06	5.80E-06
P-32	8.25E-04	3.86E-05	3.18E-05	0.00E+00	0.00E+00	0.00E+00	2.28E-05
Cr-51	0.00E+00	0.00E+00	8.90E-09	4.94E-09	1.35E-09	9.02E-09	4.72E-07
Mn-54	0.00E+00	1.07E-05	2.85E-06	0.00E+00	3.00E-06	0.00E+00	8.98E-06
Mn-56	0.00E+00	3.34E-07	7.54E-08	0.00E+00	4.04E-07	0.00E+00	4.84E-05
Fe-55	1.15E-05	6.10E-06	1.89E-06	0.00E+00	0.00E+00	3.45E-06	1.13E-06
Fe-59	1.65E-05	2.67E-05	1.33E-05	0.00E+00	0.00E+00	7.74E-06	2.78E-05
Co-57	0.00E+00	4.93E-07	9.98E-07	0.00E+00	0.00E+00	0.00E+00	4.04E-06
Co-58	0.00E+00	1.80E-06	5.51E-06	0.00E+00	0.00E+00	0.00E+00	1.05E-05
Co-60	0.00E+00	5.29E-06	1.56E-05	0.00E+00	0.00E+00	0.00E+00	2.93E-05
Ni-63	5.38E-04	2.88E-05	1.83E-05	0.00E+00	0.00E+00	0.00E+00	1.94E-06
Ni-65	2.22E-06	2.09E-07	1.22E-07	0.00E+00	0.00E+00	0.00E+00	2.56E-05
Cu-64	0.00E+00	2.45E-07	1.48E-07	0.00E+00	5.92E-07	0.00E+00	1.15E-05
Zn-65	1.37E-05	3.65E-05	2.27E-05	0.00E+00	2.30E-05	0.00E+00	6.41E-06
Zn-69	4.38E-08	6.33E-08	5.85E-09	0.00E+00	3.84E-08	0.00E+00	3.99E-06
Zn-69m	7.10E-07	1.21E-06	1.43E-07	0.00E+00	7.03E-07	0.00E+00	3.94E-05
Br-82	0.00E+00	0.00E+00	7.55E-06	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Br-83	0.00E+00	0.00E+00	1.71E-07	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Br-84	0.00E+00	0.00E+00	1.98E-07	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Br-85	0.00E+00	0.00E+00	9.12E-09	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Rb-86	0.00E+00	6.70E-05	4.12E-05	0.00E+00	0.00E+00	0.00E+00	4.31E-06
Rb-88	0.00E+00	1.90E-07	1.32E-07	0.00E+00	0.00E+00	0.00E+00	9.32E-09
Rb-89	0.00E+00	1.17E-07	1.04E-07	0.00E+00	0.00E+00	0.00E+00	1.02E-09
Sr-89	1.32E-03	0.00E+00	3.77E-05	0.00E+00	0.00E+00	0.00E+00	5.11E-05
Sr-90	1.70E-02	0.00E+00	4.31E-03	0.00E+00	0.00E+00	0.00E+00	2.29E-04
Sr-91	2.40E-05	0.00E+00	9.06E-07	0.00E+00	0.00E+00	0.00E+00	5.30E-05
Sr-92	9.03E-06	0.00E+00	3.62E-07	0.00E+00	0.00E+00	0.00E+00	1.71E-04
Y-90	4.11E-08	0.00E+00	1.10E-09	0.00E+00	0.00E+00	0.00E+00	1.17E-04
Y-91m	3.82E-10	0.00E+00	1.39E-11	0.00E+00	0.00E+00	0.00E+00	7.48E-07
Y-91	6.02E-07	0.00E+00	1.61E-08	0.00E+00	0.00E+00	0.00E+00	8.02E-05
Y-92	3.60E-09	0.00E+00	1.03E-10	0.00E+00	0.00E+00	0.00E+00	1.04E-04
Y-93	1.14E-08	0.00E+00	3.13E-10	0.00E+00	0.00E+00	0.00E+00	1.70E-04
Zr-95	1.16E-07	2.55E-08	2.27E-08	0.00E+00	3.65E-08	0.00E+00	2.66E-05
Zr-97	6.99E-09	1.01E-09	5.96E-10	0.00E+00	1.45E-09	0.00E+00	1.53E-04
Nb-95	2.25E-08	8.76E-09	6.26E-09	0.00E+00	8.23E-09	0.00E+00	1.62E-05
Nb-97	2.17E-10	3.92E-11	1.83E-11	0.00E+00	4.35E-11	0.00E+00	1.21E-05
Mo-99	0.00E+00	1.33E-05	3.29E-06	0.00E+00	2.84E-05	0.00E+00	1.10E-05
Tc-99m	9.23E-10	1.81E-09	3.00E-08	0.00E+00	2.63E-08	9.19E-10	1.03E-06
Tc-101	1.07E-09	1.12E-09	1.42E-08	0.00E+00	1.91E-08	5.92E-10	3.56E-09
Ru-103	7.31E-07	0.00E+00	2.81E-07	0.00E+00	1.84E-06	0.00E+00	1.89E-05
Ru-105	6.45E-08	0.00E+00	2.34E-08	0.00E+00	5.67E-07	0.00E+00	4.21E-05
Ru-106	1.17E-05	0.00E+00	1.46E-06	0.00E+00	1.58E-05	0.00E+00	1.82E-04

**Table 6.4 - INGESTION DOSE FACTORS -  $DF_{aij}$**   
(mrem/pCi ingested) (Page 6 of 8)  
CHILD

Nuclide	bone	liver	total body	thyroid	kidney	lung	GI-LLI
Ag-110m	5.39E-07	3.64E-07	2.91E-07	0.00E+00	6.78E-07	0.00E+00	4.33E-05
Sb-124	1.11E-05	1.44E-07	3.89E-06	2.45E-08	0.00E+00	6.16E-06	6.94E-05
Sb-125	7.16E-06	5.52E-08	1.50E-06	6.63E-09	0.00E+00	3.99E-06	1.71E-05
Te-125m	1.14E-05	3.09E-06	1.52E-06	3.20E-06	0.00E+00	0.00E+00	1.10E-05
Te-127m	2.89E-05	7.78E-06	3.43E-06	6.91E-06	8.24E-05	0.00E+00	2.34E-05
Te-127	4.71E-07	1.27E-07	1.01E-07	3.26E-07	1.34E-06	0.00E+00	1.84E-05
Te-129m	4.87E-05	1.36E-05	7.56E-06	1.57E-05	1.43E-04	0.00E+00	5.94E-05
Te-129	1.34E-07	3.74E-08	3.18E-08	9.56E-08	3.92E-07	0.00E+00	8.34E-06
Te-131m	7.20E-06	2.49E-06	2.65E-06	5.12E-06	2.41E-05	0.00E+00	1.01E-04
Te-131	8.30E-08	2.53E-08	2.47E-08	6.35E-08	2.51E-07	0.00E+00	4.36E-07
Te-132	1.01E-05	4.47E-06	5.40E-06	6.51E-06	4.15E-05	0.00E+00	4.50E-05
I-130	2.92E-06	5.90E-06	3.04E-06	6.50E-04	8.82E-06	0.00E+00	2.76E-06
I-131	1.72E-05	1.73E-05	9.83E-06	5.72E-03	2.84E-05	0.00E+00	1.54E-06
I-132	8.00E-07	1.47E-06	6.76E-07	6.82E-05	2.25E-06	0.00E+00	1.73E-06
I-133	5.92E-06	7.32E-06	2.77E-06	1.36E-03	1.22E-05	0.00E+00	2.95E-06
I-134	4.19E-07	7.78E-07	3.58E-07	1.79E-05	1.19E-06	0.00E+00	5.16E-07
I-135	1.75E-06	3.15E-06	1.49E-06	2.79E-04	4.83E-06	0.00E+00	2.40E-06
Cs-134	2.34E-04	3.84E-04	8.10E-05	0.00E+00	1.19E-04	4.27E-05	2.07E-06
Cs-136	2.35E-05	6.46E-05	4.18E-05	0.00E+00	3.44E-05	5.13E-06	2.27E-06
Cs-137	3.27E-04	3.13E-04	4.62E-05	0.00E+00	1.02E-04	3.67E-05	1.96E-06
Cs-138	2.28E-07	3.17E-07	2.01E-07	0.00E+00	2.23E-07	2.40E-08	1.46E-07
Ba-139	4.14E-07	2.21E-10	1.20E-08	0.00E+00	1.93E-10	1.30E-10	2.39E-05
Ba-140	8.31E-05	7.28E-08	4.85E-06	0.00E+00	2.37E-08	4.34E-08	4.21E-05
Ba-141	2.00E-07	1.12E-10	6.51E-09	0.00E+00	9.69E-11	6.58E-10	1.14E-07
Ba-142	8.74E-08	6.29E-11	4.88E-09	0.00E+00	5.09E-11	3.70E-11	1.14E-09
La-140	1.01E-08	3.53E-09	1.19E-09	0.00E+00	0.00E+00	0.00E+00	9.84E-05
La-142	5.24E-10	1.67E-10	5.23E-11	0.00E+00	0.00E+00	0.00E+00	3.31E-05
Ce-141	3.97E-08	1.98E-08	2.94E-09	0.00E+00	8.68E-09	0.00E+00	2.47E-05
Ce-143	6.99E-09	3.79E-06	5.49E-10	0.00E+00	1.59E-09	0.00E+00	5.55E-05
Ce-144	2.08E-06	6.52E-07	1.11E-07	0.00E+00	3.61E-07	0.00E+00	1.70E-04
Pr-143	3.93E-08	1.18E-08	1.95E-09	0.00E+00	6.39E-09	0.00E+00	4.24E-05
Pr-144	1.29E-10	3.99E-11	6.49E-12	0.00E+00	2.11E-11	0.00E+00	8.59E-08
Nd-147	2.79E-08	2.26E-08	1.75E-09	0.00E+00	1.24E-08	0.00E+00	3.58E-05
W-187	4.29E-07	2.54E-07	1.14E-07	0.00E+00	0.00E+00	0.00E+00	3.57E-05
Np-239	5.25E-09	3.77E-10	2.65E-10	0.00E+00	1.09E-09	0.00E+00	2.79E-05

## References:

Dose Factors for Co-57, Zn-69m, Br-82, Nb-97, Sb-124, Sb-125 are from Reference 17, Table 2.  
All others are from Reference 4, Table E-13.

NOTE: The tritium dose factor for bone is assumed to be equal to the total body dose factor. This assumes that tritium will act similarly in all organs (Reference 24).

**Table 6.4 - INGESTION DOSE FACTORS -  $DF_{aij}$**   
(mrem/pCi ingested) (Page 7 of 8)  
INFANT

Nuclide	bone	liver	total body	thyroid	kidney	lung	GI-LLI
H-3	3.08E-07	3.08E-07	3.08E-07	3.08E-07	3.08E-07	3.08E-07	3.08E-07
C-14	2.37E-05	5.06E-06	5.06E-06	5.06E-06	5.06E-06	5.06E-06	5.06E-06
Na-24	1.01E-05	1.01E-05	1.01E-05	1.01E-05	1.01E-05	1.01E-05	1.01E-05
P-32	1.70E-03	1.00E-04	6.59E-05	0.00E+00	0.00E+00	0.00E+00	2.30E-05
Cr-51	0.00E+00	0.00E+00	1.41E-08	9.20E-09	2.01E-09	1.79E-08	4.11E-07
Mn-54	0.00E+00	1.99E-05	4.51E-06	0.00E+00	4.41E-06	0.00E+00	7.31E-06
Mn-56	0.00E+00	8.18E-07	1.41E-07	0.00E+00	7.03E-07	0.00E+00	7.43E-05
Fe-55	1.39E-05	8.98E-06	2.40E-06	0.00E+00	0.00E+00	4.39E-06	1.14E-06
Fe-59	3.08E-05	5.38E-05	2.12E-05	0.00E+00	0.00E+00	1.59E-05	2.57E-05
Co-57	0.00E+00	1.15E-06	1.87E-06	0.00E+00	0.00E+00	0.00E+00	3.92E-06
Co-58	0.00E+00	3.60E-06	8.98E-06	0.00E+00	0.00E+00	0.00E+00	8.97E-06
Co-60	0.00E+00	1.08E-05	2.55E-05	0.00E+00	0.00E+00	0.00E+00	2.57E-05
Ni-63	6.34E-04	3.92E-05	2.20E-05	0.00E+00	0.00E+00	0.00E+00	1.95E-06
Ni-65	4.70E-06	5.32E-07	2.42E-07	0.00E+00	0.00E+00	0.00E+00	4.05E-05
Cu-64	0.00E+00	6.09E-07	2.82E-07	0.00E+00	1.03E-06	0.00E+00	1.25E-05
Zn-65	1.84E-05	6.31E-05	2.91E-05	0.00E+00	3.06E-05	0.00E+00	5.33E-05
Zn-69	9.33E-08	1.68E-07	1.25E-08	0.00E+00	6.98E-08	0.00E+00	1.37E-05
Zn-69m	1.50E-06	3.06E-06	2.79E-07	0.00E+00	1.24E-06	0.00E+00	4.24E-05
Br-82	0.00E+00	0.00E+00	1.27E-05	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Br-83	0.00E+00	0.00E+00	3.63E-07	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Br-84	0.00E+00	0.00E+00	3.82E-07	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Br-85	0.00E+00	0.00E+00	1.94E-08	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Rb-86	0.00E+00	1.70E-04	8.40E-05	0.00E+00	0.00E+00	0.00E+00	4.35E-06
Rb-88	0.00E+00	4.98E-07	2.73E-07	0.00E+00	0.00E+00	0.00E+00	4.85E-07
Rb-89	0.00E+00	2.86E-07	1.97E-07	0.00E+00	0.00E+00	0.00E+00	9.74E-08
Sr-89	2.51E-03	0.00E+00	7.20E-05	0.00E+00	0.00E+00	0.00E+00	5.16E-05
Sr-90	1.85E-02	0.00E+00	4.71E-03	0.00E+00	0.00E+00	0.00E+00	2.31E-04
Sr-91	5.00E-05	0.00E+00	1.81E-06	0.00E+00	0.00E+00	0.00E+00	5.92E-05
Sr-92	1.92E-05	0.00E+00	7.13E-07	0.00E+00	0.00E+00	0.00E+00	2.07E-04
Y-90	8.69E-08	0.00E+00	2.33E-09	0.00E+00	0.00E+00	0.00E+00	1.20E-04
Y-91m	8.10E-10	0.00E+00	2.76E-11	0.00E+00	0.00E+00	0.00E+00	2.70E-06
Y-91	1.13E-06	0.00E+00	3.01E-08	0.00E+00	0.00E+00	0.00E+00	8.10E-05
Y-92	7.65E-09	0.00E+00	2.15E-10	0.00E+00	0.00E+00	0.00E+00	1.46E-04
Y-93	2.43E-08	0.00E+00	6.62E-10	0.00E+00	0.00E+00	0.00E+00	1.92E-04
Zr-95	2.06E-07	5.02E-08	3.56E-08	0.00E+00	5.41E-08	0.00E+00	2.50E-05
Zr-97	1.48E-08	2.54E-09	1.16E-09	0.00E+00	2.56E-09	0.00E+00	1.62E-04
Nb-95	4.20E-08	1.73E-08	1.00E-08	0.00E+00	1.24E-08	0.00E+00	1.46E-05
Nb-97	4.59E-10	9.79E-11	3.53E-11	0.00E+00	7.65E-11	0.00E+00	3.09E-05
Mo-99	0.00E+00	3.40E-05	6.63E-06	0.00E+00	5.08E-05	0.00E+00	1.12E-05
Tc-99m	1.92E-09	3.96E-09	5.10E-08	0.00E+00	4.26E-08	2.07E-09	1.15E-06
Tc-101	2.27E-09	2.86E-09	2.83E-08	0.00E+00	3.40E-08	1.56E-09	4.86E-07
Ru-103	1.48E-06	0.00E+00	4.95E-07	0.00E+00	3.08E-06	0.00E+00	1.80E-05
Ru-105	1.36E-07	0.00E+00	4.58E-08	0.00E+00	1.00E-06	0.00E+00	5.41E-05
Ru-106	2.41E-05	0.00E+00	3.01E-06	0.00E+00	2.85E-05	0.00E+00	1.83E-04

**Table 6.4 - INGESTION DOSE FACTORS -  $DF_{aij}$**   
(mrem/pCi ingested) (Page 8 of 8)  
INFANT

Nuclide	bone	liver	total body	thyroid	kidney	lung	GI-LLI
Ag-110m	9.96E-07	7.27E-07	4.81E-07	0.00E+00	1.04E-06	0.00E+00	3.77E-05
Sb-124	2.14E-05	3.15E-07	6.63E-06	5.68E-08	0.00E+00	1.34E-05	6.60E-05
Sb-125	1.23E-05	1.19E-07	2.53E-06	1.54E-08	0.00E+00	7.72E-06	1.64E-05
Te-125m	2.33E-05	7.79E-06	3.15E-06	7.84E-06	0.00E+00	0.00E+00	1.11E-05
Te-127m	5.85E-05	1.94E-05	7.08E-06	1.69E-05	1.44E-04	0.00E+00	2.36E-05
Te-127	1.00E-06	3.35E-07	2.15E-07	8.14E-07	2.44E-06	0.00E+00	2.10E-05
Te-129m	1.00E-04	3.43E-05	1.54E-05	3.84E-05	2.50E-04	0.00E+00	5.97E-05
Te-129	2.84E-07	9.79E-08	6.63E-08	2.38E-07	7.07E-07	0.00E+00	2.27E-05
Te-131m	1.52E-05	6.12E-06	5.05E-06	1.24E-05	4.21E-05	0.00E+00	1.03E-04
Te-131	1.76E-07	6.50E-08	4.94E-08	1.57E-07	4.50E-07	0.00E+00	7.11E-06
Te-132	2.08E-05	1.03E-05	9.61E-06	1.52E-05	6.44E-05	0.00E+00	3.81E-05
I-130	6.00E-06	1.32E-05	5.30E-06	1.48E-03	1.45E-05	0.00E+00	2.83E-06
I-131	3.59E-05	4.23E-05	1.86E-05	1.39E-02	4.94E-05	0.00E+00	1.51E-06
I-132	1.66E-06	3.37E-06	1.20E-06	1.58E-04	3.76E-06	0.00E+00	2.73E-06
I-133	1.25E-05	1.82E-05	5.33E-06	3.31E-03	2.14E-05	0.00E+00	3.08E-06
I-134	8.69E-07	1.78E-06	6.33E-07	4.15E-05	1.99E-06	0.00E+00	1.84E-06
I-135	3.64E-06	7.24E-06	2.64E-06	6.49E-04	8.07E-06	0.00E+00	2.62E-06
Cs-134	3.77E-04	7.03E-04	7.10E-05	0.00E+00	1.81E-04	7.42E-05	1.91E-06
Cs-136	4.59E-05	1.35E-04	5.04E-05	0.00E+00	5.38E-05	1.10E-05	2.05E-06
Cs-137	5.22E-04	6.11E-04	4.33E-05	0.00E+00	1.64E-04	6.64E-05	1.91E-06
Cs-138	4.81E-07	7.82E-07	3.79E-07	0.00E+00	3.90E-07	6.09E-08	1.25E-06
Ba-139	8.81E-07	5.84E-10	2.55E-08	0.00E+00	3.51E-10	3.54E-10	5.58E-05
Ba-140	1.71E-04	1.71E-07	8.81E-06	0.00E+00	4.06E-08	1.05E-07	4.20E-05
Ba-141	4.25E-07	2.91E-10	1.34E-08	0.00E+00	1.75E-10	1.77E-10	5.19E-06
Ba-142	1.84E-07	1.53E-10	9.06E-09	0.00E+00	8.81E-11	9.26E-11	7.59E-07
La-140	2.11E-08	8.32E-09	2.14E-09	0.00E+00	0.00E+00	0.00E+00	9.77E-05
La-142	1.10E-09	4.04E-10	9.67E-11	0.00E+00	0.00E+00	0.00E+00	6.86E-05
Ce-141	7.87E-08	4.80E-08	5.65E-09	0.00E+00	1.48E-08	0.00E+00	2.48E-05
Ce-143	1.48E-08	9.82E-06	1.12E-09	0.00E+00	2.86E-09	0.00E+00	5.73E-05
Ce-144	2.98E-06	1.22E-06	1.67E-07	0.00E+00	4.93E-07	0.00E+00	1.71E-04
Pr-143	8.13E-08	3.04E-08	4.03E-09	0.00E+00	1.13E-08	0.00E+00	4.29E-05
Pr-144	2.74E-10	1.06E-10	1.38E-11	0.00E+00	3.84E-11	0.00E+00	4.93E-06
Nd-147	5.53E-08	5.68E-08	3.48E-09	0.00E+00	2.19E-08	0.00E+00	3.60E-05
W-187	9.03E-07	6.28E-07	2.17E-07	0.00E+00	0.00E+00	0.00E+00	3.69E-05
Np-239	1.11E-08	9.93E-10	5.61E-10	0.00E+00	1.98E-09	0.00E+00	2.87E-05

## References:

Dose Factors for Co-57, Zn-69m, Br-82, Nb-97, Sb-124, Sb-125 are from Reference 17, Table 1.  
All others are from Reference 4, Table E-14.

NOTE: The tritium dose factor for bone is assumed to be equal to the total body dose factor. This assumes that tritium will act similarly in all organs (Reference 24).

**Table 6.5 - BIOACCUMULATION FACTORS ( $B_i$ ) FOR FRESHWATER FISH**

<b>Nuclide</b>	<b><math>B_i</math></b>	<b>Nuclide</b>	<b><math>B_i</math></b>
H-3	9.0E-01	Tc-99m	1.5E+01
C-14	4.6E+03	Tc-101	1.5E+01
Na-24	1.0E+02	Ru-103	1.0E+01
P-32	1.0E+05	Ru-105	1.0E+01
Cr-51	2.0E+02	Ru-106	1.0E+01
Mn-54	4.0E+02	Ag-110m	2.3E+00
Mn-56	4.0E+02	Sb-124	1.0E+00
Fe-55	1.0E+02	Sb-125	1.0E+00
Fe-59	1.0E+02	Sn-125	3.0E+03
Co-57	5.0E+01	Te-125m	4.0E+02
Co-58	5.0E+01	Te-127m	4.0E+02
Co-60	5.0E+01	Te-127	4.0E+02
Ni-63	1.0E+02	Te-129m	4.0E+02
Ni-65	1.0E+02	Te-129	4.0E+02
Cu-64	5.0E+01	Te-131m	4.0E+02
Zn-65	2.0E+03	Te-131	4.0E+02
Zn-69	2.0E+03	Te-132	4.0E+02
Zn-69m	2.0E+03	I-130	4.0E+01
Br-82	4.2E+02	I-131	4.0E+01
Br-83	4.2E+02	I-132	4.0E+01
Br-84	4.2E+02	I-133	4.0E+01
Br-85	4.2E+02	I-134	4.0E+01
Rb-86	2.0E+03	I-135	4.0E+01
Rb-88	2.0E+03	Cs-134	1.9E+03
Rb-89	2.0E+03	Cs-136	1.9E+03
Sr-89	5.6E+01	Cs-137	1.9E+03
Sr-90	5.6E+01	Cs-138	1.9E+03
Sr-91	5.6E+01	Ba-139	4.0E+00
Sr-92	5.6E+01	Ba-140	4.0E+00
Y-90	2.5E+01	Ba-141	4.0E+00
Y-91m	2.5E+01	Ba-142	4.0E+00
Y-91	2.5E+01	La-140	2.5E+01
Y-92	2.5E+01	La-142	2.5E+01
Y-93	2.5E+01	Ce-141	1.0E+00
Zr-95	3.3E+00	Ce-143	1.0E+00
Zr-97	3.3E+00	Ce-144	1.0E+00
Nb-95	3.0E+04	Pr-143	2.5E+01
Nb-97	3.0E+04	Pr-144	2.5E+01
Mo-99	1.0E+01	Nd-147	2.5E+01
		W-187	1.2E+03
		Np-239	1.0E+01

**References:**

Bioaccumulation factors for Ag, Sb, and Sn - nuclides are from Reference 16.

Bioaccumulation factors for I-, Cs-, and Sr- nuclides are from Reference 21, Table 3.2.4.

All other nuclides' bioaccumulation factors are from Reference 4, Table A-1.

**Table 6.6 - EXTERNAL DOSE FACTORS FOR STANDING ON CONTAMINATED GROUND -  $DF_{ij}$**   
(mrem/h per pCi/m<sup>2</sup>) (Page 1 of 2)

<b>Nuclide</b>	<b>Total Body</b>	<b>Skin</b>
H-3	0.0	0.0
C-14	0.0	0.0
Na-24	2.50E-08	2.90E-08
P-32	0.0	0.0
Cr-51	2.20E-10	2.60E-10
Mn-54	5.80E-09	6.80E-09
Mn-56	1.10E-08	1.30E-08
Fe-55	0.0	0.0
Fe-59	8.00E-09	9.40E-09
Co-57	1.77E-09	2.21E-09
Co-58	7.00E-09	8.20E-09
Co-60	1.70E-08	2.00E-08
Ni-63	0.0	0.0
Ni-65	3.70E-09	4.30E-09
Cu-64	1.50E-09	1.70E-09
Zn-65	4.00E-09	4.60E-09
Zn-69	0.0	0.0
Zn-69m	5.50E-09	6.59E-09
Br-82	3.18E-08	3.90E-08
Br-83	6.40E-11	9.30E-11
Br-84	1.20E-08	1.40E-08
Br-85	0.0	0.0
Rb-86	6.30E-10	7.20E-10
Rb-88	3.50E-09	4.00E-09
Rb-89	1.50E-08	1.80E-08
Sr-89	5.60E-13	6.50E-13
Sr-91	7.10E-09	8.30E-09
Sr-92	9.00E-09	1.00E-08
Y-90	2.20E-12	2.60E-12
Y-91m	3.80E-09	4.40E-09
Y-91	2.40E-11	2.70E-11
Y-92	1.60E-09	1.90E-09
Y-93	5.70E-10	7.80E-10
Zr-95	5.00E-09	5.80E-09
Zr-97	5.50E-09	6.40E-09
Nb-95	5.10E-09	6.00E-09
Nb-97	8.11E-09	1.00E-08
Mo-99	1.90E-09	2.20E-09
Tc-99m	9.60E-10	1.10E-09
Tc-101	2.70E-09	3.00E-09
Ru-103	3.60E-09	4.20E-09
Ru-105	4.50E-09	5.10E-09

**Table 6.6 - EXTERNAL DOSE FACTORS FOR STANDING ON CONTAMINATED GROUND -  $DF_{ij}$**   
(mrem/h per pCi/m<sup>2</sup>) (Page 2 of 2)

Nuclide	Total Body	Skin
Ru-106	1.50E-09	1.80E-09
Ag-110m	1.80E-08	2.10E-08
Sb-124	2.17E-08	2.57E-08
Sb-125	5.48E-09	6.80E-09
Te-125m	3.50E-11	4.80E-11
Te-127m	1.10E-12	1.30E-12
Te-127	1.00E-11	1.10E-11
Te-129m	7.70E-10	9.00E-10
Te-129	7.10E-10	8.40E-10
Te-131m	8.40E-09	9.90E-09
Te-131	2.20E-09	2.60E-06
Te-132	1.70E-09	2.00E-09
I-130	1.40E-08	1.70E-08
I-131	2.80E-09	3.40E-09
I-132	1.70E-08	2.00E-08
I-133	3.70E-09	4.50E-09
I-134	1.60E-08	1.90E-08
I-135	1.20E-08	1.40E-08
Cs-134	1.20E-08	1.40E-08
Cs-136	1.50E-08	1.70E-08
Cs-137	4.20E-09	4.90E-09
Cs-138	2.10E-08	2.40E-08
Ba-139	2.40E-09	2.70E-09
Ba-140	2.10E-09	2.40E-09
Ba-141	4.30E-09	4.90E-09
Ba-142	7.90E-09	9.00E-09
La-140	1.50E-08	1.70E-08
La-142	1.50E-08	1.80E-08
Ce-141	5.50E-10	6.20E-10
Ce-143	2.20E-09	2.50E-09
Ce-144	3.20E-10	3.70E-10
Pr-143	0.0	0.0
Pr-144	2.00E-10	2.30E-10
Nd-147	1.00E-09	1.20E-09
W-187	3.10E-09	3.60E-09
Np-239	9.50E-10	1.10E-09

References:

Dose Factors for Co-57, Zn-69m, Br-82, Nb-97, Sb-124 and Sb-125 are from Reference 18.  
All others are from Reference 4, Table E-6.

Figure 6.1 - LIQUID EFFLUENT RELEASE POINTS

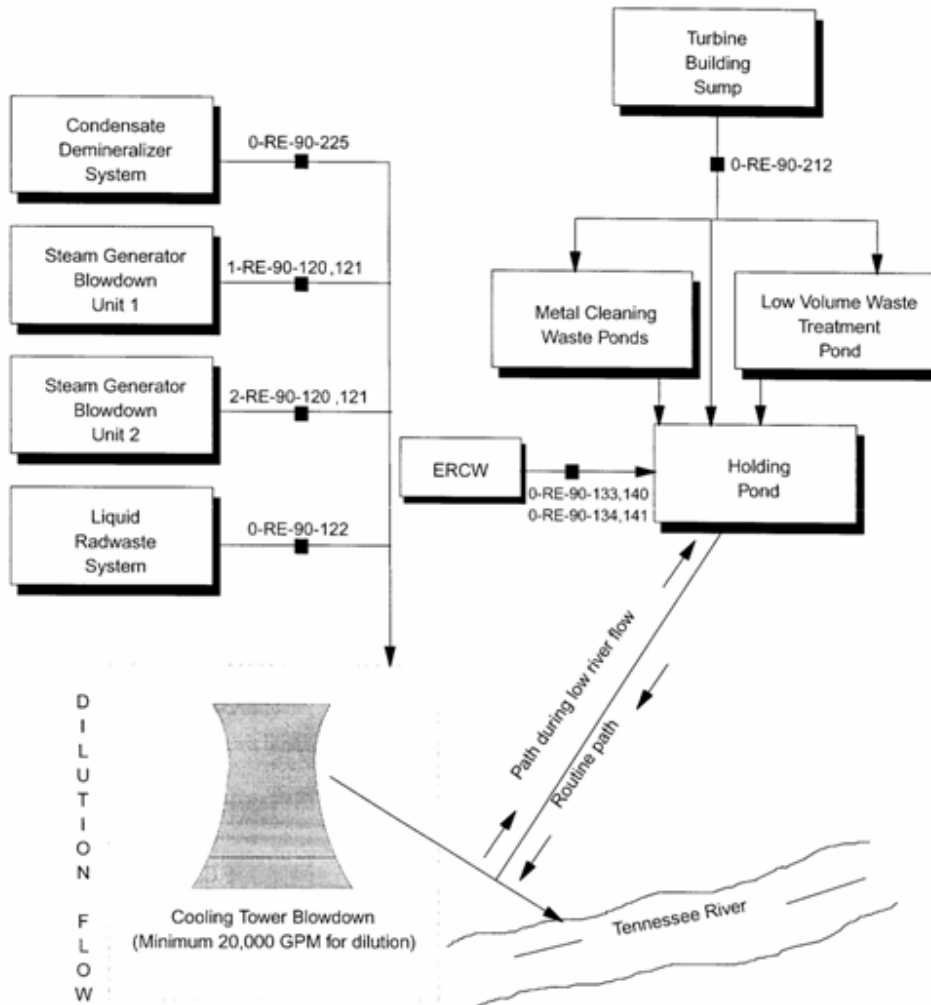


Figure 6.2 - LIQUID RADWASTE SYSTEM


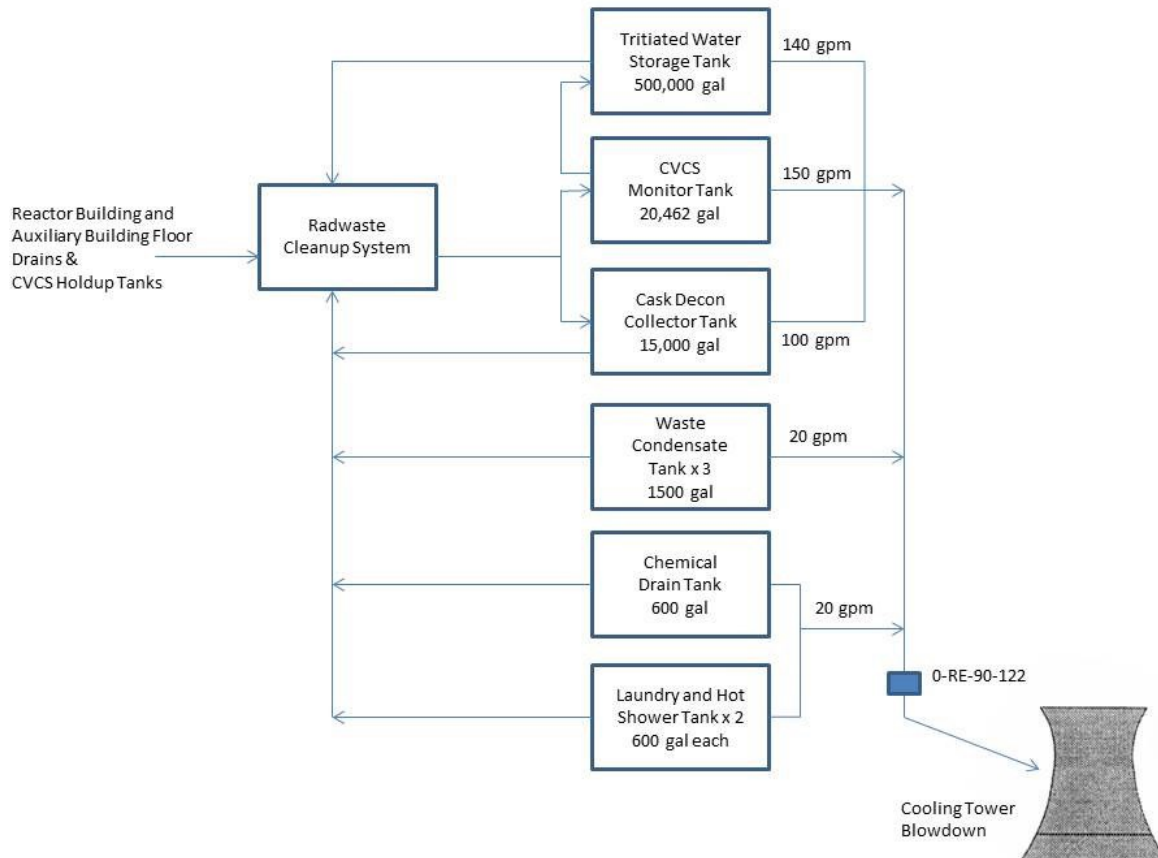


Figure 6.3 - STEAM GENERATOR BLOWDOWN/CONDENSATE DEMINERALIZER

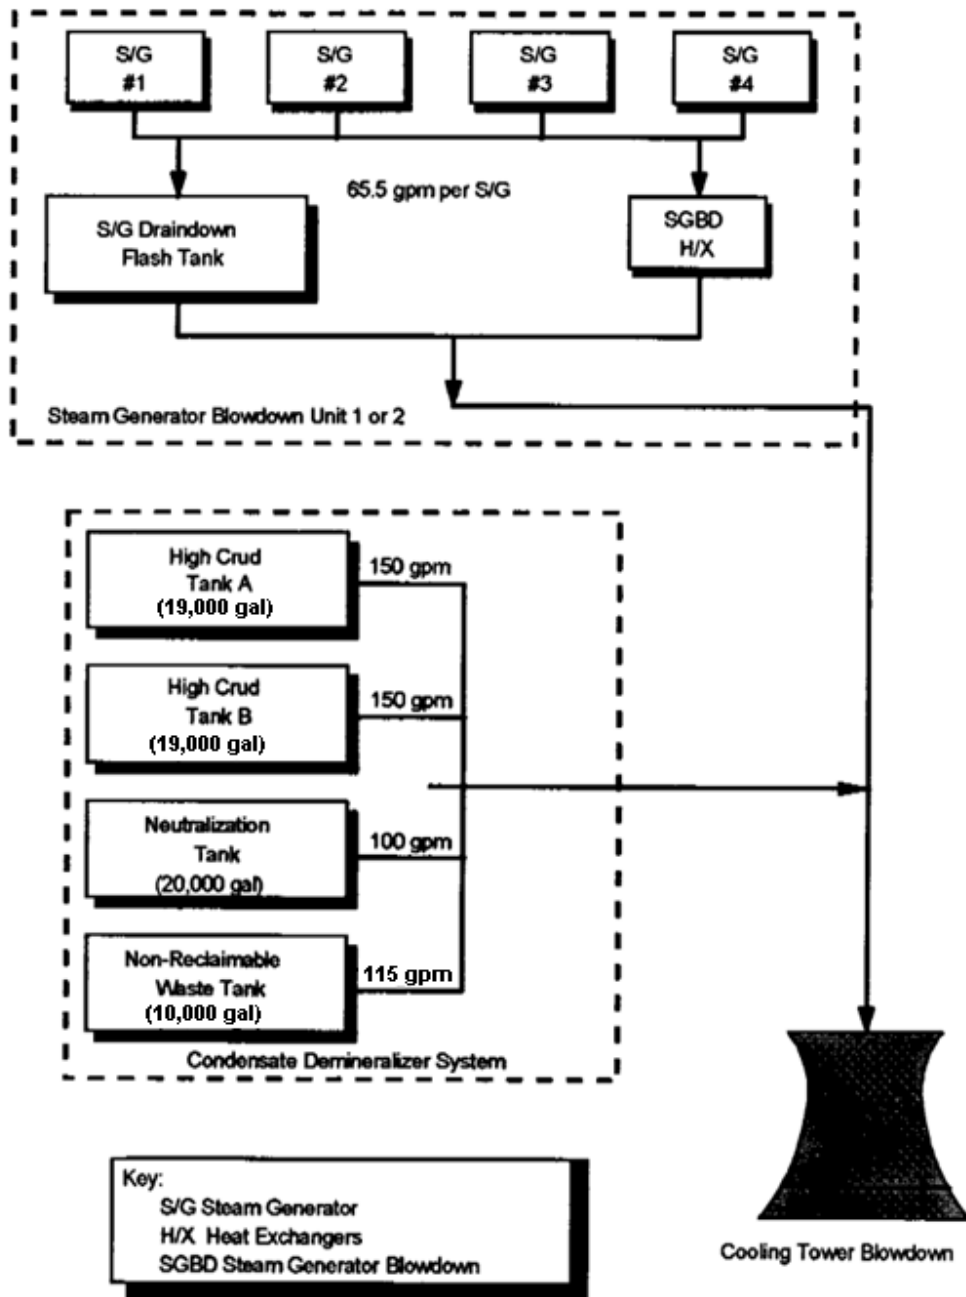

## 7.0 - GASEOUS EFFLUENTS INTRODUCTION

There are six discharge points for gaseous radioactive effluents from WBN. These discharge points are: Unit 1 Condenser Vacuum Exhaust (CVE), Unit 2 CVE, Service Building Exhaust, Auxiliary Building Exhaust, Unit 1 Shield Building Exhaust, and Unit 2 Shield Building Exhaust. Detailed descriptions are provided below, and Figure 7.1 provides an outline of these airborne discharge points with associated radiation monitors. None of these discharge points meets the criteria of Regulatory Guide 1.111 for elevated releases; therefore, all releases are considered to be ground-level. Various plant systems contribute activity to the CVE, the Service Building Exhaust and the Auxiliary Building Exhaust, but these sources are not treated as individual release points. There are two gas systems associated with each Shield Building Exhaust: the Waste Gas Decay Tank (WGDT) System and the Containment Purge System which includes the Incore Instrument Room Purge.

The discharge points and the two associated gas systems are each monitored by noble gas radiation monitors. These monitors perform two main functions: to identify any unexpected radioactivity releases, and to ensure that the dose rate limits of ODCM Control 1.2.2.1 are met. Each monitor has an alarm/trip setpoint which causes the monitor to alarm if the monitor's setpoint is exceeded. The monitors do not have separate alarm and trip setpoints; they have one setpoint which performs both functions. The noble gas radiation monitors for Containment Purge and the WGDT release points initiate an isolation function if the alarm/trip setpoint is exceeded. The radiation monitor alarm/trip setpoints for each release point and discharge point are based on the radioactive noble gases in the gaseous effluent. It is not considered practical to apply instantaneous alarm/trip setpoints for integrating radiation monitors sensitive to radioiodines, radioactive materials in particulate form, and radionuclides other than noble gases.

Releases are continuous, except for releases from the WGDT or Containment Purge Systems which are made as batch releases.

For batch releases, the WGDT or Containment to be released is grab sampled for radioactivity in accordance with Table 2.2-2. The samples are analyzed to determine the maximum allowable release flow rate to ensure compliance with the dose rate limits of ODCM Control 1.2.2.1 as described in ODCM Section 7.2. The sampling results are also used to determine a setpoint for the associated noble gas radiation monitor for the release. The setpoints are determined in accordance with ODCM Section 7.1. Dose calculations are performed for each release, as outlined in ODCM Sections 7.3 and 7.4, to determine compliance with ODCM Controls 1.2.2.2 and 1.2.2.3.

For continuous releases, the pathways are sampled for radioactivity periodically, as required by Table 2.2-2. The samples are analyzed to ensure compliance with the dose and dose rate limits of ODCM Control 1.2.2.1, 1.2.2.2, and 1.2.2.3, as described in ODCM Sections 7.1 and 7.2. The sampling results are also used to determine a setpoint for the associated noble gas radiation monitor for the release. The setpoints are determined in accordance with ODCM Section 7.1. Dose calculations are performed for each sampling period, as outlined in ODCM Sections 7.3 and 7.4, to determine compliance with ODCM Controls 1.2.2.2 and 1.2.2.3.

Once per month, the projected dose is calculated, as outlined in ODCM Section 7.5, to determine compliance with ODCM Control 1.2.2.4.

All dose calculations performed to determine compliance with ODCM Controls 1.2.2.2, 1.2.2.3 and 1.2.2.4 are detailed in ODCM Sections 7.3 and 7.4. The calculational methodologies are based on the guidance provided in NUREG-0133 (Reference 3) and Regulatory Guide 1.109 (Reference 4). Because all releases are ground level, semi-infinite cloud models are used in the dose calculations.

The quantities of each radionuclide identified and released are input into a more rigorous calculation methodology, described in ODCM Section 7.7, to determine the individual and population doses to be reported to the NRC in the Annual Radioactive Effluent Release Report. These dose calculation methodologies are based on the guidance provided in Regulatory Guide 1.109 (Reference 4).

## **RELEASE/DISCHARGE POINTS DESCRIPTION**

There are six discharge points at WBN that are monitored for airborne radioactive effluents. These are: a CVE for each unit, a common Service Building Exhaust, a common Auxiliary Building Exhaust and a Shield Building Exhaust for each unit. Each of these discharge points may have one or more release points associated with it as described below. Figure 7.1 provides a simplified outline of the airborne effluent release and discharge points with associated radiation monitor identifications. Figure 7.2 provides a more detailed description of the release and discharge points, with flow rates, radiation monitors, and associated inputs.

### **Condenser Vacuum Exhaust**

The CVEs are located in the turbine buildings. They exhaust at a maximum design flow rate of 45 cfm per pump. These discharge points are monitored by radiation monitors 1,2-RE-90-119 for normal operation.

### **Service Building Exhaust**

Areas in the Service Building in which work is conducted which may produce radioactive effluents all exhaust to the Service Building Exhaust. This discharge point exhausts at a maximum design flow rate of approximately 10,000 cfm and is monitored by radiation monitor 0-RE-90-132B.

### **Auxiliary Building Exhaust**

The Auxiliary Building exhausts at a maximum total design flow of 228,000 cfm (2 of 4 ventilation fans and 1 fuel handling fan). This discharge point exhaust is monitored by radiation monitor 0-RE-90-101B. The annulus vacuum priming fans (2 fans at 1000 cfm each) exhaust to the auxiliary building fuel handling exhaust header.

### **Shield Building Exhaust**

There is one Shield Building Exhaust for each unit. These discharge points are monitored by radiation monitors 1,2-RE-90-400A.

There are nine Waste Gas Decay Tanks (WGDTs) that discharge into the waste gas header which is released into a Shield Building Vent (see Figure 7.3). The Train A Auxiliary Building Gas Treatment System (ABGTS) is operated during a WGDT release. Each WGDT has a design capacity of 600 ft<sup>3</sup> and a maximum design release rate of 100 cfm [SOURCE NOTE 17]. The WGDT release point is monitored by radiation monitor 0-RE-90-118.

The Auxiliary Building Gas Treatment System (ABGTS) draws from the Auxiliary Building Secondary Containment Enclosure and exhausts to the Shield Building Exhaust. Any activity released from the Auxiliary Building through the ABGTS is accounted for as a part of the Auxiliary Building Exhaust releases, and will not be tracked separately. An Auxiliary Building Isolation signal starts the ABGTS. The Emergency Gas Treatment System is used to draw a vacuum in the annulus and exhaust to the Shield Building Exhaust under emergency conditions, and could do so during normal operation.

Both the Containment Purge and the Incore Instrument Room Purge from each unit tie into the Shield Building Exhaust. The Containment Purge release point exhausts at a maximum of 28,000 cfm and is monitored by radiation monitors 1,2-RE-90-130 and 1,2-RE-90-131. If the Incore Instrument Room Purge is operating exclusively, it exhausts at 800 cfm, and is monitored by the Containment Purge Monitors given above. The common header exhausts to the Shield Building Exhaust.

## 7.1 GASEOUS EFFLUENT MONITOR INSTRUMENT SETPOINTS

Airborne effluent noble gas monitor setpoints are determined to ensure that the dose rate at the UNRESTRICTED AREA BOUNDARY does not exceed the dose rate limits given in ODCM Control 1.2.2.1 and to identify unexpected releases. ODCM Control 1.1.2 establishes operability requirements for these monitors. Allocation factors (AF) are used in the setpoint calculation to allocate a fraction of the total body dose rate limit to each discharge point. These allocation factors may be changed as required to support plant operational needs, but shall not exceed a sum of one. Therefore, a particular monitor reaching the calculated maximum setpoint as described below does not necessarily mean that the dose rate limit at the UNRESTRICTED AREA BOUNDARY is being exceeded; the alarm indicates that the specific release/discharge point is contributing a greater fraction of the dose rate limit than was allocated to the associated monitor and will require further evaluation.

The gaseous effluent radiation monitors and their setpoint information are outlined below:

Pathway	Monitor	Default Setpoint	Setpoint Limit	Release Setpoint
Containment Purge	1-RE-90-130 2-RE-90-130 1-RE-90-131 2-RE-90-131	Section 7.1.1.3	(1)	Section 7.1.2
WGDT	0-RE-90-118	Section 7.1.1.2	$S_{\max}$	Section 7.1.2
Shield Building Exhaust	1-RE-90-400A 2-RE-90-400A	Section 7.1.1.3	$S_{\max}$	Section 7.1.2
Auxiliary Building Exhaust	0-RE-90-101B	Section 7.1.1.3	$S_{\max}$	Section 7.1.2
Service Building Exhaust	0-RE-90-132B	Section 7.1.1.3	$S_{\max}$	Section 7.1.2
CVE	1-RE-90-119 2-RE-90-119	Section 7.1.1.4	$S_{\max}$	Section 7.1.2

(1)  $S_{\max}$  or Tech Spec value from setpoint and scaling document, whichever is smaller.

### 7.1.1 Default Monitor Setpoints

7.1.1.1 Reserved for future use.

#### 7.1.1.2 Waste Gas Decay Tank Effluent Monitor (0-RE-90-118)

During periods of release, the methodology in Section 7.1.2 will be used to determine the monitor setpoint and may be set at a default value. Site procedures will document and control this value.

#### 7.1.1.3 Shield Building Exhaust (1,2-RE-90-400A), Auxiliary Building Exhaust (0-RE-90-101B), Containment Purge Effluent Monitors (1,2-RE-90-130,-131), and Service Building Exhaust (0-RE-90-132B)

These discharge point effluent monitors are set to ensure compliance with ODCM Control 1.2.2.1. The default setpoints are determined by calculating the maximum calculated setpoint described by Equation 7.3 using Xe-133 monitor efficiencies, design flow rates, and setting the ratio  $DR_{lim}/DR$  equal to 1.0. The default setpoints for the shield building monitors are calculated in units of  $\mu\text{Ci/s}$ . The default setpoints will be defined in plant procedures.

#### 7.1.1.4 Condenser Vacuum Exhaust Vent (1,2-RE-90-119)

This discharge point effluent monitor is set to ensure compliance with ODCM Control 1.2.2.1 and to identify the presence of primary to secondary leakage of radioactivity. The default setpoint is determined in one of two ways: by calculating the maximum calculated setpoint as described in Section 7.1.1.3, and then taking a percentage of this value as the setpoint; or by defining the setpoint as two times the normal background. The default setpoint will be defined in plant instructions. Once a primary to secondary leak is identified, the setpoint on this monitor may be incrementally adjusted upward as defined in plant procedures to enable it to be used to identify any further increases in the leak rate.

### 7.1.2 Release Permit Monitor Setpoint Determination

For each release, two setpoints are calculated for the monitor: one based on the expected response of the monitor to the radioactivity in the effluent stream (described in Sections 7.1.2.1 and 7.1.2.2) which allows for the identification of any release of radioactivity above the expected amount; and a calculated maximum setpoint which corresponds to the most restrictive dose rate limit given in ODCM Control 1.2.2.1 (described in Section 7.1.2.3) which ensures that the release will be stopped if it exceeds the dose rate limits after dilution. A comparison is then made (as described in Section 7.1.2.4) between these two calculated setpoints and the default setpoints (described in Section 7.1.1) to determine which is used for the release.

**7.1.2.1 Expected Monitor Response**

The expected monitor response,  $ER$ , is determined using the following equation:

$$ER = BKG + \sum_i E_i C_i \quad (7.1)$$

where:

$BKG$  = monitor background, cpm.

$E_i$  = efficiency factor for the monitor for nuclide  $i$ , cpm per  $\mu\text{Ci/cc}$ . This term may also be referred to as a response or calibration factor.

$C_i$  = measured concentration of nuclide  $i$ ,  $\mu\text{Ci/cc}$ .

**7.1.2.2 Expected Response Setpoint**

An expected response setpoint  $S_{ER}$  is calculated for the monitor for each release:

$$S_{ER} = X \sum_i E_i C_i + X BKG \quad (7.2)$$

where:

$X$  = administrative factors designed to account for expected variations in monitor response and background (as defined in plant procedures). The ranges of values are:  $1 < X \leq 2.0$ .  
[SOURCE NOTE 15]

**7.1.2.3 Calculated Maximum Setpoint**

The calculated maximum setpoint,  $S_{\max}$  in cpm, corresponding to the dose rate limit is determined using the following equation:

$$S_{\max} = \left\{ AF \ VCF \ SF \left[ \frac{DR_{\text{Lim}}}{DR} (ER - BKG) \right] \right\} + BKG \quad (7.3)$$

where:

$AF$  = dose rate allocation factor for the release point, dimensionless. The sum of all dose rate allocation factors must be  $\leq 1$ . The dose rate allocation factors for release points are defined in approved plant procedures.

$VCF$  = Vacuum correction factor applied to noble gas monitors whose detector operates at a negative pressure. This factor will be defined in plant procedures for applicable monitors and will have a range of:  $0 < VCF \leq 1.0$ . [SOURCE NOTE 2]

$SF$  = safety factor for the monitor, dimensionless. Safety factors will be  $\leq 1$ . Safety factors for each monitor are defined in approved plant procedures.

$DR_{\text{Lim}}$  = the dose rate limit, mrem/y.

= 500 mrem/y to the total body for noble gases,

= 3000 mrem/y to the skin for noble gases, and

$DR$  = the calculated dose rate for the release, mrem/y.

=  $DR_{\text{TB}}$  for total body (as described in Section 7.2.1),

=  $DR_s$  for skin (as described in Section 7.2.2), and

$ER$  = expected monitor response (as calculated in Equation 7.1), cpm.

$BKG$  = the monitor background, cpm.

When release permits are generated, the expected response and maximum calculated setpoints are determined as described in Equations 7.2 and 7.3. A comparison is made between these two calculated setpoints and the default setpoint as described below to choose the appropriate setpoint for the monitor during the release (after the release, the monitor is normally returned to the default setpoint).

- |  |   |
|--|---|
| 1. IF $S_{ER} < S_{default} < S_{max}$ | Reported = $S_{default}$  |
| 2. IF $S_{ER} < S_{max} < S_{default}$ | Reported = $S_{ER}$   |
| 3. IF $S_{default} < S_{ER} < S_{max}$ | Reported = $S_{ER}$<br>= $S_{default}$ (for Containment Purge monitors) |
| 4. IF $S_{ER} \geq S_{max}$            | Reported = $S_{max}$  |

## 7.2 GASEOUS EFFLUENTS - DOSE RATES

Dose rates are calculated for total body and skin due to submersion within a cloud of noble gases using a semi-infinite cloud model as described in NUREG-0133. The dose rates are compared to their respective limits and are used in the determination of setpoints for noble gas radiation monitors.

### 7.2.1 Total Body Dose Rate

The calculated total body dose rate must meet the condition (from NUREG-0133 Section 5.2.1):

$$\sum_i \left[ V_i Q_{is} + DFB_i \left\{ \left( \frac{\chi}{Q} \right)_v Q_{iv} \right\} \right] \leq 500 \text{ mrem/y}$$

Since there are no elevated release points at WBN, the elevated release terms in the equation ( $V_i$  and  $Q_{is}$ ) are not used. Substituting the flow ( $f$ ) multiplied by the concentration ( $C$ ) for the release rate ( $Q$ ) in the above equation, the dose rate to the total body,  $DR_{TB}$  in mrem/y, is calculated using the following equation:

$$DR_{TB} = \frac{\chi}{Q} f \sum_i C_i DFB_i \quad (7.4)$$

where:

$\chi/Q$  = terrain adjusted relative concentration,  $s/m^3$ . Relative air concentrations are calculated for the unrestricted area boundary in each of the 16 sectors as described in Section 7.9.2 using the historical meteorological data for the period 1986-2005 given in Table 7.2. For dose rate calculations, the highest value from the 16 unrestricted area boundary locations is used. The values for each of the sixteen sectors are given in Table 7.3 (maximum values are highlighted on the table).

$f$  = flowrate of effluent stream, cc/s.

$C_i$  = concentration of noble gas nuclide  $i$  in effluent stream,  $\mu\text{Ci/cc}$ .

$DFB_i$  = total body dose factor due to gamma radiation for noble gas nuclide  $i$ , mrem/y per  $\mu\text{Ci/m}^3$  (Table 7.4).

The total body dose rate is calculated for each release. It is compared to the limit of 500 mrem/y and is also used in the determination of the radiation monitor setpoint as described in Section 7.1.2.

### 7.2.2 Skin Dose Rate

The calculated skin dose rate must meet the condition (from NUREG-0133 Section 5.2.1):

$$\sum_i \left\{ \left[ \left( DFS_i \left( \frac{\chi}{Q} \right)_s + 1.1 B_i \right) Q_{is} \right] + \left[ DFS_i + 1.1 DF_{\gamma i} \right] \left[ \left( \frac{\chi}{Q} \right)_s Q_{iv} \right] \right\} \leq 3000 \text{ mrem/y}$$

Since there are no elevated release points at WBN, the stack terms in the equation,  $DFS_i$ ,  $(\chi/Q)_s$ ,  $B_i$ , and  $Q_{is}$ , are not used. Substituting the flow (f) multiplied by the concentration (C) for the release rate (Q) in the above equation, the dose rate to the skin,  $DR_S$  in mrem/y, is calculated using the following equation:

$$DR_S = \frac{\chi}{Q} f \sum_i C_i (DF_{Si} + 1.11 DF_{\gamma i}) \quad (7.5)$$

where:

$\chi/Q$  = terrain adjusted relative concentration,  $s/m^3$ . Relative air concentrations are calculated for the unrestricted area boundary in each of the 16 sectors as described in Section 7.9.2 using the historical meteorological data for the period 1986-2005 given in Table 7.2. For dose rate calculations, the highest value from the 16 unrestricted area boundary locations is used. The values for each of the sixteen sectors are given in Table 7.3 (maximum values are highlighted on the table).

f = flowrate of effluent stream, cc/s.

$C_i$  = concentration of noble gas nuclide i in effluent stream,  $\mu\text{Ci/cc}$ .

$DF_{Si}$  = skin dose factor due to beta radiation for noble gas nuclide i, mrem/y per  $\mu\text{Ci/m}^3$  (Table 7.4).

1.11 = the average ratio of tissue to air energy absorption coefficients, mrem/mrad. (1.11 is used from Regulatory Guide 1.109 Equation B-7 in lieu of 1.1 from NUREG-0133)

$DF_{\gamma i}$  = dose conversion factor for external gamma for noble gas nuclide i, mrad/y per  $\mu\text{Ci/m}^3$  (Table 7.4).

The skin dose rate is calculated for each release. It is compared to the limit of 3000 mrem/y and is also used in the determination of the radiation monitor setpoint as described in Section 7.1.2.

### 7.2.3 I-131, I-133, Tritium and All Radionuclides in Particulate Form with Half-Lives of Greater Than 8 Days - Organ Dose Rate

Organ dose rates due to I-131, I-133, tritium and all radionuclides in particulate form with half-lives of greater than 8 days,  $DR_j$  in mrem/y, are calculated for all age groups (adult, teen, child, and infant) and all organs (bone, liver, total body, thyroid, kidney, lung, and GI Tract). The calculated organ dose rate must meet the condition (from NUREG-0133 Section 5.2.1):

$$\sum_i P_i (W_s Q_s + W_v Q_{iv}) \leq 1500 \text{ mrem/y}$$

Since there are no elevated release points at WBN, the elevated release terms ( $W_s$  and  $Q_s$ ) are not used. Substituting the flow ( $f$ ) multiplied by the concentration ( $C$ ) for the release rate ( $Q$ ) in the above equation, and inserting the appropriate dispersion factor ( $\chi/Q$  or  $D/Q$ ) for each pathway considered, the organ dose rate,  $DR_j$  in mrem/y, is calculated using the following equation:

$$DR_j = f \left\{ C_T \frac{\chi}{Q} (R_{IT} + R_{CPT}) + \sum_i C_i \left[ \frac{\chi}{Q} R_{Ii} + \frac{D}{Q} (R_{CPI} + R_{MPi} + R_{VFi} + R_{Gi}) \right] \right\} \quad (7.6)$$

where:

$f$  = flowrate of effluent stream, cc/s.

$C_T$  = concentration of tritium in effluent stream,  $\mu\text{Ci/cc}$ .

$\chi/Q$  = terrain adjusted relative concentration,  $\text{s/m}^3$ . Relative air concentrations are calculated for the unrestricted area boundary in each of the 16 sectors as described in Section 7.9.2 using the historical meteorological data for the period 1986-2005 given in Table 7.2. For dose rate calculations, the highest value from the 16 unrestricted area boundary locations is used. The values for each of the sixteen sectors are given in Table 7.3 (maximum values are highlighted on the table).

=  $(\chi/Q)$  for the inhalation and tritium ingestion pathways,

$R_{IT}$  = inhalation dose factor for tritium, mrem/y per  $\mu\text{Ci/m}^3$ . Dose factor is calculated as described in Section 7.8.13.

$R_{CPT}$  = Grass-cow-milk dose factor for tritium, mrem/y per  $\mu\text{Ci/m}^3$ . Dose factor is calculated as described in Section 7.8.7..

$C_i$  = concentration of nuclide  $i$  in effluent stream,  $\mu\text{Ci/cc}$ .

$R_{Ii}$  = inhalation dose factor for each identified nuclide  $i$ , mrem/y per  $\mu\text{Ci/m}^3$ . Dose factors are calculated as described in Section 7.8.13.

$D/Q$  = terrain adjusted relative deposition,  $1/\text{m}^2$ . Relative deposition is calculated for the unrestricted area boundary in each of the 16 sectors as described in Section 7.9.3 using the historical meteorological data for the period 1986-2005 given in Table 7.2. For dose rate calculations, the highest value from the 16 unrestricted area boundary locations is used. The values for each of the sixteen sectors are given in Table 7.3 (maximum values are highlighted on the table).

$R_{CPI}$  = Grass-cow-milk dose factor for each identified nuclide  $i$ ,  $\text{m}^2\text{-mrem/y per } \mu\text{Ci/s}$ . Dose factors are calculated as described in Section 7.8.1.

$R_{MPi}$  = Grass-beef dose factor for each identified nuclide  $i$ ,  $\text{m}^2\text{-mrem/y per } \mu\text{Ci/s}$ . Dose factors are calculated as described in Section 7.8.3.

$R_{VFi}$  = Fresh leafy vegetable dose factor for each identified nuclide  $i$ ,  $\text{m}^2\text{-mrem/y per } \mu\text{Ci/s}$ . Dose factors are calculated as described in Section 7.8.5.

$R_{Gi}$  = ground plane dose factor for each identified nuclide  $i$ ,  $\text{m}^2\text{-mrem/y per } \mu\text{Ci/s}$ . Dose factors are calculated as described in Section 7.8.14.

The maximum organ dose rate is selected from among the dose rates calculated for all the organs and all age groups. It is compared to the limit of 1500 mrem/y.

### 7.3 DOSE - NOBLE GASES

Doses are calculated for gamma and beta air doses due to exposure to a semi-infinite cloud of noble gases. These doses will be calculated at the UNRESTRICTED AREA BOUNDARY location with the highest terrain adjusted annual-average  $\chi/Q$  based on 1986-2005 meteorological data (Table 7.2). This location is chosen from the UNRESTRICTED AREA BOUNDARY locations listed in Table 7.1. Dispersion factors are calculated using the methodology described in Section 7.9.2.

No credit is taken for radioactive decay.

#### 7.3.1 Gamma Dose to Air

NUREG-0133 Section 5.3.1 provides the following equation for the calculation of the gamma air dose from noble gases:

$$D = k \sum_i \left[ M_i \left( \frac{\chi}{Q} \right)_v Q_{iv} + \left( \frac{\chi}{q} \right)_v q_{iv} \right] + [B_i Q_{is} + b_i q_{is}]$$

Because there are no elevated release points, the terms subscripted s in the equation are not used. Since all releases are considered to be long-term, the terms using lower case variables are not used. Since WBN will be calculating a dose for each release made, the total release (Q) in the above equation is replaced by the release rate (Q) multiplied by the length of the release (T). The gamma air dose,  $D_\gamma$  in mrad, is calculated for each release using the following equation:

$$D_\gamma = 1.9 \text{ E-}06 \frac{\chi}{Q} \sum_i Q_i DF_{\gamma i} T \quad (7.7)$$

where:

1.9E-06 = conversion factor, y/min.

$\chi/Q$  = highest terrain adjusted unrestricted area boundary annual-average relative concentration,  $\text{s/m}^3$  (from Table 7.3).

$Q_i$  = release rate for nuclide i,  $\mu\text{Ci/s}$ .

$DF_{\gamma i}$  = dose conversion factor for external gamma for nuclide i (Table 7.4), mrad/y per  $\mu\text{Ci/m}^3$ .

T = duration of release, min.

The gamma air dose calculated by this method will be used in the cumulative dose calculations discussed in Section 7.3.3.

### 7.3.2 Beta Dose to Air

NUREG-0133 Section 5.3.1 provides the following equation for the calculation of the beta air dose from noble gases:

$$D = k \sum_i \left\{ N_i \left[ \left( \frac{\chi}{Q} \right)_v Q_{iv} + \left( \frac{\chi}{Q} \right)_v q_{iv} \right] + \left[ \left( \frac{\chi}{Q} \right)_s Q_{is} + \left( \frac{\chi}{Q} \right)_s q_{is} \right] \right\}$$

Because there are no elevated release points, the terms subscripted s in the equation are not used. Since all releases are considered to be long-term, the terms using lower case variables are not used. Since WBN will be calculating a dose for each release made, the total release (Q) in the above equation is replaced by the release rate (Q) multiplied by the length of the release (T). The beta air dose,  $D_b$  in mrad, is calculated for each release using the following equation:

$$D_b = 1.9E-06 \frac{\chi}{Q} \sum_i Q_i DF_{\beta i} T \quad (7.8)$$

where:

1.9E-06 = conversion factor, y/min.

$\chi/Q$  = highest terrain adjusted unrestricted area boundary annual-average relative concentration,  $s/m^3$  (from Table 7.3).

$Q_i$  = release rate for nuclide i,  $\mu Ci/s$ .

$DF_{\beta i}$  = dose conversion factor for external beta for nuclide i, mrad/y per  $\mu Ci/m^3$  (from Table 7.4).

T = duration of release, min.

The beta air dose calculated by this method will be used in the cumulative dose calculations discussed in Section 7.3.3.

### 7.3.3 Cumulative Dose - Noble Gas

Quarterly and annual sums of all doses are calculated for each release as described below to compare to the limits listed in ODCM Control 1.2.2.2.

For noble gases, cumulative doses are calculated for gamma and beta air doses. Doses due to each release are summed with the doses for all previous releases in the current quarter or year to obtain cumulative quarterly and annual doses.

### 7.3.4 Comparison to Limits

The cumulative calendar quarter and calendar year doses are compared to their respective limits in accordance with Surveillance Requirement 2.2.2.2. to determine compliance.

## 7.4 DOSE DUE TO I-131, I-133, C-14, TRITIUM AND ALL RADIONUCLIDES IN PARTICULATE FORM WITH HALF-LIVES OF GREATER THAN 8 DAYS

### 7.4.1 Organ Dose Calculation

Organ doses due to I-131, I-133, C-14, tritium and all radionuclides in particulate form with half-lives of greater than 8 days are calculated for each release for the critical receptor. The critical receptor is defined as the UNRESTRICTED AREA BOUNDARY in the sector with the highest annual average terrain adjusted  $\chi/Q$ . The annual average  $\chi/Q$  and  $D/Q$  are calculated using the methodology in Sections 7.9.2 and 7.9.3 using the historical 1986-2005 meteorological data (Table 7.2). A conservative assumption is used to select the dispersion factors for the critical receptor. The highest calculated  $\chi/Q$  and  $D/Q$  values are chosen from Table 7.1 values after being multiplied by the applicable terrain adjustment factors (see Table 7.3), and may not be for the same compass sector. Pathways considered to exist at this location are inhalation, ground plane exposure, grass-cow-milk ingestion, grass-cow-beef ingestion and fresh leafy and stored vegetable ingestion. All age groups are considered (adult, teen, child and infant). Dose factors for these age groups and pathways are calculated as described in Section 7.8. For the ground exposure pathway, which has no age or organ specific dose factors, the total body dose will be added to the internal organ doses for all age groups.

NUREG-0133 Section 5.3.1 provides the following equation for the calculation of the organ dose from radioiodines, radioactive materials in particulate form with half-lives greater than 8 days:

$$D = k \sum_i R_i (W_s Q_{is} + w_s q_{is} + W_v Q_{iv} + w_v q_{iv})$$

Because there are no elevated release points, the terms subscripted s in the equation are not used. Since all releases are considered to be long-term, the terms using lower case variables are not used. Since WBN will be calculating a dose for each release made, the total release (Q) in the above equation is replaced by the release rate (Q) times the length of the release (T). The general equation for the calculation of organ dose is:

$$D_i = 3.17E-08 T \sum_i \sum_P R_{Pi} (W_P Q_i) \quad (7.9)$$

where:

3.17E-08 = conversion factor, y/s

T = duration of release, s.

$R_{Pi}$  = dose factor for pathway P for each identified nuclide i,  $m^2$ -mrem/y per  $\mu Ci/s$  for ground plane, grass-milk animal-milk, grass-cow-beef, and vegetation pathways, and mrem/y per  $\mu Ci/m^3$  for inhalation, C-14 and tritium ingestion pathways. Equations for calculating these dose factors are given in Section 7.8.

$W_P$  = dispersion factor for the location and pathway P (from Table 7.3),  
= terrain adjusted  $\chi/Q$  for the inhalation, C-14 and tritium ingestion pathways,  
= terrain adjusted  $D/Q$  for the food and ground plane pathways,

$Q_i$  = release rate for radionuclide i,  $\mu Ci/s$ .

From the four age groups considered, the maximum is determined by comparing all organ doses for all age groups. The age group with the highest single organ dose is selected as the critical age group. The organ doses for the critical age group will be used in the cumulative doses discussed in Section 7.4.2.

#### 7.4.2 Cumulative Organ Doses

Quarterly and annual sums of all doses are calculated for each release as described below to compare to the limits listed in ODCM Control 1.2.2.3.

For maximum organ dose, cumulative quarterly and annual doses are maintained for each of the eight organs considered. The cumulative dose is obtained by summing the doses for each organ of the critical age group (as calculated in Section 7.4.1) as determined for each release with the organ doses for all previous releases in the quarter or year to obtain the cumulative quarterly and annual doses. Thus, the cumulative organ doses will be conservative values, consisting of doses belonging to various age groups depending on the mix of radionuclides. The highest of these cumulative organ doses is used for the comparison to the limits described in ODCM Control 1.2.2.3.

#### 7.4.3 Comparison to Limits

The cumulative calendar quarter and calendar year doses are compared to their respective limits in accordance with ODCM Surveillance Requirement 2.2.2.3 to determine compliance.

### 7.5 DOSE PROJECTIONS

In accordance with ODCM Surveillance Requirement 2.2.2.4.1, dose projections will be performed. This will be done for the gamma dose, the beta dose and the maximum organ dose.

$$D = \left\{ \frac{(a + b)}{d} \times 31 \right\} + c \quad (7.10)$$

where:

- D = the 31-day dose projection, mrem.
- a = the cumulative dose for the quarter, mrem.
- b = the projected dose for this release (as calculated in Sections 7.4.1, 7.4.2 and 7.4.3), mrem.
- c = any anticipated additional dose in the next month from other sources, mrem.
- d = current number of days into the quarter up to the time of the release under consideration.

The 31-day projected dose will be compared to the limits given in ODCM Control 1.2.2.4 in accordance with Surveillance Requirement 2.2.2.4.1 to determine compliance.

### 7.6 GASEOUS RADWASTE TREATMENT SYSTEM DESCRIPTION

The GASEOUS RADWASTE TREATMENT SYSTEM (GRTS) described in the WBN FSAR shall be maintained and operated to keep releases ALARA. A simplified flow diagram for the GRTS is given in Figure 7.3.

## 7.7 DOSE CALCULATIONS FOR REPORTING

A complete dose analysis utilizing the total estimated gaseous releases for each calendar quarter will be performed and reported as required in ODCM Administrative Control 5.2. All real pathways and receptor locations identified by the most recent land use survey are considered. In addition, actual meteorological data representative of a ground level release for each corresponding calendar quarter will be used. For iodine releases, it is assumed that half the iodine released is in organic form. Organic iodine causes a dose only by inhalation. For cow-milk and beef ingestion doses, the fraction of the time the animals are on stored feed (identified in the survey) is used in the calculation.

### 7.7.1 Noble Gas - Gamma and Beta Air Dose

Regulatory Guide 1.109 Equation B-5 provides the following equation for the calculation of gamma and beta air doses from noble gas releases:

$$D = \sum_i \chi_{im} (DF_{\gamma i} \text{ or } DF_{\beta i}) \quad (7.11)$$

where:

$\chi_{im}$  = concentration of nuclide i at location m,  $\mu\text{Ci}/\text{m}^3$ . Air concentrations are calculated as described by Equation 7.39.

$DF_{\gamma i}$  = dose conversion factor for external gamma for nuclide i, mrad/y per  $\mu\text{Ci}/\text{m}^3$  (Table 7.4).

$DF_{\beta i}$  = dose conversion factor for external beta for nuclide i, mrad/y per  $\mu\text{Ci}/\text{m}^3$  (Table 7.4).

### 7.7.2 Noble Gas - Air Submersion Dose

Regulatory Guide 1.109 Equation B-8 provides the following equation for the calculation of the total body submersion dose from noble gas releases:

$$D = SF \sum_i \chi_{im} DFB_i \quad (7.12)$$

where:

SF = shielding factor. This factor is conservatively set equal to 1.0.

$\chi_{im}$  = concentration of nuclide i at location m,  $\mu\text{Ci}/\text{m}^3$ . Air concentrations are calculated as described by Equation 7.39.

$DFB_i$  = total body dose conversion factor due to submersion in a semi-infinite cloud of noble gases for nuclide i, mrem/y per  $\mu\text{Ci}/\text{m}^3$  (Table 7.4).

Regulatory Guide 1.109 Equation B-9 provides the following equation for the calculation of the skin submersion dose from noble gas releases:

$$D = \left\{ 1.11 SF \sum_i \chi_{im} DF_{\gamma i} \right\} + \sum_i \chi_{im} DFS_i \quad (7.13)$$

where:

1.11 = the average ratio of tissue to air energy absorption coefficients, mrem/mrad.

SF = shielding factor. This factor is conservatively set equal to 1.0.

$\chi_{im}$  = concentration of nuclide i at location m,  $\mu\text{Ci}/\text{m}^3$ . Air concentrations are calculated as described by Equation 7.39.

$DF_{\gamma i}$  = dose conversion factor for external gamma for nuclide i, mrad/y per  $\mu\text{Ci}/\text{m}^3$  (Table 7.4).

$DFS_i$  = skin dose conversion factor due to submersion in a semi-infinite cloud of noble gases for nuclide i, mrem/y per  $\mu\text{Ci}/\text{m}^3$  (Table 7.4).

**7.7.3 Radioiodine, Particulate, C-14, and Tritium - Maximum Organ Dose**

Regulatory Guide 1.109 Equations C-2, -4, and -13 provide the following equations for the calculation of doses from the release of iodine and particulate radionuclides:

$$D = S_F \sum_i C_{Gi} R_{Gi} \quad (\text{for ground contamination})$$

$$D = BR_a \sum_i \chi_i R_{Pi} \quad (\text{for inhalation})$$

$$D = \sum_i R_{Pi} (U_{va} f_g C_{iv} + U_{ma} C_{im} + U_{Fa} C_{Fi} + U_{La} f_L C_{Li}) \quad (\text{for ingestion})$$

These three equations are combined into one equation for this presentation by dropping the subscripts on the dose factors, and substituting the appropriate dispersion factor ( $D/Q$  or  $\chi/Q$ ) multiplied by the total release ( $Q$ ) for the concentration terms ( $C$ ) as follows:

$$D = BR_a \sum_i \frac{\chi}{Q} Q_i R_{Pi} + S_F \sum_i \frac{D}{Q} Q_i R_{Gi} + \sum_i R_{Pi} \frac{D}{Q} Q_i (U_{va} f_g + U_{ma} + U_{Fa} + U_{La} f_L)$$

The shielding factor ( $S_F$ ) is conservatively set equal to 1.0, therefore, that term drops out of the equation.

The vegetable fractions ( $f$ ), ingestion rates ( $U$ ) and breathing rate ( $BR$ ) are included in the calculation of the dose factors, given in ODCM Sections 7.8.1 through 7.8.14, therefore, they may also be dropped from this equation. The equation then becomes:

$$D = \sum_i \frac{\chi}{Q} Q_i R_{Pi} + \sum_i \frac{D}{Q} Q_i R_{Gi} + \sum_i \frac{D}{Q} Q_i R_{Pi}$$

Since the calculation of C-14 and tritium concentrations in vegetation are based on air concentration rather than ground deposition (Equations C-8 and C-9 in Regulatory Guide 1.109), separate terms are added to the equation to account for the C-14 and tritium ingestion dose pathways. In addition, a terrain adjustment factor (TAF) is added. Therefore the equation for calculating the organ dose,  $D_j$  in mrem, is:

$$D_j = 3.17 \text{E}-08 \left\{ \left( \frac{\chi}{Q} \right) \sum_P R_{PT} Q_T + \left( \frac{\chi}{Q} \right) \sum_P R_{PC14} Q_{C14} + \sum_i \left[ \left( \frac{D}{Q} \right) \sum_P R_{Pi} + \left( \frac{D}{Q} \right) R_{Gi} + \left( \frac{\chi}{Q} \right) R_{Pi} \right] Q_i \right\} \quad (7.14)$$

where:

3.17E-08 = conversion factor, y/s.

$D/Q$  = Terrain Adjusted Relative deposition for location under consideration,  $\text{m}^{-2}$ . Relative deposition is calculated as described in Equation 7.41.

$R_{PT}$  = ingestion dose factor for pathway P for tritium,  $\text{m}^2\text{-mrem/y per } \mu\text{Ci/s}$ . Ingestion pathways available for consideration are the same as those listed above for  $R_{Pi}$ . Equations for calculating ingestion dose factors for tritium are given in Sections 7.8.7 through 7.8.12.

$Q_T$  = adjusted release rate for tritium for location under consideration,  $\mu\text{Ci/s}$ . The initial release rate is adjusted to account for decay between the release point and the location, depending on the frequency of wind speeds applicable to that sector. Hence, the adjusted release rate is equal to the actual release rate decayed for an average travel time during the period.

$$Q_T = Q_{Ti} \sum_{k=1}^9 f_k \exp \left( -\lambda_T \frac{x}{u_k} \right) \quad (7.15)$$

where:

$Q_{Ti}$  = initial average release rate for tritium over the period,  $\mu\text{Ci/s}$ .

$f_k$  = joint relative frequency of occurrence of winds in windspeed class k blowing toward this exposure point, expressed as a fraction.

$\lambda_T$  = radiological decay constant for tritium,  $\text{s}^{-1}$ .

$x$  = downwind distance, m.

$u_k$  = midpoint value of wind speed class interval k, m/s.

- $R_{PC14}$  = ingestion dose factor for pathway P for C-14,  $m^2\text{-mrem/y}$  per  $\mu\text{Ci/s}$ . Ingestion pathways available for consideration are the same as those listed above for  $R_{Pi}$ . Equations for calculating ingestion dose factors for C-14 are given in Sections 7.8.15 through 7.8.20.
- $Q_{C14}$  = adjusted release rate for C-14 for location under consideration,  $\mu\text{Ci/s}$ . The initial release rate is adjusted to account for decay between the release point and the location, depending on the frequency of wind speeds applicable to that sector. Hence, the adjusted release rate is equal to the actual release rate decayed for an average travel time during the period.

$$Q_{C14} = Q_{C14I} \sum_{k=1}^9 f_k \exp\left(-\lambda_{C14} \frac{x}{u_k}\right)$$

where:

$Q_{C14I}$  = initial average release rate for C-14 over the period,  $\mu\text{Ci/s}$ .

$f_k$  = joint relative frequency of occurrence of winds in windspeed class k blowing toward this exposure point, expressed as a fraction.

$\lambda_{C14}$  = radiological decay constant for C-14,  $s^{-1}$ .

$x$  = downwind distance, m.

$u_k$  = midpoint value of wind speed class interval k, m/s.

- $R_{Pi}$  = ingestion dose factor for pathway P for each identified nuclide i (except C-14 and tritium),  $m^2\text{-mrem/y}$  per  $\mu\text{Ci/s}$ . Ingestion pathways available for consideration include:  
 pasture grass-milk animal-milk ingestion -  $R_{CP}$  (see Section 7.8.1).  
 stored feed-milk animal-milk ingestion -  $R_{CS}$  (see Section 7.8.2).  
 pasture grass-beef ingestion -  $R_{MP}$  (see Section 7.8.3).  
 stored feed-beef ingestion -  $R_{MS}$  (see Section 7.8.4).  
 fresh leafy vegetable ingestion -  $R_{VF}$  (see Section 7.8.5).  
 stored vegetable ingestion -  $R_{VS}$  (see Section 7.8.6).
- $R_{Gi}$  = Dose factor for standing on contaminated ground,  $m^2\text{-mrem/y}$  per  $\mu\text{Ci/s}$ . The equation for calculating the ground plane dose factor is given in Section 7.8.14.
- $\chi/Q$  = Relative concentration for location under consideration,  $s/m^3$ . Relative concentrations are calculated as described by Equation 7.40.
- $R_{Ii}$  = Inhalation dose factor,  $mrem/y$  per  $\mu\text{Ci/m}^3$ . The equation for calculating the inhalation dose factor is given in Section 7.8.13.
- $Q_i$  = adjusted release rate for nuclide i for location under consideration,  $\mu\text{Ci/s}$ . Calculated in the same manner as  $Q_T$  above.

The highest organ dose for a real receptor is determined by summing the dose contribution from all identified pathways for each receptor including ground contamination, inhalation, vegetable ingestion (for identified garden locations), cow and/or goat milk ingestion (if a cow or goat is identified for the location), beef ingestion (the beef ingestion dose for the location of highest beef dose for all receptors will be considered the beef dose for all receptors).

#### 7.7.4 Population Doses

The population dose is determined using Equation D-1 from Regulatory Guide 1.109:

$$D = k \sum_m \text{POP}_m \sum_i D_{aij} \text{FP}_{ma}$$

For determining population doses to the 50-mile population around the plant, each compass sector is broken down into elements. These elements are defined in Table 7.5. Dispersion factors are calculated for the midpoint of each sector element (see Table 7.5). For each of these sector elements, an average dose is calculated, and then multiplied by the population in that sector element. The average dose is determined by multiplying the maximum individual dose for the sector by the ratio of the average to the maximum usage rates. For population doses resulting from ingestion, it is conservatively assumed that

all food eaten by the average individual is grown within the sector element. The general equation used for calculating the population dose in a given sector element is:

$$\text{Dose}_{\text{pop}} = \frac{0.001}{\text{TAF}} \sum_p \text{RATIO}_p \text{POP}_m \text{FP}_a \text{DOSE}_p$$

where:

0.001 = conversion from mrem to rem.

TAF = Terrain Adjustment Factor. Given the population centers are far from the site, the straight line dispersion factors provide conservative dose results when compared to a variable trajectory model.

RATIO<sub>p</sub> = ratio of average to maximum dose for pathway P. Maximum ingestion rates are given in Table 6.3. (Average ingestion rates are obtained from Reference 4, Table E-4.)

= 0.5 for submersion and ground exposure pathways, a shielding/occupancy factor.

= 1.0 for the inhalation pathway.

= 0.515, 0.515, 0.5, and 0.355 for milk, for infant, child, teen and adult, respectively. (It is assumed that the ratio of average to maximum infant milk ingestion rates is the same as that for child.)

= 1.0, 0.90, 0.91, 0.86 for beef ingestion, for infant, child, teen and adult, respectively.

= 1.0, 0.38, 0.38, 0.37 for vegetable ingestion, for infant, child, teen and adult, respectively. (It is assumed that the vegetable ingestion ratio also applies to leafy vegetables.)

POP<sub>m</sub> = the population of the sector element m, persons (Table 7.6).

FP<sub>a</sub> = fraction of the population belonging to each age group.

= 0.015, 0.167, 0.153, 0.665 for infant, child, teen and adult, respectively (fractions taken from Reference 21, Table 3.39).

DOSE<sub>p</sub> = the dose for pathway P to the maximum individual at the location under consideration, mrem (as described in Sections 7.7.1, 7.7.2, and 7.7.3). For ingestion pathways, this dose is multiplied by an average decay correction to account for decay as the food is moved through the food distribution cycle. This average decay correction, ADC, is defined as follows:

For milk and vegetables:

$$\text{ADC} = \exp(-\lambda_i t_d) \quad (7.17)$$

For beef:

$$\text{ADC} = \frac{\exp(-\lambda_i t_d) \lambda_i t_{cb}}{1 - \exp(-\lambda_i t_{cb})} \quad (7.18)$$

where:

$\lambda_i$  = decay constant for nuclide i, s<sup>-1</sup>.

$t_d$  = distribution time for food product under consideration (values from Reference 4, Table D-1).

= 1.21E+06 s (14 d) for vegetables.

= 3.46E+05 s (4 d) for milk.

= 7d for beef

$t_{cb}$  = time to consume a whole beef, as described in Section 7.8.3.

For beef ingestion, the additional factors in the calculation of ADC negate the integration of the dose term over the period during which a whole beef is consumed, for the calculation of population dose. In other words, this assumes that the maximum individual freezes and eats a whole beef, while the average individual buys smaller portions at a time.

Population doses are summed over all sector elements to obtain a total population dose for the 50-mile population.

#### **7.7.5 Reporting of Doses**

The calculated quarterly doses and calculated population doses described in Section 7.7 are reported in the Annual Radioactive Effluent Release Report as required by ODCM Administrative Control 5.2.

**7.7.6 Dose to a MEMBER OF THE PUBLIC Inside the CONTROLLED or RESTRICTED AREA**

The Basis for ODCM Control 1.2.2.1 states that for MEMBERS OF THE PUBLIC who may at times be within the CONTROLLED or RESTRICTED AREA, the occupancy factor of that MEMBER OF THE PUBLIC will usually be sufficiently low to compensate for any increase in the atmospheric dispersion factor above that for the UNRESTRICTED AREA BOUNDARY. This basis also states that examples of calculations for such MEMBERS OF THE PUBLIC will be given in the ODCM.

Calculations are presented in Section 12.4 of the WBN UFSAR which estimate the annual doses at the RESTRICTED AREA BOUNDARY (WBN UFSAR Table 12.4-2). The total dose rate is the sum of the adult whole body inhalation dose rate, the gamma dose rate from the plume and ground contamination, and the gamma dose rate from outdoor storage tanks. As indicated in the UFSAR, the highest total dose rate at the RESTRICTED AREA BOUNDARY is 105 mrem/y, based on a continuous 2000 h/y occupancy. Use of a more realistic occupancy, reflective of the transient traffic expected for this location, would result in a much lower dose estimate. It is, therefore, considered highly unlikely that a member of the public would receive greater than 100 mrem/y at or beyond the RESTRICTED AREA BOUNDARY.

In addition to this calculation, the dose to these MEMBERS OF THE PUBLIC (obtained from dosimeters deployed near the UNRESTRICTED AREA BOUNDARY and from estimates of the dose from gaseous effluents) will be reviewed on an annual basis to ensure that the actual exposure to any individuals is less than 100 mrem/y for these locations. The results of this review will be included in the Annual Radiological Effluent Report pursuant to ODCM Administrative Control 5.2.

## 7.8 GASEOUS RELEASES - DOSE FACTORS

### 7.8.1 Pasture Grass-Cow/Goat-Milk Ingestion Dose Factors - $R_{Cpi}$

(m<sup>2</sup>-mrem/y per  $\mu$ Ci/s)

The general dose equation stated in Regulatory Guide 1.109 for calculating the annual dose from consuming foods containing atmospherically released radionuclides (Equation C-13) is:

Dose(D) = Dose Conversion Factor(DFL)\*Usage Rate(U)\*Radionuclide Concentration in Media(C)

For the milk pathway, Regulatory Guide 1.109 Equations C-5 and C-10 are inserted into the above equation to yield the following:

$$D = DFL U_{ap} F_{mi} Q_f \exp(-\lambda_i t_{fm}) d_i \exp(-\lambda_i t_h) \left\{ \frac{r [1 - \exp(-\lambda_E t_e)]}{Y_p \lambda_E} + \frac{B_{iv} [1 - \exp(-\lambda_i t_b)]}{P \lambda_i} \right\} \exp(-\lambda_i t_h)$$

Since the dose equation in Sections 7.4 and 7.7.3 (Equations 7.9 and 7.14) contain the variable  $d_i$  (equal to the product of the release rate (Q) and the deposition factor (D/Q)), the factors remaining in the above equation are defined as the dose factor. For pasture grass, the variable  $t_h$  is defined as zero in Regulatory Guide 1.109, therefore that exponential term drops out of the equation. The resulting dose factor equation is:

$$R_{Cpi} = 10^6 DFL_{iaj} U_{ap} F_{mi} Q_f \exp(-\lambda_i t_{fm}) f_p \left\{ \frac{r [1 - \exp(-\lambda_E t_{ep})]}{Y_p \lambda_E} + \frac{B_{iv} [1 - \exp(-\lambda_i t_b)]}{P \lambda_i} \right\} \quad (7.19)$$

where:

$10^6$  = conversion factor, pCi/ $\mu$ Ci.

$DFL_{iaj}$  = ingestion dose conversion factor for nuclide i, age group a, organ j, mrem/pCi (Table 6.4).

$U_{ap}$  = milk ingestion rate for age group a, L/y.

$F_{mi}$  = transfer factor for nuclide i from animal's feed to milk, d/L (Table 6.2).

$Q_f$  = animal's consumption rate, kg/d.

$\lambda_i$  = decay constant for nuclide i, s<sup>-1</sup> (Table 6.2).

$t_{fm}$  = transport time from milking to receptor, s.

$f_p$  = fraction of time animal spends on pasture, dimensionless.

$r$  = fraction of activity retained on pasture grass, dimensionless.

$\lambda_E$  = the effective decay constant, due to radioactive decay and weathering, s<sup>-1</sup>.  
=  $\lambda_i + \lambda_W$ .

$\lambda_W$  = weathering decay constant for leaf and plant surfaces, s<sup>-1</sup>.

$t_{ep}$  = time pasture is exposed to deposition, s.

$Y_p$  = agricultural productivity by unit area of pasture grass, kg/m<sup>2</sup>.

$B_{iv}$  = transfer factor for nuclide i from soil to vegetation, pCi/kg (wet weight of vegetation) per pCi/kg (dry soil). (Table 6.2)

$t_b$  = time period over which accumulation on the ground is evaluated, s.

$P$  = effective surface density of soil, kg/m<sup>2</sup>.

NOTE: Factors defined above which do not reference a table for their numerical values are given in Table 6.3.

### 7.8.2 Stored Feed-Cow/Goat-Milk Ingestion Dose Factors - $R_{CSi}$

( $m^2$ -mrem/y per  $\mu Ci/s$ )

The general dose equation stated in Regulatory Guide 1.109 for calculating the annual dose from consuming foods containing atmospherically released radionuclides (Equation C-13) is:

Dose(D) = Dose Conversion Factor(DFL)\*Usage Rate(U)\*Radionuclide Concentration in Media(C)

For the milk pathway, Regulatory Guide 1.109 Equations C-5 and C-10 are inserted into the above equation to yield the following:

$$D = DFL U_{ap} F_m Q_F \exp(-\lambda t_{fm}) d_i \left\{ \frac{r [1 - \exp(-\lambda_E t_e)]}{Y_v \lambda_E} + \frac{B_{iv} [1 - \exp(-\lambda t_b)]}{P \lambda} \right\} \exp(-\lambda t_h)$$

Since the dose equation in Sections 7.4 and 7.7.3 (Equations 7.9 and 7.14) contain the variable  $d_i$  (equal to the product of the release rate (Q) and the deposition factor (D/Q)), the factors remaining in the above equation are defined as the dose factor. For stored feed, it is assumed that the milk animals will be eating the feed continuously from the time of harvest, therefore the decay term for the consumption of stored feed used is not that given in Reg. Guide 1.109 for the end of the period between harvest and consumption, but is instead an integrated decay over the period (Reference 10). The resulting dose factor is:

$$R_{CSi} = 10^6 DFL_{iaj} U_{ap} F_{mi} Q_f \exp(-\lambda_i t_{fm}) f_s \left\{ \frac{1 - \exp(-\lambda_i t_{csf})}{t_{csf} \lambda_i} \right\} \left\{ \frac{r [1 - \exp(-\lambda_E t_e)]}{Y_{sf} \lambda_E} + \frac{B_{iv} [1 - \exp(-\lambda_i t_b)]}{P \lambda_i} \right\} \quad (7.20)$$

where:

$10^6$  = conversion factor, pCi/ $\mu Ci$ .

$DFL_{iaj}$  = ingestion dose conversion factor for nuclide i, age group a, organ j, mrem/pCi (Table 6.4).

$U_{ap}$  = milk ingestion rate for age group a, L/y.

$F_{mi}$  = transfer factor for nuclide i from animal's feed to milk, d/L (Table 6.2).

$Q_f$  = animal's consumption rate, kg/d.

$f_s$  = fraction of time animal spends on stored feed, dimensionless.

$\lambda_i$  = decay constant for nuclide i,  $s^{-1}$  (Table 6.2).

$t_{fm}$  = transport time from milking to receptor, s.

$t_{csf}$  = time between harvest of stored feed and consumption by animal, s.

$r$  = fraction of activity retained on pasture grass, dimensionless.

$\lambda_E$  = the effective decay constant, due to radioactive decay and weathering,  $s^{-1}$   
=  $\lambda_i + \lambda_W$ .

$\lambda_W$  = weathering decay constant for leaf and plant surfaces,  $s^{-1}$ .

$t_e$  = time stored feed is exposed to deposition, s.

$Y_{sf}$  = agricultural productivity by unit area of stored feed,  $kg/m^2$ .

$B_{iv}$  = transfer factor for nuclide i from soil to vegetation, pCi/kg (wet weight of vegetation) per pCi/kg (dry soil). (Table 6.2)

$t_b$  = time period over which accumulation on the ground is evaluated, s.

$P$  = effective surface density of soil,  $kg/m^2$ .

NOTE: Factors defined above which do not reference a table for their numerical values are given in Table 6.3.

### 7.8.3 Pasture Grass-Beef Ingestion Dose Factors - $R_{MPi}$

(m<sup>2</sup>-mrem/y per  $\mu$ Ci/s)

The general dose equation stated in Regulatory Guide 1.109 for calculating the annual dose from consuming foods containing atmospherically released radionuclides (Equation C-13) is:

Dose(D) = Dose Conversion Factor(DFL)\*Usage Rate(U)\*Radionuclide Concentration in Media(C)

For the beef pathway, Regulatory Guide 1.109 Equations C-5 and C-12 are inserted into the above equation to yield the following:

$$D = DFL U_{ap} F_f Q_F \exp(-\lambda t_s) d_i \left\{ \frac{r [1 - \exp(-\lambda_E t_e)]}{Y_V \lambda_E} + \frac{B_{iv} [1 - \exp(-\lambda t_b)]}{P \lambda} \right\} \exp(-\lambda t_h)$$

Since the dose equation in Sections 7.4 and 7.7.3 (Equations 7.9 and 7.14) contain the variable  $d_i$  (equal to the product of the release rate (Q) and the deposition factor (D/Q)), the factors remaining in the above equation are defined as the dose factor. In addition, a factor is added to account for the decay during the time the beef is being consumed. This term assumes that the individual slaughters and eats the animal over a period of time ( $t_{cb}$ ) (Reference 10). For pasture grass, the variable  $t_h$  is defined as zero in Regulatory Guide 1.109, therefore that exponential term drops out of the equation. The resulting dose factor is:

$$R_{MPi} = 10^6 DFL_{iaj} U_{am} F_{fi} Q_f \left\{ \frac{[1 - \exp(-\lambda_i t_{cb})]}{\lambda_i t_{cb}} \right\} \exp(-\lambda_i t_s) f_p \left\{ \frac{r [1 - \exp(-\lambda_E t_{ep})]}{Y_p \lambda_E} + \frac{B_{iv} [1 - \exp(-\lambda_i t_b)]}{P \lambda_i} \right\} \quad (7.21)$$

where:

$10^6$  = conversion factor, pCi/ $\mu$ Ci.

$DFL_{iaj}$  = ingestion dose conversion factor for nuclide i, age group a, organ j, mrem/pCi (Table 6.4).

$U_{am}$  = beef ingestion rate for age group a, kg/y.

$F_{fi}$  = transfer factor for nuclide i from cow's feed to beef, d/kg (Table 6.2).

$Q_f$  = cow's consumption rate, kg/d.

$\lambda_i$  = decay constant for nuclide i, s<sup>-1</sup> (Table 6.2).

$t_{cb}$  = time for receptor to consume a whole beef, s.

$t_s$  = transport time from slaughter to consumer, s.

$f_p$  = fraction of time cow spends on pasture, dimensionless.

$r$  = fraction of activity retained on pasture grass, dimensionless.

$\lambda_E$  = the effective decay constant, due to radioactive decay and weathering, s<sup>-1</sup>, equal to  $\lambda_i + \lambda_W$ .

$\lambda_W$  = weathering decay constant for leaf and plant surfaces, s<sup>-1</sup>.

$t_{ep}$  = time pasture is exposed to deposition, s.

$Y_p$  = agricultural productivity by unit area of pasture grass, kg/m<sup>2</sup>.

$B_{iv}$  = transfer factor for nuclide i from soil to vegetation, pCi/kg (wet weight of vegetation) per pCi/kg (dry soil). (Table 6.2)

$t_b$  = time over which accumulation on the ground is evaluated, s.

$P$  = effective surface density of soil, kg/m<sup>2</sup>.

NOTE: Factors defined above which do not reference a table for their numerical values are given in Table 6.3.

#### 7.8.4 Stored Feed-Beef Ingestion Dose Factors - $R_{MSi}$

(m<sup>2</sup>-mrem/y per  $\mu$ Ci/s)

The general dose equation stated in Regulatory Guide 1.109 for calculating the annual dose from consuming foods containing atmospherically released radionuclides (Equation C-13) is:

Dose(D) = Dose Conversion Factor(DFL)\*Usage Rate(U)\*Radionuclide Concentration in Media(C)

For the beef pathway, Regulatory Guide 1.109 Equations C-5 and C-12 are inserted into the above equation to yield the following:

$$D = \text{DFL } U_{\text{ap}} F_{\text{f}} Q_{\text{f}} \exp(-\lambda t_{\text{s}}) d_{\text{i}} \left\{ \frac{r [1 - \exp(-\lambda_{\text{E}} t_{\text{e}})]}{Y_{\text{f}} \lambda_{\text{E}}} + \frac{B_{\text{iv}} [1 - \exp(-\lambda t_{\text{b}})]}{P \lambda} \right\} \exp(-\lambda t_{\text{h}})$$

Since the dose equation in Sections 7.4 and 7.7.3 (Equations 7.9 and 7.14) contain the variable  $d_{\text{i}}$  (equal to the product of the release rate (Q) and the deposition factor (D/Q)), the factors remaining in the above equation are defined as the dose factor. In addition, factors are added to account for the decay during the time the animals are consuming the stored feed ( $t_{\text{csf}}$ ) and during the time period of over which the beef is being consumed ( $t_{\text{cb}}$ ) (Reference 10). The resulting dose factor is:

$$R_{MSi} = 10^6 \text{DFL}_{\text{iaj}} U_{\text{am}} F_{\text{fi}} Q_{\text{f}} \left\{ \frac{[1 - \exp(-\lambda_i t_{\text{cb}})]}{\lambda_i t_{\text{cb}}} \right\} \exp(-\lambda_i t_{\text{s}}) f_{\text{s}} \left\{ \frac{[1 - \exp(-\lambda_i t_{\text{csf}})]}{\lambda_i t_{\text{csf}}} \right\} \left\{ \frac{r [1 - \exp(-\lambda_{\text{E}} t_{\text{e}})]}{Y_{\text{sf}} \lambda_{\text{E}}} + \frac{B_{\text{iv}} [1 - \exp(-\lambda_i t_{\text{b}})]}{P \lambda_i} \right\} \quad (7.22)$$

where:

$10^6$  = conversion factor, pCi/ $\mu$ Ci.

$\text{DFL}_{\text{iaj}}$  = ingestion dose conversion factor for nuclide i, age group a, organ j, mrem/pCi (Table 6.4).

$U_{\text{am}}$  = beef ingestion rate for age group a, kg/y.

$F_{\text{fi}}$  = transfer factor for nuclide i from cow's feed to beef, d/kg (Table 6.2).

$Q_{\text{f}}$  = cow's consumption rate, kg/d.

$\lambda_i$  = decay constant for nuclide i, s<sup>-1</sup> (Table 6.2).

$t_{\text{cb}}$  = time for receptor to consume a whole beef, s.

$t_{\text{s}}$  = transport time from slaughter to consumer, s.

$f_{\text{s}}$  = fraction of time cow spends on stored feed, dimensionless.

$t_{\text{csf}}$  = time between harvest of stored feed and consumption by cow, s.

$r$  = fraction of activity retained on pasture grass, dimensionless.

$t_{\text{e}}$  = time stored feed is exposed to deposition, s.

$Y_{\text{sf}}$  = agricultural productivity by unit area of stored feed, kg/m<sup>2</sup>.

$\lambda_{\text{E}}$  = the effective decay constant, due to radioactive decay and weathering, s<sup>-1</sup>,  
=  $\lambda_i + \lambda_{\text{W}}$ .

$\lambda_{\text{W}}$  = weathering decay constant for leaf and plant surfaces, s<sup>-1</sup>.

$B_{\text{iv}}$  = transfer factor for nuclide i from soil to vegetation, pCi/kg (wet weight of vegetation) per pCi/kg (dry soil). (Table 6.2)

$t_{\text{b}}$  = time over which accumulation on the ground is evaluated, s.

$P$  = effective surface density of soil, kg/m<sup>2</sup>.

NOTE: Factors defined above which do not reference a table for their numerical values are given in Table 6.3.

### 7.8.5 Fresh Leafy Vegetable Ingestion Dose Factors - $R_{VFi}$

(m<sup>2</sup>-mrem/y per  $\mu\text{Ci/s}$ )

The general dose equation stated in Regulatory Guide 1.109 for calculating the annual dose from consuming foods containing atmospherically released radionuclides (Equation C-13) is:

Dose(D) = Dose Conversion Factor(DFL)\*Usage Rate(U)\*Radionuclide Concentration in Media(C)

For the vegetable pathway, Regulatory Guide 1.109 Equation C-5 is inserted into the above equation to yield the following:

$$D = \text{DFL} \text{UFL}_a d_i \left\{ \frac{r [1 - \exp(-\lambda_E t_e)]}{Y_v \lambda_E} + \frac{B_{iv} [1 - \exp(-\lambda t_b)]}{P \lambda} \right\} \exp(-\lambda t_{hc})$$

Since the dose equation in Sections 7.4 and 7.7.3 (Equations 7.9 and 7.14) contain the variable  $d_i$  (equal to the product of the release rate (Q) and the deposition factor (D/Q)), the factors remaining in the above equation are defined as the dose factor. Thus, the dose factor is:

$$R_{VFi} = 10^6 \text{DFL}_{iaj} \exp(-\lambda_i t_{hc}) \text{U}_{FLa} F_L \left\{ \frac{r [1 - \exp(-\lambda_E t_e)]}{Y_f \lambda_E} + \frac{B_{iv} [1 - \exp(-\lambda_i t_b)]}{P \lambda_i} \right\} \quad (7.23)$$

where:

$10^6$  = conversion factor, pCi/ $\mu\text{Ci}$ .

$\text{DFL}_{iaj}$  = ingestion dose conversion factor for nuclide i, age group a, organ j, mrem/pCi (Table 6.4).

$\lambda_i$  = decay constant for nuclide i, s<sup>-1</sup> (Table 6.2).

$t_{hc}$  = average time between harvest of vegetables and their consumption and/or storage, s.

$\text{UFL}_a$  = consumption rate of fresh leafy vegetables by the receptor in age group a, kg/y.

$f_L$  = fraction of fresh leafy vegetables grown locally, dimensionless.

$r$  = fraction of deposited activity retained on vegetables, dimensionless.

$\lambda_E$  = the effective decay constant, due to radioactive decay and weathering, s<sup>-1</sup>.  
=  $\lambda_i + \lambda_W$

$\lambda_W$  = decay constant for removal of activity on leaf and plant surfaces by weathering, s<sup>-1</sup>.

$t_e$  = exposure time in garden for fresh leafy and/or stored vegetables, s.

$Y_f$  = agricultural yield for fresh leafy vegetables, kg/m<sup>2</sup>.

$B_{iv}$  = transfer factor for nuclide i from soil to vegetables, pCi/kg (wet weight of vegetation) per pCi/kg (dry soil). (Table 6.2)

$t_b$  = time period over which accumulation on the ground is evaluated, s.

$P$  = effective surface density of soil, kg/m<sup>2</sup>.

NOTE: Factors defined above which do not reference a table for their numerical values are given in Table 6.3.

### 7.8.6 Stored Vegetable Ingestion Dose Factors - $R_{VSi}$

$m^2\text{-mrem/y per } \mu\text{Ci/s}$

The general dose equation stated in Regulatory Guide 1.109 for calculating the annual dose from consuming foods containing atmospherically released radionuclides (Equation C-13) is:

Dose(D) = Dose Conversion Factor(DFL)\*Usage Rate(U)\*Radionuclide Concentration in Media(C)

For the vegetable pathway, Regulatory Guide 1.109 Equation C-5 is inserted into the above equation to yield the following:

$$D = \text{DFL} \text{UFL}_a d_i \left\{ \frac{r [1 - \exp(-\lambda_E t_e)]}{Y_V \lambda_E} + \frac{B_{iv} [1 - \exp(-\lambda t_b)]}{P \lambda} \right\} \exp(-\lambda t_{hc})$$

Since the dose equation in Sections 7.4 and 7.7.3 (Equations 7.9 and 7.14) contain the variable  $d_i$  (equal to the product of the release rate (Q) and the deposition factor (D/Q)), the factors remaining in the above equation are defined as the dose factor. One additional decay term is added to account for the decay during the period of time after harvest during which the food is consumed ( $t_{sv}$ ); this term assumes that the stored vegetables are eaten throughout the storage period (Reference 10). Thus, the dose factor is:

$$R_{VSi} = 10^6 \text{DFL}_{iaj} \exp(-\lambda_i t_{hc}) U_{Sa} f_g \left\{ \frac{[1 - \exp(-\lambda_i t_{sv})]}{\lambda_i t_{sv}} \right\} \left\{ \frac{r [1 - \exp(-\lambda_E t_e)]}{Y_{sv} \lambda_E} + \frac{B_{iv} [1 - \exp(-\lambda_i t_b)]}{P \lambda_i} \right\} \quad (7.24)$$

where:

$10^6$  = conversion factor,  $\text{pCi}/\mu\text{Ci}$ .

$\text{DFL}_{iaj}$  = ingestion dose conversion factor for nuclide i, age group a, organ j,  $\text{mrem/pCi}$  (Table 6.4).

$\lambda_i$  = decay constant for nuclide i,  $\text{s}^{-1}$  (Table 6.2).

$t_{hc}$  = average time between harvest of vegetables and their consumption and/or storage, s.

$U_{Sa}$  = consumption rate of stored vegetables by the receptor in age group a,  $\text{kg/y}$ .

$f_g$  = fraction of stored vegetables grown locally, dimensionless.

$t_{sv}$  = time between storage of vegetables and their consumption, s.

$r$  = fraction of deposited activity retained on vegetables, dimensionless.

$\lambda_E$  = the effective decay constant, due to radioactive decay and weathering,  $\text{s}^{-1}$ .  
=  $\lambda_i + \lambda_W$

$\lambda_W$  = decay constant for removal of activity on leaf and plant surfaces by weathering,  $\text{s}^{-1}$ .

$t_e$  = exposure time in garden for fresh leafy and/or stored vegetables, s.

$Y_{sv}$  = agricultural yield for stored vegetables,  $\text{kg/m}^2$ .

$B_{iv}$  = transfer factor for nuclide i from soil to vegetables,  $\text{pCi/kg}$  (wet weight of vegetation) per  $\text{pCi/kg}$  (dry soil). (Table 6.2)

$t_b$  = time period over which accumulation on the ground is evaluated, s.

$P$  = effective surface density of soil,  $\text{kg/m}^2$ .

NOTE: Factors defined above which do not reference a table for their numerical values are given in Table 6.3.

### 7.8.7 Tritium-Pasture Grass-Cow/Goat-Milk Dose Factor - $R_{CPT}$ (mrem/y per $\mu\text{Ci}/\text{m}^3$ )

The general dose equation stated in Regulatory Guide 1.109 for calculating the annual dose from consuming foods containing atmospherically released radionuclides (Equation C-13) is:

Dose(D) = Dose Conversion Factor(DFL)\*Usage Rate(U)\*Radionuclide Concentration in Media(C)

For the milk pathway, Regulatory Guide 1.109 Equations C-9 and C-10 are inserted into the above equation to yield the following:

$$D = \text{DFL} U_{\text{ap}} F_{\text{mT}} Q_{\text{f}} \exp(-\lambda t_{\text{fm}}) Q_{\text{T}} \frac{\chi}{Q} \left[ 0.75 \left( \frac{0.5}{H} \right) \right]$$

Since the dose equation in Sections 7.4 and 7.7.3 (Equations 7.9 and 7.14) contain the variables for the release rate (Q) and the dispersion factor ( $\chi/Q$ ), the factors remaining in the above equation are defined as the dose factor. The resulting dose factor equation is:

$$R_{CPT} = 10^3 10^6 \text{DFL}_{\text{Taj}} F_{\text{mT}} Q_{\text{f}} U_{\text{ap}} \left[ 0.75 \left( \frac{0.5}{H} \right) \right] f_{\text{p}} \exp(-\lambda_{\text{T}} t_{\text{fm}}) \quad (7.25)$$

where:

$10^3$  = conversion factor, g/kg.

$10^6$  = conversion factor, pCi/ $\mu\text{Ci}$ .

$\text{DFL}_{\text{Taj}}$  = ingestion dose conversion factor for tritium for age group a, organ j, mrem/pCi (Table 6.4).

$F_{\text{mT}}$  = transfer factor for tritium from animal's feed to milk, d/L (Table 6.2).

$Q_{\text{f}}$  = animal's consumption rate, kg/d.

$U_{\text{ap}}$  = milk ingestion rate for age group a, L/y.

0.75 = the fraction of total feed that is water.

0.5 = the ratio of the specific activity of the feed grass water to the atmospheric water.

H = absolute humidity of the atmosphere, g/ $\text{m}^3$ .

$f_{\text{p}}$  = fraction of time animal spends on pasture, dimensionless.

$\lambda_{\text{T}}$  = decay constant for tritium,  $\text{s}^{-1}$  (Table 6.2).

$t_{\text{fm}}$  = transport time from milking to receptor, s.

### 7.8.8 Tritium-Stored Feed-Cow/Goat-Milk Dose Factor - $R_{CST}$ (mrem/y per $\mu\text{Ci}/\text{m}^3$ )

The general dose equation stated in Regulatory Guide 1.109 for calculating the annual dose from consuming foods containing atmospherically released radionuclides (Equation C-13) is:

$$\text{Dose}(D) = \text{Dose Conversion Factor}(\text{DFL}) * \text{Usage Rate}(U) * \text{Radionuclide Concentration in Media}(C)$$

For the milk pathway, Regulatory Guide 1.109 Equations C-9 and C-10 are inserted into the above equation to yield the following:

$$D = \text{DFL} U_{\text{ap}} F_{\text{m}} Q_{\text{f}} \exp(-\lambda t_{\text{fm}}) Q_{\text{T}} \frac{\chi}{Q} \left[ 0.75 \left( \frac{0.5}{H} \right) \right]$$

Since the dose equation in Sections 7.4 and 7.7.3 (Equations 7.9 and 7.14) contain the variables for the release rate (Q) and the dispersion factor ( $\chi/Q$ ), the factors remaining in the above equation are defined as the dose factor. In addition, a factor is added to account for the decay during the time the animals are consuming the stored feed (Reference 10). The resulting dose factor is:

$$R_{CST} = 10^3 10^6 \text{DFL}_{\text{Taj}} F_{\text{IT}} Q_{\text{f}} U_{\text{ap}} \left[ 0.75 \left( \frac{0.5}{H} \right) \right] f_{\text{s}} \exp(-\lambda_{\text{T}} t_{\text{fm}}) \left\{ \frac{[1 - \exp(-\lambda_{\text{T}} t_{\text{csf}})]}{\lambda_{\text{T}} t_{\text{csf}}} \right\} \quad (7.26)$$

where:

- $10^3$  = conversion factor, g/kg.
- $10^6$  = conversion factor, pCi/ $\mu\text{Ci}$ .
- $\text{DFL}_{\text{Taj}}$  = ingestion dose conversion factor for H-3 for age group a, organ j, mrem/pCi (Table 6.4).
- $F_{\text{IT}}$  = transfer factor for H-3 from cow's feed to beef, d/kg (Table 6.2).
- $Q_{\text{f}}$  = cow's consumption rate, kg/d.
- $U_{\text{ap}}$  = milk ingestion rate for age group a, L/y.
- 0.75 = the fraction of total feed that is water.
- 0.5 = the ratio of the specific activity of the feed grass water to the atmospheric water.
- H = absolute humidity of the atmosphere, g/ $\text{m}^3$ .
- $f_{\text{s}}$  = fraction of time cow spends on stored feed, dimensionless.
- $\lambda_{\text{T}}$  = decay constant for tritium,  $\text{s}^{-1}$  (Table 6.2).
- $t_{\text{fm}}$  = transport time from milking to receptor, s.
- $t_{\text{csf}}$  = time to consume stored feed, s.

NOTE: Factors defined above which do not reference a table for their numerical values are given in Table 6.3.

### 7.8.9 Tritium-Pasture Grass-Beef Dose Factor - $R_{MPT}$

(mrem/y per  $\mu\text{Ci}/\text{m}^3$ )

The general dose equation stated in Regulatory Guide 1.109 for calculating the annual dose from consuming foods containing atmospherically released radionuclides Equation C-13) is:

Dose(D) = Dose Conversion Factor(DFL)\*Usage Rate(U)\*Radionuclide Concentration in Media(C)

For the beef pathway, Regulatory Guide 1.109 Equations C-9 and C-10 are inserted into the above equation to yield the following:

$$D = \text{DFL} U_{\text{ap}} F_{\text{f}} Q_{\text{f}} \exp(-\lambda t_{\text{s}}) Q_{\text{T}} \frac{\chi}{Q} \left[ 0.75 \left( \frac{0.5}{H} \right) \right]$$

Since the dose equation in Sections 7.4 and 7.7.3 (Equations 7.9 and 7.14) contain the variables for the release rate (Q) and the dispersion factor ( $\chi/Q$ ), the factors remaining in the above equation are defined as the dose factor. Two decay terms are added to the equation to account for the decay during the time the pasture is exposed to the activity in the air, and the decay during the time the beef is being consumed (Reference 10). The resulting dose factor is:

$$R_{MPT} = 10^3 10^6 \text{DFL}_{\text{Taj}} F_{\text{fT}} Q_{\text{f}} U_{\text{am}} \left[ 0.75 \left( \frac{0.5}{H} \right) \right] f_{\text{p}} \exp(-\lambda_{\text{T}} t_{\text{s}}) \left\{ \frac{[1 - \exp(-\lambda_{\text{T}} t_{\text{ep}})]}{\lambda_{\text{T}} t_{\text{ep}}} \right\} \left\{ \frac{[1 - \exp(-\lambda_{\text{T}} t_{\text{cb}})]}{\lambda_{\text{T}} t_{\text{cb}}} \right\} \quad (7.27)$$

where:

$10^3$  = conversion factor, g/kg.

$10^6$  = conversion factor, pCi/ $\mu\text{Ci}$ .

$\text{DFL}_{\text{Taj}}$  = ingestion dose conversion factor for H-3 for age group a, organ j, mrem/pCi (Table 6.4).

$F_{\text{fT}}$  = transfer factor for H-3 from cow's feed to beef, d/kg (Table 6.2).

$Q_{\text{f}}$  = cow's consumption rate, kg/d.

$U_{\text{am}}$  = beef ingestion rate for age group a, kg/y.

0.75 = the fraction of total feed that is water.

0.5 = the ratio of the specific activity of the feed grass water to the atmospheric water.

H = absolute humidity of the atmosphere, g/m<sup>3</sup>.

$f_{\text{p}}$  = fraction of time cow spends on pasture, dimensionless.

$\lambda_{\text{T}}$  = decay constant for tritium, s<sup>-1</sup> (Table 6.2).

$t_{\text{s}}$  = transport time from slaughter to consumer, s.

$t_{\text{ep}}$  = time pasture is exposed to deposition, s.

$t_{\text{cb}}$  = time for receptor to consume a whole beef, s.

### 7.8.10 Tritium-Stored Feed-Beef Dose Factor - $R_{MST}$ (mrem/y per $\mu\text{Ci}/\text{m}^3$ )

The general dose equation stated in Regulatory Guide 1.109 for calculating the annual dose from consuming foods containing atmospherically released radionuclides (Equation C-13) is:

$$\text{Dose}(D) = \text{Dose Conversion Factor}(\text{DFL}) * \text{Usage Rate}(U) * \text{Radionuclide Concentration in Media}(C)$$

For the beef pathway, Regulatory Guide 1.109 Equations C-9 and C-10 are inserted into the above equation to yield the following:

$$D = \text{DFL} U_{\text{am}} F_f Q_f \exp(-\lambda t_s) Q_T \frac{\chi}{Q} \left[ 0.75 \left( \frac{0.5}{H} \right) \right]$$

Since the dose equation in Sections 7.4 and 7.7.3 (Equations 7.9 and 7.14) contain the variables for the release rate ( $Q$ ) and the dispersion factor ( $\chi/Q$ ), the factors remaining in the above equation are defined as the dose factor. Two decay terms are added to the equation to account for the decay during the time the pasture is exposed to the activity in the air, and the decay during the time the beef is being consumed (Reference 10). The resulting dose factor is:

$$R_{MST} = 10^3 10^6 \text{DFL}_{\text{Taj}} F_{\text{fT}} Q_f U_{\text{am}} \left[ 0.75 \left( \frac{0.5}{H} \right) \right] f_s \exp(-\lambda_T t_s) \left\{ \frac{[1 - \exp(-\lambda_T t_{\text{csf}})]}{\lambda_T t_{\text{csf}}} \right\} \left\{ \frac{[1 - \exp(-\lambda_T t_{\text{cb}})]}{\lambda_T t_{\text{cb}}} \right\} \quad (7.28)$$

where:

$10^3$  = conversion factor, g/kg.

$10^6$  = conversion factor, pCi/ $\mu\text{Ci}$ .

$\text{DFL}_{\text{Taj}}$  = ingestion dose conversion factor for H-3 for age group a, organ j, mrem/pCi (Table 6.4).

$F_{\text{fT}}$  = transfer factor for H-3 from cow's feed to beef, d/kg (Table 6.2).

$Q_f$  = cow's consumption rate, kg/d.

$U_{\text{am}}$  = beef ingestion rate for age group a, kg/y.

0.75 = the fraction of total feed that is water.

0.5 = the ratio of the specific activity of the feed grass water to the atmospheric water.

$H$  = absolute humidity of the atmosphere, g/ $\text{m}^3$ .

$f_s$  = fraction of time cow spends on stored feed, dimensionless.

$\lambda_T$  = decay constant for tritium,  $\text{s}^{-1}$  (Table 6.2).

$t_s$  = transport time from slaughter to consumer, s.

$t_{\text{csf}}$  = time to consume stored feed, s.

$t_{\text{cb}}$  = time for receptor to consume a whole beef, s.

NOTE: Factors defined above which do not reference a table for their numerical values are given in Table 6.3.

### 7.8.11 Tritium-Fresh Leafy Vegetable Dose Factor - $R_{VFT}$ (mrem/y per $\mu\text{Ci}/\text{m}^3$ )

The general dose equation stated in Regulatory Guide 1.109 for calculating the annual dose from consuming foods containing atmospherically released radionuclides (Equation C-13) is:

$$\text{Dose}(D) = \text{Dose Conversion Factor}(\text{DFL}) * \text{Usage Rate}(U) * \text{Radionuclide Concentration in Media}(C)$$

For the vegetable pathway, Regulatory Guide 1.109 Equation C-9 is inserted into the above equation to yield the following:

$$D = \text{DFL} U_{\text{ap}} \exp(-\lambda t_{\text{hc}}) Q_T \frac{\chi}{Q} \left[ 0.75 \left( \frac{0.5}{H} \right) \right]$$

Since the dose equation in Sections 7.4 and 7.7.3 (Equations 7.9 and 7.14) contain the variables for the release rate (Q) and the dispersion factor ( $\chi/Q$ ), the factors remaining in the above equation are defined as the dose factor. The resulting dose factor is:

$$R_{VFT} = 10^3 10^6 \text{DFL}_{\text{Taj}} \left[ 0.75 \left( \frac{0.5}{H} \right) \right] U_{\text{FLa}} f_L \exp(-\lambda_T t_{\text{hc}}) \quad (7.29)$$

where:

$10^3$  = conversion factor, g/kg.

$10^6$  = conversion factor, pCi/ $\mu\text{Ci}$ .

$\text{DFL}_{\text{Taj}}$  = ingestion dose conversion factor for tritium for age group a, organ j, mrem/pCi (Table 6.4).

0.75 = the fraction of total vegetation that is water.

0.5 = the ratio of the specific activity of the vegetables water to the atmospheric water.

H = absolute humidity of the atmosphere, g/ $\text{m}^3$ .

$U_{\text{FLa}}$  = consumption rate of fresh leafy vegetables by the receptor in age group a, kg/y.

$f_L$  = fraction of fresh leafy vegetables grown locally, dimensionless.

$\lambda_T$  = decay constant for tritium,  $\text{s}^{-1}$  (Table 6.2).

$t_{\text{hc}}$  = time between harvest of vegetables and their consumption and/or storage, s.

NOTE: Factors defined above which do not reference a table for their numerical values are given in Table 6.3.

### 7.8.12 Tritium-Stored Vegetable Dose Factor - $R_{VST}$ (mrem/y per $\mu\text{Ci}/\text{m}^3$ )

The general dose equation stated in Regulatory Guide 1.109 for calculating the annual dose from consuming foods containing atmospherically released radionuclides (Equation C-13) is:

$$\text{Dose}(D) = \text{Dose Conversion Factor}(\text{DFL}) * \text{Usage Rate}(U) * \text{Radionuclide Concentration in Media}(C)$$

For the vegetable pathway, Regulatory Guide 1.109 Equation C-9 is inserted into the above equation to yield the following:

$$D = \text{DFL} U_{\text{ap}} \exp(-\lambda t_{\text{hc}}) Q_T \frac{\chi}{Q} \left[ 0.75 \left( \frac{0.5}{H} \right) \right]$$

Since the dose equation in Sections 7.4 and 7.7.3 (Equations 7.9 and 7.14) contain the variables for the release rate (Q) and the dispersion factor ( $\chi/Q$ ), the factors remaining in the above equation are defined as the dose factor. An additional decay term is added to account for the decay during the time the vegetables are stored (this term assumes that the vegetables are being eaten during the storage period) (Reference 10). The resulting dose factor is:

$$R_{VST} = 10^3 10^6 \text{DFL}_{\text{Taj}} \left[ 0.75 \left( \frac{0.5}{H} \right) \right] U_{\text{Sa}} f_g \left\{ \frac{[1 - \exp(-\lambda_T t_{\text{sv}})]}{\lambda_T t_{\text{sv}}} \right\} \exp(-\lambda_T t_{\text{hc}}) \quad (7.30)$$

where:

$10^3$  = conversion factor, g/kg.

$10^6$  = conversion factor, pCi/ $\mu\text{Ci}$ .

$\text{DFL}_{\text{Taj}}$  = ingestion dose conversion factor for tritium for age group a, organ j, mrem/pCi (Table 6.4).

0.75 = the fraction of total vegetation that is water.

0.5 = the ratio of the specific activity of the vegetation water to the atmospheric water.

H = absolute humidity of the atmosphere, g/ $\text{m}^3$ .

$U_{\text{Sa}}$  = consumption rate of stored vegetables by the receptor in age group a, kg/y.

$f_g$  = fraction of stored vegetables grown locally, dimensionless.

$\lambda_T$  = decay constant for tritium,  $\text{s}^{-1}$  (Table 6.2).

$t_{\text{sv}}$  = time between harvest of stored vegetables and their consumption and/or storage, s.

$t_{\text{hc}}$  = time between harvest of vegetables and their storage, s.

**7.8.13 Inhalation Dose Factors -  $R_{ii}$** (mrem/y per  $\mu\text{Ci}/\text{m}^3$ )

The inhalation dose factors are calculated using the equation provided in NUREG-0133, Section 5.3.1.1.

$$R_{ii} = 10^6 \text{ DFA}_{iaj} \text{ BR}_a \quad (7.31)$$

where:

$10^6$  = conversion factor,  $\text{pCi}/\mu\text{Ci}$ .

$\text{DFA}_{iaj}$  = inhalation dose conversion factor for nuclide i, age group a and organ j, mrem/pCi (Table 7.7).

$\text{BR}_a$  = breathing rate for age group a,  $\text{m}^3/\text{y}$  (Table 6.3).

**7.8.14 Ground Plane Dose Factors -  $R_{Gi}$**  $(\text{m}^2\text{-mrem}/\text{y per } \mu\text{Ci}/\text{s})$ 

The ground plane dose factors are calculated using the equation provided in NUREG-0133, Section 5.3.1.2. The shielding factor in that equation is conservatively assumed to be 1.0.

$$R_{Gi} = 10^6 \text{ 8760 DFG}_{ij} \frac{1}{\lambda_i} [1 - \exp(-\lambda_i t_b)] \quad (7.32)$$

where:

$10^6$  = conversion factor,  $\text{pCi}/\mu\text{Ci}$ .

8760 = conversion factor, h/y.

$\text{DFG}_{ij}$  = dose conversion factor for standing on contaminated ground for nuclide i and organ j (total body and skin), mrem/h per  $\text{pCi}/\text{m}^2$  (Table 6.6).

$\lambda_i$  = decay constant of nuclide i,  $\text{s}^{-1}$  (Table 6.2).

$t_b$  = time period over which the ground accumulation is evaluated, s (Table 6.3).

**7.8.15 C-14-Pasture Grass-Cow/Goat-Milk Dose Factor -  $R_{CPC14}$**   
(mrem/y per  $\mu\text{Ci}/\text{m}^3$ )

The general dose equation stated in Regulatory Guide 1.109 for calculating the annual dose from consuming foods containing atmospherically released radionuclides (Equation C-13) is:

$$\text{Dose}(D) = \text{Dose Conversion Factor}(\text{DFL}) * \text{Usage Rate}(U) * \text{Radionuclide Concentration in Media}(C)$$

For the milk pathway, Regulatory Guide 1.109 Equations C-8 and C-10 are inserted into the above equation to yield the following:

$$D = \text{DFL} U_{\text{ap}} F_{\text{m}} Q_{\text{f}} \exp(-\lambda t_{\text{fm}}) Q_{\text{C14}} \frac{\chi}{Q} \left( \frac{0.11}{0.16} \right)$$

Since the dose equation in Sections 7.4 and 7.7.3 (Equations 7.9 and 7.14) contain the variables for the release rate (Q) and the dispersion factor ( $\chi/Q$ ), the factors remaining in the above equation are defined as the dose factor. The resulting dose factor equation is:

$$R_{CPC14} = 10^3 10^6 \text{DFL}_{\text{C14aj}} F_{\text{mC14}} Q_{\text{f}} U_{\text{ap}} \left( \frac{0.11}{0.16} \right) f_{\text{p}} \exp(-\lambda_{\text{C14}} t_{\text{fm}}) \quad (7.33)$$

where:

- $10^3$  = conversion factor, g/kg.
- $10^6$  = conversion factor, pCi/ $\mu\text{Ci}$ .
- $\text{DFL}_{\text{C14aj}}$  = ingestion dose conversion factor for carbon 14 for age group a, organ j, mrem/pCi (Table 6.4).
- $F_{\text{mC14}}$  = transfer factor for carbon 14 from animal's feed to milk, d/L (Table 6.2).
- $Q_{\text{f}}$  = animal's consumption rate, kg/d.
- $U_{\text{ap}}$  = milk ingestion rate for age group a, L/y.
- 0.11 = the fraction of total plant mass that is natural carbon, dimensionless.
- 0.16 = is equal to the concentration of natural carbon in the atmosphere, in  $\text{g}/\text{m}^3$ .
- $f_{\text{p}}$  = fraction of time animal spends on pasture, dimensionless.
- $\lambda_{\text{C14}}$  = decay constant for carbon 14,  $\text{s}^{-1}$  (Table 6.2).
- $t_{\text{fm}}$  = transport time from milking to receptor, s.

NOTE: Factors defined above which do not reference a table for their numerical values, are listed in Table 6.3.

**7.8.16 C-14-Stored Feed-Cow/Goat-Milk Dose Factor -  $R_{CSC14}$**   
(mrem/y per  $\mu\text{Ci}/\text{m}^3$ )

The general dose equation stated in Regulatory Guide 1.109 for calculating the annual dose from consuming foods containing atmospherically released radionuclides (Equation C-13) is:

$$\text{Dose}(D) = \text{Dose Conversion Factor}(\text{DFL}) * \text{Usage Rate}(U) * \text{Radionuclide Concentration in Media}(C)$$

For the milk pathway, Regulatory Guide 1.109 Equations C-8 and C-10 are inserted into the above equation to yield the following:

$$D = \text{DFL} U_{\text{ap}} F_{\text{m}} Q_{\text{f}} \exp(-\lambda t_{\text{fm}}) Q_{\text{C14}} \frac{\chi}{Q} \left( \frac{0.11}{0.16} \right)$$

Since the dose equation in Sections 7.4 and 7.7.3 (Equations 7.9 and 7.14) contain the variables for the release rate (Q) and the dispersion factor ( $\chi/Q$ ), the factors remaining in the above equation are defined as the dose factor. In addition, a factor is added to account for the decay during the time the animals are consuming the stored feed (Reference 10). The resulting dose factor equation is:

$$R_{CST} = 10^3 10^6 \text{DFL}_{\text{C14aj}} F_{\text{mC14}} Q_{\text{f}} U_{\text{am}} \left( \frac{0.11}{0.16} \right) f_{\text{s}} \exp(-\lambda_{\text{C14}} t_{\text{fm}}) \left\{ \frac{[1 - \exp(-\lambda_{\text{C14}} t_{\text{csf}})]}{\lambda_{\text{C14}} t_{\text{csf}}} \right\} \quad (7.34)$$

where:

- $10^3$  = conversion factor, g/kg.
- $10^6$  = conversion factor, pCi/ $\mu\text{Ci}$ .
- $\text{DFL}_{\text{C14aj}}$  = ingestion dose conversion factor for carbon 14 for age group a, organ j, mrem/pCi (Table 6.4).
- $F_{\text{mC14}}$  = transfer factor for carbon 14 from cow's feed to milk, d/L (Table 6.2).
- $Q_{\text{f}}$  = animal's consumption rate, kg/d.
- $U_{\text{ap}}$  = milk ingestion rate for age group a, L/y.
- 0.11 = the fraction of total plant mass that is natural carbon, dimensionless.
- 0.16 = is equal to the concentration of natural carbon in the atmosphere, in  $\text{g}/\text{m}^3$ .
- $f_{\text{s}}$  = fraction of time animal spends on stored feed, dimensionless.
- $\lambda_{\text{C14}}$  = decay constant for carbon 14,  $\text{s}^{-1}$  (Table 6.2).
- $t_{\text{csf}}$  = time between harvest of stored feed and consumption by animal, s.
- $t_{\text{fm}}$  = transport time from milking to receptor, s.

NOTE: Factors defined above which do not reference a table for their numerical values, are listed in Table 6.3.

**7.8.17 C-14-Pasture Grass-Beef Dose Factor -  $R_{MPC14}$**   
(mrem/y per  $\mu\text{Ci}/\text{m}^3$ )

The general dose equation stated in Regulatory Guide 1.109 for calculating the annual dose from consuming foods containing atmospherically released radionuclides Equation C-13) is:

$$\text{Dose}(D) = \text{Dose Conversion Factor}(\text{DFL}) * \text{Usage Rate}(U) * \text{Radionuclide Concentration in Media}(C)$$

For the beef pathway, Regulatory Guide 1.109 Equations C-8 and C-10 are inserted into the above equation to yield the following:

$$D = \text{DFL} U_{\text{ap}} F_{\text{m}} Q_{\text{f}} \exp(-\lambda t_{\text{fm}}) Q_{\text{C14}} \frac{\chi}{Q} \left( \frac{0.11}{0.16} \right)$$

Since the dose equation in Sections 7.4 and 7.7.3 (Equations 7.9 and 7.14) contain the variables for the release rate (Q) and the dispersion factor ( $\chi/Q$ ), the factors remaining in the above equation are defined as the dose factor. Two decay terms are added to the equation to account for the decay during the time the pasture is exposed to the activity in the air, and the decay during the time the beef is being consumed (Reference 10). The resulting dose factor is:

$$R_{MPC14} = 10^3 10^6 \text{DFL}_{\text{C14aj}} F_{\text{IC14}} Q_{\text{f}} U_{\text{am}} \left( \frac{0.11}{0.16} \right) f_{\text{p}} \exp(-\lambda_{\text{C14}} t_{\text{s}}) \left\{ \frac{[1 - \exp(-\lambda_{\text{C14}} t_{\text{ep}})]}{\lambda_{\text{C14}} t_{\text{ep}}} \right\} \left\{ \frac{[1 - \exp(-\lambda_{\text{C14}} t_{\text{cb}})]}{\lambda_{\text{C14}} t_{\text{cb}}} \right\} \quad (7.35)$$

where:

- $10^3$  = conversion factor, g/kg.
- $10^6$  = conversion factor, pCi/ $\mu\text{Ci}$ .
- $\text{DFL}_{\text{C14aj}}$  = ingestion dose conversion factor for carbon 14 for age group a, organ j, mrem/pCi (Table 6.4).
- $F_{\text{IC14}}$  = transfer factor for carbon 14 from cow's feed to meat, d/kg (Table 6.2).
- $Q_{\text{f}}$  = cow's consumption rate, kg/d.
- $U_{\text{am}}$  = meat ingestion rate for age group a, kg/y.
- 0.11 = the fraction of total plant mass that is natural carbon, dimensionless.
- 0.16 = is equal to the concentration of natural carbon in the atmosphere, in  $\text{g}/\text{m}^3$ .
- $f_{\text{p}}$  = fraction of time cow spends on pasture, dimensionless.
- $\lambda_{\text{C14}}$  = decay constant for carbon 14,  $\text{s}^{-1}$  (Table 6.2).
- $t_{\text{s}}$  = transport time from slaughter to consumer, s.
- $t_{\text{ep}}$  = time pasture is exposed to deposition, s.
- $t_{\text{cb}}$  = time for receptor to consume a whole beef, s.

NOTE: Factors defined above which do not reference a table for their numerical values, are listed in Table 6.3.

**7.8.18 C-14-Stored Feed-Beef Dose Factor -  $R_{MSC14}$**   
(mrem/y per  $\mu\text{Ci}/\text{m}^3$ )

The general dose equation stated in Regulatory Guide 1.109 for calculating the annual dose from consuming foods containing atmospherically released radionuclides Equation C-13) is:

$$\text{Dose}(D) = \text{Dose Conversion Factor}(\text{DFL}) * \text{Usage Rate}(U) * \text{Radionuclide Concentration in Media}(C)$$

For the beef pathway, Regulatory Guide 1.109 Equations C-8 and C-10 are inserted into the above equation to yield the following:

$$D = \text{DFL} U_{\text{ap}} F_{\text{m}} Q_{\text{f}} \exp(-\lambda t_{\text{fm}}) Q_{\text{C14}} \frac{\chi}{Q} \left( \frac{0.11}{0.16} \right)$$

Since the dose equation in Sections 7.4 and 7.7.3 (Equations 7.9 and 7.14) contain the variables for the release rate (Q) and the dispersion factor ( $\chi/Q$ ), the factors remaining in the above equation are defined as the dose factor. Two decay terms are added to the equation to account for the decay during the time the pasture is exposed to the activity in the air, and the decay during the time the beef is being consumed (Reference 10). The resulting dose factor is:

$$R_{MSC14} = 10^3 10^6 \text{DFL}_{\text{C14aj}} F_{\text{IC14}} Q_{\text{f}} U_{\text{am}} \left( \frac{0.11}{0.16} \right) f_{\text{p}} \exp(-\lambda_{\text{C14}} t_{\text{s}}) \left\{ \frac{[1 - \exp(-\lambda_{\text{C14}} t_{\text{csf}})]}{\lambda_{\text{C14}} t_{\text{csf}}} \right\} \left\{ \frac{[1 - \exp(-\lambda_{\text{C14}} t_{\text{cb}})]}{\lambda_{\text{C14}} t_{\text{cb}}} \right\} \quad (7.36)$$

where:

- $10^3$  = conversion factor, g/kg.
- $10^6$  = conversion factor, pCi/ $\mu\text{Ci}$ .
- $\text{DFL}_{\text{C14aj}}$  = ingestion dose conversion factor for carbon 14 for age group a, organ j, mrem/pCi (Table 6.4).
- $F_{\text{IC14}}$  = transfer factor for carbon 14 from cow's feed to meat, d/kg (Table 6.2).
- $Q_{\text{f}}$  = cow's consumption rate, kg/d.
- $U_{\text{am}}$  = meat ingestion rate for age group a, kg/y.
- 0.11 = the fraction of total plant mass that is natural carbon, dimensionless.
- 0.16 = is equal to the concentration of natural carbon in the atmosphere, in g/ $\text{m}^3$ .
- $f_{\text{s}}$  = fraction of time cow spends on stored feed, dimensionless.
- $\lambda_{\text{C14}}$  = decay constant for carbon 14,  $\text{s}^{-1}$  (Table 6.2).
- $t_{\text{s}}$  = transport time from slaughter to consumer, s.
- $t_{\text{csf}}$  = time between harvest of stored feed and consumption by animal, s.
- $t_{\text{cb}}$  = time for receptor to consume a whole beef, s.

NOTE: Factors defined above which do not reference a table for their numerical values, are listed in Table 6.3.

**7.8.19 C-14-Fresh Leafy Vegetable Dose Factor -  $R_{VFC14}$**   
(mrem/y per  $\mu\text{Ci}/\text{m}^3$ )

The general dose equation stated in Regulatory Guide 1.109 for calculating the annual dose from consuming foods containing atmospherically released radionuclides (Equation C-13) is:

$$\text{Dose}(D) = \text{Dose Conversion Factor}(\text{DFL}) * \text{Usage Rate}(U) * \text{Radionuclide Concentration in Media}(C)$$

For the vegetable pathway, Regulatory Guide 1.109 Equation C-8 is inserted into the above equation to yield the following:

$$D = \text{DFL } U_{\text{ap}} \exp(-\lambda t_{\text{hc}}) Q_{\text{C14}} \frac{\chi}{Q} \left( \frac{0.11}{0.16} \right)$$

Since the dose equation in Sections 7.4 and 7.7.3 (Equations 7.9 and 7.14) contain the variables for the release rate (Q) and the dispersion factor ( $\chi/Q$ ), the factors remaining in the above equation are defined as the dose factor. The resulting dose factor is:

$$R_{VFC14} = 10^3 10^6 \text{DFL}_{\text{C14aj}} \left( \frac{0.11}{0.16} \right) U_{\text{FLa}} f_L \exp(-\lambda_{\text{C14}} t_{\text{hc}}) \quad (7.37)$$

where:

- $10^3$  = conversion factor, g/kg.
- $10^6$  = conversion factor, pCi/ $\mu\text{Ci}$ .
- $\text{DFL}_{\text{C14aj}}$  = ingestion dose conversion factor for carbon 14 for age group a, organ j, mrem/pCi (Table 6.4).
- 0.11 = the fraction of total plant mass that is natural carbon, dimensionless.
- 0.16 = is equal to the concentration of natural carbon in the atmosphere, in g/ $\text{m}^3$ .
- $U_{\text{FLa}}$  = consumption rate of fresh leafy vegetables by the receptor in age group a, kg/y.
- $f_L$  = fraction of fresh leafy vegetables grown locally, dimensionless.
- $\lambda_{\text{C14}}$  = decay constant for carbon 14,  $\text{s}^{-1}$  (Table 6.2).
- $t_{\text{hc}}$  = time between harvest of vegetables and their consumption and/or storage, s.

NOTE: Factors defined above which do not reference a table for their numerical values, are listed in Table 6.3.

**7.8.20 C-14-Stored Vegetables Dose Factor -  $R_{VSC14}$**   
(mrem/y per  $\mu\text{Ci}/\text{m}^3$ )

The general dose equation stated in Regulatory Guide 1.109 for calculating the annual dose from consuming foods containing atmospherically released radionuclides (Equation C-13) is:

$$\text{Dose}(D) = \text{Dose Conversion Factor}(\text{DFL}) * \text{Usage Rate}(U) * \text{Radionuclide Concentration in Media}(C)$$

For the vegetable pathway, Regulatory Guide 1.109 Equation C-9 is inserted into the above equation to yield the following:

$$D = \text{DFL } U_{\text{ap}} \exp(-\lambda t_{\text{hc}}) Q_{\text{C14}} \frac{\chi}{Q} \left( \frac{0.11}{0.16} \right)$$

Since the dose equation in Sections 7.4 and 7.7.3 (Equations 7.9 and 7.14) contain the variables for the release rate (Q) and the dispersion factor ( $\chi/Q$ ), the factors remaining in the above equation are defined as the dose factor. An additional decay term is added to account for the decay during the time the vegetables are stored (this term assumes that the vegetables are being eaten during the storage period) (Reference 10). The resulting dose factor is:

$$R_{VSC14} = 10^3 10^6 \text{DFL}_{\text{C14aj}} \left( \frac{0.11}{0.16} \right) U_{\text{Sa}} f_g \left\{ \frac{[1 - \exp(-\lambda_{\text{C14}} t_{\text{sv}})]}{\lambda_{\text{C14}} t_{\text{sv}}} \right\} \exp(-\lambda_{\text{C14}} t_{\text{hc}}) \quad (7.38)$$

where:

- $10^3$  = conversion factor, g/kg.
- $10^6$  = conversion factor, pCi/ $\mu\text{Ci}$ .
- $\text{DFL}_{\text{C14aj}}$  = ingestion dose conversion factor for carbon 14 for age group a, organ j, mrem/pCi (Table 6.4).
- 0.11 = the fraction of total plant mass that is natural carbon, dimensionless.
- 0.16 = is equal to the concentration of natural carbon in the atmosphere, in g/ $\text{m}^3$ .
- $U_{\text{Sa}}$  = consumption rate of stored vegetables by the receptor in age group a, kg/y.
- $f_g$  = fraction of stored vegetables grown locally, dimensionless.
- $\lambda_{\text{C14}}$  = decay constant for carbon 14,  $\text{s}^{-1}$  (Table 6.2).
- $t_{\text{sv}}$  = time between harvest of stored vegetables and their consumption and/or storage, s.
- $t_{\text{hc}}$  = time between harvest of vegetables and their storage, s.

NOTE: Factors defined above which do not reference a table for their numerical values, are listed in Table 6.3.

## 7.9 DISPERSION METHODOLOGY

Dispersion factors are calculated for radioactive effluent releases using hourly average meteorological data consisting of wind speed and direction measurements at 10m and temperature measurements at 10m and 46m.

A sector-average dispersion equation consistent with Regulatory Guide 1.111 is used. The dispersion model considers plume depletion (using information from Figure 7.4), and building wake effects. Terrain effects on dispersion are considered as described in Section 7.9.4.

Hourly average meteorological data are expressed as a joint-frequency distribution of wind speed, wind direction, and atmospheric stability. The joint-frequency distribution which represents the historical meteorological data for the period January 1986 to December 2005 is given in Table 7.2.

The wind speed classes that are used are as follows:

Number	Range (m/s)	Midpoint (m/s)
1	<0.3	0.13
2	0.3-0.6	0.45
3	0.7-1.5	1.10
4	1.6-2.4	1.99
5	2.5-3.3	2.88
6	3.4-5.5	4.45
7	5.6-8.2	6.91
8	8.3-10.9	9.59
9	>10.9	10.95

The stability classes that will be used are the standard Pasquill A through G classifications. The stability classes 1-7 will correspond to A=1, B=2, ..., G=7.

### 7.9.1 Air Concentration - $\chi$

Air concentrations of nuclides at downwind locations are calculated using the following equation:

$$\chi_i = \sum_{k=1}^9 \frac{1}{TAF} \sum_{l=1}^7 \sqrt{\frac{2}{\pi}} \frac{f_{kl} Q_i p}{\sum_{z_l} u_k \left( \frac{2\pi x}{n} \right)} \exp\left(-\lambda_i \frac{x}{u_k}\right) \quad (7.39)$$

where:

$f_{kl}$  = joint relative frequency of occurrence of winds in windspeed class k, stability class l, blowing toward this exposure point, expressed as a fraction.

$Q_i$  = average annual release rate of radionuclide i,  $\mu\text{Ci/s}$ .

$p$  = fraction of radionuclide remaining in plume (Figure 7.4).

TAF = site specific terrain adjustment factor (see Table 7.3). Calculated as described in Section 7.9.4.

$\sum_{z_l}$  = vertical dispersion coefficient for stability class l which includes a building wake adjustment,

$$= \sqrt{\sigma_{z_l}^2 + \frac{c\alpha}{\pi}},$$

or  $= \sqrt{3} \sigma_{z_l}$ , whichever is smaller.

where:

$\sigma_{z_l}$  is the vertical dispersion coefficient for stability class l (m) (Figure 7.5),

c is a building shape factor (c=0.5) (Reference 5),

a is the minimum building cross-sectional area (1630 m<sup>2</sup>) (Reference 23).

$u_k$  = midpoint value of wind speed class interval k, m/s.

- x = downwind distance, m.  
n = number of sectors, 16.  
 $\lambda_i$  = radioactive decay coefficient of radionuclide i, s<sup>-1</sup>  
 $2\pi x/n$  = sector width at point of interest, m.

### 7.9.2 Adjusted Relative Concentration - $\chi/Q$

Relative concentrations of nuclides at downwind locations are calculated using the following equation:

$$\frac{\chi}{Q} = \text{TAF} \sum_{k=1}^9 \sum_{l=1}^7 \sqrt{\frac{2}{\pi}} \frac{f_{kl}}{\sum_{zl} u_k \left( \frac{2\pi x}{n} \right)} \quad (7.40)$$

where:

$f_{kl}$  = joint relative frequency of occurrence of winds in windspeed class k, stability class l, blowing toward this exposure point, expressed as a fraction.

TAF = site specific terrain adjustment factor (see Table 7.3). Calculated as described in Section 7.9.4.

$\sum_{zl}$  = vertical dispersion coefficient for stability class l which includes a building wake adjustment,

$$= \sqrt{\sigma_{zl}^2 + \frac{c\alpha}{\pi}},$$

or  $= \sqrt{3} \sigma_{zl}$ , whichever is smaller.

where:

$\sigma_{zl}$  is the vertical dispersion coefficient for stability class l (m) (Figure 7.5),

c is a building shape factor (c=0.5) (Reference 5),

a is the minimum building cross-sectional area (1630 m<sup>2</sup>) (Reference 23).

$u_k$  = midpoint value of wind speed class interval k, m/s.

x = downwind distance, m.

n = number of sectors, 16.

$2\pi x/n$  = sector width at point of interest, m.

### 7.9.3 Adjusted Relative Deposition - $D/Q$

Relative deposition of nuclides at downwind locations is calculated using the following equation:

$$\frac{D}{Q} = \text{TAF} \sum_{k=1}^9 \sum_{l=1}^7 \frac{f_{kl} dr}{\left( \frac{2\pi x}{n} \right)} \quad (7.41)$$

where:

$f_{kl}$  = joint relative frequency of occurrence of winds in windspeed class k and stability class l, blowing toward this exposure point, expressed as a fraction.

dr = relative deposition rate, m<sup>-1</sup> (from Figure 7.6).

TAF = site specific terrain adjustment factor (see Table 7.3). Calculated as described in Section 7.9.4.

x = downwind distance, m.

n = number of sectors, 16.

$2\pi x/n$  = sector width at point of interest, m.

#### 7.9.4 Terrain Adjustment Factor - TAF

As discussed in Reference 5, the straight-line dispersion model does not account for spatial and temporal variations in the airflow expected from the southwest-northeast aligned river valley. Such variations are considered by application of site-specific terrain adjustment factors, TAF. These factors were developed through the comparison of variable trajectory model results with straight-line model results for onsite meteorological data for 1978 (Reference 19). The ratio of the variable trajectory model dispersion factors to the straight-line model dispersion factors is defined as the TAF.

The dispersion factors used in the dose rate and dose calculations described in Sections 7.2.2, 7.2.3, 7.3.1, 7.3.2, and 7.4.1 are calculated using the meteorological data from the 1986 to 2005 period (in Table 7.2).  $\chi/Q$  and D/Q values are calculated for each of the 16 UNRESTRICTED AREA BOUNDARY sector locations (Table 7.1). These are multiplied by the TAF associated with each of these sectors (see Table 7.3). The highest of these dispersion values are chosen for the dose or dose rate calculations.

The dispersion factors used in the dose calculations described in Section 7.7 are calculated using the actual meteorological data for the period.  $\chi/Q$  or D/Q values are calculated using Equations 7.40 and 7.41 for the UNRESTRICTED AREA BOUNDARY locations identified in Table 7.1, for the 16 nearest resident locations, and all garden and milk animal locations identified in the annual land use census described in Section 9.3. The TAF values associated with these dispersion factors is the ratio of the dispersion factor calculated by the variable trajectory model to that calculated by the straight-line model for each of these locations using the 1978 meteorological data. These values will be calculated for all locations identified by the land use census and then used to modify the  $\chi/Q$  and D/Q values determined with the actual meteorological data. Any TAF values of less than 1.0 will be defined as 1.0.

Table 7.1 - WBN - OFFSITE RECEPTOR LOCATION DATA

Receptor	Sector	DISTANCE from plant (m)	$\chi/Q$ * (s/m <sup>3</sup> )	D/Q* (1/m <sup>2</sup> )
Unrestricted Area Boundary	N	1550	3.01E-06	4.78E-09
Unrestricted Area Boundary	NNE	1980	3.53E-06	6.83E-09
Unrestricted Area Boundary	NE	1580	5.00E-06	5.24E-09
Unrestricted Area Boundary	ENE	1370	7.24E-06	5.16E-09
Unrestricted Area Boundary	E	1280	8.56E-06	6.04E-09
Unrestricted Area Boundary	ESE	1250	7.94E-06	6.44E-09
Unrestricted Area Boundary	SE	1250	7.40E-06	6.33E-09
Unrestricted Area Boundary	SSE	1250	4.03E-06	5.47E-09
Unrestricted Area Boundary	S	1340	2.81E-06	6.16E-09
Unrestricted Area Boundary	SSW	1550	2.07E-06	5.25E-09
Unrestricted Area Boundary	SW	1670	2.12E-06	3.50E-09
Unrestricted Area Boundary	WSW	1430	3.04E-06	3.54E-09
Unrestricted Area Boundary	W	1460	1.76E-06	1.73E-09
Unrestricted Area Boundary	WNW	1400	9.96E-08	9.52E-10
Unrestricted Area Boundary	NW	1400	1.21E-06	1.25E-09
Unrestricted Area Boundary	NNW	1460	1.68E-06	1.93E-09
Liquid Discharge			N/A	N/A

NOTE: For quarterly airborne dose calculations, doses will also be calculated for all locations identified in the most recent land use census, and for any additional points deemed necessary.

\*These  $\chi/Q$  and D/Q values must be multiplied by the sector specific Terrain Adjustment Factor (see Table 7.3) prior to selecting the critical UNRESTRICTED AREA BOUNDARY location to be used in dose calculations.

**Table 7.2 - JOINT PERCENTAGE FREQUENCIES OF WIND DIRECTION AND WIND SPEED FOR  
DIFFERENT STABILITY CLASSES**  
(Page 1 of 7)

STABILITY CLASS A (DELTA T<=-1.9 C/100 M)										
Watts Bar Nuclear Plant										
JAN 1, 1986 - DEC 31, 2005										
WIND DIRECTION	CALM	0.6-1.4	1.5-3.4	WIND SPEED (MPH)		7.5-12.4	12.5-18.4	18.5-24.4	>=24.5	TOTAL
				3.5-5.4	5.5-7.4					
N	0.000	0.001	0.011	0.052	0.079	0.095	0.005	0.000	0.000	0.244
NNE	0.000	0.001	0.021	0.084	0.124	0.181	0.007	0.000	0.000	0.418
NE	0.000	0.000	0.034	0.100	0.080	0.094	0.000	0.000	0.000	0.308
ENE	0.000	0.000	0.039	0.076	0.045	0.017	0.000	0.000	0.000	0.175
E	0.000	0.000	0.037	0.040	0.010	0.004	0.000	0.000	0.000	0.092
ESE	0.000	0.000	0.017	0.023	0.002	0.001	0.000	0.000	0.000	0.042
SE	0.000	0.001	0.026	0.027	0.005	0.004	0.000	0.000	0.000	0.064
SSE	0.000	0.000	0.049	0.063	0.015	0.011	0.001	0.000	0.000	0.140
S	0.000	0.002	0.070	0.180	0.142	0.121	0.020	0.001	0.000	0.535
SSW	0.000	0.000	0.063	0.371	0.594	0.700	0.049	0.001	0.000	1.778
SW	0.000	0.000	0.029	0.146	0.148	0.065	0.002	0.000	0.000	0.390
WSW	0.000	0.000	0.007	0.020	0.018	0.040	0.006	0.000	0.000	0.091
W	0.000	0.000	0.006	0.007	0.029	0.059	0.007	0.000	0.000	0.108
WNW	0.000	0.000	0.004	0.010	0.011	0.064	0.005	0.000	0.000	0.093
NW	0.000	0.000	0.004	0.007	0.019	0.052	0.005	0.000	0.000	0.087
NNW	0.000	0.000	0.009	0.021	0.038	0.081	0.012	0.000	0.000	0.161
SUBTOTAL	0.001	0.005	0.426	1.226	1.359	1.589	0.119	0.001	0.000	4.725
TOTAL HOURS OF VALID STABILITY OBSERVATIONS						170639				
TOTAL HOURS OF STABILITY CLASS A						8030				
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS A						7945				
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS						168144				
TOTAL HOURS CALM						1				

METEOROLOGICAL FACILITY: Watts Bar Nuclear Plant  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

MEAN WIND SPEED = 6.72

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

**Table 7.2 - JOINT PERCENTAGE FREQUENCIES OF WIND DIRECTION AND WIND SPEED FOR  
DIFFERENT STABILITY CLASSES**

(Page 2 of 7)

STABILITY CLASS B (-1.9< DELTA T<=-1.7 C/100 M)										
Watts Bar Nuclear Plant										
JAN 1, 1986 - DEC 31, 2005										
WIND DIRECTION	CALM	0.6-1.4	1.5-3.4	WIND SPEED(MPH)						TOTAL
				3.5-5.4	5.5-7.4	7.5-12.4	12.5-18.4	18.5-24.4	>=24.5	
N	0.000	0.000	0.027	0.092	0.084	0.109	0.005	0.000	0.000	0.318
NNE	0.000	0.001	0.039	0.155	0.147	0.212	0.009	0.000	0.000	0.563
NE	0.000	0.000	0.081	0.147	0.090	0.077	0.001	0.000	0.000	0.396
ENE	0.000	0.001	0.058	0.096	0.043	0.010	0.000	0.000	0.000	0.208
E	0.000	0.001	0.046	0.052	0.004	0.002	0.000	0.000	0.000	0.106
ESE	0.000	0.002	0.026	0.022	0.000	0.000	0.000	0.000	0.000	0.051
SE	0.000	0.000	0.039	0.032	0.005	0.002	0.001	0.000	0.000	0.078
SSE	0.000	0.000	0.057	0.035	0.008	0.004	0.000	0.000	0.000	0.104
S	0.000	0.001	0.077	0.148	0.075	0.039	0.014	0.001	0.000	0.354
SSW	0.000	0.001	0.082	0.322	0.266	0.199	0.020	0.000	0.000	0.890
SW	0.000	0.000	0.036	0.169	0.054	0.014	0.001	0.000	0.000	0.275
WSW	0.000	0.000	0.007	0.037	0.015	0.021	0.001	0.000	0.000	0.081
W	0.000	0.000	0.006	0.011	0.025	0.040	0.009	0.000	0.000	0.091
WNW	0.000	0.001	0.005	0.014	0.031	0.079	0.007	0.000	0.000	0.137
NW	0.000	0.000	0.007	0.015	0.033	0.071	0.008	0.000	0.000	0.135
NNW	0.000	0.000	0.011	0.034	0.040	0.079	0.008	0.000	0.000	0.173
SUBTOTAL	0.000	0.007	0.606	1.383	0.923	0.958	0.083	0.001	0.000	3.960

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	170639
TOTAL HOURS OF STABILITY CLASS B	6722
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS B	6659
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	168144
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: Watts Bar Nuclear Plant  
STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

MEAN WIND SPEED = 5.98

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

**Table 7.2 - JOINT PERCENTAGE FREQUENCIES OF WIND DIRECTION AND WIND SPEED FOR  
DIFFERENT STABILITY CLASSES**  
(Page 3 of 7)

STABILITY CLASS C (-1.7< DELTA T<=-1.5 C/100 M)									
Watts Bar Nuclear Plant									
JAN 1, 1986 - DEC 31, 2005									
WIND DIRECTION	CALM	0.6-1.4	1.5-3.4	WIND SPEED (MPH)					
				3.5-5.4	5.5-7.4	7.5-12.4	12.5-18.4	18.5-24.4	>=24.5
N	0.000	0.001	0.060	0.141	0.125	0.151	0.007	0.000	0.000
NNE	0.000	0.001	0.111	0.224	0.209	0.260	0.013	0.000	0.000
NE	0.000	0.003	0.139	0.221	0.117	0.070	0.001	0.000	0.000
ENE	0.000	0.001	0.113	0.127	0.030	0.005	0.001	0.000	0.000
E	0.000	0.005	0.080	0.049	0.005	0.002	0.000	0.000	0.000
ESE	0.000	0.003	0.054	0.028	0.002	0.001	0.000	0.000	0.000
SE	0.000	0.002	0.071	0.033	0.002	0.001	0.000	0.000	0.000
SSE	0.000	0.002	0.080	0.064	0.009	0.004	0.002	0.000	0.000
S	0.000	0.001	0.128	0.230	0.085	0.048	0.008	0.001	0.000
SSW	0.000	0.001	0.152	0.423	0.256	0.177	0.019	0.000	0.000
SW	0.000	0.001	0.080	0.225	0.070	0.011	0.001	0.000	0.000
WSW	0.000	0.001	0.023	0.049	0.026	0.015	0.001	0.000	0.000
W	0.000	0.001	0.016	0.027	0.039	0.042	0.004	0.000	0.000
WNW	0.000	0.000	0.013	0.030	0.049	0.111	0.010	0.000	0.000
NW	0.000	0.000	0.020	0.036	0.043	0.096	0.011	0.000	0.000
NNW	0.000	0.000	0.032	0.059	0.064	0.098	0.011	0.000	0.000
SUBTOTAL	0.000	0.023	1.171	1.968	1.130	1.093	0.089	0.001	0.000

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	170639
TOTAL HOURS OF STABILITY CLASS C	9309
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS C	9207
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	168144
TOTAL HOURS CALM	0

METEOROLOGICAL FACILITY: Watts Bar Nuclear Plant  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

MEAN WIND SPEED = 5.57

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

**Table 7.2 - JOINT PERCENTAGE FREQUENCIES OF WIND DIRECTION AND WIND SPEED FOR  
DIFFERENT STABILITY CLASSES**  
(Page 4 of 7)

STABILITY CLASS D (-1.5< DELTA T<=-0.5 C/100 M)										
Watts Bar Nuclear Plant										
JAN 1, 1986 - DEC 31, 2005										
WIND DIRECTION	CALM	0.6-1.4	1.5-3.4	WIND SPEED(MPH)						TOTAL
				3.5-5.4	5.5-7.4	7.5-12.4	12.5-18.4	18.5-24.4	>=24.5	
N	0.006	0.050	0.656	0.996	1.063	1.203	0.034	0.000	0.000	4.007
NNE	0.006	0.052	0.697	1.241	1.206	1.182	0.072	0.002	0.000	4.458
NE	0.007	0.064	0.796	1.060	0.477	0.203	0.005	0.000	0.000	2.612
ENE	0.008	0.095	0.840	0.479	0.115	0.038	0.002	0.000	0.000	1.577
E	0.005	0.126	0.478	0.137	0.022	0.005	0.000	0.000	0.000	0.774
ESE	0.003	0.081	0.275	0.057	0.006	0.004	0.000	0.000	0.000	0.426
SE	0.004	0.090	0.369	0.076	0.022	0.014	0.001	0.001	0.000	0.575
SSE	0.006	0.133	0.566	0.160	0.035	0.034	0.014	0.000	0.000	0.949
S	0.011	0.174	1.104	0.699	0.296	0.251	0.076	0.004	0.000	2.615
SSW	0.015	0.145	1.610	1.796	0.927	0.815	0.076	0.002	0.000	5.386
SW	0.010	0.167	1.060	0.790	0.202	0.097	0.004	0.000	0.000	2.329
WSW	0.006	0.109	0.558	0.289	0.123	0.088	0.004	0.000	0.000	1.177
W	0.005	0.121	0.406	0.293	0.258	0.256	0.008	0.000	0.000	1.347
WNW	0.004	0.095	0.353	0.394	0.491	0.520	0.021	0.000	0.000	1.879
NW	0.004	0.071	0.353	0.403	0.532	0.608	0.046	0.001	0.000	2.017
NNW	0.004	0.042	0.445	0.566	0.631	0.795	0.034	0.000	0.000	2.517
SUBTOTAL	0.104	1.615	10.566	9.436	6.405	6.113	0.395	0.010	0.000	34.645

TOTAL HOURS OF VALID STABILITY OBSERVATIONS	170639
TOTAL HOURS OF STABILITY CLASS D	58946
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS D	58253
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS	168144
TOTAL HOURS CALM	175

METEOROLOGICAL FACILITY: Watts Bar Nuclear Plant  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

MEAN WIND SPEED = 4.96

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

**Table 7.2 - JOINT PERCENTAGE FREQUENCIES OF WIND DIRECTION AND WIND SPEED FOR  
DIFFERENT STABILITY CLASSES**  
(Page 7 of 7)

STABILITY CLASS G (DELTA T > 4.0 C/100 M)									
Watts Bar Nuclear Plant									
JAN 1, 1986 - DEC 31, 2005									
WIND DIRECTION	CALM	0.6-1.4	1.5-3.4	WIND SPEED (MPH)					
				3.5-5.4	5.5-7.4	7.5-12.4	12.5-18.4	18.5-24.4	>=24.5
N	0.035	0.221	0.066	0.001	0.000	0.000	0.000	0.000	0.000
NNE	0.034	0.199	0.077	0.001	0.000	0.000	0.000	0.000	0.000
NE	0.048	0.271	0.123	0.002	0.000	0.000	0.000	0.000	0.000
ENE	0.059	0.300	0.188	0.004	0.001	0.000	0.000	0.000	0.000
E	0.032	0.202	0.058	0.002	0.000	0.000	0.000	0.000	0.000
ESE	0.016	0.116	0.018	0.000	0.000	0.000	0.000	0.000	0.000
SE	0.021	0.145	0.023	0.000	0.000	0.000	0.000	0.000	0.000
SSE	0.025	0.173	0.032	0.001	0.000	0.000	0.000	0.000	0.000
S	0.036	0.246	0.051	0.002	0.000	0.000	0.000	0.000	0.000
SSW	0.060	0.367	0.123	0.005	0.001	0.000	0.000	0.000	0.000
SW	0.096	0.569	0.222	0.002	0.000	0.000	0.000	0.000	0.000
WSW	0.162	0.916	0.410	0.007	0.000	0.000	0.000	0.000	0.000
W	0.169	1.036	0.351	0.002	0.000	0.000	0.000	0.000	0.000
WNW	0.130	0.825	0.240	0.004	0.000	0.000	0.000	0.000	0.000
NW	0.127	0.751	0.292	0.002	0.000	0.000	0.000	0.000	0.000
NNW	0.058	0.356	0.120	0.002	0.000	0.000	0.000	0.000	0.000
SUBTOTAL	1.109	6.695	2.394	0.037	0.001	0.000	0.000	0.000	0.000
TOTAL HOURS OF VALID STABILITY OBSERVATIONS						170639			
TOTAL HOURS OF STABILITY CLASS G						17454			
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY CLASS G						17211			
TOTAL HOURS OF VALID WIND DIRECTION-WIND SPEED-STABILITY OBSERVATIONS						168144			
TOTAL HOURS CALM						1864			

METEOROLOGICAL FACILITY: Watts Bar Nuclear Plant  
 STABILITY BASED ON DELTA-T BETWEEN 9.51 AND 45.63 METERS  
 WIND SPEED AND DIRECTION MEASURED AT 9.72 METER LEVEL

MEAN WIND SPEED = 1.14

NOTE: TOTALS AND SUBTOTALS ARE OBTAINED FROM UNROUNDED NUMBERS

Table 7.3 - ADJUSTED DISPERSION FACTORS

Sector	$\chi/Q$ (Terrain Adjusted) (s/m <sup>3</sup> )	D/Q(Terrain Adjusted) (1/m <sup>2</sup> )
N	5.12E-06	8.13E-09
NNE	6.35E-06	1.23E-08
NE	1.05E-05	1.10E-08
ENE	1.23E-05	8.77E-09
E	1.37E-05	9.66E-09
ESE	1.43E-05	1.16E-08
SE	1.11E-05	9.49E-09
SSE	6.04E-06	8.21E-09
S	5.33E-06	1.17E-08
SSW	4.14E-06	1.05E-08
SW	4.46E-06	7.34E-09
WSW	5.47E-06	6.37E-09
W	2.11E-06	2.07E-09
WNW	2.49E-06	2.38E-09
NW	2.05E-06	2.13E-09
NNW	2.68E-06	3.08E-09

\*The Site Specific Terrain Adjustment Factor (TAF) is equal to the ratio of the variable trajectory  $\chi/Q$  to the straight-line  $\chi/Q$ . See ODCM Section 7.9.4 for a full explanation.

Table 7.4 - DOSE FACTORS FOR SUBMERSION IN NOBLE GASES

	Submersion dose mrem/y per $\mu\text{Ci}/\text{m}^3$		Air dose mrad/y per $\mu\text{Ci}/\text{m}^3$	
	$\text{DF}_{\text{Bi}}$	$\text{DF}_{\text{Si}}$	$\text{DF}_{\text{gi}}$	$\text{DF}_{\text{bi}}$
Kr-83m	7.56E-02	---	1.93E+01	2.88E+02
Kr-85m	1.17E+03	1.46E+03	1.23E+03	1.97E+03
Kr-85	1.61E+01	1.34E+03	1.72E+01	1.95E+03
Kr-87	5.92E+03	9.73E+03	6.17E+03	1.03E+04
Kr-88	1.47E+04	2.37E+03	1.52E+04	2.93E+03
Kr-89	1.66E+04	1.01E+04	1.73E+04	1.06E+04
Kr-90	1.56E+04	7.29E+03	1.63E+04	7.83E+03
Xe-131m	9.15E+01	4.76E+02	1.56E+02	1.11E+03
Xe-133m	2.51E+02	9.94E+02	3.27E+02	1.48E+03
Xe-133	2.94E+02	3.06E+02	3.53E+02	1.05E+03
Xe-135m	3.12E+03	7.11E+02	3.36E+03	7.39E+02
Xe-135	1.81E+03	1.86E+03	1.92E+03	2.46E+03
Xe-137	1.42E+03	1.22E+04	1.51E+03	1.27E+04
Xe-138	8.83E+03	4.13E+03	9.21E+03	4.75E+03
Ar-41	8.84E+03	2.69E+03	9.30E+03	3.28E+03

Reference:  
Regulatory Guide 1.109, Table B-1 (Reference 4).

**Table 7.5 - SECTOR ELEMENTS CONSIDERED FOR POPULATION DOSES**

<b>Range of Sector Element (mi)</b>	<b>Midpoint of Sector Element (mi)</b>
Unrestricted Area Boundary - 1	0.8
1 - 2	1.5
2 - 3	2.5
3 - 4	3.5
4 - 5	4.5
5 - 10	7.5
10 - 20	15
20 - 30	25
30 - 40	35
40 - 50	45

Table 7.6 - POPULATION WITHIN EACH SECTOR ELEMENT

Distance from Site (miles)

Sectors	Radii/Distances (mi)									
	0-1	1-2	2-3	3-4	4-5	5-10	10-20	20-30	30-40	40-50
N	0	18	0	0	135	2465	1885	2778	4798	6172
NNE	0	0	18	411	185	1536	11762	18766	14502	2547
NE	0	0	18	308	287	827	3783	16734	29838	78334
ENE	0	0	18	308	287	497	3553	29539	63798	253831
E	0	8	431	308	616	552	11352	18647	30063	44013
ESE	0	0	0	27	41	68	6230	20120	5068	3280
SE	8	0	0	29	39	135	19852	15185	3950	7822
SSE	21	0	0	246	413	103	8951	12907	2918	48593
S	16	0	0	0	1983	3824	4586	42883	56430	17985
SSW	0	0	21	0	0	546	5725	42517	46281	106392
SW	0	0	0	0	0	1051	12978	14499	62307	111795
WSW	0	6	36	59	126	711	12791	2837	2840	3372
W	0	14	22	101	90	710	3406	5555	2944	5474
WNW	0	0	22	126	79	490	2091	4372	5654	20511
NW	0	108	332	376	526	2655	2889	18634	10462	15956
NNW	0	0	0	173	123	3116	1536	33843	11609	5890
Total	45	155	919	2471	4930	19287	113368	299818	353432	728968

Table 7.7 - INHALATION DOSE FACTORS -  $DF_{iao}$ 

(mrem/pCi inhaled)

(Page 1 of 8)

ADULT

Nuclide	bone	liver	total body	thyroid	kidney	lung	GI-LLI
H-3	1.58E-07	1.58E-07	1.58E-07	1.58E-07	1.58E-07	1.58E-07	1.58E-07
C-14	2.27E-06	4.26E-07	4.26E-07	4.26E-07	4.26E-07	4.26E-07	4.26E-07
Na-24	1.28E-06	1.28E-06	1.28E-06	1.28E-06	1.28E-06	1.28E-06	1.28E-06
P-32	1.65E-04	9.64E-06	6.26E-06	0.00E+00	0.00E+00	0.00E+00	1.08E-05
Cr-51	0.00E+00	0.00E+00	1.25E-08	7.44E-09	2.85E-09	1.80E-06	4.15E-07
Mn-54	0.00E+00	4.95E-06	7.87E-07	0.00E+00	1.23E-06	1.75E-04	9.67E-06
Mn-56	0.00E+00	1.55E-10	2.29E-11	0.00E+00	1.63E-10	1.18E-06	2.53E-06
Fe-55	3.07E-06	2.12E-06	4.93E-07	0.00E+00	0.00E+00	9.01E-06	7.54E-07
Fe-59	1.47E-06	3.47E-06	1.32E-06	0.00E+00	0.00E+00	1.27E-04	2.35E-05
Co-57	0.00E+00	8.65E-08	8.39E-08	0.00E+00	0.00E+00	4.62E-05	3.93E-06
Co-58	0.00E+00	1.98E-07	2.59E-07	0.00E+00	0.00E+00	1.16E-04	1.33E-05
Co-60	0.00E+00	1.44E-06	1.85E-06	0.00E+00	0.00E+00	7.46E-04	3.56E-05
Ni-63	5.40E-05	3.93E-06	1.81E-06	0.00E+00	0.00E+00	2.23E-05	1.67E-06
Ni-65	1.92E-10	2.62E-11	1.14E-11	0.00E+00	0.00E+00	7.00E-07	1.54E-06
Cu-64	0.00E+00	1.83E-10	7.69E-11	0.00E+00	5.78E-10	8.48E-07	6.12E-06
Zn-65	4.05E-06	1.29E-05	5.82E-06	0.00E+00	8.62E-06	1.08E-04	6.68E-06
Zn-69	4.23E-12	8.14E-12	5.65E-13	0.00E+00	5.27E-12	1.15E-07	2.04E-09
Zn-69m	1.02E-09	2.45E-09	2.24E-10	0.00E+00	1.48E-09	2.38E-06	1.71E-05
Br-82	0.00E+00	0.00E+00	1.69E-06	0.00E+00	0.00E+00	0.00E+00	1.30E-06
Br-83	0.00E+00	0.00E+00	3.01E-08	0.00E+00	0.00E+00	0.00E+00	2.90E-08
Br-84	0.00E+00	0.00E+00	3.91E-08	0.00E+00	0.00E+00	0.00E+00	2.05E-13
Br-85	0.00E+00	0.00E+00	1.60E-09	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Rb-86	0.00E+00	1.69E-05	7.37E-06	0.00E+00	0.00E+00	0.00E+00	2.08E-06
Rb-88	0.00E+00	4.84E-08	2.41E-08	0.00E+00	0.00E+00	0.00E+00	4.18E-19
Rb-89	0.00E+00	3.20E-08	2.12E-08	0.00E+00	0.00E+00	0.00E+00	1.16E-21
Sr-89	3.80E-05	0.00E+00	1.09E-06	0.00E+00	0.00E+00	1.75E-04	4.37E-05
Sr-90	1.24E-02	0.00E+00	7.62E-04	0.00E+00	0.00E+00	1.20E-03	9.02E-05
Sr-91	7.74E-09	0.00E+00	3.13E-10	0.00E+00	0.00E+00	4.56E-06	2.39E-05
Sr-92	8.43E-10	0.00E+00	3.64E-11	0.00E+00	0.00E+00	2.06E-06	5.38E-06
Y-90	2.61E-07	0.00E+00	7.01E-09	0.00E+00	0.00E+00	2.12E-05	6.32E-05
Y-91m	3.26E-11	0.00E+00	1.27E-12	0.00E+00	0.00E+00	2.40E-07	1.66E-10
Y-91	5.78E-05	0.00E+00	1.55E-06	0.00E+00	0.00E+00	2.13E-04	4.81E-05
Y-92	1.29E-09	0.00E+00	3.77E-11	0.00E+00	0.00E+00	1.96E-06	9.19E-06
Y-93	1.18E-08	0.00E+00	3.26E-10	0.00E+00	0.00E+00	6.06E-06	5.27E-05
Zr-95	1.34E-05	4.30E-06	2.91E-06	0.00E+00	6.77E-06	2.21E-04	1.88E-05
Zr-97	1.21E-08	2.45E-09	1.13E-09	0.00E+00	3.71E-09	9.84E-06	6.54E-05
Nb-95	1.76E-06	9.77E-07	5.26E-07	0.00E+00	9.67E-07	6.31E-05	1.30E-05
Nb-97	2.78E-11	7.03E-12	2.56E-12	0.00E+00	8.18E-12	3.00E-07	3.02E-08
Mo-99	0.00E+00	1.51E-08	2.87E-09	0.00E+00	3.64E-08	1.14E-05	3.10E-05
Tc-99m	1.29E-13	3.64E-13	4.63E-12	0.00E+00	5.52E-12	9.55E-08	5.20E-07
Tc-101	5.22E-15	7.52E-15	7.38E-14	0.00E+00	1.35E-13	4.99E-08	1.36E-21
Ru-103	1.91E-07	0.00E+00	8.23E-08	0.00E+00	7.29E-07	6.31E-05	1.38E-05
Ru-105	9.88E-11	0.00E+00	3.89E-11	0.00E+00	1.27E-10	1.37E-06	6.02E-06
Ru-106	8.64E-06	0.00E+00	1.09E-06	0.00E+00	1.67E-05	1.17E-03	1.14E-04

Table 7.7 - INHALATION DOSE FACTORS -  $DF_{iao}$ 

(mrem/pCi inhaled)

(Page 2 of 8)

ADULT

Nuclide	bone	liver	total body	thyroid	kidney	lung	GI-LLI
Ag-110m	1.35E-06	1.25E-06	7.43E-07	0.00E+00	2.46E-06	5.79E-04	3.78E-05
Sb-124	3.90E-06	7.36E-08	1.55E-06	9.44E-09	0.00E+00	3.10E-04	5.08E-05
Sb-125	6.67E-06	7.44E-08	1.58E-06	6.75E-09	0.00E+00	2.18E-04	1.26E-05
Sn-125	1.16E-06	3.12E-08	7.03E-08	2.59E-08	0.00E+00	7.37E-05	6.81E-05
Te-125m	4.27E-07	1.98E-07	5.84E-08	1.31E-07	1.55E-06	3.92E-05	8.83E-06
Te-127m	1.58E-06	7.21E-07	1.96E-07	4.11E-07	5.72E-06	1.20E-04	1.87E-05
Te-127	1.75E-10	8.03E-11	3.87E-11	1.32E-10	6.37E-10	8.14E-07	7.17E-06
Te-129m	1.22E-06	5.84E-07	1.98E-07	4.30E-07	4.57E-06	1.45E-04	4.79E-05
Te-129	6.22E-12	2.99E-12	1.55E-12	4.87E-12	2.34E-11	2.42E-07	1.96E-08
Te-131m	8.74E-09	5.45E-09	3.63E-09	6.88E-09	3.86E-08	1.82E-05	6.95E-05
Te-131	1.39E-12	7.44E-13	4.49E-13	1.17E-12	5.46E-12	1.74E-07	2.30E-09
Te-132	3.25E-08	2.69E-08	2.02E-08	2.37E-08	1.82E-07	3.60E-05	6.37E-05
I-130	5.72E-07	1.68E-06	6.60E-07	1.42E-04	2.61E-06	0.00E+00	9.61E-07
I-131	3.15E-06	4.47E-06	2.56E-06	1.49E-03	7.66E-06	0.00E+00	7.85E-07
I-132	1.45E-07	4.07E-07	1.45E-07	1.43E-05	6.48E-07	0.00E+00	5.08E-08
I-133	1.08E-06	1.85E-06	5.65E-07	2.69E-04	3.23E-06	0.00E+00	1.11E-06
I-134	8.05E-08	2.16E-07	7.69E-08	3.73E-06	3.44E-07	0.00E+00	1.26E-10
I-135	3.35E-07	8.73E-07	3.21E-07	5.60E-05	1.39E-06	0.00E+00	6.56E-07
Cs-134	4.66E-05	1.06E-04	9.10E-05	0.00E+00	3.59E-05	1.22E-05	1.30E-06
Cs-136	4.88E-06	1.83E-05	1.38E-05	0.00E+00	1.07E-05	1.50E-06	1.46E-06
Cs-137	5.98E-05	7.76E-05	5.35E-05	0.00E+00	2.78E-05	9.40E-06	1.05E-06
Cs-138	4.14E-08	7.76E-08	4.05E-08	0.00E+00	6.00E-08	6.07E-09	2.33E-13
Ba-139	1.17E-10	8.32E-14	3.42E-12	0.00E+00	7.78E-14	4.70E-07	1.12E-07
Ba-140	4.88E-06	6.13E-09	3.21E-07	0.00E+00	2.09E-09	1.59E-04	2.73E-05
Ba-141	1.25E-11	9.41E-15	4.20E-13	0.00E+00	8.75E-15	2.42E-07	1.45E-17
Ba-142	3.29E-12	3.38E-15	2.07E-13	0.00E+00	2.86E-15	1.49E-07	1.96E-26
La-140	4.30E-08	2.17E-08	5.73E-09	0.00E+00	0.00E+00	1.70E-05	5.73E-05
La-142	8.54E-11	3.88E-11	9.65E-12	0.00E+00	0.00E+00	7.91E-07	2.64E-07
Ce-141	2.49E-06	1.69E-06	1.91E-07	0.00E+00	7.83E-07	4.52E-05	1.50E-05
Ce-143	2.33E-08	1.72E-08	1.91E-09	0.00E+00	7.60E-09	9.97E-06	2.83E-05
Ce-144	4.29E-04	1.79E-04	2.30E-05	0.00E+00	1.06E-04	9.72E-04	1.02E-04
Pr-143	1.17E-06	4.69E-07	5.80E-08	0.00E+00	2.70E-07	3.51E-05	2.50E-05
Pr-144	3.76E-12	1.56E-12	1.91E-13	0.00E+00	8.81E-13	1.27E-07	2.69E-18
Nd-147	6.59E-07	7.62E-07	4.56E-08	0.00E+00	4.45E-07	2.76E-05	2.16E-05
W-187	1.06E-09	8.85E-10	3.10E-10	0.00E+00	0.00E+00	3.63E-06	1.94E-05
Np-239	2.87E-08	2.82E-09	1.55E-09	0.00E+00	8.75E-09	4.70E-06	1.49E-05

## Reference:

Dose Factors for Co-57, Zn-69m, Br-82, Nb-97, Sb-124, Sb-125, Sn-125 are from Reference 17, Table 8.  
All others from: Regulatory Guide 1.109, Table E-7.

NOTE: The tritium dose factor for bone is assumed to be equal to the total body dose factor. This assumes that tritium will act similarly in all organs (Reference 24).

Table 7.7 - INHALATION DOSE FACTORS - DF<sub>iao</sub>

(mrem/pCi inhaled)

(Page 3 of 8)

TEEN

Nuclide	bone	liver	total body	thyroid	kidney	lung	GI-LLI
H-3	1.59E-07	1.59E-07	1.59E-07	1.59E-07	1.59E-07	1.59E-07	1.59E-07
C-14	3.25E-06	6.09E-07	6.09E-07	6.09E-07	6.09E-07	6.09E-07	6.09E-07
Na-24	1.72E-06	1.72E-06	1.72E-06	1.72E-06	1.72E-06	1.72E-06	1.72E-06
P-32	2.36E-04	1.37E-05	8.95E-06	0.00E+00	0.00E+00	0.00E+00	1.16E-05
Cr-51	0.00E+00	0.00E+00	1.69E-08	9.37E-09	3.84E-09	2.62E-06	3.75E-07
Mn-54	0.00E+00	6.39E-06	1.05E-06	0.00E+00	1.59E-06	2.48E-04	8.35E-06
Mn-56	0.00E+00	2.12E-10	3.15E-11	0.00E+00	2.24E-10	1.90E-06	7.18E-06
Fe-55	4.18E-06	2.98E-06	6.93E-07	0.00E+00	0.00E+00	1.55E-05	7.99E-07
Fe-59	1.99E-06	4.62E-06	1.79E-06	0.00E+00	0.00E+00	1.91E-04	2.23E-05
Co-57	0.00E+00	1.18E-07	1.15E-07	0.00E+00	0.00E+00	7.33E-05	3.93E-06
Co-58	0.00E+00	2.59E-07	3.47E-07	0.00E+00	0.00E+00	1.68E-04	1.19E-05
Co-60	0.00E+00	1.89E-06	2.48E-06	0.00E+00	0.00E+00	1.09E-03	3.24E-05
Ni-63	7.25E-05	5.43E-06	2.47E-06	0.00E+00	0.00E+00	3.84E-05	1.77E-06
Ni-65	2.73E-10	3.66E-11	1.59E-11	0.00E+00	0.00E+00	1.17E-06	4.59E-06
Cu-64	0.00E+00	2.54E-10	1.06E-10	0.00E+00	8.01E-10	1.39E-06	7.68E-06
Zn-65	4.82E-06	1.67E-05	7.80E-06	0.00E+00	1.08E-05	1.55E-04	5.83E-06
Zn-69	6.04E-12	1.15E-11	8.07E-13	0.00E+00	7.53E-12	1.98E-07	3.56E-08
Zn-69m	1.44E-09	3.39E-09	3.11E-10	0.00E+00	2.06E-09	3.92E-06	2.14E-05
Br-82	0.00E+00	0.00E+00	2.28E-06	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Br-83	0.00E+00	0.00E+00	4.30E-08	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Br-84	0.00E+00	0.00E+00	5.41E-08	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Br-85	0.00E+00	0.00E+00	2.29E-09	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Rb-86	0.00E+00	2.38E-05	1.05E-05	0.00E+00	0.00E+00	0.00E+00	2.21E-06
Rb-88	0.00E+00	6.82E-08	3.40E-08	0.00E+00	0.00E+00	0.00E+00	3.65E-15
Rb-89	0.00E+00	4.40E-08	2.91E-08	0.00E+00	0.00E+00	0.00E+00	4.22E-17
Sr-89	5.43E-05	0.00E+00	1.56E-06	0.00E+00	0.00E+00	3.02E-04	4.64E-05
Sr-90	1.35E-02	0.00E+00	8.35E-04	0.00E+00	0.00E+00	2.06E-03	9.56E-05
Sr-91	1.10E-08	0.00E+00	4.39E-10	0.00E+00	0.00E+00	7.59E-06	3.24E-05
Sr-92	1.19E-09	0.00E+00	5.08E-11	0.00E+00	0.00E+00	3.43E-06	1.49E-05
Y-90	3.73E-07	0.00E+00	1.00E-08	0.00E+00	0.00E+00	3.66E-05	6.99E-05
Y-91m	4.63E-11	0.00E+00	1.77E-12	0.00E+00	0.00E+00	4.00E-07	3.77E-09
Y-91	8.26E-05	0.00E+00	2.21E-06	0.00E+00	0.00E+00	3.67E-04	5.11E-05
Y-92	1.84E-09	0.00E+00	5.36E-11	0.00E+00	0.00E+00	3.35E-06	2.06E-05
Y-93	1.69E-08	0.00E+00	4.65E-10	0.00E+00	0.00E+00	1.04E-05	7.24E-05
Zr-95	1.82E-05	5.73E-06	3.94E-06	0.00E+00	8.42E-06	3.36E-04	1.86E-05
Zr-97	1.72E-08	3.40E-09	1.57E-09	0.00E+00	5.15E-09	1.62E-05	7.88E-05
Nb-95	2.32E-06	1.29E-06	7.08E-07	0.00E+00	1.25E-06	9.39E-05	1.21E-05
Nb-97	3.92E-11	9.72E-12	3.55E-12	0.00E+00	1.14E-11	4.91E-07	2.71E-07
Mo-99	0.00E+00	2.11E-08	4.03E-09	0.00E+00	5.14E-08	1.92E-05	3.36E-05
Tc-99m	1.73E-13	4.83E-13	6.24E-12	0.00E+00	7.20E-12	1.44E-07	7.66E-07
Tc-101	7.40E-15	1.05E-14	1.03E-13	0.00E+00	1.90E-13	8.34E-08	1.09E-16
Ru-103	2.63E-07	0.00E+00	1.12E-07	0.00E+00	9.29E-07	9.79E-05	1.36E-05
Ru-105	1.40E-10	0.00E+00	5.42E-11	0.00E+00	1.76E-10	2.27E-06	1.13E-05
Ru-106	1.23E-05	0.00E+00	1.55E-06	0.00E+00	2.38E-05	2.01E-03	1.20E-04

Table 7.7 - INHALATION DOSE FACTORS - DF<sub>iao</sub>

(mrem/pCi inhaled)

(Page 4 of 8)

TEEN

Nuclide	bone	liver	total body	thyroid	kidney	lung	GI-LLI
Ag-110m	1.73E-06	1.64E-06	9.99E-07	0.00E+00	3.13E-06	8.44E-04	3.41E-05
Sb-124	5.38E-06	9.92E-08	2.10E-06	1.22E-08	0.00E+00	4.81E-04	4.98E-05
Sb-125	9.23E-06	1.01E-07	2.15E-06	8.80E-09	0.00E+00	3.42E-04	1.24E-05
Sn-125	1.66E-06	4.42E-08	9.99E-08	3.45E-08	0.00E+00	1.26E-04	7.29E-05
Te-125m	6.10E-07	2.80E-07	8.34E-08	1.75E-07	0.00E+00	6.70E-05	9.38E-06
Te-127m	2.25E-06	1.02E-06	2.73E-07	5.48E-07	8.17E-06	2.07E-04	1.99E-05
Te-127	2.51E-10	1.14E-10	5.52E-11	1.77E-10	9.10E-10	1.40E-06	1.01E-05
Te-129m	1.74E-06	8.23E-07	2.81E-07	5.72E-07	6.49E-06	2.47E-04	5.06E-05
Te-129	8.87E-12	4.22E-12	2.20E-12	6.48E-12	3.32E-11	4.12E-07	2.02E-07
Te-131m	1.23E-08	7.51E-09	5.03E-09	9.06E-09	5.49E-08	2.97E-05	7.76E-05
Te-131	1.97E-12	1.04E-12	6.30E-13	1.55E-12	7.72E-12	2.92E-07	1.89E-09
Te-132	4.50E-08	3.63E-08	2.74E-08	3.07E-08	2.44E-07	5.61E-05	5.79E-05
I-130	7.80E-07	2.24E-06	8.96E-07	1.86E-04	3.44E-06	0.00E+00	1.14E-06
I-131	4.43E-06	6.14E-06	3.30E-06	1.83E-03	1.05E-05	0.00E+00	8.11E-07
I-132	1.99E-07	5.47E-07	1.97E-07	1.89E-05	8.65E-07	0.00E+00	1.59E-07
I-133	1.52E-06	2.56E-06	7.78E-07	3.65E-04	4.49E-06	0.00E+00	1.29E-06
I-134	1.11E-07	2.90E-07	1.05E-07	4.94E-06	4.58E-07	0.00E+00	2.55E-09
I-135	4.62E-07	1.18E-06	4.36E-07	7.76E-05	1.86E-06	0.00E+00	8.69E-07
Cs-134	6.28E-05	1.41E-04	6.86E-05	0.00E+00	4.69E-05	1.83E-05	1.22E-06
Cs-136	6.44E-06	2.42E-05	1.71E-05	0.00E+00	1.38E-05	2.22E-06	1.36E-06
Cs-137	8.38E-05	1.06E-04	3.89E-05	0.00E+00	3.80E-05	1.51E-05	1.06E-06
Cs-138	5.82E-08	1.07E-07	5.58E-08	0.00E+00	8.28E-08	9.84E-09	3.38E-11
Ba-139	1.67E-10	1.18E-13	4.87E-12	0.00E+00	1.11E-13	8.08E-07	8.06E-07
Ba-140	6.84E-06	8.38E-09	4.40E-07	0.00E+00	2.85E-09	2.54E-04	2.86E-05
Ba-141	1.78E-11	1.32E-14	5.93E-13	0.00E+00	1.23E-14	4.11E-07	9.33E-14
Ba-142	4.62E-12	4.63E-15	2.84E-13	0.00E+00	3.92E-15	2.39E-07	5.99E-20
La-140	5.99E-08	2.95E-08	7.82E-09	0.00E+00	0.00E+00	2.68E-05	6.09E-05
La-142	1.20E-10	5.31E-11	1.32E-11	0.00E+00	0.00E+00	1.27E-06	1.50E-06
Ce-141	3.55E-06	2.37E-06	2.71E-07	0.00E+00	1.11E-06	7.67E-05	1.58E-05
Ce-143	3.32E-08	2.42E-08	2.70E-09	0.00E+00	1.08E-08	1.63E-05	3.19E-05
Ce-144	6.11E-04	2.53E-04	3.28E-05	0.00E+00	1.51E-04	1.67E-03	1.08E-04
Pr-143	1.67E-06	6.64E-07	8.28E-08	0.00E+00	3.86E-07	6.04E-05	2.67E-05
Pr-144	5.37E-12	2.20E-12	2.72E-13	0.00E+00	1.26E-12	2.19E-07	2.94E-14
Nd-147	9.83E-07	1.07E-06	6.41E-08	0.00E+00	6.28E-07	4.65E-05	2.28E-05
W-187	1.50E-09	1.22E-09	4.29E-10	0.00E+00	0.00E+00	5.92E-06	2.21E-05
Np-239	4.23E-08	3.99E-09	2.21E-09	0.00E+00	1.25E-08	8.11E-06	1.65E-05

## References:

Dose Factors for Co-57, Zn-69m, Br-82, Nb-97, Sb-124, Sb-125, Sn-125 are from Reference 17, Table 7.  
All others from: Regulatory Guide 1.109, Table E-8.

NOTE: The tritium dose factor for bone is assumed to be equal to the total body dose factor. This assumes that tritium will act similarly in all organs (Reference 24).

Table 7.7 - INHALATION DOSE FACTORS - DF<sub>iao</sub>

(mrem/pCi inhaled)

(Page 5 of 8)

CHILD

Nuclide	bone	liver	total body	thyroid	kidney	lung	GI-LLI
H-3	3.04E-07	3.04E-07	3.04E-07	3.04E-07	3.04E-07	3.04E-07	3.04E-07
C-14	9.70E-06	1.82E-06	1.82E-06	1.82E-06	1.82E-06	1.82E-06	1.82E-06
Na-24	4.35E-06	4.35E-06	4.35E-06	4.35E-06	4.35E-06	4.35E-06	4.35E-06
P-32	7.04E-04	3.09E-05	2.67E-05	0.00E+00	0.00E+00	0.00E+00	1.14E-05
Cr-51	0.00E+00	0.00E+00	4.17E-08	2.31E-08	6.57E-09	4.59E-06	2.93E-07
Mn-54	0.00E+00	1.16E-05	2.57E-06	0.00E+00	2.71E-06	4.26E-04	6.19E-06
Mn-56	0.00E+00	4.48E-10	8.43E-11	0.00E+00	4.52E-10	3.55E-06	3.33E-05
Fe-55	1.28E-05	6.80E-06	2.10E-06	0.00E+00	0.00E+00	3.00E-05	7.75E-07
Fe-59	5.59E-06	9.04E-06	4.51E-06	0.00E+00	0.00E+00	3.43E-04	1.91E-05
Co-57	0.00E+00	2.44E-07	2.88E-07	0.00E+00	0.00E+00	1.37E-04	3.58E-06
Co-58	0.00E+00	4.79E-07	8.55E-07	0.00E+00	0.00E+00	2.99E-04	9.29E-06
Co-60	0.00E+00	3.55E-06	6.12E-06	0.00E+00	0.00E+00	1.91E-03	2.60E-05
Ni-63	2.22E-04	1.25E-05	7.56E-06	0.00E+00	0.00E+00	7.43E-05	1.71E-06
Ni-65	8.08E-10	7.99E-11	4.44E-11	0.00E+00	0.00E+00	2.21E-06	2.27E-05
Cu-64	0.00E+00	5.39E-10	2.90E-10	0.00E+00	1.63E-09	2.59E-06	9.92E-06
Zn-65	1.15E-05	3.06E-05	1.90E-05	0.00E+00	1.93E-05	2.69E-04	4.41E-06
Zn-69	1.81E-11	2.61E-11	2.41E-12	0.00E+00	1.58E-11	3.84E-07	2.75E-06
Zn-69m	4.26E-09	7.28E-09	8.59E-10	0.00E+00	4.22E-09	7.36E-06	2.71E-05
Br-82	0.00E+00	0.00E+00	5.66E-06	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Br-83	0.00E+00	0.00E+00	1.28E-07	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Br-84	0.00E+00	0.00E+00	1.48E-07	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Br-85	0.00E+00	0.00E+00	6.84E-09	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Rb-86	0.00E+00	5.36E-05	3.09E-05	0.00E+00	0.00E+00	0.00E+00	2.16E-06
Rb-88	0.00E+00	1.52E-07	9.90E-08	0.00E+00	0.00E+00	0.00E+00	4.66E-09
Rb-89	0.00E+00	9.33E-08	7.83E-08	0.00E+00	0.00E+00	0.00E+00	5.11E-10
Sr-89	1.62E-04	0.00E+00	4.66E-06	0.00E+00	0.00E+00	5.83E-04	4.52E-05
Sr-90	2.73E-02	0.00E+00	1.74E-03	0.00E+00	0.00E+00	3.99E-03	9.28E-05
Sr-91	3.28E-08	0.00E+00	1.24E-09	0.00E+00	0.00E+00	1.44E-05	4.70E-05
Sr-92	3.54E-09	0.00E+00	1.42E-10	0.00E+00	0.00E+00	6.49E-06	6.55E-05
Y-90	1.11E-06	0.00E+00	2.99E-08	0.00E+00	0.00E+00	7.07E-05	7.24E-05
Y-91m	1.37E-10	0.00E+00	4.98E-12	0.00E+00	0.00E+00	7.60E-07	4.64E-07
Y-91	2.47E-04	0.00E+00	6.59E-06	0.00E+00	0.00E+00	7.10E-04	4.97E-05
Y-92	5.50E-09	0.00E+00	1.57E-10	0.00E+00	0.00E+00	6.46E-06	6.46E-05
Y-93	5.04E-08	0.00E+00	1.38E-09	0.00E+00	0.00E+00	2.01E-05	1.05E-04
Zr-95	5.13E-05	1.13E-05	1.00E-05	0.00E+00	1.61E-05	6.03E-04	1.65E-05
Zr-97	5.07E-08	7.34E-09	4.32E-09	0.00E+00	1.05E-08	3.06E-05	9.49E-05
Nb-95	6.35E-06	2.48E-06	1.77E-06	0.00E+00	2.33E-06	1.66E-04	1.00E-05
Nb-97	1.16E-10	2.08E-11	9.74E-12	0.00E+00	2.31E-11	9.23E-07	7.52E-06
Mo-99	0.00E+00	4.66E-08	1.15E-08	0.00E+00	1.06E-07	3.66E-05	3.42E-05
Tc-99m	4.81E-13	9.41E-13	1.56E-11	0.00E+00	1.37E-11	2.57E-07	1.30E-06
Tc-101	2.19E-14	2.30E-14	2.91E-13	0.00E+00	3.92E-13	1.58E-07	4.41E-09
Ru-103	7.55E-07	0.00E+00	2.90E-07	0.00E+00	1.90E-06	1.79E-04	1.21E-05
Ru-105	4.13E-10	0.00E+00	1.50E-10	0.00E+00	3.63E-10	4.30E-06	2.69E-05
Ru-106	3.68E-05	0.00E+00	4.57E-06	0.00E+00	4.97E-05	3.87E-03	1.16E-04

**Table 7.7 - INHALATION DOSE FACTORS -  $DF_{iao}$** 

(mrem/pCi inhaled)

(Page 6 of 8)

CHILD

Nuclide	bone	liver	total body	thyroid	kidney	lung	GI-LLI
Ag-110m	4.56E-06	3.08E-06	2.47E-06	0.00E+00	5.74E-06	1.48E-03	2.71E-05
Sb-124	1.55E-05	2.00E-07	5.41E-06	3.41E-08	0.00E+00	8.76E-04	4.43E-05
Sb-125	2.66E-05	2.05E-07	5.59E-06	2.46E-08	0.00E+00	6.27E-04	1.09E-05
Sn-125	4.95E-06	9.94E-08	2.95E-07	1.03E-07	0.00E+00	2.43E-04	7.17E-05
Te-125m	1.82E-06	6.29E-07	2.47E-07	5.20E-07	0.00E+00	1.29E-04	9.13E-06
Te-127m	6.72E-06	2.31E-06	8.16E-07	1.64E-06	1.72E-05	4.00E-04	1.93E-05
Te-127	7.49E-10	2.57E-10	1.65E-10	5.30E-10	1.91E-09	2.71E-06	1.52E-05
Te-129m	5.19E-06	1.85E-06	8.22E-07	1.71E-06	1.36E-05	4.76E-04	4.91E-05
Te-129	2.64E-11	9.45E-12	6.44E-12	1.93E-11	6.94E-11	7.93E-07	6.89E-06
Te-131m	3.63E-08	1.60E-08	1.37E-08	2.64E-08	1.08E-07	5.56E-05	8.32E-05
Te-131	5.87E-12	2.28E-12	1.78E-12	4.59E-12	1.59E-11	5.55E-07	3.60E-07
Te-132	1.30E-07	7.36E-08	7.12E-08	8.58E-08	4.79E-07	1.02E-04	3.72E-05
I-130	2.21E-06	4.43E-06	2.28E-06	4.99E-04	6.61E-06	0.00E+00	1.38E-06
I-131	1.30E-05	1.30E-05	7.37E-06	4.39E-03	2.13E-05	0.00E+00	7.68E-07
I-132	5.72E-07	1.10E-06	5.07E-07	5.23E-05	1.69E-06	0.00E+00	8.65E-07
I-133	4.48E-06	5.49E-06	2.08E-06	1.04E-03	9.13E-06	0.00E+00	1.48E-06
I-134	3.17E-07	5.84E-07	2.69E-07	1.37E-05	8.92E-07	0.00E+00	2.58E-07
I-135	1.33E-06	2.36E-06	1.12E-06	2.14E-04	3.62E-06	0.00E+00	1.20E-06
Cs-134	1.76E-04	2.74E-04	6.07E-05	0.00E+00	8.93E-05	3.27E-05	1.04E-06
Cs-136	1.76E-05	4.62E-05	3.14E-05	0.00E+00	2.58E-05	3.93E-06	1.13E-06
Cs-137	2.45E-04	2.23E-04	3.47E-05	0.00E+00	7.63E-05	2.81E-05	9.78E-07
Cs-138	1.71E-07	2.27E-07	1.50E-07	0.00E+00	1.68E-07	1.84E-08	7.29E-08
Ba-139	4.98E-10	2.66E-13	1.45E-11	0.00E+00	2.33E-13	1.56E-06	1.56E-05
Ba-140	2.00E-05	1.75E-08	1.17E-06	0.00E+00	5.71E-09	4.71E-04	2.75E-05
Ba-141	5.29E-11	2.95E-14	1.72E-12	0.00E+00	2.56E-14	7.89E-07	7.44E-08
Ba-142	1.35E-11	9.73E-15	7.54E-13	0.00E+00	7.87E-15	4.44E-07	7.41E-10
La-140	1.74E-07	6.08E-08	2.04E-08	0.00E+00	0.00E+00	4.94E-05	6.10E-05
La-142	3.50E-10	1.11E-10	3.49E-11	0.00E+00	0.00E+00	2.35E-06	2.05E-05
Ce-141	1.06E-05	5.28E-06	7.83E-07	0.00E+00	2.31E-06	1.47E-04	1.53E-05
Ce-143	9.89E-08	5.37E-08	7.77E-09	0.00E+00	2.26E-08	3.12E-05	3.44E-05
Ce-144	1.83E-03	5.72E-04	9.77E-05	0.00E+00	3.17E-04	3.23E-03	1.05E-04
Pr-143	4.99E-06	1.50E-06	2.47E-07	0.00E+00	8.11E-07	1.17E-04	2.63E-05
Pr-144	1.61E-11	4.99E-12	8.10E-13	0.00E+00	2.64E-12	4.23E-07	5.32E-08
Nd-147	2.92E-06	2.36E-06	1.84E-07	0.00E+00	1.30E-06	8.87E-05	2.22E-05
W-187	4.41E-09	2.61E-09	1.17E-09	0.00E+00	0.00E+00	1.11E-05	2.46E-05
Np-239	1.26E-07	9.04E-09	6.35E-09	0.00E+00	2.63E-08	1.57E-05	1.73E-05

## Reference:

Dose Factors for Co-57, Zn-69m, Br-82, Nb-97, Sb-124, Sb-125, Sn-125 are from Reference 17, Table 6.  
All others from: Regulatory Guide 1.109, Table E-9.

NOTE: The tritium dose factor for bone is assumed to be equal to the total body dose factor. This assumes that tritium will act similarly in all organs (Reference 24).

Table 7.7 - INHALATION DOSE FACTORS -  $Df_{iao}$ 

(mrem/pCi inhaled)

(Page 7 of 8)

INFANT

Nuclide	bone	liver	total body	thyroid	kidney	lung	GI-LLI
H-3	4.62E-07	4.62E-07	4.62E-07	4.62E-07	4.62E-07	4.62E-07	4.62E-07
C-14	1.89E-05	3.79E-06	3.79E-06	3.79E-06	3.79E-06	3.79E-06	3.79E-06
Na-24	7.54E-06	7.54E-06	7.54E-06	7.54E-06	7.54E-06	7.54E-06	7.54E-06
P-32	1.45E-03	8.03E+05	5.53E-05	0.00E+00	0.00E+00	0.00E+00	1.15E-05
Cr-51	0.00E+00	0.00E+00	6.39E-08	4.11E-08	9.45E-09	9.17E-06	2.55E-07
Mn-54	0.00E+00	1.81E-05	3.56E-06	0.00E+00	3.56E-06	7.14E-04	5.04E-06
Mn-56	0.00E+00	1.10E-09	1.58E-10	0.00E+00	7.86E-10	8.95E-06	5.12E-05
Fe-55	1.41E-05	8.39E-06	2.38E-06	0.00E+00	0.00E+00	6.21E-05	7.82E-07
Fe-59	9.69E-06	1.68E-05	6.77E-06	0.00E+00	0.00E+00	7.25E-04	1.77E-05
Co-57	0.00E+00	4.65E-07	4.58E-07	0.00E+00	0.00E+00	2.71E-04	3.47E-06
Co-58	0.00E+00	8.71E-07	1.30E-06	0.00E+00	0.00E+00	5.55E-04	7.95E-06
Co-60	0.00E+00	5.73E-06	8.41E-06	0.00E+00	0.00E+00	3.22E-03	2.28E-05
Ni-63	2.42E-04	1.46E-05	8.29E-06	0.00E+00	0.00E+00	1.49E-04	1.73E-06
Ni-65	1.71E-09	2.03E-10	8.79E-11	0.00E+00	0.00E+00	5.80E-06	3.58E-05
Cu-64	0.00E+00	1.34E-09	5.53E-10	0.00E+00	2.84E-09	6.64E-06	1.07E-05
Zn-65	1.38E-05	4.47E-05	2.22E-05	0.00E+00	2.32E-05	4.62E-04	3.67E-05
Zn-69	3.85E-11	6.91E-11	5.13E-12	0.00E+00	2.87E-11	1.05E-06	9.44E-06
Zn-69m	8.98E-09	1.84E-08	1.67E-09	0.00E+00	7.45E-09	1.91E-05	2.92E-05
Br-82	0.00E+00	0.00E+00	9.49E-06	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Br-83	0.00E+00	0.00E+00	2.72E-07	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Br-84	0.00E+00	0.00E+00	2.86E-07	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Br-85	0.00E+00	0.00E+00	1.46E-08	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Rb-86	0.00E+00	1.36E-04	6.30E-05	0.00E+00	0.00E+00	0.00E+00	2.17E-06
Rb-88	0.00E+00	3.98E-07	2.05E-07	0.00E+00	0.00E+00	0.00E+00	2.42E-07
Rb-89	0.00E+00	2.29E-07	1.47E-07	0.00E+00	0.00E+00	0.00E+00	4.87E-08
Sr-89	2.84E-04	0.00E+00	8.15E-06	0.00E+00	0.00E+00	1.45E-03	4.57E-05
Sr-90	2.92E-02	0.00E+00	1.85E-03	0.00E+00	0.00E+00	8.03E-03	9.36E-05
Sr-91	6.83E-08	0.00E+00	2.47E-09	0.00E+00	0.00E+00	3.76E-05	5.24E-05
Sr-92	7.50E-09	0.00E+00	2.79E-10	0.00E+00	0.00E+00	1.70E-05	1.00E-04
Y-90	2.35E-06	0.00E+00	6.30E-08	0.00E+00	0.00E+00	1.92E-04	7.43E-05
Y-91m	2.91E-10	0.00E+00	9.90E-12	0.00E+00	0.00E+00	1.99E-06	1.68E-06
Y-91	4.20E-04	0.00E+00	1.12E-05	0.00E+00	0.00E+00	1.75E-03	5.02E-05
Y-92	1.17E-08	0.00E+00	3.29E-10	0.00E+00	0.00E+00	1.75E-05	9.04E-05
Y-93	1.07E-07	0.00E+00	2.91E-09	0.00E+00	0.00E+00	5.46E-05	1.19E-04
Zr-95	8.24E-05	1.99E-05	1.45E-05	0.00E+00	2.22E-05	1.25E-03	1.55E-05
Zr-97	1.07E-07	1.83E-08	8.36E-09	0.00E+00	1.85E-08	7.88E-05	1.00E-04
Nb-95	1.12E-05	4.59E-06	2.70E-06	0.00E+00	3.37E-06	3.42E-04	9.05E-06
Nb-97	2.44E-10	5.21E-11	1.88E-11	0.00E+00	4.07E-11	2.37E-06	1.92E-05
Mo-99	0.00E+00	1.18E-07	2.31E-08	0.00E+00	1.89E-07	9.63E-05	3.48E-05
Tc-99m	9.98E-13	2.06E-12	2.66E-11	0.00E+00	2.22E-11	5.79E-07	1.45E-06
Tc-101	4.65E-14	5.88E-14	5.80E-13	0.00E+00	6.99E-13	4.17E-07	6.03E-07
Ru-103	1.44E-06	0.00E+00	4.85E-07	0.00E+00	3.03E-06	3.94E-04	1.15E-05
Ru-105	8.74E-10	0.00E+00	2.93E-10	0.00E+00	6.42E-10	1.12E-05	3.46E-05
Ru-106	6.20E-05	0.00E+00	7.77E-06	0.00E+00	7.61E-05	8.26E-03	1.17E-04

Table 7.7 - INHALATION DOSE FACTORS -  $Df_{iao}$ 

(mrem/pCi inhaled)

(page 8 of 8)

INFANT

Nuclide	bone	liver	total body	thyroid	kidney	lung	GI-LLI
Ag-110m	7.13E-06	5.16E-06	3.57E-06	0.00E+00	7.80E-06	2.62E-03	2.36E-05
Sb-124	2.71E-05	3.97E-07	8.56E-06	7.18E-08	0.00E+00	1.89E-03	4.22E-05
Sb-125	3.69E-05	3.41E-07	7.78E-06	4.45E-08	0.00E+00	1.17E-03	1.05E-05
Sn-125	1.01E-05	2.51E-07	6.00E-07	2.47E-07	0.00E+00	6.43E-04	7.26E-05
Te-125m	3.40E-06	1.42E-06	4.70E-07	1.16E-06	0.00E+00	3.19E-04	9.22E-06
Te-127m	1.19E-05	4.93E-06	1.48E-06	3.48E-06	2.68E-05	9.37E-04	1.95E-05
Te-127	1.59E-09	6.81E-10	3.49E-10	1.32E-09	3.47E-09	7.39E-06	1.74E-05
Te-129m	1.01E-05	4.35E-06	1.59E-06	3.91E-06	2.27E-05	1.20E-03	4.93E-05
Te-129	5.63E-11	2.48E-11	1.34E-11	4.82E-11	1.25E-10	2.14E-06	1.88E-05
Te-131m	7.62E-08	3.93E-08	2.59E-08	6.38E-08	1.89E-07	1.42E-04	8.51E-05
Te-131	1.24E-11	5.87E-12	3.57E-12	1.13E-11	2.85E-11	1.47E-06	5.87E-06
Te-132	2.66E-07	1.69E-07	1.26E-07	1.99E-07	7.39E-07	2.43E-04	3.15E-05
I-130	4.54E-06	9.91E-06	3.98E-06	1.14E-03	1.09E-05	0.00E+00	1.42E-06
I-131	2.71E-05	3.17E-05	1.40E-05	1.06E-02	3.70E-05	0.00E+00	7.56E-07
I-132	1.21E-06	2.53E-06	8.99E-07	1.21E-04	2.82E-06	0.00E+00	1.36E-06
I-133	9.46E-06	1.37E-05	4.00E-06	2.54E-03	1.60E-05	0.00E+00	1.54E-06
I-134	6.58E-07	1.34E-06	4.75E-07	3.18E-05	1.49E-06	0.00E+00	9.21E-07
I-135	2.76E-06	5.43E-06	1.98E-06	4.97E-04	6.05E-06	0.00E+00	1.31E-06
Cs-134	2.83E-04	5.02E-04	5.32E-05	0.00E+00	1.36E-04	5.69E-05	9.53E-07
Cs-136	3.45E-05	9.61E-05	3.78E-05	0.00E+00	4.03E-05	8.40E-06	1.02E-06
Cs-137	3.92E-04	4.37E-04	3.25E-05	0.00E+00	1.23E-04	5.09E-05	9.53E-07
Cs-138	3.61E-07	5.58E-07	2.84E-07	0.00E+00	2.93E-07	4.67E-08	6.26E-07
Ba-139	1.06E-09	7.03E-13	3.07E-11	0.00E+00	4.23E-13	4.25E-06	3.64E-05
Ba-140	4.00E-05	4.00E-08	2.07E-06	0.00E+00	9.59E-09	1.14E-03	2.74E-05
Ba-141	1.12E-10	7.70E-14	3.55E-12	0.00E+00	4.64E-14	2.12E-06	3.39E-06
Ba-142	2.84E-11	2.36E-14	1.40E-12	0.00E+00	1.36E-14	1.11E-06	4.95E-07
La-140	3.61E-07	1.43E-07	3.68E-08	0.00E+00	0.00E+00	1.20E-04	6.06E-05
La-142	7.36E-10	2.69E-10	6.46E-11	0.00E+00	0.00E+00	5.87E-06	4.25E-05
Ce-141	1.98E-05	1.19E-05	1.42E-06	0.00E+00	3.75E-06	3.69E-04	1.54E-05
Ce-143	2.09E-07	1.38E-07	1.58E-08	0.00E+00	4.03E-08	8.30E-05	3.55E-05
Ce-144	2.28E-03	8.65E-04	1.26E-04	0.00E+00	3.84E-04	7.03E-03	1.06E-04
Pr-143	1.00E-05	3.74E-06	4.99E-07	0.00E+00	1.41E-06	3.09E-04	2.66E-05
Pr-144	3.42E-11	1.32E-11	1.72E-12	0.00E+00	4.80E-12	1.15E-06	3.06E-06
Nd-147	5.67E-06	5.81E-06	3.57E-07	0.00E+00	2.25E-06	2.30E-04	2.23E-05
W-187	9.26E-09	6.44E-09	2.23E-09	0.00E+00	0.00E+00	2.83E-05	2.54E-05
Np-239	2.65E-07	2.37E-08	1.34E-08	0.00E+00	4.73E-08	4.25E-05	1.78E-05

## Reference:

Dose Factors for Co-57, Zn-69m, Br-82, Nb-97, Sb-124, Sb-125, Sn-125 are from Reference 17, Table 5.  
All others from: Regulatory Guide 1.109, Table E-10.

NOTE: The tritium dose factor for bone is assumed to be equal to the total body dose factor. This assumes that tritium will act similarly in all organs (Reference 24).

Figure 7.1 - GASEOUS EFFLUENT RELEASE/DISCHARGE POINTS

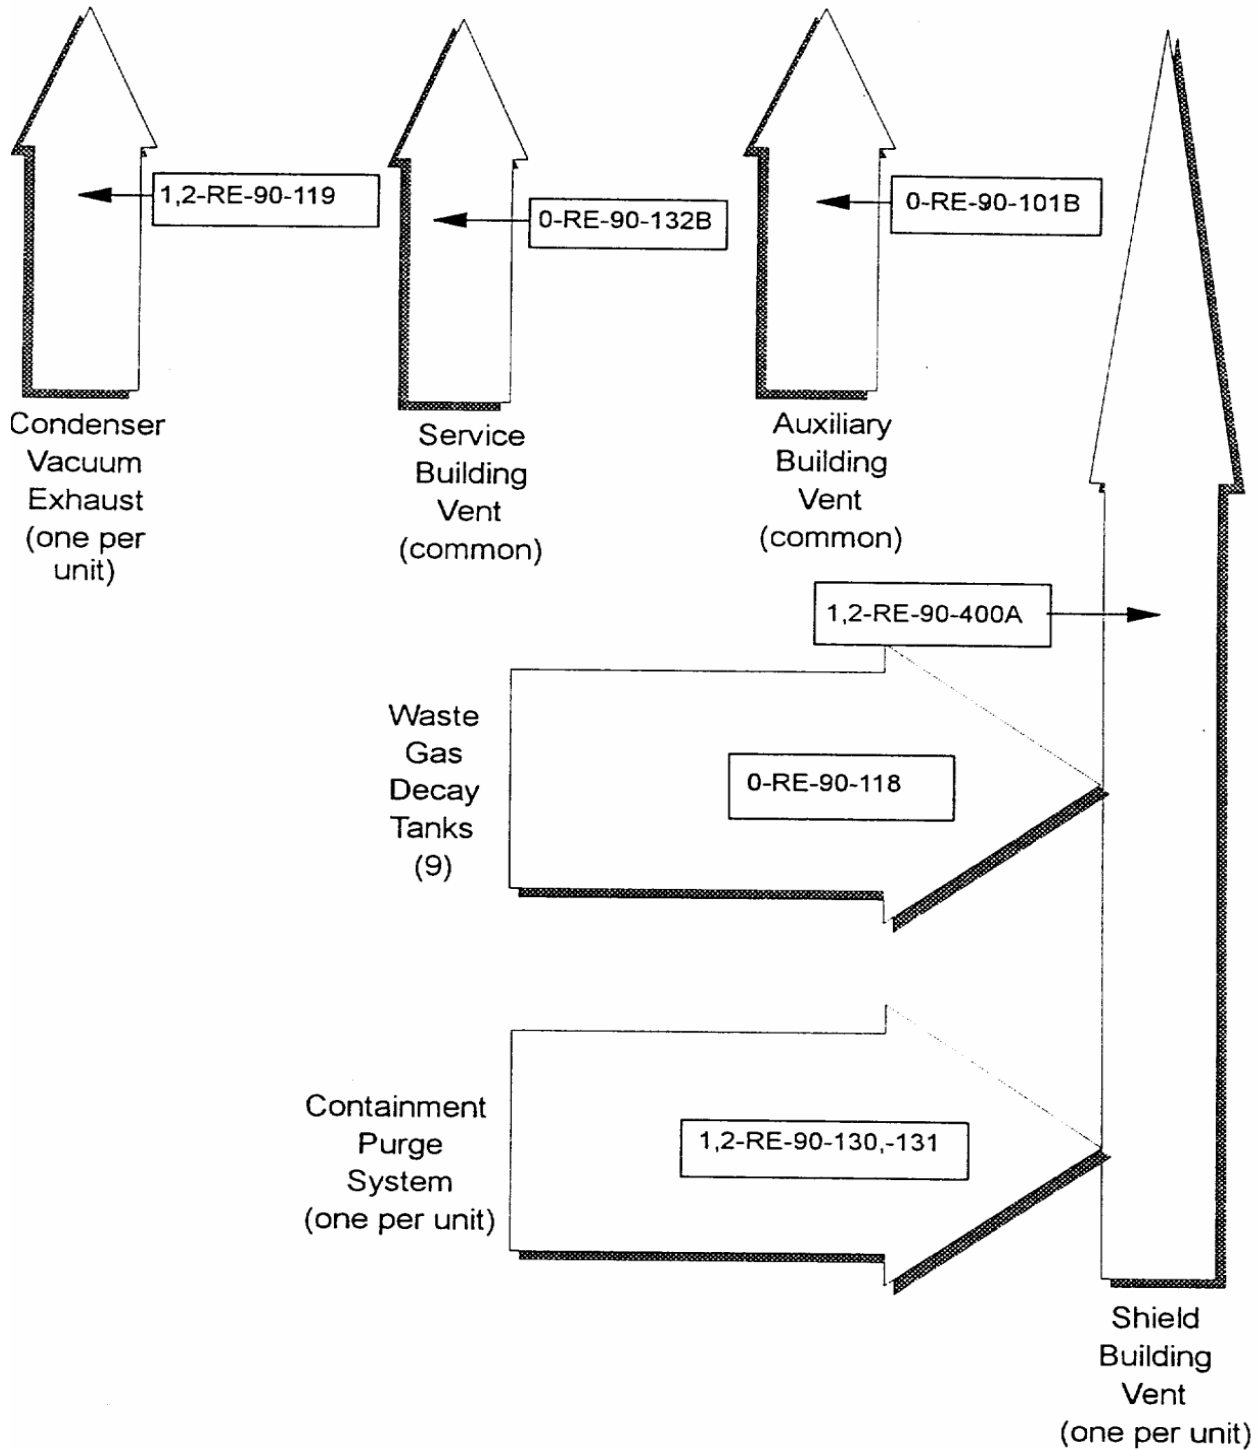


Figure 7.2 - DETAIL OF GASEOUS RELEASE/DISCHARGE POINTS

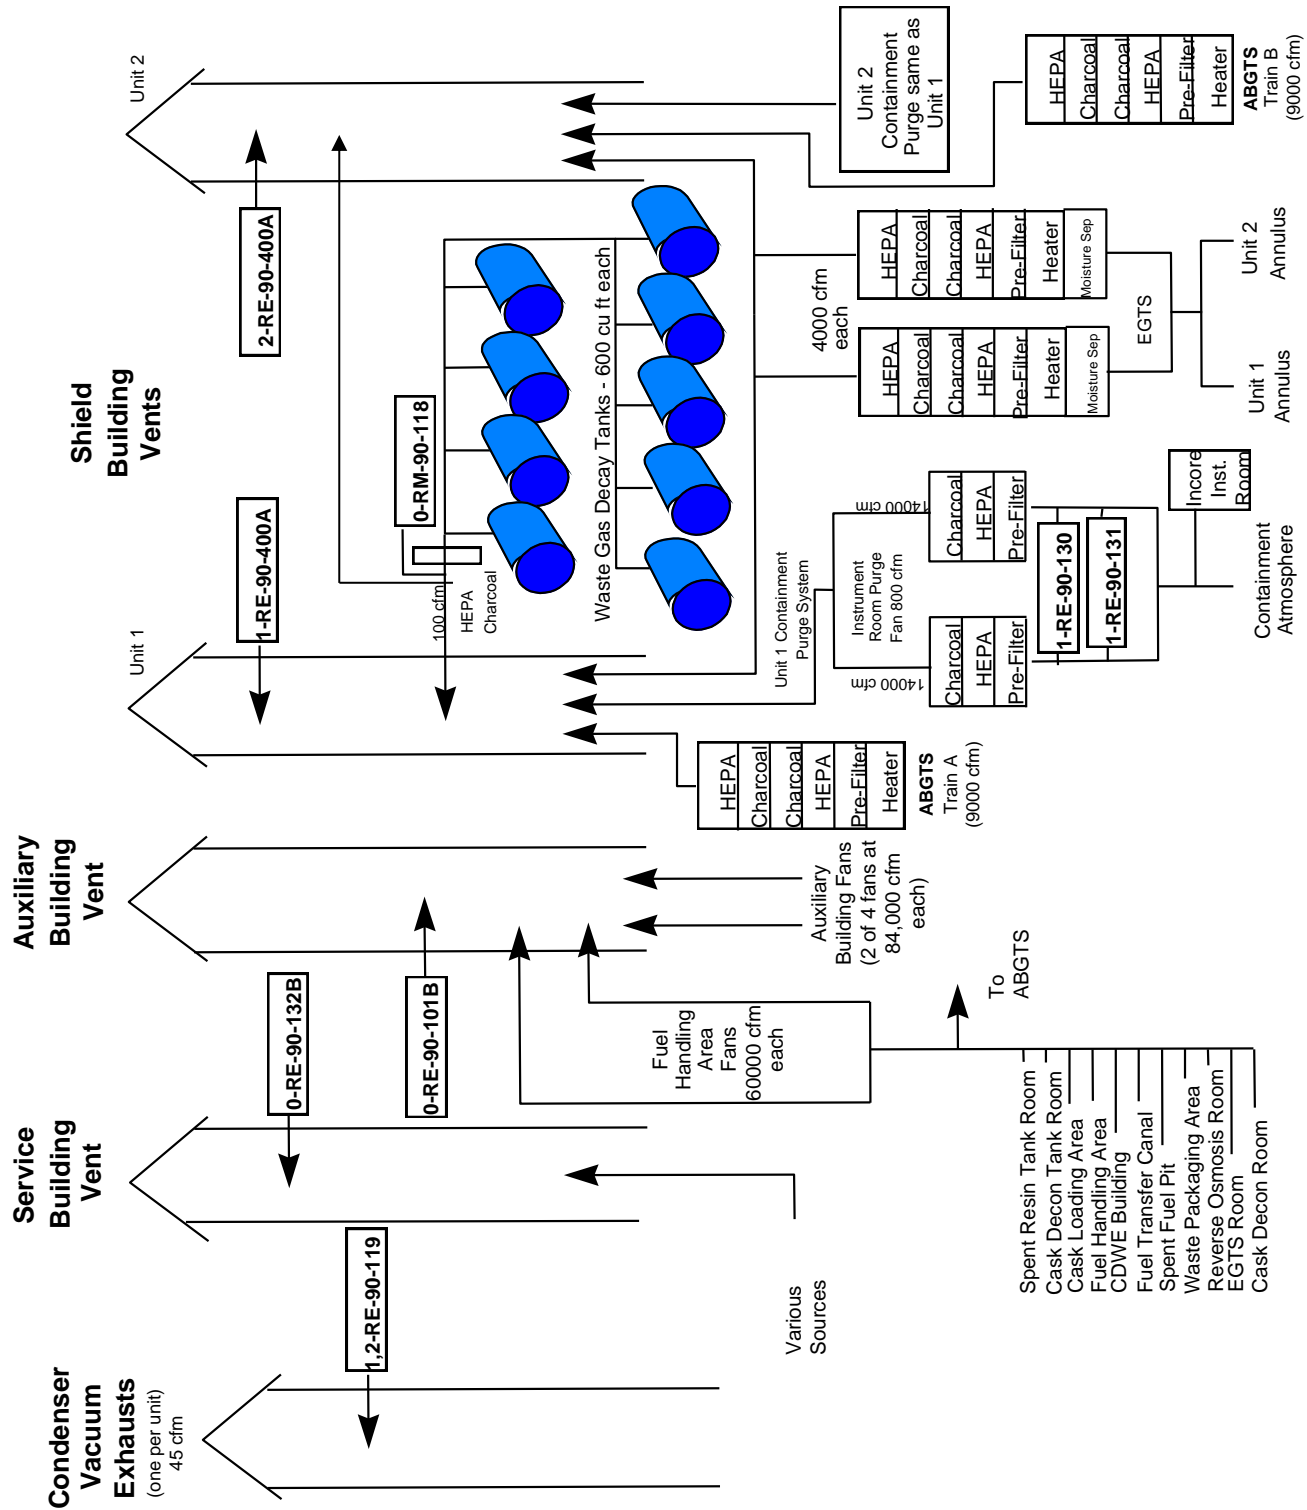


Figure 7.3 - GASEOUS RADWASTE TREATMENT SYSTEM



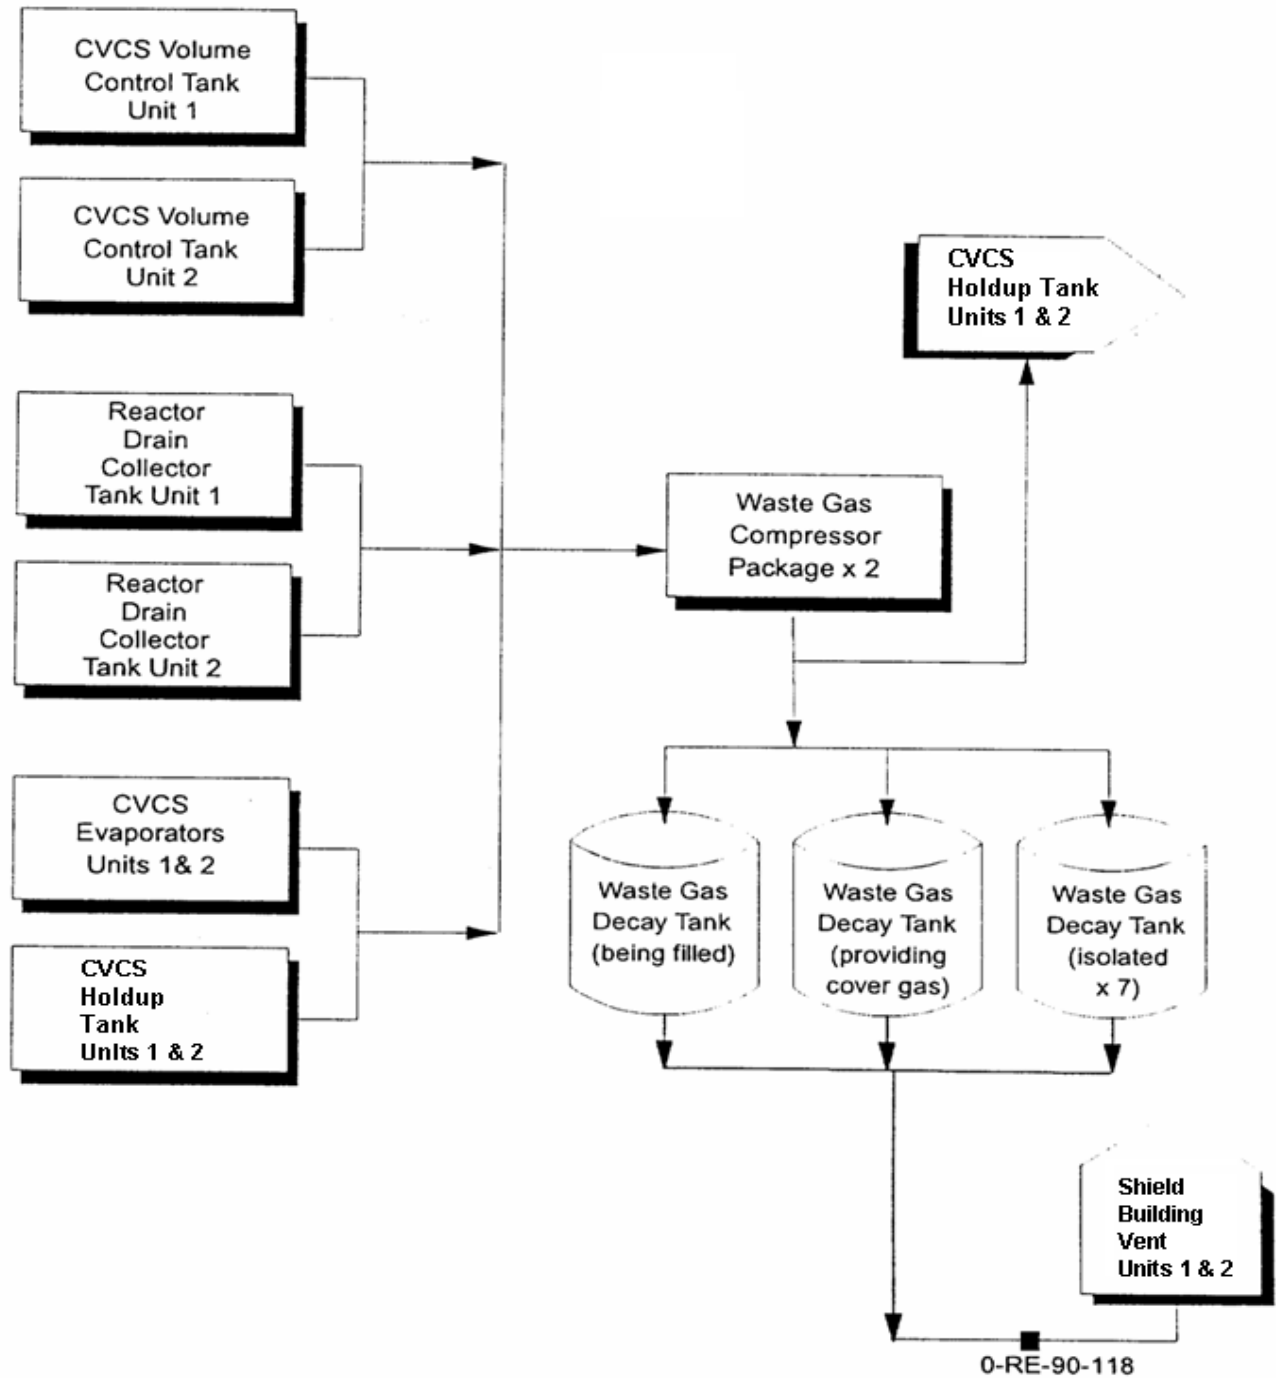


Figure 7.4 - PLUME DEPLETION EFFECT FOR GROUND LEVEL RELEASES  
(All Stability Classes)

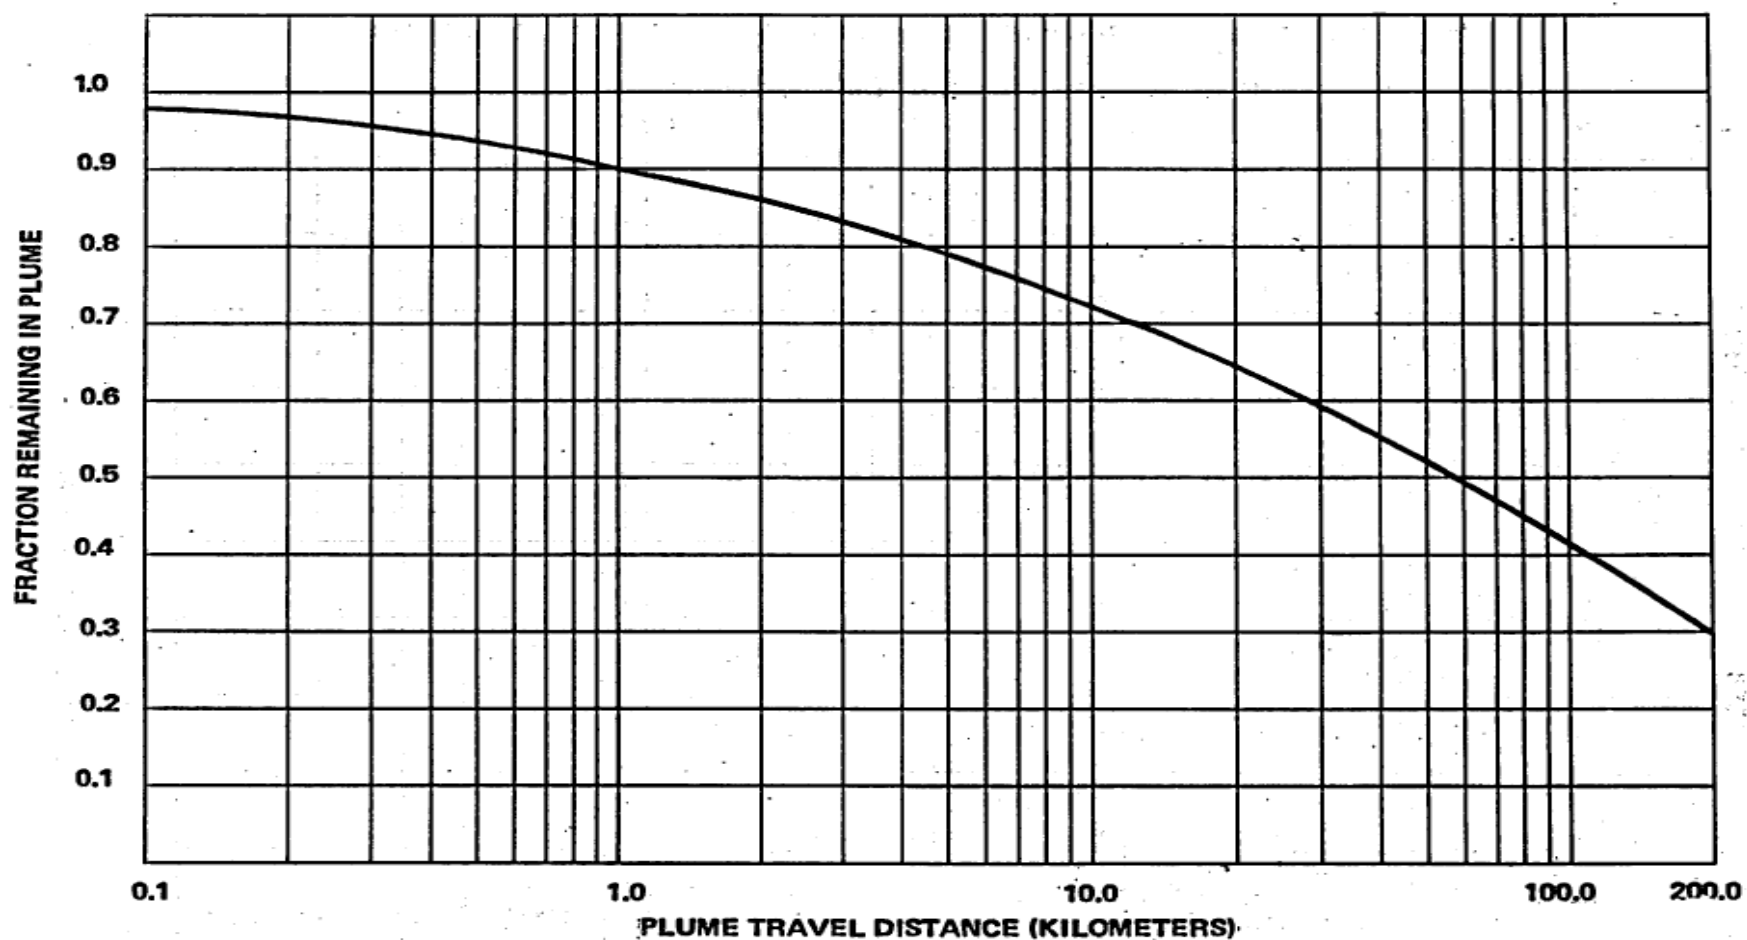


Source: Reference 5, Figure 2

Figure 7.5 - VERTICAL STANDARD DEVIATION OF MATERIAL IN A PLUME

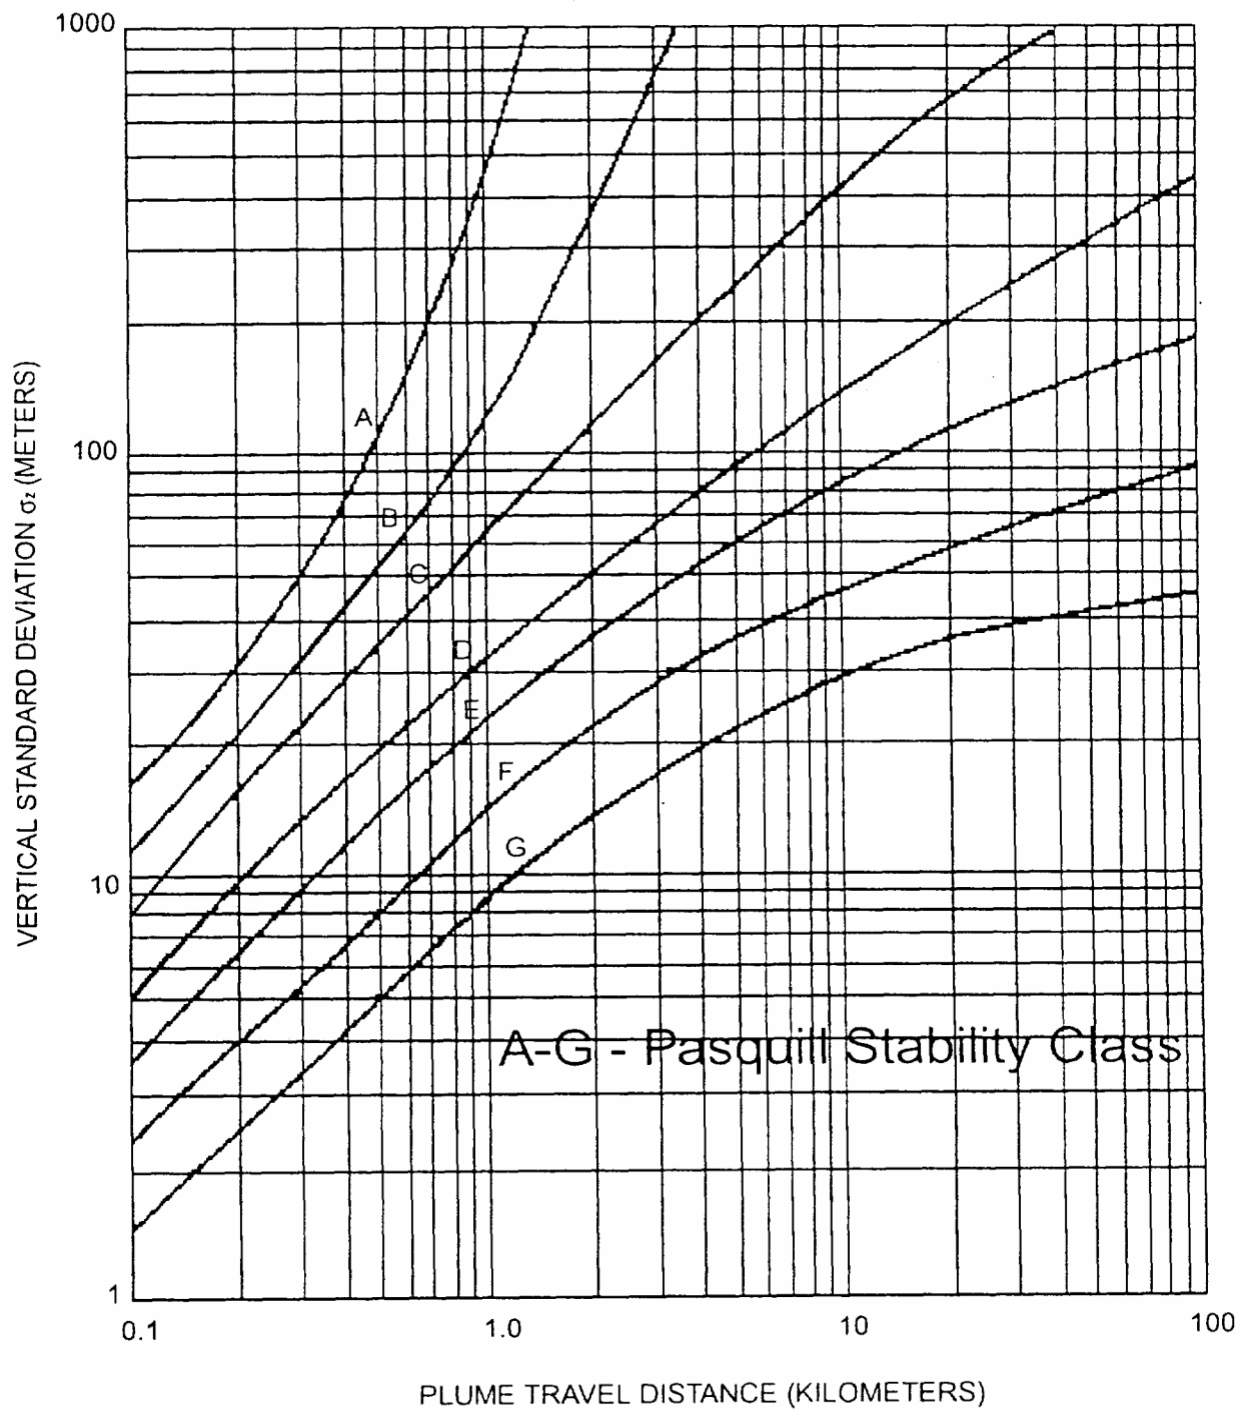

Source: Reference 5, Figure 1

Figure 7.6 - RELATIVE DEPOSITION FOR GROUND LEVEL RELEASES  
(All Stability Classes)

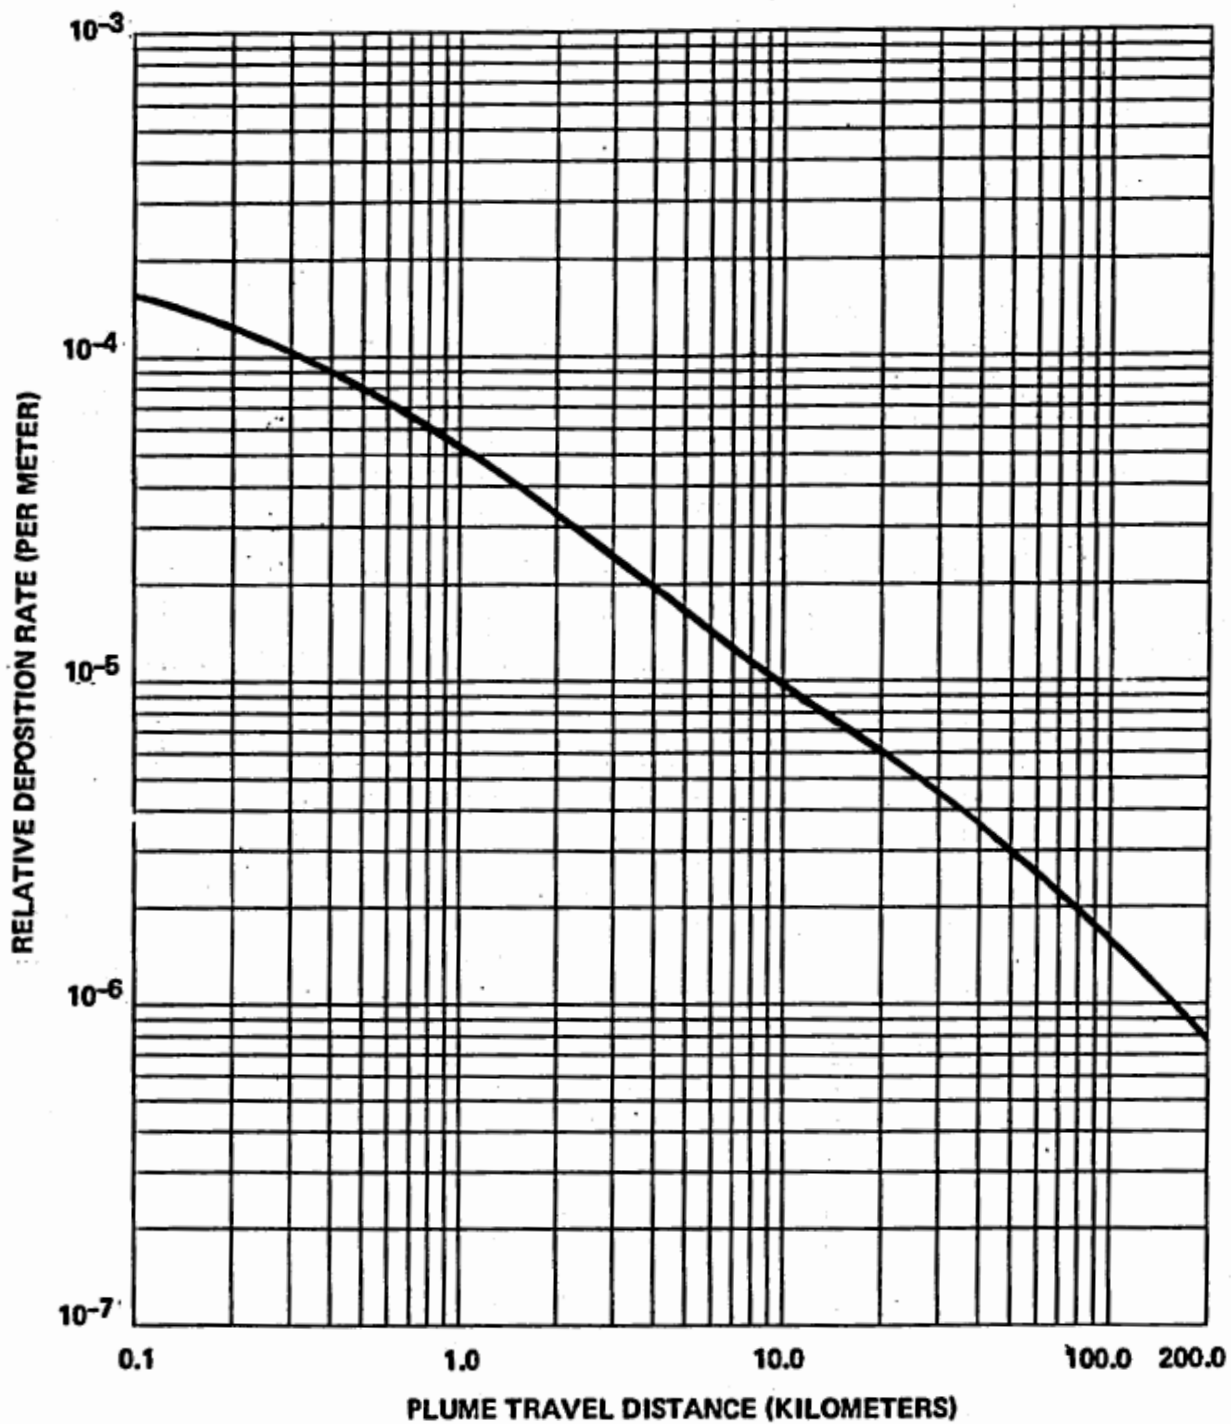

Source: Reference 5, Figure 6

## 8.0 - TOTAL DOSE

### 8.1 TOTAL MAXIMUM INDIVIDUAL DOSES

To determine compliance with 40 CFR 190 as required in ODCM Surveillance Requirement 2.2.3.1 and 2.2.3.2, the dose contributions to the maximum individual from WBN radioactive effluents and all other nearby uranium fuel cycle sources will be considered. The annual dose to the maximum individual will be conservatively estimated by using the following equation:

$$D = \sum_{q=1}^4 D(\text{airtb}) + D(\text{airorg}) + D(\text{liqtb}) + D(\text{liqorg}) + D(\text{direct}) \quad (8.1)$$

where:

q = calendar quarter

D(airtb) = the total body air submersion dose (as calculated in Section 7.7)

D(airorg) = the critical organ dose from gaseous effluents (as calculated in Section 7.7),

D(liqtb) = the total body dose from liquid effluents (as calculated in Section 6.6.4),

D(liqorg) = the critical organ dose from liquid effluents (as calculated in Section 6.6.4),

D(direct) = the direct radiation dose measured by the environmental monitoring program.

The dose calculated is compared to the total body/organ limit of 25 mrem. If the dose is greater than 25 mrem, then the dose to each individual organ will be evaluated separately for comparison to the limits.

## **9.0 - RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM (REMP)**

### **9.1 MONITORING PROGRAM DESCRIPTION**

The REMP shall be conducted in accordance with the requirements of ODCM Control 1.3.1. The monitoring program described in Tables 9.1, 9.2, and 9.3, and in Figures 9.1, 9.2 and 9.3 shall be conducted.

The program consists of 3 major sections corresponding to the atmospheric pathway, the terrestrial pathway, and the waterborne pathway. In the atmospheric monitoring program, samples of air particulates and atmospheric radioiodines are collected from established stations. The stations are identified as Local Monitor (LM) stations, located at or near the UNRESTRICTED AREA BOUNDARY; Perimeter Monitor (PM) stations, located typically 3-10 miles from the site; and Remote Monitor (RM) stations, located greater than 10 miles from the site. The remote monitors are considered as background or control stations.

The terrestrial monitoring program includes the collection of milk, soil, and food crops. In addition, direct gamma radiation levels will be measured in the vicinity of the plant.

The waterborne monitoring program consists of the collection of samples of surface and ground water, drinking water, sediment, and fish. Samples are collected both downstream and upstream from the plant site.

The basic description of the REMP is included in Tables 9.1 and 9.2. Table 9.3 describes the locations of the direct gamma radiation detectors (dosimeter). Figures 9.1, 9.2, and 9.3 show the locations of the stations within one mile of the site, between one and five miles from the site, and greater than 5 miles from the site, respectively.

Deviations are permitted from the required sampling schedule if specimens are unobtainable due to hazardous conditions, sample unavailability, or malfunction of sampling equipment. If the latter, every effort shall be made to complete corrective action prior to the end of the next sampling period. Deviations from the required program will be reported in the Annual Radiological Environmental Operating Report in accordance with the provisions of ODCM Control 1.3.1.a and Administrative Control 5.1. Changes made in the program resulting from unavailability of samples will be reported in accordance with ODCM Control 1.3.1.c.

### **9.2 DETECTION CAPABILITIES**

Analytical techniques shall be such that the detection capabilities listed in Table 2.3-3 are achieved.

### **9.3 LAND USE CENSUS**

A land use survey shall be conducted in accordance with the requirements given in ODCM Control 1.3.2. The results of the survey shall be reported in the Annual Radiological Environmental Operating Report. Changes made in the REMP as a result of the Land Use Census will be reported in accordance with the provisions of ODCM Control 1.3.2.b.

#### **9.4 INTERLABORATORY COMPARISON PROGRAM**

Analyses shall be performed on radioactive materials supplied as part of an Interlaboratory Comparison Program which is in accordance with RG 4.15. A summary of the results obtained in the intercomparison shall be included in the Annual Radiological Environmental Operating Report.

If analyses are not performed as required corrective actions taken to prevent a recurrence shall be reported in the Annual Radiological Environmental Operating Report.

#### **9.5 DATA REVIEW AND REPORTING**

Results of this program shall be reported in accordance with ODCM Administrative Control 5.1, Annual Radiological Environmental Monitoring Report. Analytical results exceeding the reporting levels outlined in ODCM Table 2.3-2 will be reported in accordance with the requirements of ODCM Control 1.3.1.b. As noted in WBN FSAR Section 11.6, routine releases from WBN will result in environmental concentrations well below the detection limits for environmental media, making correlations between calculated effluent release data and environmental measurements impractical. Only if radioactive releases from the site result in statistically measurable increases in environmental levels can dose correlations be made.

**Table 9.1 - REMP - MONITORING, SAMPLING, AND ANALYSIS**  
(Page 1 of 5)

Exposure Pathway and/or Sample	Sample Locations <sup>1</sup>	Sampling and Collection Frequency	Type and Frequency of Analysis
<b>1. DIRECT RADIATION</b>			
	<p>2 or more dosimeters placed at locations (in different sectors) at or near the unrestricted area boundary in each of the 16 sectors.</p> <p>2 or more dosimeters placed at stations located approximately 5 miles from the plant in each of the 16 sectors</p> <p>2 or more dosimeters in at least 8 additional locations of special interest, including at least 2 control stations.</p>	Once per 92 days	Gamma dose at least once per 92 days

**Table 9.1 - REMP - MONITORING, SAMPLING, AND ANALYSIS**

(Page 2 of 5)

Exposure Pathway and/or Sample	Sample Locations <sup>1</sup>	Sampling and Collection Frequency	Type and Frequency of Analysis
<b>2. AIRBORNE</b>			
Particulates and Radioiodines	<p>4 samples from locations (in different sectors) at or near the unrestricted area boundary (LM-1,2,3,and 4)</p> <p>4 samples from communities approximately 6-10 miles distance from the plant. (PM-2,3,4,and 5)</p> <p>2 samples from control locations greater than 10 miles from the plant (RM-2 and 3)</p>	Continuous sampler operation with sample collection once per 7 days (more frequently if required by dust loading)	<p>Particulate samples: Analyze for gross beta radioactivity <math>\geq</math> 24 hours following filter change. Perform gamma isotopic analysis on each sample if gross beta &gt; 10 times that of control sample.</p> <p>Composite at least once per 31 days (by location) for gamma scan.</p> <p>Radioiodine cartridge: I-131 at least once per 7 days</p>
Atmospheric Moisture	<p>4 samples from locations (in different sectors) at or near the SITE BOUNDARY (LM-1,2,3,and 4)</p> <p>2 samples from communities approximately 4-10 miles distance from the plant. (PM-2,5,)</p> <p>1 sample from control location greater than 10 miles from the plant (RM-3)</p>	Continuous sampler operation with sample collection biweekly	Analyze each sample for H-3
Soil	Samples from same location as air particulates.	Once per year	Gamma scan, Sr-89, Sr-90 once per year

**Table 9.1 - REMP - MONITORING, SAMPLING, AND ANALYSIS**  
(Page 3 of 5)

Exposure Pathway and/or Sample	Sample Locations <sup>1</sup>	Sampling and Collection Frequency	Type and Frequency of Analysis
<b>3. WATERBORNE</b>			
Surface	TRM 529.3 TRM 523.1 TRM 517.9	Collected by automatic sequential-type sampler <sup>2</sup> with composite samples collected at least once per 31 days	Gamma scan and H-3 analysis of each sample
Ground	5 sampling locations from ground water monitoring wells adjacent to plant  1 sampling location from groundwater source upgradient from the plant	Collected by automatic sequential-type sampler with composite samples collected at least once per 31 days	Gross beta, gamma scan, and H-3 analysis of each sample
Drinking	1 sample at the first potable surface water supply downstream from the plant (TRM 503.8)  1 sample at the next downstream potable surface water supplier (greater than 10 miles downstream) (TRM 473.0)  1 sample at control location <sup>3</sup> (TRM 529.3)	Collected by automatic sequential type sampler <sup>2</sup> with composite sample collected at least once per 31 days	Gross beta, gamma scan, and H-3 analysis of each sample
Shoreline	TRM 513, TRM 530.2	At least once per 184 days	Gamma scan of each sample.
Pond Sediment	One sample from at least three locations in Yard Holding Pond.	Annually	Gamma scan of each sample.

**Table 9.1 - REMP - MONITORING, SAMPLING, AND ANALYSIS**

(Page 4 of 5)

Exposure Pathway and/or Sample	Sample Locations <sup>1</sup>	Sampling and Collection Frequency	Type and Frequency of Analysis
<b>4. INGESTION</b>			
Milk	<p>1 sample from milk producing animals in each of 1-3 areas indicated by the cow census where doses are calculated to be highest. If samples are not available from a milk animal location, doses to that area may be estimated by projecting the doses from concentrations detected in milk from other sectors or samples of vegetation may be taken monthly where milk is produced but is not available.</p> <p>At least 1 sample from a control location</p>	At least once per 15 days	Gamma isotopic and I-131 analysis of each sample. Sr-89, Sr-90 once per quarter
Fish	<p>One sample of commercially important species (Freshwater Drum or Catfish) and one sample of recreationally important species (Crappie (White or Black), or Bass (Largemouth, Smallmouth, or Spotted)). One sample of each species from downstream of Watts Bar Nuclear Plant, Chickamauga reservoir, and Watts Bar reservoir. One control sample of same species in areas not influenced by plant discharge.</p>	At least once per 184 days.	Gamma scan on edible portion.

**Table 9.1 - REMP - MONITORING, SAMPLING, AND ANALYSIS**

(Page 5 of 5)

Exposure Pathway and/or Sample	Sample Locations <sup>1</sup>	Sampling and Collection Frequency	Type and Frequency of Analysis
Food Products	1 sample each of principal food products grown at private gardens and/or farms in the vicinity of the plant. A control sample from similar food products grown 15 to 30 km distant in the least prevalent wind direction.	At least once per 365 days at the time of harvest. The types of foods available will vary. Following is a list of typical foods which may be available: Cabbage and/or Lettuce Corn Green Beans Potatoes Tomatoes	Gamma scan on edible portion.
Vegetation <sup>4</sup>	Samples from farms producing milk but not providing a milk sample	At least once per 31 days	I-131 and gamma scan at least once per 31 days.

<sup>1</sup> Sample locations, except for Food Products, are listed in Table 9.2 and 9.3, and shown in Figures 9.1, 9.2, and 9.3. The sample locations for Food Products are provided in the Annual Radioactive Effluent Release Report and are based on the current Land Use Survey as addressed in ODCM Surveillance Requirements 2.3.2.

<sup>2</sup> Samples shall be collected by collecting an aliquot at intervals not exceeding 2 hours.

<sup>3</sup> The surface water sample collected at TRM 529.3 is considered a control for the raw drinking water sample.

<sup>4</sup> Vegetation sampling is applicable only for farms that meet the criteria for milk sampling and when milk sampling cannot be performed.

Other Notes: LM = Local Monitor  
PM = Perimeter Monitor  
RM = Remote Monitor  
TRM = Tennessee River Mile

Table 9.2 - REMP - SAMPLING LOCATIONS

Map Location Number	Station <sup>a</sup>	Sector	Approximate Distance (mi)	Indicator (I) or Control(C)	Samples Collected <sup>b</sup>
2	PM-2	NW	7.0	I	AP, CF, S, AM
3	PM-3	NNE	10.4	I	AP, CF, S
4	PM-4	NE/ENE <sup>c</sup>	7.6	I	AP, CF, S
5	PM-5	S	8.0	I	AP, CF, S, AM
6	RM-2	SW	15.0	C	AP, CF, S, AM
7	RM-3	NNW	15.0	C	AP, CF, S, AM
8	LM-1	SSW	0.5	I	AP, CF, S, AM
9	LM-2	NNE	0.4	I	AP, CF, S, AM
10	LM-3	NNE	1.9	I	AP, CF, S, AM
11	LM-4	SE	0.9	I	AP, CF, S, AM
18	Well #1	S	0.6	I	W
20	Farm N	ESE	4.1	I	M
23	Well #5	N	0.5	C	W
25	TRM 517.9	-	9.9 <sup>d</sup>	I	SW
26	TRM 523.1	-	4.7 <sup>d</sup>	I	SW
27	TRM 529.3	-	1.5 <sup>d</sup>	C	SW, PW <sup>e</sup>
31	TRM 473.0 (C.F. Industries)	-	54.8 <sup>d</sup>	I	PW
32	TRM 513.0	-	14.8 <sup>d</sup>	I	SS
33	TRM 530.2	-	2.4 <sup>d</sup>	C	SS
35	TRM 503.8 (Dayton)	-	24.0 <sup>d</sup>	I	PW
37	TRM 522.8-527.8 (Downstream of WBNP)	-	-	I	F
38	TRM 471-530 (Chickamauga Lake)	-	-	I	F
39	TRM 530-602 (Watts Bar Lake)	-	-	C	F
81	Yard Pond	SSE/S/SSW	Onsite	I	PS
82	Well A	SSE	0.6	I	W
83	Well B	SSE	0.5	I	W
84	Well C	ESE	0.3	I	W
85	Well F	SE	0.3	I	W
86	Farm HH	SSW	1.4	I	M
87	Farm BB	SW	18.6	C	M

<sup>a</sup> See Figures 9.1, 9.2, and 9.3<sup>b</sup> Sample codes: AP = Air particulate filter; CF = Charcoal Filter; F = Fish; S = Soil; AM = atmospheric moisture, M = Milk; PW = Public Water; SS = Shoreline Sediment; SW = Surface Water; W= Well Water, PS= Pond Sediment<sup>c</sup> Station located on boundary between these sectors<sup>d</sup> Distance from plant discharge (TRM 527.8)<sup>e</sup> The surface water sample from TRM 529.3 is also considered a control for raw Public Water samples.

Table 9.3 - REMP - DOSIMETRY LOCATIONS

Map Location Number	Station	Sector	Approx. Dist. (mi)	On/ Offsite <sup>a</sup>	Map Location Number	Station	Sector	Approx. Dist. (mi)	On/ Offsite <sup>a</sup>
2	NW-3	NW	7.0	Off	55	SSE-1A	SSE	0.6	On
3	NNE-3	NNE	10.4	Off	56	SSE-2	SSE	5.8	Off
4	ENE-3	ENE	7.6	Off	57	S-1	S	0.7	On
5	S-3	S	7.8	Off	58	S-2	S	4.8	Off
6	SW-3	SW	15.0	Off	59	SSW-1	SSW	0.8	On
7	NNW-4	NNW	15.0	Off	60	SSW-3	SSW	5.0	Off
10	NNE-1A	NNE	1.9	On	62	SW-1	SW	0.8	On
11	SE-1A	SE	0.9	On	63	SW-2	SW	5.3	Off
12	SSW-2	SSW	1.3	On	64	WSW-1	WSW	0.9	On
14	W-2	W	4.8	Off	65	WSW-2	WSW	3.9	Off
40	N-1	N	1.2	On	66	W-1	W	0.9	On
41	N-2	N	4.7	Off	67	WNW-1	WNW	0.9	On
42	NNE-1	NNE	1.2	On	68	WNW-2	WNW	4.9	Off
43	NNE-2	NNE	4.1	Off	69	NW-1	NW	1.1	On
44	NE-1	NE	0.9	On	70	NW-2	NW	4.7	Off
45	NE-2	NE	2.9	Off	71	NNW-1	NNW	1.0	On
46	NE-3	NE	6.1	Off	72	NNW-2	NNW	4.5	Off
47	ENE-1	ENE	0.7	On	73	NNW-3	NNW	7.0	Off
48	ENE-2	ENE	5.8	Off	74	ENE-2A	ENE	3.5	Off
49	E-1	E	1.3	On	75	SE-2A	SE	3.1	Off
50	E-2	E	5.0	Off	76	S-2A	S	2.0	Off
51	ESE-1	ESE	1.2	On	77	W-2A	W	3.2	Off
52	ESE-2	ESE	4.4	Off	78	NW-2A	NW	3.0	Off
54	SE-2	SE	5.3	Off	79	SSE-1	SE	0.5	On

<sup>a</sup> Dosimeters designated onsite (On ) are those located two miles or less from the plant. Dosimeters designated offsite (Off) are those located more than two miles from the plant.

Figure 9.1 - REMP LOCATIONS WITHIN ONE MILE OF THE PLANT


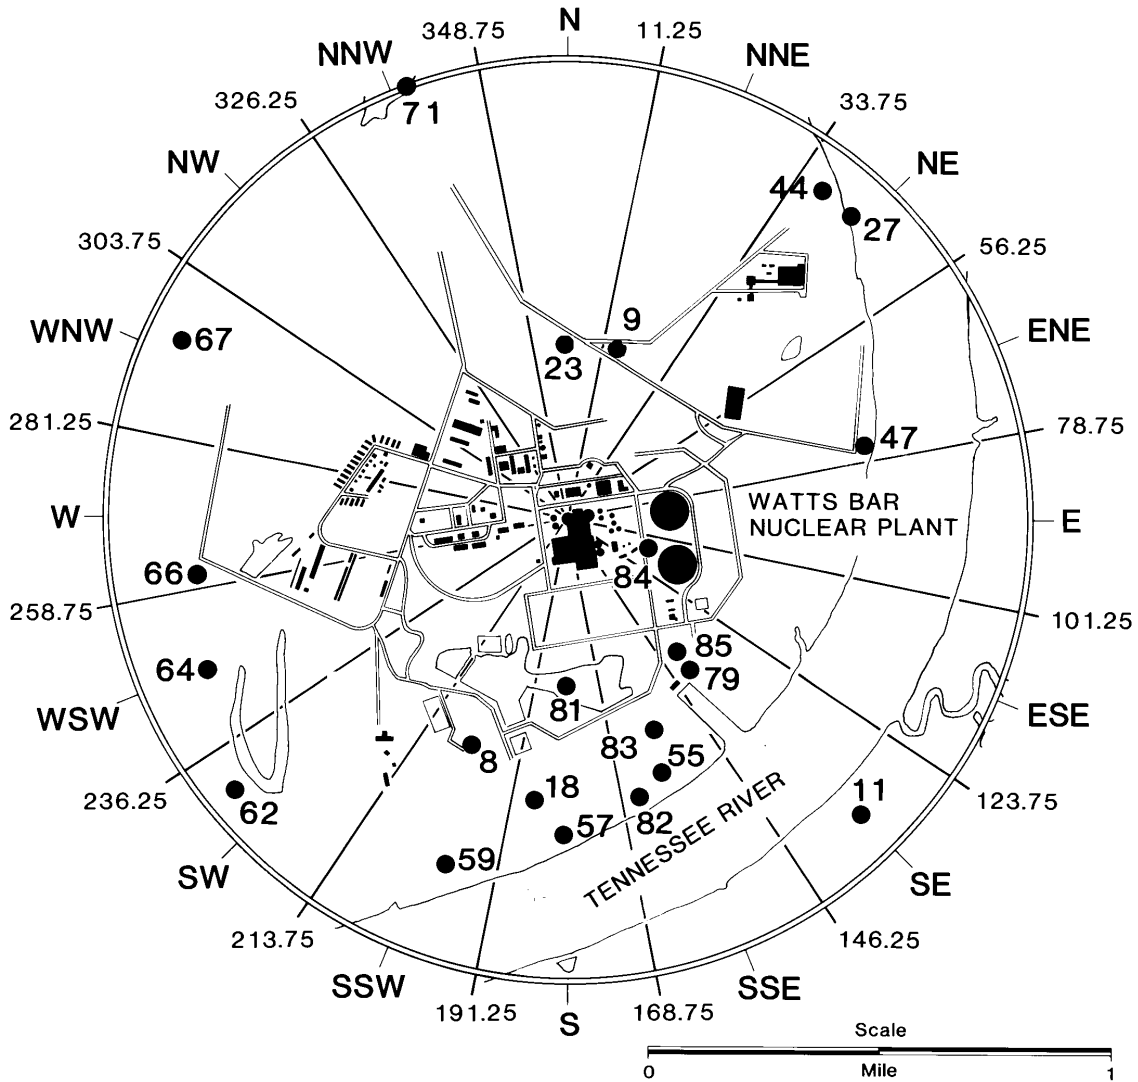


Figure 9.2 - REMP LOCATIONS FROM ONE TO FIVE MILES FROM THE PLANT



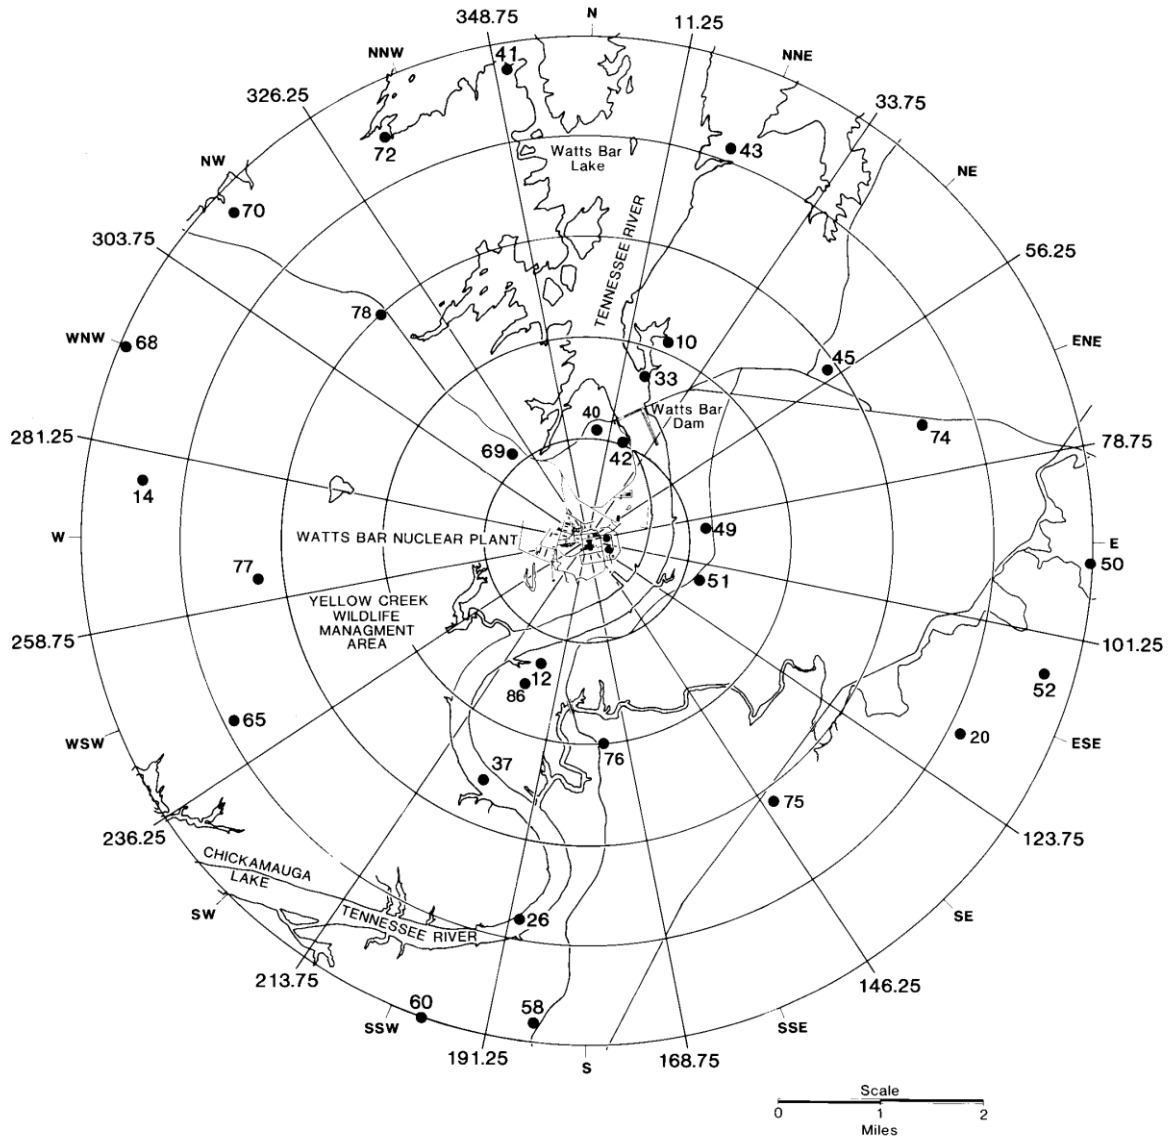

## **10.0 REFERENCES**

1. NUREG-1301, "Offsite Dose Calculation Manual Guidance: Standard Radiological Effluent Controls for Pressurized Water Reactors," Generic Letter 89-01, Supplement No. 1. April 1991.
2. Draft NRC Generic Letter, "Guidance for Modification of Technical Specifications to Reflect (a) Revisions to 10 CFR Part 20, 'Standards for Protection Against Radiation' and 10 CFR 50.36a, 'Technical Specifications on Effluents from Nuclear Power Reactors', (b) Related Current Industry Initiatives and (c) Miscellaneous Related Editorial Clarifications."
3. NUREG-0133, "Preparation of Radiological Effluent Technical Specifications for Nuclear Power Plants," September 1978.
4. Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977.
5. Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors," Revision 1, July 1977.
6. Regulatory Guide 1.113, "Estimating Aquatic Dispersion of Effluents from Accidental and Routine Reactor Releases for the Purpose of Implementing 10 CFR Part 50 Appendix I," Revision 1, April 1977.
7. Regulatory Guide 1.21, "Measuring, Evaluating, and Reporting Radioactivity in Solid Wastes and Releases of Radioactive Materials in Liquid and Gaseous Effluents from Light-Water-Cooled Reactors," Revision 1, June 1974.
8. Radiological Assessment Branch Technical Position on Environmental Monitoring, Revision 1, November 1979.
9. WBN Final Environmental Statement, WBNP Units 1,2,3, Chattanooga, TN, November 9, 1972.
10. WBN Final Safety Analysis Report.
11. TVA Memorandum, E. E. Driver to R. B. Maxwell, "Watts Bar Nuclear Plant Dispersion," December 3, 1984.
12. TVA Memorandum, Edwin M. Scott to Betsy Eiford-Lee, "Fish Harvest Estimates for the Revision of the QWATA Computer Code," December 15, 1987.
13. TVA Memorandum, D. L. Stone to B. Eiford-Lee, "Surface area Computations for the Revision of the QWATA Code," April 26, 1988.
14. Final Supplemental Environmental Impact Statement, "Completion and Operation of Watts Bar Nuclear Plant Unit 2," Tennessee Valley Authority, June, 2007.
15. DOE-TIC-11026, "Radioactive Decay Data Tables - A Handbook of Decay Data for Application to Radiation Dosimetry and Radiological Assessment," D. C. Kocher, 1981.

16. ORNL 4992, "Methodology for Calculating Radiation Doses from Radioactivity Released to the Environment," March 1976.
17. NUREG-0172, "Age Specific Radiation Dose Commitment Factors for a One Year Chronic Intake," November 1977.
18. Dose-Rate Conversion Factors for External Exposure to Photon and Electron Radiation from Radionuclides Occurring in Routine Releases from Nuclear Fuel Cycle Facilities, D. C. Kocher, Health Physics Volume 38, April 1980.
19. TVA Memorandum, John P. Blackwell to M. L. Millinor, "Development of Atmospheric Dispersion Adjustment Factors for Application in the Watts Bar Nuclear Plant Offsite Dose Calculation Manual," November 16, 1990.
20. International Commission on Radiological Protection Publication 23, "Report of the Task Group on Reference Man," 1975.
21. NUREG/CR-1004, "A Statistical Analysis of Selected Parameters for Predicting Food Chain Transport and Internal Dose of Radionuclides," October 1979.
22. "Tennessee Valley Authority Effluent Management System (48-8434) Technical Reference Manual," Canberra Nuclear - Nuclear Data Systems Division, January 1994.
23. TVA Memorandum, M. S. Robinson to Radiological Hygiene Branch Files, "Cross-Sectional Areas of Nuclear Reactor Buildings," November 2, 1977.
24. Sequoyah Nuclear Plant Offsite Dose Calculation Manual.
25. TVA Quarterly Water Dose Assessment Computer Code Documentation, Revision 2.0, November 1989
26. TVA Memorandum, M. C. Brickey to M. E. Greeno, "Watts Bar Nuclear Plant Offsite Dose Calculation Manual - Changes Required - Revised agreements based on meeting between Nuclear Engineering and Chemistry on March 9, 1994," March 17, 1994
27. TVA Memorandum, Ed Steinhauser and Stan Nelson to Mike Greeno, "Offsite Dose Calculation Manual for Systems 14 and 15," February 10, 1994
28. TVA Memorandum, M. C. Brickey to Mike Greeno, "ODCM Change Request," March 3, 1995
29. NDP-00-0344, Revision 1, "Implementation and Utilization of Tritium Producing Burnable Absorber Rods (TPBARS) in Watts Bar Unit 1."
30. WBN Unit 1 and Unit 2 Technical Specifications
31. TVA Technical Paper, "NPG Site Carbon-14 Production and Release Estimates," dated April 19, 2011

## 11.0 SOURCE NOTES

<u>SOURCE NOTE</u>	<u>Source Document</u>	<u>Summary</u>
1	NCO850192001	TVA response as described in NRC evaluation SER No. 5, Section 11.7, paragraph 4.
2	NRC IE Bulletin 82-49 SQN LER 50-327/92019	Adjust noble gas monitor setpoints based on chamber pressure.
3		Source Note deleted and calibration interval changed to 18 months per NE SSD 1-F-90-400A,B,C,D,-452 and 2-F-90-400C,-452.
4	NCO920030880	Specifications will ensure compliance with 10 CFR 50.34a (ALARA) and to ensure that concentrations of radioactive effluents released to unrestricted areas are within the limits specified in 10 CFR 20.106 (20.1301). The reporting requirements of 50.36a (a)(2) will also be included in these specifications.
5	NCO920042424	To ensure compliance with Radiological Effluent Tech Specs, cumulative dose calculations will be performed once per month.
6	NCO920042422	ODCM shall contain Radiological Environmental Monitoring Program sampling and analysis frequencies.
7	NCO920042500	Dose Calculations will be performed monthly to ensure that the dose rate in unrestricted areas due to gaseous effluents from the reactor at the site will be limited to the prescribed values.
8	NCO920042501	A complete analysis utilizing the total estimated liquid release for each calendar quarter will be performed and reported as required by Technical Specifications.
9	NCO920042502	Dose projections will be performed in accordance with Technical Specifications.
10	NCO920042423	Post-release analysis will be done using actual release data to ensure that limits were not exceeded. This data and setpoints will be recorded in auditable records by plant personnel.
11	WBPER960319	Operability requirements for Kurz isokinetic sampling panels will be added to the ODCM.

<u>SOURCE NOTE</u>	<u>Source Document</u>	<u>Summary</u>
13	WBPER970486 NCO970059002 NCO970059004	Added operability requirements for heat trace on iodine/particulate sample lines for Condenser Vacuum Exhaust and Shield Building Exhausts.
15	WBPER970492	Changed allowable monitor tolerance factor to 2.0 for gaseous monitor setpoint calculations.
16	WBPER971422	Changed submittal requirements to correspond to CFR requirements.
17	WBPER970332	Changed maximum design release flow rate for WGDT from 55 cfm to 100 cfm to reflect current design output.

**APPENDIX A - NOTATION CONVENTIONS**

(Page 1 of 7)

**Symbol Key**

This symbol key provides a cross-reference between the symbols used in the Watts Bar ODCM and those symbols used in the Regulatory Guidance documents for the ODCM (References 1, 2, 3, 4, and 5). The Watts Bar symbol is given, along with a definition of the term; then the reference document is given for that term, along with the corresponding symbol used in that reference.

Some terms may be subscripted in the WBN ODCM text and in the regulatory document. For simplification, no subscripts are included in this symbol key. The use of subscripts is standard throughout the WBN ODCM as follows:

subscript a: age group  
 subscript i: radionuclide (T is used to denote tritium and C14 is used to denote C-14)  
 subscript j: organ  
 subscript k: windspeed category  
 subscript l: Pasquill stability class  
 subscript m: Public Water Supply or population element  
 subscript P: dose pathway  
 subscript r: river reach

WBN ODCM Symbol	Definition	Source Reference	Source Symbol
a	Minimum building cross-sectional area	R.G. 1.111 (p. 11)	$D_z^2$
A	Liquid dose factor	NUREG-0133 (p. 15)	A
a	Cumulative dose for a quarter	N/A	
ADC	Average decay correction	N/A	
AF	Allocation Fraction	N/A	
APR	Size of river reach	N/A	
$A_F$	Dose factor for fish ingestion	NUREG-0133 (p. 15)	
$A_R$	Dose factor for shoreline recreation	N/A	
ATMW	Ratio of average to maximum ingestion rates	N/A	
BKG	Background	N/A	
B	Bioaccumulation factor	NUREG-0133 (p. 16)	BF
b	Projected dose for a release	N/A	
$B_{iv}$	Transfer factor for nuclide i from soil to vegetation	R.G. 1.109 (p. 3)	$B_{iv}$
BR	Breathing rate	NUREG-0133 (p. 25)	BR
c	Air concentration	R.G. 1.109 (p. 25)	c
c	Any anticipated additional dose in the next month from other sources	N/A	
C	Concentration	NUREG-0133 (p. 15)	C
$\chi/Q$	Relative concentration	R.G. 1.109 (p. 5)	$\chi/Q$

## APPENDIX A - NOTATION CONVENTIONS

(Page 2 of 7)

## Symbol Key

WBN ODCM Symbol	Definition	Source Reference	Source Symbol
d	Number of days in the current quarter prior to the time of a release	N/A	
D	Dose	NUREG-0133 (p. 15)	D
D <sub>NF</sub>	Near-field dilution	NUREG-0133 (p. 15)	F
D/Q	Relative deposition	R.G. 1.109 (p. 24)	d
DFB	Dose Conversion Factor for total body submersion	R.G. 1.109 (p. 6)	DFB
DF <sub>b</sub>	Dose Conversion Factor for beta air dose	R.G. 1.109 (p. 5)	DF <sub>b</sub>
DFG	Dose conversion factor for standing on contaminated ground	NUREG-0133 (p. 26)	DFG
DF <sub>g</sub>	Dose conversion factor for gamma air dose	R.G. 1.109 (p. 5)	DF <sub>g</sub>
DF	Ingestion dose conversion factor	NUREG-0133 (p. 16, 33)	DF, DFL
DFA	Inhalation Dose Conversion Factor	NUREG-0133 (p. 25)	DFA
DFS	Dose conversion factor for skin submersion dose	R.G. 1.109 (p. 6)	DFS
DR	Dose rate	N/A	
dr	Relative deposition rate	R.G. 1.111 (p. 12)	dr
E	Efficiency	NUREG-1301 (p. 40)	E
ECL	Effluent Concentration Limit	N/A	
ER	Expected Monitor Response	N/A	
F	Dilution flow	NUREG-0133 Addendum A	F
f	Waste flow	NUREG-0133 Addendum A	f
F <sub>f</sub>	Transfer factor from cow's feed to beef	R.G. 1.109 (p. 28)	F <sub>f</sub>
f <sub>g</sub>	Fraction of stored vegetables grown locally	R.G. 1.109 (p. 7)	f <sub>g</sub>
FISH	Average amount of fish ingested	N/A	
f <sub>kl</sub>	Joint relative frequency of occurrence of winds in windspeed class k and stability class l	R.G. 1.111 (p. 9)	n/N
f <sub>L</sub>	Fraction of fresh leafy vegetables grown locally	R.G. 1.109 (p. 7)	F <sub>l</sub>
F <sub>m</sub>	Transfer factor from animal's feed to milk	R.G. 1.109 (p. 27)	F <sub>m</sub>
fP	Fraction of population in an age group	R.G. 1.109 (p. 30)	f
f <sub>p</sub>	Fraction of time animal spends on pasture	R.G. 1.109 (p. 28)	f <sub>p</sub>

## APPENDIX A - NOTATION CONVENTIONS

(Page 3 of 7)

### Symbol Key

WBN ODCM Symbol	Definition	Source Reference	Source Symbol
$f_s$	Fraction of time animal spends on stored feed	R.G. 1.109 (p. 28)	$f_s$
H	Absolute humidity of the atmosphere	R.G. 1.109 (p. 27)	H
HRSVIS	Length of shoreline recreation visit	N/A	
HVST	Fish harvest for the Tennessee River	N/A	
$K_C$	Transfer coefficient from water to shoreline sediment	R.G. 1.109 (p. 14)	$K_C$
$\lambda$	Radioactive decay constant	N/A	
$\lambda_E$	Effective decay constant	R.G. 1.109 (p. 4)	$\lambda_E$
LLD	Lower Limit of detection	NUREG-1301 (p. 40)	LLD
$\lambda_W$	Weathering decay constant	R.G. 1.109 (p. 4)	$\lambda_W$
M	Mass density of sediment	R.G. 1.109 (p. 14)	M
n	Number of compass sectors	N/A	
P	Effective surface density of soil	R.G. 1.109 (p. 3)	P
$\rho$	Fraction of radionuclide remaining in plume	R.G. 1.111 (p. 12)	$\rho$
POP	Population	R.G. 1.109 (p. 30)	P
POPF	Population dose due to fish ingestion	R.G. 1.109 (p. 30)	$D^P$
POPR	Total recreation population dose	R.G. 1.109 (p. 30)	$D^P$
POPWTR	Population dose due to water ingestion	R.G. 1.109 (p. 30)	$D^P$
Q	Release rate	NUREG-0133 (p. 22)	Q
q	Total release in a period	NUREG-0133 (p. 29)	q
$Q_f$	Milk animal's consumption rate	R.G. 1.109 (p. 3)	$Q_f$
r	Fraction of activity retained on pasture grass.	R.G. 1.109 (p. 3)	r
$R_P$	Gaseous Dose Factor for Pathway P	NUREG-0133 (p. 26)	P
$R_I$	Inhalation dose factor	NUREG-0133 (p. 26)	P
$R_G$	Ground plane dose factor	NUREG-0133 (p. 26)	P
$R_{CP}$	Pasture grass-milk animal-milk ingestion	NUREG-0133 (p. 26)	P
$R_{CS}$	Stored feed-milk animal-milk ingestion	NUREG-0133 (p. 26)	P
$R_{MP}$	Pasture grass-beef ingestion	NUREG-0133 (p. 26)	P
$R_{MS}$	Stored feed-beef ingestion	NUREG-0133 (p. 26)	P
$R_{VF}$	Fresh leafy vegetable ingestion	NUREG-0133 (p. 26)	P

## APPENDIX A - NOTATION CONVENTIONS

(Page 4 of 7)

## Symbol Key

WBN ODCM Symbol	Definition	Source Reference	Source Symbol
$R_{VS}$	Stored vegetable ingestion	NUREG-0133 (p. 26)	P
R	Sum of the ratios	N/A	
RATIO	Ratio of average to maximum dose	N/A	
REQFRA	Fraction of yearly recreation which occurs in a quarter	N/A	
rf	Recreation factor	N/A	
RF	River flow	N/A	
$s_b$	Standard deviation	NUREG-1301 (p. 40)	$s_b$
SF	Safety factor	N/A	
SHVIS	Shoreline visits per year	N/A	
$S_{max}$	Setpoint corresponding to the ODCM Limit	N/A	
$\Sigma_z$	Vertical dispersion coefficient	R.G. 1.111 (p. 11)	$\Sigma_z$
$\sigma_z$	Vertical dispersion coefficient	R.G. 1.111 (p. 11)	$s_z$
T	Duration of release	NUREG-0133 (p. 15)	$\Delta t$
$\Delta t$	Elapsed time between midpoint of sample collection and counting time	NUREG-1301 (p. 40)	$\Delta t$
TAF	Terrain adjustment factor	N/A	
$t_b$	Time period over which accumulation on the ground is evaluated	R.G. 1.109 (p. 14, 26)	$t_b, t$
$t_{cb}$	Time for receptor to consume a whole beef	N/A	
$t_d$	Distribution time for water, fish, milk, beef, or vegetables	R.G. 1.109 (p. 4)	$t_p$
$t_{csf}$	Time between harvest of stored feed and consumption by animal	R.G. 1.109 (p. 4)	$t_h$
$t_e$	Exposure time in garden for fresh leafy and/or stored vegetables	R.G. 1.109 (p. 4)	$t_e$
$t_{ep}$	Time pasture is exposed to deposition	R.G. 1.109 (p. 4)	$t_e$
$t_{esf}$	Time stored feed is exposed to deposition	R.G. 1.109 (p. 4)	$t_e$
TFDOS	Individual fish ingestion dose	R.G. 1.109 (p. 30)	D
$t_{fm}$	Transport time from milking to receptor	N/A	$t_{fm}$
$t_{hc}$	Average time between harvest of vegetables and their consumption and/or storage	R.G. 1.109 (p. 4)	$t_h$

## APPENDIX A - NOTATION CONVENTIONS

(Page 5 of 7)

## Symbol Key

WBN ODCM Symbol	Definition	Source Reference	Source Symbol
$t_s$	Transport time from slaughter to consumer	R.G. 1.109 (p. 28)	$t_s$
TSHDOS	Total shoreline dose rate	R.G. 1.109 (p. 30)	D
$t_{sv}$	Time period over which stored vegetables are consumed	N/A	
TWDOS	Total individual water dose	R.G. 1.109 (p. 30)	D
$u$	Wind speed	R.G. 1.111 (p. 9)	$u$
$U_f$	Fish consumption rate	NUREG-0133 (p. 16)	$U_F$
$U_{FL}$	Consumption rate of fresh leafy vegetables	R.G. 1.109 (p. 7)	$U^L$
$U_m$	Meat ingestion rate	R.G. 1.109 (p. 7)	$U^F$
$U_p$	Milk ingestion rate	R.G. 1.109 (p. 7)	$U_p$
$U_R$	Recreation usage factor	R.G. 1.109 (p. 14)	$U$
$U_S$	Consumption rate of stored vegetables by the receptor	R.G. 1.109 (p. 7)	$U^V$
$U_w$	Water consumption rate	NUREG-0133 (p. 16)	$U_W$
$V$	Sample size	NUREG-1301 (p. 40)	$V$
$W$	Dispersion factor	NUREG-0133 (p. 22)	$W$
SWF	Shoreline width factor	R.G. 1.109 (p. 14)	$W$
$x$	Downwind distance	R.G. 1.111 (p. 11)	$x$
$Y$	Radiochemical yield	NUREG-1301 (p. 40)	$Y$
$Y_f$	Agricultural yield for fresh leafy vegetables	R.G. 1.109 (p. 4)	$Y_v$
$Y_p$	Agricultural productivity by unit area of pasture grass	R.G. 1.109 (p. 4)	$Y_v$
$Y_{sf}$	Agricultural productivity by unit area of stored feed	R.G. 1.109 (p. 4)	$Y_v$
$Y_{sv}$	Agricultural yield for stored vegetables	R.G. 1.109 (p. 4)	$Y_v$

## **APPENDIX A - NOTATION CONVENTIONS**

(Page 6 of 7)

### **List of Acronyms**

ABGTS - Auxiliary Building Gas Treatment System  
ALARA - As Low As Reasonably Achievable  
CDCT - Cask Decontamination Collector Tank  
CFR - Code of Federal Regulations  
CTBD - Cooling Tower Blowdown  
CVCS - Chemical Volume Control System  
CVE - Condenser Vacuum Exhaust  
EPA - Environmental Protection Agency  
ERCW - Essential Raw Cooling Water  
ESF - Engineered Safety Feature  
FI - Flow Indicator  
FSAR - Final Safety Analysis Report  
GRTS - Gaseous Radwaste Treatment System  
GWS- Groundwater Sump  
HCT - High Crud Tanks  
HEPA - High Efficiency Particulate Air  
LLD - Lower Limit of Detection  
LM - Local Monitor  
LPF - Loop Flow  
LRTS - Liquid Radwaste Treatment System  
NIST - National Institute of Standards and Technology  
NRC - Nuclear Regulatory Commission  
NRWT - Non-Reclaimable Waste Tank  
ODCM - Offsite Dose Calculation Manual  
PM - Perimeter Monitor  
PWS - Public Water Supply  
REMP - Radiological Environmental Monitoring Program  
RE - Radiation Element  
RM - Remote Monitor  
SGBD - Steam Generator Blowdown  
SQN - Sequoyah Nuclear Plant  
SR - Surveillance Requirement  
SSP - Site Standard Practice  
TBS - Turbine Building Sump  
TRM - Tennessee River Mile  
TS - Technical Specifications  
TWST – Tritiated Water Storage Tank  
WBN - Watts Bar Nuclear Plant  
WGDT - Waste Gas Decay Tank

## APPENDIX A - NOTATION CONVENTIONS

(Page 7 of 7)

### List of Units

The following units are used consistently throughout the WBN ODCM. The table is included to provide the reader with the unit corresponding to each abbreviation used.

cc	cubic centimeters
cfs	cubic feet per second
Ci	Curie
cpm	counts per minute
d	day
g	gram
gpm	gallons per minute
h	hour
kg	kilogram
L	liter
lb	pound
m	meters
μCi	microcurie
mi	mile
min	minute
ml	milliliter
mrad	millirad
mrem	millirem
pCi	picocurie
s	second
y	year

### Other Notes:

Equations in the text of the WBN ODCM are numbered by section, i.e., equations in Section 6.0 are numbered as 6.1, 6.2, etc. Only final equations are numbered; any equations which are reproduced from Regulatory Guides or NUREGs and used to derive a WBN specific equation are not numbered.

## APPENDIX B - Deviations in the WBN ODCM Controls/Surveillance Requirements from Those Given in NUREG-1301

(Page 1 of 4)

**NOTE: All future deviations to the guidance provided in NUREG-1301 will be documented in the ODCM revision log.**

1. Controls 1.0.1 and 1.0.2 and Surveillance Requirements 2.0.1-2.0.4 have been replaced by the most recent WBN LCOs 3.0.1 and 3.0.2 and SRs 3.0.1-3.0.4. This has been done to ensure consistency between the WBN TS and the WBN ODCM.
2. Control 1/2.1.1 NUREG-1301 does not list the applicability for liquid monitoring instrumentation. Applicability for WBN liquid effluent instrumentation is defined in Table 1.1-1 to match the requirements provided in the ACTION statements associated with the table.  
 Table 2.1-1 - Channel calibration for the Diffuser Discharge Flow Indicator is changed to yearly due to requirements in the NPDES permit. This is more conservative than required by NUREG-1301.  
 Table 2.1-1 - The Channel Operational Test Frequency for items 3.a (Radwaste Flow), 3.b (Steam Generator Blowdown Flow), and 3.c (Condensate Demineralizer Flow) are N/A. These items do not have an associated alarm, interlock, and/or trip setpoint, therefore a Channel Operational Test cannot be performed for these items.  
 Table 2.1-1 - Footnote 1 is deleted from Items 1.b (Steam Generator Blowdown Radiation) and 1.c (Condensate Demineralizer radiation). Item 1.b and 1.c generate an automatic isolation on level above the alarm/trip setpoint, not instrument malfunction.  
 Table 2.1-1 - The circuit failure test associated with the channel operational test (COT) has been deleted. By definition a COT verifies the channel can process an input signal and actuate output devices and that there are no circuit failures that impact the required functions. The notes in Tables 2.1-2 which supplement the COT definition require tests to verify operation of specific features that alert the operator of a malfunction. These include downscale failure (loss of counts), controls not in operate mode (switch mispositioned), and loss of sample flow. Circuit failure could be caused by any number of subcomponent failures. There is not a specific circuit that is monitoring for each of those subcomponent failures.
3. Control 1/2.1.2 - Table 1.1-2 limits operability for WGDT release instrumentation to periods of release.  
 Table 1.1-2 - Includes operability requirements for heat trace on iodine/particulate sample lines for Condenser Vacuum Exhaust and Shield Building Exhaust.  
 Tables 1.1-2 and 2.1-2 require that both Unit 1 and 2 Shield Building Exhaust monitors must meet operability requirements to operate either unit. This is because releases through the ABGTS may exit from either unit's Shield Building Vent.  
 Table 1.1-2 - Wording is added to clarify the Shield Building Vent monitor noble gas channel operability requirements. This monitor has the capability to read in units of  $\mu\text{Ci/cc}$  or  $\mu\text{Ci/s}$ . The usual channel will read in  $\mu\text{Ci/s}$ , but this wording allows the monitor to be switched to read in  $\mu\text{Ci/cc}$  if the flow channel becomes inoperable to eliminate the need for compensatory samples.  
 Table 1.1-2 - The Applicability for Items 2.a, c, and d (Condenser Vacuum Exhaust (CVE) radiation monitors and flow instruments) is MODES 1, 2, 3, and 4 and during MODES 5 and 6 with CVE System in operation. The radiation monitoring instrumentation does not have to be operable if the Exhaust system is not in operation.  
 Table 1.1-2 - Items 3.f and 4.e were added as part of the changes associated with operating with a TPBAR core.  
 Table 2.1-2 - Includes surveillance requirements for heat trace on iodine/particulate sample lines for Condenser Vacuum Exhaust and Shield Building Exhaust.  
 Table 2.1-2 - The channel operational test frequency for 3.b (Shield Building Exhaust Iodine and Particulate Sampler), and 4.b (Auxiliary Building Exhaust Iodine and Particulate Sampler) of Table 2.1-2 are N/A. These items have no associated alarm, interlock, and/or trip setpoint, therefore a Channel Operational Test cannot be performed.

## APPENDIX B - Deviations in the WBN ODCM Controls/Surveillance Requirements from Those Given in NUREG-1301

(Page 2 of 4)

Table 2.1-2 - The channel check requirements for all iodine and particulate samplers are N/A. A CHANNEL CHECK is defined as verifying indication of flow during periods of release. The channel check requirement is intended to demonstrate that the sampler is operable. An indication of flow through the sampler verifies its operability. The daily channel check for the sampler flow(s) and the weekly sampler filter changeout required by the sampling and analysis program in Table 2.2-2 provide this indication of operability, therefore a channel check requirement in this Table is redundant.

Table 2.1-2 - The circuit failure test associated with the channel operational test (COT) has been deleted. By definition a COT verifies the channel can process an input signal and actuate output devices and that there are no circuit failures that impact the required functions. The notes in Tables 2.1-2 which supplement the COT definition require tests to verify operation of specific features that alert the operator of a malfunction. These include downscale failure (loss of counts), controls not in operate mode (switch mispositioned), and loss of sample flow. Circuit failure could be caused by any number of subcomponent failures. There is not a specific circuit that is monitoring for each of those subcomponent failures.

CHANNEL OPERATIONAL TEST frequencies may be extended if justified. The justification includes meeting a 95/95 confidence acceptance criterion based on hardware of similar design.

4. Control 1/2.1.3 is added to place the meteorological monitoring requirements in the ODCM.
5. Control 1/2.2.1.1 - Table 2.2-1, the requirements for sampling of continuous liquid release pathways (TBS and SGBD) are for daily grab samples rather than a continuous sampler. This is consistent with the requirements of the NRC approved SER and SSER 16 for WBN and the WBN Unit 1 ODCM, Revision 3 (i.e., SER 9407280068, dated July 26, 1994). The definition of a composite liquid effluent sample is somewhat different than that given in NUREG-1301 (WBN will be creating the composite in the lab from the grab samples, the NUREG is referring to a composite sample from a continuous sampler). The analyses for these daily grab samples are daily, rather than weekly. Each sample will be analyzed, rather than compositing the samples for the week.  
Table 2.2-1 - Footnote 6 is added to require that the continuous liquid release points be sampled only if primary to secondary leakage is identified, and either the monitor must be set to two times background OR compensatory samples are being collected. This is consistent with requirements in the SQN effluent control program. The activity determination is clarified to state that principal gamma emitters will be used for the determination.
6. Control 1/2.2.2.1:  
Table 2.2-2 is reformatted from the NUREG version to place more of the requirements in the table itself, and eliminate some of the footnotes. This allows easier implementation of the sampling requirements in plant procedures.
  - a. Table 2.2-2 requires sampling of containment purge and vent following shutdown, startup, or a thermal power change exceeding 15% of RATED THERMAL POWER within a 1 hour period. This is consistent with the NUREG, but WBN goes further to state that this does not need to be done if analysis shows that the DEI has not increased by a factor of 3 or more, AND if the lower containment noble gas monitor does not show an increase of a factor of 3 or more. This is consistent with the NRC approved SER and SSER 16 for WBN and the WBN Unit 1 ODCM, Revision 3 (i.e., SER 9407280068, dated July 26, 1994).
  - b. Table 2.2-2, Footnote 8 details applicability and timing requirements for sampling of the containment for purges. This note is consistent with one in the SQN ODCM, except that MODE requirements and times are different.

**APPENDIX B - Deviations in the WBN ODCM Controls/Surveillance  
Requirements from Those Given in NUREG-1301**

(Page 3 of 4)

- c. Table 2.2-2, Footnote 8 details applicability and timing requirements for sampling for incore instrument room purges. This note is consistent with one in the SQN ODCM, except that MODE requirements and times are different.
  - d. Table 2.2-2, Footnote 10 details applicability requirements for sampling of the containment for venting. This note is consistent with one in the SQN ODCM, but details are different.
  - e. Table 2.2-2, the Shield Building Exhaust is excluded from the monthly requirement for grab sampling to analyze for noble gas and tritium, since all releases through this point will have been quantified previously.
  - f. Table 2.2-2, Footnote 11 excludes the Condenser Vacuum Exhaust from the requirements for sampling until a primary to secondary leak is identified. The activity determination is clarified to state that principal gamma emitters will be used for the determination.
  - g. Table 2.2-2, the table limits the principal gamma emitters for grab samples to the noble gas nuclides to clarify that particulate releases are quantified from filter analyses.
  - h. Table 2.2-2 - Footnotes 3 and 7 allow compensatory grab samples to be used to determine if activity levels have increased during periods of radiation monitor inoperability.
  - i. Table 2.2-2 - Requirements for continuous tritium sampling were added for the Auxiliary Building Exhaust, Unit 1 Shield Building, and Unit 2 Shield Building Exhaust to quantify releases during the irradiation and storage of TPBARs. Since tritium samples will be collected continuously footnotes 4 and 5, which required tritium grab samples, were removed. The use of continuous tritium samplers provides a more accurate account of the tritium released than grab samples.
  - j. Footnotes 8 and 10 clarifies that only the containment compartment to be released needs to be sampled. This will eliminate unnecessary sampling.
  - k. Table 2.2-2 - Prior to release each Waste Gas Decay Tank will require tritium analysis as part of the changes associated with operating with a TPBAR core.
7. Control 1/2.3.1:
- a. Table 2.3-1 - the drinking water control sample location is defined in footnote 9 to be the upstream surface water sample.
  - b. Requirements for drinking water sample analysis differ from NUREG-1301. Due to the large downstream distance of the first public water supply (> 10 miles) and the volume of dilution water available, doses due to water ingestion will be very low under normal circumstances. This situation applies at both SQN and BFN and is reflected in their Environmental Monitoring Programs.
  - c. Text is added to Table 2.3-1 footnote 8 to state that the hydraulic gradient of the groundwater at the WBN site is such that the groundwater will move from the site toward the river, therefore groundwater sampling is not required.
  - d. Table 2.3-1 footnote 3 is added to clarify identification of control samples for iodine and particulate airborne monitoring.
  - e. Table 2.3-1, The invertebrate sampling requirements have been relocated to the waterborne section of the Table to more accurately reflect the purpose of these samples. There is negligible ingestion of invertebrates from the Tennessee River.
8. BASES 1/2.1.3 - Bases for the meteorological monitoring instrumentation Control are in the ODCM.
9. BASES 1/2.2.1.1 - An additional reference is given for further LLD discussion (ARH-SA-215, June 1975). Allocation of activity between the reactor units for dose calculation purposes is discussed in more detail.
10. BASES 1/2.2.1.2 - Text is added to explain that the dose for composited nuclides will be calculated using the values from the previous compositing period.

**APPENDIX B - Deviations in the WBN ODCM Controls/Surveillance  
Requirements from Those Given in NUREG-1301**

(Page 4 of 4)

11. Not used.
12. BASES 1/2.2.2.1 - An additional reference is given for further LLD discussion (ARH-SA-215, June 1975). Allocation of activity between the reactor units for dose calculation purposes is discussed in more detail.
13. BASES 1/2.2.2.2 and 1/2.2.2.4 - Allocation of activity between the reactor units for dose calculation purposes is discussed in more detail.
14. BASES 1/2.3.1 - An additional reference is given for further LLD discussion (ARH-SA-215, June 1975).
15. The definitions of Member of the Public and Restricted area are not consistent with those given in NUREG-1301. This is due to the revision to 10 CFR 20 implemented by TVA on 1/1/94. The definitions are consistent with that regulation. Similar changes are made to the BASES sections to clarify the wording where these definitions are used. Figure 3.1 shows the locations of these boundaries and areas. A calculation is given in Section 7.7.6 for a member of the public inside the SITE BOUNDARY demonstrating that the location of the unrestricted area boundary on the opposite side of the Tennessee River meets the intent of the regulation.
16. The Source Check definition is changed to reflect changes made in the definition for SQN (revision 27). The new definition will allow the use of internal test circuits in lieu of a radioactive source (some monitors use an LED light source to provide the check signal to the photomultiplier tube).
17. The Operational Modes Table (Table 3.2) is consistent with the WBN TS.
18. NUREG-1301 provides guidance for sampling and/or monitoring of specific media, which includes invertebrates. TVA has determined that within the vicinity of WBN, there are no invertebrates that are harvested for commercial or recreational consumption. Therefore, TVA has deleted all requirements regarding invertebrate sampling and/or monitoring for WBN.
19. NUREG-1301 provides guidance for CHANNEL OPERATIONAL TEST (COT) frequency. TVA has extended the COT frequency guidance of NUREG-1301 based on the results of TVA calculation WBN-EBB-EDQ-1090-99005, "Extending Channel Operational Test Frequency for Radiation Monitors." The COT frequency was evaluated utilizing the binomial density function referenced in NUREG-1475 to analyze the work orders against 95/95 criteria. The radiation monitoring loops (and subsequent work orders) were divided into four categories due to differing radiation monitoring equipment function, and calibration frequency. Each category was analyzed separately to the 95/95 probability and confidence that the attribute of interest is indicative of the population. The attribute of interest for this statistical test is the "as-left" band.

## **APPENDIX C - WBN ODCM REVISION PROCESS**

(Page 1 of 7)

This Appendix establishes the minimum requirements for preparation, review, and approval of the Watts Bar Nuclear Plant Offsite Dose Calculation Manual. This Appendix also implements the requirements of ODCM Section 5.3 and WBN TS 5.7.2.3.

### **1.0 Reviewer Responsibilities**

#### **1.1 Affected Organization Review (AOR)**

The identification of affected organizations is the responsibility of the Sponsor and applies to all revisions of the ODCM.

The affected organizations shall ensure that their reviewers have adequate understanding of the requirements and intent of the ODCM and access to pertinent background information.

The AO reviews the draft for impact on the organization and adequate interface - not technical content.

#### **1.2 Independent Qualified Review (IQR)**

An independent qualified review (IQR) is the process of performing an independent technical review by Qualified Reviewers (QR) of activities potentially affecting nuclear safety.

The IQR shall NOT include the person who prepared the ODCM revision.

An IQR is performed by QRs designated by responsible department level managers to perform an independent technical review of activities potentially affecting nuclear safety.

#### **1.3 Cross Disciplinary Review (CDR)**

The need for a CDR is determined by the IQR.

CDR is a technical review by disciplines other than those responsible for the document preparation.

The CDR is responsible for only the technical aspects of the areas specified by the IQR and any portions of the document that support or justify those areas.

Persons performing CDR do not have to be IQR qualified.

#### **1.4 Plant Operations Review Committee (PORC) Review**

The PORC reviews and recommends final approval of the ODCM.

#### **1.5 Approval Authority**

The Plant Manager will approve all revisions to the ODCM as required by Technical Specifications.

Signature authority shall not be delegated to a lower level manager.

**APPENDIX C - WBN ODCM REVISION PROCESS**  
(Page 2 of 7)

**2.0 Processing ODCM Revisions**

**2.1 Requestor (If other than the Sponsor)**

Identify the need for an ODCM improvement.

Prepare a justification for the ODCM revision.

Attach a marked-up copy of the existing ODCM.

Forward the requested ODCM revision to the sponsoring organization.

**2.2 ODCM Sponsor**

Evaluate requested changes and determine if necessary.

If the requested change is not necessary, return the request to the requestor with explanation why the change is not needed.

Incorporate all changes in a draft revision on BSL.

Identify the organizations to perform AOR and complete the top portion of Attachment A for each organization.

Distribute Attachment A to each Affected Organization and request completion of the review prior to expected PORC review date.

Obtain appropriate reviews of the ODCM revision in BSL.

**2.3 Reviews**

**2.3.1 IQR**

Review the ODCM using all questions on Attachment B as a guideline and forward comments to the Sponsor.

Identify discipline or organization to perform CDR, if needed.

**APPENDIX C - WBN ODCM REVISION PROCESS**  
(Page 3 of 7)

**2.3.2 Affected Organization Reviewer**

Review the proposed changes on BSL and provide comments to the ODCM Sponsor.

Review the ODCM for impact on assigned organization, identify procedures/documents which require revision to implement the ODCM revision on the Attachment A, and return the Attachment A to the ODCM Sponsor.

**2.4 Sponsor**

Resolve comments and obtain reviewer's concurrence in BSL. Escalate any unresolved comments to appropriate management.

Ensure ODCM has been reviewed by sponsor and IQR in accordance with Attachment B.

Ensure all Affected Organizations have reviewed the ODCM change and have identified the affected procedures on Attachment A.

Ensure all IQR, and CDR review requirements have been met.

Assign an Effective Date typically 60 calendar days forward UNLESS there is reasonable justification for making it effective earlier, such as plant operating conditions, test schedules, commitment or corrective action deadlines, or implementation of upper-tier requirements, or lack of affected procedures identified on Attachment A.

**2.5 PORC**

Review changes and Attachment B. Document recommendation for approval in BSL.

**2.6 Plant Manager**

Approve the ODCM revision in BSL.

**3.7 ODCM Sponsor**

Record the ODCM approval date and implementation date on each completed Attachment A provided by the affected organizations.

Return the Attachment A to each affected organization.

**3.8 Affected Organization**

Revise procedures identified on the Attachment A and assign an effective date which matches that of the ODCM revision.

Complete the Attachment A and return to the ODCM Sponsor.

## **APPENDIX C - WBN ODCM REVISION PROCESS**

(Page 4 of 7)

### **3.9 ODCM Sponsor**

Ensure all Affected Organizations have completed and returned Attachment A prior to the effective date of the ODCM.

Forward the approved ODCM change to Management Services at least three working days before the implementation date.

The completed Attachments A and B are QA records, and are handled in accordance with the Document Control and Records Management Program.

Forward a completed copy of each revision to Licensing to be filed and forwarded to the NRC in the Annual Radiological Effluent Release Report.

### **3.10 Management Services**

Issue the ODCM and implementing procedures on the effective date of the ODCM revision.

\_\_\_\_\_/\_\_\_\_\_  
Affected Organization                      Date

**APPENDIX C - WBN ODCM REVISION PROCESS**

(Page 6 of 7)

**Attachment B**

**ODCM Review Checklist**

All questions of this checklist are considered by the ODCM preparer and reviewed by the Independent Qualified Reviewer (IQR). Only the revised portion of the ODCM should be evaluated.

	<b>Changes to Section(s) 1.0-5.0</b>	<b>YES</b>	<b>NO</b>	<b>N/A</b>
1.	Does the revision meet the intent of the guidance provided in NUREG-1301 for radiological effluent and environmental monitoring controls/surveillance requirements?			
2.	Do definitions in Section 3.0 match those provided in the WBN TS, NUREG-1301, or other NRC guidance?			
3.	Do Administrative Controls in Section 5.0 match those provided in WBN TS, NUREG-1301, or other NRC guidance?			
4.	Does the ODCM fulfill the requirements of TVA, Federal or State Laws, WBN FSAR, and any other referenced requirements documents?			
5.	Does the numbering of the Control and its accompanying Surveillance Requirement correspond?			
6.	Are instrument/equipment numbers and units of measure an exact match with those on the equipment?			
7.	Does nomenclature accurately describe the equipment and correspond to label identifiers?			
8.	Are referenced documents applicable, valid, and listed in the reference section?			
9.	Does this change maintain the level of radioactive effluent control required by 10 CFR Part 20.1302, 40 CFR Part 190, 10 CFR Part 50.36a, and Appendix I to 10 CFR Part 50? Provide justification for answer:			

Preparer	/	Date
IQR	/	Date

**APPENDIX C - WBN ODCM REVISION PROCESS**

(Page 7 of 7)

**Attachment B****ODCM Review Checklist (continued)**

	<b>Changes to Section(s) 6.0-11.0</b>	<b>YES</b>	<b>NO</b>	<b>N/A</b>
10.	Are there methodologies given in Sections 6.0 through 9.0 which implement the applicable ODCM Controls?			
11.	Are references to ODCM Controls and Surveillance Requirements accurate and correct?			
12.	Are changes to setpoint calculation methodologies consistent with the guidance provided in NUREG-0133?			
13.	Are changes to liquid effluent concentration compliance methodologies consistent with the guidance provided in NUREG-0133 and 10 CFR Part 20?			
14.	Are changes to gaseous effluent dose rate calculation/compliance methodologies consistent with the guidance provided in NUREG-0133 and/or Regulatory Guide 1.109?			
15.	Are changes to dose or dose projection calculation/compliance methodologies consistent with the guidance provided in NUREG-0133 and/or Regulatory Guide 1.109?			
16.	Are instrument/equipment numbers and units of measure an exact match with those on the equipment?			
17.	Are referenced documents applicable, valid, and listed in the references?			
18.	Are ODCM Sections numbered consistently and consecutively?			
19.	Are references to other ODCM Sections correct?			
20.	Are references to ODCM Tables and Figures accurate and correct?			
21.	Are any new acronyms defined in Appendix A?			
22.	Are equations numbered consecutively?			
23.	Does dimensional analysis yield the correct units for equations?			
24.	Are terms used in equations defined after the equation (and in Appendix A) and the proper units given for that term?			
25.	Do units on equation terms which reference tables match the units used for that term in the Table?			
26.	Are references given for table and other values correct and accurate?			
27.	Do data values given match those in the reference?			
28.	Do text descriptions of release/discharge points in Sections 6.0 and 7.0 correspond with the Figures referenced in those sections?			
29.	The change does not adversely impact the accuracy or reliability of effluent, dose, or setpoint calculations? Provide justification for answer:			

\_\_\_\_\_  
Preparer\_\_\_\_\_  
Date\_\_\_\_\_  
IQR\_\_\_\_\_  
Date