

Callaway Energy Center  
2017 Annual Radioactive Effluent Release Report

# Callaway Energy Center 2017 Annual Radioactive Effluent Release Report

Renewed Facility Operating License NPF-30

Docket Numbers 50-483 and 72-1045



# Callaway Energy Center 2017 Annual Radioactive Effluent Release Report

Renewed Facility Operating License NPF-30  
Docket Numbers 50-483 and 72-1045

## 1. Introduction

This Annual Radioactive Effluent Release Report (ARERR) is submitted by Union Electric Co., dba Ameren Missouri, in accordance with the requirements of 10 CFR 50.36a and 10 CFR 72.44(d)(3), Callaway Energy Center Technical Specification 5.6.3, and HI-STORM UMAX Certificate of Compliance Section 5.1.c. This report is for the period January 1, 2017 to December 31, 2017.

The doses to the Member of the Public from all liquid and gaseous effluents discharged during the reporting period were small fractions of the NRC and EPA regulatory limits and the Radioactive Effluent Control limits in the Offsite Dose Calculation Manual.

Radionuclide concentrations in liquid and gaseous effluents were obtained by effluent sampling and radiological analysis in accordance with the requirements of FSAR-SP/ODCM Radiological Effluent Control (REC) Table 16.11-1 and Table 16.11-4. Gamma spectroscopy was the

## Abstract

The Annual Radioactive Effluent Release Report covers the operation of the Callaway Energy Center during the year 2017. The report includes a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the unit. The report also includes an annual summary of hourly meteorological data collected during the year and an assessment of radiation dose to the Member of the Public from liquid and gaseous effluents.

primary analysis technique used to determine the radionuclide composition and concentration of liquid and gaseous effluents. Composite samples were analyzed for the hard to detect nuclides by an independent laboratory. Tritium and gross alpha were measured for both liquid and gaseous effluents using liquid scintillation counting and gas flow proportional counting techniques, respectively. The total radioactivity in effluent releases was determined from the measured concentrations of each radionuclide present and the total volume of effluents discharged.

The concept of average energy is not applicable to the Callaway Plant radiological effluent monitoring program since the release rate limits for fission and activation gases in gaseous effluent are not based on the average energy of the radionuclide mixture.

The Radiological Effluent Control (REC) limits applicable to the release of radioactive material in liquid and gaseous effluents are provided below.

## Regulatory Limits

The Callaway regulatory limits are provided in the Radiological Effluent Controls in FSAR-SP/ODCM Chapter 16.11.

### Fission and Activation Gases (Noble Gases)

The dose rate due to radioactive noble gases released in gaseous effluents from the site to areas at and beyond the site boundary shall be limited to less than or equal to 500 mrem/yr to the total body and less than or equal to 3000 mrem/yr to the skin.

The air dose due to noble gases released in gaseous effluents, from each unit, to areas at and beyond the site boundary shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 5 mrad for gamma radiation and less than or equal to 10 mrad for beta radiation; and
- b. During any calendar year: Less than or equal to 10 mrad for gamma radiation and less than or equal to 20 mrad for beta radiation.

### Radioiodine, Tritium, and Particulates

The dose rate due to Iodine-131 and Iodine-133, tritium and all radionuclides in particulate form with half-lives greater than eight (8) days released in gaseous effluents from the site to areas at and beyond the site boundary shall be limited to less than or equal to 1500 mrem/yr to any organ.

The dose to a Member of the Public from Iodine-131 and Iodine-133, tritium, and all radionuclides in particulate form with half-lives greater than eight (8) days in gaseous effluents released to areas at and beyond the site boundary shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 7.5 mrem to any organ; and
- b. During any calendar year: Less than or equal to 15 mrem to any organ.

### Liquid Effluents

The concentration of radioactive material released in liquid effluents to unrestricted areas shall be limited to 10 times the concentrations specified in 10 CFR 20 Appendix B To Part 20, Table 2, Column 2 (Effluent Concentrations) for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the concentration shall be limited to 2.0E-04  $\mu\text{Ci/mL}$  total activity.

The dose or dose commitment to an Individual from radioactive materials in liquid effluents released to unrestricted areas shall be limited:

- a. During any calendar quarter to less than or equal to 1.5 mrem to the total body and less than or equal to 5 mrem to any organ; and
- b. During any calendar year to less than or equal to 3 mrem to the whole body and to less than or equal to 10 mrem to any organ.

### Uranium Fuel Cycle Sources

The annual (calendar year) dose or dose commitment to any Member of the Public due to releases of radioactivity and to radiation from uranium fuel cycle sources shall be limited to less than or equal to 25 mrem to the total body or any organ, except the thyroid, which shall be limited to less than or equal to 75 mrem.

## 2. Gaseous Effluents

The quantity of radioactive material released in gaseous effluents during the reporting period is summarized in Table A-1. The quarterly and annual sums of all radionuclides discharged in gaseous effluents are reported in Tables A-1A and A-1B. All gaseous effluent releases are considered to be ground level.

Gaseous Batch Releases		Q1 & Q2	Q3 & Q4
Number of batch releases:		29	23
Total time period for batch releases:	minutes	1773	9031
Max time period for a batch release:	minutes	435	6519
Avg. time period for a batch release:	minutes	61	393
Min. time period for a batch release:	minutes	19	31

The quantity of <sup>14</sup>C released in gaseous effluents was calculated as described in EPRI Technical Report 1021106<sup>1</sup>.

There were no radioactive effluents from the Independent Spent Fuel Storage Installation (ISFSI). The HI-STORM UMAX Canister Storage System does not create any radioactive materials or have any radioactive waste treatment systems. Specification 3.1.1, "Multi-Purpose Canister (MPC)", provides assurance that there are no radioactive effluents from the ISFSI.<sup>2</sup>

### 3. Liquid Effluents

The quantity of radioactive material released in liquid effluents during the reporting period is summarized in Table A-2. The quarterly and annual sums of all radionuclides discharged in liquid effluents are reported in Table A-2A. All liquid effluents were discharged in batch mode; there were no continuous liquid discharges for the reporting period. Dilution by the Missouri River, in the form of the near- field dilution factor, is utilized in the ODCM dose calculation methodology.

Liquid Batch Releases		Q1 & Q2	Q3 & Q4
Number of batch releases:		22	38
Total time period for batch releases:	minutes	10218	16925
Max time period for a batch release:	minutes	873	806
Avg. time period for a batch release:	minutes	464	445
Min. time period for a batch release:	minutes	255	224

### 4. Solid Waste Storage and Shipments

The volume and activity of solid waste shipped for disposal is provided in Table A-3.

### 5. Dose Assessments

The annual evaluation of dose to the Member of the Public is calculated in accordance with the methodology and parameters in the ODCM and is reported in Tables A-4 and A-5.

<sup>1</sup> *Estimation of Carbon- 14 in Nuclear Power Plant Gaseous Effluents*, Technical Report 1021106, Electric Power Research Institute, December, 2010.

<sup>2</sup> Certificate of Compliance No. 1040, Appendix A, Technical Specifications for the HI\_STORM UMAX Canister Storage System, Specification 5.1.

### 5.1 Table A-4, Dose Assessments, 10 CFR 50, Appendix I

The dose assessments reported in Table A-4 were calculated using the methodology and parameters in the ODCM and demonstrate compliance with 10 CFR 50, Appendix I. The gamma air dose and beta air dose were calculated at the nearest Site Boundary location with the highest value of X/Q, as described in the ODCM. The maximum organ dose from gaseous effluents was calculated for the ingestion, inhalation, and ground plane pathways at the location of the nearest resident with the highest value of D/Q, as described in the ODCM. The organ dose does not include the dose from  $^{14}\text{C}$ , which is listed separately.

### 5.2 Table A-5, EPA 40 CFR 190 Individual in the Unrestricted Area

The dose assessments reported in Table A-5 are the doses to the Member of the Public from activities within the Site Boundary plus the doses at the location of the Nearest Residence. A large portion of the residual land of the Callaway Site is managed by the State of Missouri Conservation Department as the Reform Wildlife Management Area. Pursuant to the guidance provided in Regulatory Guide 1.21, rev.2, the dose reported in Table A-5 is the sum of the dose from gaseous effluents (at the Nearest Resident location and within the Site Boundary), plus the dose contribution due to activities within the Site Boundary and the organ dose from inhalation of  $^{14}\text{C}$  (at the Nearest Resident location and within the Site Boundary). The dose assessments in Table A-5 demonstrate compliance with 10 CFR 20.1301(e) and 40 CFR 190.

## 6. Supplemental Information

### 6.1 Abnormal Releases or Abnormal Discharges

There were no abnormal releases or abnormal discharges during the reporting period.

### 6.2 Non- routine Planned Discharges

There were no non- routine planned discharges during the reporting period.

### 6.3 Radioactive Waste Treatment System Changes

There were no major changes to the liquid or gaseous radwaste treatment system during the reporting period.

### 6.4 Annual Land Use Census Changes

There were no changes identified in the locations for dose calculation. Changes in sample locations identified in the Land Use Census are described in the Annual Radioactive Environmental Operating Report.

### 6.5 Effluent Monitoring System Non- functionality

BM-RE-52, Steam Generator Blowdown Discharge Monitor, has been non- functional since 2010 when the surveillances were changed to on- demand. The procedures for performing discharges

by this pathway were voided in 2007. The last discharge via this pathway was Q2 1986<sup>3</sup>, therefore the associated action statement has been met since BMRE52 became non- functional. Callaway Energy Center is in the process of removing BM-RE-52 from ODCM/ FSAR-SP Table 16.11-2, Radioactive Effluent Monitoring Instrumentation the associated discharge point from ODCM/FSAR-SP Table 16.11-1, Radioactive Liquid Waste Sampling and Analysis Program.

While operating in mode 1, GTRE22, Noble Gas Activity Monitor, was non- functional for 35 hours due to equipment malfunction between 7/2/17 10:14:00 – 7/3/17 21:20:00. During this time, there was a containment vent in progress on 7/2/17 until 12:29, which is an overlap of 2:15 hrs. The associated action statement requires that the purge be suspended within 4 hours, therefore the requirements of the associated action statement were met.

### 6.6 Offsite Dose Calculation Manual Changes

APA-ZZ-01003, "Callaway Plant Offsite Dose Calculation Manual" was revised during the reporting period. The changes are described in detail in Appendix B to APA-ZZ-01003. A complete copy of APA-ZZ-01003 rev. 22 with revision bars showing the areas of change is attached.

### 6.7 Process Control Program Changes

There were no changes to APA-ZZ-01011, "Process Control Program" during the reporting period.

### 6.8 Corrections to Previous Reports

The condition discussed in Section 6.5 for BM-RE-52 affects all reports 2010- 2016.

### 6.9 Other Information Related to Radioactive Effluents

Meteorological dispersion parameters, data recovery rate, and Joint Frequency Tables for the monitoring period are attached as Appendix B.

---

<sup>3</sup> Callaway Plant Semiannual Radioactive Effluent Release Report, January- June 1986, Table 2B.

## Appendix A

*Tables of Quantities Released in Liquid and Gaseous Radioactive Effluents and in Solid Radioactive Waste Shipments*

*Tables of Doses from the Discharge of Liquid and Gaseous Radioactive Effluents*

Table A-1: Gaseous Effluents- Summation of All Releases							
Summation of All Releases	Unit	Quarter 1	Quarter 2	Quarter 3	Quarter 4	Total	Estimated Uncertainty (%) <sup>4</sup>
<b>Fission &amp; Activation Gases</b>	Ci	5.33E-2	4.06E-2	1.08E-1	4.95E-1	6.97E-1	20
<i>Average Release Rate</i>	μCi/s	6.85E-3	5.16E-3	1.36E-2	6.22E-2	2.20E-2	
<i>% of Limit</i>	%	N/A	N/A	N/A	N/A	N/A	
<sup>131</sup> Iodine	Ci	0	0	0	0	0	23
<i>Average Release Rate</i>	μCi/s	0	0	0	0	0	
<i>% of Limit</i>	%	N/A	N/A	N/A	N/A	N/A	
<b>Particulates</b>	Ci	0	0	0	0	0	30
<i>Average Release Rate</i>	μCi/s	0	0	0	0	0	
<i>% of Limit</i>	%	N/A	N/A	N/A	N/A	N/A	
<i>Gross Alpha</i>	Ci	1.57E-7	2.96E-7	1.58E-7	1.29E-7	7.40E-7	
<sup>3</sup> H	Ci	5.75E0	9.02E0	1.01E1	1.82E1	4.31E1	14
<i>Average Release Rate</i>	μCi/s	7.40E-1	1.15E0	1.28E0	2.29E0	1.37E0	
<i>% of Limit</i>	%	N/A	N/A	N/A	N/A	N/A	
<sup>14</sup> C <sup>5</sup>	Ci	2.60E0	2.60E0	2.60E0	2.60E0	1.04E1	

<sup>4</sup> Safety Analysis calculation 87-063-00, January 6, 1988

<sup>5</sup> <sup>14</sup>C activity is estimated based on EPRI report TR-1021106, *Estimation of <sup>14</sup>C in Nuclear Power Plant Effluents*, December 2010.

Callaway Energy Center  
 2017 Annual Radioactive Effluent Release Report

<b>Table A-1A: Gaseous Effluents- Ground Level Release- Batch Mode</b>						
<b>Fission &amp; Activation Gases</b>	<b>Units</b>	<b>Quarter 1</b>	<b>Quarter 2</b>	<b>Quarter 3</b>	<b>Quarter 4</b>	<b>Total for the year</b>
<sup>41</sup> Ar	Ci	4.30E-2	4.06E-2	1.08E-1	4.90E-1	6.82E-1
<sup>85</sup> Kr	Ci	1.03E-2	0	0	4.65E-3	1.50E-2
<sup>133</sup> Xe	Ci	0	0	0	4.86E-5	4.86E-5
<b>Total</b>	<b>Ci</b>	<b>5.33E-2</b>	<b>4.06E-2</b>	<b>1.08E-1</b>	<b>4.95E-1</b>	<b>6.97E-1</b>
<b>Iodines &amp; Halogens</b>	<b>Units</b>	<b>Quarter 1</b>	<b>Quarter 2</b>	<b>Quarter 3</b>	<b>Quarter 4</b>	<b>Total for the year</b>
<sup>131</sup> I	Ci	0	0	0	0	0
<b>Particulates</b>	<b>Units</b>	<b>Quarter 1</b>	<b>Quarter 2</b>	<b>Quarter 3</b>	<b>Quarter 4</b>	<b>Total for the year</b>
	Ci	0	0	0	0	0
<sup>3</sup> H	Ci	1.49E-1	2.31E-1	5.84E-1	1.92E0	2.85E0
<b>Gross α</b>	<b>Ci</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>
<sup>14</sup> C	Ci	4.28E-1	4.28E-1	4.28E-1	4.28E-1	1.71E0

Callaway Energy Center  
 2017 Annual Radioactive Effluent Release Report

Table A-1B: Gaseous Effluents- Ground Level Release- Continuous Mode						
Fission & Activation Gases	Units	Quarter 1	Quarter 2	Quarter 3	Quarter 4	Total for the year
	Ci	0	0	0	0	0
Iodines & Halogens	Units	Quarter 1	Quarter 2	Quarter 3	Quarter 4	Total for the year
	Ci	0	0	0	0	0
Particulates	Units	Quarter 1	Quarter 2	Quarter 3	Quarter 4	Total for the year
	Ci	0	0	0	0	0
<sup>3</sup> H	Ci	5.60E0	8.79E0	9.56E0	1.63E1	4.03E1
Gross α	Ci	1.57E-7	2.96E-7	1.58E-7	1.29E-7	7.40E-7
<sup>14</sup> C	Ci	2.17E0	2.17E0	2.17E0	2.17E0	8.68E0

Table A-2: Liquid Effluents- Summation of All Releases

Summation of All Liquid Releases	Units	Quarter 1	Quarter 2	Quarter 3	Quarter 4	Total	Est. Uncert. (%) <sup>6</sup>
<b>Fission and Activation Products<sup>7</sup></b>	Ci	4.97E-3	7.94E-3	5.14E-3	2.82E-2	4.62E-2	20
<i>Avg Diluted Conc</i>	μCi/ml	4.96E-8	5.24E-8	2.09E-8	1.72E-7	6.98E-8	
<i>% of Limit</i>	%	N/A	N/A	N/A	N/A	N/A	
<b><sup>3</sup>H</b>	Ci	1.30E2	4.31E2	6.73E2	1.84E2	1.42E3	14
<i>Avg Diluted Conc</i>	μCi/ml	1.30E-3	2.85E-3	2.73E-3	1.12E-3	2.14E-3	
<i>% of Limit</i>	%	N/A	N/A	N/A	N/A	N/A	
<b>Dissolved &amp; Entrained Gases</b>	Ci	0.00E0	0.00E0	3.03E-4	1.57E-3	1.87E-3	27
<i>Avg Diluted Conc</i>	μCi/ml	0.00E0	0.00E0	1.23E-9	9.57E-9	4.56E-09	
<i>% of Limit</i>	%	N/A	N/A	N/A	N/A	N/A	
<b>Gross α</b>	Ci	0.00E0	1.29E-4	5.29E-5	0.00E0	1.82E-4	29
<i>Avg Diluted Conc</i>	μCi/ml	0.00E0	8.52E-10	2.15E-10	0.00E0	4.57E-10	
<b>Vol Liquid Effluent<sup>8</sup></b>	Liters	3.13E6	3.39E6	5.07E6	5.15E6	1.67E7	
<b>Dilution Volume<sup>9</sup></b>	Liters	9.69E7	1.48E8	2.41E8	1.59E8	6.45E8	
<b>Avg river flow<sup>10</sup></b>	m <sup>3</sup> /s	1.50E3	4.69E3	2.44E3	1.77E3	2.60E3	
<b>Time period for releases</b>	hrs	6.68E1	1.04E2	1.70E2	1.12E2	4.52E2	

<sup>6</sup> Safety Analysis calculation 87-063-00, January 6, 1988

<sup>7</sup> Excludes <sup>3</sup>H, noble gases, and gross alpha.

<sup>8</sup> Primary system liquid effluent plus secondary liquid effluent, prior to dilution.

<sup>9</sup> Does not include Missouri River dilution.

<sup>10</sup> Average Missouri River flow for the year at the Hermann, MO monitoring station as reported by the USGS.

Table A-2A: Liquid Effluents- Batch Mode						
Fission & Activation Products	Units	Quarter 1	Quarter 2	Quarter 3	Quarter 4	Total for the year
<sup>60</sup> Co	Ci	5.06E-4	7.06E-4	9.85E-4	3.14E-4	2.51E-3
<sup>137</sup> Cs	Ci	1.97E-4	1.43E-4	1.03E-4	7.63E-6	4.51E-4
<sup>63</sup> Ni	Ci	9.08E-5	1.86E-3	1.52E-4	8.77E-5	2.19E-3
<sup>125</sup> Sb	Ci	4.16E-3	5.12E-3	3.88E-3	2.27E-2	3.59E-2
<sup>58</sup> Co	Ci	2.66E-6	1.17E-5	0	9.34E-5	1.08E-4
<sup>124</sup> Sb	Ci	9.89E-6	0	2.43E-5	3.58E-3	3.61E-3
<sup>51</sup> Cr	Ci	0	9.57E-5	0	7.30E-4	8.26E-4
<sup>54</sup> Mn	Ci	0	0	4.70E-6	0	4.70E-6
<sup>132</sup> I	Ci	0	0	0	3.15E-4	3.15E-4
<sup>132</sup> Te	Ci	0	0	0	3.30E-4	3.30E-4
<sup>117m</sup> Sn	Ci	0	0	0	3.36E-5	3.36E-5
<sup>126</sup> Sb	Ci	0	0	0	1.77E-5	1.77E-5
Total	Ci	4.97E-03	7.94E-03	5.15E-03	2.82E-02	4.63E-2
Dissolved & Entrained Gases	Units	Quarter 1	Quarter 2	Quarter 3	Quarter 4	Total for the year
<sup>133</sup> Xe	Ci	0	0	3.03E-4	1.57E-3	1.87E-3
<sup>3</sup> H	Ci	1.30E2	4.31E2	6.73E2	1.84E2	1.42E3
Gross α	Ci	0	1.29E-4	5.29E-5	0	1.82E-4

Table A-3: Low Level Waste

Resins, Filters, And Evaporator Bottoms			
Waste Class	Volume		Curies Shipped
	ft <sup>3</sup>	m <sup>3</sup>	
A	1.60E+02	4.52E+00	1.79E+00
B	0.00E+00	0.00E+00	0.00E+00
C	7.50E+00	2.12E-01	1.74E+00
Unclassified	5.00E+00	1.42E-01	2.03E+00
All	1.67E+02	4.73E+00	3.53E+00

Major Nuclides for the Above Table: 4.73E+01 stek  
H-3, C-14, Cr-51, Fe-55, Co-58, Co-60, Ni-59, Ni-63, Sr-90, Zr-95, Nb-94, Nb-95, Tc-99, Sn-117m, I-129, Cs-134, Cs-137, Ce-144, Pu-238, Pu-239, Pu-240, Pu-241, Pu-

Dry Active Waste (DAW)			
Waste Class	Volume		Curies Shipped
	ft <sup>3</sup>	m <sup>3</sup>	
A	1.06E+04	3.01E+02	1.41E-01
B	0.00E+00	0.00E+00	0.00E+00
C	0.00E+00	0.00E+00	0.00E+00
Unclassified	0.00E+00	0.00E+00	0.00E+00
All	1.06E+04	3.01E+02	1.41E-01

Major Nuclides for the Above Table: 2.01E+3 stek  
H-3, C-14, Cr-51, Mn-54, Fe-55, Co-58, Co-60, Ni-59, Ni-63, Zn-65, Sr-90, Nb-94, Nb-95, Tc-99, Ru-106, Sb-125, I-129, Cs-134, Cs-137, Pu-238, Pu-239, Pu-240, Pu-

Irradiated Components			
Waste Class	Volume		Curies Shipped
	ft <sup>3</sup>	m <sup>3</sup>	
A	0.00E+00	0.00E+00	0.00E+00
B	0.00E+00	0.00E+00	0.00E+00
C	0.00E+00	0.00E+00	0.00E+00
Unclassified	0.00E+00	0.00E+00	0.00E+00
All	0.00E+00	0.00E+00	0.00E+00

Major Nuclides for the Above Table:

Callaway Energy Center  
 2017 Annual Radioactive Effluent Release Report

Other Waste			
Waste Class	Volume		Curies Shipped
	ft <sup>3</sup>	m <sup>3</sup>	
A	0.00E+00	0.00E+00	0.00E+00
B	0.00E+00	0.00E+00	0.00E+00
C	0.00E+00	0.00E+00	0.00E+00
Unclassified	0.00E+00	0.00E+00	0.00E+00
<b>All</b>	0.00E+00	0.00E+00	0.00E+00
Major Nuclides for the Above Table:			

Sum Of All Low-Level Waste Shipped From Site			
Waste Class	Volume		Curies Shipped
	ft <sup>3</sup>	m <sup>3</sup>	
A	1.08E+04	3.06E+02	1.93E+00
B	0.00E+00	0.00E+00	0.00E+00
C	7.50E+00	2.12E-01	1.74E+00
Unclassified	5.00E+00	1.42E-01	2.03E+00
<b>All</b>	1.08E+04	3.06E+02	3.67E+00
Major Nuclides for the Above Table: H-3, C-14, Cr-51, Mn-54, Fe-55, Co-58, Co-60, Ni-59, Ni-63, Zn-65, Sr-90, Zr-95, Nb-94, Nb-95, Tc-99, Ru-106, Sn-117m, Sb-125, I-129, Cs-134, Cs-137, Ce-144, Pu-238, Pu-239, Pu-240, Pu-241, Pu-242, Am-241, Cm-242, Cm-243, Cm-244			

	Quarter 1	Quarter 2	Quarter 3	Quarter 4	Yearly total
<b>Liquid Effluent Dose Limit, Total Body (mrem)</b>	1.5	1.5	1.5	1.5	3
Total Body Dose (mrem)	7.23E-4	1.13E-3	1.45E-3	3.42E-4	3.65E-3
% Limit (%)	0.05%	0.08%	0.10%	0.02%	0.12%
<b>Liquid Effluent Dose Limit, Maximum Organ (mrem)</b>	5	5	5	5	10
Maximum Organ Dose (mrem)	9.86E-4	1.34E-3	1.59E-3	5.30E-4	4.28E-3
% Limit (%)	0.02%	0.03%	0.03%	0.01%	0.04%
<b>Gaseous Effluent Dose Limit, Gamma Air (mrem)</b>	5	5	5	5	10
Gamma Air Dose (mrad)	2.04E-5	1.93E-5	5.13E-5	2.33E-4	3.24E-4
% Limit (%)	0.00%	0.00%	0.00%	0.00%	0.00%
<b>Gaseous Effluent Dose Limit, Beta Air (mrem)</b>	10	10	10	10	20
Beta Air Dose (mrad)	8.22E-6	6.80E-6	1.81E-5	8.25E-5	1.16E-4
% Limit (%)	0.00%	0.00%	0.00%	0.00%	0.00%
<b>Gaseous Effluent Dose Limit, Maximum Organ (mrem)</b>	7.5	7.5	7.5	7.5	15
Maximum organ dose <sup>11</sup> (mrem)	1.50E-3	2.35E-3	2.63E-3	4.75E-3	1.13E-2
% Limit (%)	0.02%	0.03%	0.04%	0.06%	0.07%
<sup>14</sup> C Maximum organ dose (mrem) <sup>12</sup>	3.25E-3	3.25E-3	3.25E-3	3.25E-3	1.30E-2

<sup>11</sup> Iodine, <sup>3</sup>H, and particulates with greater than an 8 day half- life.

<sup>12</sup> Not included in above totals

Callaway Energy Center  
2017 Annual Radioactive Effluent Release Report

	Whole Body	Thyroid	Max Other Organ
<b>Dose Limit</b>	25 mrem	75 mrem	25 mrem
<b>Dose</b>	1.66E-02	1.64E-02	2.79E-02
<b>% Limit</b>	0.07%	0.02%	0.11%

## Appendix B

### *Meteorological Parameters for the Reporting Period*

*Joint Frequency Tables; Totals of Hours at Each Wind Speed & Direction for the period January 1, 2017- December 31, 2017*

## Meteorological Parameters for the Reporting Period

### Nearest Resident Dispersion Parameters

Direction: NNW

Distance: 2913 meters

X/Q, Undecayed and Undepleted: 9.75E-07 sec/m<sup>3</sup>

X/Q Decayed and Undepleted: 9.63E-07 sec/m<sup>3</sup>

X/Q Decayed and Depleted: 8.12E-07 sec/m<sup>3</sup>

D/Q Deposition rate: 2.76E-09 m<sup>-2</sup>

### Site Boundary Dispersion Parameters

Direction: SSW

Distance: 1400 meters

X/Q, Undecayed and Undepleted: 1.62E-06 sec/m<sup>3</sup>

X/Q Decayed and Undepleted: 1.61E-06 sec/m<sup>3</sup>

X/Q Decayed and Depleted: 1.43E-06 sec/m<sup>3</sup>

D/Q Deposition rate: 5.35E-09 m<sup>-2</sup>

### Meteorological Data Recovery Rate

10 meters elevation      Hours of valid data: 8723  
   Total hours in period: 8760  
   Recovery rate: 99.6%

60 meters elevation      Hours of valid data: 8723  
   Total hours in period: 8760  
   Recovery rate: 99.6%

Joint Frequency Distribution: Hours at Wind Speed and Direction												
January- December, 2017												
All Stabilities												
Elevations: Winds 10m    Stability 60m												
Wind Direction Sector	Wind Speed Range (m/s)											Total
	<0.50	0.5- 1	1.1- 1.5	1.6- 2	2.1- 3	3.1- 4	4.1- 5	5.1- 6	6.1- 8	8.1- 10	>10.00	
N	3	19	65	66	164	118	89	42	23	6	0	595
NNE	0	47	65	69	163	119	51	14	3	1	0	532
NE	6	43	54	52	116	86	49	19	4	0	0	429
ENE	5	20	47	43	63	49	28	5	2	0	0	262
E	5	28	38	36	109	48	20	14	2	0	0	300
ESE	4	31	43	56	111	68	18	5	2	0	0	338
SE	5	24	125	139	243	130	25	1	0	0	0	692
SSE	4	44	76	129	408	178	68	30	18	1	0	956
S	0	39	60	76	246	228	143	85	100	9	2	988
SSW	4	23	46	74	159	124	105	38	37	3	1	614
SW	1	24	63	79	185	115	67	42	12	1	0	589
WSW	3	28	50	48	103	69	27	15	6	2	0	351
W	6	35	33	41	88	95	68	29	27	1	0	423
WNW	2	24	52	54	134	77	88	31	26	0	0	488
NW	0	21	72	82	149	130	81	28	8	0	0	571
NNW	1	39	43	85	140	135	80	40	24	2	0	589
Tot	49	489	932	1129	2581	1769	1007	438	294	26	3	8717
Hours of Calm .....	6											
Hours of Variable Direction .....	0											
Hours of Valid Data .....	8723											
Hours of Missing Data .....	37											
Hours in Period .....	8760											

Joint Frequency Distribution: Hours at Wind Speed and Direction												
January- December, 2017												
Class A Extremely Unstable based on lapse rate												
Elevations: Winds 10m Stability 60m												
Wind Direction Sector	Wind Speed Range (m/s)											Total
	<0.50	0.5- 1	1.1- 1.5	1.6- 2	2.1- 3	3.1- 4	4.1- 5	5.1- 6	6.1- 8	8.1- 10	>10.00	
N	0	0	0	0	0	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	1	1	0	0	0	2
E	0	0	0	0	0	0	0	2	0	0	0	2
ESE	0	0	0	0	0	0	0	0	0	0	0	0
SE	0	0	0	0	2	9	5	0	0	0	0	16
SSE	0	0	0	0	4	8	8	1	0	0	0	21
S	0	0	0	1	1	12	12	3	11	0	0	40
SSW	0	0	0	0	0	4	7	3	5	0	0	19
SW	0	0	0	0	0	3	11	17	4	0	0	35
WSW	0	0	0	0	0	6	3	1	0	0	0	10
W	0	0	0	0	0	1	9	1	0	0	0	11
WNW	0	0	0	0	1	2	15	9	2	0	0	29
NW	0	0	0	0	0	0	16	0	1	0	0	17
NNW	0	0	0	0	0	0	2	0	0	0	0	2
Tot	0	0	0	1	8	45	89	38	23	0	0	204
Hours of Calm .....	0											
Hours of Variable Direction .....	0											
Hours of Valid Data .....	204											
Hours of Missing Data .....	37											
Hours in Period .....	8760											

Joint Frequency Distribution: Hours at Wind Speed and Direction												
January- December, 2017												
Class B Moderately Unstable based on lapse rate												
Elevations: Winds 10m Stability 60m												
Wind Direction Sector	Wind Speed Range (m/s)											Total
	<0.50	0.5- 1	1.1- 1.5	1.6- 2	2.1- 3	3.1- 4	4.1- 5	5.1- 6	6.1- 8	8.1- 10	>10.00	
N	0	0	0	0	0	0	0	0	2	0	0	2
NNE	0	0	0	1	1	2	1	0	0	0	0	5
NE	0	0	0	0	0	0	0	1	0	0	0	1
ENE	0	0	0	0	0	2	3	0	1	0	0	6
E	0	0	0	0	1	2	1	1	0	0	0	5
ESE	0	0	0	0	2	3	1	0	0	0	0	6
SE	0	0	0	2	9	13	5	0	0	0	0	29
SSE	0	0	0	3	16	15	4	4	1	0	0	43
S	0	0	1	1	15	13	5	7	5	0	0	47
SSW	0	0	0	1	8	14	12	4	10	0	0	49
SW	0	0	0	0	7	15	11	7	2	0	0	42
WSW	0	0	0	0	2	6	1	2	1	0	0	12
W	0	0	0	0	3	6	8	2	5	0	0	24
WNW	0	0	0	0	3	9	8	1	3	0	0	24
NW	0	0	0	0	3	6	5	1	1	0	0	16
NNW	0	0	0	0	2	1	4	1	3	0	0	11
Tot	0	0	1	8	72	107	69	31	34	0	0	322
Hours of Calm .....	0											
Hours of Variable Direction .....	0											
Hours of Valid Data .....	322											
Hours of Missing Data .....	37											
Hours in Period .....	8760											

Joint Frequency Distribution: Hours at Wind Speed and Direction												
January- December, 2017												
Class C Slightly Unstable based on lapse rate												
Elevations: Winds 10m Stability 60m												
Wind Direction Sector	Wind Speed Range (m/s)											Total
	<0.50	0.5- 1	1.1- 1.5	1.6- 2	2.1- 3	3.1- 4	4.1- 5	5.1- 6	6.1- 8	8.1- 10	>10.00	
N	0	0	1	1	9	9	3	4	3	1	0	31
NNE	0	0	0	1	7	8	2	2	0	0	0	20
NE	0	0	0	1	3	3	3	2	2	0	0	14
ENE	0	0	1	1	5	5	1	1	0	0	0	14
E	0	0	0	2	3	3	2	2	0	0	0	12
ESE	0	0	0	2	7	9	2	0	0	0	0	20
SE	0	0	1	8	28	13	3	0	0	0	0	53
SSE	0	0	0	3	23	7	4	0	1	0	0	38
S	0	0	1	9	13	11	13	7	13	2	0	69
SSW	0	0	0	6	19	12	21	7	5	0	0	70
SW	0	0	1	6	16	18	5	5	0	0	0	51
WSW	0	0	1	6	14	8	2	1	0	0	0	32
W	0	0	0	0	6	5	3	4	2	0	0	20
WNW	0	0	0	1	17	11	6	2	3	0	0	40
NW	0	0	1	2	12	16	4	2	2	0	0	39
NNW	0	0	0	2	4	11	9	5	7	0	0	38
Tot	0	0	7	51	186	149	83	44	38	3	0	561
Hours of Calm .....	0											
Hours of Variable Direction .....	0											
Hours of Valid Data .....	561											
Hours of Missing Data .....	37											
Hours in Period .....	8760											

Joint Frequency Distribution: Hours at Wind Speed and Direction												
January- December, 2017												
Class D Neutral based on lapse rate												
Elevations: Winds 10m Stability 60m												
Wind Direction Sector	Wind Speed Range (m/s)											Total
	<0.50	0.5- 1	1.1- 1.5	1.6- 2	2.1- 3	3.1- 4	4.1- 5	5.1- 6	6.1- 8	8.1- 10	>10.00	
N	0	1	17	29	87	82	80	36	16	4	0	352
NNE	0	1	15	19	92	97	43	12	3	1	0	283
NE	0	2	15	15	79	67	46	16	2	0	0	242
ENE	1	0	13	16	33	39	22	3	1	0	0	128
E	0	3	9	7	68	34	15	8	2	0	0	146
ESE	0	1	14	22	51	35	13	4	2	0	0	142
SE	0	1	22	35	100	56	10	0	0	0	0	224
SSE	0	3	13	23	61	47	25	17	11	1	0	201
S	0	7	11	25	53	53	44	41	62	6	2	304
SSW	0	3	9	13	41	40	29	15	14	3	1	168
SW	0	3	17	23	70	36	27	9	6	1	0	192
WSW	0	4	14	15	40	29	12	11	5	2	0	132
W	0	4	12	12	52	47	19	21	20	1	0	188
WNW	0	2	5	26	74	39	52	17	13	0	0	228
NW	0	3	10	30	73	77	51	22	4	0	0	270
NNW	0	4	11	29	66	98	55	25	14	2	0	304
Tot	1	42	207	339	1040	876	543	257	175	21	3	3504
Hours of Calm .....												1
Hours of Variable Direction .....												0
Hours of Valid Data .....												3505
Hours of Missing Data .....												37
Hours in Period .....												8760

Joint Frequency Distribution: Hours at Wind Speed and Direction												
January- December, 2017												
Class E Slightly Stable based on lapse rate												
Elevations: Winds 10m Stability 60m												
Wind Direction Sector	Wind Speed Range (m/s)											Total
	<0.50	0.5- 1	1.1- 1.5	1.6- 2	2.1- 3	3.1- 4	4.1- 5	5.1- 6	6.1- 8	8.1- 10	>10.00	
N	0	6	19	26	44	27	6	2	2	1	0	133
NNE	0	11	17	27	49	12	5	0	0	0	0	121
NE	0	9	6	22	26	16	0	0	0	0	0	79
ENE	0	3	12	16	22	3	1	0	0	0	0	57
E	0	11	15	19	33	9	2	1	0	0	0	90
ESE	0	7	9	21	44	21	2	1	0	0	0	105
SE	0	5	45	45	82	35	2	1	0	0	0	215
SSE	0	4	16	38	105	69	27	8	5	0	0	272
S	0	5	8	10	63	111	64	27	9	1	0	298
SSW	1	5	12	17	45	44	35	9	3	0	0	171
SW	0	3	18	28	46	34	12	4	0	0	0	145
WSW	0	6	19	19	35	17	9	0	0	0	0	105
W	2	9	7	22	24	36	29	1	0	0	0	130
WNW	0	6	12	11	34	16	7	2	5	0	0	93
NW	0	5	21	25	42	30	5	3	0	0	0	131
NNW	0	6	6	25	59	24	10	9	0	0	0	139
Tot	3	101	242	371	753	504	216	68	24	2	0	2284
Hours of Calm .....	0											
Hours of Variable Direction .....	0											
Hours of Valid Data .....	2284											
Hours of Missing Data .....	37											
Hours in Period .....	8760											

Joint Frequency Distribution: Hours at Wind Speed and Direction												
January- December, 2017												
Class F Moderately Stable based on lapse rate												
Elevations: Winds 10m Stability 60m												
Wind Direction Sector	Wind Speed Range (m/s)											Total
	<0.50	0.5- 1	1.1- 1.5	1.6- 2	2.1- 3	3.1- 4	4.1- 5	5.1- 6	6.1- 8	8.1- 10	>10.00	
N	0	8	12	8	19	0	0	0	0	0	0	47
NNE	0	17	20	15	11	0	0	0	0	0	0	63
NE	2	12	17	13	7	0	0	0	0	0	0	51
ENE	1	10	18	10	3	0	0	0	0	0	0	42
E	1	8	11	8	4	0	0	0	0	0	0	32
ESE	2	13	18	11	7	0	0	0	0	0	0	51
SE	2	7	43	45	20	4	0	0	0	0	0	121
SSE	1	12	17	44	157	22	0	0	0	0	0	253
S	0	10	17	15	78	24	5	0	0	0	0	149
SSW	1	5	15	26	40	10	1	0	0	0	0	98
SW	1	6	18	19	39	9	1	0	0	0	0	93
WSW	2	11	15	8	11	3	0	0	0	0	0	50
W	2	9	9	7	3	0	0	0	0	0	0	30
WNW	1	9	18	8	5	0	0	0	0	0	0	41
NW	0	7	29	18	13	1	0	0	0	0	0	68
NNW	0	12	13	23	7	1	0	0	0	0	0	56
Tot	16	156	290	278	424	74	7	0	0	0	0	1245
Hours of Calm .....	1											
Hours of Variable Direction .....	0											
Hours of Valid Data .....	1246											
Hours of Missing Data .....	37											
Hours in Period .....	8760											

Joint Frequency Distribution: Hours at Wind Speed and Direction												
January- December, 2017												
Class G Extremely Stable based on lapse rate												
Elevations: Winds 10m Stability 60m												
Wind Direction Sector	Wind Speed Range (m/s)											Total
	<0.50	0.5- 1	1.1- 1.5	1.6- 2	2.1- 3	3.1- 4	4.1- 5	5.1- 6	6.1- 8	8.1- 10	>10.00	
N	3	4	16	2	5	0	0	0	0	0	0	30
NNE	0	18	13	6	3	0	0	0	0	0	0	40
NE	4	20	16	1	1	0	0	0	0	0	0	42
ENE	3	7	3	0	0	0	0	0	0	0	0	13
E	4	6	3	0	0	0	0	0	0	0	0	13
ESE	2	10	2	0	0	0	0	0	0	0	0	14
SE	3	11	14	4	2	0	0	0	0	0	0	34
SSE	3	25	30	18	42	10	0	0	0	0	0	128
S	0	17	22	15	23	4	0	0	0	0	0	81
SSW	2	10	10	11	6	0	0	0	0	0	0	39
SW	0	12	9	3	7	0	0	0	0	0	0	31
WSW	1	7	1	0	1	0	0	0	0	0	0	10
W	2	13	5	0	0	0	0	0	0	0	0	20
WNW	1	7	17	8	0	0	0	0	0	0	0	33
NW	0	6	11	7	6	0	0	0	0	0	0	30
NNW	1	17	13	6	2	0	0	0	0	0	0	39
Tot	29	190	185	81	98	14	0	0	0	0	0	597
Hours of Calm .....	4											
Hours of Variable Direction .....	0											
Hours of Valid Data .....	601											
Hours of Missing Data .....	37											
Hours in Period .....	8760											

Joint Frequency Distribution: Hours at Wind Speed and Direction												
January- December, 2017												
All Stabilities												
Elevations: Winds 60m Stability 60m												
Wind Direction Sector	Wind Speed Range (m/s)											Total
	<0.50	0.5- 1	1.1- 1.5	1.6- 2	2.1- 3	3.1- 4	4.1- 5	5.1- 6	6.1- 8	8.1- 10	>10.00	
N	0	3	16	15	56	108	110	120	72	20	6	526
NNE	0	3	11	18	67	109	120	108	38	5	1	480
NE	0	3	15	23	58	102	117	118	69	2	0	507
ENE	0	5	4	14	42	81	76	59	26	2	0	309
E	1	3	15	14	43	76	90	46	27	3	0	318
ESE	0	2	8	17	45	65	94	62	21	3	0	317
SE	0	4	17	71	226	189	108	28	2	3	0	648
SSE	0	6	11	29	135	168	136	130	117	20	3	755
S	0	4	9	20	90	93	151	195	289	133	26	1010
SSW	0	1	12	21	57	96	117	147	241	57	9	758
SW	0	3	10	14	75	94	106	129	214	52	6	703
WSW	0	2	13	19	55	51	72	73	75	19	9	388
W	0	3	9	12	50	54	55	76	129	43	18	449
WNW	0	3	8	4	38	66	62	92	149	49	31	502
NW	0	1	6	15	38	72	127	146	166	48	5	624
NNW	0	1	4	12	50	61	91	92	86	17	13	427
Tot	1	47	168	318	1125	1485	1632	1621	1721	476	127	8721
Hours of Calm .....	2											
Hours of Variable Direction .....	0											
Hours of Valid Data .....	8723											
Hours of Missing Data .....	37											
Hours in Period .....	8760											

Joint Frequency Distribution: Hours at Wind Speed and Direction												
January- December, 2017												
Class A Extremely Unstable based on lapse rate												
Elevations: Winds 60m Stability 60m												
Wind Direction Sector	Wind Speed Range (m/s)											Total
	<0.50	0.5- 1	1.1- 1.5	1.6- 2	2.1- 3	3.1- 4	4.1- 5	5.1- 6	6.1- 8	8.1- 10	>10.00	
N	0	0	0	0	0	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0	2	0	0	0	2
E	0	0	0	0	0	0	0	1	1	0	0	2
ESE	0	0	0	0	0	0	0	0	0	0	0	0
SE	0	0	0	0	0	4	6	1	0	0	0	11
SSE	0	0	0	0	3	5	8	7	1	0	0	24
S	0	0	0	0	2	2	9	9	6	8	1	37
SSW	0	0	0	0	0	0	5	5	7	6	1	24
SW	0	0	0	0	0	0	1	5	18	10	1	35
WSW	0	0	0	0	0	0	2	4	2	1	0	9
W	0	0	0	0	0	0	0	3	7	1	0	11
WNW	0	0	0	0	0	1	0	1	19	7	4	32
NW	0	0	0	0	0	0	0	2	13	1	0	16
NNW	0	0	0	0	0	0	0	0	1	0	0	1
Tot	0	0	0	0	5	12	31	40	75	34	7	204
Hours of Calm .....	0											
Hours of Variable Direction .....	0											
Hours of Valid Data .....	204											
Hours of Missing Data .....	37											
Hours in Period .....	8760											

Joint Frequency Distribution: Hours at Wind Speed and Direction												
January- December, 2017												
Class B Moderately Unstable based on lapse rate												
Elevations: Winds 60m Stability 60m												
Wind Direction Sector	Wind Speed Range (m/s)											Total
	<0.50	0.5- 1	1.1- 1.5	1.6- 2	2.1- 3	3.1- 4	4.1- 5	5.1- 6	6.1- 8	8.1- 10	>10.00	
N	0	0	0	0	0	0	0	0	1	0	0	1
NNE	0	0	0	1	0	1	1	1	0	1	0	5
NE	0	0	0	0	0	0	1	0	1	0	0	2
ENE	0	0	0	0	0	0	2	2	0	1	0	5
E	0	0	0	0	0	1	1	2	1	0	0	5
ESE	0	0	0	0	0	2	2	0	0	0	0	4
SE	0	0	0	1	3	14	5	5	0	0	0	28
SSE	0	0	0	0	11	17	10	0	6	1	0	45
S	0	0	0	1	8	7	9	8	7	4	1	45
SSW	0	0	0	1	2	9	9	12	7	9	0	49
SW	0	0	0	0	0	9	8	6	13	6	1	43
WSW	0	0	0	0	0	2	2	5	5	2	1	17
W	0	0	0	0	0	3	2	4	8	4	2	23
WNW	0	0	0	0	0	5	3	8	7	1	3	27
NW	0	0	0	0	0	3	2	5	5	2	0	17
NNW	0	0	0	0	0	1	0	2	0	1	2	6
Tot	0	0	0	4	24	74	57	60	61	32	10	322
Hours of Calm .....												0
Hours of Variable Direction .....												0
Hours of Valid Data .....												322
Hours of Missing Data .....												37
Hours in Period .....												8760

Joint Frequency Distribution: Hours at Wind Speed and Direction												
January- December, 2017												
Class C Slightly Unstable based on lapse rate												
Elevations: Winds 60m Stability 60m												
Wind Direction Sector	Wind Speed Range (m/s)											Total
	<0.50	0.5- 1	1.1- 1.5	1.6- 2	2.1- 3	3.1- 4	4.1- 5	5.1- 6	6.1- 8	8.1- 10	>10.00	
N	0	0	0	0	6	5	5	2	6	1	1	26
NNE	0	1	0	0	0	7	6	1	1	0	0	16
NE	0	0	1	0	2	4	3	1	5	1	0	17
ENE	0	0	0	1	3	6	1	2	0	0	0	13
E	0	0	1	0	4	3	1	3	1	0	0	13
ESE	0	0	0	1	4	2	7	2	0	0	0	16
SE	0	0	0	6	17	18	6	1	0	0	0	48
SSE	0	0	0	0	18	15	2	5	0	1	0	41
S	0	0	0	1	17	9	7	7	10	11	4	66
SSW	0	0	1	2	8	17	9	12	15	6	0	70
SW	0	0	0	1	11	13	9	11	13	3	0	61
WSW	0	0	0	3	7	5	7	6	2	0	0	30
W	0	0	0	0	4	5	1	2	9	3	1	25
WNW	0	0	0	0	4	9	9	4	10	2	3	41
NW	0	0	0	0	4	6	14	11	8	3	1	47
NNW	0	0	0	2	4	1	7	6	4	6	1	31
Tot	0	1	3	17	113	125	94	76	84	37	11	561
Hours of Calm .....	0											
Hours of Variable Direction .....	0											
Hours of Valid Data .....	561											
Hours of Missing Data .....	37											
Hours in Period .....	8760											

Joint Frequency Distribution: Hours at Wind Speed and Direction												
January- December, 2017												
Class D Neutral based on lapse rate												
Elevations: Winds 60m Stability 60m												
Wind Direction Sector	Wind Speed Range (m/s)											Total
	<0.50	0.5- 1	1.1- 1.5	1.6- 2	2.1- 3	3.1- 4	4.1- 5	5.1- 6	6.1- 8	8.1- 10	>10.00	
N	0	1	7	12	36	56	62	69	52	17	4	316
NNE	0	0	10	8	43	69	67	59	22	4	1	283
NE	0	1	9	11	26	69	57	52	38	1	0	264
ENE	0	1	3	5	21	38	27	14	19	1	0	129
E	1	2	7	9	25	38	28	7	15	3	0	135
ESE	0	0	4	8	25	29	27	15	12	3	0	123
SE	0	1	4	19	74	67	38	9	1	1	0	214
SSE	0	2	7	17	44	36	34	36	21	10	2	209
S	0	0	6	11	35	32	24	39	73	66	18	304
SSW	0	0	5	9	23	35	30	23	32	16	8	181
SW	0	0	5	8	28	29	45	33	35	19	3	205
WSW	0	0	9	9	23	22	18	25	19	11	8	144
W	0	2	3	6	29	24	24	26	36	25	14	189
WNW	0	1	3	2	23	29	31	44	68	32	16	249
NW	0	1	3	10	26	40	64	55	76	36	3	314
NNW	0	1	3	8	38	40	48	42	48	7	10	245
Tot	1	13	88	152	519	653	624	548	567	252	87	3504
Hours of Calm .....	1											
Hours of Variable Direction .....	0											
Hours of Valid Data .....	3505											
Hours of Missing Data .....	37											
Hours in Period .....	8760											

Joint Frequency Distribution: Hours at Wind Speed and Direction												
January- December, 2017												
Class E Slightly Stable based on lapse rate												
Elevations: Winds 60m Stability 60m												
Wind Direction Sector	Wind Speed Range (m/s)											Total
	<0.50	0.5- 1	1.1- 1.5	1.6- 2	2.1- 3	3.1- 4	4.1- 5	5.1- 6	6.1- 8	8.1- 10	>10.00	
N	0	1	4	1	10	33	31	31	9	2	1	123
NNE	0	1	0	6	14	29	28	30	6	0	0	114
NE	0	1	3	7	12	15	28	36	8	0	0	110
ENE	0	1	1	5	10	12	23	13	3	0	0	68
E	0	0	2	3	6	21	39	10	6	0	0	87
ESE	0	0	4	6	6	14	39	25	5	0	0	99
SE	0	0	2	16	60	57	40	9	1	2	0	187
SSE	0	2	0	5	27	41	44	49	56	7	1	232
S	0	2	1	3	12	16	34	53	135	40	2	298
SSW	0	1	5	1	9	13	25	34	115	14	0	217
SW	0	1	2	2	16	17	21	35	60	11	1	166
WSW	0	1	1	1	11	13	25	22	29	2	0	105
W	0	1	2	1	8	13	17	21	65	10	1	139
WNW	0	0	1	1	7	13	13	23	35	7	5	105
NW	0	0	3	3	2	14	28	38	40	6	1	135
NNW	0	0	0	2	5	9	24	33	22	3	0	98
Tot	0	12	31	63	215	330	459	462	595	104	12	2283
Hours of Calm .....	1											
Hours of Variable Direction .....	0											
Hours of Valid Data .....	2284											
Hours of Missing Data .....	37											
Hours in Period .....	8760											

Joint Frequency Distribution: Hours at Wind Speed and Direction												
January- December, 2017												
Class F Moderately Stable based on lapse rate												
Elevations: Winds 60m Stability 60m												
Wind Direction Sector	Wind Speed Range (m/s)											Total
	<0.50	0.5- 1	1.1- 1.5	1.6- 2	2.1- 3	3.1- 4	4.1- 5	5.1- 6	6.1- 8	8.1- 10	>10.00	
N	0	0	3	0	3	11	12	12	2	0	0	43
NNE	0	1	0	2	6	1	13	13	6	0	0	42
NE	0	0	2	4	10	7	20	21	11	0	0	75
ENE	0	1	0	3	3	13	15	12	1	0	0	48
E	0	1	4	2	4	8	9	20	3	0	0	51
ESE	0	1	0	2	8	8	10	18	4	0	0	51
SE	0	2	4	18	55	20	13	3	0	0	0	115
SSE	0	2	2	3	21	37	30	31	26	1	0	153
S	0	1	1	2	7	11	52	57	48	4	0	183
SSW	0	0	0	4	5	8	23	41	47	4	0	132
SW	0	1	1	0	11	8	15	29	61	3	0	129
WSW	0	1	2	2	7	5	11	9	15	3	0	55
W	0	0	1	4	4	6	10	18	4	0	0	47
WNW	0	1	2	0	1	5	4	9	7	0	0	29
NW	0	0	0	1	3	4	17	30	17	0	0	72
NNW	0	0	0	0	3	3	5	5	5	0	0	21
Tot	0	12	22	47	151	155	259	328	257	15	0	1246
Hours of Calm .....	0											
Hours of Variable Direction .....	0											
Hours of Valid Data .....	1246											
Hours of Missing Data .....	37											
Hours in Period .....	8760											

Joint Frequency Distribution: Hours at Wind Speed and Direction												
January- December, 2017												
Class G Extremely Stable based on lapse rate												
Elevations: Winds 60m Stability 60m												
Wind Direction Sector	Wind Speed Range (m/s)											Total
	<0.50	0.5- 1	1.1- 1.5	1.6- 2	2.1- 3	3.1- 4	4.1- 5	5.1- 6	6.1- 8	8.1- 10	>10.00	
N	0	1	2	2	1	3	0	6	2	0	0	17
NNE	0	0	1	1	4	2	5	4	3	0	0	20
NE	0	1	0	1	8	7	8	8	6	0	0	39
ENE	0	2	0	0	5	12	8	14	3	0	0	44
E	0	0	1	0	4	5	12	3	0	0	0	25
ESE	0	1	0	0	2	10	9	2	0	0	0	24
SE	0	1	7	11	17	9	0	0	0	0	0	45
SSE	0	0	2	4	11	17	8	2	7	0	0	51
S	0	1	1	2	9	16	16	22	10	0	0	77
SSW	0	0	1	4	10	14	16	20	18	2	0	85
SW	0	1	2	3	9	18	7	10	14	0	0	64
WSW	0	0	1	4	7	4	7	2	3	0	0	28
W	0	0	3	1	5	3	1	2	0	0	0	15
WNW	0	1	2	1	3	4	2	3	3	0	0	19
NW	0	0	0	1	3	5	2	5	7	0	0	23
NNW	0	0	1	0	0	7	7	4	6	0	0	25
Tot	0	9	24	35	98	136	108	107	82	2	0	601
Hours of Calm .....	0											
Hours of Variable Direction .....	0											
Hours of Valid Data .....	601											
Hours of Missing Data .....	37											
Hours in Period .....	8760											

## Appendix C

### *Callaway Energy Center Offsite Dose Calculation Manual*



**Callaway**  
Energy Center

**APA-ZZ-01003**  
**OFF-SITE DOSE CALCULATION MANUAL**  
**MINOR Revision 022**

## Contents

1.	PURPOSE AND SCOPE.....	5
2.	LIQUID EFFLUENTS.....	5
2.1.	Liquid Effluent Monitors.....	5
2.1.1.	Continuous Liquid Effluent Monitors.....	7
2.2.	Calculation of Liquid Effluent Monitor Setpoints.....	7
2.2.1.	CALCULATION OF THE ECV SUM.....	7
2.2.2.	CALCULATION OF THE MAXIMUM PERMISSIBLE LIQUID EFFLUENT DISCHARGE FLOW RATE.....	8
2.2.3.	CALCULATION OF LIQUID EFFLUENT MONITOR SETPOINT.....	9
2.3.	Liquid Effluent Concentration Measurements.....	10
2.4.	Dose due to Liquid Effluents.....	10
2.4.1.	THE MAXIMUM EXPOSED INDIVIDUAL.....	10
2.4.2.	CALCULATION OF DOSE FROM LIQUID EFFLUENTS.....	11
2.4.3.	SUMMARY, CALCULATION OF DOSE DUE TO LIQUID EFFLUENTS.....	13
2.5.	Liquid Radwaste Treatment System.....	13
2.6.	Liquid Effluents Dose Factors.....	13
3.	GASEOUS EFFLUENTS.....	13
3.1.	Gaseous Effluent Monitors.....	13
3.1.1.	CONTINUOUS RELEASE GASEOUS EFFLUENT MONITORS.....	14
3.1.2.	BATCH RELEASE GASEOUS EFFLUENT MONITORS.....	15
3.2.	Gaseous Effluent Monitor Setpoints.....	16
3.2.1.	TOTAL BODY DOSE RATE SETPOINT CALCULATIONS.....	16
3.2.2.	SKIN DOSE RATE SETPOINT CALCULATION.....	17
3.3.	Calculation of Dose and Dose Rate from Gaseous Effluents.....	18
3.3.1.	DOSE RATE FROM GASEOUS EFFLUENTS.....	18
3.3.2.	DOSE DUE TO GASEOUS EFFLUENTS.....	20
3.4.	Gaseous Radwaste Treatment System.....	22
3.5.	Gaseous Effluents Dose Factors.....	23
4.	DOSE AND DOSE COMMITMENT FROM URANIUM FUEL CYCLE SOURCES.....	23

4.1. Calculation of Dose and Dose Commitment from Uranium Fuel Cycle Sources .....23

4.1.1. IDENTIFICATION OF THE MEMBER OF THE PUBLIC.....24

4.1.2. TOTAL DOSE TO THE NEAREST RESIDENT .....24

4.1.3. TOTAL DOSE TO THE CRITICAL RECEPTOR WITHIN THE SITE BOUNDARY.....24

5. RADIOLOGICAL ENVIRONMENTAL MONITORING .....27

5.1. Description Of The Radiological Environmental Monitoring Program .....27

5.2. Performance Testing Of Environmental Thermoluminescence Dosimeters .....27

6. ANNUAL AVERAGE ATMOSPHERIC DISPERSION PARAMETERS .....27

6.1. Annual Atmospheric Dispersion Parameters.....27

6.1.1. Determination of Dispersion Estimates for Special Receptor Locations .....28

6.1.2. Atmospheric Dispersion Parameters for Farming Areas within the Site Boundary.....28

6.2. Annual Meteorological Data Processing.....28

7. REPORTING REQUIREMENTS .....29

7.1. Annual Radiological Environmental Operating Report .....29

7.2. Annual Radioactive Effluent Release Report .....29

8. RADIOACTIVE EFFLUENT CONTROLS (REC) .....29

9. ADMINISTRATIVE CONTROLS .....29

9.1. Major Changes to Liquid and Gaseous Radwaste Treatment Systems .....29

9.2. Changes to the Offsite Dose Calculation Manual (ODCM) .....30

10. BIBLIOGRAPHY .....30

Table 1: Ingestion Dose Commitment Values ( $A_{IT}$ ) for Adult Age Group .....35

Table 2: Bioaccumulation Factor ( $Bf_i$ ) .....38

Table 3: Dose Factor for Exposure to a Semi- Infinite Cloud of Noble Gases .....39

Table 4: Ground Plane Pathway Dose Factors ( $R_i$ ) .....40

Table 5: Child Inhalation Pathway Dose Factors ( $R_i$ ) .....41

Table 6: Child Grass- Cow – Milk Pathway Dose Factors ( $R_i$ ) .....43

Table 7: Child Grass- Goat – Milk Pathway Dose Factors ( $R_i$ ) .....45

Table 8: Child Meat Pathway Dose Factors ( $R_i$ ).....47

Table 9: Child Vegetation Pathway Dose Factors ( $R_i$ ).....49

Table 10: Highest Annual Average Atmospheric Dispersion Parameters.....51

Table 11: Application of Atmospheric Dispersion Parameters for Release Permits .....52

Table 12: Application of Atmospheric Dispersion Parameters Annual Radioactive  
Effluent Release Report .....53

Table 13: Meteorological Data Selection Hierarchy.....54

Appendix A: Methodology for Calculating Dose from  $^{14}\text{C}$  in Gaseous  
Effluents .....55

Appendix B: Record of Revisions.....68

## OFF-SITE DOSE CALCULATION MANUAL

### 1. Purpose and Scope

The Offsite Dose Calculation Manual (ODCM) describes the methodology and parameters used in the calculation of off-site doses resulting from radioactive gaseous and liquid effluents, in the calculation of gaseous and liquid effluent monitoring Alarm/Trip Setpoints, and in the conduct of the Radiological Environmental Monitoring Program. The ODCM also contains the Radioactive Effluent Controls and Radiological Environmental Monitoring Program required by T/S 5.5.4 and FSAR-SP Chapter 16.11.4, and descriptions of the information that should be included in the Annual Radiological Environmental Operating and Annual Effluent Release Reports required by T/S 5.6.2 and T/S 5.6.3

Compliance with the Radiological Effluent Controls limits demonstrates compliance with the limits of 10 CFR 20.1301.<sup>1,2,3</sup>

The ODCM consists of two parts: FSAR-SP Chapter 16.11 which contains the Radiological Effluent Controls (RECs), and APA-ZZ-01003, which contains the methodology and parameters used to implement the RECs.

### 2. Liquid Effluents

#### 2.1. Liquid Effluent Monitors

Gross radioactivity monitors which provide for automatic termination of liquid effluent releases are present on the liquid effluent lines. Flow rate measurement devices are present on the liquid effluent lines and the discharge line (cooling tower blowdown). Setpoints, precautions, and limitations applicable to the operation of the Callaway Plant liquid effluent monitors are provided in the appropriate Plant Procedures. Setpoint values are calculated to assure that alarm and trip actions occur prior to exceeding ten times the Effluent Concentration Values (ECV) limits in 10 CFR Part 20 at the release point to the Unrestricted Area. The calculated alarm and trip action setpoints for the liquid effluent line monitors and flow measuring devices must satisfy the following equation:

$$\frac{cf}{F+f} \leq C$$

Eq. 1

Where:

---

<sup>1</sup> Statements of Consideration, Federal Register, Vol. 56, No. 98, Tuesday, May 21, 1991, Subpart D, page 23374

<sup>2</sup> 10 CFR 50.36 a (b)

<sup>3</sup> Letter, F. J. Congel to J. F. Schmidt, dated April 23, 1991

**C** is the liquid effluent concentration value (ECV) implementing REC 16.11.1.1 for the site in  $\mu\text{Ci/ml}$ ;

**c** is the setpoint, in ( $\mu\text{Ci/ml}$ ), of the radioactivity monitor measuring the radioactivity concentration in the effluent line prior to dilution and subsequent release. The setpoint, which is inversely related to the volumetric flow of the effluent line and directly related to the volumetric flow of the dilution stream plus the effluent stream, represents a value, which, if exceeded, would result in concentrations exceeding ten times the values of 10 CFR Part 20 Appendix B, Table 2, Column 2, in the Unrestricted Area;

**f** is the undiluted waste flow rate as measured at the radiation monitor location, in volume per unit time, but in the same units as **F**, below; and

**F** is the dilution water flow rate setpoint as measured prior to the release point, in volume per unit time. If **F** is large compared to **f**, then  $F + f \cong F$ .<sup>4</sup>

If no dilution is provided then  $c \leq C$ .

The radioactive liquid waste stream is diluted by the plant discharge line prior to entry into the Missouri River. Normally, the dilution flow is obtained from the cooling tower blowdown, but should this become unavailable, the plant water treatment facility supplies the necessary dilution flow via a bypass line.

The limiting concentration which corresponds to the liquid radwaste effluent monitor setpoint is to be calculated using methodology from the expression above. Thus, the expression for determining the setpoint of the liquid radwaste effluent line monitor becomes:

$$c \leq \frac{C(F + f)}{f} (\mu\text{Ci} / \text{ml})$$

Eq. 2

The alarm/trip setpoint calculations are based on the minimum dilution flow rate (corresponding to the dilution flow rate setpoint), the maximum effluent stream flow rate, and the actual isotopic analysis. Due to the possibility of a simultaneous release from more than one release pathway, a portion of the total site release limit is allocated to each pathway. The determination and usage of the allocation factor is discussed in Section 2.2. In the event the alarm/trip setpoint is reached, an evaluation will be performed using actual dilution and effluent flow values and actual isotopic analysis to ensure that REC 16.11.1.1 limits were not exceeded.

---

<sup>4</sup> NUREG-0133, pages AA-1 thru AA-3

**2.1.1. Continuous Liquid Effluent Monitors**

The radiation detection monitor associated with continuous liquid effluent releases is:<sup>5,6</sup>

<u>Monitor I.D.</u>	<u>Description</u>
BM-RE-52	Steam Generator Blowdown Discharge Monitor

The Steam Generator Blowdown discharge is not considered to be radioactive unless radioactivity has been detected by the associated effluent radiation monitor or by laboratory analysis. The sampling frequency, minimum analysis frequency, and type of analysis performed are Per FSAR-SP Table 16.11-1.

**2.1.2. Radioactive Liquid Batch Release Effluent Monitors**

The radiation monitor associated with the liquid effluent batch release system is:<sup>7</sup>

<u>Monitor I.D.</u>	<u>Description</u>
HB-RE-18	Liquid Radwaste Discharge Monitor

This effluent stream is normally considered to be radioactive. The sampling frequency, minimum analysis frequency, and the type of analysis performed are per FSAR-SP Table 16.11-1.

**2.2. Calculation of Liquid Effluent Monitor Setpoints**

The dependence of the setpoint, **c**, on the radionuclide distribution, yields, calibration, and monitor parameters, requires that several variables be considered in setpoint calculations.<sup>8</sup>

**2.2.1. Calculation of the ECV Sum**

The isotopic concentration of the release(s) being considered must be determined. This is obtained from the analyses required per FSAR-SP Table 16.11-1, and is used to calculate an ECV sum (ECVSUM):

$$ECVSUM = \left( \sum_{i = g, a, s, t, f} (C_i) / (ECV_i) \right)$$

Eq. 3

Where:

**C<sub>g</sub>** is the concentration of each measured gamma emitting nuclide observed by gamma-ray spectroscopy of the waste sample;

---

<sup>5</sup> FSAR-SP, Section 11.5.2.2.3.1

<sup>6</sup> FSAR-SP, Section 11.5.2.2.3.4

<sup>7</sup> FSAR-SP, Section 11.5.2.2.3.2

<sup>8</sup> NUREG-0133, pages AA-1 thru AA-3

$C_a$  is the concentration of  $^{237}\text{Np}$ ,  $^{238}\text{Pu}$ ,  $^{239/240}\text{Pu}$ ,  $^{241}\text{Pu}$ ,  $^{241}\text{Am}$ ,  $^{242}\text{Cm}$ , &  $^{243/244}\text{Cm}$ , in the quarterly composite sample based on previous composite sample analyses;

$C_s$  is the measured concentrations of  $^{89}\text{Sr}$  and  $^{90}\text{Sr}$  as determined by analysis of the quarterly composite sample based on previous composite sample analyses;

$C_t$  is the measured concentration of  $^3\text{H}$  in the waste sample; and

$C_f$  is the measured concentration of  $^{55}\text{Fe}$  &  $^{63}\text{Ni}$  as determined by analysis of the quarterly composite sample based on previous composite sample analyses.

$ECV_g$ ,  $ECV_s$ ,  $ECV_a$ ,  $ECV_f$ , and  $ECV_t$  are ten times the limiting concentrations of the appropriate radionuclides from 10 CFR 20, Appendix B, Table 2, Column 2. For dissolved or entrained noble gases, the concentration shall be limited to  $2 \times 10^{-4}$   $\mu\text{Ci/ml}$  total activity.

For the case  $ECV_{SUM} \leq 1$ , the monitor tank effluent concentration meets the limits of REC 16.11.1.1 without dilution and the effluent may be released at any desired flow rate. If  $ECV_{SUM} > 1$  then dilution is required to ensure compliance with the concentration limits of REC 16.11.1.1. If simultaneous releases are occurring or are anticipated, an allocation fraction,  $N$ , must be applied so that available dilution flow may be apportioned among simultaneous discharge pathways. The value of  $N$  may be any value between 0 and 1 for a particular discharge point, provided that the sum of the allocation fractions for all discharge points must be  $\leq 1$ .

## 2.2.2. Calculation of the Maximum Permissible Liquid Effluent Discharge Flow Rate

The maximum permissible liquid effluent discharge flow rate is calculated by:

$$f_{max} \leq (F + f_p) \cdot SF \cdot N \div (ECV_{SUM})$$

Eq. 4

Where:

$f_{max}$  is the maximum permissible liquid effluent discharge flow rate, (in gallons/minute);

$f_p$  is the expected undiluted liquid effluent flow rate, in gpm;

$N$  is the allocation fraction which apportions dilution flow among simultaneous discharge pathways (see discussion above); and

$SF$  is the safety factor; an administrative factor used to compensate for statistical fluctuations and errors of measurements. This factor also provides a margin of safety in the calculation of the maximum liquid effluent discharge flow rate ( $f_{max}$ ). The value of  $SF$  should be  $\leq 1$ .

$F$  and  $ECV_{SUM}$  are previously defined.

The dilution water supply is furnished with a flow monitor which isolates the liquid effluent discharge if the dilution flow rate falls below its setpoint value.

In the event that  $f_{max}$  is less than  $f_p$ , then the value of  $f_{max}$  is substituted into the equation for  $f_p$ , and a new  $f_{max}$  value is calculated. This substitution is performed for three iterations in order to calculate the correct value of  $f_{max}$ .

### 2.2.3. Calculation of Liquid Effluent Monitor Setpoint

The liquid effluent monitors are NaI(Tl) based systems and respond primarily to gamma radiation. Accordingly, their setpoint is based on the total concentration of gamma emitting nuclides in the effluent:

$$c = 0.95 \cdot \left[ bkg + \left[ \left( \sum C_g \right) \div SF \right] \right]$$

Eq. 5

Where:

**c** is the monitor setpoint as previously defined, in  $\mu\text{Ci/ml}$ ;

**bkg** is the monitor background prior to discharge, in  $\mu\text{Ci/ml}$ , adjusted for monitor response; and

**0.95** is a factor for conservatism to ensure the monitor trips prior to exceeding the limits of REC 16.11.1.1

$\sum C_g$  and **SF** are as previously defined.

The monitor's background is controlled at an appropriate limit to ensure adequate sensitivity. Utilizing the methodology of ANSI N13.10-1974, the background must be maintained at a value of less than or equal to  $9 \times 10^{-6}$   $\mu\text{Ci/ml}$  (relative to  $^{137}\text{Cs}$ ) in order to detect a change of  $4 \times 10^{-7}$   $\mu\text{Ci/ml}$  of  $^{137}\text{Cs}$ .<sup>9</sup>

In the event that there is no detectable gamma activity in the effluent or if the value of  $\left\{ \left( \sum C_g \right) \div SF \right\}$  is less than the background of the monitor, then the monitor setpoint will be set at twice the current background of the monitor.

As previously stated, the monitor's response is dependent on the gamma emitting radionuclide distribution of the effluent. Accordingly, a database conversion factor is calculated for each release based upon the results of the gamma spectrometric analysis of the effluent sample and the measured response of the monitor to National Institute of Standards and Technology (NIST) traceable calibration sources:

$$DBCF_c = \left( \sum (C_g) \right) \div (CMR) \times (ECF)$$

Eq. 6

---

<sup>9</sup> HPCI 96-005, "Calculation of Maximum Background Value for HB-RE-18"

**DBCF<sub>c</sub>** is the monitor data base conversion factor which converts count rate into concentration ( $\mu\text{Ci/ml}$ );

**CMR** is the calculated response of the radiation monitor to the liquid effluent;

**ECF** is the conversion factor for  $^{137}\text{Cs}$ , which converts count rate into concentration ( $\mu\text{Ci/ml}$ ).

**C<sub>g</sub>** is as previously defined.

The new value of the DBCF<sub>c</sub> is calculated and entered into the monitor data base prior to each discharge. A more complete discussion of the derivation and calculation of the CMR is given in HPCI 87-10.

### 2.3. Liquid Effluent Concentration Measurements

Liquid batch releases are discharged as a discrete volume and each release is authorized based upon the sample analysis and the dilution flow rate existing in the discharge line at the time of release. To assure representative sampling, each liquid monitor tank is isolated and thoroughly mixed by recirculation of tank contents prior to sample collection. The methods for mixing, sampling, and analyzing each batch are outlined in applicable plant procedures. The allowable release rate limit is calculated for each batch based upon the pre-release analysis, dilution flow-rate, and other procedural conditions, prior to authorization for release. The liquid effluent discharge is monitored prior to entering the dilution discharge line and will automatically be terminated if the pre-selected alarm/trip setpoint is exceeded. Concentrations are determined primarily from the gamma isotopic and  $^3\text{H}$  analyses of the liquid batch sample. For  $^{89}\text{Sr}$ ,  $^{90}\text{Sr}$ ,  $^{55}\text{Fe}$ ,  $^{63}\text{Ni}$ ,  $^{237}\text{Np}$ ,  $^{238}\text{Pu}$ ,  $^{239/240}\text{Pu}$ ,  $^{241}\text{Pu}$ ,  $^{241}\text{Am}$ ,  $^{242}\text{Cm}$ , &  $^{243/244}\text{Cm}$ , the measured concentrations from the previous quarterly composite analyses are used until laboratory results become available. Composite samples are collected for each batch release and analyzed in accordance with FSAR-SP Table 16.11-1. The dose from liquids discharged as continuous releases is calculated by utilizing the last measured values of samples in accordance with FSAR-SP Table 16.11-1.

### 2.4. Dose due to Liquid Effluents

#### 2.4.1. The Maximum Exposed Individual

The cumulative dose determination considers the dose contributions from the maximum exposed individual's consumption of fish and potable water, as appropriate. Normally, the adult is considered to be the maximum exposed individual.<sup>10</sup>

The Callaway Plant's liquid effluents are discharged to the Missouri River. As there are no potable water intakes within 10 miles of the discharge point,<sup>11,12</sup> this pathway does not require routine evaluation. Therefore, the dose contribution from fish consumption is expected to account for more than 95% of the total man-rem dose from discharges to the Missouri River.

---

<sup>10</sup> NUREG-0133, Section 4.3

<sup>11</sup> Environmental Report, OLS, Table 2.1-19

<sup>12</sup> FSAR-SA Section 11.2.3.3.4

Dose from recreational activities is expected to contribute the additional 5%, which is considered to be negligible.<sup>13</sup>

#### 2.4.2. Calculation of Dose from Liquid Effluents

The dose contributions for the total time period  $\sum_{l=1}^m \Delta t_l$  are calculated at least once each 31 days and a cumulative summation of the total body and individual organ doses is maintained for each calendar quarter. Dose is calculated for all radionuclides identified in liquid effluents released to Unrestricted Areas using the following expression:<sup>14</sup>

$$D_{\tau} = \sum_i \left[ A_{i\tau} \sum_{l=1}^m \Delta t_l C_{il} F_l \right]$$

Eq. 7

Where:

$D_{\tau}$  is the cumulative dose commitment to the total body or any organ,  $\tau$ , from the liquid effluents for the total period  $\sum_{l=1}^m \Delta t_l$  in mrem.

$\Delta t_l$  is the length of the  $l^{th}$  time period over which  $C_{i,l}$  and  $F_l$  are averaged for all liquid releases, in hours.  $\Delta t_l$  corresponds to the actual duration of the release(s).

$C_{i,l}$  is the average measured concentration of radionuclide,  $i$ , in undiluted liquid effluent during the time period  $\Delta t_l$  from any liquid release, in ( $\mu\text{Ci/ml}$ ).

$A_{i\tau}$  is the site- related ingestion dose commitment factor to the total body or any organ  $\tau$  for each identified principal alpha, gamma and beta emitter listed in FSAR-SP Table 16.11-1, in (mrem/hr) per ( $\mu\text{Ci/ml}$ ).

$F_l$  is the near field average dilution factor for  $C_{i,l}$  during any liquid effluent release:

$$F_l = \frac{f_{max}}{(F + f_{max}) \cdot 89.77}$$

Eq. 8

Where:

$F_{max}$  is the maximum undiluted effluent flow rate during the release;

$F$  is the average dilution flow; and

<sup>13</sup> FSAR-SA, Section 11.2.3.4.3

<sup>14</sup> NUREG-0133, Section 4.3

89.77 is site specific applicable factor for the mixing effect of the discharge structure.<sup>15,16,17</sup>

The term  $C_{i,l}$  is the undiluted concentration of radioactive material in liquid waste at the common release point determined in accordance with REC 16.11.1.1, Table 16.11-1, "Radioactive Liquid Waste Sampling and Analysis Program". All dilution factors beyond the sample point(s) are included in the  $F_i$  term.

As there are currently no potable water intakes within 10 river miles of the discharge point, the drinking water pathway is not included in dose estimates to the maximally exposed individual. Should future potable water intakes be constructed within 10 river miles downstream of the discharge point, then this manual will be revised to include this pathway in dose estimates.<sup>18</sup>

The  $A_{i\tau}$  values given in Table 1 were calculated according to:<sup>19</sup>

$$A_{i\tau} = k_0 (U_w/D_w + U_F B_{Fi} + U_I B_{Ii}) DF_i$$

Eq. 9

Since there are no drinking water pathways, and CEC is a freshwater site, the terms for drinking water consumption ( $U_w/D_w$ ) and invertebrate consumption ( $U_I B_{Ii}$ ) go to zero and the equation simplifies to:

$$A_{i\tau} = k_0 U_F B_{Fi} DF_i$$

Eq. 10

Where:

$k_0$  is a constant of units conversion,  $1.14 \times 10^5 = (10^6 \text{ pCi}/\mu\text{Ci} \cdot 10^3 \text{ ml/kg} / 8760 \text{ hr/yr})$

$U_F$  is the adult fish consumption, 21 kg/yr<sup>20</sup>

$B_{Fi}$  is the bioaccumulation factor for nuclide,  $i$ , in fresh water fish, pCi/kg per pCi/L.<sup>21,22</sup>

$DF_i$  is the dose conversion factor for nuclide,  $i$ , for adults for organ,  $\tau$ , in mrem/pCi.

<sup>15</sup> NEO-54

<sup>16</sup> UOTH 83-58

<sup>17</sup> CAR 200700053- Attachments: Phase 1 final draft

<sup>18</sup> FSAR-SP, Section 11.2.3.3.4

<sup>19</sup> NUREG-0133, Section 4.3.1

<sup>20</sup> NUREG-0133, Section 4.3.1, pp. 16

<sup>21</sup> UCRL- 50564, Table 6

<sup>22</sup> NUREG/CR-4013, pp. 3.17

### 2.4.3. Summary, Calculation of Dose Due to Liquid Effluents

The dose contribution for the total time period  $\sum_{l=1}^m \Delta t_l$  is determined by calculation at least once per 31 days and a cumulative summation of the total body and organ doses is maintained for each calendar quarter. The projected dose contribution from liquid effluents for which radionuclide concentrations are determined by periodic composite and grab sample analysis may be approximated by using the last measured value. Dose contributions are determined for all radionuclides identified in liquid effluents released to Unrestricted Areas. Nuclides which are not detected in the analyses are reported as "less than" the Minimum Detectable Activity (MDA) and are not reported as being present at the Lower Limit of Detection (LLD) for that nuclide. The "less than" values are not used in the dose calculations.

### 2.5. Liquid Radwaste Treatment System

The Liquid Radwaste Treatment System is described in FSAR-SP Chapter 11.2.

The Operability of the Liquid Radwaste Treatment System ensures this system will be available for use when liquids require treatment prior to their release to the environment. Operability is demonstrated through compliance with REC 16.11.1.1. and 16.11.1.2.

Projected doses due to liquid releases to Unrestricted Areas are determined each 31 days. The prior 31 day period is used to calculate compliance. This may be modified as appropriate to account for changes in radwaste treatment which may have a significant effect on the projected doses.

### 2.6. Liquid Effluents Dose Factors

The dose conversion factors provided in Table 1 were derived from the appropriate dose conversion factors of Regulatory Guide 1.109, Table 2.2 and other sources as necessary.<sup>23,24</sup>

## 3. Gaseous Effluents

### 3.1. Gaseous Effluent Monitors

Noble gas activity monitors are present on the containment building ventilation system, plant unit ventilation system, and radwaste building ventilation system.

The alarm/trip (alarm & trip) setpoint for any gaseous effluent radiation monitor is determined based on the instantaneous noble gas total body and skin dose rate limits of REC 16.11.2.1, at the Site Boundary location with the highest annual average X/Q value.

Each gaseous monitor channel is provided with a two level system which provides sequential alarms on increasing radioactivity levels. These setpoints are designated as alert setpoints and alarm/trip setpoints.<sup>25</sup>

---

<sup>23</sup> HPCI 04-06, rev. 1

<sup>24</sup> HPCI 16-04

The radiation monitor alarm/trip setpoints for each release point are based on the radioactive noble gases in gaseous effluents. It is not considered practicable to apply instantaneous alarm/trip setpoints to integrating radiation monitors sensitive to radioiodines, radioactive materials in particulate form and radionuclides other than noble gases. The exception is GL-RE-202. The only effluent released from the Laundry Decon Facility Dryer Exhaust is in the particulate form. Conservative assumptions may be necessary in establishing setpoints to account for system variables, such as the measurement system efficiency and detection capabilities during normal, anticipated, and unusual operating conditions, variability in release flow and principal radionuclides, and the time lag between alarm/trip action and the final isolation of the radioactive effluent.<sup>26</sup> FSAR-SP Table 16.11-6 provides the instrument surveillance requirements, such as calibration, source checks, functional tests, and channel checks.

### 3.1.1. Continuous Release Gaseous Effluent Monitors

The radiation detection monitors associated with continuous gaseous effluent releases are:<sup>27,28</sup>

<u>Monitor I.D.</u>	<u>Description</u>
GT-RE-21	Unit Vent
GH-RE-10	Radwaste Building Vent
GL-RE-202	Laundry Decon Facility Dryer Exhaust Monitor

Each of the above continuously monitors gaseous radioactivity concentrations downstream of the last point of potential influent, and therefore measures effluents and not inplant concentrations.

The unit vent monitor continuously monitors the effluent from the unit vent for gaseous radioactivity. The unit vent, via ventilation exhaust systems, continuously purges various tanks and sumps normally containing low-level radioactive aerated liquids that can potentially generate airborne activity. The exhaust systems which supply air to the unit vent are from the fuel building, auxiliary building, the access control area, the containment purge, and the condenser air discharge.

The unit vent monitor provides alarm functions only, and does not terminate releases from the unit vent.

The Radwaste Building ventilation effluent monitor continuously monitors for gaseous radioactivity in the effluent duct downstream of the exhaust filter and fans. The flow path provides ventilation exhaust for all parts of the building structure and components within the building and provides a discharge path for the waste gas decay tank release line. These

---

<sup>25</sup> FSAR-SP Section 11.5.2.1.2

<sup>26</sup> NUREG- 0133, section 5.1.1

<sup>27</sup> FSAR-SP Section 11.5.2.3.3.1

<sup>28</sup> FSAR-SP Section 11.5.2.3.3.2

components represent potential sources for the release of gaseous and air particulate and iodine activities in addition to the drainage sumps, tanks, and equipment purged by the waste processing system.

This monitor will isolate the waste gas decay tank discharge line upon a high gaseous radioactivity alarm.

The Laundry Decon Facility Dryer Exhaust Monitor continuously monitors the effluent of the dryer exhaust for particulate radioactivity during operation of the dryers. This effluent point is designed to release an insignificant quantity of radioactivity. The items to be placed in the dryers are typically washed before drying removing most of the radioactive material. The dryer effluent then passes through a HEPA filter before being sampled and released.

The Laundry Decon Facility Dryer Exhaust Monitor will secure the dryers and exhaust fans and isolate the dryer effluent upon a high radioactivity alarm or for a monitor failure.

The continuous Unit Vent and Radwaste Building Vent gaseous effluent monitor setpoints are established using the methodology described in Section 3.2. Since there are two continuous gaseous effluent release points, a fraction of the total dose rate limit (DRL) will be allocated to each release point. Neglecting the batch releases, the plant Unit Vent monitor has been allocated 0.7 DRL and the Radwaste Building Vent monitor has been allocated 0.3 DRL. These allocation factors may be changed as required to support plant operational needs, but shall not be allowed to exceed unity (i.e., 1.0). Therefore, a particular monitor reaching the setpoint would not necessarily mean the dose rate limit at the Site Boundary is being exceeded; the alarm only indicates that the specific release point is contributing a greater fraction of the dose rate limit than was allocated to the associated monitor, and will necessitate an evaluation of both systems.

For a loss of all isokinetic sampling and/or all heat tracing for the Unit Vent or Radwaste Building Vent grab samplers, one hour is allowed to restore a sampler to service. If sampling cannot be restored within one hour, all batch releases and ventilation not required for the operation of the plant should be secured. The best available sampling should be maintained during this period and normal sampling returned to service as soon as possible.

### 3.1.2. Batch Release Gaseous Effluent Monitors

The radiation monitors associated with batch release gaseous effluents are:<sup>29,30,31</sup>

<u>Monitor I.D.</u>	<u>Description</u>
GT-RE-22, GT-RE-33	Containment Purge System
GH-RE-10	Radwaste Building Vent

---

<sup>29</sup> FSAR-SP Section 11.5.2.3.3.2

<sup>30</sup> FSAR-SP Section 11.5.2.3.2.3

<sup>31</sup> FSAR-SP Section 11.5.2.3.2.2

The Containment Purge System continuously monitors the containment purge exhaust duct during purge operations for gaseous radioactivity. The primary purpose of these monitors is to isolate the containment purge system on high gaseous activity via the ESFAS.

The sample points are located outside the containment between the containment isolation dampers and the containment purge filter adsorber unit.

The Radwaste Building Vent monitor was previously described.

A pre-release isotopic analysis is performed for each batch release to determine the identity and quantity of the principal radionuclides. The alarm/trip setpoint(s) is adjusted accordingly to ensure that the limits of REC 16.11.2.1 are not exceeded.

### 3.2. Gaseous Effluent Monitor Setpoints

The alarm/trip setpoint for the Unit Vent and Radwaste Building Vent gaseous effluent monitors is determined based on the more restrictive of the total body dose rate (Eq. 11) and skin dose rate (Eq. 13) as calculated for the Site Boundary. In the event there is no noble gas activity in the sample, then the high alarm setpoint is set to the default value of 2.2E-02  $\mu\text{Ci/cc}$ . This corresponds to 50% of the 500 mrem/yr limit of REC 16.11.2.1.<sup>32</sup> Each monitor is allocated only 50% of the limit such that the sum total of the two monitors cannot exceed the limit.

The alarm/ trip setpoint for the Laundry Decon Facility Exhaust Monitor is set to less than or equal to 2,000 cpm above equilibrium background. The maximum allowed background is 2,000 cpm as discussed in HPCI 99-05.

#### 3.2.1. Total Body Dose Rate Setpoint Calculations

To ensure that the limits of REC 16.11.2.1 are met, the alarm/trip setpoint based on the total body dose rate is calculated according to:

$$S_{tb} \leq D_{tb} R_{tb} F_s F_a$$

Eq. 11

Where:

$S_{tb}$  is the alarm/trip setpoint based on the total body dose rate ( $\mu\text{Ci/cc}$ );

$D_{tb}$  is the REC 16.11.2.1 dose rate limit of 500 mrem/yr, conservatively interpreted as a continuous release over a one year period;

$F_s$  is the safety factor; a conservative factor used to compensate for statistical fluctuations and errors of measurement. (For example,  $F_s = 0.5$  corresponds to a 100% variation.) Default value is  $F_s = 0.1$ .

---

<sup>32</sup> HPCI 8403, page 9

$F_a$  is the allocation factor which will modify the required dilution factor such that simultaneous gaseous releases may be made without exceeding the limits of REC 16.11.2.1.

$R_{tb}$  is a factor used to convert dose rate to the effluent concentration as measured by the effluent monitor, in ( $\mu\text{Ci}/\text{cc}$ ) per ( $\text{mrem}/\text{yr}$ ) to the total body, determined according to:

$$R_{tb} = C \div \left[ \left( \overline{X/Q} \right) \sum_i (K_i Q_i) \right]$$

Eq. 12

Where:

$C$  is the reading of a noble gas monitor corresponding to the sample radionuclide concentrations for the release. Concentrations are determined in accordance with FSAR-SP Table 16.11-4. The mixture of radionuclides determined via grab sampling of the effluent stream or source is correlated to a calibration factor to determine monitor response. The monitor response is based on concentration, not release rate, and is in units of ( $\mu\text{Ci}/\text{cc}$ );

$\overline{X/Q}$  is the highest calculated annual average relative concentration for any area at or beyond the Site Boundary in ( $\text{sec}/\text{m}^3$ ) (Table 10, Table 11, and Table 12);

$K_i$  is the total body dose factor due to gamma emissions for each identified noble gas radionuclide, in ( $\text{mrem}/\text{yr}$ ) per ( $\mu\text{Ci}/\text{m}^3$ ) (Table 3); and

$Q_i$  is the rate of release of noble gas radionuclide,  $i$ , in ( $\mu\text{Ci}/\text{sec}$ ).

$Q_i$  is calculated as the product of the ventilation path flow rate and the measured activity of the effluent stream as determined by sampling.

### 3.2.2. Skin Dose Rate Setpoint Calculation

To ensure that the limits of REC 16.11.2.1 are met, the alarm/trip setpoint based on the skin dose rate is calculated according to:

$$S_s \leq D_s R_s F_s F_a$$

Eq. 13

Where:

$F_s$  and  $F_a$  are as previously defined;

$S_s$  is the alarm/trip setpoint based on the skin dose rate;

$D_s$  is the REC 16.11.2.1 dose rate limit of 3000  $\text{mrem}/\text{yr}$ , conservatively interpreted as a continuous release over a one year period; and

$R_s$  is the factor used to convert dose rate to the effluent concentration as measured by the effluent monitor, in ( $\mu\text{Ci}/\text{cc}$ ) per ( $\text{mrem}/\text{yr}$ ) to the skin, determined according to:

$$R_s = C \div \left[ \left( \overline{X/Q} \right) \sum_i (L_i + 1.1M_i) Q_i \right]$$

Eq. 14

Where:

$L_i$  is the skin dose factor due to beta emissions for each identified noble gas radionuclide, in (mrem/yr) per ( $\mu\text{Ci}/\text{m}^3$ );

1.1 is a factor of units conversion; 1 mrad air dose = 1.1 mrem skin dose; and

$M_i$  is the air dose factor due to gamma emissions for each identified noble gas radionuclide, in (mrad/yr) per ( $\mu\text{Ci}/\text{m}^3$ ).

$C$ ,  $\overline{X/Q}$ , and  $Q_i$  are previously defined.

### 3.3. Calculation of Dose and Dose Rate from Gaseous Effluents

#### 3.3.1. Dose Rate from Gaseous Effluents

The following methodology is applicable to the location (Site Boundary or beyond) characterized by the values of the parameter  $X/Q$  which results in the maximum total body or skin dose rate. In the event that the analysis indicates a different location for the total body and skin dose limitations, the location selected for consideration is that which minimizes the allowable release values.<sup>33</sup>

The factors  $K_i$ ,  $L_i$ , and  $M_i$  relate the radionuclide airborne concentrations to various dose rates, assuming a semi-infinite cloud model.

##### 3.3.1.1. Dose Rate from Noble Gases

The release rate limit for noble gases is determined according to the following general relationships.<sup>34</sup>

$$D_{tb} = \sum_i \left[ K_i Q_i \left( \overline{X/Q} \right) \right] \leq 500 \text{ mrem/yr}$$

Eq. 15

$$D_s = \sum_i \left[ (L_i + 1.1 M_i) \left( \overline{X/Q} \right) Q_i \right] \leq 3000 \text{ mrem/yr}$$

Eq. 16

Where:

---

<sup>33</sup> NUREG-0133, Section 5.1.2

<sup>34</sup> NUREG-0133, Section 5.1.2

$Q_i$  is the release rate of noble gas radionuclides,  $i$ , in gaseous effluents, from all vent releases in ( $\mu\text{Ci}/\text{sec}$ ); and

1.1 is a factor of units conversion factor; 1 mrad air dose = 1.1 mrem skin dose.

$L_i$ ,  $M_i$ ,  $K_i$ ,  $(\overline{X/Q})$ ,  $D_{tb}$  and  $D_s$  are as previously identified.

### 3.3.1.2. Dose Rate from Radionuclides Other than Noble Gases

The release rate limit for  $^{131}\text{I}$  and  $^{133}\text{I}$ , for  $^3\text{H}$ , and for all radioactive materials in particulate form with half-lives greater than 8 days is determined according to:<sup>35</sup>

$$D_o = \sum_i R_i \left[ \overline{X/Q} \right] Q_i \leq 1500 \text{ mrem/yr}$$

Eq. 17

Where:

$D_o$  is the dose rate to any critical organ, in (mrem/yr);

$R_i$  is the dose parameter for radionuclides other than noble gases for the inhalation pathway for the child, based on the critical organ, in (mrem/yr) per ( $\mu\text{Ci}/\text{m}^3$ ); and

$Q_i$  is the release rate of radionuclides other than noble gases,  $i$ , in gaseous effluents, from all vent releases in ( $\mu\text{Ci}/\text{sec}$ ).

$(\overline{X/Q})$  is as previously defined.

The dose parameter ( $R_i$ ) includes the internal dosimetry of radionuclide,  $i$ , and the receptor's breathing rate, which are functions of the receptor's age. The child age group has been selected as the limiting age group. All radiodines are assumed to be released in elemental form.<sup>36</sup>

$R_i$  values were calculated according to:<sup>37</sup>

$$R_i = K' (BR) DFA_i$$

Eq. 18

Where:

$K'$  is a factor of units conversion factor:  $1 \times 10^6$  pCi/ $\mu\text{Ci}$ ;

$BR$  is the breathing rate from Regulatory Guide 1.109, Table E-5 ( $\text{m}^3/\text{yr}$ );

<sup>35</sup> NUREG-0133, Section 5.2.1

<sup>36</sup> NUREG-0133, Section 5.2.1

<sup>37</sup> NUREG-0133, Section 5.2.1.1

**DFA<sub>i</sub>** is the maximum organ inhalation dose factor for the *i*<sup>th</sup> radionuclide, in (mrem/pCi). The total body is considered as an organ in the selection of DFA<sub>i</sub>.<sup>38,39</sup>

The results of periodic tritium, iodine and particulate samples of the Unit Vent and Radwaste Vent are used to verify the dose rate limit was not exceeded for the period during which the samples or composite samples were obtained.

### 3.3.2. Dose Due to Gaseous Effluents

#### 3.3.2.1. Air Dose Due to Noble Gases

The air dose at the Site Boundary due to noble gases is calculated according to the following methodology:<sup>40</sup>

During any calendar quarter, for gamma radiation:

$$D_g = 3.17E-08 \sum_i \left[ M_i \left( \overline{X/Q} \right) Q_i \right] \leq 5 \text{ mrad}$$

Eq. 19

During any calendar quarter, for beta radiation:

$$D_b = 3.17E-08 \sum_i \left[ N_i \left( \overline{X/Q} \right) Q_i \right] \leq 10 \text{ mrad}$$

Eq. 20

During any calendar year, for gamma radiation:

$$D_g = 3.17E-08 \sum_i \left[ M_i \left( \overline{X/Q} \right) Q_i \right] \leq 10 \text{ mrad}$$

Eq. 21

During any calendar year, for beta radiation:

$$D_b = 3.17E-08 \sum_i \left[ N_i \left( \overline{X/Q} \right) Q_i \right] \leq 20 \text{ mrad}$$

Eq. 22

Where:

**D<sub>g</sub>** is the air dose in mrad, from gamma radiation due to noble gases released in gaseous effluent;

**D<sub>b</sub>** is the air dose in mrad, from beta radiation due to noble gases released in gaseous effluents;

<sup>38</sup> Regulatory Guide 1.109, Appendix E, Table E-9

<sup>39</sup> ZZ-48

<sup>40</sup> NUREG-0133, Section 5.3.1

$N_i$  is the air dose factor due to beta emissions for each identified noble gas radionuclide,  $i$ , in (mrad/yr) per ( $\mu\text{Ci}/\text{m}^3$ );

$Q_i$  is the releases of noble gas radionuclides,  $i$ , in gaseous effluents, for all gaseous releases in ( $\mu\text{Ci}$ ). Releases are cumulative over the calendar quarter or year as appropriate.  $Q_i$  is calculated as the product of the ventilation flow rate and the measured activity of the effluent stream as determined by sampling; and

$3.17 \times 10^{-8}$  is the inverse of the number of seconds per year.

$\overline{X/Q}$  &  $M_i$  are as previously defined.

### 3.3.2.2. Dose Due to Radionuclides Other than Noble Gases

The dose to a Member of the Public from  $^{131}\text{I}$  and  $^{133}\text{I}$ , for  $^3\text{H}$ , and all radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents released to areas at and beyond the Site Boundary, is calculated according to the following expressions:

During any calendar quarter:

$$\sum_j D_{i,j} \leq 7.5 \text{ mrem}$$

Eq. 23

During any calendar year:

$$\sum_j D_{i,j} \leq 15 \text{ mrem}$$

Eq. 24

For each pathway,  $j$ , (i.e., for inhalation, ground plane, meat, cow- milk, goat- milk, and vegetation)  $D_{i,j}$  is calculated according to the expression:

$$D_{i,j} = 3.17E-8 \sum_i R_{i,j} [W_j Q_i]$$

Eq. 25

Where:

$D_{i,j}$  is the dose in mrem, to a Member of the Public from radionuclides other than noble gases, from pathway  $j$ , received by organ  $I$  (including total body);

$R_{i,j}$  is the dose factor for each identified radionuclide,  $i$ , in  $\text{m}^2$  (mrem/yr) per ( $\mu\text{Ci}/\text{sec}$ ) or (mrem/yr) per ( $\mu\text{Ci}/\text{m}^3$ ) as appropriate, for the pathway  $j$ , and exposed organ  $I$ , appropriate to the age group of the critical Member of the Public receptor;

$W_j$  is the  $\overline{X/Q}$  for the inhalation and tritium pathways, in  $\text{sec}/\text{m}^3$  and is the  $\overline{D/Q}$  for the food and ground plane pathways, in  $\text{meters}^{-2}$ .

$\overline{D/Q}$  is the average relative deposition of the effluent at or beyond the Site Boundary, considering depletion of the plume during transport;

$Q_i$  is the release of radioiodines, radioactive materials in particulate form, and radionuclides other than noble gases,  $i$ , in gaseous effluents, for all gaseous releases in  $\mu\text{Ci}$ . Releases are cumulative over the calendar quarter or year as appropriate.  $Q_i$  is calculated as the product of ventilation flow rate and the measured activity of the effluent stream as determined by sampling; and

$3.17 \times 10^{-8}$  is the inverse of the number of seconds per year.

$\overline{X/Q}$  is as previously defined. Refer to Table 10, Table 11, and Table 12 for applicability;

Although the annual average relative concentration  $\overline{X/Q}$  and the average relative deposition rate  $\overline{D/Q}$  are generally considered to be at the approximate receptor location in lieu of the Site Boundary for these calculations, it is acceptable to consider the ingestion, inhalation, and ground plane pathways to coexist at the location of the nearest residence with the highest value of  $\overline{X/Q}$ .<sup>41</sup> The Total Body dose from ground plane deposition is added to the dose for each individual organ.<sup>42</sup>

### 3.4. Gaseous Radwaste Treatment System

The gaseous radwaste treatment system and the ventilation exhaust system are available for use whenever gaseous effluents require treatment prior to being released to the environment. The gaseous radwaste treatment system is designed to allow for the retention of all gaseous fission products to be discharged from the reactor coolant system. The retention system consists of eight (8) waste gas decay tanks. Normally, waste gases will be retained for at least 60 days prior to discharge. When practicable, waste gas decay tanks are discharged outside the growing season or at night such that  $^{14}\text{C}$  released from the waste gas system will not be incorporated into the ingestion pathways and will result in a lower dose to the Member of the Public. For this purpose, the growing season is defined as April 1 through November 1.<sup>43</sup> These systems will provide reasonable assurance that the releases of radioactive materials in gaseous effluents will be kept ALARA.

The Operability of the gaseous radwaste treatment system ensures this system will be available for use when gases require treatment prior to their release to the environment. Operability is demonstrated through compliance with REC 16.11.2.1, 16.11.2.2, and 16.11.2.3.

Projected doses (gamma air, beta air, and organ dose) due to gaseous effluents at or beyond the Site Boundary are determined each 31 days. The prior 31 day period is used to calculate

---

<sup>41</sup> NUREG-0133, Section 5.3.1

<sup>42</sup> Regulatory Guide 1.109, Appendix C, Section 1

<sup>43</sup> Hammer, Gregory, R., "Climate of Missouri", monograph available from the National Climatic Data Center (NCDC) of the National Oceanic and Atmospheric Administration (NOAA), January, 2006.

compliance. This may be modified as appropriate to account for changes in radwaste treatment which may have a significant effect on the projected doses.

### **3.5. Gaseous Effluents Dose Factors**

The dose conversion factors were derived from the appropriate dose conversion factors in Regulatory Guide 1.109 and other sources as necessary.<sup>44,45</sup> Particulate nuclides with a half-life of less than 8 days are not considered.<sup>46</sup>  $^{90}\text{Y}$ ,  $^{140}\text{La}$ , and  $^{144}\text{Pr}$  are included because the parent half-life is greater than 8 days, and equilibrium is assumed.

## **4. Dose and Dose Commitment from Uranium Fuel Cycle Sources**

### **4.1. Calculation of Dose and Dose Commitment from Uranium Fuel Cycle Sources**

The annual dose or dose commitment to a Member of the Public for Uranium Fuel Cycle Sources is determined as:

- Dose to the total body and internal organs due to gamma ray exposure from submersion in a cloud of radioactive noble gases, ground plane exposure, and direct radiation from the Unit, onsite storage of low-level radioactive waste, and outside storage tanks;
- Dose to skin due to beta radiation from submersion in a cloud of radioactive noble gases, and ground plane exposure;
- Thyroid dose due to inhalation and ingestion of radioiodines; and
- Organ dose due to inhalation and ingestion of radioactive material.

It is assumed that total body dose from sources of gamma radiation irradiates internal body organs at the same numerical rate.<sup>47</sup>

The dose from gaseous effluents is considered to be the summation of the dose at the individual's residence and the dose to the individual from activities within the Site Boundary.

Since the doses via liquid releases are very conservatively evaluated, there is reasonable assurance that no real individual will receive a significant dose from radioactive liquid release pathways. Therefore, only doses to individuals via airborne pathways and doses resulting from direct radiation are considered in determining compliance to 40 CFR 190.<sup>48</sup>

There are no other Uranium Fuel Cycle Sources within 8 km of the Callaway Plant.

---

<sup>44</sup> ZZ-78

<sup>45</sup> ZZ-250

<sup>46</sup> Inspection Report 50-483/92002 (DRSS)

<sup>47</sup> NUREG-0543, Section III, page 8

<sup>48</sup> NUREG-0543, Section IV, page 9

#### **4.1.1. Identification of the Member of the Public**

The Member of the Public is considered to be a real individual, including all persons not occupationally associated with the Callaway Plant, but who may use portions of the plant site for recreational or other purposes not associated with the plant.<sup>49</sup> Accordingly, it is necessary to characterize this individual with respect to his utilization of areas both within and at or beyond the Site Boundary and identify, as far as possible, major assumptions which could be reevaluated if necessary to demonstrate continued compliance with 40 CFR 190 through the use of more realistic assumptions.<sup>50,51</sup>

The evaluation of Total Dose from the Uranium Fuel Cycle should consider the dose to two Critical Receptors: (a) The Nearest Resident, and (b) The Critical Receptor within the Site Boundary.

#### **4.1.2. Total Dose to the Nearest Resident**

The dose to the Nearest Resident is due to plume exposure from noble gases, ground plane exposure, and inhalation and ingestion pathways. It is conservatively assumed that each ingestion pathway (meat, milk, and vegetation) exists at the location of the Nearest Resident.

It is assumed that direct radiation dose from operation of the Unit and storage of radioactive material, and dose from gaseous effluents due to activities within the Site Boundary is negligible for the Nearest Resident. The total Dose from the Uranium Fuel Cycle to the Nearest Resident is calculated using the methodology discussed in Section 3, using concurrent meteorological data for the location of the Nearest Resident with the highest value of X/Q.

The location of the Nearest Resident in each meteorological sector is determined from the Annual Land Use Census conducted in accordance with the Requirements of REC 16.11.4.2.

#### **4.1.3. Total Dose to the Critical Receptor within the Site Boundary**

The Union Electric Company has entered into an agreement with the State of Missouri Department of Conservation for management of the residual lands surrounding the Callaway Plant, including some areas within the Site Boundary. Under the terms of this agreement, certain areas have been opened to the public for low intensity recreational uses (hunting, hiking, sightseeing, etc.) but recreational use is excluded in an area immediately surrounding the plant site (refer to Figure 4.1). Much of the residual lands within the Site Boundary are leased to area farmers by the Department of Conservation to provide income to support management and development costs. Activities conducted under these leases are primarily

---

<sup>49</sup> NUREG-0133, Section 3.8

<sup>50</sup> NUREG-0543, Section IV, page 9

<sup>51</sup> NUREG-0543, section III, page 6

comprised of farming (animal feed), grazing, and forestry. Crops for human consumption are specifically prohibited by the lease.<sup>52,53,54</sup>

Based on the utilization of areas within the Site Boundary, it is reasonable to assume that the critical receptor within the Site Boundary is a farmer, and that his dose from activities within the Site Boundary is due to exposure incurred while conducting his farming activities. The previous tenant estimated that he spent approximately 1100 hours per year working the farm plots of the Reform Conservation Area.<sup>55</sup>

Any reevaluation of assumptions should consider only real receptors and real pathways using realistic assumptions, and should include a reevaluation of the occupancy period at the locations of real exposure (e.g. a real individual would not simultaneously exist at each point of maximum exposure).

#### **4.1.3.1. Total Dose to the Farmer from Gaseous Effluents**

The Total Dose to the farmer from gaseous effluents is calculated for the adult age group using the methodology discussed in Section 3, utilizing historical meteorological data from Table 10 for activities within the Site Boundary. The Reform Conservation Area farm plots are leased to several different farmers therefore there is no dose calculation for the farmer's residence.

It is assumed that food ingestion pathways do not exist within the Site Boundary, therefore the gaseous effluents dose within the Site Boundary is due to plume exposure from Noble Gases and the ground plane and inhalation pathways.

##### **4.1.3.1.1. Direct Radiation Dose**

The direct radiation dose to the Member of Public due to activities within the Site Boundary is insignificant.<sup>56,57</sup>

---

<sup>52</sup> Environmental Report, OLS, Section 2.1.2.3


<sup>53</sup> Environmental Report, OLS, Section 2.1.3.3.4

<sup>54</sup> Management Agreement for the Public Use of Lands, Exhibit A.

<sup>55</sup> Private communication, H.C. Lindeman & B.F. Holderness, August 6, 1986

<sup>56</sup> HPCI 12-06

<sup>57</sup> HPCI 15-05

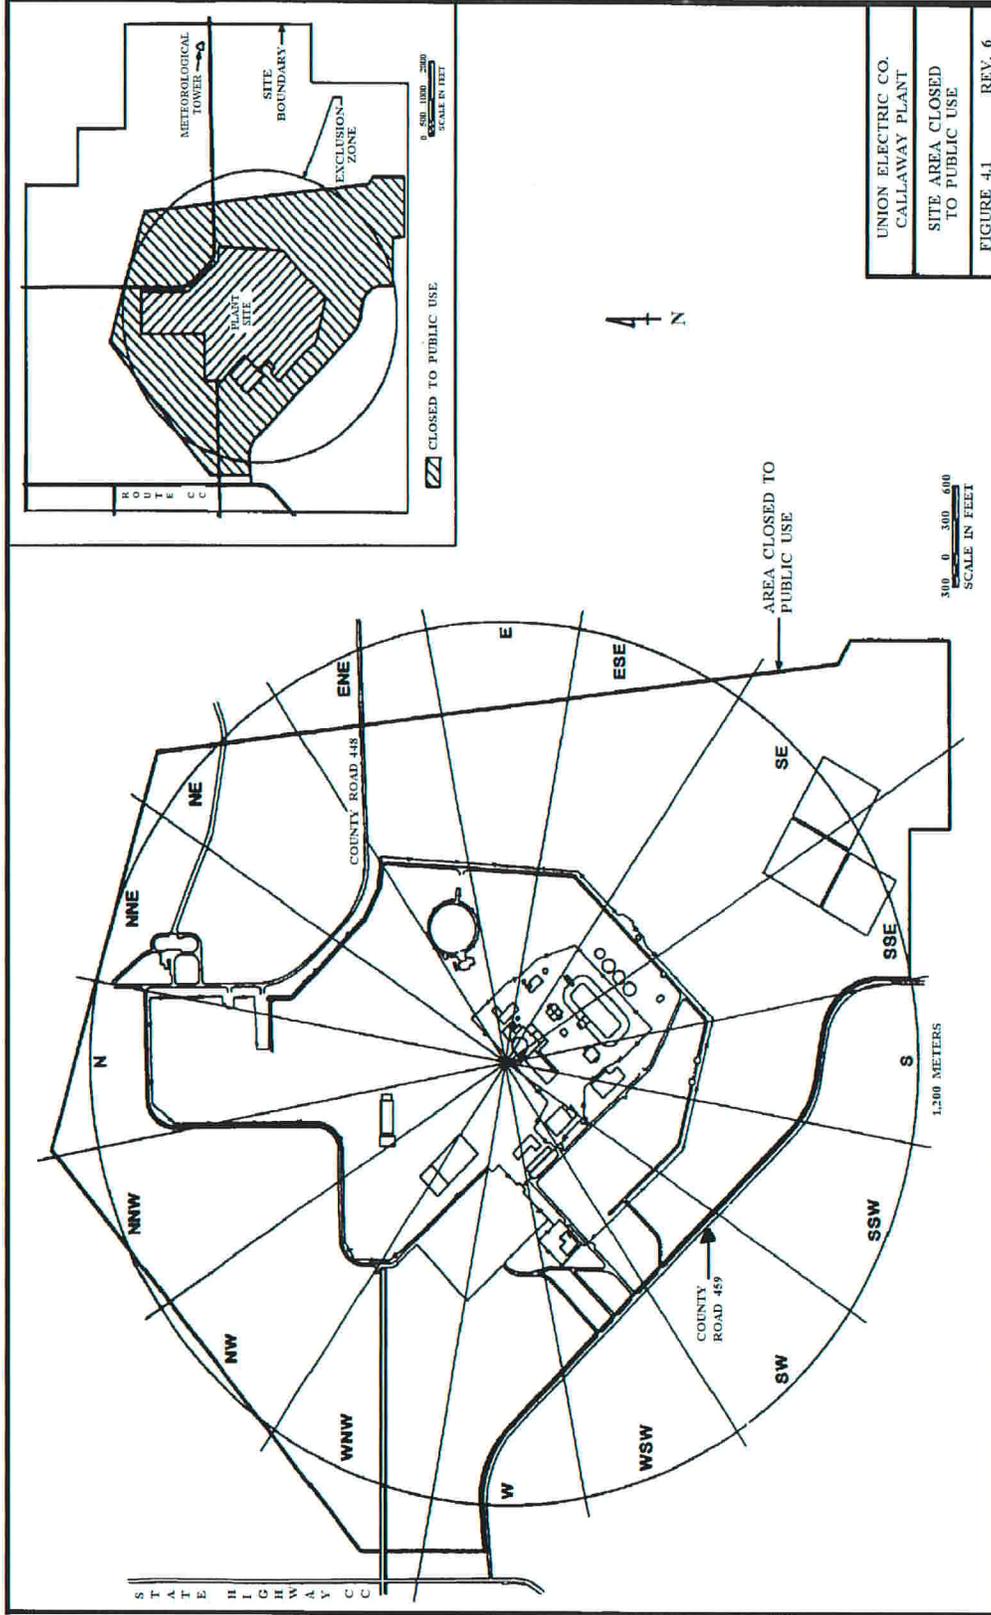

## **5. Radiological Environmental Monitoring**

### **5.1. Description Of The Radiological Environmental Monitoring Program**

The Radiological Environmental Monitoring Program is intended to provide background data for pre- operation and to supplement the radiological effluent release monitoring program during plant operation. Radiation exposure to the public from the various specific pathways and direct radiation is evaluated by this program.

Some deviations from the sampling frequency may be necessary due to seasonal unavailability, hazardous conditions, or other legitimate reasons. Efforts are made to obtain all required samples within the required time frame. Any deviation(s) in sampling frequency or location is documented in the Annual Radiological Environmental Operating Report.

REMP sampling locations that use meteorological sectors and or distance from the plant site were verified as described in HPCI 99-01.

Sampling, reporting, and analytical requirements are given in FSAR-SP Tables 16.11-7, 16.11-8, and 16.11-9.

Airborne, waterborne, direct radiation, and ingestion samples collected under the monitoring program are analyzed by an independent, third-party laboratory. With the exception of direct radiation, the laboratory is required to participate in an Interlaboratory Analyses Program per Reg. Guide 4.15.<sup>58</sup> The laboratory participates in an Interlaboratory crosscheck program administered by Environmental Resources Associates (ERA), Mixed Analyte Performance Evaluation Program (MAPEP), or equivalent program. This participation includes all of the determinations (sample medium - radionuclide combination) that are both offered by ERA and/or MAPEP and are also included in the environmental monitoring program.

### **5.2. Performance Testing Of Environmental Thermoluminescence Dosimeters**

Dosimeters used for monitoring of direct radiation dose in the Radiological Environmental Monitoring Program are tested for accuracy and precision to demonstrate compliance with the applicable portions of Regulatory Guide 4.13.

## **6. Annual Average Atmospheric Dispersion Parameters**

### **6.1. Annual Atmospheric Dispersion Parameters**

The dispersion values presented in Table 10 were determined through the analysis of five years of on-site meteorological data.<sup>59</sup> The straight-line Gaussian dispersion model XOQDOQ<sup>60</sup> was used for determination of the long-term atmospheric dispersion parameters. A more detailed discussion of the methodology and input data utilized to calculate these parameters can be found in HPCI 1503.

---

<sup>58</sup> Regulatory Guide 4.15, rev. 1, section 6.3.2

<sup>59</sup> HPCI 1503

<sup>60</sup> NUREG/CR2919

### 6.1.1. Determination of Dispersion Estimates for Special Receptor Locations

XOQDOQ is utilized to obtain dispersion parameters for 22 standard distances. Dispersion parameters at the Site Boundary and at special receptor locations are estimated by logarithmic interpolation according to:<sup>61</sup>

$$X = X_1 (d/d_1)^B$$

Eq. 26

Where:

$$B = \frac{\ln (X_2/X_1)}{\ln (d_2/d_1)}$$

Eq. 27

$X_1$ ,  $X_2$  are the atmospheric dispersion parameters at distance  $d_1$  and  $d_2$ , respectively, from the source. The distances  $d_1$  and  $d_2$  are selected such that they satisfy the relationship  $d_1 < d < d_2$ .

### 6.1.2. Atmospheric Dispersion Parameters for Farming Areas within the Site Boundary

The dispersion parameters for farming areas within the Site Boundary are intended for a narrow scope application; that of calculating the dose to the current farmer<sup>62</sup> from gaseous effluents while he conducts farming activities within the Site Boundary.

For the purpose of these calculations, it was assumed that all of the farmer's time, approximately 1100 hours per year, is spent on croplands of the Reform Conservation Area, including plots within the Site Boundary, and that his time is divided among the plots proportional to the acreage of each plot. Fractional acreage/time-weighted dispersion parameters were calculated for each plot as described in HPCI 1502. The weighted dispersion parameters for each plot were summed (according to type) in order to produce a composite value of the dispersion parameters which are presented in Table 10. These dispersion parameters therefore represent the distributed activities of the farmer within the Site Boundary and his estimated occupancy period.

## 6.2. Annual Meteorological Data Processing

The annual atmospheric dispersion parameters utilized in the calculation of doses for demonstration of compliance with the numerical dose objectives of 10 CFR 50, Appendix I, are determined using XOQDOQ.<sup>63</sup> Multiple sensors are utilized to ensure 90% valid data recovery for the wind speed, wind direction, and ambient air temperature parameters as required by Regulatory Guide 1.23. The selection hierarchy is presented in Table 13.

The input parameters to XOQDOQ are documented in HPCI 1503.

---

<sup>61</sup> FSAR-SA 2.3.5.2.1.2

<sup>62</sup> The farming plots are leased by the Missouri Department of Conservation to multiple farmers through a bidding process. This represents a composite of those persons farming the plots within the Site Boundary.

<sup>63</sup> NUREG/CR-2919

A quality check of the meteorological data is performed prior to processing to ensure the validity of the calculated dispersion parameters.

## **7. Reporting Requirements**

### **7.1. Annual Radiological Environmental Operating Report**

The reporting requirements for the Annual Radiological Environmental Operating Report (AREOR) have been relocated to FSAR-SP 16.11.5.1.

### **7.2. Annual Radioactive Effluent Release Report**

The reporting requirements for the Annual Radioactive Effluent Release Report (ARERR) have been relocated to FSAR-SP 16.11.5.2. The application of atmospheric dispersion parameters in the ARERR is presented in Table 12.

## **8. Radioactive Effluent Controls (REC)**

The Radioactive Effluent Controls were relocated to FSAR-SP Chapter 16.11, "Offsite Dose Calculation Manual Radioactive Effluent Controls". The former ODCM REC numbers appear on each of the RECs in FSAR-SP Chapter 16.11, and may be used as a cross-reference between the previous and the current numbering system if necessary.

## **9. Administrative Controls**

### **9.1. Major Changes to Liquid and Gaseous Radwaste Treatment Systems**

A summary of Licensee-initiated major changes to the Radwaste Treatment Systems (liquid and gaseous) must be reported to the Commission in the Annual Radioactive Effluent Release Report (ARERR) for the period in which the evaluation was reviewed by the On-Site Review Committee (ORC). On site documentation must contain:

- A summary of the evaluation that led to the determination that the change could be made in accordance with 10 CFR 50.59;
- Sufficient detailed information to totally support the reason for the change without benefit of additional or supplemental information;
- A detailed description of the equipment, components and process involved and the interfaces with other plant systems;
- An evaluation of the change, which shows the predicted releases of radioactive materials in liquid and gaseous effluents that differ from those previously predicted in the License application and amendments thereto;
- An evaluation of the change, which shows the expected maximum exposures to a Member of the Public in the Unrestricted Area and to the general population that differ from those previously estimated in the License application and amendments thereto;

- A comparison of the predicted releases of radioactive materials, in liquid and gaseous effluents, to the actual releases for the period prior to when the changes are to be made;
- An estimate of the exposure to plant operating personnel as a result of the change; and
- Documentation of the fact that the change was reviewed and found acceptable by the ORC.

Changes to the Radwaste Treatment Systems shall become effective upon review and approval by the ORC.

## **9.2. Changes to the Offsite Dose Calculation Manual (ODCM)**

All changes to the ODCM shall be performed pursuant to T/S AC 5.5.1

Review for each revision of the ODCM must include the Radiation Protection Department.

## **10. Bibliography**

ANSI N13.10-1974 , "Specification & Performance of On-Site Instrumentation for Continuously Monitoring Radioactivity in Effluents". (1974)

CAR 200700053 – " Missouri River Low Flow Trend for 2006", Attachments: Phase 1 Final Draft

CDP-ZZ-00200, Appendix B, "Primary Plant Systems Tables", rev. 36. November, 2015.

Certificate of Compliance No. 1040, Appendix A, Technical Specifications for the HI-STORM UMAX Canister Storage System. April, 2015.

EGG-PHY-9703, "Technical Evaluation Report for the evaluation of ODCM Revision 0 (May, 1990) Callaway Plant, Unit 1", transmitted via letter, Samuel J. Collins (USNRC) to D. F. Schnell (UE), dated July 12, 1996.

EPRI TR-1021106, "Estimation of <sup>14</sup>C in Nuclear Power Plant Effluents", December, 2010

Generic Letter 89-01, "Guidance for the Implementation of Programmatic Controls for RETS in the Administrative Controls Section of Technical Specifications and the Relocation of Procedural Details of Current RETS to the Offsite Dose Calculation Manual or Process Control Program", US Nuclear Regulatory Commission. (1989)

Hammer, Gregory, R., "Climate of Missouri", monograph available from the National Climatic Data Center (NCDC) of the National Oceanic and Atmospheric Administration (NOAA), January, 2006

HPCI 8403, "Setpoints and Associated Bases for Process and Effluent Radioactivity Monitors (SP System)". June, 1984.

HPCI 8710, "Methodology for Calculating the Response of Gross NaI(Tl) Monitors to Liquid Effluent Streams", rev. 1, April, 2005.

HPCI 8902, "Calculation of ODCM Dose Commitment Factors", rev. 0. September, 1989.

HPCI 9605, "Calculation of Maximum Background Value for HB-RE-18", rev.0. September, 1996

HPCI 9901, "Documentation of REMP Procedure Changes". Rev.0. January, 2000.

HPCI 9905, "Calculation of Setpoint for GL-RE-202", rev.0. April, 1999.

HPCI 0406 "Calculation of Liquid Effluent Dose Commitment Factors ( $A_{it}$ ) for the Adult Age Group", rev. 1. November, 2004.

HPCI 0509, "Radiological Environmental Monitoring Program (REMP) Calculation of Direct Dose from RAM Storage at Stores II", rev. 0. April, 2005.

HPCI 0510, "Radiological Environmental Monitoring Program (REMP) Calculation of Direct Dose from RAM Storage in the Radwaste Yard", rev. 0. April, 2005.

HPCI 0601, "Equipment Hatch Platform and Missile Shield Modification Direct Dose Calculation to the Member of the Public", rev. 0. January, 2006.

HPCI 1003, "Evaluation of the 2010 Land Use Census", rev. 0. December, 2010.

HPCI 1102, "Dose to the Member of the Public from the Release of  $^{14}\text{C}$  in Gaseous Effluents for 2010", rev.0. July, 2011.

HPCI 1206, "Evaluation of Direct Radiation Dose to the Member of the Public Due to Activities within the site Boundary", rev. 0. August, 2012.

HPCI 1502, "Atmospheric Dispersion Parameters for Activities Inside the Site Boundary", rev. 0. February, 2015.

HPCI 1503, "Calculation of Long- Term Meteorological Dispersion Parameters", rev. 1. April, 2015

HPCI 1504, "Evaluation of the 2014 Annual Land Use Census", rev. 1. March, 2015

HPCI 1505, "Evaluation of Direct Radiation Dose to the Member of the Public from the Independent Spent Fuel Storage Facility", rev. 1. July, 2015.

HPCI 1508, "Evaluation of the 2015 Land Use Census", rev.0. March, 2016.

HPCI 1604, " Calculation of  $^{126}\text{Sb}$  Ingestion Dose Commitment Factors ( $A_{it}$ )", rev. 0. April, 2016.

IAEA Technical Reports Series no. 421, "Management of Waste Containing Tritium and Carbon- 14", 2004

Internal USNRC memo, F. J. Congel to V. L. Miller, et al, dated April 17, 1992.

Kunz, C., "Carbon-14 Discharge at Three Light- Water Reactors", *Health Physics*, vol. 49, pages 25- 35, 1985

Letter, F. J. Congel to J. F. Schmidt, dated April 23, 1992.

Letter, F. J. Congel to J. F. Schmidt, dated December 9, 1991.

Letter, F. J. Congel to J. F. Schmidt, dated June 8, 1993.

Letter, F. J. Congel to J. F. Schmidt, dated September 14, 1992.

Management Agreement for the Public Use of Lands, Union Electric Company and the State of Missouri Department of Conservation, January 15, 2009.

Memo, F. J. Congel, "Eighth Set of Questions and Answers on 10 CFR Part 20", May 26, 1994.

NCRP Report 81, "Carbon-14 in the Environment", January 1985

Neeb, Karl- Heinz, *The Radiochemistry of Nuclear Power Plants with Light Water Reactors*, Walter de Gruyter, Berlin, 1997

NEO-54, memo, D. W. Capone to S. E. Miltenberger, dated January 5, 1983; Union Electric Company correspondence.

NUREG-0017, "Calculation of Releases of Radioactive Materials in Gaseous and Liquid Effluents from Pressurized Water Reactors PWR-GALE Code," April, 1985

NUREG-0133, "Preparation of Radiological Effluent Technical Specification for Nuclear Power Plants", U.S. Nuclear Regulatory Commission. (1978)

NUREG-0543, "Methods for Demonstrating LWR Compliance with the EPA Uranium Fuel Cycle Standard (40 CFR Part 190)", U. S. Nuclear Regulatory Commission. (1980)

NUREG-1301, "Offsite Dose Calculation Manual Guidance: Standard Radiological Effluent Controls for Pressurized Water Reactors, Generic Letter 89-01, Supplement No. 1", April, 1991

NUREG/CR-2919, "XOQDOQ, Computer Program For the Meteorological Evaluation of Routine Effluent Releases at Nuclear Power Stations", U.S. Nuclear Regulatory Commission. (1982)

NUREG/CR-6204, "Questions and Answers Based on Revised 10 CFR 20", May, 1994

Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purposes of Evaluating Compliance with 10 CFR Part 50, Appendix I", Revision 1, U. S. Nuclear Regulatory Commission. (1977)

Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors", Revision 1, U. S. Nuclear Regulatory Commission. (1977)

Regulatory Guide 1.21, "Measuring, Evaluating, and Reporting Radioactive Material in Liquid and Gaseous Effluents and Solid Waste", (Revision 2), U. S. Nuclear Regulatory Commission. (2009)

Regulatory Guide 4.13, "Performance, Testing, and procedural specifications for Thermoluminescence Dosimetry: Environmental Applications "(Revision 1), U. S. Nuclear Regulatory Commission. (1977)

Regulatory Guide 4.15, "Quality Assurance for Radiological Monitoring Programs (Normal Operations) – Effluent Streams and the Environment" (Revision 1), U. S. Nuclear Regulatory Commission (1979)

Statements of Consideration, Federal Register, Vol. 56, No. 98, Tuesday, May 21, 1991, Subpart D, page 23374.

Title 10, "Energy", Chapter 1, Code of Federal Regulations, Part 20; U.S. Government Printing Office, Washington, D.C. 20402.

Title 10, "Energy", Chapter 1, Code of Federal Regulations, Part 72, Subpart F; U.S. Government Printing Office, Washington, D.C. 20402.

Title 10, "Energy", Chapter 1, Code of Federal Regulations, Part 50, Appendix I; U.S. Government Printing Office, Washington, D.C. 20402.

Title 40, "Protection of Environment", Chapter 1, Code of Federal Regulations, Part 190; U.S. Government Print Office, Washington, D.C. 20402.

Union Electric Company Callaway Plant Environmental Report, Operating License Stage

Union Electric Company Callaway Plant, Unit 1, Final Safety Analysis Report- Standard Plant

UOTH 83-58, "Documentation of ODCM Dose Factors and Parameters". (1983)

USNRC Inspection Report 50-483/92002(DRSS), Section 5, page 5.

Westinghouse Calculation Note CN-TA-02-135, "Callaway (SCP) RSG IGOR/RETRAN Base Deck, May 16, 2003

ZZ-250, Rev. 0, "ODCM Gaseous Pathway Dose Factors for Child Age Group and Ground Plane Dose Factors". (1992)

ZZ-48, "Calculation of Inhalation and Ingestion Dose Commitment Factors for the Adult and Child". (1988)

ZZ-57, "Dose Factors for Eu-154". (1989)

ZZ-78, Rev. 2, "ODCM Gaseous Pathway Dose Factors for Adult Age Group". (1992)

**Table 1: Ingestion Dose Commitment Values ( $A_{it}$ ) for Adult Age Group**  
(mrem/hr) per ( $\mu\text{Ci/ml}$ )

Nuclide	Bone	Liver	Total Body	Thyroid	Kidney	Lung	GI-LLI
<sup>3</sup> H	0.00E+00	2.26E-01	2.26E-01	2.26E-01	2.26E-01	2.26E-01	2.26E-01
<sup>7</sup> Be	1.31E-02	2.98E-02	1.45E-02	0.00E+00	3.15E-02	0.00E+00	5.17E+00
<sup>24</sup> Na	4.07E+02	4.07E+02	4.07E+02	4.07E+02	4.07E+02	4.07E+02	4.07E+02
<sup>51</sup> Cr	0.00E+00	0.00E+00	1.27E+00	7.61E-01	2.81E-01	1.69E+00	3.20E+02
<sup>54</sup> Mn	0.00E+00	4.38E+03	8.35E+02	0.00E+00	1.30E+03	0.00E+00	1.34E+04
<sup>56</sup> Mn	0.00E+00	1.10E+02	1.95E+01	0.00E+00	1.40E+02	0.00E+00	3.51E+03
<sup>55</sup> Fe	6.58E+02	4.55E+02	1.06E+02	0.00E+00	0.00E+00	2.54E+02	2.61E+02
<sup>59</sup> Fe	1.04E+03	2.44E+03	9.36E+02	0.00E+00	0.00E+00	6.82E+02	8.14E+03
<sup>57</sup> Co	0.00E+00	2.09E+01	3.48E+01	0.00E+00	0.00E+00	0.00E+00	5.31E+02
<sup>58</sup> Co	0.00E+00	8.92E+01	2.00E+02	0.00E+00	0.00E+00	0.00E+00	1.81E+03
<sup>60</sup> Co	0.00E+00	2.56E+02	5.65E+02	0.00E+00	0.00E+00	0.00E+00	4.81E+03
<sup>63</sup> Ni	3.11E+04	2.16E+03	1.04E+03	0.00E+00	0.00E+00	0.00E+00	4.50E+02
<sup>65</sup> Ni	1.26E+02	1.64E+01	7.49E+00	0.00E+00	0.00E+00	0.00E+00	4.17E+02
<sup>64</sup> Cu	0.00E+00	9.97E+00	4.68E+00	0.00E+00	2.51E+01	0.00E+00	8.50E+02
<sup>65</sup> Zn	2.32E+04	7.37E+04	3.33E+04	0.00E+00	4.93E+04	0.00E+00	4.64E+04
<sup>69</sup> Zn	4.93E+01	9.43E+01	6.56E+00	0.00E+00	6.13E+01	0.00E+00	1.42E+01
<sup>82</sup> Br	0.00E+00	0.00E+00	2.27E+03	0.00E+00	0.00E+00	0.00E+00	2.60E+03
<sup>83</sup> Br	0.00E+00	0.00E+00	4.04E+01	0.00E+00	0.00E+00	0.00E+00	5.82E+01
<sup>84</sup> Br	0.00E+00	0.00E+00	5.24E+01	0.00E+00	0.00E+00	0.00E+00	4.11E-04
<sup>85</sup> Br	0.00E+00	0.00E+00	2.15E+00	0.00E+00	0.00E+00	0.00E+00	1.01E-15
<sup>86</sup> Rb	0.00E+00	1.01E+05	4.71E+04	0.00E+00	0.00E+00	0.00E+00	1.99E+04
<sup>88</sup> Rb	0.00E+00	2.90E+02	1.54E+02	0.00E+00	0.00E+00	0.00E+00	4.00E-09
<sup>89</sup> Rb	0.00E+00	1.92E+02	1.35E+02	0.00E+00	0.00E+00	0.00E+00	1.12E-11
<sup>89</sup> Sr	2.21E+04	0.00E+00	6.35E+02	0.00E+00	0.00E+00	0.00E+00	3.55E+03
<sup>90</sup> Sr	5.44E+05	0.00E+00	1.34E+05	0.00E+00	0.00E+00	0.00E+00	1.57E+04
<sup>91</sup> Sr	4.07E+02	0.00E+00	1.64E+01	0.00E+00	0.00E+00	0.00E+00	1.94E+03
<sup>92</sup> Sr	1.54E+02	0.00E+00	6.68E+00	0.00E+00	0.00E+00	0.00E+00	3.06E+03
<sup>90</sup> Y	5.76E-01	0.00E+00	1.54E-02	0.00E+00	0.00E+00	0.00E+00	6.10E+03
<sup>91m</sup> Y	5.44E-03	0.00E+00	2.11E-04	0.00E+00	0.00E+00	0.00E+00	1.60E-02
<sup>91</sup> Y	8.44E+00	0.00E+00	2.26E-01	0.00E+00	0.00E+00	0.00E+00	4.64E+03
<sup>92</sup> Y	5.06E-02	0.00E+00	1.48E-03	0.00E+00	0.00E+00	0.00E+00	8.86E+02
<sup>93</sup> Y	1.60E-01	0.00E+00	4.43E-03	0.00E+00	0.00E+00	0.00E+00	5.09E+03
<sup>95</sup> Zr	2.40E-01	7.70E-02	5.21E-02	0.00E+00	1.21E-01	0.00E+00	2.44E+02
<sup>97</sup> Zr	1.33E-02	2.68E-03	1.22E-03	0.00E+00	4.04E-03	0.00E+00	8.30E+02
<sup>95</sup> Nb	4.47E+02	2.48E+02	1.34E+02	0.00E+00	2.46E+02	0.00E+00	1.51E+06
<sup>99</sup> Mo	0.00E+00	1.03E+02	1.96E+01	0.00E+00	2.34E+02	0.00E+00	2.39E+02
<sup>99m</sup> Tc	8.87E-03	2.51E-02	3.19E-01	0.00E+00	3.81E-01	1.23E-02	1.48E+01

**Table 1: Ingestion Dose Commitment Values ( $A_{it}$ ) for Adult Age Group**  
(mrem/hr) per ( $\mu\text{Ci/ml}$ )

Nuclide	Bone	Liver	Total Body	Thyroid	Kidney	Lung	GI-LLI
<sup>101</sup> Tc	9.12E-03	1.31E-02	1.29E-01	0.00E+00	2.37E-01	6.72E-03	3.95E-14
<sup>103</sup> Ru	4.43E+00	0.00E+00	1.91E+00	0.00E+00	1.69E+01	0.00E+00	5.17E+02
<sup>105</sup> Ru	3.69E-01	0.00E+00	1.46E-01	0.00E+00	4.76E+00	0.00E+00	2.26E+02
<sup>106</sup> Ru	6.58E+01	0.00E+00	8.33E+00	0.00E+00	1.27E+02	0.00E+00	4.26E+03
<sup>109</sup> Cd	0.00E+00	5.55E+02	1.94E+01	0.00E+00	5.31E+02	0.00E+00	5.60E+03
<sup>110m</sup> Ag	8.85E-01	8.18E-01	4.86E-01	0.00E+00	1.61E+00	0.00E+00	3.34E+02
<sup>113</sup> Sn	5.67E+04	1.61E+03	3.26E+03	9.19E+02	0.00E+00	0.00E+00	1.69E+05
<sup>122</sup> Sb	5.48E-01	1.12E-02	1.66E-01	7.73E-03	0.00E+00	2.94E-01	0.00E+00
<sup>124</sup> Sb	6.70E+00	1.27E-01	2.66E+00	1.63E-02	0.00E+00	5.22E+00	1.90E+02
<sup>125</sup> Sb	4.29E+00	4.79E-02	1.02E+00	4.36E-03	0.00E+00	3.30E+00	4.72E+01
<sup>126</sup> Sb	2.75E+00	5.59E-02	9.92E-01	1.68E-02	0.00E+00	1.68E+00	2.25E+02
<sup>127m</sup> Te	6.48E+03	2.32E+03	7.90E+02	1.66E+03	2.63E+04	0.00E+00	2.17E+04
<sup>127</sup> Te	1.05E+02	3.78E+01	2.28E+01	7.80E+01	4.29E+02	0.00E+00	8.31E+03
<sup>129m</sup> Te	1.10E+04	4.11E+03	1.74E+03	3.78E+03	4.60E+04	0.00E+00	5.54E+04
<sup>129</sup> Te	3.01E+01	1.13E+01	7.33E+00	2.31E+01	1.26E+02	0.00E+00	2.27E+01
<sup>131m</sup> Te	1.66E+03	8.10E+02	6.75E+02	1.28E+03	8.21E+03	0.00E+00	8.04E+04
<sup>131</sup> Te	1.89E+01	7.88E+00	5.96E+00	1.55E+01	8.26E+01	0.00E+00	2.67E+00
<sup>132</sup> Te	2.41E+03	1.56E+03	1.47E+03	1.72E+03	1.50E+04	0.00E+00	7.38E+04
<sup>130</sup> I	2.71E+01	8.01E+01	3.16E+01	6.79E+03	1.25E+02	0.00E+00	6.89E+01
<sup>131</sup> I	1.49E+02	2.14E+02	1.22E+02	7.00E+04	3.66E+02	0.00E+00	5.64E+01
<sup>132</sup> I	7.29E+00	1.95E+01	6.82E+00	6.82E+02	3.11E+01	0.00E+00	3.66E+00
<sup>133</sup> I	5.14E+01	8.87E+01	2.70E+01	1.30E+04	1.55E+02	0.00E+00	7.97E+01
<sup>134</sup> I	3.81E+00	1.03E+01	3.70E+00	1.79E+02	1.64E+01	0.00E+00	9.01E-03
<sup>135</sup> I	1.59E+01	4.17E+01	1.54E+01	2.75E+03	6.68E+01	0.00E+00	4.70E+01
<sup>134</sup> Cs	2.98E+05	7.09E+05	5.79E+05	0.00E+00	2.29E+05	7.61E+04	1.24E+04
<sup>136</sup> Cs	3.12E+04	1.23E+05	8.86E+04	0.00E+00	6.85E+04	9.38E+03	1.40E+04
<sup>137</sup> Cs	3.82E+05	5.22E+05	3.42E+05	0.00E+00	1.77E+05	5.89E+04	1.01E+04
<sup>138</sup> Cs	2.64E+02	5.22E+02	2.59E+02	0.00E+00	3.84E+02	3.79E+01	2.23E-03
<sup>139</sup> Ba	9.29E-01	6.62E-04	2.72E-02	0.00E+00	6.19E-04	3.75E-04	1.65E+00
<sup>140</sup> Ba	1.94E+02	2.44E-01	1.27E+01	0.00E+00	8.30E-02	1.40E-01	4.00E+02
<sup>141</sup> Ba	4.51E-01	3.41E-04	1.52E-02	0.00E+00	3.17E-04	1.93E-04	2.13E-10
<sup>142</sup> Ba	2.04E-01	2.10E-04	1.28E-02	0.00E+00	1.77E-04	1.19E-04	2.87E-19
<sup>140</sup> La	1.50E-01	7.54E-02	1.99E-02	0.00E+00	0.00E+00	0.00E+00	5.54E+03
<sup>142</sup> La	7.66E-03	3.48E-03	8.68E-04	0.00E+00	0.00E+00	0.00E+00	2.54E+01
<sup>141</sup> Ce	2.24E-02	1.52E-02	1.72E-03	0.00E+00	7.04E-03	0.00E+00	5.79E+01
<sup>143</sup> Ce	3.95E-03	2.92E+00	3.23E-04	0.00E+00	1.29E-03	0.00E+00	1.09E+02
<sup>144</sup> Ce	1.17E+00	4.88E-01	6.27E-02	0.00E+00	2.90E-01	0.00E+00	3.95E+02

**Table 1: Ingestion Dose Commitment Values ( $A_{in}$ ) for Adult Age Group**  
(mrem/hr) per ( $\mu\text{Ci/ml}$ )

Nuclide	Bone	Liver	Total Body	Thyroid	Kidney	Lung	GI-LLI
<sup>143</sup> Pr	5.51E-01	2.21E-01	2.73E-02	0.00E+00	1.27E-01	0.00E+00	2.41E+03
<sup>144</sup> Pr	1.80E-03	7.48E-04	9.16E-05	0.00E+00	4.22E-04	0.00E+00	2.59E-10
<sup>147</sup> Nd	3.76E-01	4.35E-01	2.60E-02	0.00E+00	2.54E-01	0.00E+00	2.09E+03
<sup>154</sup> Eu	3.68E+01	4.52E+00	3.22E+00	0.00E+00	2.17E+01	0.00E+00	3.28E+03
<sup>181</sup> Hf	4.00E-02	1.94E-01	1.80E-02	0.00E+00	4.18E-02	0.00E+00	2.21E+02
<sup>187</sup> W	2.96E+02	2.47E+02	8.65E+01	0.00E+00	0.00E+00	0.00E+00	8.10E+04
<sup>237</sup> Np	3.28E+04	2.85E+03	1.33E+03	0.00E+00	9.86E+03	0.00E+00	1.90E+03
<sup>239</sup> Np	2.85E-02	2.80E-03	1.54E-03	0.00E+00	8.74E-03	0.00E+00	5.75E+02
<sup>238</sup> Pu	5.70E+03	8.03E+02	1.43E+02	0.00E+00	6.13E+02	0.00E+00	6.12E+02
<sup>239</sup> Pu*	6.59E+03	8.88E+02	1.60E+02	0.00E+00	6.80E+02	0.00E+00	5.68E+02
<sup>241</sup> Pu	1.38E+02	7.07E+00	2.78E+00	0.00E+00	1.28E+01	0.00E+00	1.17E+01
<sup>241</sup> Am	4.90E+04	1.72E+04	3.24E+03	0.00E+00	2.44E+04	0.00E+00	4.44E+03
<sup>242</sup> Cm	1.23E+03	1.26E+03	8.20E+01	0.00E+00	3.72E+02	0.00E+00	4.74E+03
<sup>243</sup> Cm**	3.82E+04	1.44E+04	2.24E+03	0.00E+00	1.05E+04	0.00E+00	4.67E+03

\*Includes Pu-240 contribution

\*\*Includes Cm-244 contribution

**Table 2: Bioaccumulation Factor (Bf<sub>i</sub>)<sup>(a)</sup>**  
(pCi/kg) per (pCi/liter)

Element	Bf <sub>i</sub> Fish (Freshwater)	Element	Bf <sub>i</sub> Fish (Freshwater)
H	9.0 E - 01	Rh	1.0 E + 01
Be	2.0 E + 00	Ag	2.3 E + 00
Na	1.0 E + 02	Cd	2.0 E + 02
Cr	2.0 E + 02	Sn	3.0 E + 03
Mn	4.0 E + 02	Sb	1.0 E + 00
Fe	1.0 E + 02	Te	4.0 E + 02
Co	5.0 E + 01	I	1.5 E + 01
Ni	1.0 E + 02	Cs	2.0 E + 03
Cu	5.0 E + 01	Ba	4.0 E + 00
Zn	2.0 E + 03	La	2.5 E + 01
Br	4.2 E + 02	Ce	1.0 E + 00
Rb	2.0 E + 03	Pr	2.5 E + 01
Sr	3.0 E + 01	Nd	2.5 E + 01
Y	2.5 E + 01	Eu	2.5 E + 01
Zr	3.3 E + 00	Hf	3.3 E + 00
Nb	3.0 E + 04	W	1.2 E + 03
Mo	1.0 E + 01	Np	1.0 E + 01
Tc	1.5 E + 01	Pu	3.5 E + 00
Ru	1.0 E + 01	Am	2.5 E + 01
		Cm	2.5 E + 01

<sup>(a)</sup> Values from Regulatory Guide 1.109, Rev. 1, Table A-1 and HPCI 04-06.

**Table 3: Dose Factor for Exposure to a Semi- Infinite Cloud of Noble Gases**

Radionuclide	Total Body Dose Factor K <sub>i</sub> (mrem/yr) per (μCi/m <sup>3</sup> )	Skin Dose Factor L <sub>i</sub> (mrem/yr) per (μCi/m <sup>3</sup> )	Gamma Air Dose Factor M <sub>i</sub> (mrad/yr) per (μCi/m <sup>3</sup> )	Beta Air Dose Factor N <sub>i</sub> (mrad/yr) per (μCi/m <sup>3</sup> )
<sup>83m</sup> Kr	7.56 E-02	-----	1.93 E+01	2.88 E+02
<sup>85m</sup> Kr	1.17E+03	1.46E+03	1.23 E+03	1.97 E+03
<sup>85</sup> Kr	1.61 E+01	1.34 E+03	1.72 E+01	1.95 E+03
<sup>87</sup> Kr	5.92 E+03	9.73 E+03	6.17 E+03	1.03 E+04
<sup>88</sup> Kr	1.47 E+04	2.37 E+03	1.52 E+04	2.93 E+03
<sup>89</sup> Kr	1.66 E+04	1.01 E+04	1.73 E+04	1.06 E+04
<sup>90</sup> Kr	1.56 E+04	7.29 E+03	1.63 E+04	7.83 E+03
<sup>131m</sup> Xe	9.15 E+01	4.76 E+02	1.56 E+02	1.11 E+03
<sup>133m</sup> Xe	2.51 E+02	9.94 E+02	3.27 E+02	1.48 E+03
<sup>133</sup> Xe	2.94 E+02	3.06 E+02	3.53 E+02	1.05 E+03
<sup>135m</sup> Xe	3.12 E+03	7.11 E+02	3.36 E+03	7.39 E+02
<sup>135</sup> Xe	1.81 E+03	1.86 E+03	1.92 E+03	2.46 E+03
<sup>137</sup> Xe	1.42 E+03	1.22 E+04	1.51 E+03	1.27 E+04
<sup>138</sup> Xe	8.83 E+03	4.13 E+03	9.21 E+03	4.75 E+03
<sup>41</sup> Ar	8.84 E+03	2.69 E+03	9.30 E+03	3.28 E+03

**Table 4: Ground Plane Pathway Dose Factors (R<sub>i</sub>)**  
(m<sup>2</sup>mrem/yr) per (μCi/sec)

Nuclide	Total Body	Skin	Nuclide	Total Body	Skin
<sup>3</sup> H	0.00E+00	0.00E+00	<sup>113</sup> Sn	1.43E+07	4.09E+07
<sup>7</sup> Be	2.24E+07	3.21E+07	<sup>124</sup> Sb	8.74E+08	1.23E+09
<sup>51</sup> Cr	4.66E+06	5.51E+06	<sup>125</sup> Sb	3.57E+09	5.19E+09
<sup>54</sup> Mn	1.39E+09	1.63E+09	<sup>127m</sup> Te	9.17E+04	1.08E+05
<sup>55</sup> Fe	0.00E+00	0.00E+00	<sup>129m</sup> Te	1.98E+07	2.31E+07
<sup>59</sup> Fe	2.73E+08	3.21E+08	<sup>130</sup> I	5.51E+06	6.69E+06
<sup>57</sup> Co	2.98E+08	4.37E+08	<sup>131</sup> I	1.72E+07	2.09E+07
<sup>58</sup> Co	3.79E+08	4.44E+08	<sup>132</sup> I	1.25E+06	1.47E+06
<sup>60</sup> Co	2.15E+10	2.53E+10	<sup>133</sup> I	2.45E+06	2.98E+06
<sup>63</sup> Ni	0.00E+00	0.00E+00	<sup>134</sup> I	4.47E+05	5.31E+05
<sup>65</sup> Zn	7.47E+08	8.59E+08	<sup>135</sup> I	2.53E+06	2.95E+06
<sup>86</sup> Rb	8.99E+06	1.03E+07	<sup>134</sup> Cs	6.85E+09	8.00E+09
<sup>89</sup> Sr	2.16E+04	2.51E+04	<sup>136</sup> Cs	1.51E+08	1.71E+08
<sup>90</sup> Sr	0.00E+00	0.00E+00	<sup>137</sup> Cs	1.03E+10	1.20E+10
<sup>90</sup> Y	5.36E+06	6.32E+06	<sup>140</sup> Ba	2.05E+07	2.35E+07
<sup>91</sup> Y	1.07E+06	1.21E+06	<sup>140</sup> La	1.47E+08	1.66E+08
<sup>95</sup> Zr	2.45E+08	2.84E+08	<sup>141</sup> Ce	1.37E+07	1.54E+07
<sup>95</sup> Nb	2.50E+08	2.94E+08	<sup>144</sup> Ce	6.96E+07	8.04E+07
<sup>103</sup> Ru	1.08E+08	1.26E+08	<sup>143</sup> Pr	0.00E+00	0.00E+00
<sup>106</sup> Ru	4.22E+08	5.07E+08	<sup>144</sup> Pr	4.35E+07	5.00E+07
<sup>110m</sup> Ag	3.44E+09	4.01E+09	<sup>147</sup> Nd	8.39E+06	1.01E+07
<sup>109</sup> Cd	3.76E+07	1.54E+08	<sup>154</sup> Eu	2.21E+10	3.15E+10
			<sup>181</sup> Hf	1.97E+08	2.82E+08

**Table 5: Child Inhalation Pathway Dose Factors (R<sub>i</sub>)**  
(mrem/yr) per (μCi/m<sup>3</sup>)

Nuclide	Bone	Liver	Total Body	Thyroid	Kidney	Lung	GI-LLI
<sup>3</sup> H	0.00E+00	1.12E+03	1.12E+03	1.12E+03	1.12E+03	1.12E+03	1.12E+03
<sup>7</sup> Be	8.47E+02	1.44E+03	9.25E+02	0.00E+00	0.00E+00	6.47E+04	2.55E+03
<sup>51</sup> Cr	0.00E+00	0.00E+00	1.54E+02	8.55E+01	2.43E+01	1.70E+04	1.08E+03
<sup>54</sup> Mn	0.00E+00	4.29E+04	9.51E+03	0.00E+00	1.00E+04	1.58E+06	2.29E+04
<sup>55</sup> Fe	4.74E+04	2.52E+04	7.77E+03	0.00E+00	0.00E+00	1.11E+05	2.87E+03
<sup>59</sup> Fe	2.07E+04	3.34E+04	1.67E+04	0.00E+00	0.00E+00	1.27E+06	7.07E+04
<sup>57</sup> Co	0.00E+00	9.03E+02	1.07E+03	0.00E+00	0.00E+00	5.07E+05	1.32E+04
<sup>58</sup> Co	0.00E+00	1.77E+03	3.16E+03	0.00E+00	0.00E+00	1.11E+06	3.44E+04
<sup>60</sup> Co	0.00E+00	1.31E+04	2.26E+04	0.00E+00	0.00E+00	7.07E+06	9.62E+04
<sup>63</sup> Ni	8.21E+05	4.63E+04	2.80E+04	0.00E+00	0.00E+00	2.75E+05	6.33E+03
<sup>65</sup> Zn	4.25E+04	1.13E+05	7.03E+04	0.00E+00	7.14E+04	9.95E+05	1.63E+04
<sup>86</sup> Rb	0.00E+00	1.98E+05	1.14E+05	0.00E+00	0.00E+00	0.00E+00	7.99E+03
<sup>89</sup> Sr	5.99E+05	0.00E+00	1.72E+04	0.00E+00	0.00E+00	2.16E+06	1.67E+05
<sup>90</sup> Sr	1.01E+08	0.00E+00	6.44E+06	0.00E+00	0.00E+00	1.48E+07	3.43E+05
<sup>90</sup> Y	4.11E+03	0.00E+00	1.11E+02	0.00E+00	0.00E+00	2.62E+05	2.68E+05
<sup>91</sup> Y	9.14E+05	0.00E+00	2.44E+04	0.00E+00	0.00E+00	2.63E+06	1.84E+05
<sup>95</sup> Zr	1.90E+05	4.18E+04	3.70E+04	0.00E+00	5.96E+04	2.23E+06	6.11E+04
<sup>95</sup> Nb	2.35E+04	9.18E+03	6.55E+03	0.00E+00	8.62E+03	6.14E+05	3.70E+04
<sup>103</sup> Ru	2.79E+03	0.00E+00	1.07E+03	0.00E+00	7.03E+03	6.62E+05	4.48E+04
<sup>106</sup> Ru	1.36E+05	0.00E+00	1.69E+04	0.00E+00	1.84E+05	1.43E+07	4.29E+05
<sup>110m</sup> Ag	1.69E+04	1.14E+04	9.14E+03	0.00E+00	2.12E+04	5.48E+06	1.00E+05
<sup>109</sup> Cd	0.00E+00	5.48E+05	2.59E+04	0.00E+00	4.96E+05	1.05E+06	2.78E+04
<sup>113</sup> Sn	1.13E+05	3.12E+03	8.62E+03	2.33E+03	0.00E+00	1.46E+06	2.26E+05
<sup>124</sup> Sb	5.74E+04	7.40E+02	2.00E+04	1.26E+02	0.00E+00	3.24E+06	1.64E+05
<sup>125</sup> Sb	9.84E+04	7.59E+02	2.07E+04	9.10E+01	0.00E+00	2.32E+06	4.03E+04
<sup>127m</sup> Te	2.49E+04	8.55E+03	3.02E+03	6.07E+03	6.36E+04	1.48E+06	7.14E+04
<sup>129m</sup> Te	1.92E+04	6.85E+03	3.04E+03	6.33E+03	5.03E+04	1.76E+06	1.82E+05

**Table 5: Child Inhalation Pathway Dose Factors (R<sub>i</sub>)**

(mrem/yr) per (μCi/m<sup>3</sup>)

Nuclide	Bone	Liver	Total Body	Thyroid	Kidney	Lung	GI-LLI
<sup>130</sup> I	8.18E+03	1.64E+04	8.44E+03	1.85E+06	2.45E+04	0.00E+00	5.11E+03
<sup>131</sup> I	4.81E+04	4.81E+04	2.73E+04	1.62E+07	7.88E+04	0.00E+00	2.84E+03
<sup>132</sup> I	2.12E+03	4.07E+03	1.88E+03	1.94E+05	6.25E+03	0.00E+00	3.20E+03
<sup>133</sup> I	1.66E+04	2.03E+04	7.70E+03	3.85E+06	3.38E+04	0.00E+00	5.48E+03
<sup>134</sup> I	1.17E+03	2.16E+03	9.95E+02	5.07E+04	3.30E+03	0.00E+00	9.55E+02
<sup>135</sup> I	4.92E+03	8.73E+03	4.14E+03	7.92E+05	1.34E+04	0.00E+00	4.44E+03
<sup>134</sup> Cs	6.51E+05	1.01E+06	2.25E+05	0.00E+00	3.30E+05	1.21E+05	3.85E+03
<sup>136</sup> Cs	6.51E+04	1.71E+05	1.16E+05	0.00E+00	9.55E+04	1.45E+04	4.18E+03
<sup>137</sup> Cs	9.07E+05	8.25E+05	1.28E+05	0.00E+00	2.82E+05	1.04E+05	3.62E+03
<sup>140</sup> Ba	7.40E+04	6.48E+01	4.33E+03	0.00E+00	2.11E+01	1.74E+06	1.02E+05
<sup>140</sup> La	6.44E+02	2.25E+02	7.55E+01	0.00E+00	0.00E+00	1.83E+05	2.26E+05
<sup>141</sup> Ce	3.92E+04	1.95E+04	2.90E+03	0.00E+00	8.55E+03	5.44E+05	5.66E+04
<sup>144</sup> Ce	6.77E+06	2.12E+06	3.61E+05	0.00E+00	1.17E+06	1.20E+07	3.89E+05
<sup>143</sup> Pr	1.85E+04	5.55E+03	9.14E+02	0.00E+00	3.00E+03	4.33E+05	9.73E+04
<sup>144</sup> Pr	5.96E-02	1.85E-02	3.00E-03	0.00E+00	9.77E-03	1.57E+03	1.97E+02
<sup>147</sup> Nd	1.08E+04	8.73E+03	6.81E+02	0.00E+00	4.81E+03	3.28E+05	8.21E+04
<sup>154</sup> Eu	1.01E+07	9.21E+05	8.40E+05	0.00E+00	4.03E+06	6.14E+06	1.10E+05
<sup>181</sup> Hf	2.78E+04	1.01E+05	1.25E+04	0.00E+00	2.05E+04	1.06E+06	6.62E+04

**Table 6: Child Grass- Cow – Milk Pathway Dose Factors (R<sub>i</sub>)**  
(m<sup>2</sup>mrem/yr) per (μCi/sec)

Nuclide	Bone	Liver	Total Body	Thyroid	Kidney	Lung	GI-LLI
<sup>3</sup> H	0.00E+00	1.57E+03	1.57E+03	1.57E+03	1.57E+03	1.57E+03	1.57E+03
<sup>7</sup> Be	7.50E+03	1.28E+04	8.20E+03	0.00E+00	1.25E+04	0.00E+00	7.12E+05
<sup>51</sup> Cr	0.00E+00	0.00E+00	1.02E+05	5.66E+04	1.55E+04	1.03E+05	5.40E+06
<sup>54</sup> Mn	0.00E+00	2.10E+07	5.59E+06	0.00E+00	5.89E+06	0.00E+00	1.76E+07
<sup>55</sup> Fe	1.12E+08	5.94E+07	1.84E+07	0.00E+00	0.00E+00	3.36E+07	1.10E+07
<sup>59</sup> Fe	1.20E+08	1.95E+08	9.70E+07	0.00E+00	0.00E+00	5.64E+07	2.03E+08
<sup>57</sup> Co	0.00E+00	3.84E+06	7.78E+06	0.00E+00	0.00E+00	0.00E+00	3.15E+07
<sup>58</sup> Co	0.00E+00	1.21E+07	3.72E+07	0.00E+00	0.00E+00	0.00E+00	7.08E+07
<sup>60</sup> Co	0.00E+00	4.32E+07	1.27E+08	0.00E+00	0.00E+00	0.00E+00	2.39E+08
<sup>63</sup> Ni	2.97E+10	1.59E+09	1.01E+09	0.00E+00	0.00E+00	0.00E+00	1.07E+08
<sup>65</sup> Zn	4.14E+09	1.10E+10	6.86E+09	0.00E+00	6.95E+09	0.00E+00	1.94E+09
<sup>86</sup> Rb	0.00E+00	8.78E+09	5.40E+09	0.00E+00	0.00E+00	0.00E+00	5.65E+08
<sup>89</sup> Sr	6.63E+09	0.00E+00	1.89E+08	0.00E+00	0.00E+00	0.00E+00	2.57E+08
<sup>90</sup> Sr	1.12E+11	0.00E+00	2.84E+10	0.00E+00	0.00E+00	0.00E+00	1.51E+09
<sup>90</sup> Y	3.38E+03	0.00E+00	9.05E+01	0.00E+00	0.00E+00	0.00E+00	9.62E+06
<sup>91</sup> Y	3.91E+04	0.00E+00	1.04E+03	0.00E+00	0.00E+00	0.00E+00	5.20E+06
<sup>95</sup> Zr	3.84E+03	8.43E+02	7.51E+02	0.00E+00	1.21E+03	0.00E+00	8.80E+05
<sup>95</sup> Nb	3.72E+05	1.45E+05	1.03E+05	0.00E+00	1.36E+05	0.00E+00	2.68E+08
<sup>103</sup> Ru	4.29E+03	0.00E+00	1.65E+03	0.00E+00	1.08E+04	0.00E+00	1.11E+05
<sup>106</sup> Ru	9.25E+04	0.00E+00	1.15E+04	0.00E+00	1.25E+05	0.00E+00	1.44E+06
<sup>110m</sup> Ag	2.09E+08	1.41E+08	1.13E+08	0.00E+00	2.63E+08	0.00E+00	1.68E+10
<sup>109</sup> Cd	0.00E+00	3.86E+06	1.79E+05	0.00E+00	3.45E+06	0.00E+00	1.25E+07
<sup>113</sup> Sn	6.11E+08	1.26E+07	3.48E+07	9.29E+08	0.00E+00	0.00E+00	4.32E+08
<sup>124</sup> Sb	1.09E+08	1.41E+06	3.81E+07	2.40E+05	0.00E+00	6.03E+07	6.80E+08
<sup>125</sup> Sb	8.71E+07	6.72E+05	1.83E+07	8.07E+04	0.00E+00	4.86E+07	2.08E+08
<sup>127m</sup> Te	2.08E+08	5.61E+07	2.47E+07	4.98E+07	5.94E+08	0.00E+00	1.69E+08
<sup>129m</sup> Te	2.72E+08	7.59E+07	4.22E+07	8.76E+07	7.98E+08	0.00E+00	3.31E+08

**Table 6: Child Grass- Cow – Milk Pathway Dose Factors (R<sub>i</sub>)**

(m<sup>2</sup>mrem/yr) per (μCi/sec)

Nuclide	Bone	Liver	Total Body	Thyroid	Kidney	Lung	GI-LLI
<sup>130</sup> I	1.73E+06	3.50E+06	1.80E+06	3.85E+08	5.23E+06	0.00E+00	1.64E+06
<sup>131</sup> I	1.30E+09	1.31E+09	7.46E+08	4.34E+11	2.15E+09	0.00E+00	1.17E+08
<sup>132</sup> I	6.92E-01	1.27E+00	5.85E-01	5.90E+01	1.95E+00	0.00E+00	1.50E+00
<sup>133</sup> I	1.72E+07	2.13E+07	8.05E+06	3.95E+09	3.54E+07	0.00E+00	8.57E+06
<sup>134</sup> I	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
<sup>135</sup> I	5.41E+04	9.74E+04	4.61E+04	8.63E+06	1.49E+05	0.00E+00	7.42E+04
<sup>134</sup> Cs	2.27E+10	3.72E+10	7.84E+09	0.00E+00	1.15E+10	4.14E+09	2.00E+08
<sup>136</sup> Cs	1.01E+09	2.78E+09	1.80E+09	0.00E+00	1.48E+09	2.21E+08	9.78E+07
<sup>137</sup> Cs	3.23E+10	3.09E+10	4.56E+09	0.00E+00	1.01E+10	3.62E+09	1.93E+08
<sup>140</sup> Ba	1.17E+08	1.03E+05	6.84E+06	0.00E+00	3.34E+04	6.12E+04	5.94E+07
<sup>140</sup> La	1.78E+02	6.23E+01	2.10E+01	0.00E+00	0.00E+00	0.00E+00	1.74E+06
<sup>141</sup> Ce	2.19E+04	1.09E+04	1.62E+03	0.00E+00	4.79E+03	0.00E+00	1.36E+07
<sup>144</sup> Ce	1.62E+06	5.09E+05	8.67E+04	0.00E+00	2.82E+05	0.00E+00	1.33E+08
<sup>143</sup> Pr	7.19E+02	2.16E+02	3.57E+01	0.00E+00	1.17E+02	0.00E+00	7.76E+05
<sup>144</sup> Pr	5.04E+00	1.56E+00	2.53E-01	0.00E+00	8.24E-01	0.00E+00	3.35E+03
<sup>147</sup> Nd	4.45E+02	3.61E+02	2.79E+01	0.00E+00	1.98E+02	0.00E+00	5.71E+05
<sup>154</sup> Eu	9.43E+04	8.48E+03	7.75E+03	0.00E+00	3.73E+04	0.00E+00	1.97E+06
<sup>181</sup> Hf	6.44E+02	2.35E+03	2.91E+02	0.00E+00	4.76E+02	0.00E+00	8.66E+05

**Table 7: Child Grass- Goat – Milk Pathway Dose Factors (R<sub>i</sub>)**  
(m<sup>2</sup>mrem/yr) per (μCi/sec)

Nuclide	Bone	Liver	Total Body	Thyroid	Kidney	Lung	GI-LLI
<sup>3</sup> H	0.00E+00	3.20E+03	3.20E+03	3.20E+03	3.20E+03	3.20E+03	3.20E+03
<sup>7</sup> Be	9.00E+02	1.53E+03	9.84E+02	0.00E+00	1.50E+03	0.00E+00	8.55E+04
<sup>51</sup> Cr	0.00E+00	0.00E+00	1.22E+04	6.79E+03	1.85E+03	1.24E+04	6.48E+05
<sup>54</sup> Mn	0.00E+00	2.52E+06	6.71E+05	0.00E+00	7.06E+05	0.00E+00	2.11E+06
<sup>55</sup> Fe	1.45E+06	7.72E+05	2.39E+05	0.00E+00	0.00E+00	4.36E+05	1.43E+05
<sup>59</sup> Fe	1.56E+06	2.53E+06	1.26E+06	0.00E+00	0.00E+00	7.34E+05	2.64E+06
<sup>57</sup> Co	0.00E+00	4.61E+05	9.33E+05	0.00E+00	0.00E+00	0.00E+00	3.78E+06
<sup>58</sup> Co	0.00E+00	1.46E+06	4.46E+06	0.00E+00	0.00E+00	0.00E+00	8.50E+06
<sup>60</sup> Co	0.00E+00	5.19E+06	1.53E+07	0.00E+00	0.00E+00	0.00E+00	2.87E+07
<sup>63</sup> Ni	3.56E+09	1.91E+08	1.21E+08	0.00E+00	0.00E+00	0.00E+00	1.28E+07
<sup>65</sup> Zn	4.97E+08	1.32E+09	8.23E+08	0.00E+00	8.34E+08	0.00E+00	2.32E+08
<sup>86</sup> Rb	0.00E+00	1.05E+09	6.48E+08	0.00E+00	0.00E+00	0.00E+00	6.78E+07
<sup>89</sup> Sr	1.39E+10	0.00E+00	3.97E+08	0.00E+00	0.00E+00	0.00E+00	5.39E+08
<sup>90</sup> Sr	2.35E+11	0.00E+00	5.95E+10	0.00E+00	0.00E+00	0.00E+00	3.16E+09
<sup>90</sup> Y	4.06E+02	0.00E+00	1.09E+01	0.00E+00	0.00E+00	0.00E+00	1.15E+06
<sup>91</sup> Y	4.69E+03	0.00E+00	1.25E+02	0.00E+00	0.00E+00	0.00E+00	6.25E+05
<sup>95</sup> Zr	4.60E+02	1.01E+02	9.01E+01	0.00E+00	1.45E+02	0.00E+00	1.06E+05
<sup>95</sup> Nb	4.46E+04	1.74E+04	1.24E+04	0.00E+00	1.63E+04	0.00E+00	3.21E+07
<sup>103</sup> Ru	5.14E+02	0.00E+00	1.98E+02	0.00E+00	1.29E+03	0.00E+00	1.33E+04
<sup>106</sup> Ru	1.11E+04	0.00E+00	1.38E+03	0.00E+00	1.50E+04	0.00E+00	1.73E+05
<sup>110m</sup> Ag	2.51E+07	1.69E+07	1.35E+07	0.00E+00	3.15E+07	0.00E+00	2.01E+09
<sup>109</sup> Cd	0.00E+00	4.64E+05	2.15E+04	0.00E+00	4.14E+05	0.00E+00	1.50E+06
<sup>113</sup> Sn	7.33E+07	1.51E+06	4.18E+06	1.11E+08	0.00E+00	0.00E+00	5.18E+07
<sup>124</sup> Sb	1.30E+07	1.69E+05	4.57E+06	2.88E+04	0.00E+00	7.24E+06	8.16E+07
<sup>125</sup> Sb	1.05E+07	8.06E+04	2.19E+06	9.68E+03	0.00E+00	5.83E+06	2.50E+07
<sup>127m</sup> Te	2.50E+07	6.73E+06	2.97E+06	5.98E+06	7.13E+07	0.00E+00	2.02E+07
<sup>129m</sup> Te	3.26E+07	9.10E+06	5.06E+06	1.05E+07	9.57E+07	0.00E+00	3.98E+07

**Table 7: Child Grass- Goat – Milk Pathway Dose Factors (R<sub>i</sub>)**

(m<sup>2</sup>mrem/yr) per (μCi/sec)

Nuclide	Bone	Liver	Total Body	Thyroid	Kidney	Lung	GI-LLI
<sup>130</sup> I	2.08E+06	4.20E+06	2.16E+06	4.62E+08	6.27E+06	0.00E+00	1.96E+06
<sup>131</sup> I	1.57E+09	1.57E+09	8.95E+08	5.21E+11	2.58E+09	0.00E+00	1.40E+08
<sup>132</sup> I	8.30E-01	1.53E+00	7.02E-01	7.08E+01	2.34E+00	0.00E+00	1.80E+00
<sup>133</sup> I	2.06E+07	2.55E+07	9.66E+06	4.74E+09	4.25E+07	0.00E+00	1.03E+07
<sup>134</sup> I	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
<sup>135</sup> I	6.49E+04	1.17E+05	5.53E+04	1.04E+07	1.79E+05	0.00E+00	8.90E+04
<sup>134</sup> Cs	6.80E+10	1.12E+11	2.35E+10	0.00E+00	3.46E+10	1.24E+10	6.01E+08
<sup>136</sup> Cs	3.04E+09	8.35E+09	5.40E+09	0.00E+00	4.45E+09	6.63E+08	2.93E+08
<sup>137</sup> Cs	9.68E+10	9.27E+10	1.37E+10	0.00E+00	3.02E+10	1.09E+10	5.80E+08
<sup>140</sup> Ba	1.41E+07	1.23E+04	8.21E+05	0.00E+00	4.01E+03	7.35E+03	7.13E+06
<sup>140</sup> La	2.14E+01	7.47E+00	2.52E+00	0.00E+00	0.00E+00	0.00E+00	2.08E+05
<sup>141</sup> Ce	2.63E+03	1.31E+03	1.95E+02	0.00E+00	5.75E+02	0.00E+00	1.63E+06
<sup>144</sup> Ce	1.95E+05	6.11E+04	1.04E+04	0.00E+00	3.38E+04	0.00E+00	1.59E+07
<sup>143</sup> Pr	8.63E+01	2.59E+01	4.28E+00	0.00E+00	1.40E+01	0.00E+00	9.31E+04
<sup>144</sup> Pr	6.05E-01	1.87E-01	3.04E-02	0.00E+00	9.89E-02	0.00E+00	4.03E+02
<sup>147</sup> Nd	5.34E+01	4.33E+01	3.35E+00	0.00E+00	2.37E+01	0.00E+00	6.85E+04
<sup>154</sup> Eu	1.13E+04	1.02E+03	9.29E+02	0.00E+00	4.47E+03	0.00E+00	2.37E+05
<sup>181</sup> Hf	7.73E+01	2.81E+02	3.49E+01	0.00E+00	5.72E+01	0.00E+00	1.04E+05

**Table 8: Child Meat Pathway Dose Factors (R<sub>i</sub>)**  
(m<sup>2</sup>mrem/yr) per (μCi/sec)

Nuclide	Bone	Liver	Total Body	Thyroid	Kidney	Lung	GI-LLI
<sup>3</sup> H	0.00E+00	2.34E+02	2.34E+02	2.34E+02	2.34E+02	2.34E+02	2.34E+02
<sup>7</sup> Be	7.38E+03	1.26E+04	8.07E+03	0.00E+00	1.23E+04	0.00E+00	7.00E+05
<sup>51</sup> Cr	0.00E+00	0.00E+00	8.80E+03	4.88E+03	1.33E+03	8.92E+03	4.67E+05
<sup>54</sup> Mn	0.00E+00	8.02E+06	2.14E+06	0.00E+00	2.25E+06	0.00E+00	6.73E+06
<sup>55</sup> Fe	4.58E+08	2.43E+08	7.52E+07	0.00E+00	0.00E+00	1.37E+08	4.50E+07
<sup>59</sup> Fe	3.77E+08	6.10E+08	3.04E+08	0.00E+00	0.00E+00	1.77E+08	6.35E+08
<sup>57</sup> Co	0.00E+00	5.92E+06	1.20E+07	0.00E+00	0.00E+00	0.00E+00	4.85E+07
<sup>58</sup> Co	0.00E+00	1.64E+07	5.03E+07	0.00E+00	0.00E+00	0.00E+00	9.59E+07
<sup>60</sup> Co	0.00E+00	6.94E+07	2.05E+08	0.00E+00	0.00E+00	0.00E+00	3.84E+08
<sup>63</sup> Ni	2.92E+10	1.56E+09	9.92E+08	0.00E+00	0.00E+00	0.00E+00	1.05E+08
<sup>65</sup> Zn	3.76E+08	1.00E+09	6.23E+08	0.00E+00	6.31E+08	0.00E+00	1.76E+08
<sup>86</sup> Rb	0.00E+00	5.77E+08	3.55E+08	0.00E+00	0.00E+00	0.00E+00	3.71E+07
<sup>89</sup> Sr	4.82E+08	0.00E+00	1.38E+07	0.00E+00	0.00E+00	0.00E+00	1.87E+07
<sup>90</sup> Sr	1.04E+10	0.00E+00	2.64E+09	0.00E+00	0.00E+00	0.00E+00	1.40E+08
<sup>90</sup> Y	1.93E+05	0.00E+00	5.16E+03	0.00E+00	0.00E+00	0.00E+00	5.49E+08
<sup>91</sup> Y	1.80E+06	0.00E+00	4.82E+04	0.00E+00	0.00E+00	0.00E+00	2.40E+08
<sup>95</sup> Zr	2.67E+06	5.86E+05	5.22E+05	0.00E+00	8.39E+05	0.00E+00	6.11E+08
<sup>95</sup> Nb	4.26E+06	1.66E+06	1.18E+06	0.00E+00	1.56E+06	0.00E+00	3.07E+09
<sup>103</sup> Ru	1.55E+08	0.00E+00	5.96E+07	0.00E+00	3.90E+08	0.00E+00	4.01E+09
<sup>106</sup> Ru	4.44E+09	0.00E+00	5.54E+08	0.00E+00	6.00E+09	0.00E+00	6.91E+10
<sup>110m</sup> Ag	8.40E+06	5.67E+06	4.53E+06	0.00E+00	1.06E+07	0.00E+00	6.75E+08
<sup>109</sup> Cd	0.00E+00	1.91E+06	8.84E+04	0.00E+00	1.70E+06	0.00E+00	6.18E+06
<sup>113</sup> Sn	2.18E+09	4.48E+07	1.24E+08	3.31E+09	0.00E+00	0.00E+00	1.54E+09
<sup>124</sup> Sb	2.93E+07	3.80E+05	1.03E+07	6.46E+04	0.00E+00	1.62E+07	1.83E+08
<sup>125</sup> Sb	2.85E+07	2.20E+05	5.97E+06	2.64E+04	0.00E+00	1.59E+07	6.81E+07
<sup>127m</sup> Te	1.78E+09	4.78E+08	2.11E+08	4.25E+08	5.07E+09	0.00E+00	1.44E+09
<sup>129m</sup> Te	1.79E+09	5.00E+08	2.78E+08	5.78E+08	5.26E+09	0.00E+00	2.19E+09

**Table 8: Child Meat Pathway Dose Factors (R<sub>i</sub>)**

(m<sup>2</sup>mrem/yr) per (μCi/sec)

Nuclide	Bone	Liver	Total Body	Thyroid	Kidney	Lung	GI-LLI
<sup>130</sup> I	3.06E-06	6.18E-06	3.18E-06	6.80E-04	9.23E-06	0.00E+00	2.89E-06
<sup>131</sup> I	1.66E+07	1.67E+07	9.47E+06	5.51E+09	2.74E+07	0.00E+00	1.48E+06
<sup>132</sup> I	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
<sup>133</sup> I	5.70E-01	7.05E-01	2.67E-01	1.31E+02	1.17E+00	0.00E+00	2.84E-01
<sup>134</sup> I	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
<sup>135</sup> I	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
<sup>134</sup> Cs	9.23E+08	1.51E+09	3.20E+08	0.00E+00	4.69E+08	1.68E+08	8.17E+06
<sup>136</sup> Cs	1.62E+07	4.46E+07	2.89E+07	0.00E+00	2.38E+07	3.54E+06	1.57E+06
<sup>137</sup> Cs	1.33E+09	1.28E+09	1.89E+08	0.00E+00	4.16E+08	1.50E+08	8.00E+06
<sup>140</sup> Ba	4.39E+07	3.85E+04	2.56E+06	0.00E+00	1.25E+04	2.29E+04	2.22E+07
<sup>140</sup> La	3.33E+02	1.17E+02	3.93E+01	0.00E+00	0.00E+00	0.00E+00	3.25E+06
<sup>141</sup> Ce	2.22E+04	1.11E+04	1.65E+03	0.00E+00	4.86E+03	0.00E+00	1.38E+07
<sup>144</sup> Ce	2.32E+06	7.27E+05	1.24E+05	0.00E+00	4.02E+05	0.00E+00	1.89E+08
<sup>143</sup> Pr	3.34E+04	1.00E+04	1.66E+03	0.00E+00	5.43E+03	0.00E+00	3.61E+07
<sup>144</sup> Pr	5.63E+02	1.74E+02	2.83E+01	0.00E+00	9.21E+01	0.00E+00	3.75E+05
<sup>147</sup> Nd	1.17E+04	9.48E+03	7.34E+02	0.00E+00	5.20E+03	0.00E+00	1.50E+07
<sup>154</sup> Eu	1.12E+07	1.01E+06	9.20E+05	0.00E+00	4.43E+06	0.00E+00	2.34E+08
<sup>181</sup> Hf	4.77E+06	1.74E+07	2.15E+06	0.00E+00	3.53E+06	0.00E+00	6.41E+09

**Table 9: Child Vegetation Pathway Dose Factors (R<sub>i</sub>)**

(m<sup>2</sup>mrem/yr) per (μCi/sec)

Nuclide	Bone	Liver	Total Body	Thyroid	Kidney	Lung	GI-LLI
<sup>3</sup> H	0.00E+00	4.01E+03	4.01E+03	4.01E+03	4.01E+03	4.01E+03	4.01E+03
<sup>7</sup> Be	3.38E+05	5.76E+05	3.70E+05	0.00E+00	5.65E+05	0.00E+00	3.21E+07
<sup>51</sup> Cr	0.00E+00	0.00E+00	1.17E+05	6.50E+04	1.78E+04	1.19E+05	6.21E+06
<sup>54</sup> Mn	0.00E+00	6.65E+08	1.77E+08	0.00E+00	1.86E+08	0.00E+00	5.58E+08
<sup>55</sup> Fe	8.01E+08	4.25E+08	1.32E+08	0.00E+00	0.00E+00	2.40E+08	7.87E+07
<sup>59</sup> Fe	3.98E+08	6.43E+08	3.20E+08	0.00E+00	0.00E+00	1.87E+08	6.70E+08
<sup>57</sup> Co	0.00E+00	2.99E+07	6.04E+07	0.00E+00	0.00E+00	0.00E+00	2.45E+08
<sup>58</sup> Co	0.00E+00	6.44E+07	1.97E+08	0.00E+00	0.00E+00	0.00E+00	3.76E+08
<sup>60</sup> Co	0.00E+00	3.78E+08	1.12E+09	0.00E+00	0.00E+00	0.00E+00	2.10E+09
<sup>63</sup> Ni	3.95E+10	2.11E+09	1.34E+09	0.00E+00	0.00E+00	0.00E+00	1.42E+08
<sup>65</sup> Zn	8.13E+08	2.17E+09	1.35E+09	0.00E+00	1.36E+09	0.00E+00	3.80E+08
<sup>86</sup> Rb	0.00E+00	4.52E+08	2.78E+08	0.00E+00	0.00E+00	0.00E+00	2.91E+07
<sup>89</sup> Sr	3.60E+10	0.00E+00	1.03E+09	0.00E+00	0.00E+00	0.00E+00	1.39E+09
<sup>90</sup> Sr	1.24E+12	0.00E+00	3.15E+11	0.00E+00	0.00E+00	0.00E+00	1.67E+10
<sup>90</sup> Y	3.01E+06	0.00E+00	8.04E+04	0.00E+00	0.00E+00	0.00E+00	8.56E+09
<sup>91</sup> Y	1.86E+07	0.00E+00	4.99E+05	0.00E+00	0.00E+00	0.00E+00	2.48E+09
<sup>95</sup> Zr	3.86E+06	8.48E+05	7.55E+05	0.00E+00	1.21E+06	0.00E+00	8.85E+08
<sup>95</sup> Nb	7.48E+05	2.91E+05	2.08E+05	0.00E+00	2.74E+05	0.00E+00	5.39E+08
<sup>103</sup> Ru	1.53E+07	0.00E+00	5.90E+06	0.00E+00	3.86E+07	0.00E+00	3.97E+08
<sup>106</sup> Ru	7.45E+08	0.00E+00	9.30E+07	0.00E+00	1.01E+09	0.00E+00	1.16E+10
<sup>110m</sup> Ag	3.21E+07	2.17E+07	1.73E+07	0.00E+00	4.04E+07	0.00E+00	2.58E+09
<sup>109</sup> Cd	0.00E+00	2.45E+08	1.14E+07	0.00E+00	2.18E+08	0.00E+00	7.94E+08
<sup>113</sup> Sn	1.58E+09	3.25E+07	9.00E+07	2.40E+09	0.00E+00	0.00E+00	1.12E+09
<sup>124</sup> Sb	3.52E+08	4.57E+06	1.23E+08	7.77E+05	0.00E+00	1.95E+08	2.20E+09
<sup>125</sup> Sb	4.99E+08	3.85E+06	1.05E+08	4.63E+05	0.00E+00	2.78E+08	1.19E+09
<sup>127m</sup> Te	1.32E+09	3.56E+08	1.57E+08	3.16E+08	3.77E+09	0.00E+00	1.07E+09
<sup>129m</sup> Te	8.41E+08	2.35E+08	1.31E+08	2.71E+08	2.47E+09	0.00E+00	1.03E+09

**Table 9: Child Vegetation Pathway Dose Factors (R<sub>i</sub>)**

(m<sup>2</sup>mrem/yr) per (μCi/sec)

Nuclide	Bone	Liver	Total Body	Thyroid	Kidney	Lung	GI-LLI
<sup>130</sup> I	6.16E+05	1.24E+06	6.41E+05	1.37E+08	1.86E+06	0.00E+00	5.82E+05
<sup>131</sup> I	1.43E+08	1.44E+08	8.17E+07	4.76E+10	2.36E+08	0.00E+00	1.28E+07
<sup>132</sup> I	9.23E+01	1.70E+02	7.80E+01	7.87E+03	2.60E+02	0.00E+00	2.00E+02
<sup>133</sup> I	3.53E+06	4.37E+06	1.65E+06	8.12E+08	7.28E+06	0.00E+00	1.76E+06
<sup>134</sup> I	1.56E-04	2.89E-04	1.33E-04	6.65E-03	4.42E-04	0.00E+00	1.92E-04
<sup>135</sup> I	6.26E+04	1.13E+05	5.33E+04	9.98E+06	1.73E+05	0.00E+00	8.59E+04
<sup>134</sup> Cs	1.60E+10	2.63E+10	5.55E+09	0.00E+00	8.15E+09	2.93E+09	1.42E+08
<sup>136</sup> Cs	8.24E+07	2.27E+08	1.47E+08	0.00E+00	1.21E+08	1.80E+07	7.96E+06
<sup>137</sup> Cs	2.39E+10	2.29E+10	3.38E+09	0.00E+00	7.46E+09	2.68E+09	1.43E+08
<sup>140</sup> Ba	2.77E+08	2.43E+05	1.62E+07	0.00E+00	7.90E+04	1.45E+05	1.40E+08
<sup>140</sup> La	3.36E+04	1.18E+04	3.96E+03	0.00E+00	0.00E+00	0.00E+00	3.28E+08
<sup>141</sup> Ce	6.56E+05	3.27E+05	4.86E+04	0.00E+00	1.43E+05	0.00E+00	4.08E+08
<sup>144</sup> Ce	1.27E+08	3.98E+07	6.78E+06	0.00E+00	2.21E+07	0.00E+00	1.04E+10
<sup>143</sup> Pr	1.46E+05	4.37E+04	7.23E+03	0.00E+00	2.37E+04	0.00E+00	1.57E+08
<sup>144</sup> Pr	7.88E+03	2.44E+03	3.97E+02	0.00E+00	1.29E+03	0.00E+00	5.25E+06
<sup>147</sup> Nd	7.15E+04	5.79E+04	4.48E+03	0.00E+00	3.18E+04	0.00E+00	9.17E+07
<sup>154</sup> Eu	1.66E+08	1.50E+07	1.37E+07	0.00E+00	6.57E+07	0.00E+00	3.48E+09
<sup>181</sup> Hf	4.90E+05	1.79E+06	2.21E+05	0.00E+00	3.63E+05	0.00E+00	6.59E+08

Table 10: Highest Annual Average Atmospheric Dispersion Parameters

Location <sup>(b)</sup>	Meteorological Sector	Distance (meters)	X/Q Undepleted/ undepleted (sec/m <sup>3</sup> )	X/Q Decayed/ Undepleted (sec/m <sup>3</sup> )	X/Q Decayed/ Depleted (sec/m <sup>3</sup> )	D/Q (m <sup>-2</sup> )
Site Boundary <sup>64</sup>	SSW	1400	1.8E-6	1.7E-6	1.6E-6	4.5E-9
Nearest Residence <sup>65,66</sup>	NNW	2900	1.1E-6	1.0E-6	9.0E-7	3.0E-9
Farming Areas within the Site Boundary <sup>67,68</sup>	N/A	N/A	1.6E-6	1.6E-6	1.4E-6	5.5E-9

<sup>64</sup> Dispersion parameters from HPCI 1503

<sup>65</sup> Dispersion parameters from HPCI 1504

<sup>66</sup> All ingestion dose pathways are assumed to exist at the location of the nearest resident

<sup>67</sup> Dispersion parameters from HPCI 1502

<sup>68</sup> These values were derived for a narrow scope application. Extreme caution should be exercised when determining their suitability for use in other applications

**Table 11: Application of Atmospheric Dispersion Parameters for Release Permits**

Dose Pathway	Dispersion Parameter	Controlling Age Group	REC	Controlling Location
Noble Gas, Beta Air & Gamma Air	X/Q, decayed/undepleted (2.26 day half-life)	N/A	16.11.2.2	Site Boundary
	X/Q, decayed/undepleted (2.26 day half-life)	N/A	16.11.2.1	Site Boundary
Noble Gas, Total Body & Skin	X/Q, decayed/undepleted (2.26 day half-life)	N/A	16.11.2.1	Site Boundary
	X/Q, decayed/depleted (8 day half-life)	Child	16.11.2.1 16.11.2.3	Nearest Resident Site Boundary
Ground Plane Deposition	D/Q	N/A	16.11.2.3	Nearest Resident
Ingestion pathways	D/Q*	Child	16.11.2.3	Nearest Resident

\*For <sup>3</sup>H, X/Q decayed/depleted is used instead of D/Q.<sup>69</sup>

<sup>69</sup> Regulatory Guide 1.109, Appendix C, Section 3.a

**Table 12: Application of Atmospheric Dispersion Parameters Annual Radioactive Effluent Release Report**

Dose Pathway	Dispersion Parameter	Controlling Age Group	Dispersion Values <sup>70</sup>	Controlling Location
Noble Gas, Beta Air & Gamma Air Dose	X/Q, decayed/undepleted (2.26 day half-life)	N/A	Concurrent	Site Boundary
				Nearest Resident
Noble Gas, Total Body & Skin Dose	X/Q, decayed/undepleted (2.26 day half-life)	N/A	Concurrent	Site Boundary
				Nearest Resident
Ground Plane Deposition Dose	D/Q	N/A	Concurrent	Inside Site Boundary
				Historical
Inhalation Dose	X/Q, decayed/depleted (8 day half-life)	Child	Concurrent	Site Boundary
				Nearest Resident
Ingestion Dose Pathways	D/Q (For H <sup>3</sup> , X/Q, decayed/depleted is used instead of D/Q.) <sup>71</sup>	Adult	Concurrent	Nearest Residence
				Historical
<sup>14</sup> C All Dose Pathways <sup>72</sup>	X/Q, undecayed/undepleted	Child	Concurrent	Site Boundary
				Nearest Resident
		Adult	Historical	Nearest Resident
				Inside Site Boundary

<sup>70</sup> Historical, i.e., 5 year average, dispersion parameters for activities inside the Site Boundary are provided in Table 10.

<sup>71</sup> Regulatory Guide 1.109, Appendix C, Section 3.a

<sup>72</sup> See Appendix A

**Table 13: Meteorological Data Selection Hierarchy**

<b>Parameter</b>	<b>Primary</b>	<b>First Alternate</b>	<b>Second Alternate</b>	<b>Third Alternate</b>
Wind Speed	10m A	10m B	60m A	60m B
Wind Direction	10m A	10m B	60m A	60m B
Air Temperature	10m A	10m B		
Wind Variability	10m A	10m B	60m A	60m B
Temp Difference	60-10m A	60-10m B		
Dew point/Relative Humidity	10m A	60m B		
Precipitation	1m			

(a) 'A' indicates Alpha train meteorological instrumentation.

(b) 'B' indicates Bravo train meteorological instrumentation.

## Appendix A: Methodology for Calculating Dose from $^{14}\text{C}$ in Gaseous Effluents

### 1) Introduction

The purpose of this Appendix is to provide methodology and parameters for calculating (1) the quantity of  $^{14}\text{C}$  released in gaseous effluents, (2) the dose to the Member of the Public at the nearest receptor location due to  $^{14}\text{C}$  released in gaseous effluents, and (3) the dose from  $^{14}\text{C}$  released in gaseous effluents to the Member of the Public due to activities within the Site Boundary.

The quantity of  $^{14}\text{C}$  discharged can be estimated<sup>73</sup> by sample measurements, or by use of a normalized  $^{14}\text{C}$  source term and scaling factors based on power generation,<sup>74</sup> or by use of the GALE code,<sup>75</sup> or by use of the EPRI site specific or proxy methodologies.<sup>76</sup> *Any of these methodologies is acceptable for estimating the  $^{14}\text{C}$  discharged in gaseous effluents.*

### 2) Assumptions

- a. The total quantity of  $^{14}\text{C}$  produced during the year is assumed to be released during the year in which it was produced.
- b. The quantity of  $^{14}\text{C}$  produced is determined using the methodology in EPRI TR-1021106.
- c. For conservatism, it is assumed that all  $^{14}\text{C}$  produced is released in gaseous effluents.
- d. The dose contribution of  $^{14}\text{C}$  from liquid effluents is much less than that contributed by gaseous effluents, therefore evaluation of  $^{14}\text{C}$  in liquid effluents is not required.<sup>77</sup>
- e. The dose to the Member of the Public is determined in accordance with the methodology and parameters in Regulatory Guide 1.109.
- f.  $^{14}\text{C}$  has a long half- life with respect to the plume transit time.  $^{14}\text{C}$  is discharged as  $\text{CH}_4$  or  $\text{CO}_2$  gas and does not deplete or undergo chemical change before it reaches the receptor location. Therefore the appropriate dispersion parameter is X/Q (undecayed and undepleted).

---

<sup>73</sup> Regulatory Guide 1.21, rev. 2, Section 1.9

<sup>74</sup> NCRP Report 81

<sup>75</sup> NUREG- 0017

<sup>76</sup> EPRI TR-1021106, Section 4.

<sup>77</sup> Regulatory Guide 1.21, rev. 2, Section 1.9

- g. The inhalation pathway is assumed to exist at the Nearest Residence location with the highest value of X/Q, undecayed/ undepleted as determined by the annual Land Use Census.
- h. The ingestion pathways are assumed to exist at the nearest receptor location with the highest value of X/Q, undecayed/ undepleted as determined by the annual Land Use Census. For conservatism, the Nearest Residence location may be considered the highest nearest receptor location for the ingestion pathways.
- i. The appropriate dispersion parameters for activities within the Site Boundary is provided in Table 10.
- j.  $^{14}\text{C}$  is not a gamma- emitting nuclide; therefore the ground plane pathway is negligible.
- k. As a first approximation, it is assumed that the child age group exists at the Nearest Residence and ingestion pathway locations.
- l. Only  $^{14}\text{CO}_2$  discharged during periods of photosynthesis is considered for the ingestion pathways.
- m. All of the  $^{14}\text{C}$  produced is assumed to contribute to the inhalation dose pathway, regardless of chemical form.

### 3) Applicable Dose Limits

10 CFR 50, Appendix I, states, "The calculated annual total quantity of all radioactive iodine and radioactive material in particulate form above background to be released from each light-water-cooled nuclear power reactor in effluents to the atmosphere will not result in an estimated annual dose or dose commitment from such *radioactive iodine and radioactive material in particulate form* for any individual in an unrestricted area from all pathways of exposure in excess of 15 millirems to any organ."<sup>78</sup> Radiological Effluent Control (REC) 16.11.2.3 limits the annual dose to the Member of the Public from  $^{131}\text{I}$ ,  $^{133}\text{I}$ ,  $^3\text{H}$ , and *particulates* with half-lives greater than 8 days released in gaseous effluents to 15 mrem to any organ.<sup>79</sup>  $^{14}\text{C}$  is released as a gas in the form of  $\text{CH}_4$  or  $\text{CO}_2$  and is not a radioiodine, tritium, or particulate, therefore the design objectives in 10 CFR 50, Appendix I and the limits of REC 16.11.2.3 do not apply to  $^{14}\text{C}$ .

10 CFR 20.1301(a)(1) limits the annual TEDE dose to the Member of the Public to 100 mrem.

---

<sup>78</sup> 10 CFR 50, Appendix I, section II, paragraph C

<sup>79</sup> NUREG-1301, REC 3.11.2.3

40 CFR 190.10(a) limits the total annual dose from the uranium fuel cycle to the Member of the Public to 25 mrem to the whole body or any organ. 40 CFR 190 is implemented by REC 16.11.3.1. This limit includes dose from the release of gaseous effluents to areas at or beyond the Site Boundary, the dose from gaseous effluents due to activities within the Site Boundary, and the dose from direct radiation. The methodology for calculating the total annual dose from the uranium fuel cycle is provided in Section 4.

10 CFR 72.104 requires that the annual dose equivalent to any real individual who is located beyond the controlled area must not exceed 25 mrem to the whole body, 75 mrem to the thyroid and 25 mrem to any other critical organ as a result of exposure to planned discharges of radioactive materials and direct radiation from Independent Spent Fuel Storage Installation (ISFSI) operations. There are no radioactive effluents from the ISFSI. The HI-STORM UMAX Canister Storage System does not create any radioactive materials or have any radioactive waste treatment systems. COC Specification 3.1.1, "Multi-Purpose Canister (MPC)", provides assurance that there are no radioactive effluents from the ISFSI.<sup>80</sup>  $^{14}\text{C}$  is a weak beta emitter and does not contribute to direct radiation dose.

#### 4) Estimation of $^{14}\text{C}$ in Gaseous Effluents

$^{14}\text{C}$  exists in all PWR systems, and any location or system that contains tritium most likely also will contain  $^{14}\text{C}$  in some chemical form. Measurements of  $^{14}\text{C}$  concentrations in various liquid systems have been performed, and some of the reported data are included in EPRI TR-1021106.<sup>81</sup> As a general rule,  $^{14}\text{C}$  in the primary coolant is essentially all organic with a significant fraction as a gaseous species. If the RCS liquid or gas is exposed to an oxidizing environment, such as during the forced oxidation during the shutdown evolution and during refueling outages, a slow transformation from an organic to an inorganic chemical form can occur.

Dissolved nitrogen gas and ammonia in the RCS could contribute to the  $^{14}\text{C}$  source term. The dissolved nitrogen could become significant in the latter stages of the fuel cycle due to the introduction of increased quantities of non-borated water for boron dilution. Callaway maintains a hydrogen gas overpressure on the RCS which effectively eliminates dissolved nitrogen gas and ammonia in the RCS, therefore the RCS ammonia concentration is assumed to be 0.<sup>82</sup>

In general,  $^{14}\text{C}$  is produced in light water moderated nuclear power reactors by  $^{14}\text{N}(n,p)^{14}\text{C}$  reactions with nitrogen impurities in the coolant and by  $^{17}\text{O}(n,\alpha)^{14}\text{C}$  reactions in the coolant.  $^{14}\text{C}$  produced in a nuclear power reactor can be released directly to the environment from the coolant in a gaseous form or in much smaller quantities as liquid

<sup>80</sup> Certificate of Compliance No. 1040, Appendix A, Specification 5.1.

<sup>81</sup> EPRI TR-1021106, Section 4.1

<sup>82</sup> CDP-ZZ-00200, Appendix B, Table 1.1, "Reactor Coolant System-MODES 1, 2, 3, and 4", page 6 of 23

effluents.<sup>83</sup> Kunz estimated the fraction of  $^{14}\text{C}$  in liquid and solid wastes at <5% of that in gaseous discharges<sup>84</sup>. Regulatory Guide 1.21 states that the dose contribution from  $^{14}\text{C}$  in liquid discharges is insignificant and evaluation of  $^{14}\text{C}$  released in liquid effluents is not required.<sup>85</sup>

The release and removal pathways from the primary coolant include VCT venting, boron dilution, inventory buildup on the letdown demineralizers and filters, and reactor coolant leakage. Letdown system removal is approximately 1 Ci/yr.<sup>86</sup> The  $^{14}\text{C}$  production balance is shown in Figure 1.

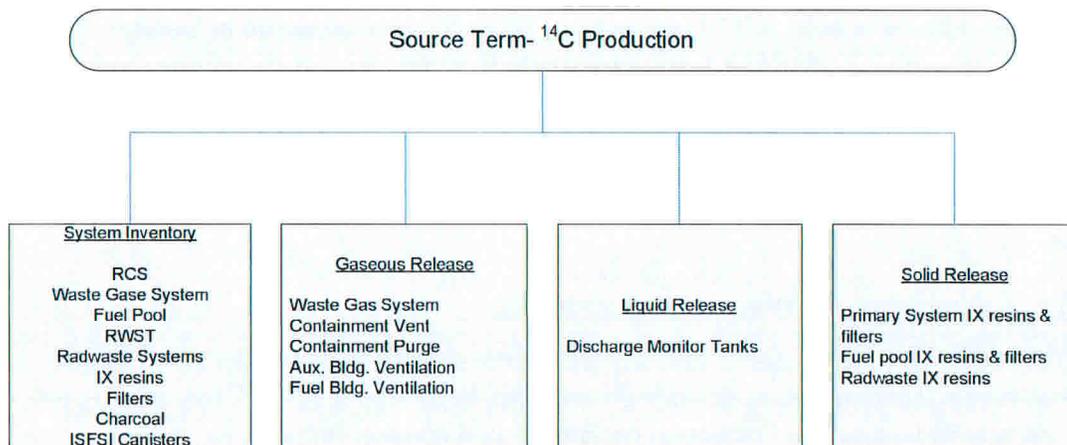


Figure 1:  $^{14}\text{C}$  Production Balance

### 5) Chemical Form of $^{14}\text{C}$ in Gaseous Effluents

Since the PWR operates with a reducing chemical environment, most, if not all, of the  $^{14}\text{C}$  species initially produced are in the reduced, i.e., organic, form and contain only a single carbon atom. Possible species include methane ( $^{14}\text{CH}_4$ ), methanol ( $^{14}\text{CH}_3\text{OH}$ ), formaldehyde ( $\text{H}_2^{14}\text{C}=\text{O}$  or the *gem*-diol  $\text{H}_2^{14}\text{C}(\text{OH})_2$ ), and formic acid ( $\text{H}^{14}\text{COOH}$ ). In theory, the only ionic species produced will be formic acid ( $\text{H}^{14}\text{CO}_2\text{H}$ ), and some or all of the formic acid will be removed by the letdown demineralizers. Formaldehyde is soluble in water and may partially be chemisorbed on the ion exchange resin. A quasi-equilibrium is established in the coolant between the initially produced species and other possible species in the reactor coolant. The most chemically reduced species and probably the most prevalent species is  $^{14}\text{CH}_4$  which partitions between the liquid and gas phases in the VCT and pressurizer.<sup>87</sup> The airborne  $^{14}\text{C}$  released from PWRs is predominantly hydrocarbons (75–95%), mainly methane ( $\text{CH}_4$ ), with only a small fraction

<sup>83</sup> IAEA Report 421, Section 3.1.3

<sup>84</sup> Kunz, 1985

<sup>85</sup> Regulatory Guide 1.21, rev. 2, section 1.09

<sup>86</sup> EPRI TR-1021106, Section 4.1

<sup>87</sup> EPRI TR-1021106, Section 4.1

in the form of CO<sub>2</sub>.<sup>88,89</sup> Regulatory Guide 1.21 states that <sup>14</sup>C releases in PWRs occur primarily as a mix of organic carbon and CO<sub>2</sub> in gaseous waste from the waste gas system.<sup>90</sup> NUREG-0017<sup>91</sup> concludes that 16.4% of the <sup>14</sup>C produced in a PWR will be released via the waste gas processing system, and the remainder, 83.6%, from the Reactor Building and the Auxiliary Building.

Due to the presence of high temperature hydrogen recombiners in the Callaway waste gas system, 100% of the <sup>14</sup>C released through the waste gas system is assumed to be released from the waste gas decay tanks in the oxidized, i.e., inorganic form as CO<sub>2</sub>. The <sup>14</sup>C released from the unit vent is assumed to be in the reduced (organic) form as CH<sub>4</sub>, therefore 16.4% of the <sup>14</sup>C produced is released through the Waste Gas Decay tanks (WGDT) as CO<sub>2</sub>, and 83.6% is released via the Unit Vent as CH<sub>4</sub>.

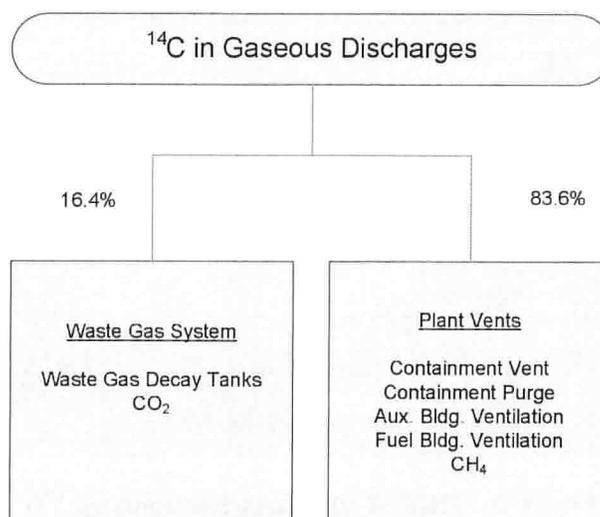


Figure 2: <sup>14</sup>C Gaseous Discharge Balance

6) <sup>14</sup>C Source Term Estimation

The neutron absorption cross section for the <sup>17</sup>O(n,α)<sup>14</sup>C reaction is shown in Figure 3. The <sup>17</sup>O(n,α)<sup>14</sup>C reaction has a 1/v region and a significant high energy neutron cross section. Given a constant neutron flux and target concentration, the rate of production of a species, N<sub>a</sub>, in atoms per second is given by:

$$N_a = N_T \cdot \{(\sigma_t \cdot \phi_t) + (\sigma_e \cdot \phi_e) + (\sigma_f \cdot \phi_f)\}$$

Where:

N<sub>a</sub> is the rate of production, atoms/sec

<sup>88</sup> IAEA Report 421, Section 3.1.3

<sup>89</sup> Neeb, section 4.2.4

<sup>90</sup> Regulatory Guide 1.21, rev. 2, section 1.09

<sup>91</sup> NUREG-0017, Section 2.2.25.2

- $NT$  is the number of  $^{17}\text{O}$  or  $^{14}\text{N}$  target atoms per kg of coolant
- $\sigma_t$  is the effective neutron cross section for thermal neutron absorption,  $\text{cm}^2$
- $\phi_t$  is the thermal neutron flux,  $\text{n/cm}^2\text{-sec}$
- $\sigma_e$  is the effective neutron cross section for epithermal energy neutron absorption,  $\text{cm}^2$
- $\phi_e$  is the epithermal neutron flux,  $\text{n/cm}^2\text{-sec}$
- $\sigma_f$  is the effective neutron cross section for fast neutron absorption,  $\text{cm}^2$
- $\phi_f$  is the fast neutron flux,  $\text{n/cm}^2\text{-sec}$

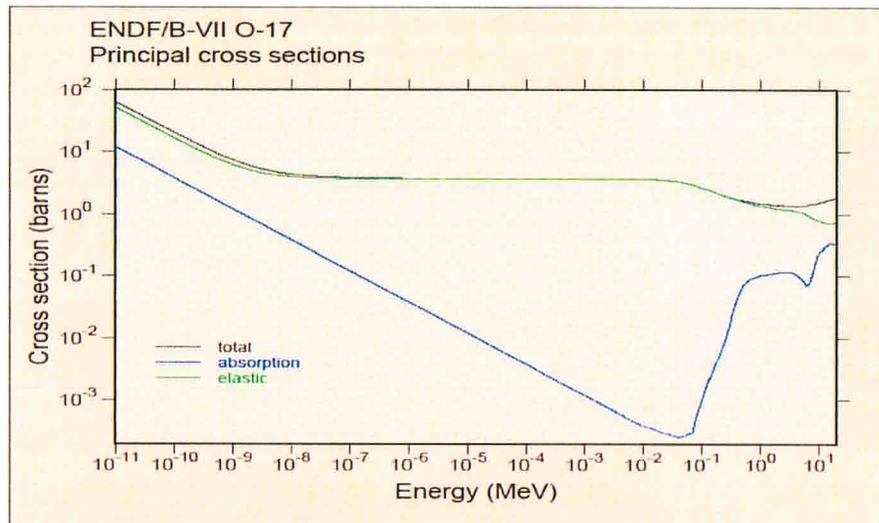


Figure 3: ENDF/B VII Cross Sections for  $^{17}\text{O}$

Table 14: Effective Cross Section for the  $^{17}\text{O}(n,\alpha)^{14}\text{C}$  Reaction in the PWR as a Function of Neutron Energy<sup>92</sup>

Neutron Group	Group Energy	Effective Cross Section
Thermal	$\leq 0.625$ eV	0.121 barns
Epithermal (E)	$> 0.625$ eV - $< 1$ MeV	0.0291 barns
Fast (F)	$\geq 1$ MeV	0.1124 barns

The source term of each species  $A_i$ , is given by:

$$A_a \text{ (dps)} = N_a \cdot \lambda_a$$

<sup>92</sup> EPRI TR-1021106, Section 4.3.2.2

$$A_a (\mu\text{Ci}) = \frac{N_a \cdot \lambda_a}{3.7E4}$$

Where  $A_a$  is the activity of species a,  $N_a$  is the number of atoms of species a,  $\lambda_a$  is the decay constant of species a, in seconds. The  $^{14}\text{C}$  production rate from the  $^{17}\text{O}(n,\alpha)^{14}\text{C}$  reaction is calculated for the three group flux distribution according to:<sup>93</sup>

$$^{14}\text{C production rate} = \frac{(1E-24 \cdot \lambda \cdot N \cdot \{(\sigma_t \phi_t) + (\sigma_e \phi_e) + (\sigma_f \phi_f)\})}{3.7E4}$$

Where:

**$^{14}\text{C Production rate}$**  is  $^{14}\text{C}$  rate of production,  $\mu\text{Ci}/\text{sec} \cdot \text{kg}$

**$N$**  is the number of target atoms per unit mass of coolant ( $1.27E22$  atoms  $^{17}\text{O}/\text{kg}$   $\text{H}_2\text{O}$ );

**$\sigma_t$**  is the effective neutron cross section for thermal neutron absorption, in barns;

**$\phi_t$**  is the thermal neutron flux,  $\text{n}/\text{cm}^2\text{-sec}$ ;

**$\sigma_e$**  is the effective neutron cross section for epithermal energy neutron absorption, in barns;

**$\phi_e$**  is the epithermal neutron flux,  $\text{n}/\text{cm}^2\text{-sec}$ ;

**$\sigma_f$**  is the effective neutron cross section for fast neutron absorption, in barns;

**$\phi_f$**  is the fast neutron flux,  $\text{n}/\text{cm}^2\text{-sec}$ ;

**$1.0E-24$**  is a units conversion factor,  $1.0E-24 \text{ cm}^2/\text{barn}$ ;

**$\lambda$**  is the  $^{14}\text{C}$  decay constant,  $3.833E-12/\text{sec}$ ; and

**$3.7E4$**  is a units conversion factor,  $3.7E4 \text{ d}/(\text{sec} \cdot \mu\text{Ci})$ .

The activity of  $^{14}\text{C}$  produced is thus the product of the production rate, the coolant mass in the active core region, and time:

$$A_C = \text{Production rate} \cdot \text{coolant mass} \cdot \text{time}$$

Where:

**$A_C$**  is the activity of  $^{14}\text{C}$  produced, in  $\mu\text{Ci}$ ;

The ***coolant mass*** is the mass of water in the active core region, in kg, corrected for core average temperature and pressure;

The ***time*** is the time period of reactor operation, in sec;

The Callaway reactor is a Westinghouse Model F, four loop Pressurized Water Reactor (PWR) rated at  $3565 \text{ MW}_{\text{th}}$ . The fuel is Westinghouse Vantage+ OFA with 193 fuel

<sup>93</sup> EPRI TR-1021106, Section 4.3.2.1

assemblies. The mass of coolant in the active core region is 12,925 kg.<sup>94</sup> The hydrogen gas overpressure in the Volume Control Tank (VCT) effectively eliminates N<sub>2</sub> and NH<sub>3</sub> in the RCS, therefore <sup>14</sup>C production from the <sup>14</sup>N(n,p)<sup>14</sup>C reaction is insignificant.

The core average neutron flux, the Effective Full Power Years (EFPY), and the fuel burnup are specific to the reactor operation for the period.

### 7) Inhalation Dose at the Nearest Residence Location from <sup>14</sup>C

The child age group is the critical age group for an airborne release of <sup>14</sup>C due to higher inhalation dose factors and higher ingestion dose factors.<sup>95</sup> The inhalation dose for the child age group, *D*, is calculated according to the expression<sup>96</sup>:

$$D_j = 3.17E4 \cdot R_a \cdot DFA_j \cdot Q_i \cdot X/Q$$

Where:

*D* is the dose in mrem, to a member of the public from <sup>14</sup>C, from the inhalation pathway, received by organ *j*;

**3.17 E4** is the number of pCi/Ci divided by the number of sec/yr;

*R<sub>a</sub>* is the breathing rate for the child age group (3700 m<sup>3</sup>/yr);<sup>97</sup>

*DFA<sub>j</sub>* is the <sup>14</sup>C inhalation pathway dose factor for organ *j*, appropriate to the child age group (mrem/pCi). For <sup>14</sup>C, the limiting organ is the bone. The *DFA<sub>bone</sub>* for the child age group is 9.70E-6 mrem/pCi, and the *DFA<sub>total body</sub>* for the child age group is 1.82E-6;<sup>98</sup>

*Q<sub>i</sub>* is the quantity of <sup>14</sup>C produced during the year (Ci/yr); and

*X/Q* is the highest calculated annual average concentration at the nearest receptor location (sec/m<sup>3</sup>).

The inhalation dose to the bone for the child age group at the Nearest Residence location is:

$$D_{bone} = 1138 \cdot Q_i \cdot X/Q$$

The inhalation dose to the total body for the child age group at the Nearest Residence location is:

$$D_{total\ body} = 213 \cdot Q_i \cdot X/Q$$

<sup>94</sup> Westinghouse Calculation Note CN-TA-02-135, "Callaway (SCP) RSG IGOR/RETRAN Base Deck", May 16, 2003

<sup>95</sup> Regulatory Guide 1.109, Table E-9, and Table E-13

<sup>96</sup> Regulatory Guide 1.109, equations C-3 and C-4.

<sup>97</sup> Regulatory Guide 1.109, Table E-5

<sup>98</sup> Regulatory Guide 1.109, Table E-9.

### 8) Dose from $^{14}\text{C}$ in Fresh Leafy Vegetation

The concentration of  $^{14}\text{C}$  in leafy vegetation is calculated by assuming that the  $^{14}\text{C}$  ratio to the natural carbon in the vegetation is the same as the ratio of  $^{14}\text{C}$  to natural carbon in the atmosphere surrounding the vegetation.<sup>99</sup>

Only  $^{14}\text{C}$  released in the oxide form ( $\text{CO}$  or  $\text{CO}_2$ ) is incorporated into the plant material.<sup>100</sup> All  $^{14}\text{C}$  released from the waste gas decay tanks is assumed to be in the organic form, as  $\text{CO}_2$ . The inorganic form, e.g.,  $\text{CH}_4$ , is not incorporated into plant material, therefore, only the organic form, e.g.,  $\text{CO}_2$  contributes to the ingestion dose pathway.  $^{14}\text{CO}_2$  released outside the growing season or at night is not incorporated into plant material and does not contribute to the dose from the ingestion pathway.  $^{14}\text{CO}_2$  released during the growing season in the daytime is assumed to be incorporated into the plant material and contributes to the ingestion dose pathway. The growing season in mid- Missouri is approximately April 1- November 1.<sup>101</sup>

The concentration of  $^{14}\text{C}$  in leafy vegetation is given by:<sup>102</sup>

$$\text{Conc}_v = \frac{3.17\text{E}7 \cdot Q_i \cdot X/Q \cdot 0.11}{0.16}$$

Where:

**Conc<sub>v</sub>** is the concentration of  $^{14}\text{C}$  in leafy vegetation grown at the nearest receptor location (pCi/kg);

**3.17E7** is equal to  $(1\text{E}12\text{pCi/C})(1\text{E}3\text{g/kg})/(3.15\text{E}7 \text{ sec/yr})$ ;

**Q<sub>i</sub>** is the quantity of  $^{14}\text{C}$  released as  $\text{CO}_2$  during periods of photosynthesis (Ci/yr);

**X/Q** is the highest calculated annual average concentration at the nearest receptor location ( $\text{sec/m}^3$ );

**0.11** is the fraction of total plant mass that is natural carbon, dimensionless; and

**0.16** is the concentration of natural carbon in the atmosphere ( $\text{g/m}^3$ ).

Substitution of constants yields:

$$\text{Conc}_v = 2.2\text{E}7 \cdot Q_i \cdot X/Q$$

The leafy vegetation ingestion dose for the Child age group at the nearest receptor location is given by:<sup>103</sup>

$$D = \text{DFI} \cdot f_i \cdot U_a \cdot \text{Conc}_v$$

<sup>99</sup> Regulatory Guide 1.109, Appendix C

<sup>100</sup> Regulatory Guide 1.109, Appendix C

<sup>101</sup> Hammer, G. R.

<sup>102</sup> Regulatory Guide 1.109, equation C-8

<sup>103</sup> Regulatory Guide 1.109, equation C-13

Where:

**D** is the annual dose to the bone or total body for the child age group from ingestion of fresh leafy vegetation, (mrem/yr);

**DFI** is the ingestion dose conversion factor for the maximum exposed organ. For the child age group, the bone is the maximum exposed organ. The **DFI<sub>bone</sub>** is 1.21E-5 mrem/pCi ingested and the **DFI<sub>total body</sub>** is 2.42E-6 mrem/pCi ingested;<sup>104</sup>

**f<sub>i</sub>** is the fraction of leafy vegetation grown in the garden at the nearest receptor location.  $f_i = 1.0$ ;<sup>105</sup> and

**U<sub>a</sub>** is the ingestion rate of leafy vegetation. For the child age group,  $U_a = 26$  kg/yr.<sup>106</sup>

### 9) Dose from <sup>14</sup>C in Milk

The concentration of <sup>14</sup>C in milk is determined as<sup>107</sup>:

$$Conc_{milk} = F_m \cdot Conc_v \cdot Q_F \cdot e^{-\lambda t_f}$$

Where:

**Conc<sub>milk</sub>** is the concentration of <sup>14</sup>C in milk, in pCi/L;

**F<sub>m</sub>** is the average fraction of the animal's daily intake of <sup>14</sup>C which appears in each liter of milk, in days/L. For cow milk,  $F_m$  is 1.2E-2 days/L.<sup>108</sup> For goat milk,  $F_m$  is 0.10 days/L;<sup>109</sup>

**Conc<sub>v</sub>** is the concentration of <sup>14</sup>C in leafy vegetation grown at the receptor location (pCi/kg), as described above;

**Q<sub>F</sub>** is the amount of feed consumed by the animal per day, in kg/day. For cows,  $Q_F$  is equal to 50 kg/day and for goats  $Q_F$  is equal to 6 kg/day;<sup>110</sup>

**t<sub>f</sub>** is the average transport time of the <sup>14</sup>C from the feed into the milk and to the receptor (a value of 2 days is assumed): and

**λ** is the radiological decay constant for <sup>14</sup>C, 3.32E-7 days<sup>-1</sup>.

The dose from <sup>14</sup>C in milk is determined as:

$$D = DFI \cdot U_a \cdot Conc_{milk}$$

Where:

<sup>104</sup> Regulatory Guide 1.109, Table E-13

<sup>105</sup> Regulatory Guide 1.109, Table E-15

<sup>106</sup> Regulatory Guide 1.109, Table E-5

<sup>107</sup> Regulatory Guide 1.109, equation C-10

<sup>108</sup> Regulatory Guide 1.109, Table E-1

<sup>109</sup> Regulatory Guide 1.109, Table E-2

<sup>110</sup> Regulatory Guide 1.109, Table E-3

**D** is the annual dose to the bone or total body for the child age group from milk ingestion, (mrem/yr);

**DFI** is the ingestion dose conversion factor for the maximum exposed organ. For the child age group, the bone is the maximum exposed organ. The **DFI<sub>bone</sub>** is 1.21E-5 mrem/pCi ingested and the **DFI<sub>total body</sub>** is 2.42E-6 mrem/pCi ingested;<sup>111</sup> and

**U<sub>a</sub>** is the ingestion rate for milk. For the child age group, U<sub>a</sub> =330 L/yr (for both cow and goat milk).<sup>112</sup>

#### 10) Dose from <sup>14</sup>C in Meat

The concentration of <sup>14</sup>C in meat is determined as<sup>113</sup>:

$$Conc_{meat} = 3.1E-2 \cdot Conc_v \cdot 50 \cdot e^{-(20 \cdot 3.32E-7)}$$

Where:

**Conc<sub>meat</sub>** is the concentration of <sup>14</sup>C in meat, in pCi/kg;

**3.1E-02** is the stable element transfer factor, in days/kg, for beef<sup>114</sup>

**Conc<sub>v</sub>** is the concentration of <sup>14</sup>C in leafy vegetation grown at the receptor location (pCi/kg), as described above;

**50** kg/day is the amount of feed consumed by the beef animal per day;<sup>115</sup>

**20** days is the average time from slaughter to consumption<sup>116</sup>; and

**3.32E-7** days<sup>-1</sup> is the radiological decay constant for <sup>14</sup>C.

The dose from <sup>14</sup>C in meat is determined as:

$$D = DFI \cdot U_a \cdot Conc_{meat}$$

Where:

**D** is the annual dose to the bone or total body for the child age group from milk ingestion, (mrem/yr);

**DFI** is the ingestion dose conversion factor for the maximum exposed organ. For the child age group, the bone is the maximum exposed organ. The **DFI<sub>bone</sub>** is 1.21E-5 mrem/pCi ingested and the **DFI<sub>total body</sub>** is 2.42E-6 mrem/pCi ingested;<sup>117</sup> and

**U<sub>a</sub>** is the ingestion rate for meat. For the child age group, U<sub>a</sub> =41 kg/yr.<sup>118</sup>

<sup>111</sup> Regulatory Guide 1.109, Table E-13

<sup>112</sup> Regulatory Guide 1.109, Table E-5

<sup>113</sup> Regulatory Guide 1.109, equation C-12

<sup>114</sup> Regulatory Guide 1.109, Table E-1

<sup>115</sup> Regulatory Guide 1.109, Table E-3

<sup>116</sup> Regulatory Guide 1.109, Table E-15

<sup>117</sup> Regulatory Guide 1.109, Table E-13

### 11) Dose to the Member of the Public from Activities within the Site Boundary

The Member of the Public performing activities within the Site Boundary is described in Section 4. The ingestion dose pathways do not exist within the Site Boundary.  $^{14}\text{C}$  is not a gamma-emitting nuclide; therefore the ground plane pathway is negligible.

The inhalation dose,  $D$ , is calculated according to the expression<sup>119</sup>:

$$D_j = 3.17E4 \cdot R_a \cdot DFA_j \cdot Q_j \cdot X/Q \cdot 1.26E-1$$

Where:

$D$  is the dose in mrem, to a member of the public from  $^{14}\text{C}$ , from the inhalation pathway, received by organ  $j$ ;

$3.17 \text{ E}4$  is the number of pCi/Ci divided by the number of sec/yr;

$R_a$  is the breathing rate for the adult age group ( $8000 \text{ m}^3/\text{yr}$ );<sup>120</sup>

$DFA_j$  is the  $^{14}\text{C}$  inhalation pathway dose factor for organ  $j$ , appropriate to the adult age group (mrem/pCi). For  $^{14}\text{C}$ , the limiting organ is the bone. The  $DFA_{\text{bone}}$  for the adult age group is  $2.27E-6$  mrem/pCi, and the  $DFA_{\text{total body}}$  and  $DFA_{\text{thyroid}}$  is  $4.26E-7$  mrem/pCi.<sup>121</sup>

$Q_j$  is the quantity of  $^{14}\text{C}$  produced during the year (Ci/yr)

$X/Q$  is the highest calculated annual average concentration for activities within the Site Boundary, as shown in Table 10.

$1.26E-1$  is the fraction of the year the farmer performs activities within the Site Boundary ( $1100 \text{ hrs}/8760 \text{ hrs}$ ), dimensionless.

---

<sup>118</sup> Regulatory Guide 1.109, Table E-5

<sup>119</sup> Regulatory Guide 1.109, equations C-3 and C-4

<sup>120</sup> Regulatory Guide 1.109, Table E-5

<sup>121</sup> Regulatory Guide 1.109, Table E-7

## 12) Alternate Methodologies

Regulatory Guide 1.21 states that the following methods are acceptable for estimating the production of  $^{14}\text{C}$ :<sup>122</sup>

- Sampling and analysis of effluent streams
- Use of normalized  $^{14}\text{C}$  source term and scaling factors based on power generation, e.g., NCRP Report 81<sup>123</sup>
- Use of the PWR GALE code<sup>124</sup>

Callaway Plant effluents have not been sampled for  $^{14}\text{C}$ . NCRP Report 81, Table 3.3 states that the total  $^{14}\text{C}$  production rate for a PWR without reactor coolant nitrogen is 6 Ci/GW<sub>e</sub>-yr. Assuming a conversion of 0.34 GW<sub>e</sub>/GW<sub>th</sub>, the expected  $^{14}\text{C}$  production rate is 2 Ci/GW<sub>th</sub>-yr or 7.2 Ci/EFPY for Callaway, which is significantly lower than the quantity of  $^{14}\text{C}$  calculated using the EPRI methodology. The PWR GALE code does not calculate the quantity of  $^{14}\text{C}$  produced, but instead assigns a value of 7.3 Ci/yr for every PWR without regard for power level, reactor coolant nitrogen concentration, or waste gas system design and operation. Again, this is significantly lower than the quantity of  $^{14}\text{C}$  calculated using the EPRI methodology. For example, using the EPRI methodology and the neutron flux distribution for Cycle 18, the  $^{14}\text{C}$  production for Callaway is 13.2 Ci/EFPY.<sup>125</sup> The  $^{14}\text{C}$  production calculated using the EPRI methodology is therefore conservative with respect to the methodologies mentioned in Regulatory Guide 1.21, rev. 2.

The EPRI methodology also provides for a PWR proxy calculation. The average  $^{14}\text{C}$  production rate for Westinghouse PWRs is 3.4 Ci/ GW<sub>th</sub>- yr<sup>126</sup>. Callaway is rated at 3.565 GW<sub>th</sub> (3565 MW<sub>th</sub>), therefore, the  $^{14}\text{C}$  production rate based on the proxy PWR is 12.1 Ci/ EFPY. The  $^{14}\text{C}$  production calculated using the EPRI proxy methodology is therefore conservative with respect to the acceptable methodologies described in Regulatory Guide 1.21, rev. 2.

---

<sup>122</sup> Regulatory Guide 1.21, Section 1.9

<sup>123</sup> NCRP Report 81

<sup>124</sup> NUREG-0017

<sup>125</sup> HPCI 11-02

<sup>126</sup> EPRI TR-1021106, Section 4.8 and Appendix D

## Appendix B: Record of Revisions<sup>127</sup>

**Rev. No. 0 Date: March 1983**

**Rev. No. 1 Date: November, 1983**

Revised to support the current RETS submittal and to incorporate NRC Staff comments.

**Rev. No. 2 Date: March, 1984**

Revised to incorporate NRC Staff comments

**Rev. No. 3 Date: June, 1985**

Revised to incorporate errata identified by ULNRC00803 and changes to the Environmental Monitoring Program. Incorporate results of 1984 Land Use Census.

**Rev. No. 4 Date: February, 1987**

Minor clarifications, incorporated 31-day projected dose methodology. Change in the utilization of areas within the Site Boundary.

**Rev. No. 5 Date: January, 1988**

Minor clarifications, revised descriptions of liquid and gaseous rad monitors, revised liquid setpoint methodology to incorporate monitor background, revised dose calculations for 40CFR190 requirements, Revised Table 6 and Figures 5.1A and 5.1B to refine descriptions of environmental TLD stations, incorporated description of environmental TLD testing required by Reg. Guide 4.13, revised Tables 1, 2, 4 and 5 to add additional nuclides, deleted redundant material from Chapter 6.

**Rev. No. 6 Date: May, 1989**

Revised methodology for calculating maximum permissible liquid effluent discharge rates and liquid effluent discharge rates and liquid effluent monitor setpoints, provided methodology for calculating liquid effluent monitors response correction factors, provided an enhanced description of controls on liquid monitor background limits, provided additional liquid and gaseous dose conversion factors and bioaccumulation factors (Tables 1, 2, 4 & 5), provided description of the use of the setpoint required by Technical Specification 4.9.4.2 during Core Alterations, added discussion of gaseous and liquid monitor setpoint selection in the event that the sample contains no detectable activity, added minimum holdup requirements for Waste Gas Decay tanks, revised dispersion parameters and accompanying description per FSAR Change Notice 88-42.

### APA-ZZ-01003

**Rev. No. 0 Date: August, 1989**

Radiological Effluent Technical Specifications were moved from the Callaway Plant Technical Specifications to Section 9.0, Radioactive Effluent Controls, of the ODCM per NRC Generic Letter 89-01. At the same time, in order to formalize control of the entire ODCM, it was converted to APA-ZZ-01003, Offsite Dose Calculation Manual.

---

<sup>127</sup> Section numbers, table numbers, etc. refer to the numbering schema used in the particular revision.

**Rev. No. 1 Date: October, 1990**

Revise Action 41 of Table 9.2-A to allow continued purging for 24 hours per Amendment 20 to operating license, issued 4/10/87.

**Rev. No. 2 Date: May, 1991**

Section 2.4.2: Changed gross alpha analysis frequency from "each batch" to a monthly composite per Table 9.3-A, and the Callaway Plant NPDES permit (reissued March 15, 1991).

**Rev. No. 3 Date: June, 1993**

Deleted HF-RE-45 and LE-RE-59 as effluent monitors. Revised table numbering for consistency with those in Section 9.0, deleted redundant material, incorporated 1992 Land Use Census results, moved LLD description to Attachment 1, moved REC Bases to Attachment 2. Deleted reporting requirements for solid radwaste, which are described in APA-ZZ-01011, Process Control Program. Addressed compliance with 10 CFR 20.1301. Revised the dilution flow rate to allow values other than 5000 gpm, based on dilution flow monitor setpoint. Revised "MPC" terminology to "ECV". Added Action 46 to REC 9.2 to clarify actions for inoperable mid and high range WRGM Channels. Revised references to be consistent with the revised 10 CFR 20. Added Appendix A. Revised Action 41 of Rec 9.2 and the operability requirements of GT-RE-22/33. Incorporated the revised  $R_i$  values in Tables 3.2 and 3.3. Added Section 6.2 and Table 6.5.

**Rev. No. 4 Date: September, 1994**

Increased the minimum channels OPERABLE requirement of REC 9.2 for GT-RE-22 & 33 from 1 channel to 2 channels. Revised Action 41 and the Bases for REC 9.2 accordingly. Incorporated the operability requirements from Tech Spec 3.9.9 into the Action statement for clarity. (Refer to CARS 199401176).

**Rev. No. 5 Date: February, 1995**

Removed the REMP station locations. Removed particulate nuclides with a half-life of less than 8 days from Tables 3.2-3.4 and removed  $^{14}\text{C}$ ,  $^{32}\text{P}$ ,  $^{63}\text{Ni}$ , and  $^{125\text{m}}\text{Te}$  from Tables 2.1, 2.2, 3.2, 3.3, and 3.4. Changed the reporting frequency of the Effluent Release Report from semiannual to annual. Removed the meat, milk and vegetable pathway dispersion parameters from Tables 6.1, 6.2, and 6.3, and clarified the applicability of the dispersion parameters and dose locations in Table 6.4. Relocated REC 9.1 and 9.2 to the FSAR. Revised footnotes 3 and 7 of Table 16.11-4 to require additional sampling of the Unit Vent in the event of a reactor power transient, only if the Unit Vent noble gas activity increases by a factor of 3 or greater. Added Section 4.1.3.1.3 for determination of dose due to the on-site storage of low level radioactive waste.

**Rev. No. 6 Date September, 1996**

Section 2: Added dose factors ( $A_{ii}$ ) for  $^{110\text{m}}\text{Ag}$ ,  $^{237}\text{Np}$ ,  $^{238}\text{Pu}$ ,  $^{239/240}\text{Pu}$ ,  $^{241}\text{Pu}$ ,  $^{241}\text{Am}$ ,  $^{242}\text{Cm}$ , and  $^{234/244}\text{Cm}$  to Table 2.1, and Bioaccumulation Factors ( $B_{fi}$ ) for Ag, Pu, Am, and Cm to Table 2.2 due to a change in the liquid radwaste treatment process. Revised the description of the methodology for performing the 31 day dose projection in Section 2.5. Revised the maximum allowable background for HB-RE-18. Section 3: Eliminated  $^{91\text{m}}\text{Y}$  and  $^{99\text{m}}\text{Tc}$  from Table 3.4 (Meat Pathway) due to a half-life of < 8 days. Substituted the phrase "more restrictive" in lieu of "lesser" in Section 3.2. Revised the definition of  $F_a$  in equation 3.1. Added description of use of samples to verify dose rates in Section 3.3.1.2. Augmented the definition of  $q_i$  in Section 3.3.2.1. Edited

equations 3.13 and 3.14 and added equation 3.15 to clarify dose calculations. Revised the methodology for performing the 31 day dose projection in Section 3.4. Section 4: Strengthened the discussion of the reevaluation of assumptions in Section 4.1.3. Section 6: Added new Table 6.6 to describe the selection and use of dispersion parameters during the preparation of the Effluent Release Report. Updated Tables 6.1 and 6.2 to reference the 1995 Land Use Census. There were no changes in the receptor locations. Section 8: Replaced the reference to HDP-ZZ-04500 to a more generic reference to the plant operating procedures, due to change in organizational structure and responsibilities. Section 9: (1) Eliminated 9.0.1 and 9.0.2 due to redundancy with Technical Specifications 3.0.1 and 3.0.2; (2) Revised Table 9.3-A to incorporate sampling and analysis requirements for TRU nuclides in liquid effluents; (3) Eliminated sampling of Fuel Building Exhaust from Table 16.11-4 and the associated footnotes due to redundancy with Unit Vent sampling; revised the continuous sampling requirements for the gaseous batch release points consistent with plant design; revised the  $^3\text{H}$  analysis frequency for Purges from weekly to "prior to each purge"; and, (4) Revised the air sampling station location criteria on Table 9.11-A and footnote # 1, and eliminated footnote #3 in order to be less generic and more descriptive of the parameters used in determining the station locations (See CARS 199502280). Revised the location requirements for milk and vegetables. Revised description of use of baseline samples to trigger gamma isotopic analysis in footnote #4, revised requirement for location of downstream sample station in footnote #6. Revised Surveillance Requirement 9.10.2.1 to eliminate liquid effluents from the surveillance. (5) Revised REC 9.5 and REC 9.9 to eliminate exceptions for partially tested effluents being released in excess of the respective limit. Section 11: Added reference 11.14.13. Attachment 2: Revised the Bases for REC 9.10 to support the elimination of liquid effluents from Surveillance 9.10.2.1. The remaining changes are editorial in nature and have no technical impact. (This revision implements CARS 199502055, CARS 199600167, CARS 199600961, CARS 199502280, and CARS 199600986).

**Rev. No. 7 Date February, 1997**

Section 9: (1) REC 9.5, "Liquid Radwaste Treatment System", Action statement: Eliminated reference to COMN 1161. (2) Table 9.11-A, items 4a (milk) and 4c (vegetation): revised to required control stations in the least prevalent wind direction. (See CARS 199700166) Appendix A: revised the discussion relative to the appropriate gross alpha Effluent Concentration Value.

**Rev. No. 8 Date May, 1997**

Section 1: The Purpose and Scope was revised to describe the split of the ODCM into two sections Per FSAR Change Notice 95-058. Section 2: Sections 2.2 and 2.3 were revised to clarify the use of nuclide- specific alpha activity vice gross alpha activity for setpoint determination. Section 2.5 was revised to delete the description of the Liquid Radwaste Treatment System. Section 6: Tables 6.1, 6.2, and 6.3 were revised to reflect the results of the 1996 Annual Land Use Census. Section 7: The reporting requirements for the Annual Radiological Environmental Operating Report and the Effluent Release Report were relocated to the FSAR Per FSAR Change Notice 95-058. Section 9: REC's and the supporting Attachments 1 and 2 were relocated to the FSAR Per FSAR Change Notice 95-058. Appendix A: Appendix A was deleted. Editorial changes were made throughout the ODCM reflecting the relocation of the REC's to the FSAR.

**Rev. No. 9 Date March, 1998**

Section 2.5: Revised projected liquid dose calculation to use previous 31 day cumulative doses. Section 3.1.1: Added GL-RE-202, Laundry Decon Facility Dryer Exhaust Monitor. Added action to be taken when the particulate and/or iodine grab sampler is not operable. Section 3.2: Added setpoint calculation for GL-RE-202. Section 3.2.1 and 3.3.2.2: Changes were made to correct typographical errors and have no technical impact. Section 3.4: Revised projected gas dose calculation to use previous 31 day cumulative doses. Section 3.5: Removed the word secular from "secular equilibrium" since the equilibrium mode could be secular or transient depending on the isotope. Table 6.2: Added Laundry Decon Facility Dryer Exhaust to title of table since these will be the dispersion factors used for this release point.

**Rev. No. 10 Date December 20, 1999**

Section 3.1: Added explanation that GL-RE-202 only monitors particulate. Section 3.2: Changed Laundry Decon Facility Exhaust Monitor setpoint to less than or equal to 2000 cpm above equilibrium background with a maximum allowed background of 2000 cpm as calculated in HPCI 99-05. Tables 6.1, 6.2, 6.3: Updated values as calculated in HPCI 99-02. Section 5.1: Defined how REMP sample locations were determined. Removed reference to Plant Operating manual since it no longer exists.

**Rev. No. 11 Date December 22, 1999**

Changes required to go from old Technical Specifications to Improved Technical Specifications (ITS). Technical Specification 4.9.4.2 changed to FSAR 16.11.2.4.1. Technical Specification 6.8.4.F changed to FSAR 16.11.4. Technical Specification 6.8.1.F changed to Improved Technical Specification 5.4.1. Technical Specification 6.14 changed to Improved Technical Specification 5.5.1. Technical Specification 6.8.4.E changed to Improved Technical Specification 5.5.4. Technical Specification 6.9.1.6 changed to Improved Technical Specification 5.6.2. Technical Specification 6.9.1.7 changed to Improved Technical Specification 5.6.3. Changed name of Annual Radiological Effluent Release Report to Effluent Release Report as stated in ITS. Added liquid releases are limited to 10 times the Appendix B, Table 2, Column 2 limits Per FSAR CN 98-041 supporting implementation of ITS.

**Rev. No. 12 Date December 01, 2000**

Section 2.1 and 2.2.1: Updated 10CFR20, Appendix B, Table II, Column 2 reference to the new 10CFR20 format. Corrected typo for "f", flow setpoint should be undiluted waste flow rate. Section 3.2.1: Corrected typo, default value for safety factor should be 0.1. Section 5.1: Updated crosscheck program used to EML since EPA program is no longer available. Section 6.2: Added vertical height of highest adjacent building used to perform concurrent year annual average atmospheric dispersion (X/Q) calculations and reference for this value. This information should be documented in the ODCM. Added responsibility for validation of meteorological data, since responsibility has changed from engineering to HPTS. Section 10.1.1: Revised to require a summary of Major Radwaste System changes to be included in the annual report. This was done to be consistent with FSAR 16.11.5.2. Several changes were made throughout the procedure to correct typographical errors and have no technical impact.

**Rev. No. 13 Date September 19, 2002**

Section 3.2: Revised to implement the approved OL 1218, Rev. 1; License Amendment no. 152 allowing equipment hatch and emergency air lock to remain open during refueling activities (FSAR CN-01-030 and CN-02-049). The amendment eliminated FSAR 16.11.2.4.1B and

subsequently deleted the core alteration setpoint value  $5.0 \text{ E-3 } \mu\text{Ci/cc}$  for Containment Purge Monitors GT-RE-22 and GT-RE-33. The alarm setpoints for the Containment Purge Monitors will be based on the methodology described in Section 3 of the ODCM.

**Rev. No. 14 Date June 17, 2003**

Revised Table 2.1 (Ingestion Dose Commitment Factor for Adult Age Group) to include dose factors for Pr-144. (CARS 200303251). Revised Section 4.1.3.1 to adjust the Farmer's residence (critical receptor) from 3830 meters in the SE sector to 2897 meters in the NNW sector. The Farmer's residence (critical receptor) was changed in 2002 to a location directly across the street from the Nearest residence. For conservatism and ease in calculation, Table 6.1 and 6.2 were revised making the distances and dispersion parameters for the Farmer's residence (critical receptor) and the Nearest residence the same. Revised section 7.2 to reference Table 6.6. Revised section 10.2.2 to remove the requirement for QA department review of the ODCM for reach revision (CARS 200304509). Added a reference to 11.14.14, Calculation HPCI 03-004 (Rev. 0), "Calculation of Liquid Effluent Dose Commitment factor for Pr-144 ( $A_{ir}$ ) for the Adult Age Group", June, 2003.

**Rev. No. 15 Date December 9, 2004**

Reformatted references to FSAR-SP Chapter 16.11 in section 1, 2.1.1, 2.1.2, 2.2.1, 2.3, 2.4.2, 2.5, 2.6, 3.1, 3.2.1, 3.5, 5.1, 7.1, 7.2, and 9. References to  $^{63}\text{Ni}$  were added to section 2.2.1 for the calculation of ECVSUM, section 2.3, and described in section 2.6 since it is an exception to non- gamma emitters not listed in FSAR-SP Table 16.11-1.  $^{63}\text{Ni}$  was added to the ODCM based on previous 10 CFR 61 sample results and 2<sup>nd</sup> quarter liquid composite analyses. Consolidated references listed in section 2.4.2 and 2.6 for the site related ingestion dose commitment factors ( $A_{ir}$ ) of Table 2.1 into HPCI 04-06, Revision 1. References to HPCIs 95-004 (Ref: 11.14.13) and 03-004 (Ref: 11.14.14) were deleted and replaced with HPCI 04-06, Revision 1 which is now listed as Ref: 11.14.13. Added  $^{63}\text{Ni}$  and  $^{122}\text{Sb}$  to Table 2.1- INGESTION DOSE COMMITMENT FACTOR ( $A_{ir}$ ) FOR ADULT AGE GROUP. Revised the reference for Table 2.1 to 11.14.13. Corrected a typo in section 3.1.2 referring to the Radwaste Building Vent system designator as GT vs. GH (CAR 200406851). References 11.19 and 11.20 were deleted in section 4.1.3.1.1. Reference 11.18 was changed to MICROSIELD (Grove Engineering, Inc.) vs. ISOSHLD. Reference 11.24 in section 4.1.3.1.3 was corrected to 11.18. Section 5.1 and 5.2 were revised to indicate that the Radiological Environmental Monitoring Program TLDs will be processed and provided by a vendor laboratory beginning in the first quarter of 2005. Section 5.2 was revised to delete reference 11.14.10 which refers to HPCI 88-08, "Performance Testing of the Environment TLD System at Callaway Plant", August 1989. Reference 11.14.7 was corrected with HPCI 87-10 vs. 88-10. Revised Table 6.1, Note (c) to reference FSAR Table 2.3-83 vs. Table 2.3-82. Revised Table 6.1 and 6.2 Note (b) to reference data is from the 2002 Land Use Census. Changed and/or corrected the Skin dose factor ( $L_i$ ) units in Table 3.1 (Dose Factor for exposure to a Semi-Infinite Cloud of Noble Gases) to  $\text{mrem/yr per } \mu\text{Ci/m}^3$ . Revised section 3.3.1.2: Added units for the term BR in  $\text{m}^3/\text{yr}$ . Removed paragraph in section 3.3.2.2 that describes actions for implementing the use of appropriate  $R_{i,j}$  values. This paragraph was taken directly from section 5.3.1 of NUREG 0133, U.S. Nuclear Regulatory Commission, "Preparation of Radiological Effluent Technical Specification for Nuclear Power Plants", USNRC NUREG-0133, Washington, D.C. 20555, October, 1978. This paragraph does not apply since the use of pathways is already considered as described in sections 4.1.2 and 4.1.3.1. Revised note (c) of Table 6.1 to reference FSAR-SA Table 2.3-83. Revised note (a) from Table 6.1 to reference FSAR-SA Table 2.3-82. In addition, revised Note (b) from Table 6.1 to reference data taken from the 2002 Land Use

Census. Revised Notes (a) and (c) from Table 6.2 to reference FSAR-SA Table 2.3-84 and 2.3-81 respectively. Added a 0.95 conservatism factor to section 2.2.3 *Calculation of Liquid Effluent Monitor Setpoint*. This will conservatively reduce the liquid monitor setpoint to further ensure the section 4.4.1 of NUREG 0133, U.S. Nuclear Regulatory Commission, "Preparation of Radiological Effluent Technical Specification for Nuclear Power Plants", USNRC NUREG-0133, Washington, D.C. 20555, October, 1978 which states the alarm and trip setpoints for each instrument channel listed in Table 3.3-11 should be provided and should correspond to a value(s) which represents a safe margin of assurance that the instantaneous liquid release limit of 10 CFR Part 20 is not exceeded. A determination was made IAW T/S 5.5.1 that the associated changes with Revision 15 maintain the levels of radioactive effluent control required by 10 CFR 20.1302, 40 CFR 190, 10 CFR 50.36a, and 10 CFR 50 Appendix I, and not adversely impact the accuracy or reliability of effluent, dose, or setpoint calculations.

**Rev. No. 16 Date December 1, 2005**

Section 5.1 was revised to remove an invalid requirement that a third-party laboratory performing analysis specifically state the Interlaboratory Comparison (crosscheck) requirements for the Radiological Environmental Monitoring Program (REMP) contract lab. Reference 11.14.14 to Reg. Guide 4.15, Quality Assurance for Radiological Monitoring Programs (Normal Operations)- Effluent Streams and the Environment, was added to provide supporting documentation for contract lab Interlaboratory Comparison requirements. Additional information on REMP contract lab participation in Interlaboratory Comparisons was also added in section 5.1. (CAR 200500891) Revised reference 11.14.7 by adding normalization and standardization factors for radionuclides listed in Table 2.1 of the ODCM that were not included in the original calculation. Added section 4.1.3.1.4 to describe direct dose to a Member of the Public from the Old Steam Generator Storage Facility (OSGSF). Reworded step 4.1.2 to describe the sources of direct radiation from "outside storage tanks" to "storage of radioactive material". Revised section 4.1.3.1.2 to include and describe direct dose calculations in support of Modification 03-1008, Equipment Hatch Platform and Missile Shield Modification. Reference 11.14.10 was added to reference direct dose calculation to the Member of the Public from Modification 03-1008. Revised section 4.1.3.1.3 to include and describe direct dose calculations from the Radwaste Yard RAM storage and Stores II. Reference 11.19 and 11.20 were added to reference direct dose calculations to the Member of the Public from RAM storage at Stores II and the Radwaste Yard. A determination was made IAW T/S 5.5.1 that the associated changes with Revision 16 maintain the levels of radioactive effluent control required by 10 CFR 20.1302, 40 CFR 190, 10 CFR 50.36a, and 10 CFR 50 Appendix I, and not adversely impact the accuracy or reliability of effluent, dose, or setpoint calculations.

**Rev. No. 17 Date March 14, 2007**

Section 2.4.1 was revised Per CAR 200701309 to state that no potable water intakes exist within 10 miles of the plant discharge point. This is due to the fact that the Annual Land Use Census ensures no newly developed potable water intakes within 10 miles of the plant discharge Per FSAR-SP Chapter 16.11.4.2c. Section 2.4.2 was revised to add reference 11.6.18 to CAR 200700053 which provides documentation of an evaluation of the site specific mixing factor for liquid effluents. Modification 06-0061 reconfigured the plant discharge terminus at the Missouri River. The modification was completed in January 2007.

**Rev. No. 18 Date October 11, 2007**

Revised Table 6.5 was revised to reflect upgrade/replacement of the primary meteorological tower instrumentation as per Modification Package 04-1020. Section 2.4.2 was revised to remove the discussion of the nearest municipal potable water intake downstream from the liquid effluent discharge point as being located near the city of St. Louis, Missouri, approximately 78 miles downstream. Since the Land Use Census annually verifies no potable water intakes within 10 miles – this discussion was deemed inappropriate in describing methodology for calculating dose to the public from liquid effluents. In addition, the distance referenced as not having potable water intakes downstream of the plant discharge was changed for consistency with section 2.4.1 and the Land Use Census.

**Rev. No. 19 Date August, 2012**

Converted to Word 2010, including appropriate formatting changes and cross-referencing for the conversion. Deleted all references to the obsolete Commitment Tracking System (COMN) and all hidden text for the obsolete hidden text referencing system. Added level of use. (CAR 201104163, Action 1) Section 3.4- Added dose reduction controls for discharge of  $^{14}\text{C}$  from the waste gas system and defined the growing season. Section 3.5- Deleted statement that non- gamma emitting nuclides not listed in the FSAR-SP Table 16.11.4 are not considered in dose calculations. Eliminated Sections 4.1.3.1.1, 4.1.3.1.2, 4.1.3.1.3, and 4.1.3.1.4- direct radiation dose is negligible; refer to HPCI 12-06. Section 5.2- changed to allow use of dosimeters other than TLDs. Section 6.1- Deleted discussion of short- term X/Q processing and the slope factor and deleted the associated table of 'S' factors. Section 6.2- Deleted designation of responsibilities for met data review. (CAR 201104163, Action 1) Section 10.2- changed to align with T/S 5.5.1. CAR 201104163, Action 2) Corrected the department title to align with organizational structure. (CAR 201104163, Action 1). Table 10 and Table 11- The dispersion parameters for the Farmer's residence were removed. As a first approximation, the dispersion parameters for the Nearest Residence will be used for the Farmer's residence. Appendix A- Appendix A was added to describe the calculation of the production of  $^{14}\text{C}$  and the calculation of dose from  $^{14}\text{C}$  in gaseous effluents. (CAR 201104163)  $^{63}\text{Ni}$  was added to the gaseous effluent inhalation pathway and ingestion pathways dose factor tables. Values for  $^{63}\text{Ni}$  are from APA-ZZ-01003, rev. 4. (CAR 201104197). Adult ingestion dose factors removed. Ingestion dose pathway removed from Table 13 for activities inside the Site Boundary.

**Rev. No. 20 Date April, 2015**

Revised Table 10 to implement the recalculated dispersion parameters using 2009- 2013 meteorology. Deleted Table 11 as described in HPCI1503. Added HPCI1502, HPCI1503, HPCI1504, & HPCI1505 as references. Deleted reference to ZZ-67. Added ISFSI to Appendix A, Figure 1. Revised Section 6 to describe the recalculation of the long- term dispersion parameters. Deleted Section 8; following sections were renumbered accordingly.

**Rev. No. 21 Date May, 2015**

Revised Table 10 to correct the dispersion parameters for the Site Boundary and Nearest Resident locations and edited to two significant digits for consistency with the remainder of Table 10. (CAR 201502908)

**Rev. No. 22 Date March, 2017**

The following changes implement CR's 201604927, 201602733, 201603668, and 201602733:

- The methodology used to calculate the  $A_{ir}$  values was added to section 2.4.2.

- Default setpoint values for GTRE21B and GHRE10B were added to section 3.2.
- Deleted the specific years of the meteorological data in section 6.1 and instead stated the dispersion parameters represent five years of on- site data to eliminate a potential error trap. The HPCI referenced in section 6.1 provides the necessary level of detail, including the years represented by the data.
- A footnote was added to section 6.1.2 to clarify that the farmer is a composite and not an actual person.
- Section 6.2 was revised to clarify the quality check of the meteorological data prior to processing.
- Section 10, "Bibliography" was revised to add new references and to update the revision level of CDP-ZZ-00200.
- <sup>126</sup>Sb was added to Table 1.
- Table 12 was revised to change the "Farmer's Residence" to the "Nearest Resident" because the farming plots are now leased to multiple farmers and it is not feasible to calculate dose to multiple farmers' residences. The footnote in Table 12 regarding <sup>3</sup>H dispersion parameters was moved into the table. <sup>14</sup>C was added to Table 12.
- Appendix A was reformatted for better readability.
- Appendix A, Section 2, "Assumptions" was revised to clarify the assumptions, principally dispersion parameter use and the dose pathways and locations.
- Appendix A, Section 3, "Applicable Dose Limits", was revised to add 10 CFR 72.104.
- Appendix A, Section 11, "Dose to the Member of the Public from Activities Within the Site Boundary", was revised to eliminate the value of the X/Q for activities within the Site Boundary and to instead refer to Table 10 as the source for the X/Q. The three condensed form equations were likewise eliminated. This eliminated an error trap in that the X/Q could be revised and it may not be recognized that the specific value was stated in the text of Appendix A, Section 11.
- Appendix A, Section 12 was edited for readability.
- Formatting changes are not marked with revision bars.