

Don/06/78

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)
DISTRIBUTION FOR INCOMING MATERIAL 50-335

REC: OREILLY J P
NRC

ORG: SCHMIDT A D
FL PWR & LIGHT

DOCDATE: 08/28/78
DATE RCVD: 09/05/78

DOCTYPE: LETTER NOTARIZED: NO
SUBJECT:

COPIES RECEIVED
LTR 1 ENCL 1

FORWARDING LICENSEE EVENT REPT (RO 50-335/78-026) ON 07/30/78 CONCERNING
DURING PWR OPERATION, THE DIGITAL DATA PROCESSING SYSTEM MANLFUNCTIONED,
RESULTING IN LOSS OF CEA BACKUP POSITION INDICATION AND THE INCORE FLUX
DETECTOR SYSTEM USED TO MONITOR FLUX D

Detector

PLANT NAME: ST LUCIE #1

REVIEWER INITIAL: XJM
DISTRIBUTOR INITIAL:

***** DISTRIBUTION OF THIS MATERIAL IS AS FOLLOWS *****

INCIDENT REPORTS
(DISTRIBUTION CODE A002)

FOR ACTION: BR CHIEF ORR#4 BC**W/4 ENCL

INTERNAL:

REG FILE**W/ENCL
I & E**W/2 ENCL
I & C SYSTEMS BR**W/ENCL
NOVAK/CHECK**W/ENCL
AD FOR ENG**W/ENCL
HANAUER**W/ENCL
AD FOR SYS & PROJ**W/ENCL
ENGINEERING BR**W/ENCL
KREGER/J. COLLINS**W/ENCL
K SEYFRIT/IE**W/ENCL

NRC PDR**W/ENCL
MIPC**W/3 ENCL
EMERGENCY PLAN BR**W/ENCL
EEB**W/ENCL
PLANT SYSTEMS BR**W/ENCL
AD FOR PLANT SYSTEMS**W/ENCL
REACTOR SAFETY BR**W/ENCL
VOLLMER/BUNCH**W/ENCL
POWER SYS BR**W/ENCL

EXTERNAL:


LPDR'S
FT PIERCE, FL**W/ENCL
NSIC**W/ENCL
ACRS CAT B**W/16 ENCL

DISTRIBUTION: LTR 44 ENCL 44
SIZE: 1P+1P

CONTROL NBR: 782480132

Ad 4
60

***** THE END *****

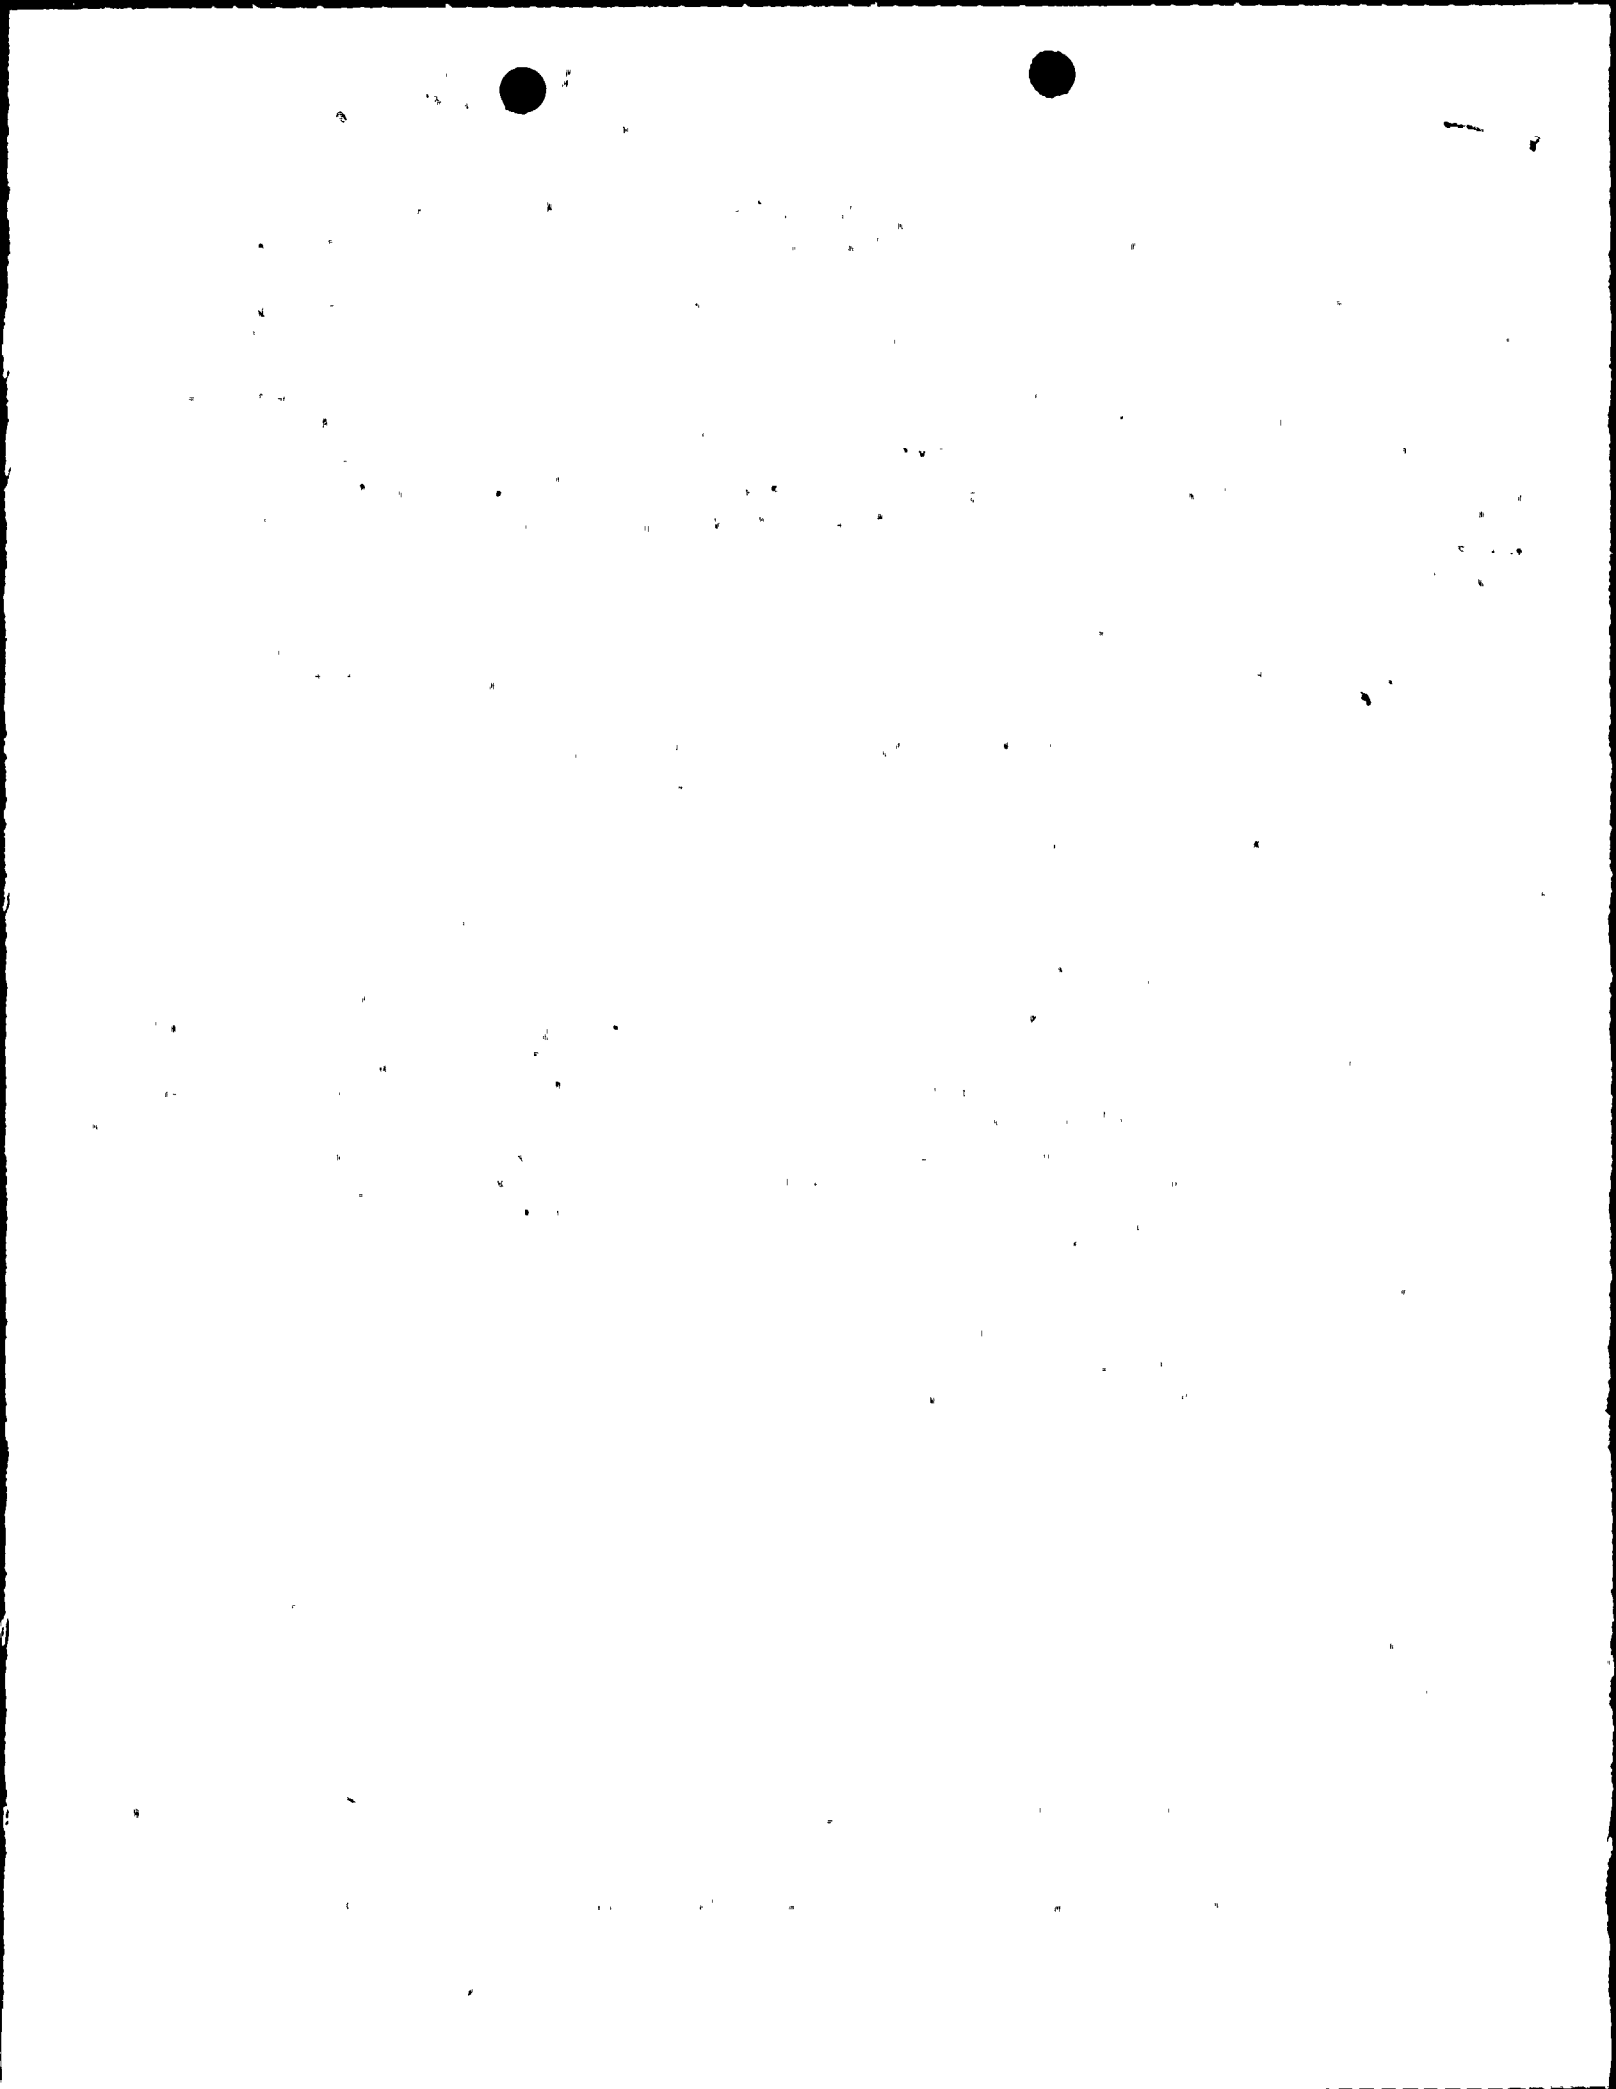

Handwritten marks and scribbles in the top right corner.