

13 04 11/1978

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)  
DISTRIBUTION FOR INCOMING MATERIAL 50-335

REC: OREILLY J P  
NRC

ORG: SCHMIDT A D  
FL PWR & LIGHT

DOC DATE: 03/30/78  
DATE RCVD: 04/11/78

DOCTYPE: LETTER NOTARIZED: NO  
SUBJECT:

COPIES RECEIVED  
LTR 1 ENCL 1

FORWARDING LICENSEE EVENT REPT (RD 50-335/78-9) ON 02/28/78 CONCERNING DURING PWR OPERATION THE DIGITAL DATA PROCESSING SYS MALFUNCTIONED... AN APPARENT MOMENTARY MEMORY FAILURE CAUSED THE DDPS TO HALT.

PLANT NAME: ST LUCIE #1

REVIEWER INITIAL: XJM  
DISTRIBUTOR INITIAL: WJ

\*\*\*\*\* DISTRIBUTION OF THIS MATERIAL IS AS FOLLOWS \*\*\*\*\*

INCIDENT REPORTS  
(DISTRIBUTION CODE A002)

FOR ACTION: BR CHIEF REID\*\*W/4 ENCL

INTERNAL: REG FILE\*\*W/ENCL  
I & E\*\*W/2 ENCL  
SCHROEDER/IPPOLITO\*\*W/ENCL  
NOVAK/CHECK\*\*W/ENCL  
KNIGHT\*\*W/ENCL  
HANAUER\*\*W/ENCL  
EISENHUT\*\*W/ENCL  
SHAD\*\*W/ENCL  
KREGER/J. COLLINS\*\*W/ENCL  
K SEYFRIT/IE\*\*W/ENCL

NRC PDR\*\*W/ENCL  
MIPC\*\*W/3 ENCL  
HOUSTON\*\*W/ENCL  
GRIMES\*\*W/ENCL  
BUTLER\*\*W/ENCL  
TEDESCO\*\*W/ENCL  
BAER\*\*W/ENCL  
VOLLMER/BUNCH\*\*W/ENCL  
ROSA\*\*W/ENCL


EXTERNAL: LPDR'S  
FT PIERCE, FL\*\*W/ENCL  
TIC\*\*W/ENCL  
NSIC\*\*W/ENCL  
ACRS CAT B\*\*W/16 ENCL

COPIES NOT SUBMITTED PER  
REGULATORY GUIDE 10.1

DISTRIBUTION: LTR 45 ENCL 45  
SIZE: 1P+1P

CONTROL NBR: 78101005  
No 60

\*\*\*\*\* THE END \*\*\*\*\*

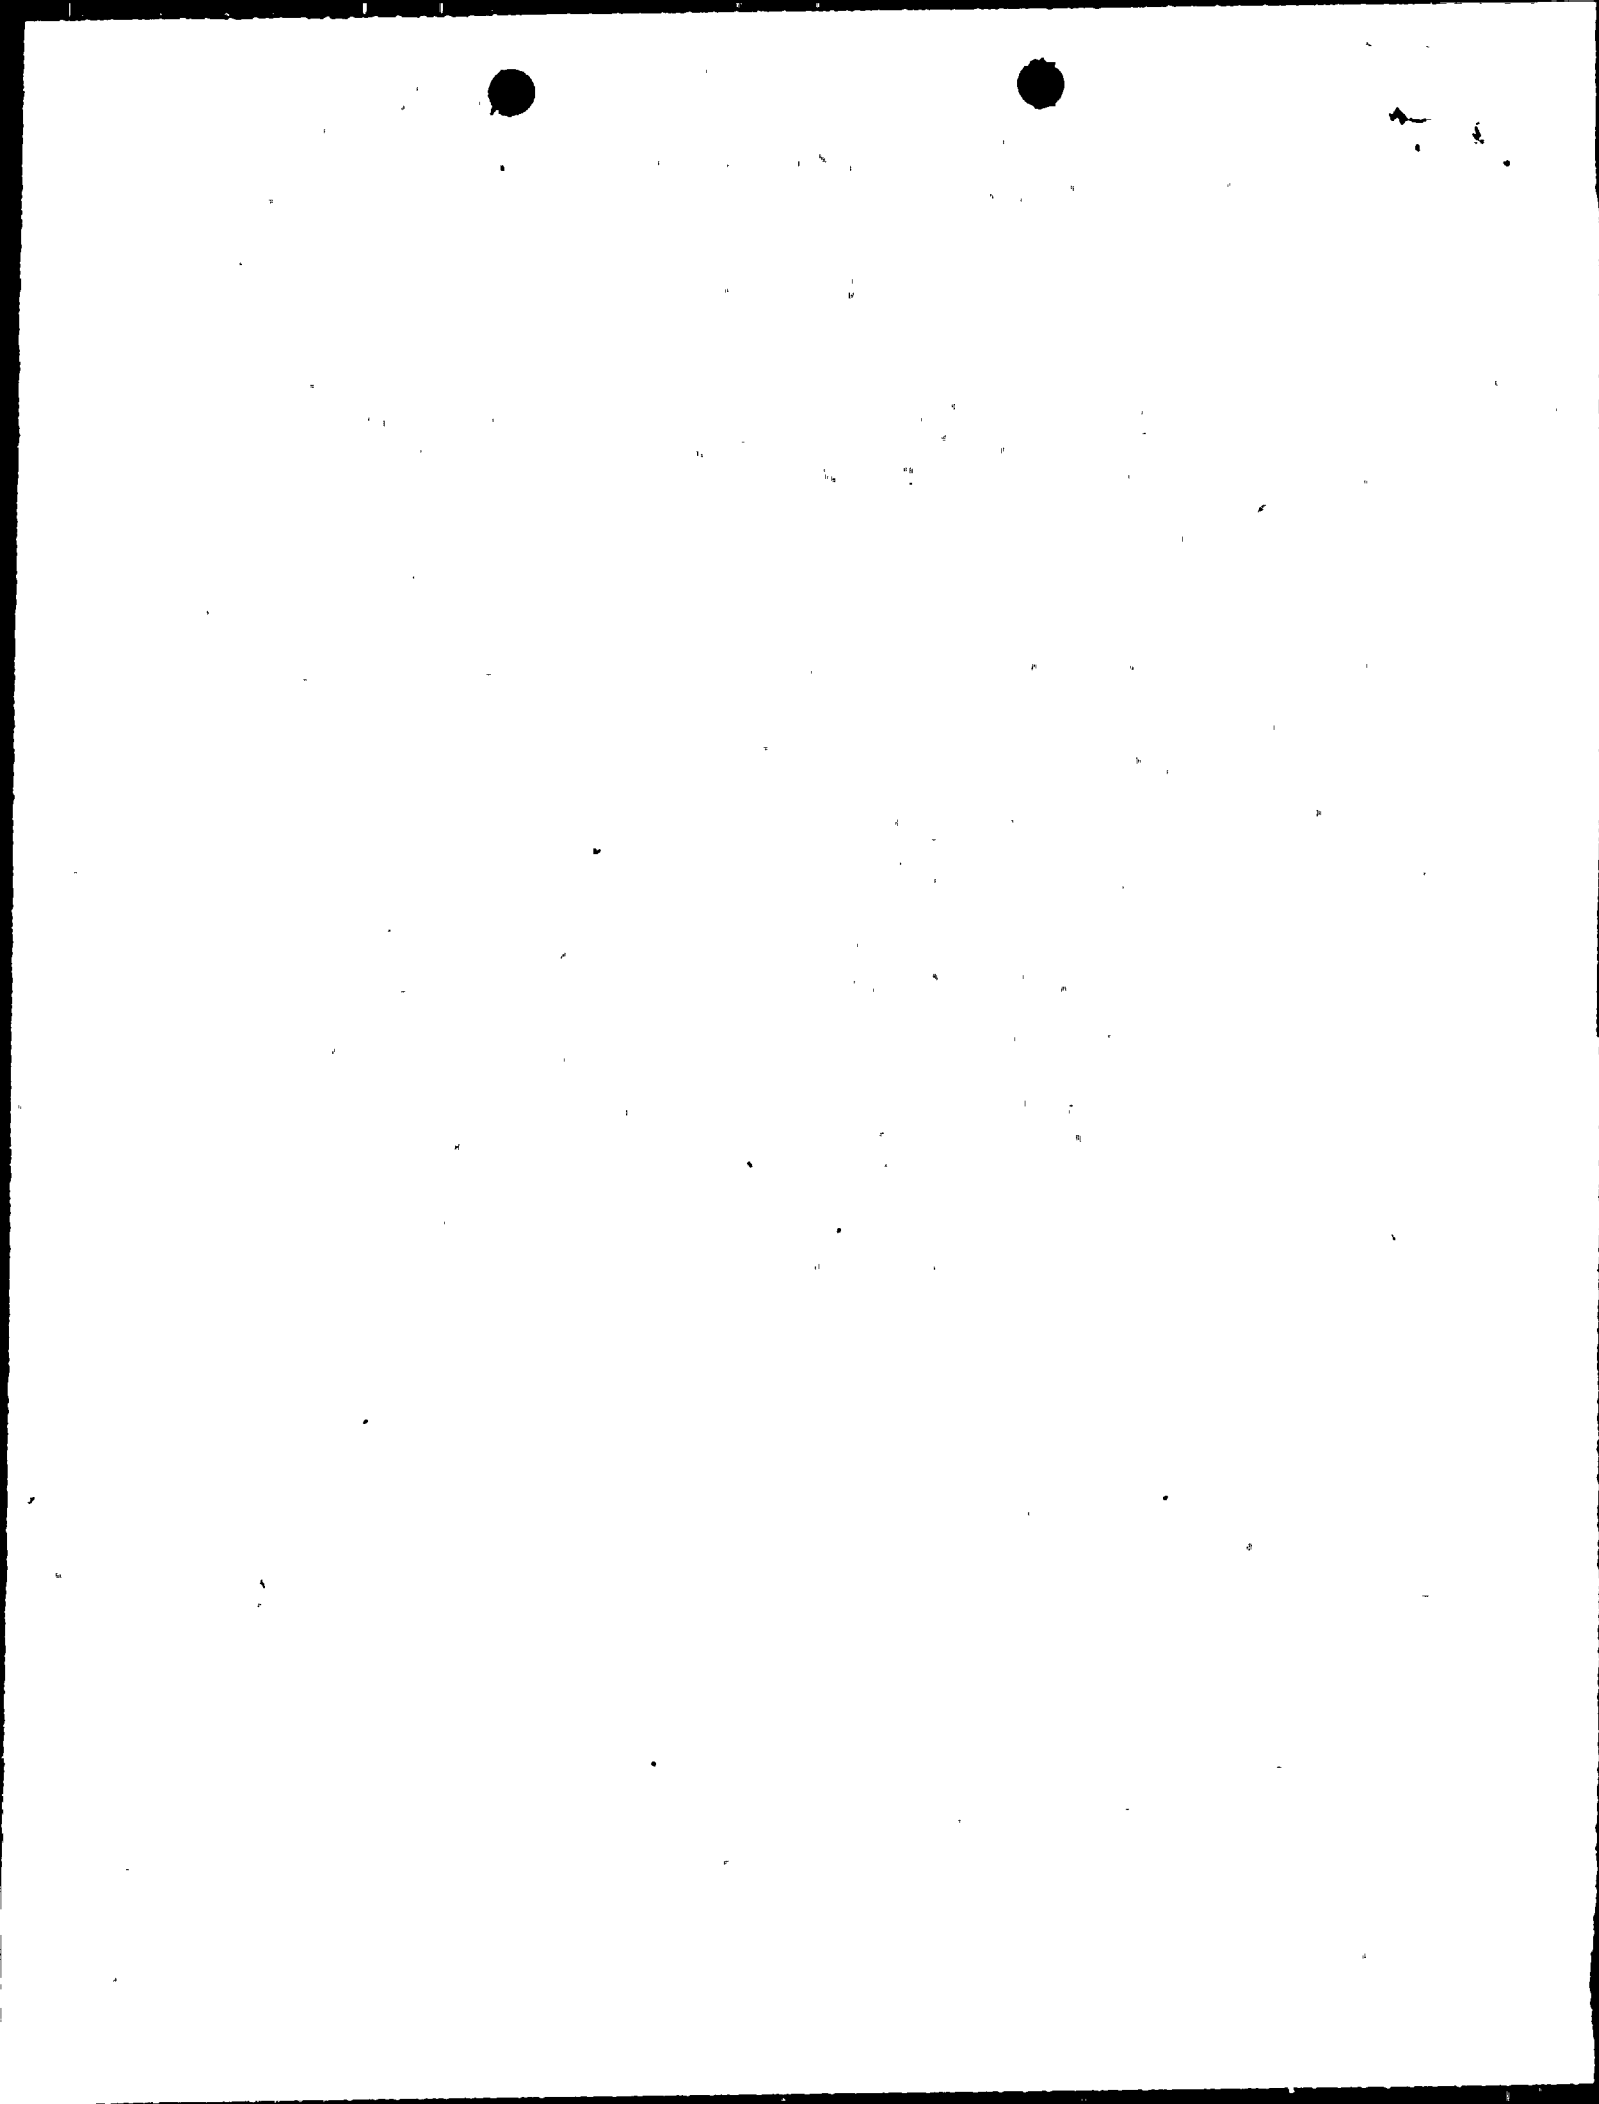

REGULATORY BOARD FILE COPY  
FLORIDA POWER & LIGHT COMPANY  
Maiton 30, 1978  
PRN-LI-78-90

Mr. James P. O'Reilly, Director, Region II  
Office of Inspection and Enforcement  
U. S. Nuclear Regulatory Commission  
230 Peachtree Street, N.W., Suite 1217  
Atlanta, Georgia 30303

1978 APR 11 PM 12 59  
RECEIVED DISTRIBUTION  
SERVICES UNIT  
US NRC  
DISTRIBUTION SERVICES  
BRANCH

Dear Mr. O'Reilly:

REPORTABLE OCCURRENCE 335-78-9  
ST. LUCIE UNIT 1  
DATE OF OCCURRENCE: FEBRUARY 28, 1978

DIGITAL DATA PROCESSING SYSTEM

The attached Licensee Event Report is being submitted in accordance with Technical Specification 6.9 to provide 30-day notification of the subject occurrence.

Very truly yours,

*A. D. Schmidt*  
A. D. Schmidt  
Vice President  
Power Resources

MAS/mb

Attachment

cc: Harold R. Reis, Esquire  
Director, Office of Inspection and Enforcement (30)  
Director, Office of Management Information and  
Program Control (3)

781010053

A002  
A05  
111



21.6

10

11

12

13

14

15

16  
17  
18  
19  
20  
21  
22  
23  
24  
25

26  
27  
28  
29  
30

31  
32

33  
34  
35  
36  
37  
38  
39  
40



11-11-11