

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL

FILE NUMBER

TO:
Mr. Don K. Davis

FROM:
Florida Power & Light Company
Miami, Fla.
Robert E. Uhrig

DATE OF DOCUMENT
8/8/77

DATE RECEIVED
8/11/77

LETTER
 ORIGINAL
 COPY

NOTORIZED
 UNCLASSIFIED

PROP

INPUT FORM

NUMBER OF COPIES RECEIVED
3 Signed

DESCRIPTION *RE out 7-7-77 ITR*

Consists of information regarding
Overpressure Protection.....

REACTOR VESSEL OVERPRESSURIZATION
DISTRIBUTION PER G. ZECH 10-21-76

PLANT NAME: St. Lucie Unit No. 1
RJL 8/11/77 (1-P)

ENCLOSURE

ACKNOWLEDGED

DO NOT REMOVE

SAFETY FOR ACTION/INFORMATION

BRANCH CHIEF: (5)	Davis		
LIC. ASST:	Reeves		
PROJECT MANAGER:	Diggs		

INTERNAL DISTRIBUTION

REG FILE			
NRC PDR			
I & E (2)			
OELD			
GOSSICK & STAFF			
BOSNAK			
PAWLICKI			
NOVAK			
EISENHUT			
SHAO			
BAER			
BUTLER			
ZECH			


EXTERNAL DISTRIBUTION

LPRD: FT. Pierce, FLA.		
TIC:		
NSIC:		
ACRS 16 CYS NOT SENT TO IA SAT. B		

CONTROL NUMBER

MA 4

772230243

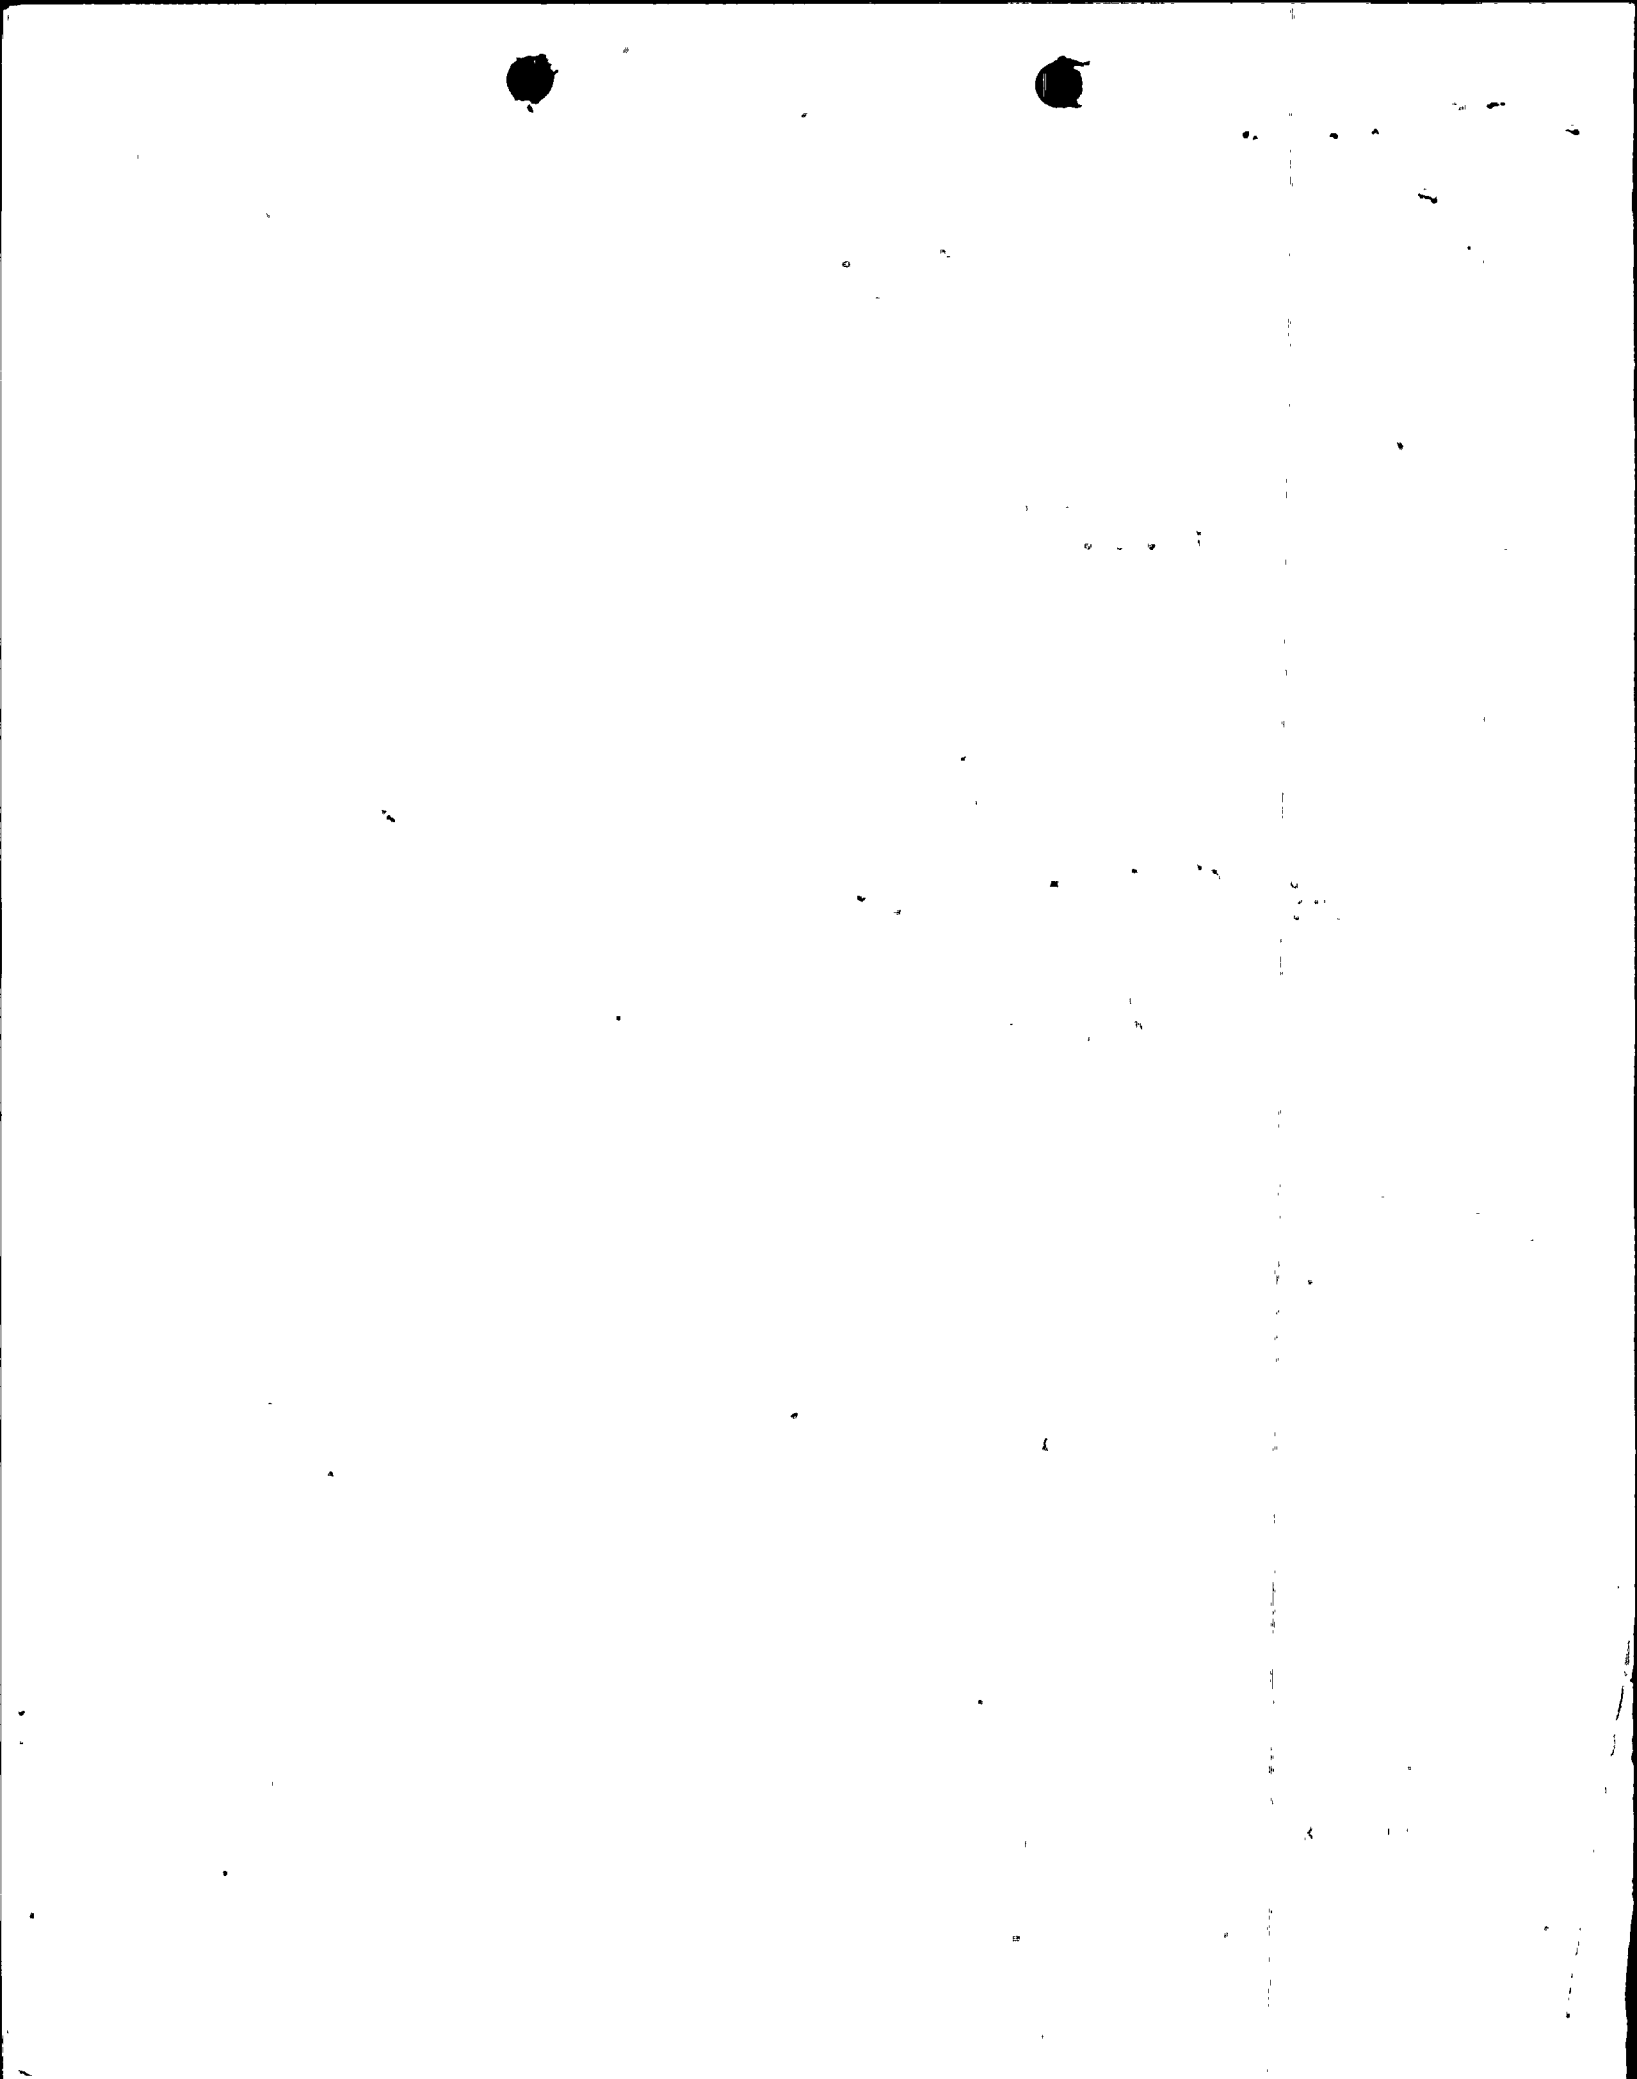



August 8, 1977
L-77-249

Office of Nuclear Reactor Regulation
Attention: Mr. Don K. Davis, Acting Chief
Operating Reactors Branch #2
Division of Operating Reactors
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555



Dear Mr. Davis:

Re: St. Lucie Unit 1
Docket No. 50-335
Overpressure Protection

Regulatory

File Cy.

After reviewing your letter of July 7, 1977, we have elected to use dual setpoint power operated relief valves (PORV's) to provide short-term overpressure protection at St. Lucie Unit 1. The interim PORV fix will be installed before the end of 1977. A description of the interim fix will be forwarded to you within approximately 2 weeks.

We are evaluating long-term protection options and will forward a description of our planned long-term overpressure protection system within approximately 4 weeks.

Very truly yours,

Robert E. Uhrig
Robert E. Uhrig
Vice President

REU/MAS/cpc

Attachment

cc: Mr. Norman C. Moseley, Region II
Robert Lowenstein, Esquire

772230243

