

50-335

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL

FILE NUMBER

TO:
Mr. Don K. Davis

FROM:
Florida Power & Light Company
Miami, Florida
Robert E. Uhrig

DATE OF DOCUMENT
5/20/77

DATE RECEIVED
5/23/77

LETTER
 ORIGINAL
 COPY

NOTORIZED
 UNCLASSIFIED

PROP

INPUT FORM

NUMBER OF COPIES RECEIVED

1519

DESCRIPTION

Consists of information regarding their review of their Reactor Coolant System cooldown, fill and vent, and heatup procedures.

(1-P)

PLANT NAME:
St Lucie Unit No. 1

RJL

ENCLOSURE

ACKNOWLEDGED

DO NOT REMOVE

SAFETY

FOR ACTION/INFORMATION

ENVIRO

ASSIGNED AD:		ASSIGNED AD:
BRANCH CHIEF: (5)	ZIEMANN	BRANCH CHIEF:
PROJECT MANAGER:	REEVES	PROJECT MANAGER:
LIC. ASST.:	DIGGS	LIC. ASST.:

INTERNAL DISTRIBUTION

<input checked="" type="checkbox"/> REG FILE	SYSTEMS SAFETY	PLANT SYSTEMS	SITE SAFETY &
<input checked="" type="checkbox"/> NRC PDR	HEINEMAN	TEDESCO	ENVIRO ANALYSIS
<input checked="" type="checkbox"/> I & E (2)	SCHROEDER	BENAROYA	DENTON & MULLER
<input checked="" type="checkbox"/> OELD		LAINAS	
GOSSICK & STAFF	ENGINEERING	IPPOLITO	ENVIRO TECH.
MIPC	MACARRY	KIRKWOOD	ERNST
CASE	BOSNAK		BALLARD
HANAUER	SIHWEIL	OPERATING REACTORS	SPANGLER
HARLESS	PAWLICKI	STELLO	
			SITE TECH.
PROJECT MANAGEMENT	REACTOR SAFETY	OPERATING TECH.	GAMMILL
BOYD	ROSS	EISENHUT	STEPP
P. COLLINS	NOVAK	SHAO	HULMAN
HOUSTON	ROSZTOCZY	BAER	
PETERSON	CHECK	BUTLER	SITE ANALYSIS
MELTZ		GRIMES	VOLLMER
HELTEMES	AT & I		BUNCH
SKOVHOLT	SALTZMAN		J. COLLINS
	RUTBERG		KREGER

EXTERNAL DISTRIBUTION


CONTROL NUMBER


<input checked="" type="checkbox"/> LPDR: FT. PIERCE FLA.	NAT. LAB:	BROOKHAVEN NAT. LAB.
<input checked="" type="checkbox"/> TIC:	REG V. IE	ULRIKSON (ORNL)
<input checked="" type="checkbox"/> NSIC:	LA PDR	
<input checked="" type="checkbox"/> CONSULTANTS:		
<input checked="" type="checkbox"/> ACRS 16 CYS HOLDING/SENT AS CAT B		

771450064

MA 4

60

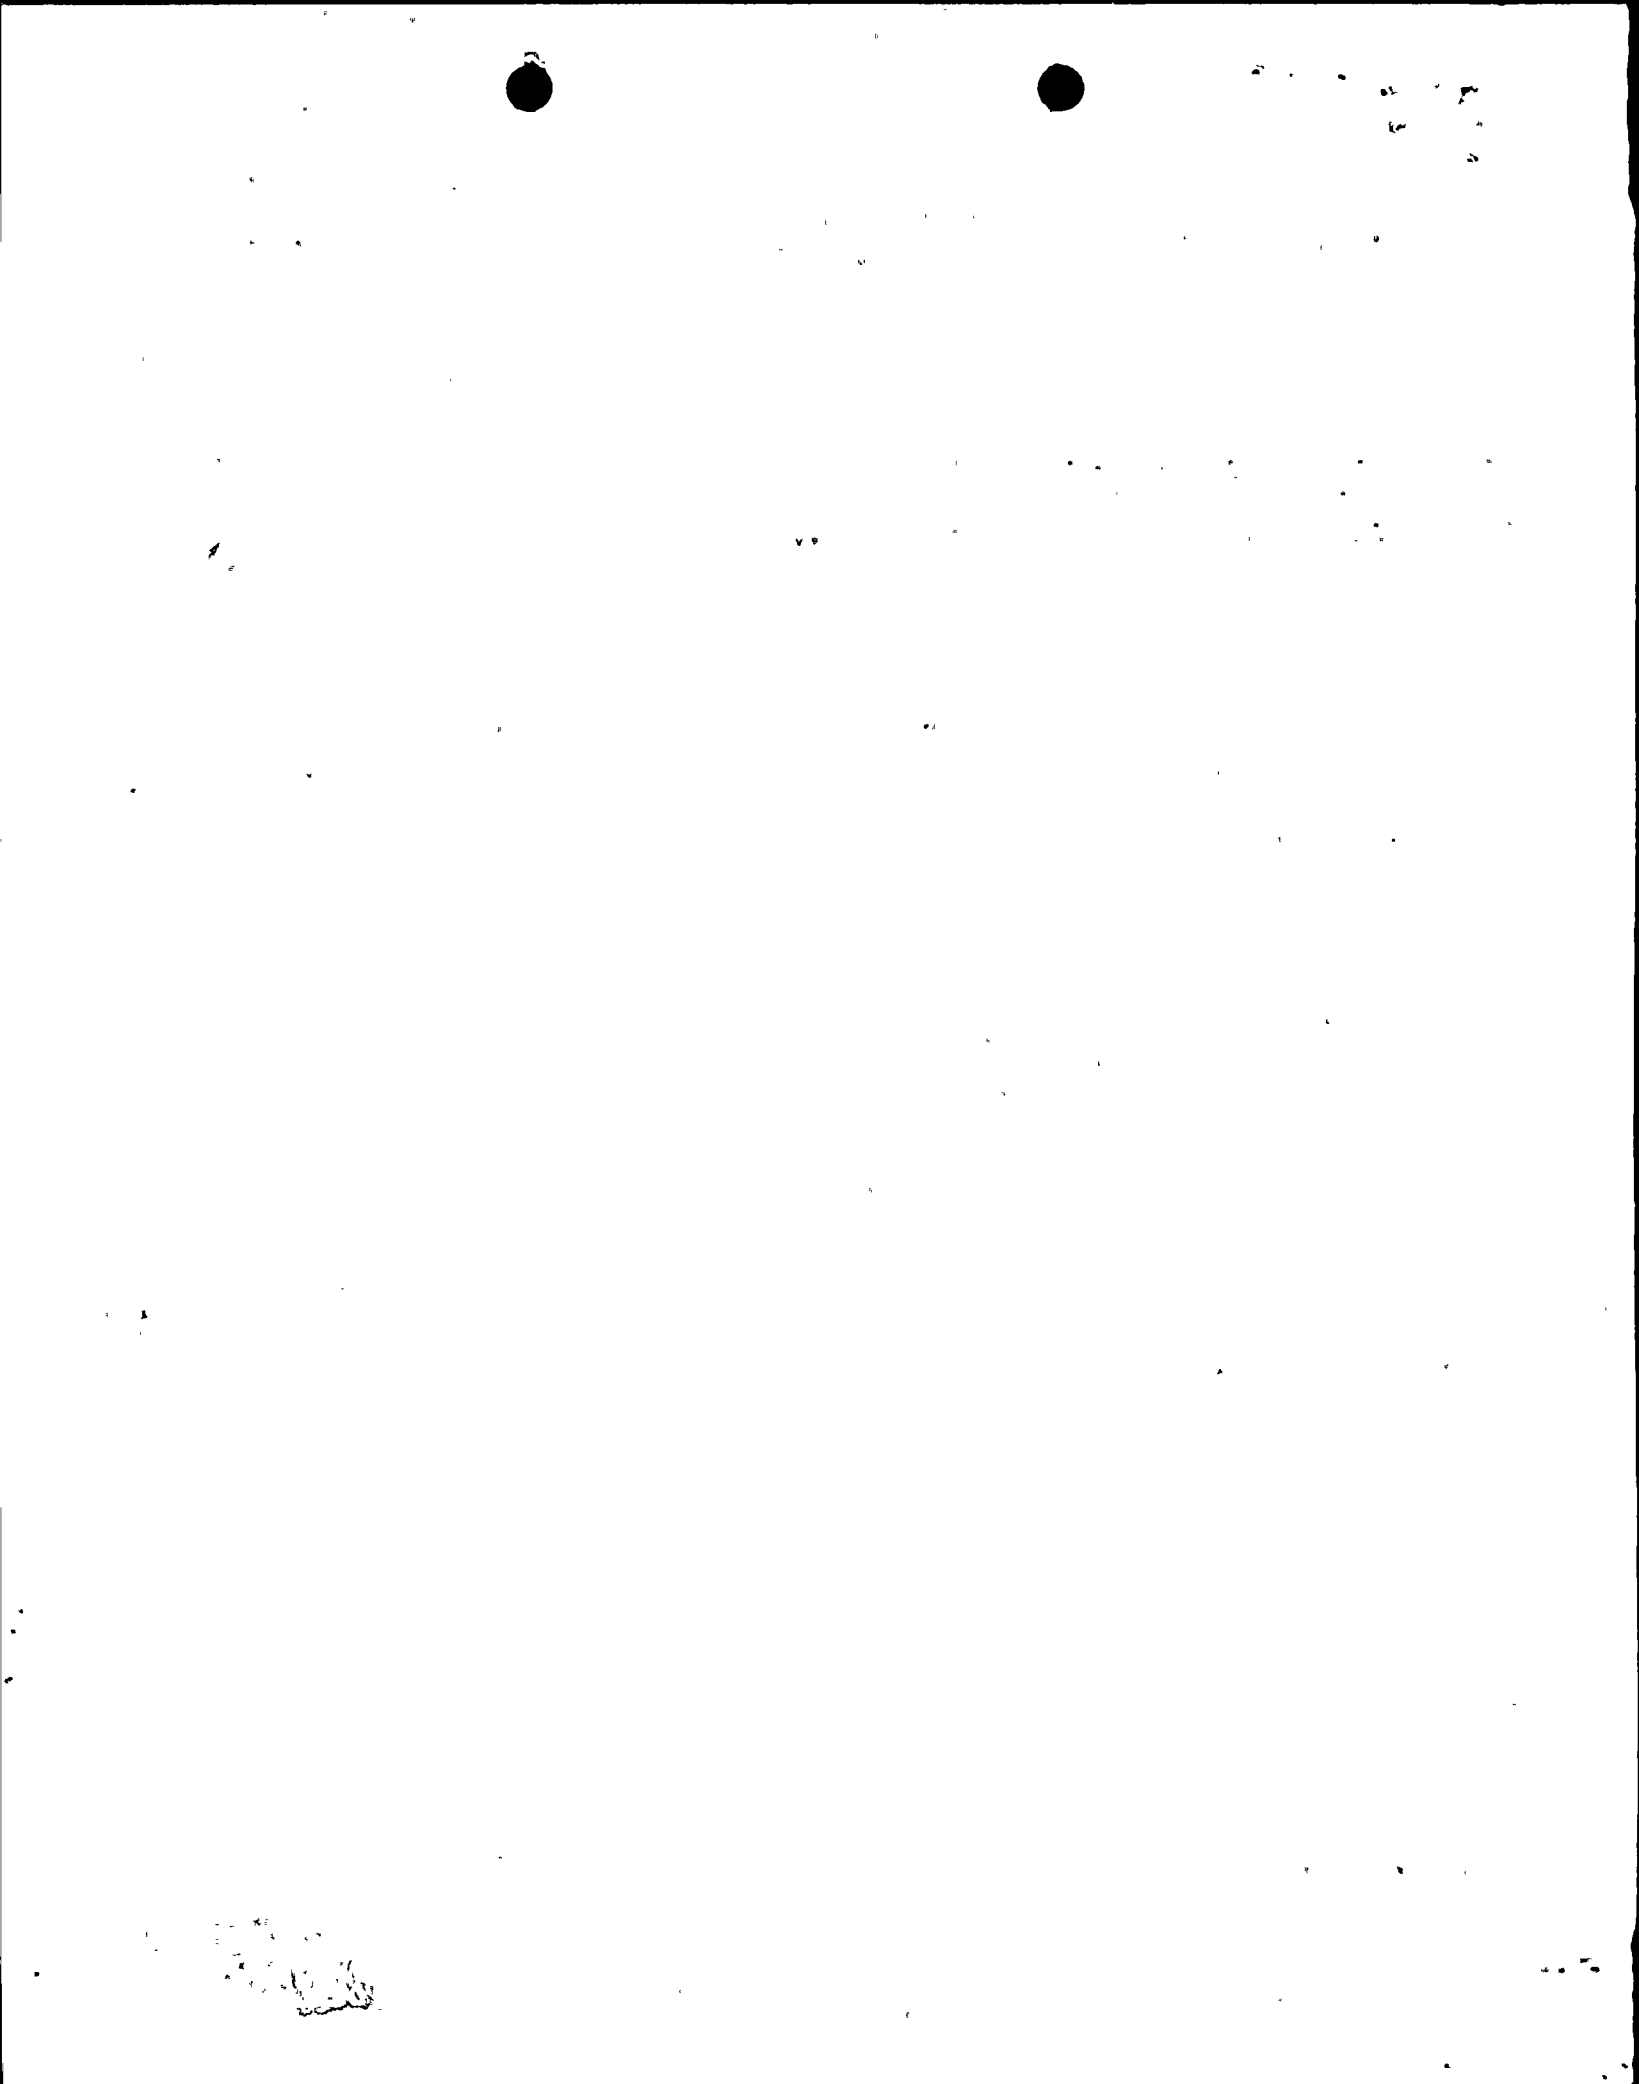

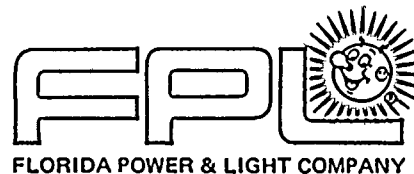

May 20, 1977
L-77-152



Office of Nuclear Reactor Regulation
Attention: Mr. Don K. Davis, Acting Chief
Operating Reactors Branch #2
Division of Operating Reactors
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Dear Mr. Davis:

Re: St. Lucie Unit 1
Docket No. 50-335
Overpressure Protection

Regulatory Docket File

In response to your letter of April 1, 1977, we have conducted a review of our Reactor Coolant System (RCS) cooldown, fill and vent, and heatup procedures, and have verified that they contain appropriate steps to determine and minimize the temperature profile within the RCS before a reactor coolant pump is started in a water-solid condition. We have also verified that our procedures have been revised in accordance with our letters of October 18, 1976 (L-76-361) and February 28, 1977 (L-77-65).

Very truly yours,

Robert E. Uhrig
Vice President

REU/MAS/cpc

cc: Mr. Norman C. Moseley, Region II
Robert Lowenstein, Esquire

MAY 23 1977

771450064

1977 MAY 23 PM 3 19

RECEIVED DOCUMENT
PROCESSING UNIT