
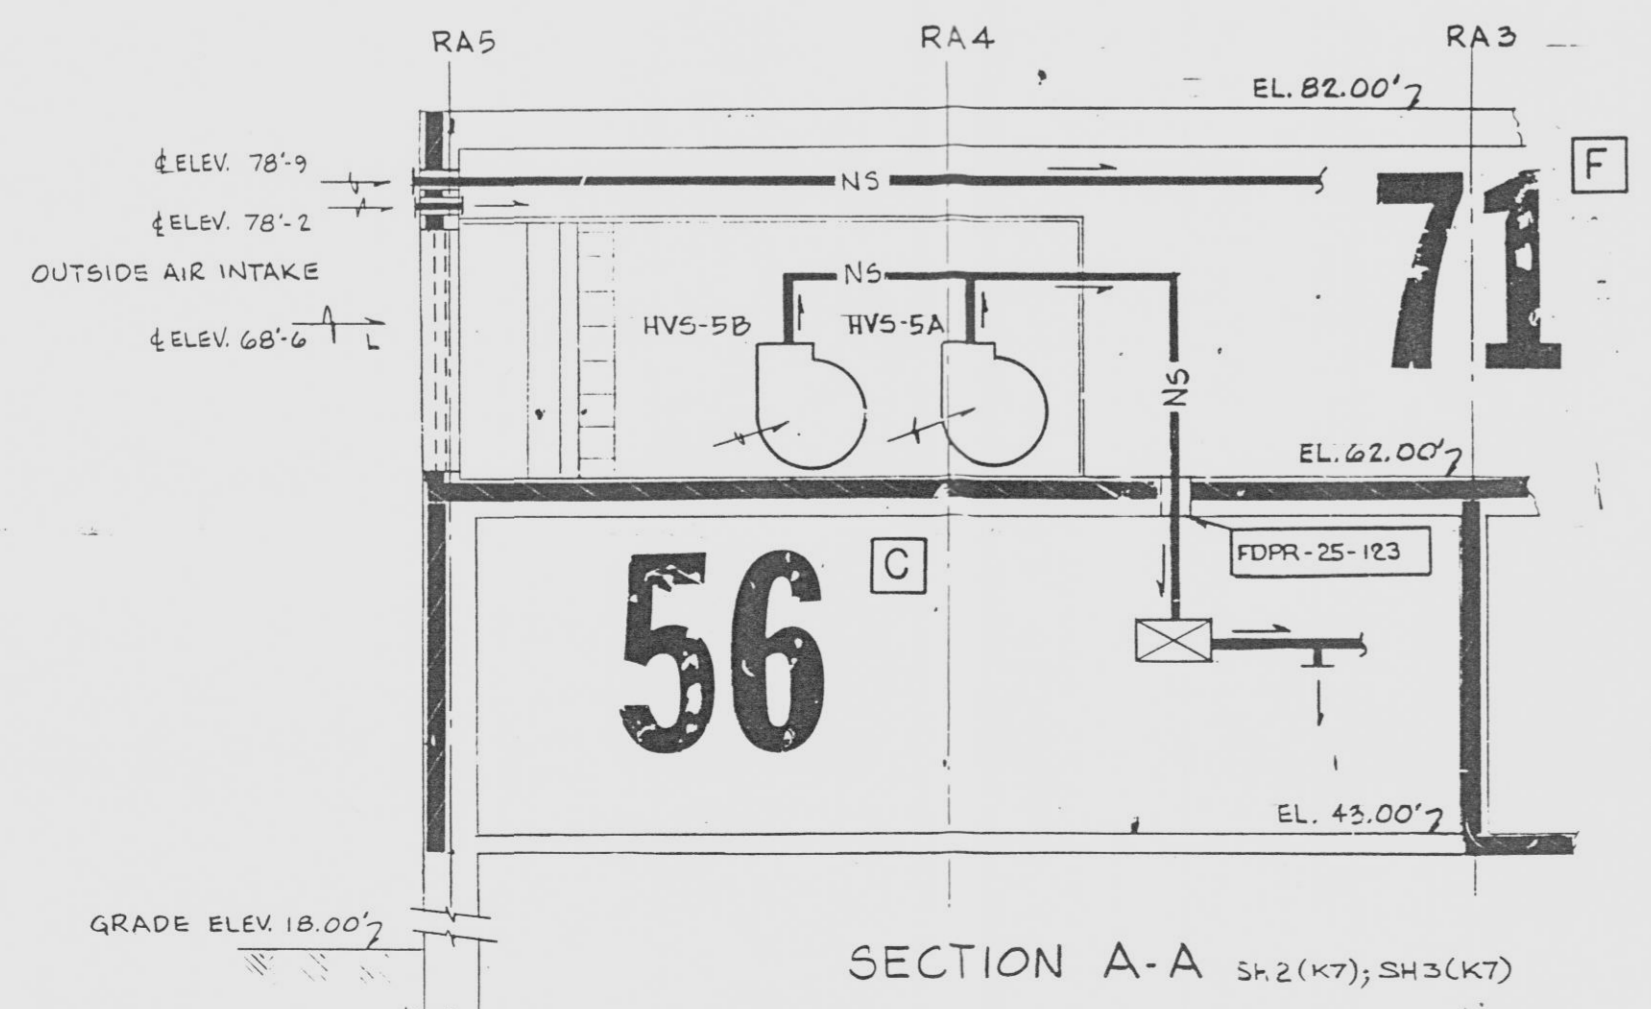
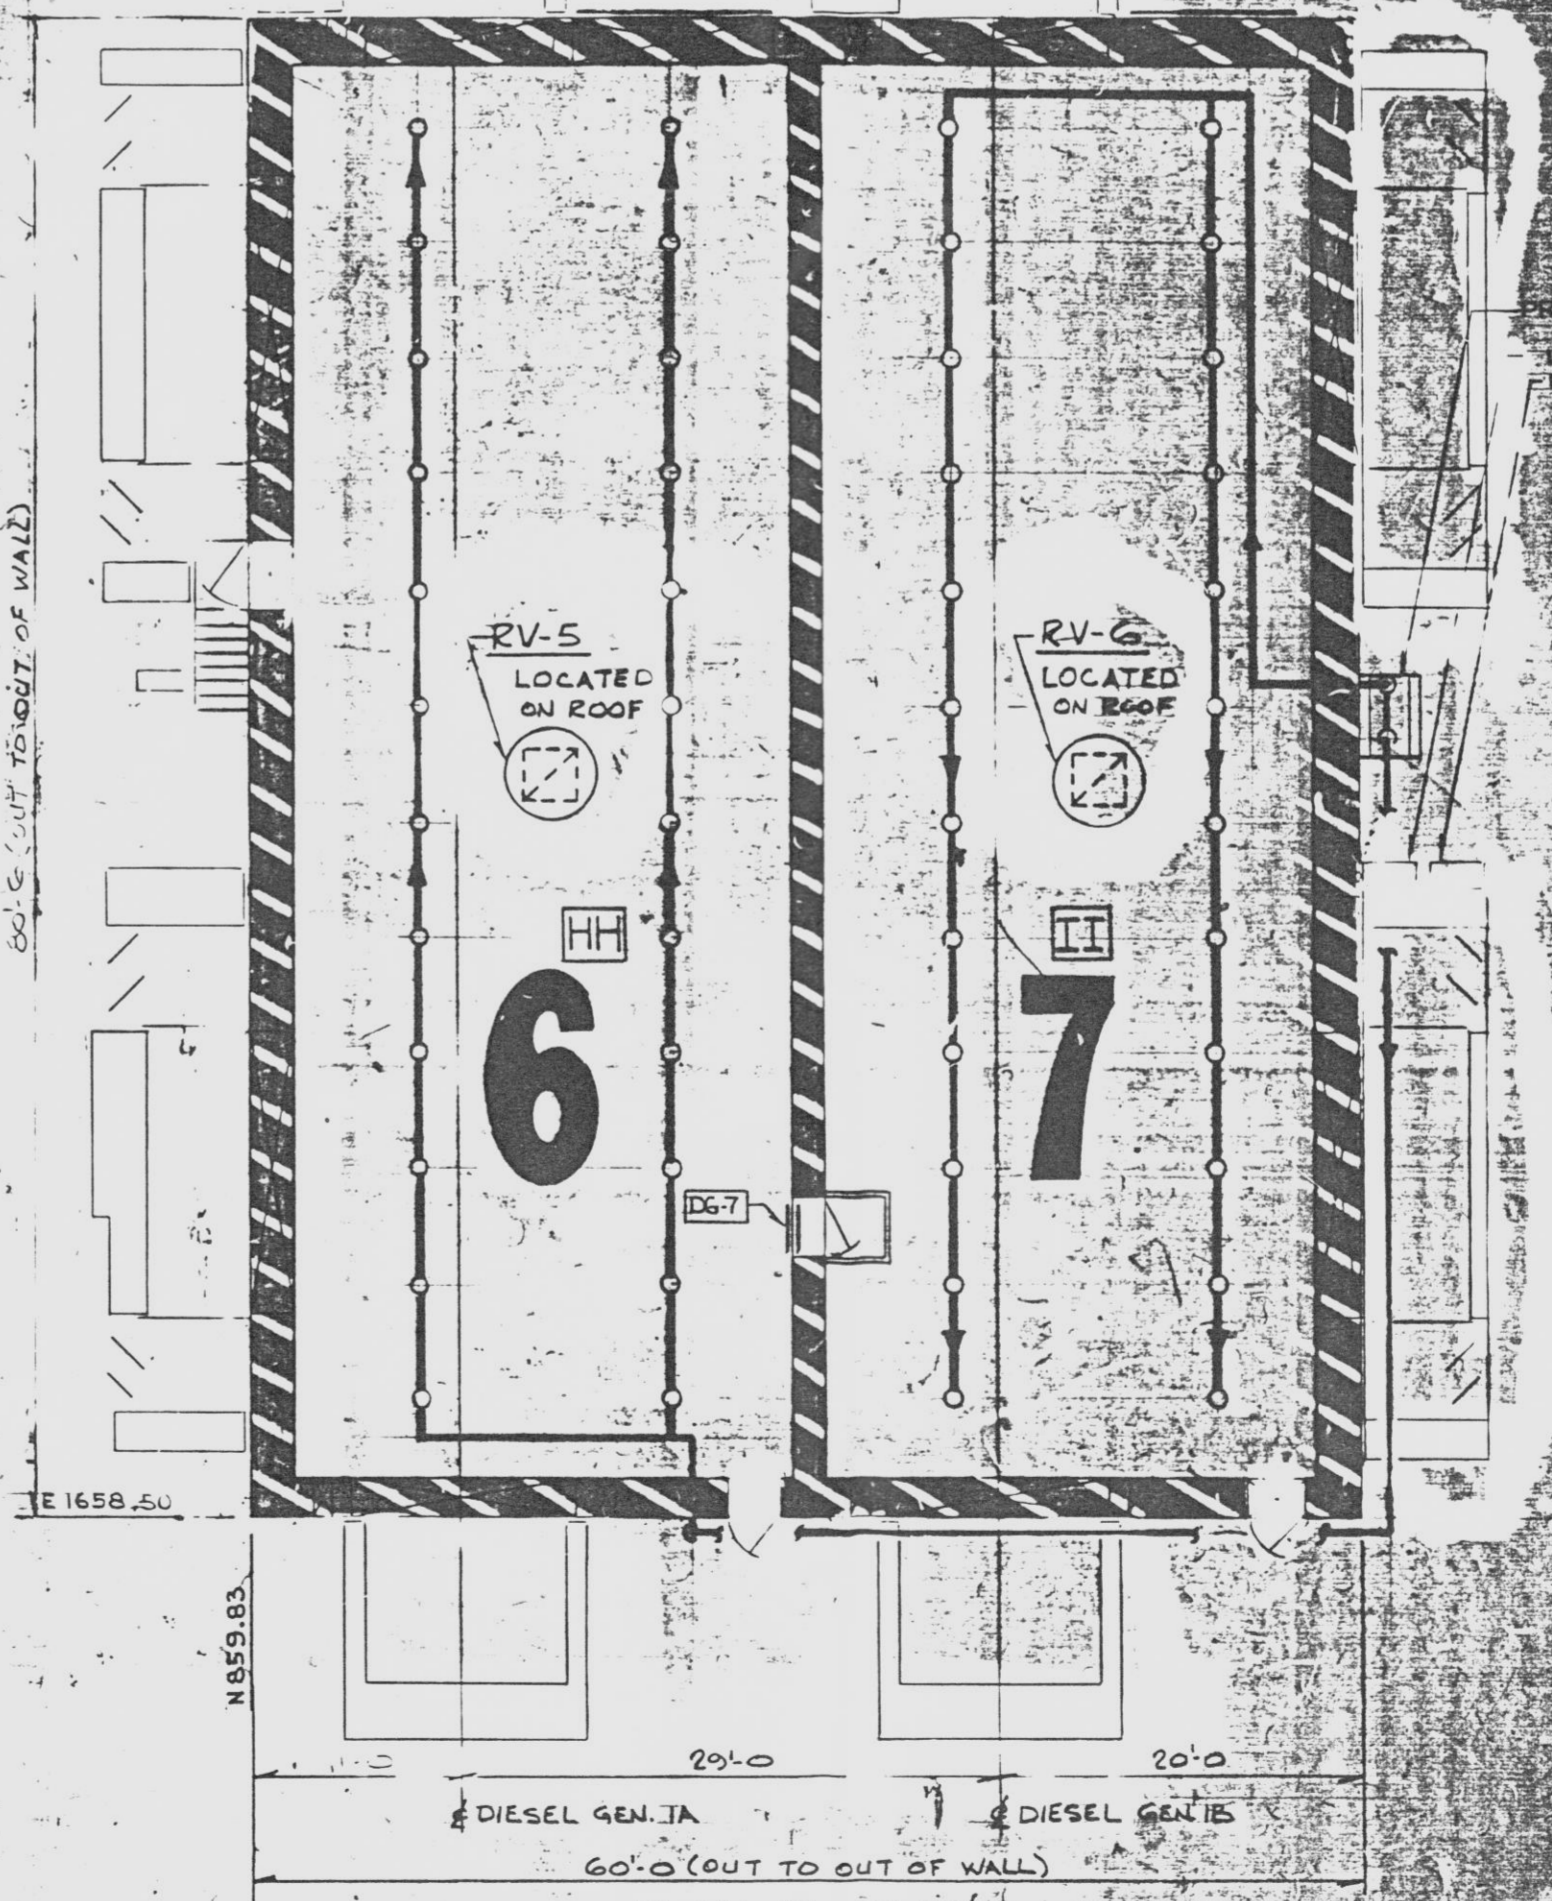
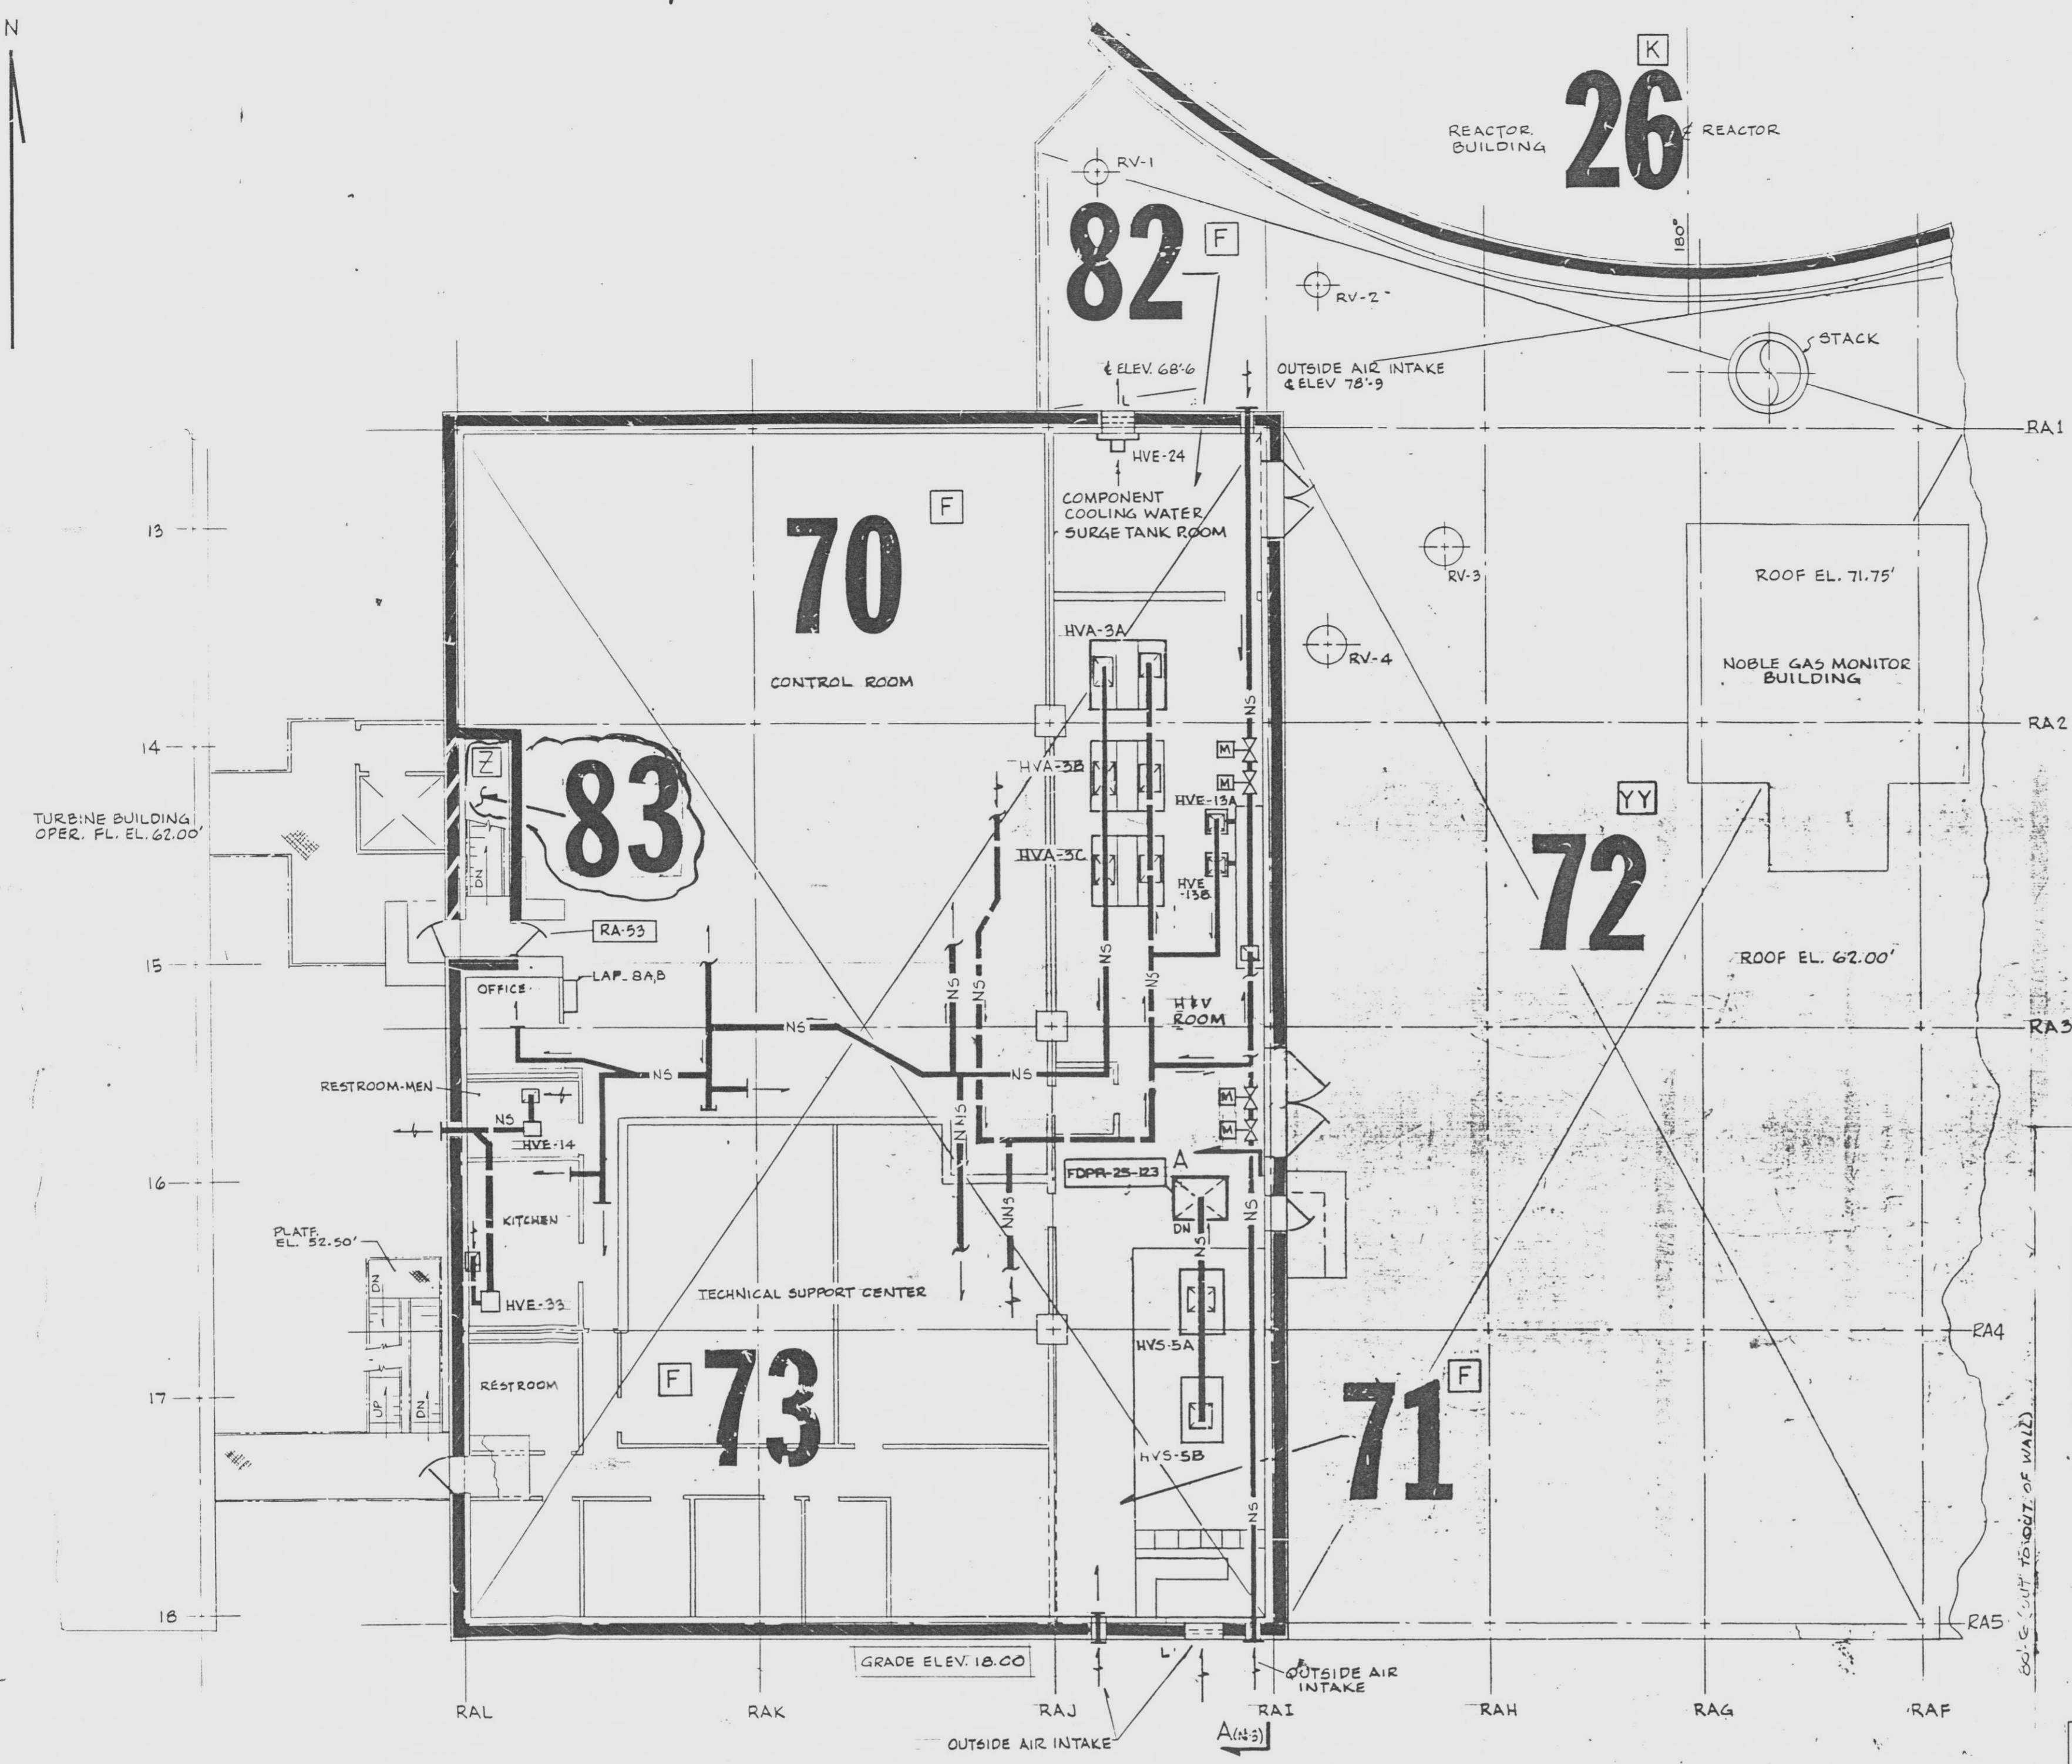


LEGEND

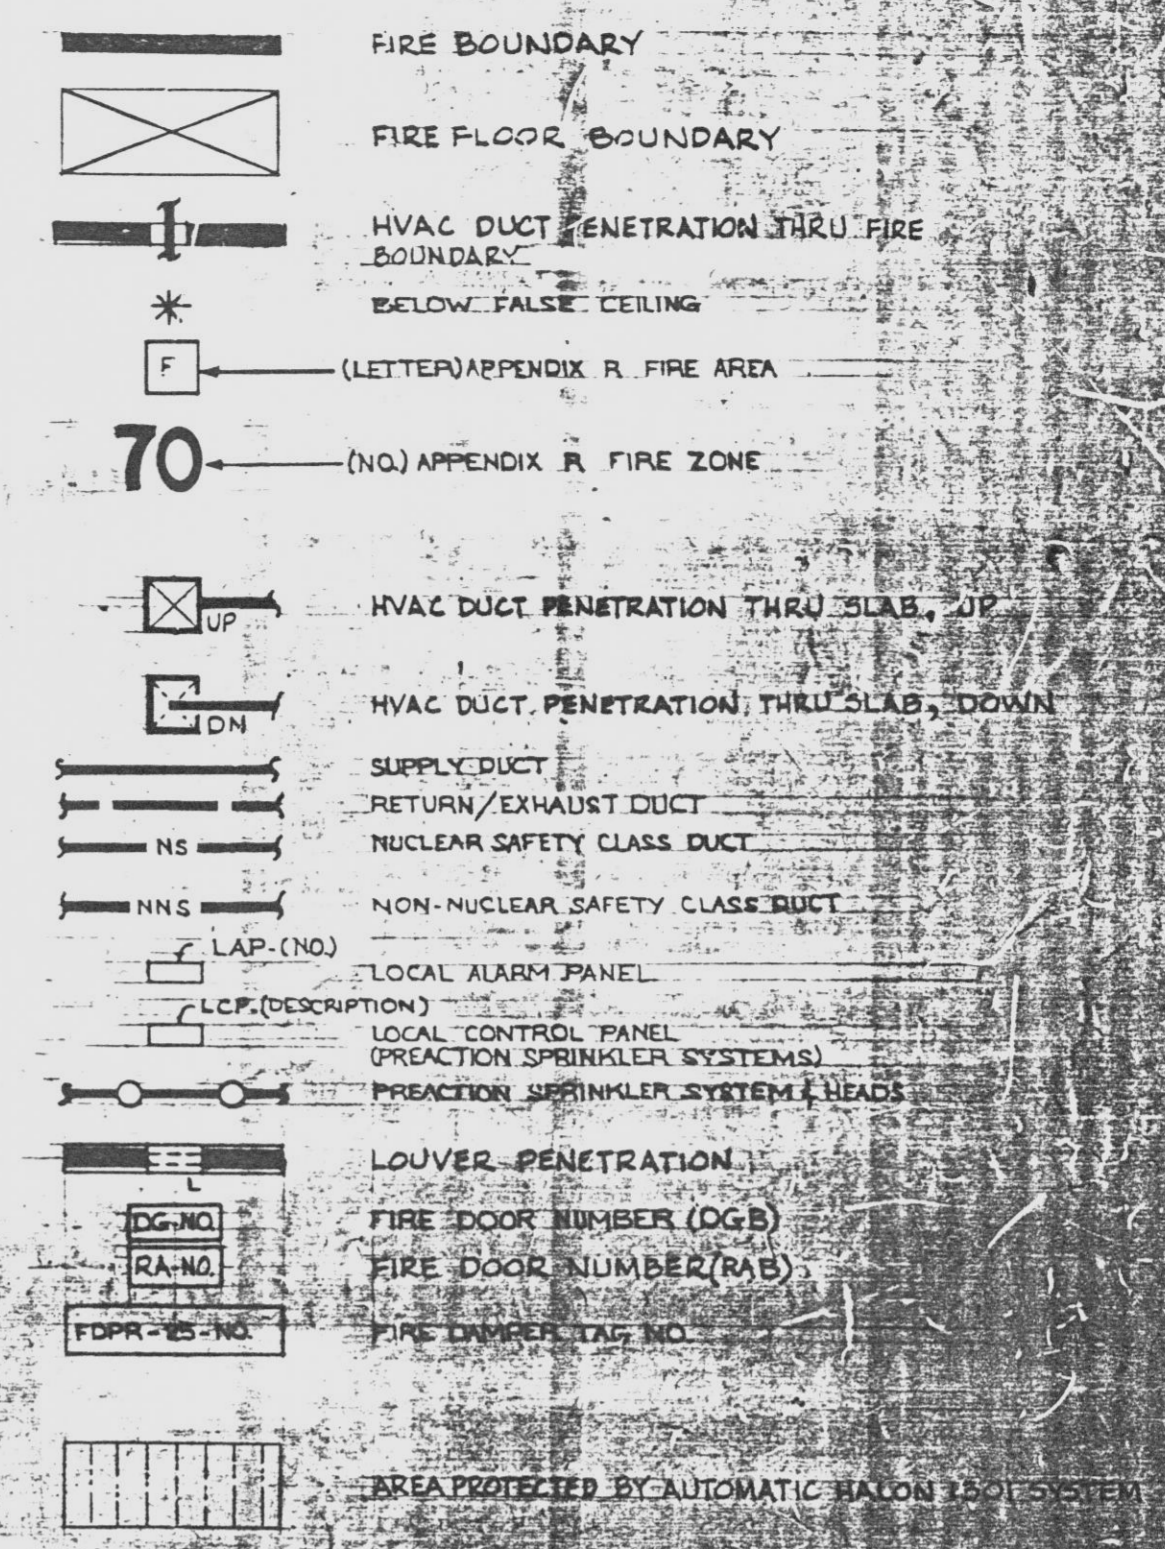

NOTES:

- FIRE DAMPER POSITION SWITCH INDICATOR SHOULD LOCAL ALARM PANEL.
- FIRE DAMPER FLEXIBLE LINKS HAVE A MINIMUM RATING OF 212°F. FIRE DAMPERS FOR 212°F AND HAVE ELECTROTHERMAL LINKS.
- ALL DOORS LABELED RA OR RAB MUST HAVE A 5 HOUR RATING UNLESS DESIGNATED AS WATER TIGHT DOOR.

FLORIDA POWER & LIGHT COMPANY  
 ST. LUCIE PLANT  
 1970-411.000000 INSTALLATION  
 FIRE PROTECTION  
 REACTOR AUX BLDG. EL. 62.00 DIESEL GEN BLDG. EL. 22.67 FIRE DOORS, DAMPERS & SPRINKLER SYSTEMS.

EBASCO SERVICES INCORPORATED  
 PROJECT NO. 8770-G-165  
 SHEET NO. SH 2

NO.	DATE	REVISION	BY	CHK	APPROVED	NO.	DATE	REVISION	BY	CHK	APPROVED
1	8-11-76	APP'D BY A.J. LIGELOW FL. P.E. NO. 51840 GENERAL ADDED (G-4), (M-4) (G-13, 15) (L-12, 17) (R-10, 11) REF. W/C	AJL			1	8-11-76	INITIAL ISSUANCE PER INT. 54-10			
2	8-11-76	REVISION 1: ADD (F-1) ZONE 2: (F-1) AREA 2 (KL-18, 19) NOTES	WJ			2	8-11-76				

E