



Indian Point Energy Center
450 Broadway, GSB
P.O. Box 249
Buchanan, N.Y. 10511-0249
Tel (914) 254-6700

Anthony J. Vitale
Site Vice President

NL-18-037

May 14, 2018

U.S. Nuclear Regulatory Commission
ATTN: Document Control Desk
11555 Rockville Pike
Rockville, MD 20852

Subject: 2017 Annual Radiological Environmental Operating Report
Indian Point Unit Nos. 1, 2 and 3
Docket Nos. 50-003, 50-247, and 50-286

Dear Sir or Madam:

Enclosed please find one copy of the Entergy Nuclear Operations, Inc. Indian Point Energy Center Annual Radiological Environmental Operating Report for the period January 1, 2017 to December 31, 2017.

This report is submitted in accordance with facility Technical Specification, Appendix A, Section 5.6.2 associated with license numbers DPR-5, DPR-26 and DPR-64 for Indian Point Unit Nos. 1, 2 and 3 respectively. There are no new regulatory commitments being made by Entergy in this correspondence.

IE25
NMSSDI
NRR
NMSS

Should you or your staff have any questions regarding this matter, please contact Mr. Robert Walpole, Manager, Regulatory Assurance at (914) 254-6710.

Sincerely,



AJV/trj

Enclosures: 2017 Annual Radiological Environmental Operating Report

cc: Mr. David Lew, Acting Regional Administrator, NRC Region I
Mr. Richard V. Guzman, Senior Project Manager, NRC NRR DORL
NRC Resident Inspector's Office, Indian Point Energy Center
Ms. Kimberly Conway, IPEC NRC Unit 1 Project Manager
Mr. Timothy Rice, Bureau of Hazardous Waste & Radiation Management, NYSDEC
Ms. Bridget Frymire, New York State Public Service Commission
Ms. Alicia Barton, President and CEO, NYSERDA

ENCLOSURE TO NL-18-037

2017 Annual Radiological Environmental Operating Report

Entergy Nuclear Operating, Inc.
Indian Point Unit Nos. 1, 2, and 3
Docket Nos. 50-003, 50-247, and 50-286

ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

ENTERGY NUCLEAR

INDIAN POINT NUCLEAR GENERATING STATION
UNITS 1, 2, AND 3

Docket No. 50-003 Indian Point Unit 1 (IP1)
Docket No. 50-247 Indian Point Unit 2 (IP2)
Docket No. 50-286 Indian Point Unit 3 (IP3)

January 1 - December 31, 2017

TABLE OF CONTENTS

		<u>Page</u>
EXECUTIVE SUMMARY		vii
1.0	INTRODUCTION	1-1
1.1	Overview	1-1
2.0	BACKGROUND	2-1
2.1	Site Description	2-1
2.2	Program Background	2-1
2.3	Program Objectives	2-1
3.0	PROGRAM DESCRIPTION	3-1
3.1	Sample Collection	3-1
3.2	Sample Analysis	3-1
3.3	Sample Collection and Analysis Methodology	3-1
3.3.1	Direct Radiation	3-1
3.3.2	Airborne Particulates and Radioiodine	3-1
3.3.3	Precipitation	3-2
3.3.4	Drinking Water	3-2
3.3.5	Ground Water	3-2
3.3.6	Soil	3-2
3.3.7	Broad Leaf Vegetation	3-2
3.3.8	Hudson River Water	3-2
3.3.9	Hudson River Bottom Sediment	3-3
3.3.10	Hudson River Shoreline Soil	3-3
3.3.11	Hudson River Aquatic Vegetation	3-3
3.3.12	Fish and Invertebrates	3-3
3.3.13	Land Use Census	3-3
3.4	Statistical Methodology	3-4
3.4.1	Lower Limit of Detection and MDC	3-4
3.4.2	Table Statistics	3-5

TABLE OF CONTENTS (continued)

	<u>Page</u>
4.0 RESULTS AND DISCUSSION	4-1
4.1 Direct Radiation	4-3
4.2 Airborne Particulates and Radioiodine	4-4
4.3 Precipitation	4-4
4.4 Drinking Water	4-4
4.5 Ground Water	4-5
4.6 Soil	4-5
4.7 Broad Leaf Vegetation	4-5
4.8 Hudson River Water	4-5
4.9 Hudson River Bottom Sediment	4-5
4.10 Hudson River Shoreline Soil	4-6
4.11 Hudson River Aquatic Vegetation	4-6
4.12 Fish and Invertebrates	4-6
4.13 Land Use Census	4-6
4.14 Conclusion	4-7
5.0 REFERENCES	5-1
APPENDICES:	
A. ENVIRONMENTAL SAMPLING AND ANALYSIS REQUIREMENTS	A-1
B. RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM RESULTS SUMMARY	B-1
C. HISTORICAL TRENDS	C-1
D. INTERLABORATORY COMPARISON PROGRAM	D-1
• Teledyne Environmental Laboratory	
• TLD Dosimeter Testing	

LIST OF FIGURES

<u>FIGURE</u>	<u>TITLE</u>	<u>Page</u>
A-1	Sampling Locations (Within Two Miles)	A-5
A-2	Sampling Locations (Greater Than Two Miles)	A-6
A-3	Additional Sampling Locations	A-7
C-1	Direct Radiation, Annual Summary, 2007 to 2017	C-3
C-2	Radionuclides in Air – Gross Beta, 2007 to 2017	C-5
C-3	Radionuclides in Hudson River Water, Inlet & Discharge 2007 to 2017	C-7
C-4	Radionuclides in Drinking Water, 2007 to 2017	C-9
C-5	Radionuclides in Shoreline Soil, 2007 to 2017	C-11
C-6	Broad Leaf Vegetation, 2007 to 2017	C-13
C-7	Radionuclides in Fish & Invertebrates, 2007 to 2017	C-15
C-9	Radionuclides in Bottom Sediment, 2007 to 2017	C-18

LIST OF TABLES

<u>TABLE</u>	<u>TITLE</u>	<u>Page</u>
A-1	Indian Point REMP Sampling Station Locations	A-2
A-2	Lower Limit of Detection Requirements for Environmental Sample Analysis	A-8
A-3	Reporting Levels for Radioactivity Concentrations in Environmental Samples	A-10
B-1	Sampling Summary, 2017	B-2
B-1a	2017 Air Sampling Deviations	B-3
B-1b	2017 Other Media Deviations	B-3
B-2	Radiological Environmental Monitoring Program Summary Indian Point Energy Center – 2017	B-4
B-3	Direct Radiation, Quarterly Data – 2017	B-10
B-4	Direct Radiation, 2007 through 2017 Data	B-11
B-5	Direct Radiation, Inner and Outer Rings – 2017	B-12
B-6	Gross Beta Activity in Airborne Particulate Samples–2017	B-13
B-7	Iodine-131 in Airborne Charcoal Samples – 2017	B-15
B-8	Gamma Emitters in Airborne Particulate Samples– 2017	B-17
B-9	Radionuclides in Rainwater Samples – 2017	B-21
B-10	Radionuclides in Drinking Water Samples – 2017	B-22
B-11	Radionuclides in Groundwater Samples – 2017	B-26
B-12	Gamma Emitters in Soil Samples – 2017	B-27
B-13	Gamma Emitters in Broadleaf Vegetation Samples – 2017	B-28
B-14	Radionuclides in River Water Samples – 2017	B-37
B-15	Gamma Emitters in Bottom Sediment Samples – 2017	B-41
B-16	Radionuclides in Shoreline Soil Samples – 2017	B-43
B-17	Gamma Emitters in Aquatic Vegetation Samples – 2017	B-46
B-18	Radionuclides in Fish / Invertebrates – 2017	B-49
B-19	Land Use Census, Residence & Milk Animal Results 2017	B-55
B-20	Land Use Census – 2017 – Unrestricted Area Boundary and Nearest Residences	B-56

LIST OF TABLES (Continued)

<u>TABLE</u>	<u>TITLE</u>	<u>Page</u>
C-1	Direct Radiation Annual Summary, 2007 – 2017	C-2
C-2	Radionuclides in Air, 2007 - 2017	C-4
C-3	Radionuclides in Hudson River Water, Inlet & Discharge 2007 to 2017	C-6
C-4	Radionuclides in Drinking Water 2007 to 2017	C-8
C-5	Radionuclides in Shoreline Soil, 2007 to 2017	C-10
C-6	Radionuclides in Broadleaf Vegetation, 2007 to 2017	C-12
C-7	Radionuclides in Fish & Invertebrates, 2007 to 2017	C-14
C-8	River Water Discharge Area Tritium, REMP vs Effluent	C-16
C-9	Radionuclides in Bottom Sediment, 2007 to 2017	C-17
D-2.1	Ratio of Agreement	D-2
D-3.1	Analytics Interlaboratory Comparison Program and Ratio of Agreement	D-3
D-3.2	DOE Interlaboratory Comparison Program and Ratio of Agreement	D-7
D-3.3	ERA Interlaboratory Comparison Program and Ratio of Agreement	D-8
D-4.1	Percent of Individual Dosimeters That Passed EDC Internal Criteria, 2017	D-9
D-4.2	Mean Dosimeter Analysis (N=6), 2017	D-10
D-4.3	Summary of Independent Dosimeter Testing, 2017	D-10

EXECUTIVE SUMMARY

EXECUTIVE SUMMARY

INTRODUCTION

This report summarizes the results of the Radiological Environmental Monitoring Program (REMP) conducted in the vicinity of Indian Point Energy Center (IPEC) during the period from January 1 to December 31, 2017. The Indian Point site consists of Units 1, 2 and 3, which are operated by Entergy Nuclear Operations Inc. Unit 1 was retired as a generating facility in 1974, and its reactor is no longer operated.

The REMP has been established to monitor/measure the radiation and radioactivity detectable in the environment that may be attributable to the operation of IPEC. This program, initiated in 1958, includes the collection, analysis, and evaluation of radiological data in order to assess the impact of IPEC on the environment.

SAMPLING AND ANALYSIS

The environmental sampling media collected in the vicinity of IPEC and at distant locations included air particulate filters and charcoal cartridges, soil, drinking water, ground water, broadleaf vegetation, river water, precipitation, shoreline sediment, bottom sediment, aquatic vegetation, fish, and invertebrates.

During 2017 there were 1161 samples collected from the atmospheric, aquatic, and terrestrial environments. This includes 164 exposure measurements which were obtained using environmental thermoluminescent dosimeters (TLDs).

A small number of inadvertent issues were encountered in 2017 in the collection of environmental samples in accordance with the IPEC Offsite Dose Calculation Manual (ODCM). Equipment failures and electrical outages resulted in a small number of instances in which lower than normal sampling volumes were collected at the airborne monitoring stations. A full description of all discrepancies encountered with the environmental monitoring program is presented in the Table B-1 of this report.

There were 1323 analyses performed on the environmental media samples. The analysis of the 2017 Indian Point environmental samples was performed by several laboratories. Thermoluminescent dosimeters were analyzed by Environmental Dosimetry Company (formerly Stanford Associates) of Sterling, MA. Teledyne Brown Engineering, Inc. of Knoxville, TN performed all the remaining analyses for 2017. Samples were analyzed as required by the IPEC ODCM.

LAND USE CENSUS

The annual land use census in the vicinity of IPEC was conducted as required by the IPEC ODCM in May through October. No dairy animals whose milk is used for human consumption were identified within 5 miles of the Station during the census. Due to the difficulty of locating individual gardens and determining those having an area greater than 500 square feet, broadleaf sampling was performed. As allowed for in the ODCM, monthly broad leaf sampling may be used in lieu of a garden census.

SUMMARY OF RESULTS

Samples collected as part of the IPEC REMP continued to contain detectable amounts of naturally-occurring and some man-made radioactive materials. Offsite ambient radiation measurements using environmental TLDs beyond the site boundary ranged between 46 and 81 milli-Roentgens (mR) per year. The range of ambient radiation levels observed with the TLDs is consistent with natural background radiation levels for New York.

Monitoring of the aquatic environment in the area of the station indicated the presence of the following potential station related radioactivity, tritium and cesium-137. The tritium was found in river water at the downstream mixing zone of the discharge at levels that were expected from routine plant operation, or other sources such as fallout from past weapons testing. Low-levels of cesium-137 were detected in Hudson River bottom sediment samples downstream of the discharge as well as three soil samples. The levels detected were consistent with historical findings. No other plant related activity was detected in any offsite samples. The predominant radioactivity for all samples was from non-plant related sources, such as fallout from nuclear weapons tests and naturally occurring radionuclides.

CONCLUSIONS

The 2017 Radiological Environmental Monitoring Program for IPEC resulted in the collection and analysis of over a thousand environmental samples and measurements. The data obtained were used to determine the impact of IPEC's operation on the environment and on the general public.

An evaluation of direct radiation measurements, environmental sample analyses, and dose calculations demonstrates that all applicable federal criteria were met. Furthermore, radiation levels and resulting doses from station operation were a small fraction of those attributed to natural and man-made background radiation.

In summary, the levels of radionuclides in the environment surrounding Indian Point were within the historical ranges, i.e., previous levels resulting from natural and anthropogenic sources for the detected radionuclides. Further, IPEC operations in 2017 did not result in exposure to the public greater than environmental background levels.

SECTION 1.0

INTRODUCTION

1.0 INTRODUCTION

1.1 Overview

The Radiological Environmental Monitoring Program (REMP) for 2017 performed by Entergy for the Indian Point Energy Center (IPEC) is discussed in this report. Since the operation of a nuclear power plant results in the release of small amounts of radioactivity and low levels of radiation, the Nuclear Regulatory Commission (NRC) requires a program to be established to monitor radiation and radioactivity in the environment (Reference 1). This report, which is submitted to the NRC annually per Indian Point Technical Specifications, summarizes the results of measurements of radiation and radioactivity in the environment in the vicinity of the IPEC and at distant locations during the period January 1 to December 31, 2017.

The REMP is used to measure the direct radiation and the airborne and waterborne pathway activity in the vicinity of the Indian Point site. Direct radiation pathways include radiation from buildings and plant structures, airborne and liquid material that might be released from the plant, cosmic radiation, and the naturally occurring radioactive materials in the ground. Analysis of thermoluminescent dosimeters (TLDs), used to measure direct radiation, indicated that there were no increased radiation levels attributable to plant operations.

The airborne pathway includes measurements of air, precipitation, drinking water, and broad leaf vegetation samples. The airborne pathway measurements indicated that there was no adverse radiological impact to the surrounding environment attributed to Indian Point Station operations.

The waterborne pathway consists of Hudson River water, fish and invertebrates, aquatic vegetation, bottom sediment, and shoreline sediment. Measurements of the media comprising the waterborne pathway indicated that there was no adverse radiological impact to the surrounding environment attributed to Indian Point Station operations.

The ground water table is listed after the rain water and drinking water tables for ease of data comparison. However, ground water is not a dose pathway since it is not a drinking water pathway at IPEC.

These results are reviewed by IPEC's staff and have been reported semiannually or annually to the Nuclear Regulatory Commission and others for over 30 years.

This report contains a description of the REMP for IPEC and the conduct of that program in 2017 as required by the IPEC ODCM. Also included are summaries and discussions of the results of the 2017 program, trend analyses (where appropriate), comparison to historical results and evaluation of any potential impact on the environment. Results of the annual land use census, as well as the inter-laboratory comparison program are included, per the ODCM requirements.

SECTION 2

BACKGROUND

2.0 BACKGROUND

2.1 Site Description

The Indian Point site occupies 239 acres on the east bank of the Hudson River on a point of land at Mile Point 42.6. The site is located in the Village of Buchanan, Westchester County, New York. Three nuclear reactors, Indian Point Unit Nos. 1, 2 and 3, and associated buildings occupy approximately 35 acres. Unit 1 began operation in 1962 and was retired as a generating facility in 1974. Units 2 and 3 began operation 1974 and 1978. Indian Point Units 1 and 2 are owned by Entergy Nuclear Indian Point 2, LLC and Unit 3 is owned by Entergy Nuclear Indian Point 3 LLC. All three units are operated by Entergy Nuclear, although only Units 2 and 3 continue to operate.

2.2 Program Background

Environmental monitoring and surveillance have been conducted at Indian Point since 1958, four years prior to the start-up of Unit 1. The pre-operational program was designed and implemented to determine the background radioactivity and to measure the variations in activity levels from natural and other sources in the vicinity, as well as fallout from atmospheric nuclear weapons tests. Thus, as used in this report, background levels consist of those resulting from both natural and anthropogenic sources of environmental radioactivity. Accumulation of this background data permits the detection and assessment of environmental activity attributable to plant operations.

2.3 Program Objectives

The current environmental monitoring program is designed to meet two primary objectives:

1. To enable the identification and quantification of changes in the radioactivity of the area.
2. To measure radionuclide concentrations in the environment attributable to operations of the Indian Point site.

To identify changes in activity, the environmental sampling schedule requires that analyses be conducted for specific environmental media on a regular basis. The radioactivity profile of the environment is established and monitored through routine evaluation of the analytical results obtained.

The REMP designates sampling locations for the collection of environmental media for analysis. These sample locations are divided into indicator and control locations. Indicator locations are established near the site, where the presence of environmental radioactivity of plant origin is most likely to be detected. Control locations are established farther away (and upwind/upstream, where applicable) from the site, where the level would not generally be affected by plant discharges. The use of indicator and control locations enables the identification of potential sources of detected radioactivity, thus meeting one of the program objectives.

Verification of expected radionuclide concentrations resulting from effluent releases attributable to the site is another objective of the REMP, which is met by meeting the two primary program objective described above. Verifying projected concentrations through the REMP is difficult since the environmental concentrations resulting from plant releases are typically too small to be detected. Plant related radionuclides were detected in 2017 in very low levels; however, residual radioactivity from atmospheric weapons tests and naturally occurring radioactivity were the predominant sources of radioactivity in the samples collected. Analysis of the 2017 REMP sample results confirms that environmental concentrations which could be attributed to radiological effluents were well below regulatory limits.

SECTION 3

PROGRAM DESCRIPTION

3.0 PROGRAM DESCRIPTION.

To achieve the objectives of the REMP and ensure compliance with the ODCM, sampling and analysis of environmental media are performed as outlined in Table A-1 and described in section 3.3.

3.1 Sample Collection

Entergy personnel perform collection of environmental samples for the Indian Point site, with the exception of fish/invertebrate samples. Collection of fish and invertebrate samples is performed by a contracted environmental vendor, Normandeau Associates, Inc.

3.2 Sample Analysis

The analysis of the 2017 Indian Point environmental samples was performed by several laboratories. Thermoluminescent dosimeters were analyzed by Environmental Dosimetry Company (formerly Stanford Associates) of Sterling, MA. Teledyne Brown Engineering, Inc. of Knoxville, TN performed all the remaining analyses.

3.3 Sample Collection and Analysis Methodology

3.3.1 Direct Radiation

Direct gamma radiation is measured using integrating calcium sulfate thermoluminescent dosimeters (TLDs), which provide cumulative measurements of radiation exposure (i.e., total integrated exposures in milli-roentgen, mR) for a given period. The area surrounding the Indian Point site is divided into 16 compass sectors. Each sector has two TLD sample locations. The inner ring is located near the site boundary at approximately 1 mile (1.6 km). The outer ring is located at approximately 5 miles (8 km) from the site (6.7- 8.0 km), see Figures A-1 and A-2. Additional TLD locations include a control location at Roseton (20.7 miles north) and eight locations of special interest. In total, there are 41 TLD sample sites, designated DR-1 through DR-41, with two TLDs placed at each site. TLDs are collected and processed on a quarterly basis. The results are reported as mR per standard quarter (91 days). The data reported is the average of the two TLDs from each sample site.

3.3.2 Airborne Particulates and Radioiodine

Air samples were taken at eight locations varying in distance from 0.28 to 20.7 miles (0.4 to 33 km) from the plant. These locations represent one control at sampling station 23 (A5) and seven indicator locations. These indicator locations are at sampling stations 4 (A1), 5 (A4), 27, 29, 44, 94 (A2), and 95 (A3). The locations are shown on Figures A-1, A-2, and A-3. The air samples are collected continuously by means of fixed air particulate filters followed by in-line charcoal cartridges. Both filters and cartridges are changed on a weekly basis. The filters are analyzed for gross beta and the cartridge samples for radioiodine. In addition, gamma spectroscopy analysis (GSA) is performed on quarterly composites of the air particulate filters.

3.3.3 Precipitation

Precipitation samples are continuously collected at one indicator location (sampling station 44) and one control location (23); see Figure A-3. They are collected in sample bottles designed to hinder evaporation. They are composited quarterly and analyzed by gamma spectroscopy and for tritium.

3.3.4 Drinking Water

Samples of drinking water are collected monthly from the Camp Field Reservoir (3.4 miles NE, sample station 7, sample designation Wb1) and New Croton Reservoir (6.3 miles SE, sample station 8); see Figure A-3. Each monthly sample is approximately 4 liters and is analyzed for gross beta and gamma-emitting radionuclides. Monthly samples are composited quarterly and analyzed for tritium.

3.3.5 Groundwater Water

Groundwater samples are obtained semi-annually at Lafarge (106.) Samples are analyzed for tritium, strontium-90, and nickel-63 and by gamma spectroscopy.

3.3.6 Soil

Soil samples are collected from two indicator locations (sampling stations 94 and 95), and one control location (23) on an annual basis; see Figure A-3. They are approximately 2 kg in size and consist of about twenty 2-inch deep cores. The soil samples are analyzed by gamma spectroscopy.

3.3.7 Broad Leaf Vegetation

Broad leaf vegetation samples are collected from three locations during the growing season. The indicator locations are sampling stations 94 (Ic2) and 95 (Ic1), and the control location is at sampling station 23 (Ic3). See Figures A-1 and A-2. The samples are collected monthly, when available, and analyzed by gamma spectroscopy. These samples consist of at least 1 kg of leafy vegetation and are used in the assessment of the food product and milk ingestion pathways.

3.3.8 Hudson River Water

Hudson River water sampling is performed continuously at the intake structure (sampling station 9, Wa1) and at a point exterior to the discharge canal where Hudson River water and water from the discharge canal mix (sampling station 10, Wa2); see Figure A-1. An automatic composite sampler is used to take representative samples. On a weekly basis, accumulated samples are taken from both sample points. These weekly river water samples are composited for monthly gamma spectroscopy analysis and quarterly for tritium analysis.

3.3.9 Hudson River Bottom Sediment

Bottom sediment and benthos are sampled at four locations: three indicator locations (sampling stations 10, 17, and 28) and one control location (84), along the Hudson River, once each spring and summer; see Figure A-3. These samples are obtained using a Peterson grab sampler or similar instrument. The bottom sediment samples are analyzed by gamma spectroscopy.

3.3.10 Hudson River Shoreline Soil

Shoreline soil samples are collected at three indicator and two control locations along the Hudson River. The indicator locations are at sampling stations 53 (Wc1), 28, and 17. The control locations are at sampling stations 50 (Wc2) and 84. Figures A-1, A-2, and A-3 show these locations. The samples are gathered at a level above low tide and below high tide and are approximately 2-kg grab samples. These samples are collected at greater than 90 days apart and are analyzed by gamma spectroscopy and for strontium-90.

3.3.11 Hudson River Aquatic Vegetation

During the spring and summer, aquatic vegetation samples are collected from the Hudson River at two indicator locations (sampling stations 17 and 28) and one control location (84); see Figure A-3. Samples of aquatic vegetation are obtained depending on sample availability. These samples are analyzed by gamma spectroscopy.

3.3.12 Fish and Invertebrates

Fish and invertebrate samples are obtained from the Hudson River at locations upstream and downstream of the plant discharge. The indicator location (downstream sample point) is designated as sampling station 25 (Ib1), and a second sampling station 107 is located further downstream. The control location (upstream) is at sampling station 23 (Ib2). See Figures A-1 and A-2. These samples are collected in season or semiannually if they are not seasonal. The fish and invertebrates sampled are analyzed by gamma spectroscopy as well as for strontium-90 and for nickel-63.

3.3.13 Land Use Census

Each year a land use census consisting of milch animal and residence surveys is conducted during the growing season to determine the current utilization of land within 5 miles (8 km) of the site. These surveys are used to determine whether there are changes in existing conditions that warrant changing the sampling program.

For example, the milch animal census is used to identify animals producing milk for human consumption within 5 miles (8 km) of Indian Point. This census consists of visual field surveys of the areas where a high probability of milch animals exists and confirmation through New York State records or with personnel such as feed suppliers who deal with farm animals and dairy associations (See Tables B-21 and B-22).

Visual inspections are made of the 5-mile area around the Indian Point Site during routine sample collections and emergency plan equipment inspections in the area throughout the year. An extensive land survey is conducted of the 5-mile area in an attempt to identify new residential areas, commercial developments and to identify milch animals in pasture.

Although there are presently no animals producing milk for human consumption within 5 miles (8 km) of the site, the census is performed to determine if a milk-sampling program needs to be conducted.

A residence census is also performed to identify the nearest residence(s) to the site in each of the 16 sectors surrounding Indian Point. See Table B-22.

A garden census was not performed, since the ODCM allows sampling of vegetation in two sectors near the site boundary in lieu of a garden census. The sectors are chosen to be in the pre-dominant wind directions with the highest predicted deposition rates.

3.4 Statistical Methodology

There are several statistical calculation methodologies used in evaluating the data from the Indian Point REMP. These methods include determination of Lower Limits of Detection (LLD) and the Minimum Detectable Concentration (MDC), and estimation of the mean and associated propagated error.

3.4.1 LOWER LIMIT OF DETECTION (LLD)

The LLD is the smallest concentration of radioactive material in a sample that will yield a net count above system background, and be detected with 95% probability, with a 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{\frac{2.71}{T_s} + 3.29 s_b * \sqrt{1 + \left(\frac{T_b}{T_s}\right)}}{E * V * k * Y * e^{-\lambda t}}$$

Where:

LLD =	The lower limit of detection as defined above (as picocurie per unit mass or volume)
T_s =	The sample counting time in minutes
s_b =	The standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute)
T_b =	The background count time in minutes
E =	The counting efficiency (as counts per transformation)
V =	The sample size (in units of mass or volume)
k =	A constant for the number of transformations per minute per unit of activity. (normally, 2.22E+6 dpm per uCi)
Y =	The fractional radiochemical yield (when applicable)
λ =	The radioactive decay constant for the particular radionuclide
t =	The elapsed time between midpoint of sample collection and time of counting

Note: The above LLD formula accounts for differing background and sample count times. The Radiological Environmental Monitoring Program, REMP, may use an LLD formula that assumes equal background and sample count times, when appropriate. The constants 2.71 and 3.29 and the general LLD equation were derived from References 2 and 3.

The value of S_b used in the calculation of the LLD for a detection system shall be based on the actual observed variance of the background counting rate or of the counting rate of the blank samples (as appropriate) rather than on an unverified theoretically predicted variance. In calculating the LLD for a radionuclide determined by gamma ray spectrometry, the background shall include the typical contributions of other radionuclides normally present in the samples. Typical values of E, V, Y, and t shall be used in the calculation. The background count rate is calculated from the background counts that are determined by a separate background count or in the case of gamma ray spectroscopy, from adjacent channels of the energy band of the gamma ray peak used for the quantitative analysis for that radionuclide.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement process and not as an a posteriori (after the fact) limit for a particular measurement. To document the post priori (after the fact) measurement statistics, the MDC is calculated after the measurement using the same equation as above.

To handle the a posteriori problem, a decision level must be defined. To minimize the number of false positives, a value is not considered positive unless it is greater than the MDC or 3 times the total standard deviation of the post priori measurement, where MDC is the post priori (after the fact) measurement statistic calculated similar to the LLD equation listed above (for $T_b = T_s$, the term $3.29 \sigma_b * [(1 + (T_b / T_s))]^{1/2} = 4.66 \sigma_b$).

3.4.2 Table Statistics

The averages shown in the summary table (Table B-2) are the averages of the positive values in accordance with the NRC's Branch Technical Position (BTP) to Regulatory Guide 4.8 (Reference 4). Samples with "<" values are not included in the averages.

It should be noted that this statistic for the mean using only positive values tends to strongly bias the average high, particularly when only a few of the data are measurably positive. The REMP data show few positive values; thus the corresponding means are biased high. Exceptions to this include direct radiation measured by TLDs and gross beta radioactivity in air, which show positive monitoring results throughout the year.

The historical data tables contain the annual averages of the positive values for each year for 2007 through 2017. The historical averages are calculated using only the positive values presented for 2007 through 2016. The 2017 average values are included in these historic tables for purposes of comparison.

SECTION 4

RESULTS AND DISCUSSION

4.0 RESULTS AND DISCUSSION

The 2017 Radiological Environmental Monitoring Program (REMP) was conducted in accordance with Indian Point's Offsite Dose Calculation Manual ODCM. The ODCM contains requirements for the number and distribution of sampling locations, the types of samples to be collected, and the types of analyses to be performed for measurement of radioactivity.

The REMP at Indian Point includes measurements of radioactivity levels in the following environmental pathways.

Direct Gamma Radiation	Airborne Particulates and Radioiodine
Precipitation	Drinking Water
Groundwater	Soil
Broad Leaf Vegetation	Hudson River Water
Bottom Sediment	Shoreline Soil
Aquatic Vegetation	Fish and Invertebrates

An annual land use and milch animal census is also part of the REMP.

To evaluate the contribution of plant operations to environmental radioactivity levels, other man-made and natural sources of environmental radioactivity, as well as the aggregate of past monitoring data, must be considered. It is not merely the detection of a radionuclide, but the evaluation of the location, magnitude, source, and history of its detection that determines its significance. Therefore, we have reported the data collected in 2017 and assessed the significance of the findings.

A summary of the results of the 2017 REMP is presented in Table B-2. This Table lists the mean and range of all positive results obtained for each of the media sampled at ODCM indicator and control locations. Discussions of these results and their evaluations are provided below.

The radionuclides detected in the environment can be grouped into three categories: (1) naturally occurring radionuclides; (2) radionuclides resulting from weapons testing and other non-plant related, anthropogenic sources; and (3) radionuclides that could be related to plant operations.

The environment contains a broad inventory of naturally occurring radionuclides which can be classified as, cosmic ray induced (e.g., Be-7, H-3) or geologically derived (e.g., Ra-226 and progeny, Th-228 and progeny, and K-40.) These radionuclides constitute the majority of the background radiation source and thus account for a majority of the annual background dose detected. Since the detected concentrations of these radionuclides were consistent at indicator and control locations, and unrelated to plant operations, their presence is noted only in the data tables and will not be discussed further.

The second group of radionuclides detected in 2017 consists of those resulting from past weapons testing in the earth's atmosphere. The more recent contamination events resulting from the Chernobyl and Fukushima accidents only indicated detectable activity shortly after their occurrences (Reference 5). However, weapons testing in the 1950's and 1960's

resulted in a significant atmospheric radionuclide inventory, which, in turn, still contributes to the concentrations in the ecological systems. Although reduced in frequency, atmospheric weapons testing continued into the 1980's. The resultant radionuclide inventory of some radionuclides, although diminishing with time (e.g., through radioactive decay and natural dispersion processes), remains detectable.

In 2017, the detected radionuclides that may be attributable to past atmospheric weapons testing consisted of Cs-137 in several media. The levels detected were consistent with the historical levels of radionuclides resulting from weapons tests as measured in previous years.

The final group of radionuclides detected by the 2017 REMP comprises those that may be attributable to current plant operations. During 2017, Cs-137 and Tritium were the only potentially plant-related radionuclides detected in any environmental samples.

H-3 may be present in the local environment due to either natural occurrence, other man-made sources, or as a result of plant operations. Natural occurrence is very low (on the order of approximately 5 pCi/liter - well below typical detectable levels). The major source of H-3 is typically from above ground nuclear weapons testing, in the range of 50 to 150 pCi/liter). Other sources include weapons production and industrial uses where levels are highly dependent on the release rates and distance from the source term. One such industrial source is nuclear power plant operation. In 2017, very low levels of H-3 were detected in two river water samples.

Cs-137 is ubiquitous in the environment from atmospheric testing debris and a lesser amount from the Chernobyl accident. In 2017, there were seven detections of Cs-137 in bottom sediment and shoreline soil at indicator locations. Cs-137 was also detected in all three soil samples obtained. In all cases, the Cs-137 concentrations, when detected, were consistent with historical values.

The fact that there was no Cs-134 present (recent plant releases would contain Cs-134) and that the levels detected were consistent with historical values indicates that the activity may be due to atmospheric weapons testing, with some contribution from plant releases from the past years. None of the fish samples indicated any detectable levels of these isotopes.

Strontium-90 (Sr-90) may also be present in the environment from atmospheric testing debris. No Sr-90 was detected in any of the fish, shoreline soil, or groundwater samples.

I-131 is also produced in fission reactors, but can result from non-plant related anthropogenic sources, e.g., medical administrations, such as has been noted in previous years. I-131 was not detected in 2017 in aquatic or terrestrial vegetation indicator and control locations.

Co-58 and Co-60 are activation/corrosion products also related to plant operations. They are produced by neutron activation in the reactor core. Co-58 has a much shorter half-life than Co-60. If Co-58 and Co-60 are concurrently detected in environmental samples, then the source of these radionuclides is more likely the result of recent releases. When significant concentrations of Co-60 are detected but no Co-58, there is an increased likelihood that the Co-60 is due to residual Co-60 from past operations. There was no Co-58 or Co-60 detected in the 2017 REMP, although they were observed in historical data.

In the following sections, a summary of the results of the 2017 REMP is presented by sample medium and the significance of any positive findings discussed. It should be noted that naturally occurring radionuclides are omitted from the summary table (Table B-2) and further discussion.

4.1 Direct Radiation

The environmental TLDs used to measure the direct radiation were TLDs supplied and processed by Environmental Dosimetry Company. In 2017, the TLD program produced a consistent picture of ambient background radiation levels in the vicinity of the Indian Point Station. A summary of the annual TLD data is provided in Table B-2 and all the TLD data are presented in Tables B-3, B-4 and B-5. TLD sample site DR-40 is the control site for the direct radiation (DR) series of measurements.

Table B-3 provides the quarterly and annual average reported doses in mR per standard quarter for each of the direct radiation sample points, DR-1 through DR-41. Table B-4 provides the mean, standard deviation, minimum and maximum values in mR per standard quarter for the years 2007 through 2017. The 2017 means are also presented in Table B-4. Table B-5 presents the 2017 TLD data for the inner ring and outer ring of TLDs. The table also provides the sector for each of the DR sample points.

The 2017 mean value for the indicator direct radiation sample points was 14.4 mR per standard quarter – which is consistent with historical values. At those locations where the 2017 mean value was higher than historical means, they are within historical bounds for the respective locations.

The DR sample locations are arranged so that there are two concentric rings of TLDs around the Indian Point site. The inner ring (DR-1 to DR-16) is close to the site boundary. The outer ring (DR-17 to DR-32) has a radius of approximately 5 miles from the three Indian Point units. The results of the annual averages for these two rings of TLDs are provided in Table B-5. The annual average for the inner ring was 14.3 mR per standard quarter and also average for the outer ring was 14.7 mR per standard quarter. The control location average for 2017 was 15.6 mR per standard quarter.

Table C-1 and Figure C-1 present the 10-year historical averages for the inner and outer rings of TLDs. The 2017 averages are consistent with the historical data. The 2017 and previous years' data show that there is no measurable direct radiation in the environment due to the operation of the Indian Point site.

4.2 Airborne Particulates and Radioiodine

An annual summary of the results of the 2017 air particulate filter and charcoal cartridge analyses is presented in Table B-2. As shown, there were no radionuclides detected in the air attributable to plant operations.

The results of the analyses of weekly air particulate filter samples for gross beta activity are presented in Table B-6 and the weekly charcoal cartridge analytical results are presented in Table B-7.

Gross beta activity was found in air particulate samples throughout the year at all indicator and control locations. The average gross beta activity for the eight indicator air sample locations was 0.013 pCi/m³ and the average for the control location was 0.012 pCi/m³. The activities detected were consistent for all locations, with no significant differences in gross beta activity in any sample due to location.

The results of the GSA of the quarterly composites of these samples are in Table B-8. These quarterly composite air samples showed that no reactor-related radionuclides were detected and that only naturally-occurring radionuclides were present at detectable levels.

The mean annual gross beta concentrations and Cs-137 concentrations in air for the past 10 years are presented in Table C-2. From this table and Figure C-2, it can be seen that the average 2017 gross beta concentration was consistent with historical levels. Cs-137 has not been detected since 1987. This is consistent with the trend of decreasing ambient Cs-137 concentrations in recent years.

From the data, it can be seen that no airborne radioactivity attributable to the operation of Indian Point was detected in 2017.

4.3 Precipitation

A summary of the precipitation sample analysis results is presented in Table B-2. Table B-9 contains the results of the precipitation samples for 2017. Only one naturally occurring radionuclide was detected in the precipitation samples.

4.4 Drinking Water

The annual program summary table (Table B-2) contains a summary of the 2017 drinking water sample analysis results. Results of the gross beta, tritium and gamma spectroscopy analyses of the monthly drinking water samples are in Table B-10. Other than Gross Beta activity consistent with historical values, no radioactivity was detected in drinking water samples. This has historically been the case for the radionuclide results for this media. Operation of the Indian Point units had no detectable radiological impact on drinking water.

4.5 Ground Water

A summary of the groundwater samples for 2017 is contained in Table B-2. Data resulting from analysis of the groundwater samples for gamma emitters, tritium analysis, Ni-63 and Sr-90 are given in Table B-11. No plant related nuclides were noted in any acceptable samples.

4.6 Soil

A summary of the soil sample analysis results is presented in Table B-2. Table B-12 contains the results of the soil samples for 2017. Other than naturally occurring radionuclides, very low levels of Cs-137 were detected in some soil samples consistent with historical results.

4.7 Broad Leaf Vegetation

Table B-2 contains a summary of the broad leaf vegetation sample analysis results. Data from analysis of the 2017 samples are presented in Table B-13.

Table C-3 contains an historical summary and Figure C-3 is an illustration of the broad leaf vegetation analysis results. There were no plant related nuclides detected in the 2017 samples. The detection of low levels of Cs-137 has occurred sporadically at indicator locations at relatively low concentrations for the past ten years, most likely the result of previous atmospheric weapons testing.

4.8 Hudson River Water

A summary of the radionuclides detected in the Hudson River water is contained in Table B-2. Data resulting from analysis of monthly Hudson River water samples for gamma emitters and quarterly composites of H-3 are presented in Tables B-14.

The only plant related activity detected was H-3, and it was detected at low levels in two indicator samples. The levels are consistent with occasional historical detection of H-3. Table C-3 shows historical H-3 concentrations at the plant inlet and discharge points. Table C-8 contains a comparison of H-3 detected at the plant discharge (Hudson River Water mixing point) versus calculated quarterly average effluents concentrations. The data in table C-8 provides assurance that the REMP is indeed providing verification of the calculation of radionuclide concentrations resulting from effluent releases attributable to the site.

4.9 Hudson River Bottom Sediment

A summary of the Hudson River bottom sediment analysis results is included in Table B-2. Table B-15 contains the results of the analysis of bottom sediment samples for 2017. Cesium-137 was detected in five of the indicator station samples, and none of the control location samples. Detection of positive levels of Cs-137 in river bottom sediment is not unusual. Cs-134 was not detected in any bottom sediment samples. The lack of Cs-134 points to the primary source of the Cs-137 in bottom sediment as being from prior historical plant releases over the years and from residual weapons test fallout.

Historical levels of Cs-137 in bottom sediment samples are shown in table C-9 and figure C-8. This data shows the continued detection of Cs-137 in bottom sediment samples at varying levels, and demonstrates that the levels observed during 2017 sampling are within the range of levels identified in historical samples.

4.10 Hudson River Shoreline Soil

A summary of the radionuclide concentrations detected in the shoreline soil samples is contained in Table B-2. Table B-16 contains the results of the gamma spectroscopic and strontium-90 analyses of the shoreline soil samples.

In addition to the naturally occurring radionuclides, Cs-137 was identified in two of the Hudson River shoreline soil samples in 2017.

An historical look at Cs-137 detected in shoreline soil at indicator and control locations can be viewed in Table C-6 and Figure C-6. Cesium-137 has been present in this media, both at indicator and occasionally at the control location, at a consistent level over the past ten years. Cesium-134 and Cs-137 are both discharged from the plant in similar quantities. The lack of Cs-134 activity is an indication that the primary source of the Cs-137 in the shoreline soil is legacy contamination from weapons fallout.

Strontium-90 (Sr-90) was not detected in any of the 8 indicator location samples or any of the control location samples.

4.11 Aquatic Vegetation

A summary of the aquatic sample analysis results is presented in Table B-2. Table B-17 contains the results of the analysis of aquatic vegetation samples for 2017. No plant related radionuclides were detected in any indicator samples. This is consistent with historical findings.

4.12 Fish and Invertebrates

A summary of the fish and invertebrate sample analysis results is presented in Table B-2. Table B-18 contains the results of the analysis of fish and invertebrate samples for 2017. No plant related radionuclides were detected. This is consistent with historical results which are shown in table and figure C-7.

4.13 Land Use Census

A census was performed in the vicinity of Indian Point in 2017. This census consisted of a milch animal and a residence census. Results of this census are presented in Tables B-21 and B-22.

The results of the 2017 census were generally same as the 2016 census results, in 2016 the presence of goats was noted on a property located less than 5.0 miles SSE of IPEC. However, discussions with the owner for the 2017 land use surveys confirmed that the goats did not produce milk for human consumption and are therefore not milch animals.

The 2017 land use census indicated there were no new residences that were closer in proximity to IPEC.

The ODCM allows the sampling of broad leaf vegetation in two sectors at the site boundary in lieu of performing a garden census. Analysis results for these two sectors are discussed in Section 4.6 and presented in Table B-14, Table C-6 and Figure C-6.

4.14 Conclusion

The Radiological Environmental Monitoring Program is conducted each year to determine the radiological impact of Indian Point operations on the environment. The preceding discussions of the results of the 2017 REMP reveal that operations at the station did not result in an impact on the environment.

The 2017 REMP results demonstrate the relative contributions of different radionuclide sources, both natural and anthropogenic, to the environmental concentrations. The results indicate that the fallout from previous atmospheric weapons testing continues to contribute to detection of Cs-137 in some environmental samples. There are infrequent detections of plant related activity in the environs; however, the radiological levels are very low and are significantly less than those from natural background and other anthropogenic sources.

SECTION 5

REFERENCES

5.0 REFERENCES

1. United States of America, Code of Federal Regulations, Title 10, Part 50, Appendix A Criteria 64.
2. Currie, L.A., "Limits for Qualitative Detection of Quantitative Determination", *Analytical Chemistry*, 40:586-593, 1968.
3. Mayer, Dauer, "Application of Systematic Error Bounds to Detection Limits for Practical Counting"., *Health Physics Journal*, 65(1): 89-91, 1993.
4. U.S. Nuclear Regulatory Commission, Branch Technical Position, "An Acceptable Radiological Environmental Monitoring Program," Revision 1, November 1979.
5. Wetherbee, Gregory A., et.al., Wet Deposition of Fission-Product Isotopes to North America from the Fukushima Dai-ichi Incident, March 2012, *Environmental Science and Technology*.
6. IPEC Offsite Dose Calculation Manual, Units 1, 2 and 3.
7. United States of America, Code of Federal Regulations, Title 10.
8. United States of America, Code of Federal Regulations, Title 40.
9. U.S. Nuclear Regulatory Commission, Regulatory Guide 4.1, "Program for Monitoring Radioactivity in the Environs of Nuclear Power Plants," Revision 1, April 1975.
10. U.S. Nuclear Regulatory Commission, Regulatory Guide 4.1, Radiological Environmental Monitoring for Nuclear Power Plants, Revision 2, June 2009.
11. Entergy Nuclear Indian Point, Radiological Environmental Monitoring Chemistry Procedures.
12. U.S. Nuclear Regulatory Commission, Regulatory Guide 4.8, Environmental Technical Specifications for Nuclear Power Plants, December 1975.
13. Eisenbud, M., *Environmental Radioactivity*, Academic Press, New York, 1987.
14. Glasstone, S., and W. H. Jordan, *Nuclear Power and Its Environmental Effects*, American Nuclear Society, La Grange Park, IL, 1980.
15. Cohen N., and Eisenbud M., *Radiological Studies of the Hudson River*, Progress Report Institute of Environmental Medicine, New York University Medical Center, December 1983.
16. U.S. Nuclear Regulatory Commission. Regulatory Guide 4.15, Revision 1, Quality Assurance for Radiological Monitoring Programs (Normal Operations) - Effluent Streams and the Environment February 1979.
17. J. W. Poston, *Cesium-137 and Other Man-Made Radionuclides in the Hudson River: A Review of the Available Literature*, Applied Physical Technology, Inc., report to NYPA, September 1977.

18. U.S. Environmental Protection Agency Report EPC-520/1 80-012, Upgrading Environmental Radiation Data, August 1980.
19. Andrews, Howard L. and Lapp, Ralph E. Nuclear Radiation Physics, Prentice-Hall, Inc., Englewood Cliffs, New Jersey, 1972.
20. U.S. Nuclear Regulatory Commission, Branch Technical Position to Regulatory Guide 4.8, An Acceptable Radiological Environmental Monitoring Program, November 1979.
21. Eichholz, Geoffrey G., Environmental Aspects of Nuclear Power, Lewis Publishers, Inc., Chelsea, Michigan, 1985.
22. Kelly, J. J. (Ed.), Effluent and Environmental Radiation Surveillance, ASTM STP #698, Philadelphia, PA, 1978.
23. Knoll, Glenn F., Radiation Detection and Measurement, first edition, John Wiley and Sons, New York, 1979.
24. Dixon, Wilfred J., Introduction to Statistical Analysis, third edition, McGraw-Hill Inc., 1969.
25. National Council on Radiation Protection. NCRP Report No. 94, Exposure of the Population in the United States and Canada from Natural Background Radiation December 1987.
26. National Council on Radiation Protection. NCRP Report No. 62, Tritium in the Environment, March 1979.
27. Kuhn, W., et al., The Influence of Soil Parameters on Cs-137 Uptake by Plants from Long-Term Fallout on Forest Clearings and Grasslands, Health Physics Journal, 46(5), p. 1083, May 1984.
28. Garner, J., et al., High Radiocesium Levels in Granite Outcrop Vegetation and Reductions Through Time, Health Physics Journal, 60(4), p. 533, April 1991.
29. McGee, E., et al., The Variability in Fallout Content of Soils and Plants and the Design of Optimum Field Sampling Strategies, Health Physics Journal, 68(3), March 1995.
30. Consolidated Edison Company of New York, Safety Evaluation for Amendment #45 to Unit 1 Provisional Operating License, January 1996.
31. U.S Nuclear Regulatory Commission, Regulatory Guide 4.13, Performance, Testing, and Procedural Specifications for Thermoluminescence Dosimetry: Environmental Applications, November 1979.
32. Office of Environmental Management, Semi-Annual Report of the Department of Energy, Quality Assessment Program, EML 617, June 2003.
33. Office of Environmental Management, Semi-Annual Report of the Department of Energy, Quality Assessment Program, EML 618, December 2003.

34. McFarland, R.C., et al., The Counting Room: Special Edition, Radioactivity and Radiochemistry, Caretaker Publications, Atlanta, Georgia, 1994.
35. Bevington, P.R., Data Reduction and Error Analysis for the Physical Sciences, McGraw Hill, 1969.
36. ENN-LI-102, Corrective Action Process
37. Technical Information Document 2003-011 "Justification for the Removal of the Radiological Environmental Monitoring Blind Spike Program at IPEC"
38. National Council on Radiation Protection and Measurements, Report No. 169, "Design of Effective Radiological Effluent Monitoring and Environmental Surveillance Programs", December 2010.
39. Donald T. Oakley, "Natural Radiation Exposure in the United States." U. S. Environmental Protection Agency, ORP/SID 72-1, June 1972.
40. National Council on Radiation Protection and Measurements, Report No. 160, "Ionizing Radiation Exposures of the Population of the United States," March 2009.
41. National Council on Radiation Protection and Measurements, Report No. 94, "Exposure of the Population of the United States and Canada from Natural Background Radiation," December 1987.
42. U.S. Nuclear Regulatory Commission, Regulatory Guide 8.29, "Instructions Concerning Risks from Occupational Radiation Exposure," Revision 0, July 1981.
43. U.S. Nuclear Regulatory Commission, NUREG-1301, "Offsite Dose Calculation Manual Guidance: Standard Radiological Effluent Controls for Pressurized Water Reactors," April 1991.
44. NYS Department of Environmental Conservation, "Measurement of Strontium and Other Radionuclides in Edible Tissue and Bone/carapace of Fish and Blue Crabs from the Lower Hudson River, New York", November 2009.

APPENDIX A

ENVIRONMENTAL SAMPLING AND ANALYSIS REQUIREMENTS

APPENDIX A

Environmental media are sampled at the locations specified in Table A-1 and shown in Figures A-1, A-2, and A-3. The samples are analyzed according to criteria established in the ODCM. These requirements include: methods of sample collection; types of sample analysis; minimum sample size required; lower limit of detection, which must be attained for each medium, sample, or analysis type, and environmental concentrations requiring special reports.

Table A-1 provides the sampling station number, location, sector, and distance from Indian Point, sample designation code, and sample type. This table gives the complete listing of sample locations used in the 2017 REMP.

Three maps are provided to show the locations of REMP sampling. Figure A-1 shows the sampling locations within two miles of Indian Point. Figures A-2 and A-3 show the sampling locations within ten miles of Indian Point.

The ODCM required lower limits of detection (LLD) for Indian Point sample analyses are presented in Table A-2. These required lower limits of detection are not the same as the lower limits of detection or critical levels actually achieved by the laboratory. The laboratory's lower limits of detection and critical levels must be equal to or lower than the required levels presented in Table A-2.

Table A-3 provides the reporting level for radioactivity in various media. Sample results that exceed these levels and are due to plant operations require that a special report be submitted to the NRC.

In addition to the sampling outlined in Table A-1, there is an environmental surveillance requirement that an annual land use and milch animal census be performed. See Tables B-19 and B-20 for the milch animal and land use census.

**TABLE A-1
INDIAN POINT REMP SAMPLING STATION LOCATIONS**

SAMPLING STATION	SAMPLE DESIGNATION	LOCATION	DISTANCE	SAMPLE TYPES
3	DR8	Service Center Building	Onsite - 0.35 Mi (SSE) at 158°	Direct Gamma
4	A1	Algonquin Gas Line	Onsite - 0.28 Mi (SW) at 234°	Air Particulate
	A1			Radioiodine
5	A4	NYU Tower	Onsite - 0.88 Mi (SSW) at 208°	Air Particulate
	A4			Radioiodine
	DR10			Direct Gamma
7	Wb1	Camp Field Reservoir	3.4 Mi (NE) at 51°	Drinking Water
8	**	Croton Reservoir	6.3 Mi (SE) at 124°	Drinking Water
9	Wa1	Plant Inlet (Hudson River Intake)*	Onsite - 0.16 Mi (W) at 273°	HR Water
10	Wa2	Discharge Canal (Mixing Zone)	Onsite - 0.3 Mi (WSW) at 249°	HR Water
	**			HR Bottom Sediment
14	DR7	Water Meter House	Onsite - 0.3 Mi (SE) at 133°	Direct Gamma
17	**	Off Verplanck	1.5 Mi (SSW) at 202.5°	HR Aquatic Vegetation
	**			HR Shoreline Soil
	**			HR Bottom Sediment
20	DR38	Cortlandt Yacht Club (AKA Montrose Marina)	1.5 Mi (S) at 180°	Direct Gamma
23	**	Roseton*	20.7 Mi (N) at 357°	Precipitation
	A5			Air Particulate, Radioiodine
	A5			Direct Gamma
	DR40			Broad Leaf Vegetation
	lc3			Soil
	**			Fish & Invertebrates
25	lb1	Downstream	Downstream	Fish & Invertebrates
27	**	Croton Point	6.36 Mi (SSE) at 156°	Air Particulate
	**			Radioiodine
	DR41			Direct Gamma
28	**	Lent's Cove	0.45 Mi (ENE) at 069°	HR Shoreline Soil
	DR4			Direct Gamma
	**			HR Bottom Sediment
	**			HR Aquatic Vegetation
29	**	Grassy Point	3.37 Mi (SSW) at 196°	Air Particulate
	**			Radioiodine
	DR39			Direct Gamma
33	DR33	Hamilton Street (Substation)	2.88 Mi (NE) at 053°	Direct Gamma
34	DR9	South East Corner of Site	Onsite - 0.52 Mi (S) at 179°	Direct Gamma
35	DR5	Broadway & Bleakley Avenue	Onsite - 0.37 Mi (E) at 092°	Direct Gamma
38	DR34	Furnace Dock (Substation)	3.43 Mi (SE) at 141°	Direct Gamma

* = Control location

** = Locations listed do not have sample designation locations
specified in the ODCM

HR = Hudson River R/S = Reuter Stokes

**TABLE A-1
INDIAN POINT REMP SAMPLING STATION LOCATIONS**

SAMPLING STATION	SAMPLE DESIGNATION	LOCATION	DISTANCE	SAMPLE TYPES
44	**	Peekskill Gas Holder Bldg	1.84 Mi (NE) at 052°	Precipitation
	**			Air Particulate
	**			Radioiodine
50	Wc2	Manitou Inlet*	4.48 Mi (NNW) at 347°	HR Shoreline Soil
53	Wc1	White Beach	0.92 Mi (SW) at 226°	HR Shoreline Soil
	DR11			Direct Gamma
56	DR37	Verplanck - Broadway & 6th Street	1.25 Mi (SSW) at 202°	Direct Gamma
57	DR1	Roa Hook	2 Mi (N) at 005°	Direct Gamma
58	DR17	Route 9D - Garrison	5.41 Mi (N) at 358°	Direct Gamma
59	DR2	Old Pemart Avenue	1.8 Mi (NNE) at 032°	Direct Gamma
60	DR18	Gallows Hill Road & Sprout Brook Road	5.02 Mi (NNE) at 029°	Direct Gamma
61	DR36	Lower South Street & Franklin Street	1.3 Mi (NE) at 052°	Direct Gamma
62	DR19	Westbrook Drive (near the Community Center)	5.03 Mi (NE) at 062°	Direct Gamma
64	DR20	Lincoln Road - Cortlandt (School Parking Lot)	4.6 Mi (ENE) at 067°	Direct Gamma
66	DR21	Croton Avenue - Cortlandt	4.87 Mi (E) at 083°	Direct Gamma
67	DR22	Colabaugh Pond Road - Cortlandt	4.5 Mi (ESE) at 114°	Direct Gamma
69	DR23	Mt. Airy & Windsor Road	4.97 Mi (SE) at 127°	Direct Gamma
71	DR25	Warren Ave - Haverstraw	4.83 Mi (S) at 188°	Direct Gamma
72	DR26	Railroad Avenue & 9W - Haverstraw	4.53 Mi (SSW) at 203°	Direct Gamma
73	DR27	Willow Grove Road & Captain Faldermeyer Drive	4.97 Mi (SW) at 226°	Direct Gamma
74	DR12	West Shore Drive - South	1.59 Mi (WSW) at 252°	Direct Gamma
75	DR31	Palisades Parkway	4.65 Mi (NW) at 225°	Direct Gamma
76	DR13	West Shore Drive - North	1.21 Mi (W) at 276°	Direct Gamma
77	DR29	Palisades Parkway	4.15 Mi (W) at 272°	Direct Gamma
78	DR14	Rt. 9W across from R/S #14	1.2 Mi (WNW) at 295°	Direct Gamma
79	DR30	Anthony Wayne Park	4.57 Mi (WNW) at 296°	Direct Gamma
80	DR15	Route 9W South of Ayers Road	1:02 Mi (NW) at 317°	Direct Gamma
81	DR-28	Palisades Pkwy - Lake Welch Exit	4.96 Mi (WSW) at 310°	Direct Gamma
82	DR16	Ayers Road	1.01 Mi (NNW) at 334°	Direct Gamma
83	DR32	Route 9W - Fort Montgomery	4.82 Mi (NNW) at 339°	Direct Gamma
84	**	Cold Spring *	10.88 Mi (N) at 356°	HR Aquatic Vegetation
	**			HR Shoreline Soil
	**			HR Bottom Sediment
88	DR6	Reuter Stokes Pole #6	0.32 Mi (ESE) at 118°	Direct Gamma
89	DR35	Highland Ave & Sprout Brook Road (near rock cut)	2.89 Mi (NNE) at 025°	Direct Gamma

* = Control location

** = Locations listed do not have sample designation locations specified in the ODCM

HR = Hudson River R/S = Reuter Stokes

**TABLE A-1
INDIAN POINT REMP SAMPLING STATION LOCATIONS**

SAMPLING STATION	SAMPLE DESIGNATION	LOCATION	DISTANCE	SAMPLE TYPES
90	DR3	Charles Point	0.88 Mi (NE) at 047°	Direct Gamma
92	DR24	Warren Road - Cortlandt	3.84 Mi (SSE) at 149°	Direct Gamma
94	A2	IPEC Training Center	Onsite- 0.39 Mi (S) at 193°	Air Particulate
	A2			Radioiodine
	lc2			Broad Leaf Vegetation
	**			Soil
95	A3	Meteorological Tower	Onsite - 0.46 Mi (SSW) at 208°	Air Particulate
	A3			Radioiodine
	lc1			Broad Leaf Vegetation
	**			Soil
106	**	Lafarge Monitoring Well	0.63 mi SW	Groundwater
107	**	Vicinity of Haverstraw Bay	2.5 mi SSW (downstream)	Fish & Invertebrates

* = Control location

** = Locations listed do not have sample designation locations specified in the ODCM

HR = Hudson River R/S = Reuter Stokes

FIGURE A-1

**SAMPLING LOCATIONS
Within Two Miles of Indian Point**

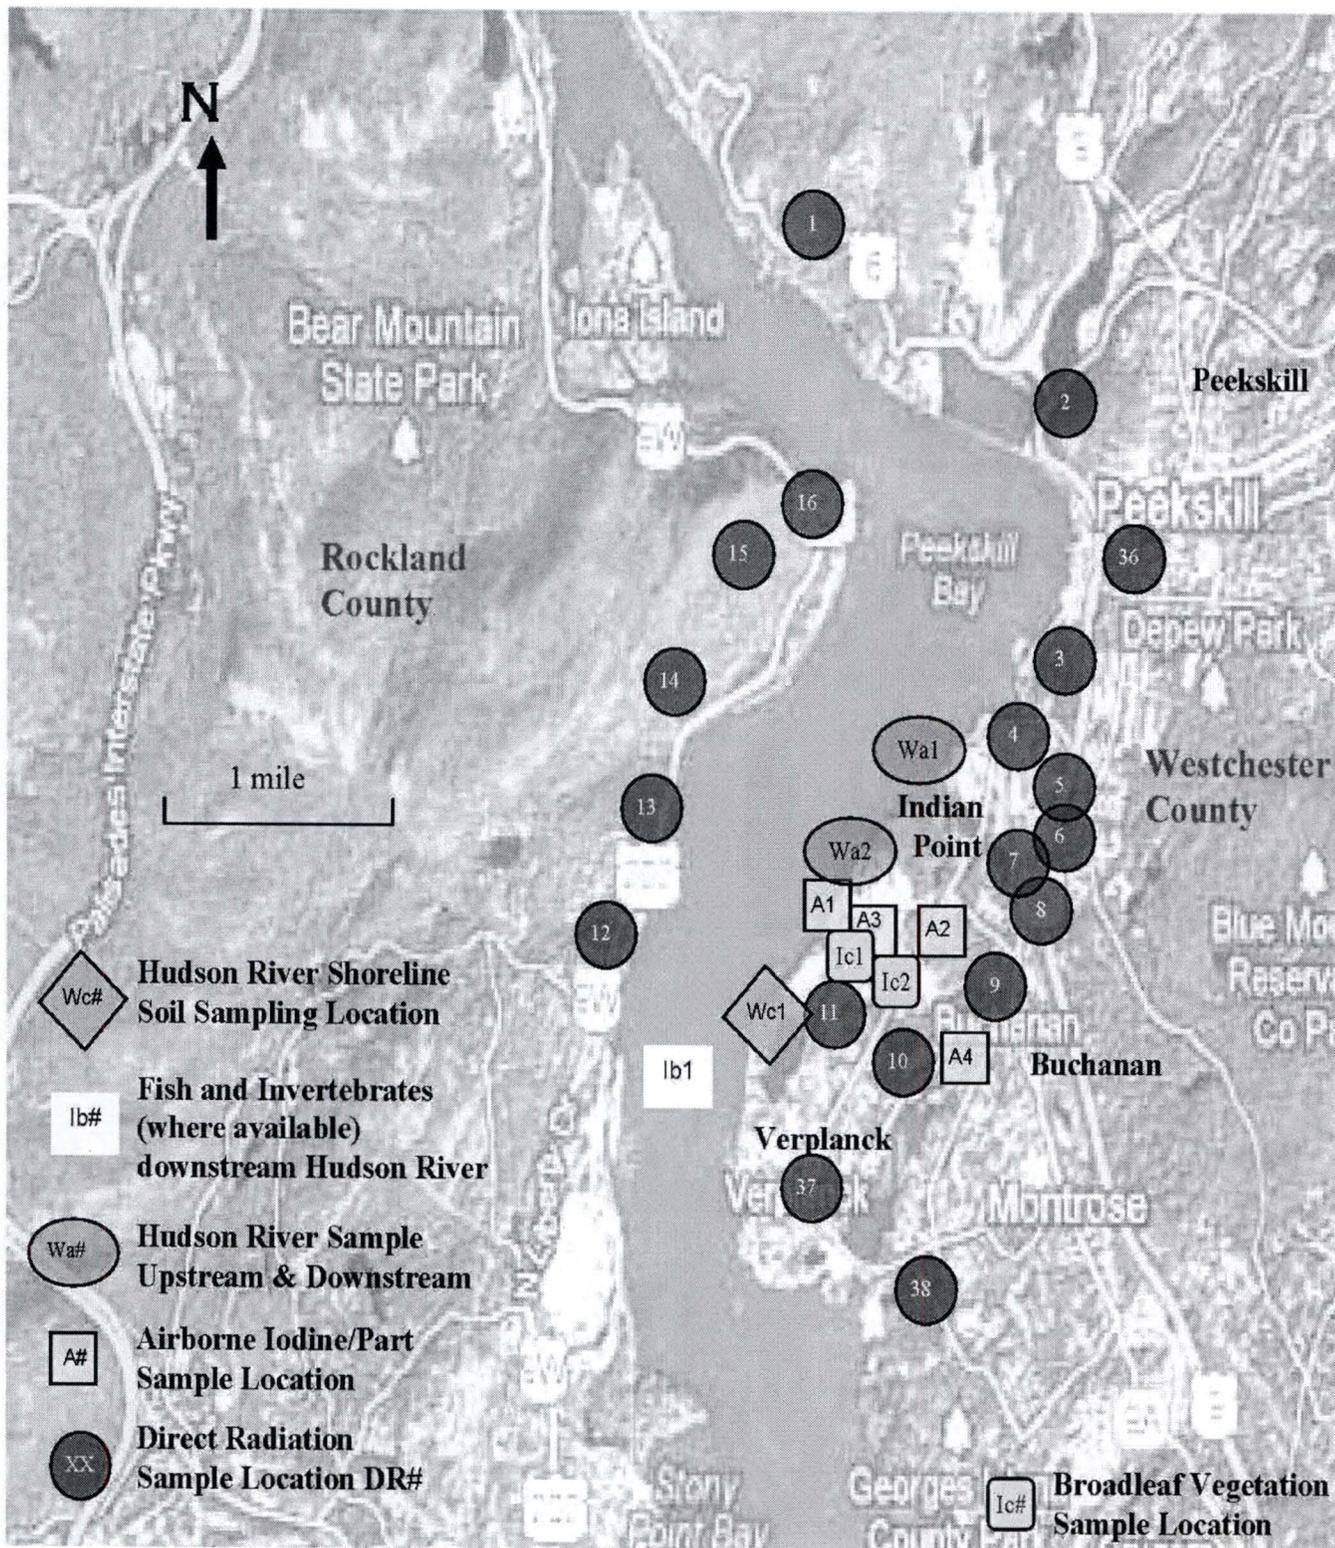


FIGURE A-3

SAMPLING LOCATIONS
Additional Sampling Locations

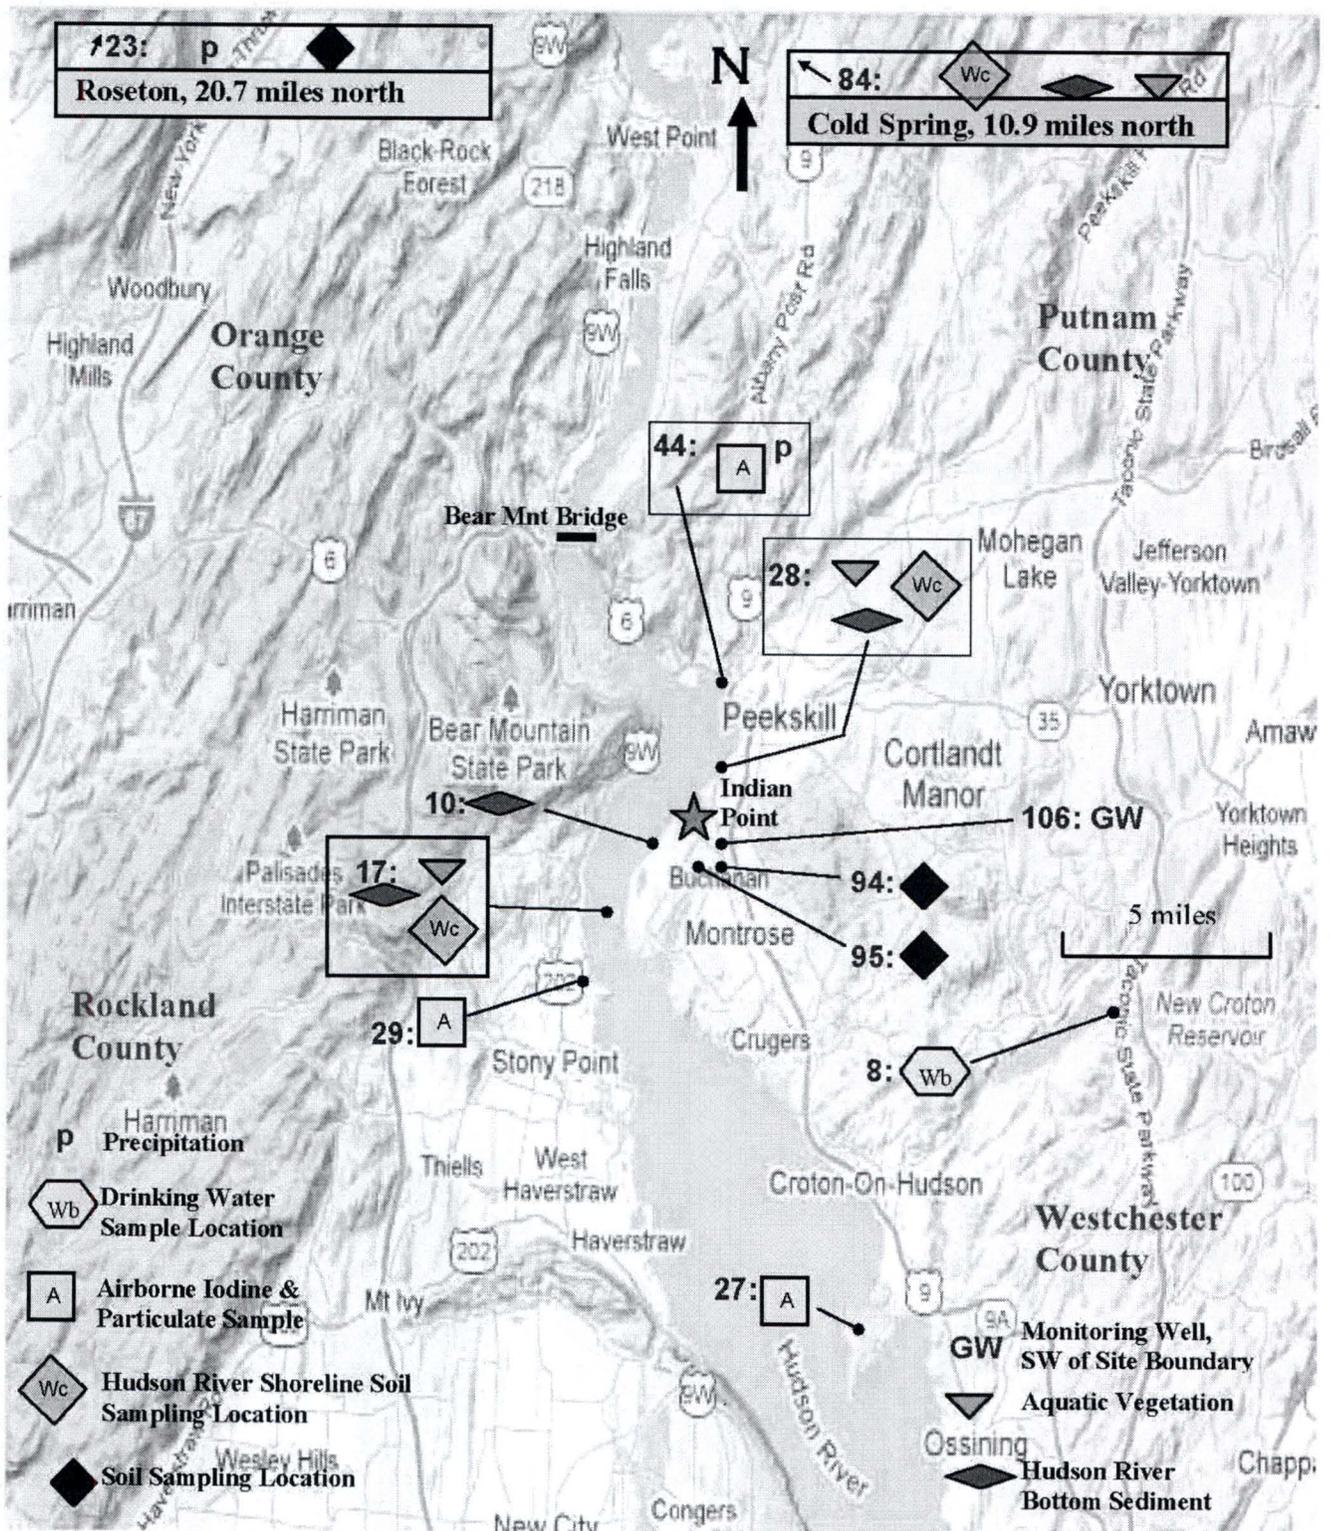


TABLE A-2

**LOWER LIMIT OF DETECTION (LLD) REQUIREMENTS
FOR ENVIRONMENTAL SAMPLES**

RADIONUCLIDE ANALYSIS	WATER (pCi/L)	AIRBORNE PARTICULATE OR GASES (pCi/m³)	FISH (pCi/kg, wet)	MILK (pCi/L)	FOOD PRODUCTS (pCi/kg, wet)	SOIL or SEDIMENT (pCi/kg, dry)
Gross Beta	4	0.01				
H-3	2,000 (d)					
Mn-54	15		130			
Fe-59	30		260			
Co-58	15		130			
Co-60	15		130			
Ni-63 (f)	30		100			
Zn-65	30		260			
Sr-90 (f)	1		5			5000
Zr-95	30					
Nb-95	15					
I-131	1 (d)	0.07		1	60	
Cs-134	15	0.05	130	15	60	150
Cs-137	18	0.06	150	18	80	180
Ba-140	60			60		
La-140	15			15		

TABLE A-2

LOWER LIMIT OF DETECTION (LLD) REQUIREMENTS FOR ENVIRONMENTAL SAMPLES

Table Notation

- (a) This list does not mean that only these nuclides are to be considered. Other peaks that are identifiable, together with those of the above nuclides, shall also be analyzed and reported in the Annual Radiological Environmental Operating Report pursuant to the ODCM.
- (b) Required detection capabilities for thermoluminescent dosimeters used for environmental measurements are given in Regulatory Guide 4.13.
- (c) The LLD is defined as the smallest concentration of radioactive material in a sample that will yield a net count, above system background, that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement.

Analyses shall be performed in such a manner that the stated LLDs will be achieved under routine conditions. Occasionally background fluctuations, unavoidable small sample sizes, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLDs unachievable.

In such cases, the contributing factors shall be identified and described in the Annual Radiological Environmental Operating Report pursuant to the ODCM.

- (d) These LLDs are for drinking water samples. If no drinking water pathway exists, the LLDs may be increased to 3,000 for H-3 and 15 for I-131.
- (e) These required lower limits of detection are associated only with the REMP requirements. The Radiological Ground Water Monitoring Program may involve unique reporting level criteria, independent of the REMP, and defined in station procedures.
- (f) Sr-90 and Ni-63 are included in this table due to their historical presence in ground water and possible migration to the environment.

TABLE A-3

REPORTING LEVELS FOR RADIOACTIVITY CONCENTRATIONS
IN ENVIRONMENTAL SAMPLES

RADIONUCLIDE ANALYSIS	WATER (pCi/L)	AIRBORNE PARTICULATE OR GASES (pCi/m ³)	FISH (pCi/kg, wet)	MILK (pCi/L)	FOOD PRODUCTS (pCi/kg, wet)
H-3	20,000 *				
Mn-54	1,000		30,000		
Fe-59	400		10,000		
Co-58	1,000		30,000		
Co-60	300		10,000		
Ni-63 ***	300		1,000		
Zn-65	300		20,000		
Sr-90 ***	8*		40		
Zr-95	400				
Nb-95	400				
I-131	2 *	0.9		3	100
Cs-134	30	10	1,000	60	1,000
Cs-137	50	20	2,000	70	2,000
Ba-140	200			300	
La-140	200			300	

* Values provided are for drinking water pathways. If no drinking water pathway exists, higher values are allowed, as follows:

H-3 30,000 pCi/L (This is a 40 CFR 141 value)
 Sr-90 12 pCi/L
 I-131 20 pCi/L

** These reporting levels are associated only with the REMP requirements. The Radiological Ground Water Monitoring Program may involve unique reporting level criteria, independent of the REMP, and defined in station procedures.

*** Sr-90 and Ni-63 are included in this table due to their historical presence in ground water and possible migration to the environment.

APPENDIX B

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM RESULTS
SUMMARY

APPENDIX B

B.1 2017 Annual Radiological Environmental Monitoring Program Summary

The results of the 2017 radiological environmental sampling program are presented in Tables B-2 through B-18. Table B-2 is a summary table of the sample results for 2017. The format of this summary table conforms to the reporting requirements of the ODCM, NRC Regulatory Guide 4.8, and NRC Branch Technical Position to Regulatory Guide 4.8 (Reference 4). In addition, the data obtained from the analysis of samples are provided in Tables B-3 through B-18.

REMP samples were analyzed by various counting methods as appropriate. The methods are; gross beta, gamma spectroscopy analysis, liquid scintillation, radiochemical analysis, and TLD processing. Gamma spectroscopy analysis was performed for the following radionuclides; Be-7, K-40, Mn-54, Co-58, Co-60, Fe-59, Zn-65, Zr-95, Nb-95, Ru-103, Ru-106, I-131, Cs-134, Cs-137, Ba/La-140, Ce-141, Ce-144, Ra-226 and Ac/Th-228. Radiochemical analyses were performed for H-3, Ni-63, Sr-90 and I-131 for specific media and locations as required in the ODCM.

B.2 Land Use Census

In accordance with Sections IP2-D3.5.2 and IP3-2.8 of the ODCM, a land use census was conducted to identify the nearest milch animal and the nearest residence. The results of the milch animal and land use census are presented in Tables B-19 and B-20, respectively. In lieu of identifying and sampling the nearest garden of greater than 50 m², at least three kinds of broad leaf vegetation were sampled near the site boundary in two sectors and at a designated control location (results are presented in Table B-13).

B.3 Sampling Deviations

During 2017, environmental sampling was performed for 12 unique media types addressed in the ODCM and for direct radiation. A total of 1161 samples of 1163 scheduled were obtained. Of the scheduled samples, 99.8% were collected and analyzed for the program. Sampling deviations are summarized in Table B-1. Discussions of the reasons for the deviations are provided in Table B-1a for the air samples and Table B-1b for other media.

B.4 Analytical Deviations

No analytical deviations were found in 2017.

B.5 Special Reports

No special reports were required under the REMP.

TABLE B-1

Summary of Sampling Deviations - 2017

MEDIA	TOTAL SCHEDULED SAMPLES	NUMBER OF DEVIATIONS*	SAMPLING EFFICIENCY %	NUMBER OF ANALYSES**	REASON FOR DEVIATION
MEDIA					
TLD	164	0	100%	164	N/A
PARTICULATES IN AIR	416	1	100%	447	See Table B-1a
CHARCOAL FILTER	416	1	100%	415	See Table B-1a
PRECIPITATION	8	0	100%	16	N/A
DRINKING WATER	24	0	100%	56	N/A
GROUNDWATER SAMPLES	2	0	100%	8	N/A
SOIL	3	0	100%	3	N/A
BROAD LEAF VEGETATION	51	0	100%	51	N/A
HUDSON RIVER WATER	24	0	100%	32	N/A
SHORELINE SOIL	10	0	100%	20	N/A
HUDSON RIVER BOTTOM SEDIMENT	8	0	100%	8	N/A
AQUATIC VEGETATION	4	0	100%	4	N/A
FISH & INVERTEBRATES	33	0	100%	99	N/A
TOTALS	1163	2	99.8%	1323	

TOTAL NUMBER OF SAMPLES COLLECTED = 1161

* Samples not collected or unable to be analyzed.

** Several sample types require more than one analysis

TABLE B-1a
2017 Air Sampling Deviations

LOCATION	DATE	PROBLEM//ACTIONS TO PREVENT RECURRENCE
27 Croton Point	1/23/2017	Delivered sample volume 1,300 ft ³ vs. expected volume of >18,920 ft ³ due to a tripped GFCI w/ 135.3 hrs outage time.
27 Croton Point	3/13/2017	Delivered sample volume of 14,600 ft ³ vs. expected volume of 20,104 ft ³ due to a tripped GFCI w/ 45.7 hrs outage time.
04 Algonquin	3/20/2017	Unable to collect sample since access was blocked by downed electrical wires causing a safety hazard.
44 Peekskill Gas Holder	4/24/2017	Delivered sample volume of 7,900 ft ³ vs. expected volume of 20,023 ft ³ due to a tripped GFCI w/ 107.7 hrs outage time.
04 Algonquin	5/15/2017	Delivered sample volume of 16,632 ft ³ vs. expected volume of 18,641 ft ³ w/ 18.6 hrs outage time.
44 Peekskill Gas Holder	9/25/2017	Delivered sample volume of 6,000 ft ³ vs. expected volume of 20,088 ft ³ due to a tripped GFCI w/ 114.4 hrs outage time.
44 Peekskill Gas Holder	11/13/2017	Delivered sample volume of 12,600 ft ³ vs. expected volume of 18,815 ft ³ due to a tripped GFCI w/ 54.8 hrs outage time.
44 Peekskill Gas Holder	11/21/2017	Delivered sample volume of 200 ft ³ vs. expected volume of 23,304 ft ³ due to a tripped GFCI w/ 193.2 hrs outage time.
44 Peekskill Gas Holder	12/11/2017	Delivered sample volume of 11,000 ft ³ vs. expected volume of 18,648 ft ³ due to a tripped GFCI w/ 69.0 hrs outage time.
29 Grassy Point	12/11/2017	Delivered sample volume of 18,600 ft ³ vs. expected volume of 20,188 ft ³ due to a tripped GFCI w/ 13.4 hrs outage time.
27 Croton Point	12/11/2017	Delivered sample volume of 700 ft ³ vs. expected volume of 19,602 ft ³ due to a tripped GFCI w/162.4 hrs outage time.
94 IPEC Training Center	12/26/2017	Air sampler hr meter stopped running. Replaced hr meter on 12/26/17

Note: All air particulate filters and Charcoal Cartridges were analyzed, except fo the air filter and air iodine from Stn 04 on 3/20/17.

TABLE B-1b
2017 Other Media Deviations

LOCATION	Date	PROBLEM / ACTIONS TO PREVENT RECURRENCE
09 Hudson River Intake	2/14/17	Composite sample not available due to sampler being found in 'Standby'. Grab sample obtained.
10 Hudson River Discharge	6/20/17	Composite sample not available due to sampler being found in 'Standby'. Grab sample obtained.
10 Hudson River Discharge	9/13/17	Hudson river discharge composite sample not available due to degraded sample suction tubing. Tubing replaced, as left pump operation SAT, and a grab sample was obtained.

TABLE B-2 RADIOLOGICAL ENVIRONMENT MONITORING PROGRAM SUMMARY
 INDIAN POINT ENERGY CENTER - 2017
 Dockets 50-03, 50-247 & 50-286

Medium or Pathway Sampled (Units)	Analysis Type	Total Number	LLD*	Indicator Locations	Location with Highest Mean			Control Locations	Non-Routine Reported Measurements
				Mean ** (Range)	Location Number	Distance Direction	Mean (Range)	Mean (Range)	
Direct Radiation (mR/Standard Quarter)	Tid-Quarterly	164	NA	14.4 (160/160) (10.8/20.5)	DR-28	4.96 Mi. WSW	20.2 (4/4) (19.8/20.5)	15.6 (4/4) (14.9/16.8)	0
Air Particulate (pCi/m ³)	Gr-B	415	0.01	.013 (361/363) (.004/.073)	27	6.36 Mi. SSE	.014 (51/52) (.005/.073)	.012 (52/52) (.005/.020)	0
Air Iodine (pCi/m ³)	GAMMA I-131	415	0.07	<LLD			-	<LLD	0
Air Particulate (10 ⁻³ pCi/m ³)	GAMMA Be-7	32	NA	112.2 (28/28) (80.7/145.5)	44	1.84 Mi. NE	118.7 (4/4) (91.1/131.9)	111.9 (4/4) (87.1/129.3)	0
	K-40		NA	<LLD			-	<LLD	0
	Cs-134		0.05	<LLD			-	<LLD	0
	Cs-137		0.06	<LLD			-	<LLD	0
	Th-228		NA	<LLD			-	<LLD	0
Rainwater (pCi/L)	H-3	8	3000	<LLD			-	<LLD	0
	GAMMA Co-60	8	15	<LLD			-	<LLD	0
	Cs-134		15	<LLD			-	<LLD	0
Rainwater (cont'd) (pCi/L)	Cs-137		18	<LLD			-	<LLD	0
Drinking Water (pCi/L)	Gr-B	24	4	3.26 (16/24) (2.24/5.27)	7	3.4 Mi. NE	3.51 (7/12) (2.55/5.27)	NA	0
	H-3	8	2000	<LLD			-	NA	0
	GAMMA Mn-54	24	15	<LLD			-	NA	0
	Co-58		15	<LLD			-	NA	0
	Fe-59		30	<LLD			-	NA	0

TABLE B-2 RADIOLOGICAL ENVIRONMENT MONITORING PROGRAM SUMMARY
 INDIAN POINT ENERGY CENTER - 2017
 Dockets 50-03, 50-247 & 50-286

Medium or Pathway Sampled (Units)	Analysis Type	Total Number	LLD*	Indicator Locations	Location with Highest Mean			Control Locations	Non-Routine Reported Measurements
				Mean ** (Range)	Location Number	Distance Direction	Mean (Range)	Mean (Range)	
Drinking Water (cont'd) (pCi/L)	Co-60	15		<LLD			-	NA	0
	Zn-65	30		<LLD			-	NA	0
	Nb-95	15		<LLD			-	NA	0
	Zr-95	15		<LLD			-	NA	0
	I-131	1		<LLD			-	NA	0
	Cs-134	15		<LLD			-	NA	0
	Cs-137	18		<LLD			-	NA	0
	Ba-140	60		<LLD			-	NA	0
	La-140	15		<LLD			-	NA	0
	Groundwater (pCi/L)	H-3	2	3000	<LLD			-	NA
Ni-63		2	30	<LLD			-	NA	0
Sr-90		2	1	<LLD			-	NA	0
GAMMA Mn-54		2	15	<LLD			-	NA	0
CO-58		15		<LLD			-	NA	0
Fe-59		30		<LLD			-	NA	0
Co-60		15		<LLD			-	NA	0
Zn-65		30		<LLD			-	NA	0
Nb-95		15		<LLD			-	NA	0

TABLE B-2 RADIOLOGICAL ENVIRONMENT MONITORING PROGRAM SUMMARY
 INDIAN POINT ENERGY CENTER - 2017
 Dockets 50-03, 50-247 & 50-286

Medium or Pathway Sampled (Units)	Analysis Type	Total Number	LLD*	Indicator Locations	Location with Highest Mean			Control Locations	Non-Routine Reported Measurements
				Mean ** (Range)	Location Number	Distance Direction	Mean (Range)	Mean (Range)	
Groundwater (cont'd) (pCi/L)	Zr-95	30		<LLD			-	NA	0
	I-131	15		<LLD			-	NA	0
	Cs-134	18		<LLD			-	NA	0
	Cs-137	60		<LLD			-	NA	0
	Ba-140	15		<LLD			-	NA	0
	La-140	15		<LLD			-	NA	0
Soil (pCi/kg dry)	GAMMA Be-7	3	NA	<LLD			-	<LLD	0
	K-40	NA		11635 (2/2) (8959/14310)	23	20.7 Mi. N	19650 (1/1)	19650 (1/1)	0
	Co-60	NA		<LLD			-	<LLD	0
	Cs-134	150		<LLD			-	<LLD	0
	Cs-137	180		206.8 (2/2) (191.1/222.4)	23	20.7 Mi. N	249.2 (1/1)	249.2 (1/1)	0
	Ra-226	NA		<LLD	23	20.7 Mi. N	1687 (1/1)	1687 (1/1)	0
	Th-228	NA		482.0 (2/2) (216.9/747.1)	23	20.7 Mi. N	947.7 (1/1)	947.7 (1/1)	0
Broadleaf Vegetation (pCi/kg wet)	GAMMA Be-7	51	NA	1574.3 (33/34) (183.9/4681)	94	0.39 Mi. S	1649.4 (16/17) (183.9/4681)	1598.2 (16/17) (389.4/4782)	0
	K-40	NA		5234.6 (34/34) (2257/8693)	95	0.46 Mi. SSW	5627.0 (17/17) (3153/8693)	4917.3 (17/17) (2087/7776)	0
	Co-60	NA		<LLD			-	<LLD	0
	I-131	60		<LLD			-	<LLD	0
	Cs-134	60		<LLD			-	<LLD	0

TABLE B-2 RADIOLOGICAL ENVIRONMENT MONITORING PROGRAM SUMMARY
 INDIAN POINT ENERGY CENTER - 2017
 Dockets 50-03, 50-247 & 50-286

Medium or Pathway Sampled (Units)	Analysis Type	Total Number	LLD*	Indicator Locations	Location with Highest Mean			Control Locations	Non-Routine Reported Measurements
				Mean ** (Range)	Location Number	Distance Direction	Mean (Range)	Mean (Range)	
Broadleaf Vegetation (cont'd) (pCi/kg wet)	Cs-137		80	<LLD			-	<LLD	0
	Th-228		NA	<LLD	23	20.7 Mi. N	21.91 (1/17)	21.91 (1/17)	0
River Water (pCi/L)	H-3	8	3000	298.5 (2/4) (216/381)	10	0.3 Mi. WSW	298.5 (2/4) (216/381)	<LLD	0
	GAMMA Mn-54	24	15	<LLD			-	<LLD	0
	Co-58		15	<LLD			-	<LLD	0
	Fe-59		30	<LLD			-	<LLD	0
	Co-60		15	<LLD			-	<LLD	0
	Zn-65		30	<LLD			-	<LLD	0
	Nb-95		15	<LLD			-	<LLD	0
	Zr-95		15	<LLD			-	<LLD	0
	I-131		15	<LLD			-	<LLD	0
	Cs-134		15	<LLD			-	<LLD	0
	Cs-137		18	<LLD			-	<LLD	0
	Ba-140		15	<LLD			-	<LLD	0
	La-140		15	<LLD			-	<LLD	0
	Bottom Sediment (pCi/kg dry)	GAMMA K-40	8	NA	15880 (6/6) (9752/19880)	84	10.88 Mi. N	20735 (2/2) (15200/26270)	20735 (2/2) (15200/26270)
Co-60			NA	<LLD			-	<LLD	0
Cs-134			150	<LLD			-	<LLD	0

TABLE B-2 RADIOLOGICAL ENVIRONMENT MONITORING PROGRAM SUMMARY
 INDIAN POINT ENERGY CENTER - 2017
 Dockets 50-03, 50-247 & 50-286

Medium or Pathway Sampled (Units)	Analysis Type	Total Number	LLD*	Indicator Locations	Location with Highest Mean			Control Locations	Non-Routine Reported Measurements
				Mean ** (Range)	Location Number	Distance Direction	Mean (Range)	Mean (Range)	
Bottom Sediment (cont'd) (pCi/kg dry)	Cs-137	180		350.3 (5/6) (73/1067)	10	0.3 Mi. WSW	570.0 (2/2) (73/1067)	<LLD	0
	Ra-226	NA		<LLD	84	10.88 Mi. N	2756 (1/2)	2756 (1/2)	0
	Th-228	NA		805.7 (6/6) (372.8/1157)	84	10.88 Mi. N	1061.8 (2/2) (964.5/1159)	1061.8 (2/2) (964.5/1159)	0
Shoreline Soil (pCi/kg dry)	Sr-90	10	5000	<LLD			-	<LLD	0
	GAMMA K-40	10	NA	12336 (6/6) (7862/15880)	84	10.88 Mi. N	34100 (2/2) (31950/36250)	22576 (4/4) (9658/36250)	0
	Cs-134	150		<LLD			-	<LLD	0
	Cs-137	180		151.0 (2/6) (85.9/216.1)	17	1.5 Mi. SSW	151.0 (2/2) (85.9/216.1)	<LLD	0
	Ra-226	NA		3190 (1/6)	28	0.45 Mi. ENE	3190 (1/2)	2256 (1/4)	0
	Th-228	NA		697.8 (4/6) (472.7/1134)	28	0.45 Mi. ENE	803.4 (2/2) (472.7/1134)	580.0 (4/4) (446.4/694.5)	0
	GAMMA Be-7	4	NA	<LLD	84	10.88 Mi. N	206.6 (1/2)	206.6 (1/2)	0
Aquatic Vegetation (pCi/kg wet)	K-40		NA	3579 (2/2) (3462/3695)	28	0.45 Mi. ENE	3695 (1/1)	2295 (2/2) (1654/2935)	0
	Co-60		NA	<LLD			-	<LLD	0
	I-131		60	<LLD			-	<LLD	0
	Cs-134		60	<LLD			-	<LLD	0
	Cs-137		80	<LLD			-	<LLD	0
	Ra-226		NA	<LLD			-	<LLD	0
	Ac-228		NA	<LLD			-	<LLD	0
	Th-228		NA	106.4 (2/2) (80/132.8)	28	0.45 Mi. ENE	132.8 (1/1)	90.4 (2/2) (85.8/95.1)	0

TABLE B-2 RADIOLOGICAL ENVIRONMENT MONITORING PROGRAM SUMMARY
 INDIAN POINT ENERGY CENTER - 2017
 Dockets 50-03, 50-247 & 50-286

Medium or Pathway Sampled (Units)	Analysis Type	Total Number	LLD*	Indicator Locations	Location with Highest Mean			Control Locations	Non-Routine Reported Measurements
				Mean ** (Range)	Location Number	Distance Direction	Mean (Range)	Mean (Range)	
Fish (pCi/kg wet)	Ni-63	33	100	<LLD				<LLD	0
	Sr-90	33	5	<LLD				<LLD	0
	GAMMA K-40	33	NA	2592 (23/23) (1164/4715)	25	Downstream	2827 (12/12) (1722/4715)	2740 (10/10) (2037/3971)	0
	Mn-54		130	<LLD				<LLD	0
	Co-58		130	<LLD				<LLD	0
	Fe-59		260	<LLD				<LLD	0
	Co-60		130	<LLD				<LLD	0
	Zn-65		260	<LLD				<LLD	0
	Cs-134		130	<LLD				<LLD	0
	Cs-137		150	<LLD				<LLD	0
	Th-228		NA	<LLD				<LLD	0

Environment Samples 1161
 Analysis 1323

* LLD IS THE LOWER LIMIT OF DETECTION
 ** THE MEAN VALUES ARE CALCULATED USING THE POSITIVE VALUES
 *** MDC IS THE MINIMUM DETECTABLE CONCENTRATION

INDIAN POINT ENERGY CENTER
TABLE B-3
DIRECT RADIATION, QUARTERLY DATA - 2017

mR/Quarter ± 1 sigma

Sample Nuclide	Station Number	First Quarter 01/01-03/31	Second Quarter 04/01-06/30	Third Quarter 07/01-09/30	Fourth Quarter 10/01-01/01	Annual Average	Annual Total
TLD	DR-01	16.3 ± 0.7	16.0 ± 1.0	17.1 ± 0.5	16.3 ± 0.7	16.4 ± 0.5	65.6
	DR-02	15.2 ± 0.7	15.0 ± 0.9	15.5 ± 0.7	14.3 ± 0.6	15.0 ± 0.5	60.1
	DR-03	12.7 ± 1.0	12.0 ± 1.0	13.5 ± 0.5	12.5 ± 0.6	12.7 ± 0.6	50.8
	DR-04	13.6 ± 0.8	13.8 ± 0.9	14.5 ± 0.7	13.0 ± 0.6	13.7 ± 0.6	54.8
	DR-05	14.1 ± 0.7	14.8 ± 1.0	15.1 ± 0.5	14.3 ± 1.3	14.5 ± 0.5	58.2
	DR-06	14.9 ± 0.8	14.6 ± 1.0	14.7 ± 0.5	13.8 ± 0.8	14.5 ± 0.5	58.0
	DR-07	15.9 ± 0.9	16.3 ± 1.2	16.7 ± 0.5	15.6 ± 0.7	16.1 ± 0.5	64.6
	DR-08	12.1 ± 0.6	12.7 ± 0.8	12.6 ± 0.7	11.5 ± 0.6	12.2 ± 0.6	48.9
	DR-09	13.7 ± 0.9	14.3 ± 1.0	14.4 ± 1.2	13.4 ± 0.8	13.9 ± 0.5	55.8
	DR-10	13.9 ± 0.8	13.5 ± 0.8	14.4 ± 0.7	13.3 ± 0.6	13.8 ± 0.5	55.1
	DR-11	11.0 ± 0.9	10.9 ± 0.8	11.7 ± 0.5	10.8 ± 0.7	11.1 ± 0.4	44.5
	DR-12	16.9 ± 1.0	15.7 ± 0.9	16.3 ± 0.8	15.9 ± 0.8	16.2 ± 0.5	64.8
	DR-13	17.5 ± 0.8	16.1 ± 0.9	17.3 ± 0.9	16.7 ± 0.8	16.9 ± 0.6	67.6
	DR-14	13.4 ± 0.6	13.1 ± 0.8	14.3 ± 0.6	13.2 ± 0.8	13.5 ± 0.5	54.0
	DR-15	13.8 ± 0.8	13.0 ± 0.8	13.6 ± 0.7	13.3 ± 0.6	13.4 ± 0.4	53.8
	DR-16	14.7 ± 0.7	14.1 ± 0.8	15.8 ± 1.3	14.7 ± 0.9	14.8 ± 0.7	59.3
	DR-17	14.7 ± 0.9	14.2 ± 0.9	15.8 ± 0.8	14.6 ± 0.8	14.8 ± 0.7	59.3
	DR-18	14.1 ± 0.8	13.9 ± 0.8	15.1 ± 0.9	14.3 ± 0.9	14.4 ± 0.5	57.5
	DR-19	15.1 ± 0.7	14.3 ± 0.9	16.3 ± 0.6	14.7 ± 0.9	15.1 ± 0.8	60.4
	DR-20	13.9 ± 1.0	14.0 ± 0.8	14.6 ± 0.8	14.1 ± 0.7	14.2 ± 0.3	56.7
	DR-21	14.3 ± 1.0	13.7 ± 0.9	14.8 ± 0.6	14.5 ± 0.6	14.3 ± 0.5	57.3
	DR-22	11.4 ± 0.8	11.3 ± 0.7	12.2 ± 0.5	11.4 ± 0.7	11.6 ± 0.4	46.3
	DR-23	14.2 ± 0.7	13.8 ± 0.8	15.3 ± 0.6	14.1 ± 1.0	14.3 ± 0.7	57.4
	DR-24	14.8 ± 0.7	14.6 ± 0.8	15.9 ± 0.8	14.9 ± 0.9	15.1 ± 0.6	60.2
	DR-25	12.5 ± 0.6	11.9 ± 0.8	12.7 ± 0.6	12.9 ± 0.7	12.5 ± 0.4	50.0
	DR-26	14.7 ± 0.8	13.3 ± 0.9	14.1 ± 0.7	13.9 ± 0.7	14.0 ± 0.6	56.0
	DR-27	14.1 ± 1.0	13.2 ± 0.8	14.6 ± 0.5	14.6 ± 1.1	14.1 ± 0.6	56.5
	DR-28	19.9 ± 0.8	19.8 ± 1.2	20.5 ± 0.9	20.5 ± 0.9	20.2 ± 0.4	80.6
	DR-29	14.3 ± 0.6	14.2 ± 0.9	15.2 ± 0.7	14.7 ± 0.7	14.6 ± 0.5	58.3
	DR-30	14.5 ± 0.7	14.3 ± 0.9	15.8 ± 0.8	14.7 ± 0.8	14.8 ± 0.6	59.3
	DR-31	16.1 ± 1.0	16.7 ± 1.0	17.8 ± 0.8	16.8 ± 0.8	16.9 ± 0.7	67.4
	DR-32	13.1 ± 0.7	13.7 ± 0.9	14.2 ± 0.6	13.5 ± 0.8	13.6 ± 0.5	54.5
	DR-33	13.6 ± 0.9	14.0 ± 1.0	13.8 ± 0.6	13.7 ± 0.9	13.8 ± 0.2	55.0
	DR-34	13.3 ± 0.9	13.7 ± 0.8	14.0 ± 0.5	13.7 ± 0.7	13.7 ± 0.3	54.7
	DR-35	13.3 ± 0.6	14.2 ± 1.2	15.2 ± 0.9	13.7 ± 1.0	14.1 ± 0.8	56.3
	DR-36	14.5 ± 0.7	15.1 ± 0.9	15.0 ± 0.8	15.0 ± 1.2	14.9 ± 0.3	59.4
	DR-37	14.0 ± 0.8	14.2 ± 1.0	14.7 ± 0.7	13.9 ± 1.0	14.2 ± 0.4	56.8
	DR-38	12.2 ± 0.6	13.0 ± 0.8	13.2 ± 0.5	11.9 ± 0.8	12.6 ± 0.6	50.3
	DR-39	14.5 ± 0.7	14.9 ± 1.2	15.5 ± 0.7	13.9 ± 0.8	14.7 ± 0.7	58.8
	DR-40*	14.9 ± 0.8	15.6 ± 1.0	16.8 ± 1.0	15.0 ± 0.9	15.6 ± 0.9	62.4
	DR-41	13.0 ± 0.7	13.9 ± 0.9	14.3 ± 0.6	12.4 ± 0.6	13.4 ± 0.9	53.5
	AVERAGE (Indicator Locations)	14.2 ± 1.6	14.1 ± 1.5	14.9 ± 1.6	14.1 ± 1.7	14.4 ± 1.6	57.5

* Control location

INDIAN POINT ENERGY CENTER
TABLE B-4
DIRECT RADIATION, 2007 THROUGH 2017 DATA

mR per Year

Station Number	Mean (2007-2016)	Standard Deviation (2007-2016)	Minimum Value (2007-2016)	Maximum Value (2007-2016)	2017 Annual Total	
DR-01	61.1	2.8	55.6	64.5	65.6	
DR-02	57.7	1.4	55.9	59.8	60.1	
DR-03	45.8	4.1	35.0	49.8	50.8	
DR-04	53.5	1.1	52.2	55.8	54.8	
DR-05	54.8	1.3	53.3	56.7	58.2	
DR-06	56.1	1.2	54.7	57.9	58.0	
DR-07	63.3	1.9	60.7	66.6	64.6	
DR-08	47.4	1.7	45.1	50.6	48.9	
DR-09	52.7	1.8	50.0	55.1	55.8	
DR-10	57.9	4.1	54.4	67.7	55.1	
DR-11	43.2	1.1	41.4	45.5	44.5	
DR-12	60.8	4.7	49.2	68.3	64.8	
DR-13	70.0	7.7	62.3	82.1	67.6	
DR-14	52.9	1.6	50.5	55.3	54.0	
DR-15	52.6	1.5	50.3	54.9	53.8	
DR-16	57.9	1.8	55.1	60.6	59.3	
DR-17	56.6	5.2	42.6	61.4	59.3	
DR-18	56.6	1.5	54.4	59.1	57.5	
DR-19	58.8	1.6	55.9	60.7	60.4	
DR-20	54.3	1.3	52.2	56.3	56.7	
DR-21	54.7	2.0	51.9	57.5	57.3	
DR-22	44.9	1.3	42.6	46.8	46.3	
DR-23	55.7	1.3	53.6	58.1	57.4	
DR-24	57.9	1.2	55.8	59.7	60.2	
DR-25	49.1	1.8	45.7	52.6	50.0	
DR-26	55.8	1.6	53.0	58.9	56.0	
DR-27	54.0	1.4	51.5	56.6	56.5	
DR-28	78.2	1.2	76.5	80.4	80.6	
DR-29	56.7	1.2	54.8	58.8	58.3	
DR-30	58.1	2.2	54.7	61.9	59.3	
DR-31	65.0	1.8	61.5	67.4	67.4	
DR-32	52.1	1.8	48.7	54.7	54.5	
DR-33	54.0	1.0	52.3	55.6	55.0	
DR-34	50.1	4.2	38.5	53.7	54.7	
DR-35	52.0	1.9	49.9	55.2	56.3	
DR-36	58.3	1.7	55.9	60.2	59.4	
DR-37	55.0	1.6	53.3	58.0	56.8	
DR-38	49.2	2.8	46.6	56.0	50.3	
DR-39	58.8	2.6	54.8	61.7	58.8	
DR-40*	59.3	7.9	49.3	75.2	62.4	
DR-41	50.9	1.5	48.4	53.9	53.5	
AVERAGE (Indicator Locations)					55.6	57.5

* Control location

INDIAN POINT ENERGY CENTER
TABLE B-5
DIRECT RADIATION, INNER AND OUTER RINGS - 2017
(mR per Year)

Inner Ring ID	Outer Ring ID	Sector	Inner Ring Annual Average	Outer Ring Annual Average
DR-01	DR-17	N	65.60	59.30
DR-02	DR-18	NNE	60.10	57.50
DR-03	DR-19	NE	50.80	60.40
DR-04	DR-20	ENE	54.80	56.70
DR-05	DR-21	E	58.20	57.30
DR-06	DR-22	ESE	58.00	46.30
DR-07	DR-23	SE	64.60	57.40
DR-08	DR-24	SSE	48.90	60.20
DR-09	DR-25	S	55.80	50.00
DR-10	DR-26	SSW	55.10	56.00
DR-11	DR-27	SW	44.50	56.50
DR-12	DR-28	WSW	64.80	80.60
DR-13	DR-29	W	67.60	58.30
DR-14	DR-30	WNW	54.00	59.30
DR-15	DR-31	NW	53.80	67.40
DR-16	DR-32	NNW	59.30	54.50
		Average	57.24	58.61

INDIAN POINT ENERGY CENTER
TABLE B-6
GROSS BETA ACTIVITY IN AIRBORNE PARTICULATE SAMPLES - 2017

pCi/m³ ± 2 Sigma

PERIOD ENDING	Algonquin 4	NYU Tower 5	Roseton 23*	Croton Point 27	Grassy Point 29	Peekskill 44	Training Building 94	Met Tower 95
01/03/17	0.011 ± 0.002	0.012 ± 0.002	0.013 ± 0.002	0.013 ± 0.002	0.012 ± 0.002	0.012 ± 0.002	0.012 ± 0.002	0.012 ± 0.002
01/09/17	0.011 ± 0.002	0.011 ± 0.003	0.013 ± 0.003	0.011 ± 0.002	0.014 ± 0.003	0.011 ± 0.003	0.012 ± 0.003	0.011 ± 0.003
01/17/17	0.014 ± 0.002	0.015 ± 0.002	0.017 ± 0.002	0.014 ± 0.002	0.013 ± 0.002	0.014 ± 0.002	0.011 ± 0.002	0.014 ± 0.002
01/23/17	0.011 ± 0.002	0.010 ± 0.002	0.011 ± 0.002	(c) < 0.029	0.011 ± 0.002	0.011 ± 0.002	0.009 ± 0.002	0.010 ± 0.002
01/30/17	0.009 ± 0.002	0.008 ± 0.002	0.007 ± 0.002	0.007 ± 0.002	0.008 ± 0.002	0.008 ± 0.002	0.006 ± 0.002	0.007 ± 0.002
02/06/17	0.012 ± 0.002	0.011 ± 0.002	0.012 ± 0.002	0.014 ± 0.003	0.011 ± 0.002	0.010 ± 0.002	0.011 ± 0.002	0.013 ± 0.003
02/13/17	0.011 ± 0.002	0.010 ± 0.002	0.012 ± 0.002	0.009 ± 0.002	0.008 ± 0.002	0.011 ± 0.002	0.013 ± 0.002	0.012 ± 0.002
02/21/17	0.013 ± 0.002	0.015 ± 0.003	0.013 ± 0.002	0.013 ± 0.002	0.013 ± 0.002	0.014 ± 0.002	0.013 ± 0.002	0.015 ± 0.002
02/27/17	0.011 ± 0.002	0.011 ± 0.002	0.013 ± 0.002	0.012 ± 0.002	0.010 ± 0.002	0.011 ± 0.002	0.013 ± 0.003	0.009 ± 0.002
03/06/17	0.014 ± 0.002	0.012 ± 0.002	0.014 ± 0.002	0.013 ± 0.002	0.012 ± 0.002	0.014 ± 0.002	0.011 ± 0.002	0.014 ± 0.002
03/13/17	0.015 ± 0.002	0.016 ± 0.003	0.012 ± 0.002	0.015 ± 0.003	0.013 ± 0.002	0.013 ± 0.002	0.013 ± 0.002	0.011 ± 0.002
03/20/17	(a)	0.016 ± 0.002	0.014 ± 0.002	0.013 ± 0.002	0.015 ± 0.002	0.017 ± 0.003	0.016 ± 0.003	0.013 ± 0.002
03/27/17 (b)	0.012 ± 0.001	0.014 ± 0.002	0.013 ± 0.002	0.014 ± 0.002	0.012 ± 0.002	0.012 ± 0.002	0.013 ± 0.002	0.011 ± 0.002
04/03/17	0.005 ± 0.002	0.005 ± 0.002	0.006 ± 0.002	0.007 ± 0.002	0.006 ± 0.002	0.006 ± 0.002	0.005 ± 0.002	0.007 ± 0.002
04/10/17	0.009 ± 0.002	0.009 ± 0.002	0.008 ± 0.002	0.010 ± 0.002	0.008 ± 0.002	0.006 ± 0.002	0.008 ± 0.002	0.010 ± 0.002
04/17/17	0.016 ± 0.002	0.016 ± 0.002	0.017 ± 0.002	0.014 ± 0.002	0.016 ± 0.002	0.015 ± 0.002	0.014 ± 0.002	0.015 ± 0.002
04/24/17	0.006 ± 0.002	0.008 ± 0.002	0.006 ± 0.002	0.006 ± 0.002	0.004 ± 0.002	0.010 ± 0.004	0.005 ± 0.002	0.008 ± 0.002
05/01/17	0.008 ± 0.002	0.008 ± 0.002	0.009 ± 0.002	0.008 ± 0.002	0.009 ± 0.002	0.009 ± 0.002	0.008 ± 0.002	0.009 ± 0.002
05/08/17	0.008 ± 0.002	0.006 ± 0.002	0.007 ± 0.002	0.008 ± 0.002	0.007 ± 0.002	0.007 ± 0.002	0.007 ± 0.002	0.006 ± 0.002
05/15/17	0.007 ± 0.002	0.005 ± 0.002	0.005 ± 0.002	0.006 ± 0.002	0.006 ± 0.002	0.006 ± 0.002	0.005 ± 0.002	0.007 ± 0.002
05/22/17	0.013 ± 0.002	0.013 ± 0.002	0.015 ± 0.002	0.013 ± 0.002	0.014 ± 0.002	0.013 ± 0.002	0.016 ± 0.002	0.009 ± 0.002
05/30/17	0.005 ± 0.002	0.006 ± 0.002	0.005 ± 0.002	0.005 ± 0.002	0.005 ± 0.002	0.005 ± 0.002	0.004 ± 0.001	0.006 ± 0.002
06/05/17	0.007 ± 0.002	0.007 ± 0.002	0.007 ± 0.002	0.008 ± 0.002	0.009 ± 0.002	0.009 ± 0.002	0.008 ± 0.002	0.008 ± 0.002
06/12/17	0.013 ± 0.002	0.010 ± 0.002	0.012 ± 0.002	0.012 ± 0.002	0.010 ± 0.002	0.013 ± 0.002	0.013 ± 0.002	0.012 ± 0.002
06/19/17	0.012 ± 0.002	0.011 ± 0.002	0.011 ± 0.002	0.013 ± 0.002	0.013 ± 0.002	0.012 ± 0.002	0.013 ± 0.002	0.012 ± 0.002
06/26/17	0.014 ± 0.002	0.014 ± 0.002	0.014 ± 0.002	0.013 ± 0.002	0.013 ± 0.002	0.014 ± 0.003	0.013 ± 0.002	0.014 ± 0.003

*Control Location

(a) Sample not able to be collected

(b) Two week sample

(c) Detection level unable to be met due to low air volume.

INDIAN POINT ENERGY CENTER
TABLE B-6
GROSS BETA ACTIVITY IN AIRBORNE PARTICULATE SAMPLES - 2017

pCi/m³ ± 2 Sigma

PERIOD ENDING	Algonquin 4	NYU Tower 5	Roseton 23*	Croton Point 27	Grassy Point 29	Peekskill 44	Training Building 94	Met Tower 95
07/03/17	0.012 ± 0.002	0.017 ± 0.003	0.011 ± 0.002	0.017 ± 0.003	0.017 ± 0.003	0.014 ± 0.002	0.013 ± 0.002	0.015 ± 0.003
07/10/17	0.010 ± 0.002	0.011 ± 0.002	0.012 ± 0.002	0.012 ± 0.002	0.012 ± 0.002	0.012 ± 0.002	0.012 ± 0.002	0.011 ± 0.002
07/17/17	0.015 ± 0.002	0.014 ± 0.002	0.015 ± 0.002	0.016 ± 0.002	0.014 ± 0.002	0.014 ± 0.002	0.015 ± 0.002	0.016 ± 0.003
07/24/17	0.016 ± 0.002	0.015 ± 0.002	0.018 ± 0.003	0.017 ± 0.002	0.016 ± 0.003	0.015 ± 0.002	0.014 ± 0.002	0.017 ± 0.003
07/31/17	0.009 ± 0.002	0.009 ± 0.002	0.009 ± 0.002	0.007 ± 0.002	0.010 ± 0.002	0.010 ± 0.002	0.008 ± 0.002	0.009 ± 0.002
08/07/17	0.013 ± 0.002	0.012 ± 0.002	0.012 ± 0.002	0.012 ± 0.002	0.015 ± 0.003	0.013 ± 0.002	0.014 ± 0.002	0.015 ± 0.003
08/14/17	0.019 ± 0.003	0.018 ± 0.003	0.016 ± 0.002	0.014 ± 0.002	0.017 ± 0.002	0.018 ± 0.003	0.015 ± 0.002	0.019 ± 0.003
08/21/17	0.013 ± 0.002	0.017 ± 0.003	0.015 ± 0.002	0.016 ± 0.002	0.016 ± 0.002	0.013 ± 0.002	0.015 ± 0.002	0.014 ± 0.002
08/28/17	0.017 ± 0.003	0.013 ± 0.002	0.014 ± 0.002	0.013 ± 0.002	0.014 ± 0.002	0.013 ± 0.002	0.012 ± 0.002	0.016 ± 0.003
09/05/17	0.012 ± 0.002	0.013 ± 0.002	0.011 ± 0.002	0.012 ± 0.002	0.012 ± 0.002	0.012 ± 0.002	0.014 ± 0.002	0.013 ± 0.002
09/11/17	0.011 ± 0.002	0.013 ± 0.003	0.012 ± 0.002	0.010 ± 0.002	0.012 ± 0.003	0.010 ± 0.002	0.010 ± 0.002	0.011 ± 0.002
09/18/17	0.017 ± 0.002	0.018 ± 0.003	0.016 ± 0.002	0.014 ± 0.002	0.017 ± 0.002	0.016 ± 0.002	0.016 ± 0.002	0.015 ± 0.002
09/25/17	0.019 ± 0.003	0.020 ± 0.003	0.020 ± 0.003	0.020 ± 0.003	0.021 ± 0.003	0.018 ± 0.006	0.021 ± 0.003	0.021 ± 0.003
10/02/17	0.014 ± 0.002	0.012 ± 0.002	0.012 ± 0.002	0.010 ± 0.002	0.012 ± 0.002	0.010 ± 0.002	0.011 ± 0.002	0.013 ± 0.002
10/10/17	0.016 ± 0.002	0.016 ± 0.002	0.016 ± 0.002	0.015 ± 0.002	0.015 ± 0.002	0.014 ± 0.002	0.016 ± 0.002	0.016 ± 0.002
10/16/17	0.014 ± 0.003	0.012 ± 0.003	0.010 ± 0.002	0.013 ± 0.003	0.015 ± 0.003	0.013 ± 0.003	0.016 ± 0.003	0.013 ± 0.003
10/23/17	0.017 ± 0.003	0.019 ± 0.003	0.020 ± 0.003	0.019 ± 0.003	0.019 ± 0.003	0.017 ± 0.003	0.019 ± 0.003	0.017 ± 0.003
10/30/17	0.010 ± 0.002	0.011 ± 0.002	0.010 ± 0.002	0.010 ± 0.002	0.011 ± 0.002	0.011 ± 0.002	0.010 ± 0.002	0.011 ± 0.002
11/06/17	0.013 ± 0.002	0.012 ± 0.002	0.014 ± 0.002	0.013 ± 0.002	0.012 ± 0.002	0.013 ± 0.002	0.013 ± 0.002	0.011 ± 0.002
11/13/17	0.011 ± 0.002	0.010 ± 0.002	0.011 ± 0.002	0.011 ± 0.002	0.012 ± 0.002	0.011 ± 0.003	0.010 ± 0.002	0.011 ± 0.002
11/21/17	0.017 ± 0.002	0.016 ± 0.002	0.016 ± 0.002	0.016 ± 0.002	0.014 ± 0.002	(c) < 0.187	0.017 ± 0.002	0.015 ± 0.002
11/27/17	0.018 ± 0.003	0.017 ± 0.003	0.015 ± 0.003	0.016 ± 0.003	0.017 ± 0.003	0.019 ± 0.003	0.017 ± 0.003	0.018 ± 0.003
12/04/17	0.016 ± 0.002	0.015 ± 0.002	0.015 ± 0.002	0.016 ± 0.002	0.016 ± 0.003	0.017 ± 0.003	0.016 ± 0.002	0.017 ± 0.002
12/11/17	0.015 ± 0.002	0.015 ± 0.002	0.017 ± 0.002	0.073 ± 0.037	0.014 ± 0.002	0.018 ± 0.004	0.017 ± 0.003	0.014 ± 0.002
12/18/17	0.011 ± 0.002	0.012 ± 0.002	0.011 ± 0.002	0.011 ± 0.002	0.011 ± 0.002	0.011 ± 0.004	0.012 ± 0.002	0.011 ± 0.002
12/26/17	0.014 ± 0.002	0.013 ± 0.002	0.015 ± 0.002	0.014 ± 0.002	0.016 ± 0.002	0.014 ± 0.002	0.015 ± 0.002	0.014 ± 0.002

*Control Location

(c) Detection level unable to be met due to low air volume.

INDIAN POINT ENERGY CENTER
TABLE B-7
IODINE-131 ACTIVITY IN AIRBORNE CHARCOAL SAMPLES - 2017

pCi/m³ ± 2 Sigma

PERIOD ENDING	Algonquin 4	NYU Tower 5	Roseton 23*	Croton Point 27	Grassy Point 29	Peekskill 44	Training Building 94	Met Tower 95
01/03/17	< 0.026	< 0.027	< 0.024	< 0.026	< 0.024	< 0.026	< 0.025	< 0.025
01/09/17	< 0.040	< 0.041	< 0.041	< 0.040	< 0.043	< 0.045	< 0.043	< 0.046
01/17/17	< 0.027	< 0.028	< 0.012	< 0.027	< 0.023	< 0.025	< 0.026	< 0.025
01/23/17	< 0.032	< 0.033	< 0.024	< 0.420	< 0.025	< 0.027	< 0.031	< 0.028
01/30/17	< 0.019	< 0.020	< 0.018	< 0.018	< 0.019	< 0.020	< 0.018	< 0.020
02/06/17	< 0.028	< 0.029	< 0.011	< 0.027	< 0.026	< 0.028	< 0.027	< 0.030
02/13/17	< 0.046	< 0.038	< 0.034	< 0.045	< 0.033	< 0.036	< 0.044	< 0.037
02/21/17	< 0.027	< 0.031	< 0.012	< 0.026	< 0.022	< 0.024	< 0.026	< 0.025
02/27/17	< 0.029	< 0.029	< 0.034	< 0.028	< 0.035	< 0.039	< 0.028	< 0.038
03/06/17	< 0.022	< 0.022	< 0.022	< 0.021	< 0.023	< 0.025	< 0.021	< 0.025
03/13/17	< 0.040	< 0.043	< 0.014	< 0.055	< 0.036	< 0.040	< 0.042	< 0.040
03/20/17	(a)	< 0.028	< 0.031	< 0.027	< 0.031	< 0.035	< 0.028	< 0.029
03/27/17	(b) < 0.013	< 0.040	< 0.027	< 0.037	< 0.029	< 0.031	< 0.038	< 0.029
04/03/17	< 0.025	< 0.025	< 0.028	< 0.024	< 0.031	< 0.030	< 0.008	< 0.033
04/10/17	< 0.019	< 0.019	< 0.014	< 0.019	< 0.015	< 0.014	< 0.017	< 0.015
04/17/17	< 0.029	< 0.029	< 0.024	< 0.030	< 0.026	< 0.025	< 0.011	< 0.026
04/24/17	< 0.031	< 0.028	< 0.026	< 0.029	< 0.028	< 0.068	< 0.029	< 0.027
05/01/17	< 0.038	< 0.035	< 0.025	< 0.036	< 0.052	< 0.050	< 0.035	< 0.051
05/08/17	< 0.029	< 0.026	< 0.027	< 0.027	< 0.030	< 0.029	< 0.026	< 0.029
05/15/17	< 0.052	< 0.042	< 0.023	< 0.045	< 0.026	< 0.025	< 0.041	< 0.025
05/22/17	< 0.039	< 0.037	< 0.038	< 0.040	< 0.041	< 0.040	< 0.038	< 0.039
05/30/17	< 0.033	< 0.032	< 0.039	< 0.033	< 0.036	< 0.040	< 0.032	< 0.040
06/05/17	< 0.019	< 0.020	< 0.031	< 0.021	< 0.030	< 0.032	< 0.008	< 0.030
06/12/17	< 0.022	< 0.021	< 0.026	< 0.022	< 0.024	< 0.026	< 0.022	< 0.027
06/19/17	< 0.028	< 0.029	< 0.023	< 0.030	< 0.022	< 0.024	< 0.028	< 0.023
06/26/17	< 0.024	< 0.023	< 0.015	< 0.022	< 0.032	< 0.033	< 0.023	< 0.033

*Control Location

(a) Sample not able to be collected

(b) Two week sample

INDIAN POINT ENERGY CENTER
TABLE B-7
IODINE-131 ACTIVITY IN AIRBORNE CHARCOAL SAMPLES - 2017

pCi/m³ ± 2 Sigma

PERIOD ENDING	Algonquin 4	NYU Tower 5	Roseton 23*	Croton Point 27	Grassy Point 29	Peekskill 44	Training Building 94	Met Tower 95
07/03/17	< 0.031	< 0.031	< 0.018	< 0.029	< 0.036	< 0.036	< 0.031	< 0.037
07/10/17	< 0.028	< 0.027	< 0.024	< 0.026	< 0.026	< 0.027	< 0.027	< 0.027
07/17/17	< 0.030	< 0.030	< 0.026	< 0.029	< 0.028	< 0.029	< 0.029	< 0.028
07/24/17	< 0.029	< 0.030	< 0.029	< 0.029	< 0.030	< 0.031	< 0.031	< 0.031
07/31/17	< 0.027	< 0.029	< 0.013	< 0.027	< 0.025	< 0.026	< 0.030	< 0.026
08/07/17	< 0.023	< 0.024	< 0.022	< 0.023	< 0.023	< 0.024	< 0.025	< 0.024
08/14/17	< 0.012	< 0.032	< 0.032	< 0.030	< 0.033	< 0.035	< 0.032	< 0.034
08/21/17	< 0.019	< 0.024	< 0.026	< 0.023	< 0.028	< 0.029	< 0.024	< 0.030
08/28/17	< 0.040	< 0.035	< 0.020	< 0.032	< 0.021	< 0.022	< 0.035	< 0.022
09/05/17	< 0.012	< 0.036	< 0.033	< 0.035	< 0.036	< 0.037	< 0.038	< 0.037
09/11/17	< 0.030	< 0.033	< 0.034	< 0.030	< 0.036	< 0.037	< 0.033	< 0.036
09/18/17	< 0.021	< 0.023	< 0.037	< 0.022	< 0.040	< 0.041	< 0.023	< 0.041
09/25/17	< 0.020	< 0.022	< 0.019	< 0.020	< 0.020	< 0.064	< 0.022	< 0.020
10/02/17	< 0.036	< 0.038	< 0.024	< 0.036	< 0.026	< 0.027	< 0.040	< 0.027
10/10/17	< 0.031	< 0.034	< 0.025	< 0.031	< 0.028	< 0.028	< 0.034	< 0.029
10/16/17	< 0.037	< 0.039	< 0.033	< 0.037	< 0.036	< 0.037	< 0.041	< 0.038
10/23/17	< 0.021	< 0.022	< 0.015	< 0.020	< 0.016	< 0.016	< 0.023	< 0.016
10/30/17	< 0.028	< 0.030	< 0.023	< 0.028	< 0.025	< 0.026	< 0.031	< 0.027
11/06/17	< 0.020	< 0.022	< 0.020	< 0.020	< 0.022	< 0.022	< 0.023	< 0.021
11/13/17	< 0.029	< 0.030	< 0.010	< 0.016	< 0.033	< 0.051	< 0.032	< 0.030
11/21/17	< 0.035	< 0.037	< 0.021	< 0.034	< 0.023	< 2.525	< 0.039	< 0.021
11/27/17	< 0.030	< 0.031	< 0.017	< 0.030	< 0.020	< 0.020	< 0.034	< 0.018
12/04/17	< 0.024	< 0.024	< 0.029	< 0.024	< 0.032	< 0.033	< 0.027	< 0.028
12/11/17	< 0.023	< 0.023	< 0.035	< 0.711	< 0.040	< 0.068	< 0.027	< 0.035
12/18/17	< 0.025	< 0.025	< 0.014	< 0.029	< 0.019	< 0.047	< 0.029	< 0.017
12/26/17	< 0.046	< 0.045	< 0.034	< 0.052	< 0.038	< 0.039	< 0.054	< 0.035

*Control Location

INDIAN POINT ENERGY CENTER
TABLE B-8
GAMMA EMITTERS IN AIRBORNE PARTICULATE SAMPLES - 2017

10^{-3} pCi/m³ ± 2 Sigma

DATE	Algonquin 4				NYU Tower 5			
	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter
Be-7	115 ± 19	92 ± 24	146 ± 26	94 ± 18	117 ± 24	119 ± 19	102 ± 21	98 ± 26
K-40	< 12	< 26	< 19	< 14	< 21	< 26	< 8	< 31
Mn-54	< 1	< 2	< 1	< 1	< 1	< 2	< 1	< 2
Co-58	< 1	< 2	< 2	< 1	< 2	< 2	< 2	< 3
Fe-59	< 5	< 6	< 7	< 4	< 6	< 8	< 6	< 9
Co-60	< 1	< 2	< 1	< 1	< 1	< 1	< 1	< 3
Zn-65	< 3	< 4	< 2	< 2	< 3	< 4	< 5	< 4
Nb-95	< 2	< 2	< 2	< 2	< 2	< 3	< 3	< 3
Zr-95	< 3	< 4	< 4	< 3	< 3	< 5	< 4	< 7
Ru-103	< 2	< 3	< 3	< 2	< 3	< 3	< 3	< 4
Ru-106	< 10	< 10	< 11	< 8	< 12	< 16	< 11	< 16
I-131	< 152	< 144	< 487	< 244	< 216	< 226	< 526	< 436
Cs-134	< 1	< 1	< 1	< 1	< 1	< 2	< 1	< 2
Cs-137	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 2
Ba-140	< 77	< 76	< 143	< 85	< 119	< 112	< 212	< 186
La-140	< 23	< 40	< 62	< 23	< 34	< 42	< 87	< 87
Ce-141	< 4	< 4	< 5	< 4	< 5	< 6	< 5	< 7
Ce-144	< 5	< 6	< 6	< 5	< 7	< 9	< 6	< 7
Ra-226	< 15	< 23	< 21	< 15	< 24	< 28	< 19	< 29
Ac-228	< 4	< 5	< 5	< 3	< 3	< 6	< 4	< 6
Th-228	< 2	< 2	< 2	< 1	< 2	< 2	< 2	< 2

INDIAN POINT ENERGY CENTER
TABLE B-8
GAMMA EMITTERS IN AIRBORNE PARTICULATE SAMPLES - 2017

10^{-3} pCi/m³ ± 2 Sigma

DATE	Roseton 23*				Croton Point 27			
	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter
Be-7	115 ± 27	129 ± 37	117 ± 27	87 ± 25	121 ± 25	127 ± 19	110 ± 30	81 ± 23
K-40	< 22	< 33	< 16	< 27	< 22	< 14	< 30	< 22
Mn-54	< 1	< 2	< 2	< 1	< 1	< 1	< 2	< 1
Co-58	< 2	< 3	< 3	< 2	< 2	< 2	< 4	< 1
Fe-59	< 5	< 10	< 11	< 6	< 6	< 5	< 11	< 8
Co-60	< 1	< 2	< 1	< 1	< 2	< 1	< 2	< 1
Zn-65	< 4	< 6	< 4	< 3	< 3	< 3	< 5	< 3
Nb-95	< 3	< 3	< 4	< 2	< 2	< 2	< 3	< 2
Zr-95	< 5	< 5	< 5	< 4	< 3	< 3	< 6	< 4
Ru-103	< 4	< 5	< 5	< 4	< 4	< 2	< 5	< 3
Ru-106	< 15	< 19	< 20	< 11	< 12	< 10	< 15	< 12
I-131	< 307	< 255	< 770	< 347	< 223	< 132	< 707	< 300
Cs-134	< 2	< 2	< 2	< 1	< 1	< 1	< 2	< 1
Cs-137	< 1	< 2	< 2	< 1	< 1	< 1	< 2	< 1
Ba-140	< 146	< 138	< 282	< 140	< 123	< 80	< 316	< 106
La-140	< 45	< 42	< 104	< 64	< 36	< 20	< 143	< 40
Ce-141	< 6	< 5	< 9	< 5	< 5	< 4	< 7	< 5
Ce-144	< 8	< 7	< 10	< 7	< 7	< 5	< 7	< 5
Ra-226	< 26	< 25	< 28	< 24	< 25	< 16	< 25	< 18
Ac-228	< 6	< 8	< 7	< 5	< 3	< 4	< 6	< 4
Th-228	< 2	< 2	< 3	< 2	< 2	< 2	< 2	< 2

* Control Location

INDIAN POINT ENERGY CENTER
TABLE B-8
GAMMA EMITTERS IN AIRBORNE PARTICULATE SAMPLES - 2017

10^{-3} pCi/m³ ± 2 Sigma

DATE	Grassy Point 29				Peekskill 44			
	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter
Be-7	94 ± 24	120 ± 24	132 ± 24	91 ± 18	125 ± 27	91 ± 20	132 ± 25	127 ± 31
K-40	< 19	< 16	< 21	< 15	< 26	< 30	< 18	< 20
Mn-54	< 1	< 1	< 1	< 1	< 1	< 1	< 2	< 2
Co-58	< 2	< 2	< 3	< 2	< 2	< 2	< 1	< 2
Fe-59	< 6	< 6	< 8	< 4	< 4	< 8	< 9	< 10
Co-60	< 1	< 1	< 2	< 1	< 1	< 2	< 1	< 2
Zn-65	< 3	< 4	< 4	< 3	< 3	< 4	< 4	< 4
Nb-95	< 2	< 2	< 3	< 2	< 3	< 2	< 2	< 3
Zr-95	< 4	< 3	< 5	< 3	< 3	< 4	< 3	< 6
Ru-103	< 2	< 3	< 5	< 3	< 4	< 3	< 3	< 5
Ru-106	< 9	< 10	< 15	< 8	< 15	< 10	< 12	< 19
I-131	< 176	< 140	< 709	< 245	< 251	< 158	< 497	< 492
Cs-134	< 1	< 1	< 2	< 1	< 2	< 1	< 1	< 2
Cs-137	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 2
Ba-140	< 88	< 59	< 222	< 119	< 135	< 74	< 210	< 193
La-140	< 41	< 42	< 82	< 44	< 20	< 37	< 58	< 90
Ce-141	< 4	< 4	< 9	< 5	< 5	< 4	< 5	< 8
Ce-144	< 5	< 5	< 9	< 5	< 7	< 6	< 6	< 10
Ra-226	< 17	< 18	< 30	< 19	< 23	< 22	< 20	< 34
Ac-228	< 5	< 4	< 6	< 4	< 6	< 6	< 4	< 8
Th-228	< 2	< 2	< 2	< 1	< 2	< 2	< 2	< 3

INDIAN POINT ENERGY CENTER
TABLE B-8
GAMMA EMITTERS IN AIRBORNE PARTICULATE SAMPLES - 2017

10^{-3} pCi/m³ ± 2 Sigma

DATE	Training Building 94				Met Tower 95			
	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter
Be-7	133 ± 21	134 ± 24	125 ± 25	81 ± 22	122 ± 23	101 ± 20	118 ± 30	93 ± 21
K-40	< 12	< 13	< 8	< 16	< 27	< 21	< 11	< 11
Mn-54	< 1	< 2	< 1	< 1	< 1	< 2	< 1	< 1
Co-58	< 2	< 2	< 2	< 3	< 2	< 2	< 2	< 2
Fe-59	< 5	< 5	< 5	< 5	< 6	< 5	< 8	< 8
Co-60	< 1	< 1	< 2	< 1	< 2	< 1	< 2	< 1
Zn-65	< 3	< 4	< 3	< 3	< 3	< 3	< 5	< 3
Nb-95	< 2	< 2	< 2	< 2	< 2	< 2	< 2	< 2
Zr-95	< 4	< 4	< 5	< 3	< 3	< 4	< 3	< 3
Ru-103	< 2	< 2	< 3	< 3	< 3	< 3	< 4	< 3
Ru-106	< 9	< 11	< 12	< 12	< 13	< 11	< 8	< 9
I-131	< 219	< 150	< 444	< 361	< 216	< 174	< 540	< 303
Cs-134	< 2	< 1	< 1	< 2	< 2	< 1	< 1	< 1
Cs-137	< 1	< 1	< 1	< 2	< 1	< 1	< 1	< 1
Ba-140	< 91	< 91	< 143	< 154	< 130	< 95	< 191	< 123
La-140	< 18	< 24	< 79	< 39	< 35	< 37	< 87	< 64
Ce-141	< 3	< 4	< 6	< 5	< 5	< 4	< 6	< 4
Ce-144	< 5	< 5	< 6	< 6	< 6	< 7	< 6	< 6
Ra-226	< 18	< 21	< 21	< 20	< 23	< 21	< 20	< 19
Ac-228	< 4	< 5	< 5	< 4	< 6	< 5	< 6	< 5
Th-228	< 2	< 2	< 2	< 2	< 2	< 2	< 2	< 1

INDIAN POINT ENERGY CENTER
TABLE B-9
RADIONUCLIDES IN RAINWATER SAMPLES - 2017

pCi/L \pm 2 Sigma

DATE	Roseton 23*				Peekskill 44			
	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter
RADIOCHEMICAL								
H-3	< 172	< 191	< 178	< 175	< 173	< 186	< 173	< 177
GAMMA								
Be-7	< 9	< 10	< 8	< 11	< 12	< 10	< 11	< 18
K-40	< 5	< 14	< 14	< 21	< 6	< 24	< 7	< 11
Mn-54	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1
Co-58	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 2
Fe-59	< 2	< 2	< 2	< 3	< 3	< 2	< 3	< 4
Co-60	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1
Zn-65	< 1	< 1	< 1	< 2	< 1	< 2	< 2	< 3
Nb-95	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 2
Zr-95	< 1	< 1	< 1	< 2	< 2	< 2	< 2	< 3
Ru-103	< 1	< 1	< 1	< 2	< 1	< 1	< 2	< 2
Ru-106	< 5	< 6	< 6	< 6	< 7	< 7	< 7	< 8
I-131	< 55	< 39	< 36	< 72	< 69	< 44	< 47	< 113
Cs-134	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1
Cs-137	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1
Ba-140	< 32	< 34	< 29	< 45	< 43	< 31	< 31	< 66
La-140	< 9	< 9	< 9	< 16	< 12	< 9	< 9	< 23
Ce-141	< 3	< 3	< 3	< 3	< 3	< 3	< 3	< 5
Ce-144	< 5	< 6	< 6	< 5	< 6	< 5	< 6	< 7
Ra-226	< 17	< 15	< 16	< 17	< 15	< 20	< 21	< 27
Ac-228	< 2	< 3	< 3	< 3	< 3	< 4	< 4	< 5
Th-228	< 1	10 \pm 3	< 2	< 2	< 2	5 \pm 3	< 1	< 2

* Control Location

INDIAN POINT ENERGY CENTER
TABLE B-10
RADIONUCLIDES IN DRINKING WATER SAMPLES - 2017

pCi/L \pm 2 Sigma

Camp Field
7

DATE	01/10/17	02/14/17	03/20/17	04/12/17	05/08/17	06/13/17
RADIOCHEMICAL						
Gr-B	4 \pm 2	< 3	< 2	3 \pm 1	< 2	< 2
H-3 (a)			< 190			< 180
GAMMA						
Be-7	< 48	< 48	< 46	< 41	< 45	< 60
K-40	< 102	< 111	< 43	< 54	< 48	< 145
Mn-54	< 4	< 4	< 6	< 5	< 6	< 9
Co-58	< 5	< 5	< 3	< 5	< 6	< 7
Fe-59	< 10	< 11	< 10	< 8	< 11	< 15
Co-60	< 7	< 4	< 6	< 2	< 7	< 4
Zn-65	< 9	< 12	< 7	< 13	< 11	< 17
Nb-95	< 5	< 7	< 5	< 6	< 6	< 7
Zr-95	< 9	< 8	< 10	< 7	< 10	< 11
Ru-103	< 5	< 5	< 6	< 6	< 6	< 8
Ru-106	< 53	< 51	< 47	< 53	< 53	< 56
I-131	< 9	< 10	< 7	< 8	< 8	< 9
Cs-134	< 5	< 6	< 5	< 6	< 6	< 7
Cs-137	< 6	< 6	< 6	< 6	< 6	< 8
Ba-140	< 24	< 20	< 17	< 24	< 25	< 31
La-140	< 6	< 7	< 7	< 8	< 7	< 10
Ce-141	< 10	< 11	< 9	< 8	< 11	< 13
Ce-144	< 41	< 41	< 44	< 39	< 48	< 56
Ra-226	< 126	< 134	< 126	< 154	< 160	< 191
Ac-228	< 24	< 23	< 13	< 20	< 29	< 36
Th-228	< 11	< 11	< 9	< 11	< 13	< 15

(a) Quarterly Composite

INDIAN POINT ENERGY CENTER
TABLE B-10
RADIONUCLIDES IN DRINKING WATER SAMPLES - 2017

pCi/L \pm 2 Sigma

Camp Field
7

DATE	07/11/17	08/15/17	09/12/17	10/06/17	11/28/17	12/11/17
RADIOCHEMICAL						
Gr-B	3 \pm 2	< 2	4 \pm 2	3 \pm 2	5 \pm 2	3 \pm 2
H-3 (a)			< 178			< 184
GAMMA						
Be-7	< 49	< 37	< 47	< 54	< 84	< 68
K-40	< 139	< 41	< 104	< 87	< 144	< 101
Mn-54	< 6	< 5	< 5	< 4	< 8	< 9
Co-58	< 6	< 4	< 5	< 6	< 9	< 11
Fe-59	< 12	< 10	< 11	< 16	< 12	< 16
Co-60	< 5	< 4	< 4	< 7	< 8	< 11
Zn-65	< 13	< 8	< 10	< 14	< 21	< 19
Nb-95	< 6	< 5	< 5	< 7	< 9	< 8
Zr-95	< 10	< 8	< 9	< 11	< 15	< 14
Ru-103	< 6	< 4	< 6	< 7	< 10	< 8
Ru-106	< 53	< 35	< 47	< 60	< 80	< 77
I-131	< 11	< 6	< 15	< 14	< 12	< 12
Cs-134	< 8	< 5	< 6	< 6	< 10	< 9
Cs-137	< 7	< 5	< 5	< 5	< 9	< 9
Ba-140	< 31	< 20	< 39	< 30	< 38	< 35
La-140	< 7	< 5	< 11	< 8	< 10	< 9
Ce-141	< 11	< 8	< 11	< 13	< 20	< 12
Ce-144	< 43	< 35	< 36	< 43	< 86	< 49
Ra-226	< 125	< 137	< 133	< 159	< 285	< 191
Ac-228	< 25	< 15	< 22	< 22	< 38	< 31
Th-228	< 12	< 10	< 9	< 11	< 20	< 14

(a) Quarterly Composite

INDIAN POINT ENERGY CENTER
TABLE B-10
RADIONUCLIDES IN DRINKING WATER SAMPLES - 2017

pCi/L \pm 2 Sigma

Croton
8

DATE	01/10/17	02/14/17	03/20/17	04/12/17	05/08/17	06/13/17
RADIOCHEMICAL						
Gr-B	3 \pm 2	< 2	3 \pm 2	3 \pm 2	3 \pm 2	2 \pm 1
H-3 (a)			< 190			< 182
GAMMA						
Be-7	< 66	< 59	< 56	< 70	< 86	< 55
K-40	< 95	< 147	< 146	< 101	< 144	< 119
Mn-54	< 8	< 6	< 7	< 9	< 9	< 7
Co-58	< 6	< 7	< 6	< 12	< 9	< 7
Fe-59	< 17	< 13	< 12	< 21	< 16	< 15
Co-60	< 9	< 8	< 7	< 8	< 9	< 9
Zn-65	< 11	< 13	< 14	< 16	< 20	< 13
Nb-95	< 9	< 6	< 6	< 10	< 9	< 8
Zr-95	< 13	< 14	< 11	< 14	< 14	< 13
Ru-103	< 8	< 8	< 6	< 9	< 9	< 8
Ru-106	< 69	< 50	< 54	< 86	< 77	< 63
I-131	< 13	< 12	< 9	< 12	< 11	< 9
Cs-134	< 8	< 6	< 8	< 9	< 8	< 9
Cs-137	< 6	< 8	< 8	< 11	< 12	< 7
Ba-140	< 33	< 33	< 23	< 40	< 39	< 28
La-140	< 12	< 9	< 8	< 14	< 11	< 8
Ce-141	< 14	< 13	< 11	< 13	< 14	< 12
Ce-144	< 60	< 49	< 48	< 50	< 58	< 50
Ra-226	< 194	< 188	< 152	< 186	< 215	< 191
Ac-228	< 29	< 24	< 31	< 32	< 40	< 25
Th-228	< 15	< 13	< 14	< 15	< 17	< 16

(a) Quarterly Composite

INDIAN POINT ENERGY CENTER
TABLE B-10
RADIONUCLIDES IN DRINKING WATER SAMPLES - 2017

pCi/L \pm 2 Sigma

Croton
8

DATE	07/11/17	08/15/17	09/12/17	10/06/17	11/28/17	12/11/17
RADIOCHEMICAL						
Gr-B	3 \pm 2	< 2	3 \pm 2	3 \pm 2	4 \pm 2	< 2
H-3 (a)			< 179			< 185
GAMMA						
Be-7	< 69	< 55	< 37	< 48	< 69	< 56
K-40	< 116	< 72	< 61	< 110	< 172	< 145
Mn-54	< 8	< 5	< 3	< 5	< 8	< 7
Co-58	< 8	< 6	< 5	< 5	< 8	< 5
Fe-59	< 15	< 11	< 9	< 12	< 13	< 10
Co-60	< 8	< 6	< 3	< 6	< 7	< 8
Zn-65	< 15	< 13	< 8	< 8	< 18	< 14
Nb-95	< 8	< 5	< 4	< 6	< 8	< 8
Zr-95	< 12	< 9	< 7	< 9	< 14	< 13
Ru-103	< 9	< 6	< 4	< 7	< 8	< 7
Ru-106	< 66	< 49	< 36	< 51	< 73	< 71
I-131	< 12	< 8	< 13	< 13	< 10	< 10
Cs-134	< 9	< 7	< 4	< 6	< 10	< 7
Cs-137	< 8	< 6	< 4	< 6	< 8	< 7
Ba-140	< 31	< 24	< 31	< 31	< 36	< 30
La-140	< 14	< 7	< 8	< 10	< 8	< 11
Ce-141	< 13	< 10	< 8	< 12	< 11	< 13
Ce-144	< 46	< 45	< 27	< 46	< 49	< 55
Ra-226	< 179	< 146	< 107	< 141	< 167	< 180
Ac-228	< 30	< 25	< 15	< 19	< 31	< 25
Th-228	< 13	< 13	< 8	< 11	< 13	< 16

(a) Quarterly Composite

INDIAN POINT ENERGY CENTER
TABLE B-11
RADIONUCLIDES IN GROUNDWATER SAMPLES - 2017

pCi/L \pm 2 Sigma

Lafarge Monitoring Well
106

DATE	04/18/17	11/16/17
RADIOCHEMICAL		
H-3	< 194	< 177
Ni-63	< 14	< 13
Sr-90	< 1	< 0
GAMMA		
Be-7	< 89	< 33
K-40	< 138	< 27
Mn-54	< 11	< 3
Co-58	< 9	< 3
Fe-59	< 16	< 6
Co-60	< 11	< 3
Zn-65	< 25	< 7
Nb-95	< 13	< 4
Zr-95	< 17	< 6
Ru-103	< 10	< 4
Ru-106	< 87	< 30
Cs-134	< 10	< 3
Cs-137	< 12	< 4
Ba-140	< 38	< 24
La-140	< 13	< 7
Ce-141	< 19	< 9
Ce-144	< 80	< 32
Ac-228	< 48	< 11

INDIAN POINT ENERGY CENTER
TABLE B-12
GAMMA EMITTERS IN SOIL SAMPLES, 2017

pCi/kg dry \pm 2 Sigma

	Roseton 23*	Training Building 94	Met Tower 95
DATE	09/25/17	09/25/17	09/25/17
Be-7	< 501	< 698	< 446
K-40	19650 \pm 1750	14310 \pm 1473	8959 \pm 966
Mn-54	< 59	< 69	< 46
Co-58	< 66	< 74	< 46
Fe-59	< 128	< 160	< 85
Co-60	< 61	< 69	< 41
Zn-65	< 164	< 158	< 107
Nb-95	< 72	< 79	< 53
Zr-95	< 122	< 129	< 77
Ru-103	< 51	< 73	< 50
Ru-106	< 455	< 616	< 436
I-131	< 102	< 149	< 83
Cs-134	< 74	< 88	< 62
Cs-137	249 \pm 63	191 \pm 68	222 \pm 68
Ba-140	< 293	< 386	< 228
La-140	< 105	< 93	< 66
Ce-141	< 91	< 134	< 78
Ce-144	< 320	< 478	< 304
Ra-226	1687 \pm 932	< 1617	< 1229
Th-228	948 \pm 100	747 \pm 121	217 \pm 80

* Control Location

INDIAN POINT ENERGY CENTER
TABLE B-13
GAMMA EMITTERS IN BROADLEAF VEGETATION SAMPLES - 2017

pCi/kg wet \pm 2 Sigma

DATE	Roseton 23*					
	05/17/17	05/17/17	05/17/17	06/21/17	06/21/17	06/21/17
GAMMA						
Be-7	450 \pm 224	389 \pm 207	891 \pm 248	616 \pm 102	< 155	2186 \pm 152
K-40	4282 \pm 545	4563 \pm 526	6909 \pm 555	4956 \pm 214	4627 \pm 234	7776 \pm 316
Mn-54	< 23	< 23	< 23	< 9	< 10	< 10
Co-58	< 26	< 25	< 22	< 10	< 11	< 11
Fe-59	< 53	< 46	< 49	< 22	< 30	< 32
Co-60	< 25	< 20	< 25	< 9	< 10	< 11
Zn-65	< 58	< 46	< 53	< 22	< 21	< 26
Nb-95	< 24	< 26	< 22	< 10	< 12	< 12
Zr-95	< 39	< 43	< 41	< 17	< 21	< 19
Ru-103	< 25	< 25	< 23	< 12	< 12	< 12
Ru-106	< 189	< 197	< 212	< 72	< 86	< 93
I-131	< 34	< 30	< 30	< 50	< 53	< 54
Cs-134	< 23	< 30	< 25	< 9	< 10	< 11
Cs-137	< 25	< 29	< 21	< 9	< 10	< 10
Ba-140	< 98	< 115	< 97	< 87	< 93	< 97
La-140	< 27	< 26	< 20	< 24	< 25	< 23
Ce-141	< 39	< 37	< 34	< 20	< 17	< 21
Ce-144	< 163	< 155	< 141	< 60	< 49	< 63
Ra-226	< 544	< 540	< 482	< 203	< 173	< 197
Th-228	< 41	< 43	< 40	< 17	< 15	22 \pm 12

* Control Location

INDIAN POINT ENERGY CENTER
TABLE B-13
GAMMA EMITTERS IN BROADLEAF VEGETATION SAMPLES - 2017

pCi/kg wet \pm 2 Sigma

DATE	Roseton 23*					
	07/26/17	07/26/17	07/26/17	08/23/17	08/23/17	08/23/17
GAMMA						
Be-7	2141 \pm 401	2248 \pm 442	1245 \pm 401	2056 \pm 394	1216 \pm 317	1811 \pm 321
K-40	5973 \pm 674	4664 \pm 693	3614 \pm 623	3086 \pm 583	4882 \pm 649	7461 \pm 842
Mn-54	< 39	< 27	< 32	< 36	< 38	< 25
Co-58	< 37	< 28	< 28	< 29	< 33	< 30
Fe-59	< 79	< 62	< 64	< 58	< 81	< 60
Co-60	< 42	< 19	< 30	< 35	< 37	< 39
Zn-65	< 93	< 67	< 65	< 69	< 86	< 79
Nb-95	< 39	< 35	< 44	< 41	< 32	< 29
Zr-95	< 60	< 46	< 64	< 52	< 57	< 59
Ru-103	< 36	< 33	< 40	< 33	< 37	< 30
Ru-106	< 348	< 254	< 306	< 322	< 363	< 269
I-131	< 59	< 53	< 58	< 45	< 54	< 41
Cs-134	< 37	< 38	< 40	< 39	< 40	< 37
Cs-137	< 35	< 33	< 30	< 32	< 42	< 27
Ba-140	< 176	< 135	< 164	< 146	< 165	< 110
La-140	< 46	< 46	< 45	< 42	< 46	< 41
Ce-141	< 57	< 44	< 61	< 56	< 55	< 45
Ce-144	< 211	< 195	< 205	< 263	< 235	< 191
Ra-226	< 814	< 603	< 935	< 912	< 814	< 699
Th-228	< 70	< 46	< 69	< 68	< 63	< 56

* Control Location

INDIAN POINT ENERGY CENTER
TABLE B-13
GAMMA EMITTERS IN BROADLEAF VEGETATION SAMPLES - 2017

pCi/kg wet \pm 2 Sigma

DATE	Roseton 23*				
	09/25/17	09/25/17	09/25/17	10/06/17	10/06/17
GAMMA					
Be-7	1667 \pm 509	521 \pm 310	1464 \pm 423	1887 \pm 334	4782 \pm 337
K-40	2087 \pm 609	6558 \pm 853	3780 \pm 817	2940 \pm 619	5436 \pm 464
Mn-54	< 44	< 40	< 44	< 20	< 20
Co-58	< 37	< 36	< 36	< 32	< 17
Fe-59	< 56	< 88	< 88	< 58	< 48
Co-60	< 29	< 41	< 29	< 23	< 20
Zn-65	< 70	< 111	< 93	< 53	< 48
Nb-95	< 34	< 36	< 41	< 28	< 21
Zr-95	< 57	< 63	< 80	< 49	< 33
Ru-103	< 43	< 45	< 35	< 28	< 21
Ru-106	< 362	< 366	< 332	< 235	< 200
I-131	< 54	< 56	< 50	< 57	< 46
Cs-134	< 37	< 48	< 48	< 27	< 23
Cs-137	< 35	< 42	< 48	< 26	< 21
Ba-140	< 154	< 151	< 186	< 134	< 118
La-140	< 31	< 35	< 62	< 50	< 22
Ce-141	< 61	< 65	< 67	< 43	< 37
Ce-144	< 246	< 271	< 239	< 159	< 135
Ra-226	< 1056	< 983	< 1035	< 691	< 469
Th-228	< 66	< 78	< 91	< 54	< 34

* Control Location

INDIAN POINT ENERGY CENTER
TABLE B-13
GAMMA EMITTERS IN BROADLEAF VEGETATION SAMPLES - 2017

pCi/kg wet \pm 2 Sigma

Training Center
94

DATE	05/17/17	05/17/17	05/17/17	06/21/17	06/21/17	06/21/17
GAMMA						
Be-7	404 \pm 161	855 \pm 177	< 178	1315 \pm 111	524 \pm 84	184 \pm 75
K-40	4154 \pm 442	8048 \pm 650	3345 \pm 473	7222 \pm 263	2672 \pm 169	5707 \pm 220
Mn-54	< 15	< 17	< 23	< 8	< 8	< 8
Co-58	< 19	< 19	< 18	< 9	< 9	< 9
Fe-59	< 42	< 46	< 47	< 26	< 21	< 23
Co-60	< 19	< 26	< 18	< 9	< 9	< 8
Zn-65	< 43	< 59	< 47	< 20	< 19	< 19
Nb-95	< 18	< 21	< 22	< 10	< 10	< 9
Zr-95	< 30	< 38	< 35	< 16	< 16	< 16
Ru-103	< 19	< 20	< 21	< 11	< 11	< 10
Ru-106	< 142	< 206	< 188	< 71	< 77	< 71
I-131	< 28	< 29	< 29	< 47	< 48	< 41
Cs-134	< 16	< 23	< 20	< 9	< 9	< 8
Cs-137	< 19	< 22	< 23	< 8	< 9	< 8
Ba-140	< 78	< 71	< 92	< 81	< 85	< 77
La-140	< 20	< 23	< 27	< 23	< 23	< 19
Ce-141	< 29	< 33	< 33	< 16	< 18	< 16
Ce-144	< 124	< 128	< 141	< 49	< 54	< 48
Ra-226	< 498	< 451	< 528	< 192	< 167	< 143
Th-228	< 32	< 38	< 37	< 14	< 14	< 12

INDIAN POINT ENERGY CENTER
TABLE B-13
GAMMA EMITTERS IN BROADLEAF VEGETATION SAMPLES - 2017

pCi/kg wet \pm 2 Sigma

Training Center
94

DATE	07/26/17	07/26/17	07/26/17	08/23/17	08/23/17	08/23/17
GAMMA						
Be-7	2564 \pm 349	1217 \pm 284	2059 \pm 398	2259 \pm 437	1604 \pm 412	1204 \pm 342
K-40	6938 \pm 697	2257 \pm 532	7014 \pm 829	6448 \pm 810	2695 \pm 596	4094 \pm 712
Mn-54	< 29	< 29	< 32	< 33	< 35	< 23
Co-58	< 26	< 20	< 35	< 35	< 33	< 31
Fe-59	< 58	< 65	< 74	< 67	< 61	< 62
Co-60	< 28	< 38	< 33	< 35	< 39	< 35
Zn-65	< 69	< 57	< 84	< 68	< 59	< 75
Nb-95	< 29	< 34	< 35	< 32	< 34	< 38
Zr-95	< 45	< 62	< 54	< 57	< 55	< 54
Ru-103	< 28	< 30	< 30	< 30	< 37	< 38
Ru-106	< 257	< 255	< 255	< 278	< 352	< 401
I-131	< 45	< 51	< 52	< 39	< 56	< 58
Cs-134	< 29	< 38	< 31	< 36	< 45	< 36
Cs-137	< 29	< 37	< 41	< 33	< 37	< 34
Ba-140	< 119	< 177	< 146	< 146	< 141	< 157
La-140	< 27	< 42	< 40	< 15	< 43	< 24
Ce-141	< 48	< 51	< 47	< 53	< 60	< 53
Ce-144	< 191	< 201	< 205	< 202	< 246	< 202
Ra-226	< 695	< 802	< 813	< 859	< 937	< 955
Th-228	< 54	< 64	< 59	< 66	< 80	< 70

INDIAN POINT ENERGY CENTER
TABLE B-13
GAMMA EMITTERS IN BROADLEAF VEGETATION SAMPLES - 2017

pCi/kg wet \pm 2 Sigma

Training Center
94

DATE	09/25/17	09/25/17	09/25/17	10/06/17	10/06/17
GAMMA					
Be-7	2294 \pm 477	4681 \pm 608	1657 \pm 475	1098 \pm 365	2471 \pm 358
K-40	2447 \pm 618	5960 \pm 960	4497 \pm 829	2616 \pm 507	6202 \pm 654
Mn-54	< 46	< 43	< 47	< 27	< 24
Co-58	< 43	< 37	< 44	< 30	< 26
Fe-59	< 40	< 86	< 83	< 71	< 51
Co-60	< 48	< 37	< 34	< 30	< 25
Zn-65	< 97	< 91	< 89	< 68	< 55
Nb-95	< 49	< 47	< 42	< 25	< 23
Zr-95	< 72	< 59	< 57	< 54	< 44
Ru-103	< 38	< 42	< 40	< 39	< 25
Ru-106	< 371	< 388	< 323	< 288	< 193
I-131	< 57	< 56	< 49	< 56	< 60
Cs-134	< 49	< 52	< 41	< 22	< 24
Cs-137	< 41	< 47	< 49	< 27	< 28
Ba-140	< 168	< 153	< 164	< 181	< 116
La-140	< 39	< 48	< 56	< 57	< 29
Ce-141	< 73	< 66	< 64	< 51	< 42
Ce-144	< 313	< 258	< 255	< 212	< 147
Ra-226	< 1035	< 834	< 1119	< 637	< 621
Th-228	< 74	< 82	< 75	< 49	< 44

INDIAN POINT ENERGY CENTER
TABLE B-13
GAMMA EMITTERS IN BROADLEAF VEGETATION SAMPLES - 2017

pCi/kg wet \pm 2 Sigma

Met Tower
95

DATE	05/17/17	05/17/17	05/17/17	06/21/17	06/21/17	06/21/17
GAMMA						
Be-7	905 \pm 221	852 \pm 228	608 \pm 186	1551 \pm 105	1302 \pm 130	1427 \pm 120
K-40	3514 \pm 507	8693 \pm 646	6645 \pm 499	7516 \pm 237	3344 \pm 209	4304 \pm 176
Mn-54	< 23	< 23	< 21	< 9	< 9	< 9
Co-58	< 25	< 20	< 19	< 9	< 11	< 10
Fe-59	< 56	< 47	< 36	< 24	< 23	< 22
Co-60	< 23	< 19	< 18	< 8	< 9	< 8
Zn-65	< 52	< 47	< 48	< 21	< 21	< 21
Nb-95	< 25	< 21	< 18	< 9	< 11	< 10
Zr-95	< 47	< 39	< 38	< 17	< 19	< 18
Ru-103	< 22	< 19	< 18	< 11	< 12	< 12
Ru-106	< 201	< 171	< 170	< 75	< 84	< 80
I-131	< 32	< 29	< 26	< 45	< 54	< 54
Cs-134	< 27	< 23	< 20	< 9	< 10	< 10
Cs-137	< 25	< 23	< 20	< 8	< 9	< 9
Ba-140	< 107	< 85	< 77	< 82	< 92	< 90
La-140	< 33	< 21	< 19	< 21	< 25	< 22
Ce-141	< 30	< 31	< 29	< 17	< 18	< 23
Ce-144	< 114	< 132	< 131	< 51	< 49	< 68
Ra-226	< 466	< 477	< 439	< 171	< 199	< 217
Th-228	< 38	< 35	< 32	< 13	< 16	< 18

INDIAN POINT ENERGY CENTER
TABLE B-13
GAMMA EMITTERS IN BROADLEAF VEGETATION SAMPLES - 2017

pCi/kg wet \pm 2 Sigma

Met Tower
95

DATE	07/26/17	07/26/17	07/26/17	08/23/17	08/23/17	08/23/17
GAMMA						
Be-7	2582 \pm 319	708 \pm 399	1671 \pm 378	1039 \pm 364	1115 \pm 324	2423 \pm 442
K-40	6697 \pm 743	5236 \pm 854	4168 \pm 597	6054 \pm 960	5997 \pm 694	6693 \pm 1024
Mn-54	< 27	< 27	< 29	< 38	< 41	< 38
Co-58	< 32	< 32	< 24	< 38	< 36	< 42
Fe-59	< 69	< 73	< 54	< 97	< 70	< 78
Co-60	< 29	< 26	< 23	< 32	< 41	< 47
Zn-65	< 75	< 74	< 52	< 111	< 95	< 94
Nb-95	< 32	< 29	< 29	< 39	< 40	< 37
Zr-95	< 50	< 66	< 42	< 79	< 64	< 50
Ru-103	< 24	< 32	< 30	< 32	< 35	< 40
Ru-106	< 259	< 277	< 254	< 329	< 328	< 235
I-131	< 51	< 58	< 51	< 58	< 52	< 55
Cs-134	< 37	< 43	< 30	< 37	< 42	< 38
Cs-137	< 29	< 32	< 32	< 41	< 36	< 45
Ba-140	< 133	< 154	< 124	< 182	< 152	< 136
La-140	< 40	< 32	< 27	< 54	< 45	< 45
Ce-141	< 47	< 58	< 45	< 57	< 50	< 54
Ce-144	< 184	< 210	< 185	< 245	< 199	< 245
Ra-226	< 659	< 822	< 661	< 987	< 742	< 888
Th-228	< 59	< 66	< 54	< 77	< 58	< 69

INDIAN POINT ENERGY CENTER
TABLE B-13
GAMMA EMITTERS IN BROADLEAF VEGETATION SAMPLES - 2017

pCi/kg wet \pm 2 Sigma

Met Tower
95

DATE	09/25/17	09/25/17	09/25/17	10/06/17	10/06/17
GAMMA					
Be-7	2784 \pm 452	801 \pm 440	978 \pm 313	2656 \pm 290	2160 \pm 286
K-40	6597 \pm 1018	4889 \pm 912	5233 \pm 904	6926 \pm 541	3153 \pm 429
Mn-54	< 38	< 43	< 37	< 21	< 23
Co-58	< 36	< 29	< 28	< 21	< 22
Fe-59	< 90	< 93	< 79	< 53	< 58
Co-60	< 34	< 44	< 50	< 24	< 24
Zn-65	< 78	< 96	< 82	< 53	< 51
Nb-95	< 41	< 47	< 43	< 23	< 27
Zr-95	< 69	< 77	< 64	< 39	< 40
Ru-103	< 37	< 41	< 36	< 23	< 24
Ru-106	< 360	< 384	< 347	< 177	< 185
I-131	< 43	< 54	< 46	< 52	< 57
Cs-134	< 29	< 53	< 50	< 26	< 27
Cs-137	< 36	< 41	< 45	< 23	< 22
Ba-140	< 143	< 150	< 141	< 128	< 137
La-140	< 44	< 66	< 46	< 39	< 43
Ce-141	< 53	< 62	< 53	< 37	< 41
Ce-144	< 219	< 256	< 211	< 138	< 154
Ra-226	< 875	< 832	< 710	< 539	< 571
Th-228	< 70	< 74	< 64	< 36	< 39

INDIAN POINT ENERGY CENTER
TABLE B-14
RADIONUCLIDES IN RIVER WATER SAMPLES - 2017

pCi/L \pm 2 Sigma

Plant Inlet Hudson River Intake
g*

DATE	01/31/17	02/28/17	03/29/17	04/25/17	05/31/17	06/27/17
RADIOCHEMICAL						
H-3 (a)			< 189			< 195
GAMMA						
K-40	< 32	152 \pm 42	< 19	< 14	< 21	< 65
Mn-54	< 2	< 3	< 2	< 2	< 1	< 3
Co-58	< 2	< 3	< 2	< 2	< 1	< 3
Fe-59	< 4	< 7	< 5	< 4	< 3	< 8
Co-60	< 2	< 3	< 2	< 2	< 1	< 3
Zn-65	< 3	< 7	< 4	< 4	< 2	< 7
Nb-95	< 2	< 4	< 2	< 2	< 1	< 4
Zr-95	< 3	< 6	< 4	< 3	< 3	< 6
Ru-103	< 2	< 4	< 2	< 2	< 2	< 4
Ru-106	< 15	< 26	< 15	< 15	< 11	< 30
I-131	< 9	< 12	< 10	< 9	< 15	< 11
Cs-134	< 2	< 3	< 2	< 2	< 1	< 4
Cs-137	< 2	< 3	< 2	< 2	< 1	< 3
Ba-140	< 15	< 24	< 18	< 16	< 19	< 25
La-140	< 5	< 9	< 6	< 6	< 6	< 8
Ce-141	< 4	< 6	< 4	< 4	< 4	< 6
Ce-144	< 13	< 17	< 13	< 12	< 9	< 18
Ra-226	< 42	< 65	< 40	< 36	< 26	< 67
Ac-228	< 6	< 12	< 7	< 8	< 5	< 12
Th-228	7 \pm 3	< 5	< 3	< 3	< 2	< 5

* Control Location
(a) Quarterly Composite

INDIAN POINT ENERGY CENTER
TABLE B-14
RADIONUCLIDES IN RIVER WATER SAMPLES - 2017

pCi/L \pm 2 Sigma

Plant Inlet Hudson River Intake

9*

DATE	07/25/17	08/29/17	09/27/17	10/31/17	11/28/17	12/27/17
RADIOCHEMICAL						
H-3 (a)			< 193			< 196
GAMMA						
K-40	< 17	< 16	< 13	74 \pm 31	< 44	< 16
Mn-54	< 2	< 2	< 1	< 2	< 2	< 2
Co-58	< 2	< 2	< 2	< 2	< 3	< 2
Fe-59	< 5	< 5	< 4	< 5	< 6	< 5
Co-60	< 2	< 2	< 1	< 2	< 2	< 2
Zn-65	< 4	< 4	< 3	< 4	< 5	< 4
Nb-95	< 3	< 2	< 2	< 2	< 3	< 2
Zr-95	< 4	< 4	< 3	< 4	< 5	< 3
Ru-103	< 3	< 3	< 2	< 3	< 3	< 2
Ru-106	< 18	< 17	< 12	< 17	< 21	< 16
I-131	< 14	< 14	< 15	< 15	< 9	< 11
Cs-134	< 2	< 2	< 1	< 2	< 3	< 2
Cs-137	< 2	< 2	< 1	< 2	< 2	< 2
Ba-140	< 24	< 24	< 20	< 22	< 19	< 17
La-140	< 7	< 7	< 7	< 7	< 6	< 6
Ce-141	< 5	< 4	< 4	< 5	< 5	< 4
Ce-144	< 16	< 11	< 10	< 15	< 17	< 11
Ra-226	< 58	< 35	< 37	< 47	< 62	< 37
Ac-228	< 9	< 8	< 5	< 6	< 8	< 7
Th-228	< 3	< 3	< 2	< 3	< 5	< 3

* Control Location
(a) Quarterly Composite

INDIAN POINT ENERGY CENTER
TABLE B-14
RADIONUCLIDES IN RIVER WATER SAMPLES - 2017

pCi/L \pm 2 Sigma

Discharge Canal
10

DATE	01/31/17	02/28/17	03/29/17	04/25/17	05/31/17	06/27/17
RADIOCHEMICAL						
H-3 (a)			216 \pm 128			< 191
GAMMA						
K-40	< 13	< 47	< 21	< 19	< 27	< 51
Mn-54	< 2	< 3	< 2	< 2	< 1	< 3
Co-58	< 2	< 3	< 2	< 2	< 1	< 3
Fe-59	< 4	< 6	< 5	< 5	< 3	< 7
Co-60	< 2	< 3	< 2	< 2	< 1	< 3
Zn-65	< 3	< 5	< 4	< 4	< 2	< 6
Nb-95	< 2	< 3	< 2	< 2	< 1	< 3
Zr-95	< 3	< 5	< 4	< 4	< 2	< 6
Ru-103	< 2	< 3	< 3	< 3	< 2	< 4
Ru-106	< 14	< 22	< 18	< 19	< 10	< 31
I-131	< 8	< 10	< 12	< 12	< 14	< 13
Cs-134	< 1	< 3	< 2	< 2	< 1	< 3
Cs-137	< 2	< 3	< 2	< 2	< 1	< 3
Ba-140	< 15	< 22	< 22	< 21	< 18	< 26
La-140	< 4	< 6	< 7	< 6	< 5	< 7
Ce-141	< 4	< 6	< 5	< 5	< 3	< 9
Ce-144	< 12	< 21	< 15	< 16	< 8	< 31
Ra-226	< 44	< 68	< 56	< 46	< 30	< 93
Ac-228	< 6	< 7	< 9	< 8	< 5	< 12
Th-228	< 3	< 5	< 4	< 4	< 2	< 7

(a) Quarterly Composite

INDIAN POINT ENERGY CENTER
TABLE B-14
RADIONUCLIDES IN RIVER WATER SAMPLES - 2017

pCi/L \pm 2 Sigma

Discharge Canal
10

DATE	07/25/17	08/29/17	09/27/17	10/31/17	11/28/17	12/27/17
RADIOCHEMICAL						
H-3 (a)			< 179			381 \pm 136
GAMMA						
K-40	< 42	47 \pm 27	< 10	62 \pm 37	< 46	< 48
Mn-54	< 2	< 2	< 1	< 2	< 2	< 2
Co-58	< 2	< 2	< 2	< 2	< 3	< 2
Fe-59	< 5	< 5	< 4	< 5	< 6	< 5
Co-60	< 2	< 2	< 1	< 2	< 3	< 2
Zn-65	< 5	< 4	< 2	< 4	< 5	< 4
Nb-95	< 3	< 2	< 2	< 2	< 3	< 2
Zr-95	< 4	< 4	< 3	< 3	< 5	< 4
Ru-103	< 3	< 3	< 2	< 3	< 3	< 3
Ru-106	< 20	< 17	< 12	< 18	< 22	< 18
I-131	< 15	< 15	< 15	< 15	< 9	< 14
Cs-134	< 2	< 2	< 1	< 2	< 3	< 2
Cs-137	< 2	< 2	< 1	< 2	< 2	< 2
Ba-140	< 25	< 24	< 20	< 23	< 19	< 23
La-140	< 8	< 8	< 6	< 7	< 6	< 7
Ce-141	< 5	< 5	< 3	< 5	< 4	< 5
Ce-144	< 15	< 12	< 9	< 13	< 14	< 14
Ra-226	< 51	< 45	< 37	< 49	< 47	< 41
Ac-228	< 8	< 7	< 6	< 8	< 8	< 8
Th-228	< 4	< 3	< 2	< 4	< 4	< 4

(a) Quarterly Composite

INDIAN POINT ENERGY CENTER
TABLE B-15
GAMMA EMITTERS IN BOTTOM SEDIMENT SAMPLES - 2017

pCi/kg dry \pm 2 Sigma

DATE	Discharge Canal 10		Off Verplanck 17	
	06/15/17	09/21/17	06/15/17	09/21/17
GAMMA				
Be-7	< 611	< 309	< 527	< 772
K-40	19560 \pm 1845	12920 \pm 813	15490 \pm 1714	19880 \pm 1851
Mn-54	< 77	< 34	< 58	< 94
Co-58	< 65	< 34	< 74	< 86
Fe-59	< 144	< 83	< 127	< 200
Co-60	< 86	< 30	< 64	< 88
Zn-65	< 181	< 78	< 136	< 189
Nb-95	< 75	< 40	< 62	< 98
Zr-95	< 123	< 61	< 111	< 178
Ru-103	< 69	< 37	< 64	< 95
Ru-106	< 516	< 305	< 574	< 742
I-131	< 114	< 94	< 107	< 237
Cs-134	< 89	< 38	< 106	< 104
Cs-137	1067 \pm 131	73 \pm 39	< 76	288 \pm 88
Ba-140	< 323	< 238	< 320	< 546
Ce-141	< 102	< 60	< 93	< 116
Ce-144	< 357	< 186	< 373	< 411
Ra-226	< 1719	< 787	< 1199	< 1516
Th-228	979 \pm 113	373 \pm 50	877 \pm 134	1157 \pm 122

INDIAN POINT ENERGY CENTER
TABLE B-15
GAMMA EMITTERS IN BOTTOM SEDIMENT SAMPLES - 2017

pCi/kg dry \pm 2 Sigma

DATE	Lent's Cove 28		Cold Spring 84*	
	06/15/17	09/21/17	06/16/17	09/22/17
GAMMA				
Be-7	< 462	< 732	< 647	< 700
K-40	9752 \pm 1173	17680 \pm 1589	15200 \pm 1739	26270 \pm 1458
Mn-54	< 60	< 82	< 85	< 78
Co-58	< 53	< 80	< 78	< 76
Fe-59	< 139	< 214	< 199	< 195
Co-60	< 62	< 92	< 90	< 75
Zn-65	< 152	< 206	< 226	< 227
Nb-95	< 62	< 95	< 89	< 91
Zr-95	< 113	< 146	< 159	< 151
Ru-103	< 61	< 89	< 83	< 86
Ru-106	< 534	< 757	< 711	< 694
I-131	< 99	< 260	< 129	< 204
Cs-134	< 68	< 96	< 115	< 86
Cs-137	150 \pm 55	174 \pm 87	< 94	< 79
Ba-140	< 312	< 567	< 419	< 473
Ce-141	< 96	< 150	< 141	< 142
Ce-144	< 384	< 519	< 579	< 496
Ra-226	< 1141	< 1640	2756 \pm 1672	< 1551
Th-228	382 \pm 124	1067 \pm 127	965 \pm 141	1159 \pm 134

* Control Location

INDIAN POINT ENERGY CENTER
TABLE B-16
RADIONUCLIDES IN SHORELINE SOIL SAMPLES - 2017

pCi/kg dry \pm 2 Sigma

DATE	Off Verplanck 17		Lent's Cove 28	
	06/02/17	09/13/17	06/02/17	09/13/17
RADIOCHEMICAL				
Sr-90	< 39	< 37	< 29	< 37
GAMMA				
Be-7	< 515	< 744	< 619	< 689
K-40	14040 \pm 1421	15880 \pm 1629	14930 \pm 1693	12670 \pm 1802
Mn-54	< 66	< 70	< 81	< 82
Co-58	< 57	< 72	< 76	< 78
Fe-59	< 121	< 206	< 140	< 178
Co-60	< 58	< 67	< 77	< 83
Zn-65	< 154	< 158	< 150	< 120
Nb-95	< 62	< 89	< 86	< 78
Zr-95	< 112	< 149	< 150	< 135
Ru-103	< 61	< 84	< 83	< 96
Ru-106	< 578	< 593	< 642	< 608
I-131	< 97	< 264	< 137	< 246
Cs-134	< 71	< 81	< 108	< 93
Cs-137	86 \pm 53	216 \pm 74	< 81	< 93
Ba-140	< 265	< 644	< 339	< 633
La-140	< 95	< 136	< 86	< 159
Ce-141	< 104	< 150	< 135	< 132
Ce-144	< 393	< 488	< 497	< 393
Ra-226	< 1479	< 1523	3190 \pm 1661	< 1444
Ac-228	< 385	< 232	< 585	< 465
Th-228	501 \pm 141	683 \pm 112	1134 \pm 172	473 \pm 103

INDIAN POINT ENERGY CENTER
TABLE B-16
RADIONUCLIDES IN SHORELINE SOIL SAMPLES - 2017

pCi/kg dry \pm 2 Sigma

DATE	Manitou Inlet 50*		White Beach 53	
	06/02/17	09/13/17	06/02/17	09/13/17
RADIOCHEMICAL				
Sr-90	< 30	< 47	< 35	< 29
GAMMA				
Be-7	< 598	< 491	< 383	< 385
K-40	9658 \pm 875	12440 \pm 1177	7862 \pm 1058	8635 \pm 870
Mn-54	< 66	< 51	< 52	< 35
Co-58	< 64	< 47	< 53	< 43
Fe-59	< 111	< 115	< 95	< 72
Co-60	< 58	< 49	< 46	< 45
Zn-65	< 191	< 107	< 108	< 95
Nb-95	< 73	< 65	< 60	< 50
Zr-95	< 116	< 99	< 98	< 69
Ru-103	< 65	< 56	< 49	< 43
Ru-106	< 538	< 359	< 420	< 340
I-131	< 108	< 144	< 81	< 131
Cs-134	< 68	< 63	< 59	< 43
Cs-137	< 72	< 56	< 56	< 40
Ba-140	< 313	< 357	< 216	< 300
La-140	< 84	< 128	< 55	< 87
Ce-141	< 127	< 95	< 62	< 70
Ce-144	< 497	< 327	< 224	< 237
Ra-226	< 1608	2256 \pm 993	< 902	< 684
Ac-228	< 291	< 192	< 220	< 180
Th-228	695 \pm 122	551 \pm 72	< 72	< 66

* Control Location

INDIAN POINT ENERGY CENTER
TABLE B-16
RADIONUCLIDES IN SHORELINE SOIL SAMPLES - 2017

pCi/kg dry \pm 2 Sigma

	Cold Spring 84*	
DATE	06/02/17	09/13/17
RADIOCHEMICAL		
Sr-90	< 24	< 35
GAMMA		
Be-7	< 486	< 476
K-40	36250 \pm 2112	31950 \pm 1955
Mn-54	< 55	< 60
Co-58	< 63	< 58
Fe-59	< 150	< 182
Co-60	< 68	< 66
Zn-65	< 174	< 158
Nb-95	< 61	< 65
Zr-95	< 119	< 114
Ru-103	< 59	< 50
Ru-106	< 572	< 480
I-131	< 91	< 177
Cs-134	< 80	< 74
Cs-137	< 71	< 65
Ba-140	< 292	< 367
La-140	< 63	< 124
Ce-141	< 91	< 87
Ce-144	< 369	< 287
Ra-226	< 1323	< 1006
Ac-228	< 180	< 383
Th-228	446 \pm 108	628 \pm 99

* Control Location

INDIAN POINT ENERGY CENTER
TABLE B-17
GAMMA EMITTERS IN AQUATIC VEGETATION SAMPLES - 2017

pCi/kg wet \pm 2 Sigma

Lent's Cove
28

DATE	06/15/17 Myrophyllium	09/21/17 Myrophyllium
Be-7	(a)	< 227
K-40		3695 \pm 404
Mn-54		< 21
Co-58		< 19
Fe-59		< 41
Co-60		< 22
Zn-65		< 54
Nb-95		< 25
Zr-95		< 41
Ru-103		< 24
Ru-106		< 193
I-131		< 58
Cs-134		< 24
Cs-137		< 25
Ba-140		< 123
La-140		< 40
Ce-141		< 43
Ce-144		< 150
Ra-226		< 566
Ac-228		< 72
Th-228		133 \pm 34

(a) Unable to locate and collect samples at this location

INDIAN POINT ENERGY CENTER
TABLE B-17
GAMMA EMITTERS IN AQUATIC VEGETATION SAMPLES - 2017

pCi/kg wet \pm 2 Sigma

Off Verplanck
17

DATE	06/15/17 Myrophyllium	09/21/17 Myrophyllium
Be-7	(a)	< 163
K-40		3462 \pm 342
Mn-54		< 16
Co-58		< 16
Fe-59		< 40
Co-60		< 15
Zn-65		< 33
Nb-95		< 18
Zr-95		< 30
Ru-103		< 18
Ru-106		< 152
I-131		< 46
Cs-134		< 21
Cs-137		< 18
Ba-140		< 103
La-140		< 31
Ce-141		< 32
Ce-144		< 104
Ra-226		< 339
Ac-228		< 55
Th-228		80 \pm 28

(a) Unable to locate and collect samples at this location

INDIAN POINT ENERGY CENTER
TABLE B-17
GAMMA EMITTERS IN AQUATIC VEGETATION SAMPLES - 2017

pCi/kg wet \pm 2 Sigma

Cold Spring
84*

DATE	06/16/17 Myrophyllium	09/22/17 Myrophyllium
Be-7	< 134	207 \pm 105
K-40	1654 \pm 273	2935 \pm 206
Mn-54	< 21	< 9
Co-58	< 15	< 10
Fe-59	< 25	< 21
Co-60	< 16	< 8
Zn-65	< 36	< 21
Nb-95	< 14	< 10
Zr-95	< 30	< 17
Ru-103	< 18	< 10
Ru-106	< 134	< 87
I-131	< 25	< 25
Cs-134	< 21	< 12
Cs-137	< 17	< 11
Ba-140	< 68	< 59
La-140	< 19	< 16
Ce-141	< 24	< 18
Ce-144	< 111	< 71
Ra-226	< 373	< 213
Ac-228	< 50	< 35
Th-228	86 \pm 23	95 \pm 21

* Control Location

INDIAN POINT ENERGY CENTER
TABLE B-18
RADIONUCLIDES IN FISH / INVERTEBRATES - 2017

pCi/kg wet \pm 2 Sigma

Downstream
107

DATE	05/01/17 White Perch	05/01/17 Catfish	05/25/17 Sunfish	05/31/17 American Eel	05/31/17 Striped Bass	06/16/17 Blue Crab
RADIOCHEMICAL						
Ni-63	< 69	< 55	< 97	< 70	< 56	< 75
Sr-90	< 4	< 2	< 4	< 4	< 3	< 5
GAMMA						
Be-7	< 735	< 809	< 508	< 595	< 840	< 579
K-40	2650 \pm 487	2530 \pm 770	2092 \pm 741	1164 \pm 755	1775 \pm 1108	2714 \pm 842
Mn-54	< 51	< 38	< 44	< 53	< 82	< 56
Co-58	< 76	< 71	< 54	< 78	< 91	< 70
Fe-59	< 241	< 158	< 149	< 147	< 236	< 169
Co-60	< 43	< 51	< 25	< 57	< 73	< 62
Zn-65	< 116	< 115	< 98	< 107	< 105	< 147
Nb-95	< 78	< 83	< 67	< 73	< 107	< 64
Zr-95	< 131	< 135	< 135	< 131	< 219	< 136
Ru-103	< 126	< 115	< 79	< 117	< 116	< 88
Ru-106	< 452	< 463	< 422	< 476	< 677	< 580
I-131	< 13010	< 9386	< 1525	< 1175	< 1625	< 404
Cs-134	< 48	< 49	< 60	< 66	< 79	< 71
Cs-137	< 45	< 41	< 41	< 62	< 74	< 70
Ba-140	< 5479	< 6201	< 1038	< 1156	< 1949	< 609
La-140	< 1536	(a)	< 432	< 470	< 430	< 134
Ce-141	< 249	< 197	< 136	< 119	< 151	< 120
Ce-144	< 306	< 204	< 248	< 296	< 339	< 397
Ra-226	< 982	< 778	< 795	< 1089	< 1347	< 1330
Th-228	< 77	< 77	< 77	< 92	< 94	< 122

(a) MDA could not be calculated due to the age of the sample at the time of analysis.

INDIAN POINT ENERGY CENTER
TABLE B-18
RADIONUCLIDES IN FISH / INVERTEBRATES - 2017

pCi/kg wet \pm 2 Sigma

Downstream
107

DATE	08/01/17 Blue Crab	08/07/17 Catfish	08/31/17 Sunfish	08/31/17 White Perch	09/11/17 American Eel
RADIOCHEMICAL					
Ni-63	< 27	< 23	< 26	< 23	< 24
Sr-90	< 3	< 2	< 2	< 2	< 2
GAMMA					
Be-7	< 698	< 664	< 585	< 759	< 256
K-40	2392 \pm 653	3161 \pm 536	2431 \pm 814	2919 \pm 749	1870 \pm 457
Mn-54	< 37	< 52	< 55	< 65	< 33
Co-58	< 64	< 67	< 59	< 61	< 32
Fe-59	< 173	< 178	< 157	< 171	< 67
Co-60	< 43	< 38	< 40	< 65	< 26
Zn-65	< 85	< 119	< 112	< 117	< 71
Nb-95	< 78	< 78	< 76	< 80	< 38
Zr-95	< 123	< 121	< 136	< 136	< 67
Ru-103	< 101	< 105	< 75	< 95	< 37
Ru-106	< 336	< 469	< 468	< 594	< 263
I-131	< 6506	< 4941	< 621	< 874	< 181
Cs-134	< 45	< 49	< 51	< 65	< 31
Cs-137	< 40	< 44	< 52	< 60	< 31
Ba-140	< 2936	< 3007	< 905	< 1174	< 268
La-140	< 993	< 970	< 311	< 310	< 105
Ce-141	< 148	< 196	< 102	< 164	< 56
Ce-144	< 238	< 308	< 255	< 399	< 153
Ra-226	< 795	< 977	< 948	< 1276	< 487
Th-228	< 67	< 76	< 82	< 107	< 45

INDIAN POINT ENERGY CENTER
TABLE B-18
RADIONUCLIDES IN FISH / INVERTEBRATES - 2017

pCi/kg wet ± 2 Sigma

Roseton
23*

DATE	05/09/17 White perch	05/16/17 Catfish	05/23/17 American Eel	05/23/17 Stripped Bass	05/24/17 Sunfish	08/01/17 White Perch
RADIOCHEMICAL						
Ni-63	< 69	< 50	< 67	< 51	< 80	< 36
Sr-90	< 4	< 4	< 3	< 4	< 3	< 4
GAMMA						
Be-7	< 676	< 1013	< 891	< 850	< 639	< 966
K-40	2548 ± 795	2778 ± 988	2037 ± 756	2579 ± 683	2397 ± 875	2488 ± 899
Mn-54	< 56	< 63	< 67	< 58	< 73	< 60
Co-58	< 63	< 82	< 93	< 79	< 102	< 80
Fe-59	< 214	< 240	< 205	< 211	< 203	< 250
Co-60	< 39	< 60	< 60	< 65	< 46	< 56
Zn-65	< 103	< 114	< 142	< 130	< 124	< 110
Nb-95	< 71	< 101	< 112	< 100	< 91	< 108
Zr-95	< 121	< 141	< 143	< 159	< 120	< 175
Ru-103	< 132	< 122	< 131	< 126	< 123	< 155
Ru-106	< 357	< 547	< 583	< 557	< 541	< 488
I-131	< 4635	< 4263	< 4518	< 2670	< 1923	< 11940
Cs-134	< 41	< 65	< 56	< 66	< 72	< 53
Cs-137	< 45	< 64	< 59	< 60	< 49	< 57
Ba-140	< 2118	< 3099	< 3044	< 2103	< 2239	< 5064
La-140	< 937	< 919	< 1076	< 717	< 320	< 1500
Ce-141	< 179	< 213	< 223	< 211	< 159	< 287
Ce-144	< 256	< 307	< 369	< 425	< 328	< 382
Ra-226	< 801	< 1158	< 1242	< 1363	< 1173	< 1311
Th-228	< 64	< 104	< 107	< 103	< 75	< 106

* Control Location

INDIAN POINT ENERGY CENTER
TABLE B-18
RADIONUCLIDES IN FISH / INVERTEBRATES - 2017

pCi/kg wet \pm 2 Sigma

Roseton
23*

DATE	08/28/17 American Eel	08/28/17 Blue Crab	09/01/17 Sunfish	09/07/17 Catfish
RADIOCHEMICAL				
Ni-63	< 25	< 25	< 44	< 25
Sr-90	< 3	< 5	< 5	< 2
GAMMA				
Be-7	< 384	< 537	< 461	< 641
K-40	2774 \pm 613	2205 \pm 523	3971 \pm 884	3623 \pm 931
Mn-54	< 40	< 45	< 48	< 63
Co-58	< 47	< 58	< 67	< 73
Fe-59	< 93	< 153	< 143	< 138
Co-60	< 45	< 44	< 58	< 56
Zn-65	< 84	< 114	< 102	< 121
Nb-95	< 49	< 71	< 77	< 81
Zr-95	< 83	< 112	< 100	< 124
Ru-103	< 56	< 74	< 69	< 84
Ru-106	< 328	< 419	< 424	< 500
I-131	< 648	< 906	< 685	< 493
Cs-134	< 34	< 52	< 56	< 68
Cs-137	< 33	< 50	< 46	< 55
Ba-140	< 853	< 1036	< 931	< 680
La-140	< 305	< 311	< 258	< 243
Ce-141	< 84	< 132	< 103	< 104
Ce-144	< 210	< 294	< 276	< 262
Ra-226	< 726	< 1080	< 940	< 1094
Th-228	< 60	< 81	< 78	< 91

* Control Location

INDIAN POINT ENERGY CENTER
TABLE B-18
RADIONUCLIDES IN FISH / INVERTEBRATES - 2017

pCi/kg wet \pm 2 Sigma

Downstream
25

DATE	05/01/17 White Perch	05/01/17 Catfish	05/24/17 Sunfish	05/31/17 American Eel	05/31/17 Stripped bass	06/16/17 Blue Crab
RADIOCHEMICAL						
Ni-63	< 74	< 50	< 67	< 54	< 63	< 75
Sr-90	< 4	< 4	< 2	< 4	< 2	< 5
GAMMA						
Be-7	< 788	< 752	< 1092	< 730	< 678	< 580
K-40	2984 \pm 756	2652 \pm 755	2047 \pm 846	1847 \pm 986	3157 \pm 952	2454 \pm 633
Mn-54	< 47	< 46	< 71	< 59	< 64	< 53
Co-58	< 73	< 85	< 95	< 95	< 83	< 63
Fe-59	< 238	< 232	< 245	< 185	< 196	< 150
Co-60	< 52	< 60	< 60	< 63	< 53	< 63
Zn-65	< 104	< 93	< 168	< 180	< 135	< 159
Nb-95	< 74	< 80	< 116	< 94	< 81	< 71
Zr-95	< 163	< 124	< 153	< 149	< 151	< 128
Ru-103	< 110	< 116	< 137	< 122	< 98	< 80
Ru-106	< 424	< 455	< 666	< 539	< 543	< 649
I-131	< 11580	< 12210	< 2760	< 1300	< 1243	< 322
Cs-134	< 45	< 48	< 80	< 58	< 79	< 78
Cs-137	< 39	< 38	< 72	< 63	< 70	< 60
Ba-140	< 5198	< 5837	< 1984	< 1807	< 1489	< 606
La-140	< 1439	< 1723	< 671	< 433	< 384	< 142
Ce-141	< 199	< 196	< 218	< 201	< 153	< 133
Ce-144	< 234	< 221	< 393	< 407	< 321	< 397
Ra-226	< 862	< 910	< 1535	< 1450	< 1202	< 1335
Th-228	< 78	< 75	< 120	< 105	< 109	< 109

INDIAN POINT ENERGY CENTER
TABLE B-18
RADIONUCLIDES IN FISH / INVERTEBRATES - 2017

pCi/kg wet \pm 2 Sigma

Downstream
25

DATE	08/03/17 Stripped Bass	08/23/17 White Perch	08/23/17 Blue Crab	08/23/17 American Eel	09/01/17 Sunfish	09/11/17 Catfish
RADIOCHEMICAL						
Ni-63	< 91	< 44	< 28	< 27	< 40	< 26
Sr-90	< 4	< 4	< 1	< 3	< 5	< 2
GAMMA						
Be-7	< 944	< 577	< 470	< 969	< 718	< 538
K-40	4715 \pm 1184	3224 \pm 906	2530 \pm 541	3307 \pm 1005	3279 \pm 709	1722 \pm 868
Mn-54	< 65	< 51	< 34	< 75	< 72	< 64
Co-58	< 98	< 67	< 45	< 92	< 82	< 85
Fe-59	< 250	< 163	< 120	< 247	< 183	< 146
Co-60	< 66	< 55	< 35	< 53	< 55	< 62
Zn-65	< 136	< 94	< 75	< 150	< 163	< 140
Nb-95	< 103	< 70	< 51	< 101	< 85	< 71
Zr-95	< 169	< 130	< 91	< 166	< 124	< 122
Ru-103	< 149	< 95	< 70	< 135	< 101	< 72
Ru-106	< 571	< 498	< 346	< 693	< 640	< 344
I-131	< 9621	< 1313	< 1088	< 2162	< 890	< 330
Cs-134	< 68	< 49	< 34	< 75	< 67	< 66
Cs-137	< 61	< 50	< 42	< 71	< 68	< 62
Ba-140	< 5105	< 1290	< 898	< 1940	< 1210	< 529
La-140	< 1398	< 487	< 327	< 430	< 384	< 170
Ce-141	< 218	< 127	< 112	< 218	< 158	< 106
Ce-144	< 287	< 275	< 225	< 521	< 423	< 263
Ra-226	< 959	< 1062	< 774	< 1480	< 1354	< 1149
Th-228	< 83	< 74	< 65	< 121	< 113	< 93

**INDIAN POINT ENERGY CENTER
TABLE B-19
LAND USE CENSUS - RESIDENCE AND MILCH ANIMAL RESULTS
2017**

The 2017 land use census indicated there were no new residences that were closer in proximity to IPEC. IPEC maintains a complete nearest residence survey with updated distances.

No milch animals were observed during this reporting period within the 5-mile zone. There are no animals producing milk for human consumption within five miles of Indian Point.

**INDIAN POINT ENERGY CENTER
TABLE B-20
LAND USE CENSUS
2017**

**UNRESTRICTED AREA BOUNDARY
AND NEAREST RESIDENCES**

Sector	Compass Point	Distance to site Boundary from Unit 2 Plant Vent (meters)	Distance to site Boundary from Unit 3 Plant Vent (meters)	Distance to nearest resident, from Unit 1 superheater (meters)	Address of nearest resident, Last Census
1	N	RIVER	RIVER	1788	41 River Road Tomkins Cove
2	NNE	RIVER	RIVER	3111	Chateau Rive Apts. John St. Peekskill
3	NE	550	636	1907	211 Viewpoint Terrace, Peekskill
4	ENE	600	775	1478	1018 Lower South St. Peekskill
5	E	662	785	1371	1103 Lower South St. Peekskill
6	ESE	569	622	715	461 Broadway Buchanan
7	SE	553	564	1168	223 First St. Buchanan
8	SSE	569	551	1240	5 Pheasant's Run Buchanan
9	S	700	566	1133	320 Broadway Verplanck
10	SSW	755	480	1574	240 Eleventh St. Verplanck
11	SW	544	350	3016	8 Spring St. Tomkins Cove
12	WSW	RIVER	RIVER	2170	9 West Shore Dr. Tomkins Cove
13	W	RIVER	RIVER	1919	712 Rt. 9W Tomkins Cove
14	WNW	RIVER	RIVER	1752	770 Rt. 9W Tomkins Cove
15	NW	RIVER	RIVER	1693	807 Rt. 9W Tomkins Cove
16	NNW	RIVER	RIVER	1609	4 River Rd. Tomkins Cove

APPENDIX C

HISTORICAL TRENDS

APPENDIX C

The past ten years of historical data for various radionuclides and media are presented both in tabular form and graphical form to facilitate the comparison of 2017 data with historical values. Although other samples were taken and analyzed, values were only tabulated and plotted where positive indications were present.

Averaging the positive values in these tables can result in a biased high value, especially, when the radionuclide is detected in only one or two quarters for the year.

TABLE C-1

DIRECT RADIATION ANNUAL SUMMARY
2007-2017

Average Quarterly Dose (mR/Quarter)			
Year	Inner Ring	Outer Ring	Control Location
2007	14.4	14.6	18.8
2008	14.5	14.2	17.3
2009	14.5	14.2	17.3
2010	14.0	14.3	13.0
2011	13.6	14.4	13.4
2012	13.2	13.5	12.5
2013	13.4	13.8	14.2
2014	13.7	13.6	14.2
2015	13.8	14	14.3
2016	14.3	14.2	15.6
2017	14.3	14.7	15.6

Historical Average 2007-2017	14.0	14.1	15.1
---	------	------	------

FIGURE C-1

DIRECT RADIATION, ANNUAL SUMMARY
2007 to 2017

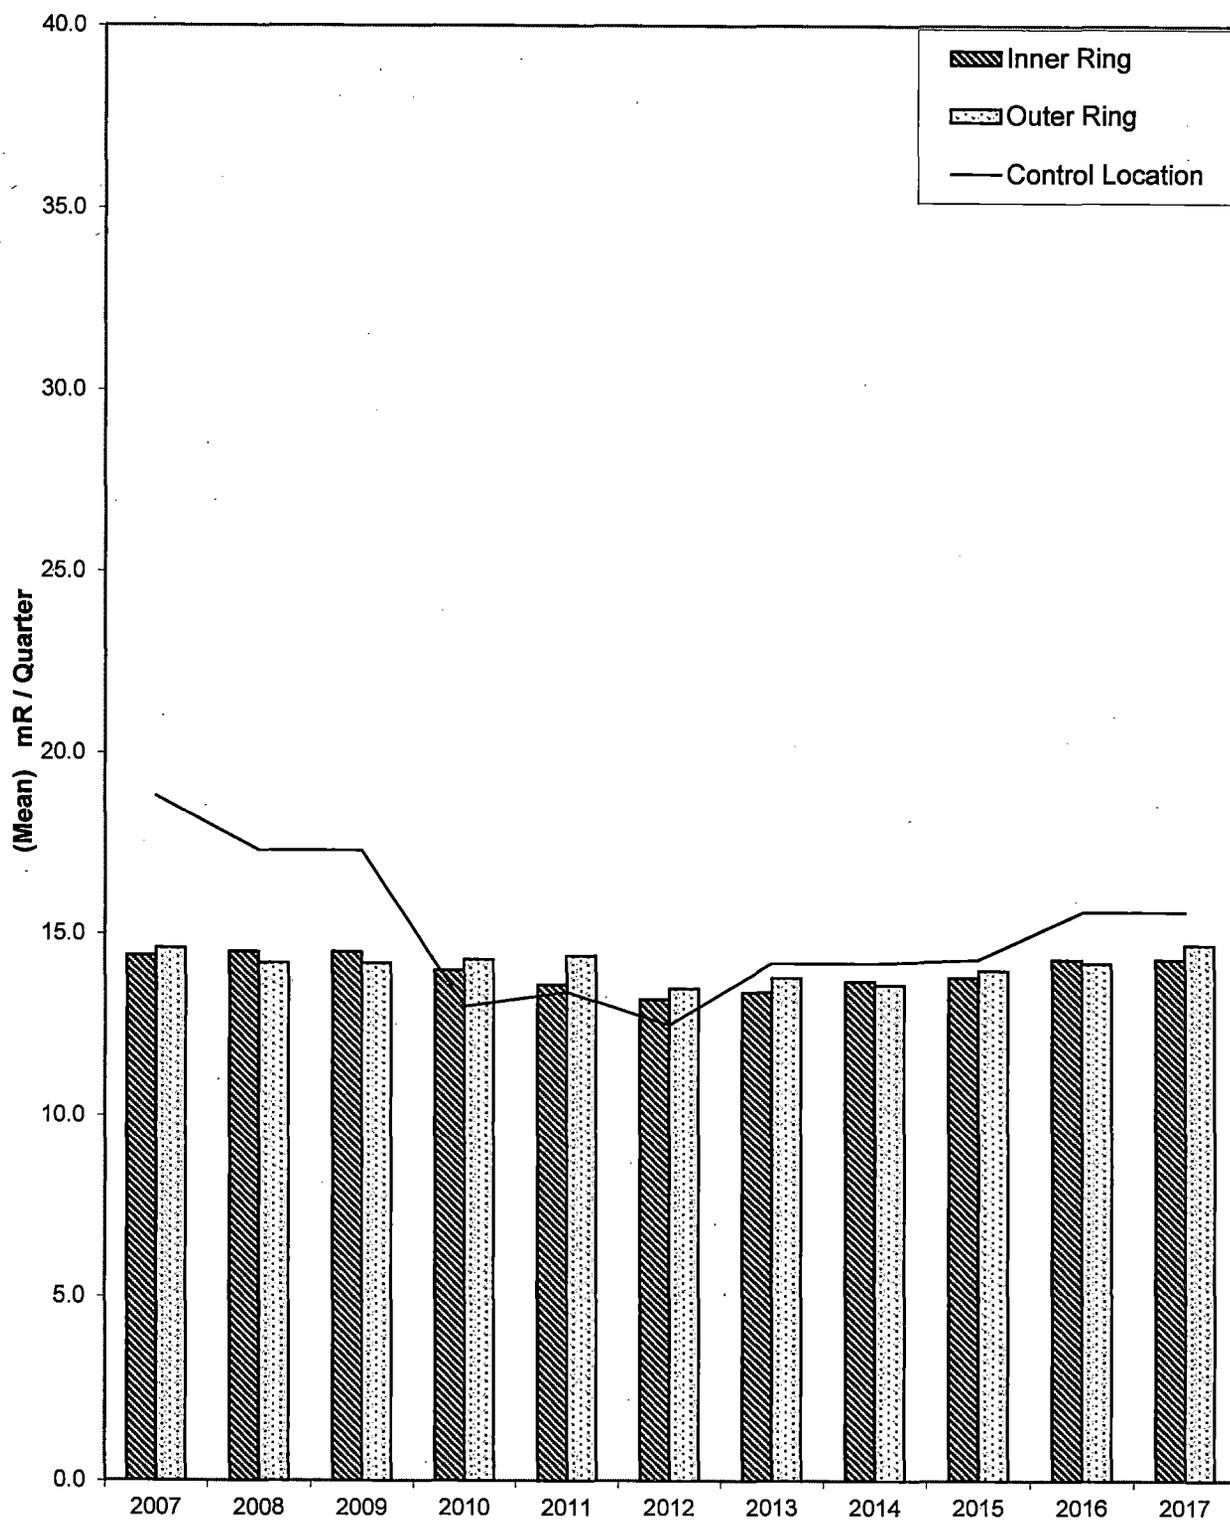


TABLE C-2
RADIONUCLIDES IN AIR
2007 to 2017
(pCi/m³)


Year	Gross Beta		Cs-137	
	All Indicator Locations	Control Location	All Indicator Locations	Control Location
2007	0.01	0.01	< L _c	< L _c
2008	0.01	0.01	< L _c	< L _c
2009	0.01	0.01	< L _c	< L _c
2010	0.01	0.01	< L _c	< L _c
2011	0.014	0.014	< L _c	< L _c
2012	0.014	0.014	< L _c	< L _c
2013	0.014	0.014	< L _c	< L _c
2014	0.013	0.013	< L _c	< L _c
2015	0.016	0.015	< L _c	< L _c
2016	0.015	0.015	< L _c	< L _c
2017	0.013	0.012	< L _c	< L _c
Historical Average 2007-2017	0.01	0.01	< L _c	< L _c

Critical Level (L_c) is less than the ODCM required LLD.

<L_c indicates no positive values above sample critical level.

FIGURE C-2

RADIONUCLIDES IN AIR - GROSS BETA
2007 to 2017

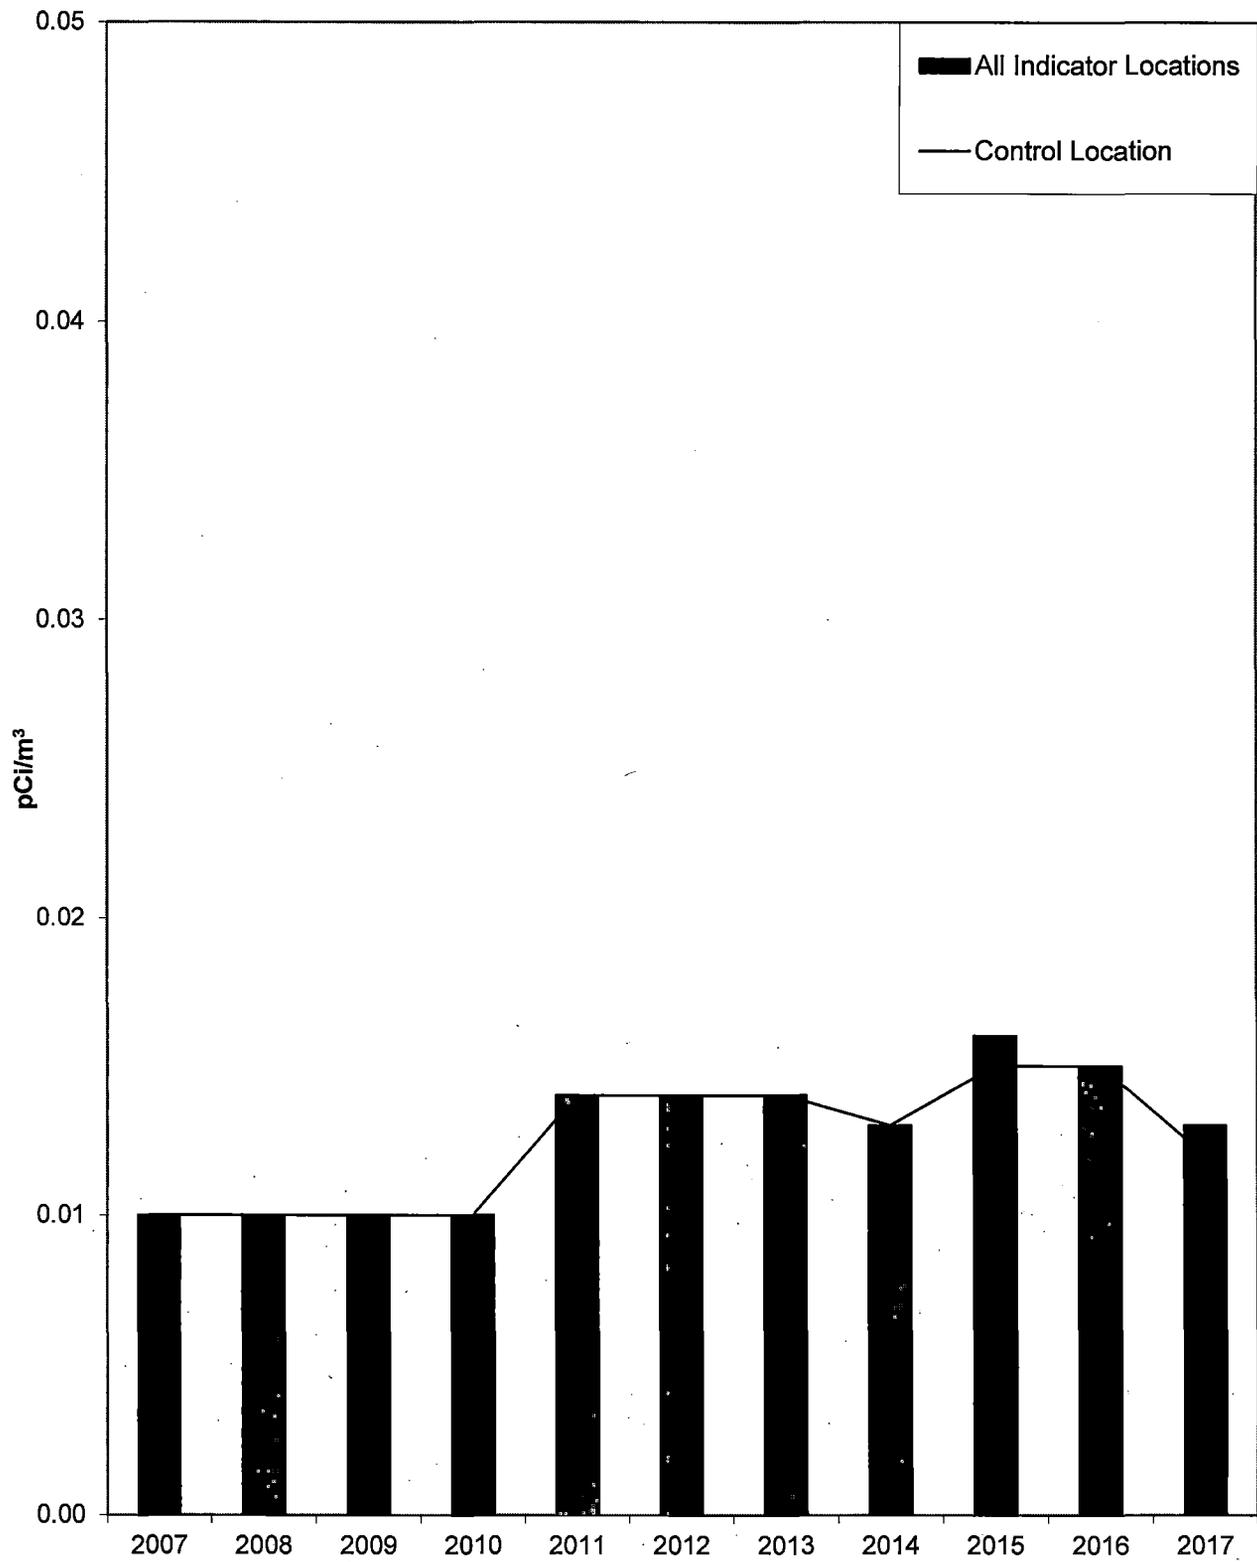

* Includes ODCM and non-ODCM indicator locations.

Gross Beta ODCM required LLD = 0.01 pCi/m³

TABLE C-3

**RADIONUCLIDES IN HUDSON RIVER WATER- TRITIUM
2007 to 2017
(pCi/L)**


Year	Tritium (H-3)		Cs-137	
	Inlet	Discharge	Inlet	Discharge
2007	< L _c	< L _c	< L _c	< L _c
2008	< L _c	< L _c	< L _c	< L _c
2009	< L _c	< L _c	< L _c	< L _c
2010	428	< L _c	< L _c	< L _c
2011	< L _c	661	< L _c	< L _c
2012	< L _c	539	< L _c	< L _c
2013	241	462	< L _c	< L _c
2014	224	253	< L _c	< L _c
2015	188	341	< L _c	< L _c
2016	< L _c	415	< L _c	< L _c
2017	< L _c	299	< L _c	< L _c
Historical Average 2007-2017	270	424	< L _c	< L _c

Critical Level (L_c) is less than the ODCM required LLD.

<L_c indicates no positive values above sample critical level.

FIGURE C-3

RADIONUCLIDES IN HUDSON RIVER WATER - TRITIUM
2007 to 2017

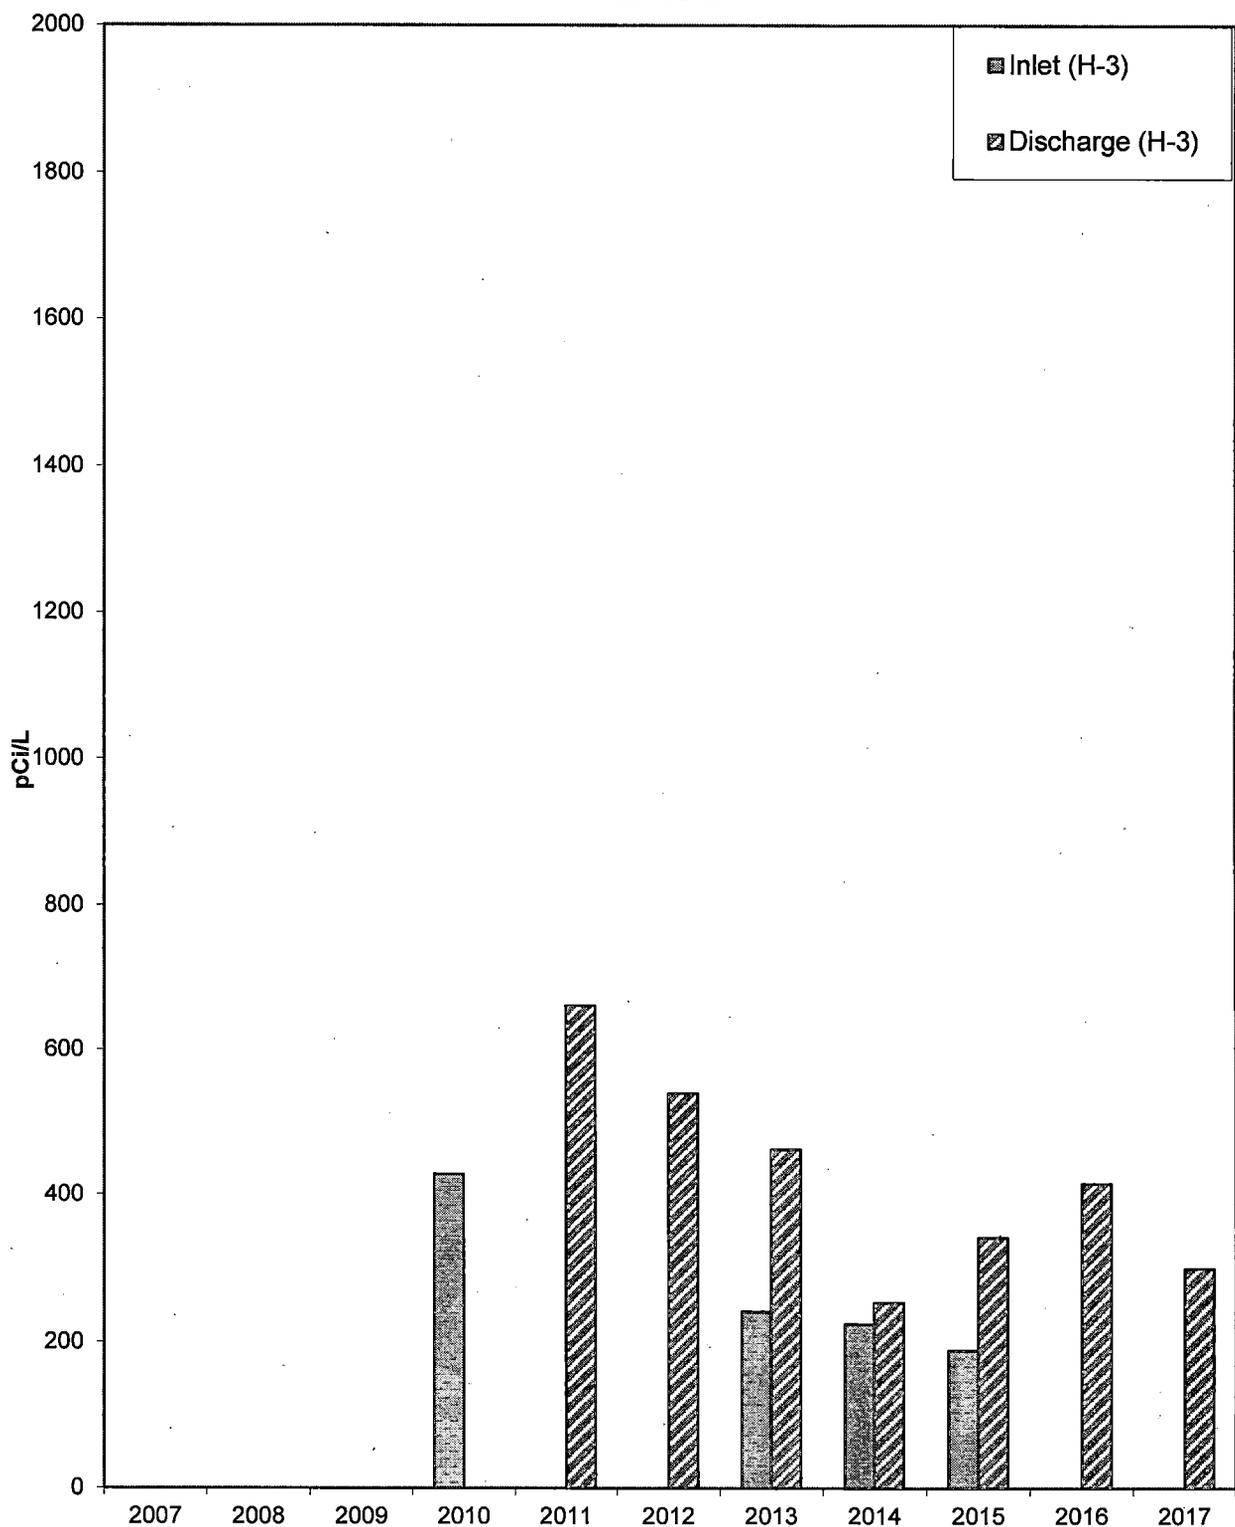

Tritium ODCM required LLD = 3000 pCi/L

TABLE C-4


**RADIONUCLIDES IN DRINKING WATER
2007 to 2017
(pCi/L)**

Year	Tritium (H-3)	Cs-137
2007	< L _c	< L _c
2008	< L _c	< L _c
2009	< L _c	< L _c
2010	< L _c	< L _c
2011	< L _c	< L _c
2012	< L _c	< L _c
2013	< L _c	< L _c
2014	< L _c	< L _c
2015	< L _c	< L _c
2016	< L _c	< L _c
2017	< L _c	< L _c
Historical Average 2007-2017	< L _c	< L _c

Critical Level (L_c) is less than the ODCM required LLD.
<L_c indicates no positive values above sample critical level.

FIGURE C-4

**RADIONUCLIDES IN DRINKING WATER
2007 to 2017**

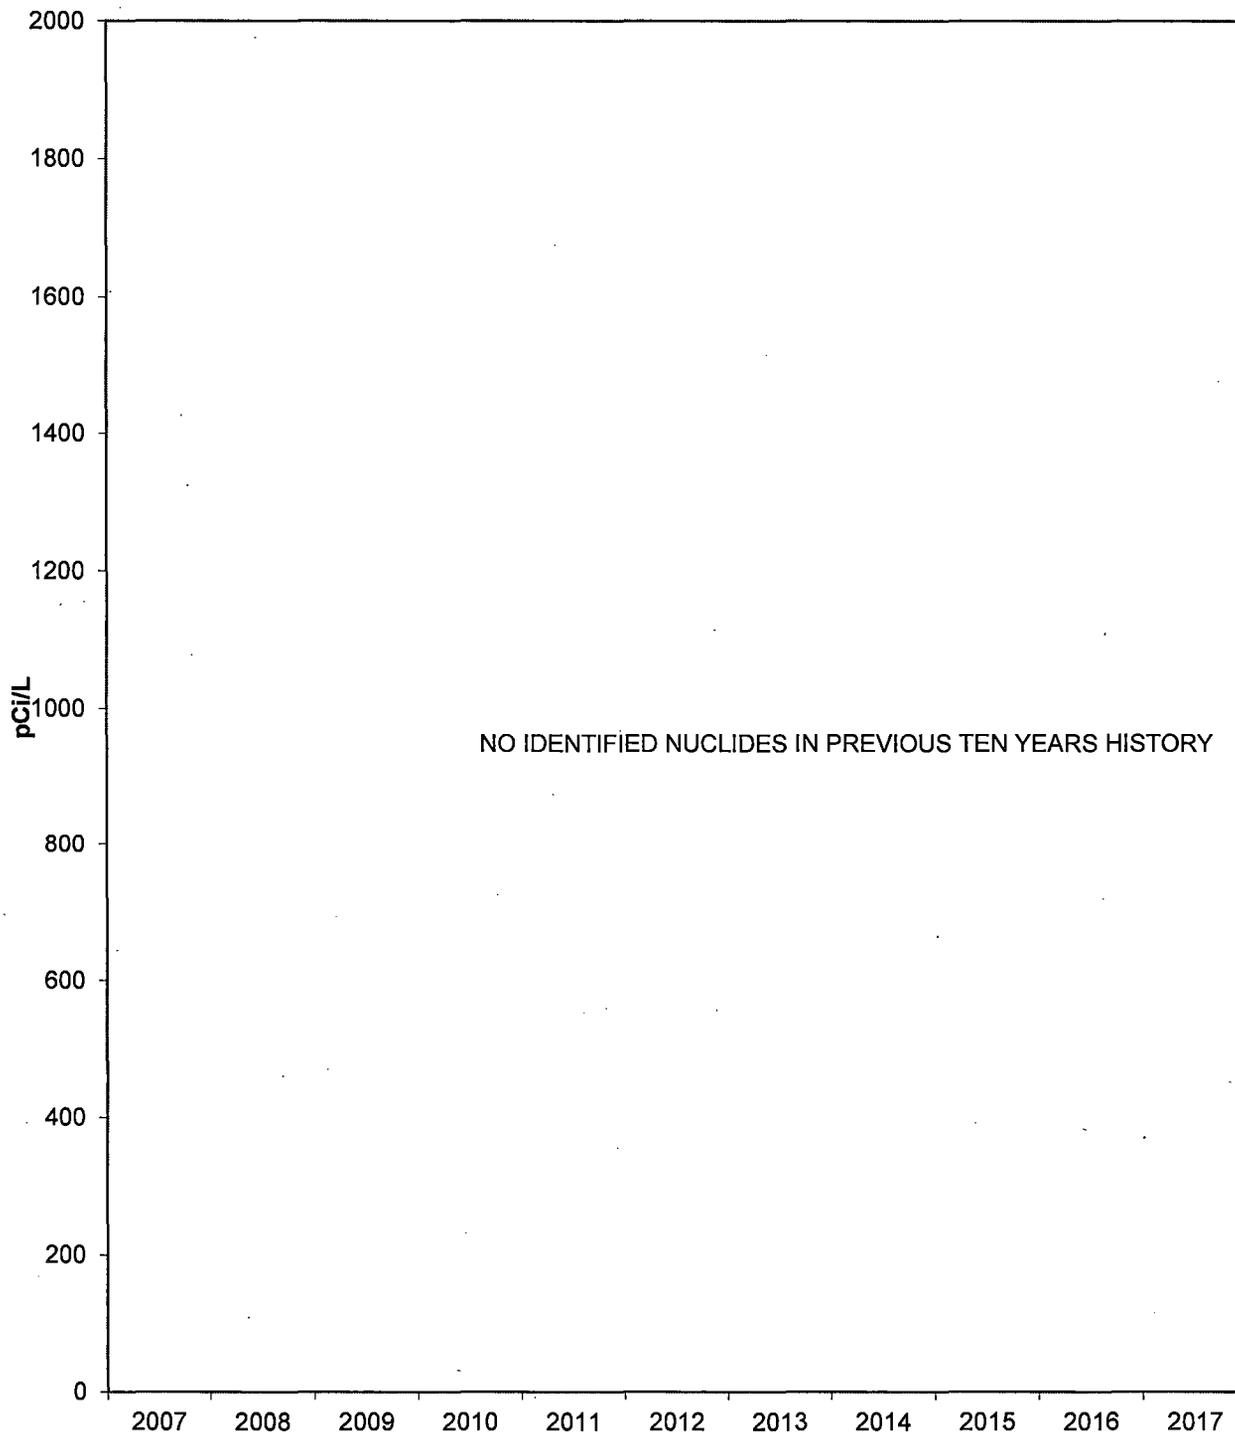

Tritium ODCM required LLD = 2000 pCi/L

TABLE C-5
RADIONUCLIDES IN SHORELINE SOIL
2007 to 2017
(pCi/Kg, dry)


Year	Cs-134		Cs-137	
	Indicator	Control	Indicator	Control
2007	< L _c	< L _c	190	< L _c
2008	< L _c	< L _c	187	< L _c
2009	< L _c	< L _c	149	< L _c
2010	< L _c	< L _c	154	63
2011	< L _c	< L _c	108	< L _c
2012	< L _c	< L _c	141	< L _c
2013	< L _c	< L _c	133	< L _c
2014	< L _c	< L _c	327	< L _c
2015	< L _c	< L _c	110	< L _c
2016	< L _c	< L _c	< L _c	< L _c
2017	< L _c	< L _c	151	< L _c
Historical Average 2007-2017	< L _c	< L _c	165	63

Critical Level (L_c) is less than the RETS required LLD.

<L_c indicates no positive values above sample critical level.

FIGURE C-5

RADIONUCLIDES IN SHORELINE SOIL
2007 to 2017

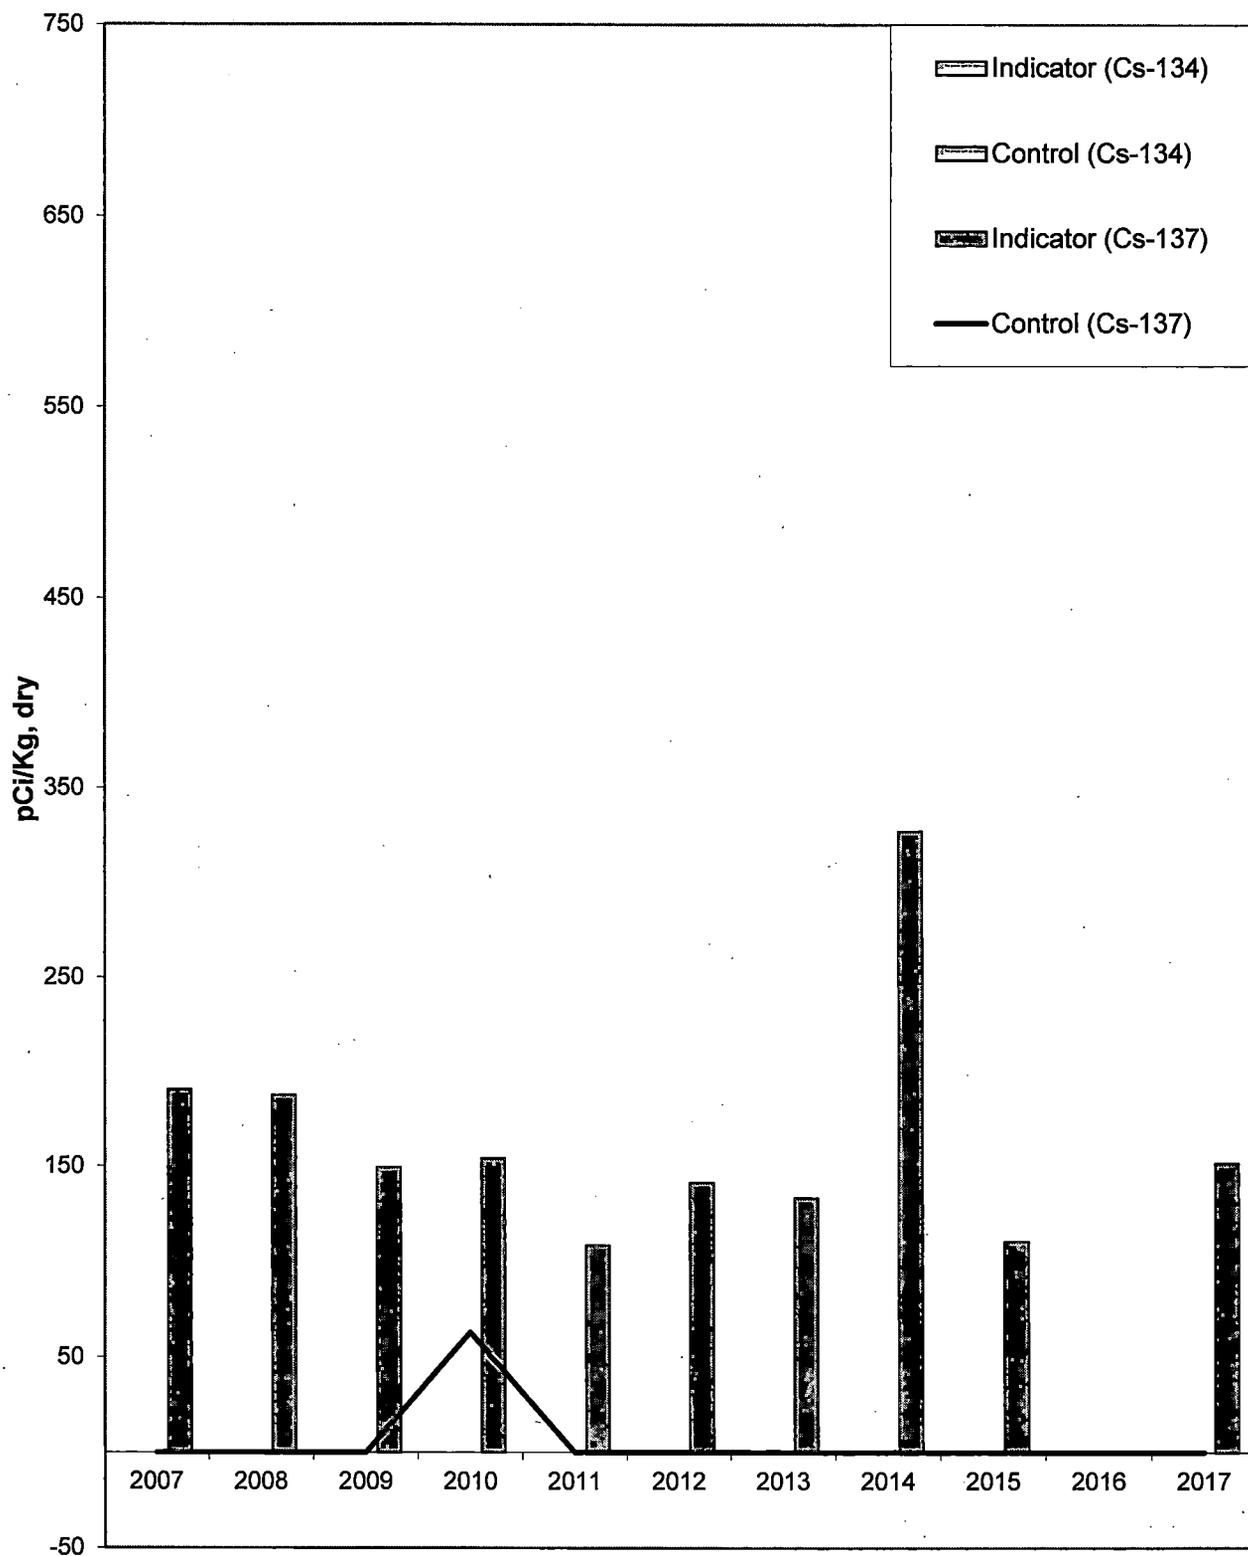

Cs-134 ODCM required LLD = 150 pCi/Kg, dry
Cs-137 ODCM required LLD = 175 pCi/Kg, dry

TABLE C-6

**RADIONUCLIDES IN BROADLEAF VEGETATION
2007 to 2017
(pCi/Kg, wet)**


Cs-137		
Year	Indicator	Control
2007	< L _c	< L _c
2008	< L _c	< L _c
2009	< L _c	< L _c
2010	< L _c	< L _c
2011	31	< L _c
2012	< L _c	< L _c
2013	44	< L _c
2014	< L _c	< L _c
2015	< L _c	< L _c
2016	< L _c	< L _c
2017	< L _c	< L _c
Historical Average 2007-2017	38	< L _c

Critical Level (L_c) is less than the ODCM required LLD.

<L_c indicates no positive values above sample critical level.

FIGURE C-6

**RADIONUCLIDES IN BROADLEAF VEGETATION
2007 to 2017**

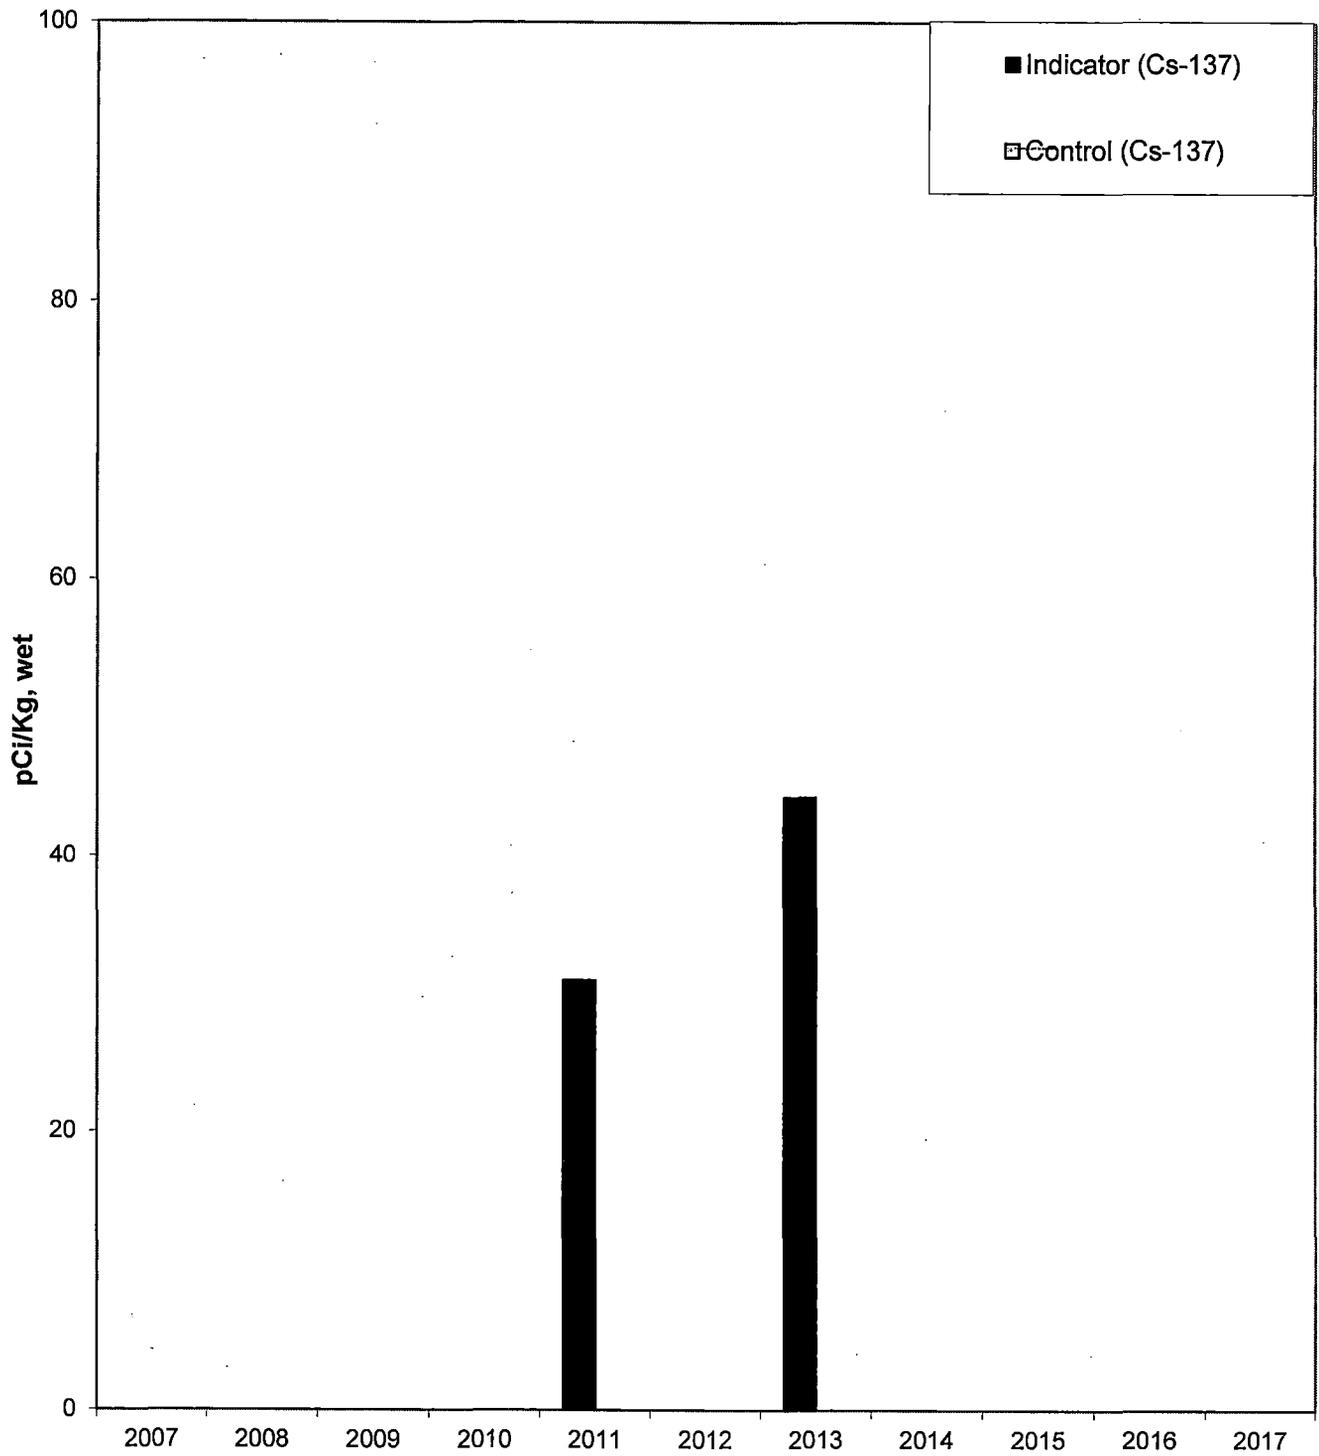

ODCM required LLD = 80 pCi/Kg, wet

TABLE C-7

**RADIONUCLIDES IN FISH AND INVERTEBRATES
2007 to 2017
(pCi/Kg, dry)**


Cs-137		
Year	Indicator	Control
2007	< L _c	< L _c
2008	< L _c	< L _c
2009	< L _c	< L _c
2010	< L _c	< L _c
2011	< L _c	< L _c
2012	< L _c	< L _c
2013	< L _c	< L _c
2014	< L _c	< L _c
2015	< L _c	< L _c
2016	< L _c	< L _c
2017	< L _c	< L _c
Historical Average 2007-2017	< L _c	< L _c

Critical Level (L_c) is less than the ODCM required LLD.

<L_c indicates no positive values above sample critical level.

FIGURE C-7

**RADIONUCLIDES IN FISH AND INVERTEBRATES -
2007 to 2017**

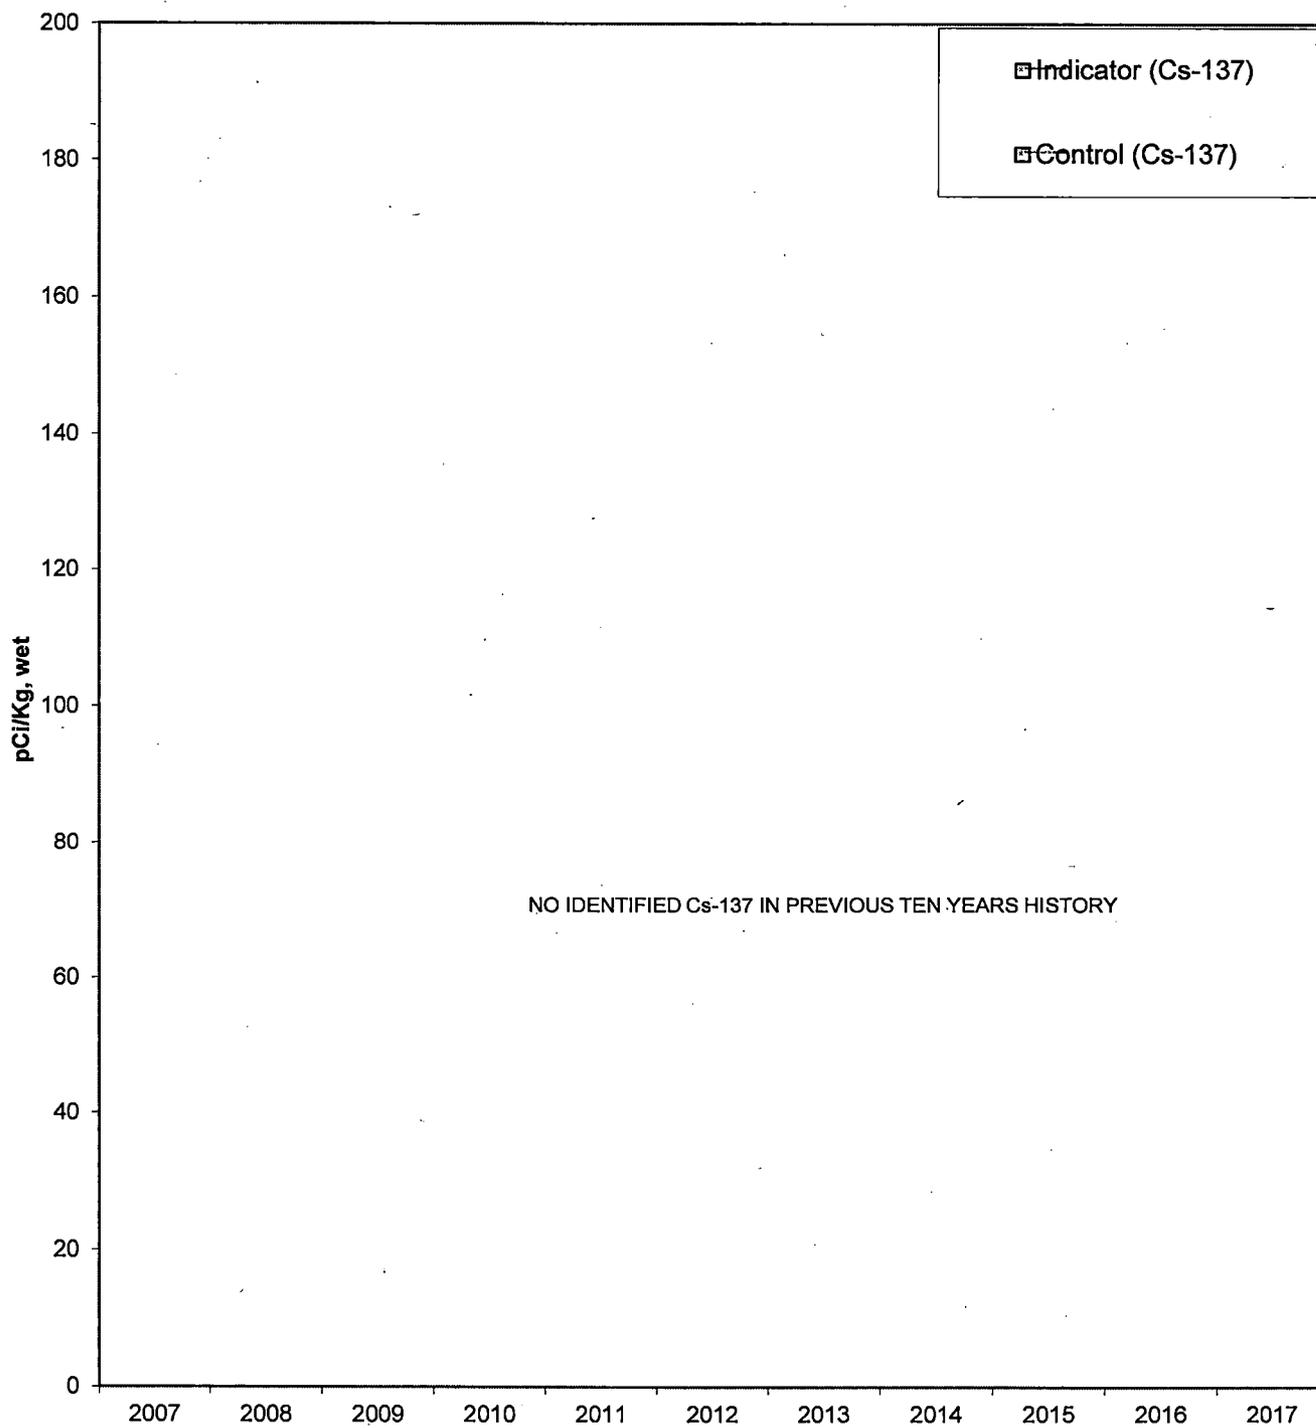

Cs-137 ODCM required LLD = 150 pCi/Kg, wet

TABLE C-8

**RIVER WATER - Discharge Area - Tritium
REMP vs. EFFLUENT
(pCi/liter)**

Year	REMP*	EFFLUENT **
1Q 2103	357	1813
2Q 2013	< 170	223
3Q 2013	< 186	428
4Q 2013	306	896
1Q 2104	<195	952
2Q 2014	253	82
3Q 2014	<189	26
4Q 2014	<157	218
1Q 2015	959	1940
2Q 2015	274	241
3Q 2015	<186	350
4Q 2015	341	536
1Q 2016	572	830
2Q 2016	257	762
3Q 2016	177	55
4Q 2016	195	253
1Q 2017	216	912
2Q 2017	<191	372
3Q 2017	<179	51
4Q 2017	381	665
Four Year Average, by Quarter, 2013 - 2017	357	600

* Sample from mixing zone, expected to be less than average activity in the discharge canal.

** Based upon Effluent Report data, average activity in the discharge canal calculated from the total H-3 discharged divided by the total dilution volume for the quarter.

TABLE C-9
RADIONUCLIDES IN BOTTOM SEDIMENT
2007 to 2017
(pCi/Kg, dry)


Cs-137		
Year	Indicator	Control
2007	221	254
2008	239	< L _c
2009	493	225
2010	552	< L _c
2011	287	238
2012	284	< L _c
2013	2738	264
2014	327	< L _c
2015	876	< L _c
2016	224	< L _c
2017	350	< L _c
Historical Average 2007-2017		245

Critical Level (L_c) is less than the RETS required LLD.

<L_c indicates no positive values above sample critical level.

FIGURE C-9

RADIONUCLIDES IN BOTTOM SEDIMENT
2007 to 2017

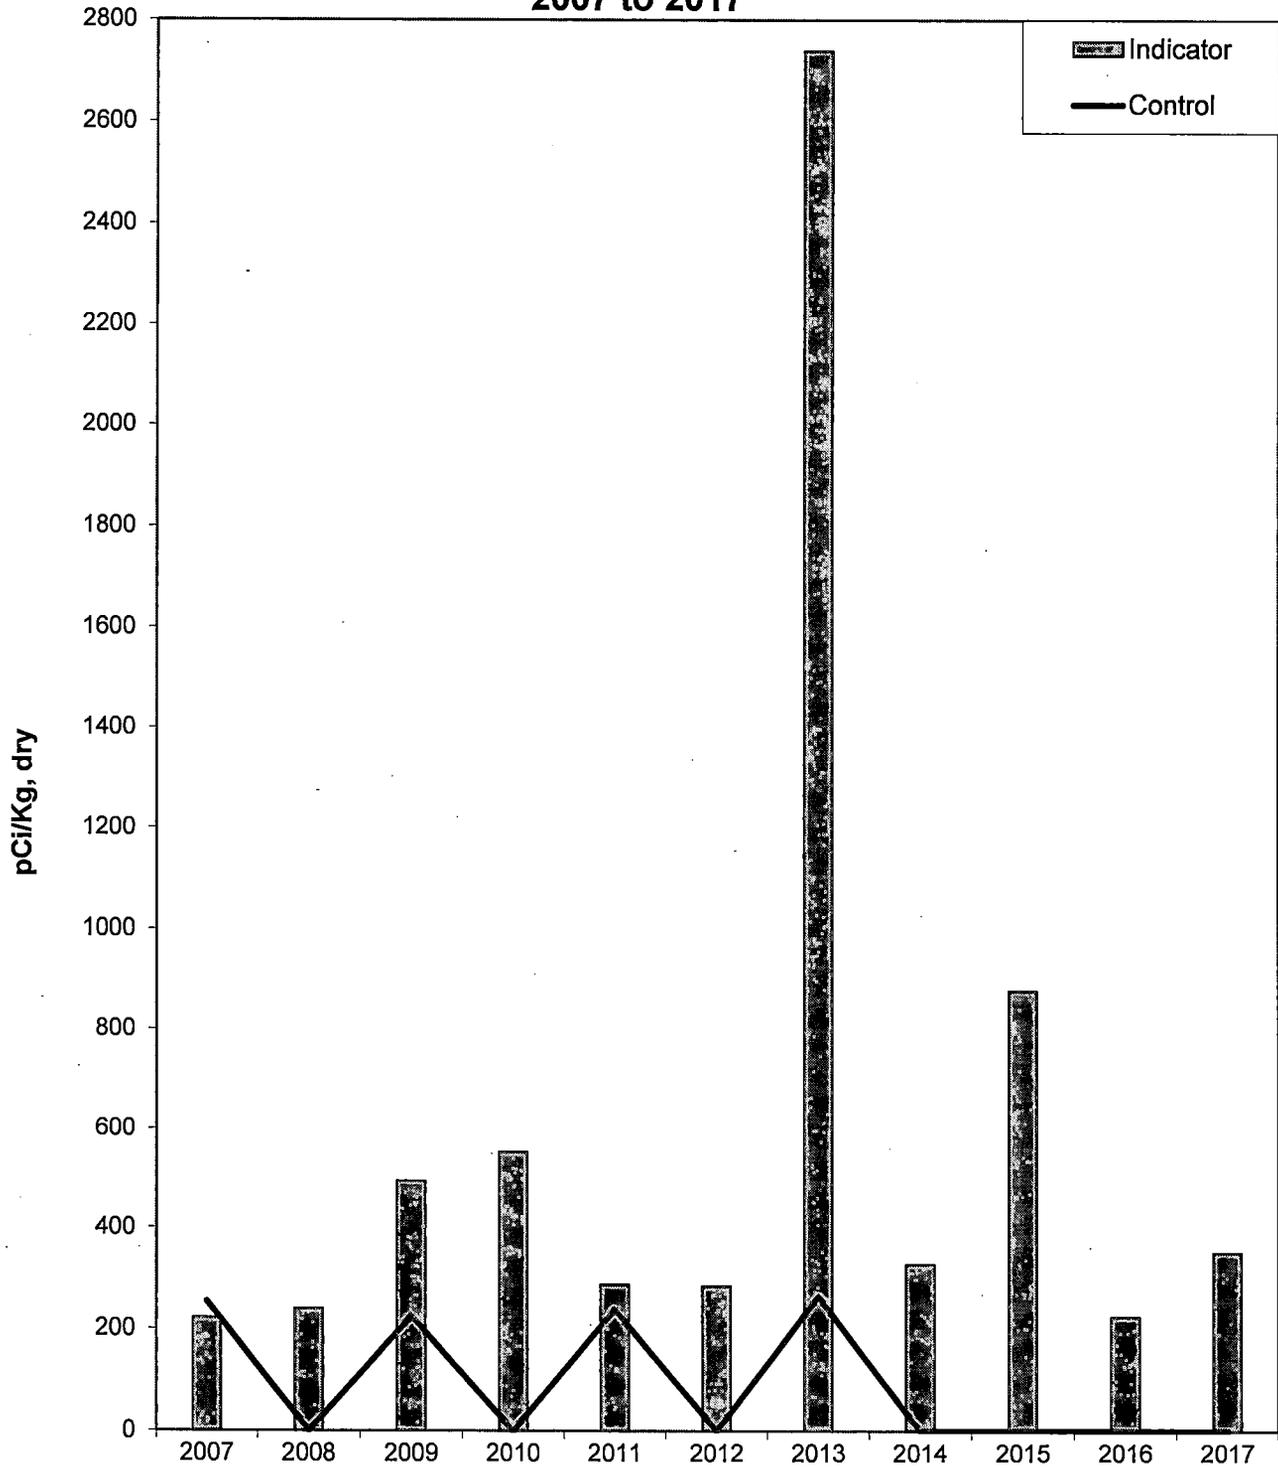

Cs-137 ODCM required LLD = 175 pCi/Kg, dry

APPENDIX D

INTERLABORATORY COMPARISON PROGRAM

APPENDIX D

INTERLABORATORY COMPARISON PROGRAM

This section presents the results of the interlaboratory comparison program for the Teledyne Brown Engineering Environmental Services and Environmental Dosimetry Company.

D.1 Program Description – Teledyne Brown Engineering Environmental Services Comparison Programs

The Teledyne Brown Engineering Environmental Services participates in several interlaboratory comparison programs. These programs include sample media for which samples are routinely collected and for which comparison samples are commercially available. Participation in these interlaboratory comparison programs ensure that independent checks on the precision and accuracy of the measurement of radioactive material in the environmental samples are performed as part of the Quality Assurance Program for environmental monitoring. To fulfill the requirement for an Interlaboratory Comparison Program, Teledyne Brown Engineering Environmental Services has engaged the following programs:

- Eckert & Ziegler Analytics Environmental Radioactivity Cross Check Program
- Department of Energy (DOE) Mixed Analyte Performance Evaluation Program (MAPEP)
- Environmental Resource Associates (ERA) Cross Check Program

These programs supply sample media as blind samples (typically spikes), which contain certified levels of radioactivity unknown to the analysis laboratory. These samples are prepared and analyzed by the Teledyne Brown Engineering Environmental Services using standard laboratory procedures. Each program issues a statistical summary report of the results. Teledyne Brown Engineering Environmental Services uses predetermined acceptance criteria methodology for evaluating its laboratory performance.

Teledyne Brown Engineering Environmental Services also analyzes laboratory blanks. The analysis of laboratory blanks provides a means to detect and measure radioactive contamination of analytical samples. The analysis of analytical blanks also provides information on the adequacy of background subtraction. Laboratory blank results are analyzed using control charts.

D.2 Acceptance Criteria

Each sample result is evaluated to determine the accuracy and precision of the laboratory's analysis result. The sample evaluation method is discussed below.

D.2.1 Analytics Sample Results Evaluation

Samples provided by Analytics are evaluated using what is specified as the NRC method. This method is based on the calculation of the ratio of results reported by the participating laboratory (QC result) to the Vendor Laboratory Known value (reference result).

An Environmental Laboratory analytical result is evaluated using the following calculation:

The value for the error resolution is calculated.

$$\text{Error Resolution} = \frac{\text{Reference Result}}{\text{Reference Results Error (1 sigma)}}$$

Using the appropriate row under the Error Resolution column in Tables D-3.1, D-3.2, and D-3.3, a corresponding Ratio of Agreement interval is given.

The value for the ratio is then calculated.

$$\text{Ratio of agreement} = \frac{\text{QC Result}}{\text{Reference Result}}$$

If the value falls within the agreement interval, the result is acceptable.

TABLE D-2.1 Ratio of Agreement

ERROR RESOLUTION	RATIO OF AGREEMENT
< 4	No Comparison
4 to 7	0.5-2.0
8 to 15	0.6-1.66
16 to 50	0.75-1.33
51 to 200	0.8-1.25
>200	0.85-1.18

This acceptance test is generally referred to as the "NRC" method. The acceptance criteria are contained in Procedure EN-CY-102. The NRC method generally results in an acceptance range of approximately $\pm 25\%$ of the Known value when applied to sample results from the Eckert & Ziegler Analytics Interlaboratory Comparison Program. This method is used as the procedurally required assessment method and requires the generation of a deviation from QA/QC program report when results are unacceptable.

D.2.2 ERA and MAPEP Sample Result Evaluation

Both these programs supply an acceptance range for evaluating the results.

D.3 Program Results Summary

The Interlaboratory Comparison Program numerical results are summarized in the following tables.

TABLE D-3.1

**Analytics Environmental Radioactivity Cross Check Program
Teledyne Brown Engineering Environmental Services**

Month/Year	Identification Number	Matrix	Nuclide	Units	TBE Reported Value	Known Value ^(a)	Ratio of TBE to Analytics Result	Evaluation ^(b)
March 2017	E11811	Milk	Sr-89	pCi/L	87	97.7	0.89	A
			Sr-90	pCi/L	12.4	16.2	0.77	W
March 2017	E11812	Milk	Ce-141	pCi/L	135	145	0.93	A
			Co-58	pCi/L	153	150	1.02	A
			Co-60	pCi/L	182	183	1.00	A
			Cr-51	pCi/L	258	290	0.89	A
			Cs-134	pCi/L	104	120	0.87	A
			Cs-137	pCi/L	142	140	1.02	A
			Fe-59	pCi/L	135	129	1.05	A
			I-131	pCi/L	92.6	97.9	0.95	A
			Mn-54	pCi/L	173	164	1.05	A
			Zn-65	pCi/L	208	199	1.04	A
			March 2017	E11813	Charcoal	I-131	pCi	92
March 2017	E11814	AP	Ce-141	pCi	99.9	101	0.99	A
			Co-58	pCi	95.4	104	0.92	A
			Co-60	pCi	140	127	1.10	A
			Cr-51	pCi	211	201	1.05	A
			Cs-134	pCi	82.1	83.2	0.99	A
			Cs-137	pCi	92.8	97.0	0.96	A
			Fe-59	pCi	107	89.3	1.20	A
			Mn-54	pCi	106	114	0.93	A
March 2017	E11816	Soil	Ce-141	pCi/g	0.258	0.250	1.03	A
Co-58			pCi/g	0.241	0.258	0.93	A	
Co-60			pCi/g	0.312	0.315	0.99	A	
Cr-51			pCi/g	0.439	0.500	0.88	A	
Cs-134			pCi/g	0.176	0.207	0.85	A	
Cs-137			pCi/g	0.304	0.317	0.96	A	
Fe-59			pCi/g	0.210	0.222	0.95	A	
Mn-54			pCi/g	0.292	0.283	1.03	A	
Zn-65			pCi/g	0.353	0.344	1.03	A	
March 2017	E11815	Water	Fe-55	pCi/L	1600	1890	0.85	A

(a) The Analytics known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation

(b) Analytics evaluation based on TBE internal QC limits:

A = Acceptable - reported result falls within ratio limits of 0.80-1.20

W = Acceptable with warning - reported result falls within 0.70-0.80 or 1.20-1.30

N = Not Acceptable - reported result falls outside the ratio limits of < 0.70 and > 1.30

TABLE D-3.1

**Analytics Environmental Radioactivity Cross Check Program
Teledyne Brown Engineering Environmental Services**

Month/Year	Identification Number	Matrix	Nuclide	Units	TBE Reported Value	Known Value ^(a)	Ratio of TBE to Analytics Result	Evaluation ^(b)			
June 2017	E11844	Milk	Sr-89	pCi/L	81.3	92.6	0.88	A			
			Sr-90	pCi/L	12.1	13.5	0.90	A			
June 2017	E11846	Milk	Ce-141	pCi/L	142	151	0.94	A			
			Co-58	pCi/L	147	155	0.95	A			
			Co-60	pCi/L	185	191	0.97	A			
			Cr-51	pCi/L	321	315	1.02	A			
			Cs-134	pCi/L	168	188	0.89	A			
			Cs-137	pCi/L	148	150	0.99	A			
			Fe-59	pCi/L	116	115	1.01	A			
			I-131	pCi/L	102	93.6	1.09	A			
			Mn-54	pCi/L	168	172	0.98	A			
			Zn-65	pCi/L	195	204	0.96	A			
			June 2017	E11847	Charcoal	I-131	pCi	87.9	84.8	1.04	A
			June 2017	E11845	AP	Sr-89	pCi	70.8	79.1	0.90	A
Sr-90	pCi	9.10				11.5	0.79	W			
June 2017	E11848	AP	Ce-141	pCi	112	116	0.96	A			
			Co-58	pCi	119	119	1.00	A			
			Co-60	pCi	171	146	1.17	A			
			Cr-51	pCi	270	241	1.12	A			
			Cs-134	pCi	152	144	1.05	A			
			Cs-137	pCi	114	115	0.99	A			
			Fe-59	pCi	94.1	88.3	1.07	A			
			Mn-54	pCi	139	132	1.06	A			
June 2017	E11849	Water	Fe-55	pCi/L	1840	1890	0.97	A			
July 2017	E11901	AP	GR-A	pCi	50.1	44.2	1.13	A			
			GR-B	pCi	218	233	0.93	A			

(a) The Analytics known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation

(b) Analytics evaluation based on TBE internal QC limits:

A = Acceptable - reported result falls within ratio limits of 0.80-1.20

W = Acceptable with warning - reported result falls within 0.70-0.80 or 1.20-1.30

N = Not Acceptable - reported result falls outside the ratio limits of < 0.70 and > 1.30

TABLE D-3.1

**Analytics Environmental Radioactivity Cross Check Program
Teledyne Brown Engineering Environmental Services**

Month/Year	Identification Number	Matrix	Nuclide	Units	TBE Reported Value	Known Value ^(a)	Ratio of TBE to Analytics Result	Evaluation ^(b)
September 2017	E11914	Milk	Sr-89	pCi/L	84.3	82.7	1.02	A
			Sr-90	pCi/L	12.6	12.1	1.04	A
	E11915	Milk	Ce-141	pCi/L	93.9	87.0	1.08	A
			Co-58	pCi/L	115	117	0.98	A
			Co-60	pCi/L	265	262	1.01	A
			Cr-51	pCi/L	273	217	1.26	W
			Cs-134	pCi/L	186	201	0.93	A
			Cs-137	pCi/L	175	172	1.02	A
			Fe-59	pCi/L	137	125	1.09	A
			I-131	pCi/L	78.0	71.0	1.10	A
			Mn-54	pCi/L	128	123	1.04	A
			Zn-65	pCi/L	206	184	1.12	A
				E11916	Charcoal	I-131	pCi	71.9
	E11917	AP	Ce-141	pCi	80.1	86.3	0.93	A
			Co-58	pCi	110	116	0.95	A
			Co-60	pCi	277	260	1.07	A
			Cr-51	pCi	275	215	1.28	W
			Cs-134	pCi	192	199	0.96	A
			Cs-137	pCi	165	170	0.97	A
			Fe-59	pCi	122	124	0.98	A
			Mn-54	pCi	120	122	0.99	A
	E11918	Water	Fe-55	pCi/L	1630	1630	1.00	A
	E11919	Soil	Ce-141	pCi/g	0.136	0.142	0.96	A
			Co-58	pCi/g	0.179	0.191	0.94	A
			Co-60	pCi/g	0.405	0.429	0.94	A
			Cr-51	pCi/g	0.230	0.355	0.65	N ⁽¹⁾
			Cs-134	pCi/g	0.272	0.328	0.83	A
			Cs-137	pCi/g	0.336	0.356	0.94	A
			Fe-59	pCi/g	0.210	0.205	1.02	A
			Mn-54	pCi/g	0.210	0.201	1.05	A
	Zn-65	pCi/g	0.301	0.301	1.00	A		

(a) The Analytics known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation

(b) Analytics evaluation based on TBE internal QC limits:

A = Acceptable - reported result falls within ratio limits of 0.80-1.20

W = Acceptable with warning - reported result falls within 0.70-0.80 or 1.20-1.30

N = Not Acceptable - reported result falls outside the ratio limits of < 0.70 and > 1.30

(1) See NCR 17-16

TABLE D-3.1

**Analytics Environmental Radioactivity Cross Check Program
Teledyne Brown Engineering Environmental Services**

Month/Year	Identification Number	Matrix	Nuclide	Units	TBE Reported Value	Known Value ^(a)	Ratio of TBE to Analytics Result	Evaluation ^(b)		
December 2017	E12054	Milk	Sr-89	pCi/L	92.1	92.3	1.00	A		
			Sr-90	pCi/L	18.3	16.9	1.09	A		
	E12055	Milk	Ce-141	pCi/L	97.8	98.3	0.99	A		
			Co-58	pCi/L	92.3	89.9	1.03	A		
			Co-60	pCi/L	176	173	1.02	A		
			Cr-51	pCi/L	226	242	0.93	A		
			Cs-134	pCi/L	118	125	0.95	A		
			Cs-137	pCi/L	148	141	1.05	A		
			Fe-59	pCi/L	123	113	1.08	A		
			I-131	pCi/L	66.0	57.8	1.14	A		
			Mn-54	pCi/L	173	161	1.08	A		
			Zn-65	pCi/L	233	211	1.10	A		
			E12056	Charcoal	I-131	pCi	48.1	47.5	1.01	A
			E12057A	AP	Ce-141	pCi	108	111	0.97	A
					Co-58	pCi	89.5	102	0.88	A
Co-60	pCi	223			196	1.14	A			
Cr-51	pCi	311			274	1.13	A			
Cs-134	pCi	141			142	1.00	A			
Cs-137	pCi	162			160	1.01	A			
Fe-59	pCi	121			129	0.94	A			
Mn-54	pCi	177			182	0.97	A			
Zn-65	pCi	203			239	0.85	A			
E12058	Water	Fe-55	pCi/L	1970	1740	1.13	A			
E12059	AP	Sr-89	pCi	71.2	87.4	0.81	A			
		Sr-90	pCi	12.9	16.0	0.81	A			

(a) The Analytics known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation

(b) Analytics evaluation based on TBE internal QC limits:

A = Acceptable - reported result falls within ratio limits of 0.80-1.20

W = Acceptable with warning - reported result falls within 0.70-0.80 or 1.20-1.30

N = Not Acceptable - reported result falls outside the ratio limits of < 0.70 and > 1.30

TABLE D-3.2

**DOE's Mixed Analyte Performance Evaluation Program (MAPEP)
Teledyne Brown Engineering Environmental Services**

Month/Year	Identification Number	Matrix	Nuclide	Units	TBE Reported Value	Known Value ^(a)	Acceptance Range	Evaluation ^(b)
February 2017	17-MaS36	Soil	Ni-63	Bq/kg	-5.512		(1)	A
			Sr-90	Bq/kg	571	624	437 - 811	A
	17-MaW36	Water	Am-241	Bq/L	0.693	0.846	0.592 - 1.100	A
			Ni-63	Bq/L	13.4	12.2	8.5 - 15.9	A
			Pu-238	Bq/L	0.7217	0.703	0.492 - 0.914	A
			Pu-239/240	Bq/L	0.9277	0.934	0.654 - 1.214	A
	17-RdF36	AP	U-234/233	Bq/sample	0.0911	0.104	0.073 - 0.135	A
			U-238	Bq/sample	0.0967	0.107	0.075 - 0.139	A
	17-RdV36	Vegetation	Cs-134	Bq/sample	6.44	6.95	4.87 - 9.04	A
			Cs-137	Bq/sample	4.61	4.60	3.22 - 5.98	A
			Co-57	Bq/sample	-0.0229		(1)	A
			Co-60	Bq/sample	8.52	8.75	6.13 - 11.38	A
			Mn-54	Bq/sample	3.30	3.28	2.30 - 4.26	A
			Sr-90	Bq/sample	1.30	1.75	1.23 - 2.28	W
Zn-65			Bq/sample	5.45	5.39	3.77 - 7.01	A	
August 2017	17-MaS37	Soil	Ni-63	Bq/kg	1130	1220	854 - 1586	A
			Sr-90	Bq/kg	296	289	202 - 376	A
	17-MaW37	Water	Am-241	Bq/L	0.838	0.892	0.624 - 1.160	A
			Ni-63	Bq/L	-0.096		(1)	A
			Pu-238	Bq/L	0.572	0.603	0.422 - 0.784	A
			Pu-239/240	Bq/L	0.863	0.781	0.547 - 1.015	A
	17-RdF37	AP	U-234/233	Bq/sample	0.103	0.084	0.059 - 0.109	W
			U-238	Bq/sample	0.115	0.087	0.061 - 0.113	N ⁽²⁾
	17-RdV37	Vegetation	Cs-134	Bq/sample	2.34	2.32	1.62 - 3.02	A
			Cs-137	Bq/sample	0.05		(1)	A
			Co-57	Bq/sample	3.32	2.8	2.0 - 3.6	A
			Co-60	Bq/sample	2.09	2.07	1.45 - 2.69	A
			Mn-54	Bq/sample	2.90	2.62	1.83 - 3.41	A
			Sr-90	Bq/sample	1.17	1.23	0.86 - 1.60	A
Zn-65	Bq/sample	6.07	5.37	3.76 - 6.98	A			

(a) The MAPEP known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation

(b) DOE/MAPEP evaluation:

A = Acceptable - reported result falls within ratio limits of 0.80-1.20

W = Acceptable with warning - reported result falls within 0.70-0.80 or 1.20-1.30

N = Not Acceptable - reported result falls outside the ratio limits of < 0.70 and > 1.30

(1) False positive test

(2) See NCR 17-15

TABLE D-3.3

**ERA Environmental Radioactivity Cross Check Program
Teledyne Brown Engineering Environmental Services**

Month/Year	Identification Number	Matrix	Nuclide	Units	TBE Reported Value	Known Value ^(a)	Acceptance Limits	Evaluation ^(b)
March 2017	MRAD-26	AP	GR-A	pCi/sample	76.3	85.5	28.6 - 133	A
April 2017	RAD-109	Water	Ba-133	pCi/L	49.2	49.7	40.8 - 55.1	A
			Cs-134	pCi/L	83.2	90.1	74.0 - 99.1	A
			Cs-137	pCi/L	202	206	185 - 228	A
			Co-60	pCi/L	51.2	54.7	49.2 - 62.7	A
			Zn-65	pCi/L	39.3	53.8	47.2 - 65.9	N ⁽¹⁾
			GR-A	pCi/L	53.6	75.0	39.5 - 92.3	A
			GR-B	pCi/L	42.7	38.5	25.5 - 46.0	A
			U-Nat	pCi/L	50.1	55.6	45.2 - 61.7	A
			H-3	pCi/L	7080	6850	5920 - 7540	A
			Sr-89	pCi/L	40.7	66.2	53.8 - 74.3	N ⁽¹⁾
			Sr-90	pCi/L	26.9	26.7	19.3 - 31.1	A
		I-131	pCi/L	26.7	29.9	24.9 - 34.9	A	
September 2017	MRAD-27	AP	GR-A	pCi/sample	40.9	50.1	16.8 - 77.8	A
		AP	GR-B	pCi/sample	58.0	61.8	39.1 - 90.1	A
October 2017	RAD-111	Water	Ba-133	pCi/L	71.3	73.7	61.7 - 81.1	A
			Cs-134	pCi/L	43.0	53.0	42.8 - 58.3	A
			Cs-137	pCi/L	48.2	52.9	47.6 - 61.1	A
			Co-60	pCi/L	69.0	69.5	62.6 - 78.9	A
			Zn-65	pCi/L	335	348	313 - 406	A
			GR-A	pCi/L	32.5	35.6	18.3 - 45.8	A
			GR-B	pCi/L	24.3	25.6	16.0 - 33.6	A
			U-Nat	pCi/L	36.6	37.0	30.0 - 40.9	A
			H-3	pCi/L	6270	6250	5390 - 6880	A
		I-131	pCi/L	26.4	24.2	20.1 - 28.7	A	
November 2017	111317O	Water	Sr-89	pCi/L	57.1	50.0	39.4 - 57.5	A
			Sr-90	pCi/L	27.1	41.8	30.8 - 48.0	N ⁽²⁾

(a) The ERA known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation.

(b) ERA evaluation:

A = Acceptable - Reported value falls within the Acceptance Limits

N = Not Acceptable - Reported value falls outside of the Acceptance Limits

(1) See NCR 17-09

(2) See NCR 17-19

D.4 Environmental TLD Quality Assurance

Environmental dosimetry services for the reporting period of January – December, 2017 were provided by the Environmental Dosimetry Company (EDC), Sterling, Massachusetts. The TLD systems at the Environmental Dosimetry Company (EDC) are calibrated and operated to ensure consistent and accurate evaluation of TLDs. The quality of the dosimetric results reported to EDC clients is ensured by in house performance testing and independent performance testing by EDC clients.

The purpose of the dosimetry quality assurance program is to provide performance documentation of the routine processing of EDC dosimeters. Performance testing provides a statistical measure of the bias and precision of dosimetry processing against a reliable standard, which in turn points out any trends or performance changes. Dosimetry quality control tests are performed on EDC Panasonic 814 Environmental dosimeters. These tests include: (1) the in house testing program conducted by the EDC QA Officer and (2) independent test perform by EDC clients.

Excluded from this report are instrumentation checks. Although instrumentation checks represent an important aspect of the quality assurance program, they are not included as process checks in this report. Instrumentation checks represent between 5-10% of the TLDs processed.

Table D-4.1 provides a summary of individual dosimeter results evaluated against the EDC internal acceptance criteria for high-energy photons (Cs-137) only. The internal acceptance (tolerance) criteria for the Panasonic Environmental dosimeters are: $\pm 15\%$ for bias and $\pm 12.8\%$ for precision. During this period, 100% (72/72) of the individual dosimeters, evaluated against these criteria met the tolerance limits for accuracy and 100% (72/72) met the criterion for precision.

Table D-4.2 provides the Bias + Standard deviation results for each group (N=6) of dosimeters evaluated against the internal tolerance criteria. Overall, 100% (12/12) of the dosimeter sets evaluated against the internal tolerance performance criteria met these criteria.

Table D-4.3 presents the independent blind spike results for irradiated dosimeters provided by client utilities during this annual period. All results passed the performance acceptance criterion.

TABLE D-4.1

**PERCENTAGE OF INDIVIDUAL DOSIMETERS THAT PASSED EDC INTERNAL CRITERIA
JANUARY – DECEMBER 2017 ^{(1), (2)}**

Dosimeter Type	Number Tested	% Passed Bias Criteria	% Passed Precision Criteria
Panasonic Environmental	72	100	100

⁽¹⁾This table summarizes results of tests conducted by EDC.

⁽²⁾Environmental dosimeter results are free in air.

TABLE D-4.2

**MEAN DOSIMETER ANALYSES (N=6)
JANUARY – DECEMBER 2017 ⁽¹⁾, ⁽²⁾**

Process Date	Mean Bias %	Standard Deviation %	Tolerance Limit +/-15%
5/01/2017	1.0	0.9	Pass
5/08/2017	-0.4	1.0	Pass
5/08/2017	0.8	2.4	Pass
7/25/2017	-2.5	1.7	Pass
7/29/2017	5.5	1.0	Pass
8/8/2017	-3.8	0.9	Pass
10/23/2017	3.8	2.8	Pass
10/31/2017	1.7	1.2	Pass
11/12/2017	0.5	1.0	Pass
2/01/2018	2.6	1.4	Pass
2/06/2018	3.0	0.6	Pass
2/08/2018	0.5	2.0	Pass

⁽¹⁾This table summarizes results of tests conducted by EDC for TLDs issued in 2017.

⁽²⁾Environmental dosimeter results are free in air.

TABLE D-4.3

**SUMMARY OF INDEPENDENT DOSIMETER TESTING
JANUARY – DECEMBER 2017 ⁽¹⁾, ⁽²⁾**

Issuance Period	Client	Mean Bias %	Standard Deviation %	Pass / Fail
1 st Qtr. 2017	Millstone	2.9	1.5	Pass
2 nd Qtr.2017	Millstone	2.8	1.2	Pass
3 rd Qtr. 2017	Millstone	1.1	2.7	Pass
4 th Qtr.2017	Millstone	-3.5	2.4	Pass
4 th Qtr.2017	Seabrook	8.6	1.6	Pass

⁽¹⁾Performance criteria are +/- 30%.

⁽²⁾Blind spike irradiations using Cs-137