

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL

GENERIC

FILE NUMBER
SUBJECT

TO: Mr Stolz

FROM: Portland General Electric
Portland, Oregon
J E Grund

DATE OF DOCUMENT
1-6-77

DATE RECEIVED
1-19-77

LETTER
 ORIGINAL
 COPY

NOTORIZED
 UNCLASSIFIED

PROP

INPUT FORM

NUMBER OF COPIES RECEIVED

1cc

DESCRIPTION

Ltr re their rpt entitled "Report of the Review Panel on the 12-14-1872 Earthquake" which was submitted to & received by NRC on 12-22-76.....

SAME DIST AS MC# 76-12940.

NOTE: LETTERS ONLY WILL BE PLACED IN THE FOLLOWING FILES IN BOTH THE DOCKET FILES & THE NRC PDR:

- 50-522/523 50-460/513
- 50-514/515 50-397
- 50-344 50-508/509

ENCLOSURE

Appendix D entitled "Selected Supporting Information".....

(33 cys encl rec'd)

FOR ACTION/INFORMATION

CENTRAL FILES (RD 16-6, 1872 Earthquake)	
NRC PDR: (Seismic Study, 1872 Earthquake)	
LPR's: (6 Sets)	
SEDRO WOOLEY, WASH	RICHLAND, WASH
ARLINGTON, OR	MONTESANO, WASH
ST HELENS, OR	


LTR ONLY INTERNAL DISTRIBUTION

W. GAMMILL	OELD		
C. STEPP (2)	E. CASE		
J. STOLZ (3)	R. BOYD		
D. VASSALLO	V. STELLO		
K. GOLLER	R. DEYOUNG		
PELLTIER	H. DENTON		
STAHL	J. MILLER		
TRAMELL	V. MOORE		
COX	L. CROCKER		
LYNCH	F. WILLIAMS		
BOHRNIA	E. HYLTON		
	H. SMITH		

EXTERNAL DISTRIBUTION

CONTROL NUMBER

TIC			
NSIC			
NOTE: DISTRIBUTION TO ACRS BEING HELD PENDING. INSTRUCTIONS FROM LPM STAHL. 6 SETS OF MATERIAL HAVE BEEN SENT TO USGS BY APPLICANT.			753

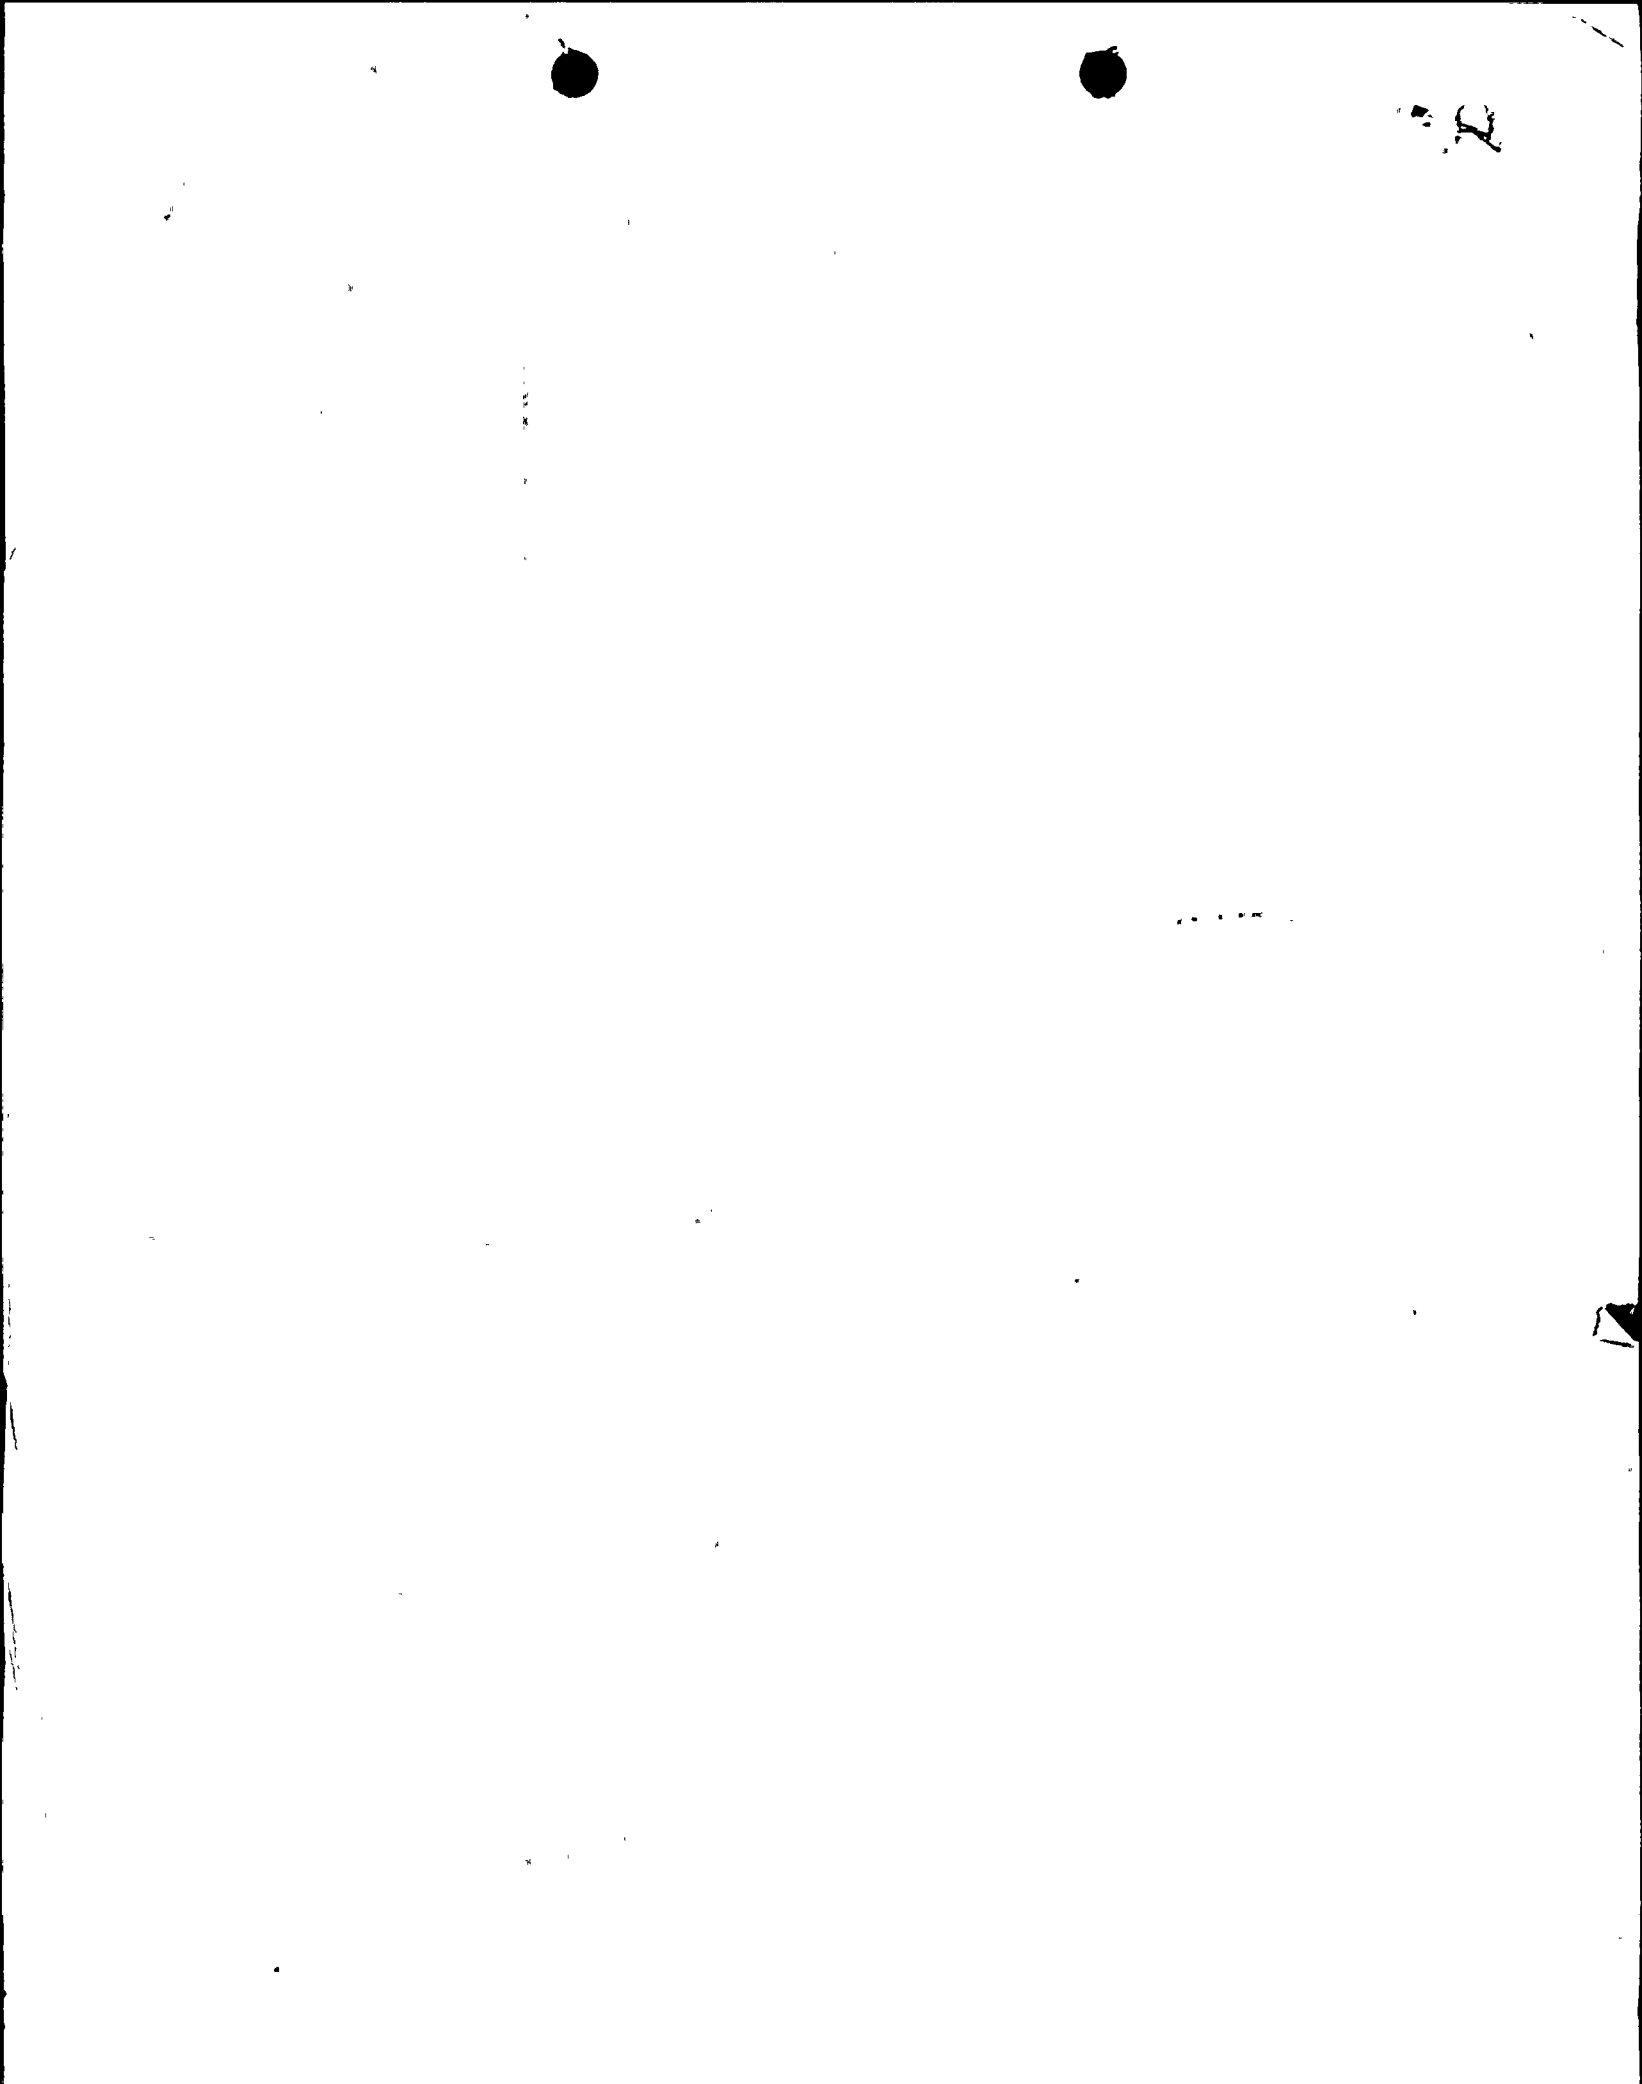

ELECTRIC BUILDING
 621 SW ALDER STREET
 PORTLAND, OREGON 97205

January 6, 1977



1872 Pacific Northwest
Earthquake Report

GRU-11-77

Mr. John Stolz, Chief
 Light Water Reactors Branch No. 1
 Division of Project Management, NRR
 U. S. Nuclear Regulatory Commission
 Washington, D. C. 20555

Dear Mr. Stolz:

Enclosed are forty (40) copies of Appendix D which accompanies the report entitled "Report of the Review Panel on the December 14, 1872 Earthquake" that was submitted December 22, 1976. To submit the report in a timely fashion this appendix was not included in the original submission because Appendix D contains only selected supporting information. The material included is considered hard to obtain due to limited availability.

By copy of this letter we are transmitting one (1) copy of Appendix D to Dr. James Devine, USGS, Reston, VA, and five (5) copies of Appendix D to Dr. Lou Pakiser, USGS, Denver, CO.

Sincerely,

J. E. Grund
 Chief Nuclear Engineer

JEG/rk
 Enclosures

c: Dr. James Devine, USGS (w/1 copy of enclosure)
 Dr. Lou Pakiser, USGS (w/5 copies of enclosure)

