


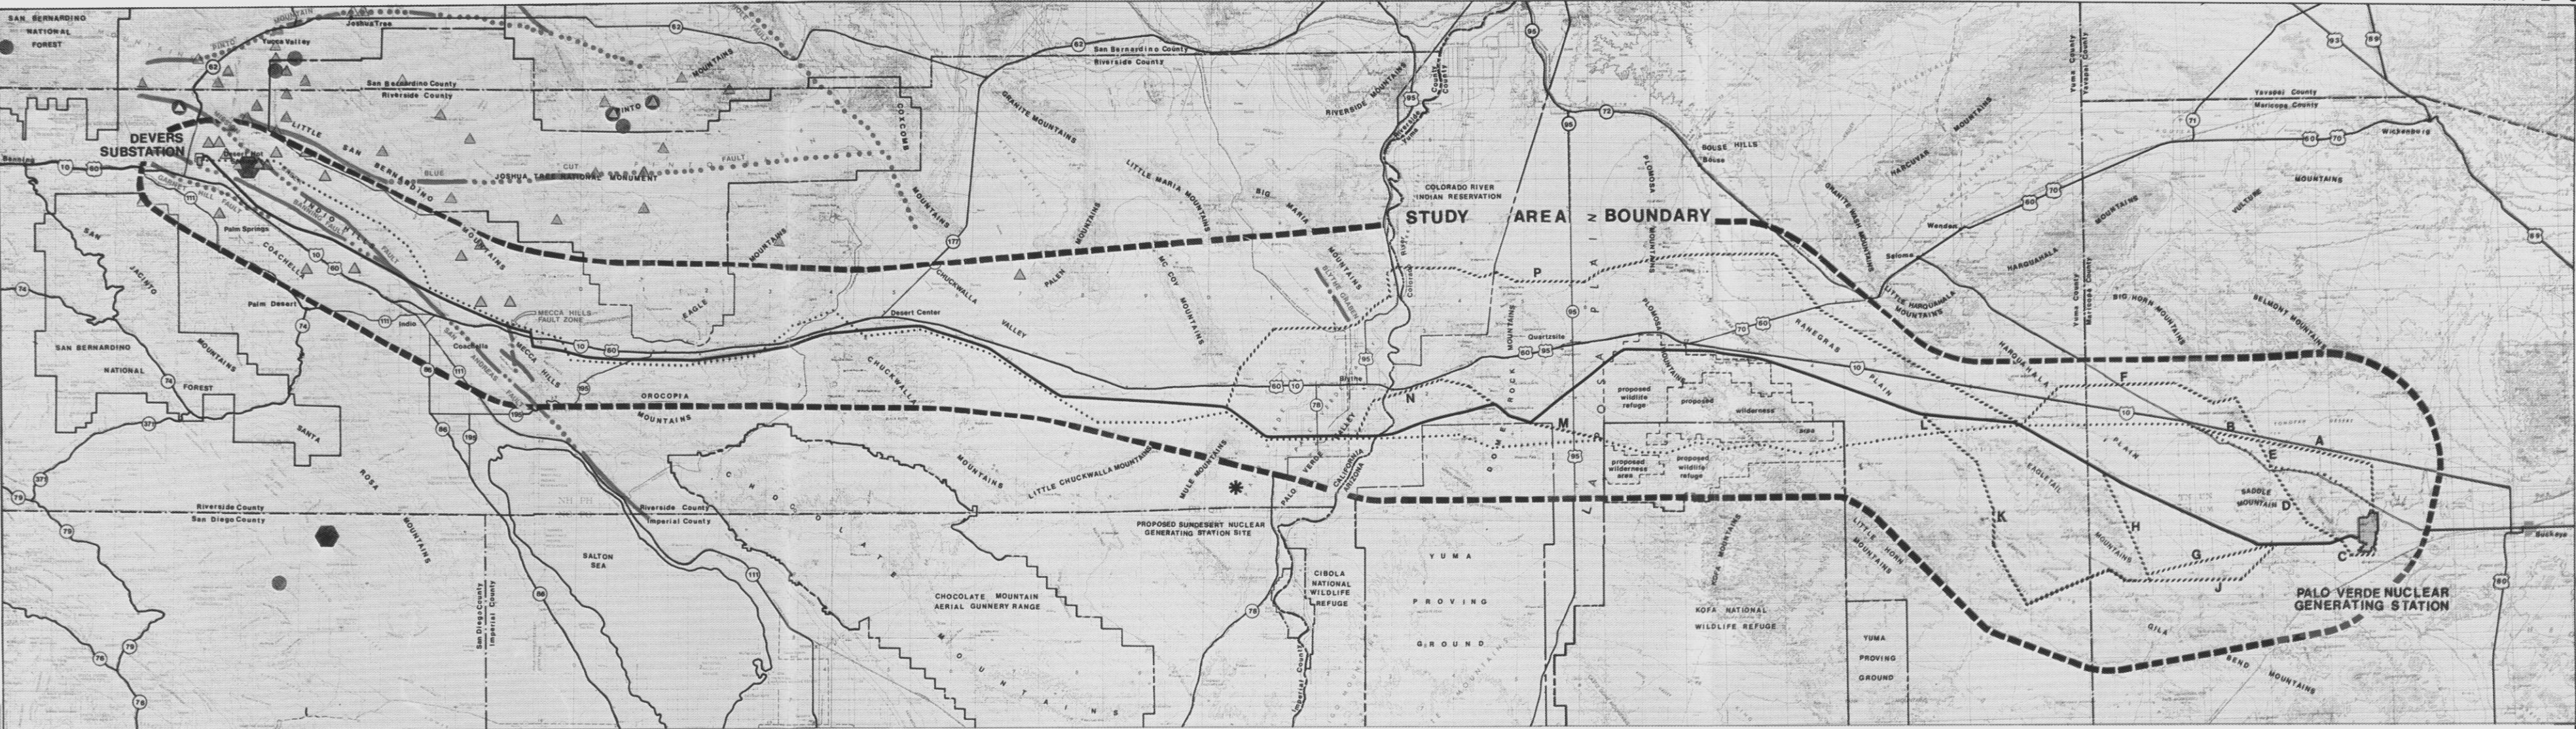

LEGEND

FAULTS

- KNOWN
- CONCEALED

EPICENTERS AND MAGNITUDES

- ▲ RICHTER 4.0 to 4.9
- RICHTER 5.0 to 5.9
- RICHTER 6.0 to 6.9

SOURCE: APPLICANT

UNITED STATES
DEPARTMENT OF THE INTERIOR
BUREAU OF LAND MANAGEMENT
PROPOSED
PALO VERDE-DEVERS 500KV TRANSMISSION LINE

SELECTED FAULTS
WITH SEISMICITY

