

October 20, 1976

PRN-LI-76-263



Mr. Norman C. Moseley, Director, Region II  
Office of Inspection and Enforcement  
U. S. Nuclear Regulatory Commission  
230 Peachtree Street, N. W., Suite 818  
Atlanta, Georgia 30303

Dear Mr. Moseley:

REPORTABLE OCCURRENCE 250-76-8  
TURKEY POINT UNIT 3  
DATE OF OCCURRENCE: OCTOBER 6, 1976

BORON INJECTION TANK

The attached Licensee Event Report is being submitted in accordance with Technical Specification 6.9.2 to provide prompt notification of the subject occurrence.

Very truly yours,

*A. D. Schmidt*  
A. D. Schmidt  
Vice President  
Power Resources

MAS/cpc

Attachment


cc: Jack R. Newman, Esquire  
Director, Office of Inspection and Enforcement (40)  
Director, Office of Management Information and  
Program Control (3)

11288

001 55 20011112

U.S.A.S.C.  
REGULATORY OPERATIONS  
REGION III  
ATLANTA, GA.  
OCT 22 9 58 AM '76



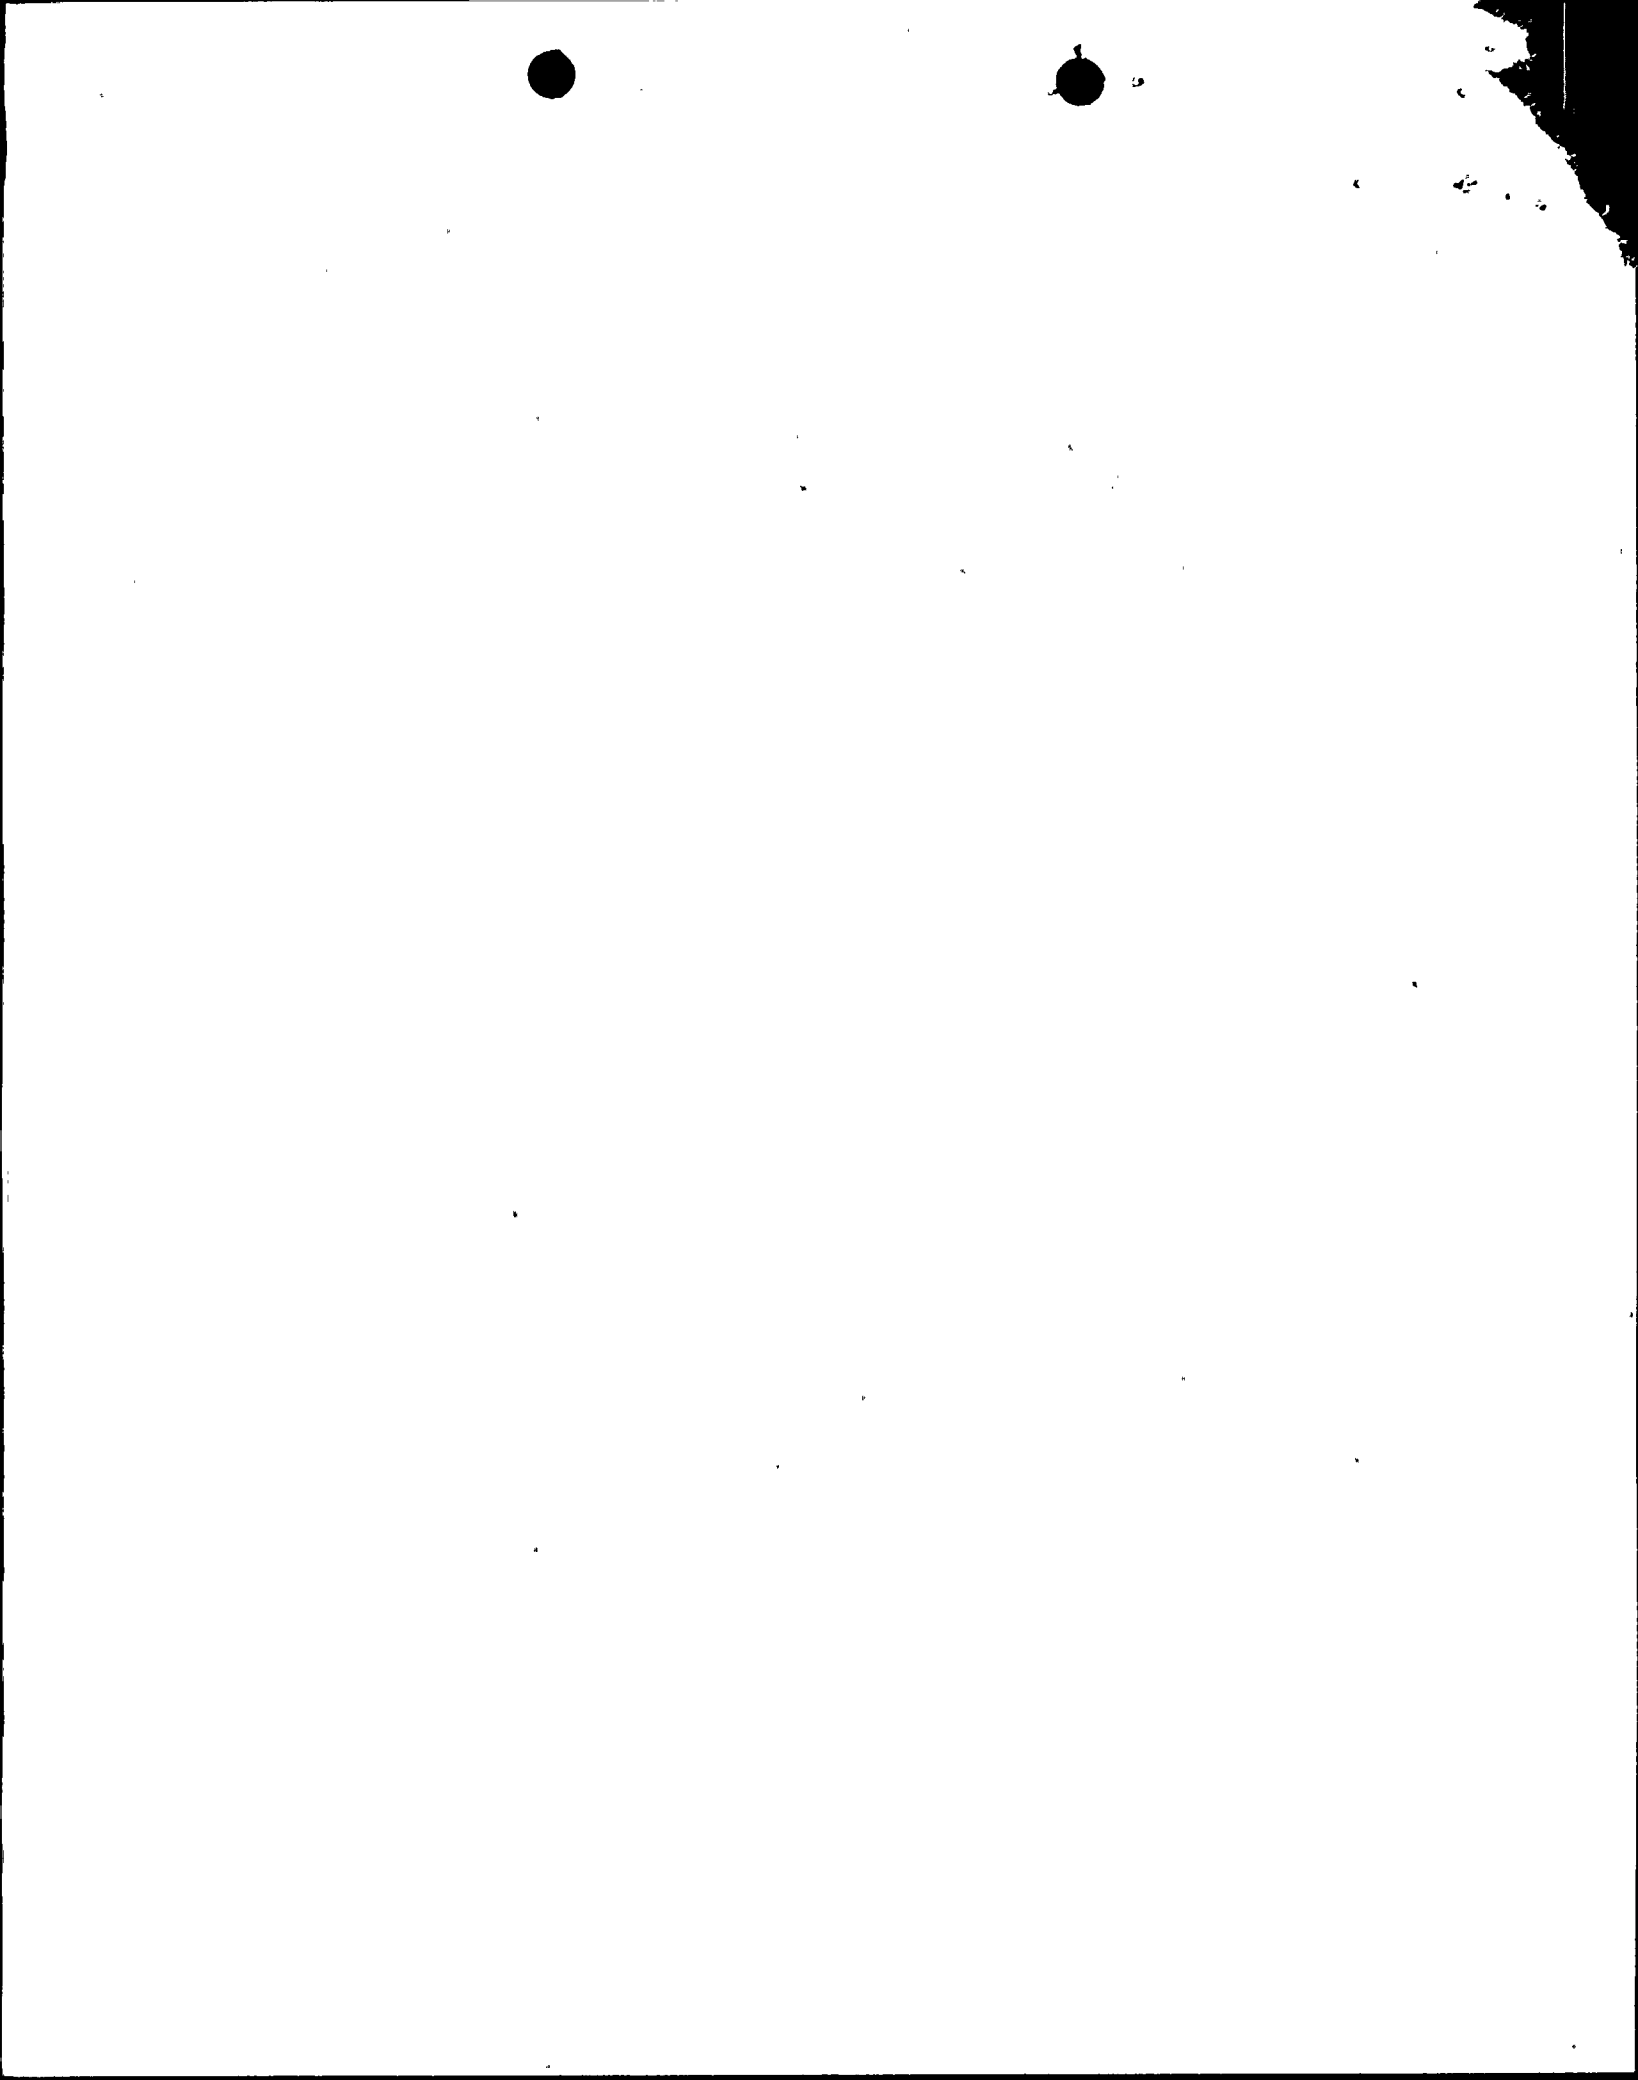

REPORTABLE OCCURRENCE 250-76-8  
LICENSEE EVENT REPORT  
PAGE TWO

Event Description (continued)

sampled and found to have a boron concentration of 20,800 ppm, whereupon recirculation of the Unit 3 BIT with the "A" BAST was begun. At approximately 10:43 a.m., followup sample results indicated that the boron concentration of the Unit 3 BIT had increased to 20,700 ppm, and the shutdown was terminated. Further investigation was unable to determine the cause of the low boron concentration.

Since the cause of this occurrence has not been identified, its similarity to previous occurrences of BIT boron dilution is not discussed in this report. (250-76-8)

