

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL

TO:

Mr. George Lear

FROM:
Florida Power & Light Company
Miami, Florida
Robert E. Uhrig

DATE OF DOCUMENT
4/21/77

DATE RECEIVED
4/26/77

LETTER
 ORIGINAL
 COPY

NOTORIZED
 UNCLASSIFIED

PROP
INPUT FORM

NUMBER OF COPIES RECEIVED
1 SIGNED

DESCRIPTION

Ltr. consisting of information regarding overpressure protection.....

(1-P)

REACTOR VESSEL OVERPRESSURIZATION DISTRIBUTION PER G. ZECH 10-21-76

PLANT NAME: Turkey Point Units 3 & 4

RJL

ENCLOSURE

ACKNOWLEDGED


DO NOT REMOVE

SAFETY		FOR ACTION/INFORMATION	
BRANCH CHIEF: (5)			
LIC. ASST:			
PROJECT MANAGER:			


INTERNAL DISTRIBUTION			
<u>REG FILE</u>			
NRC PDR			
I & E (2)			
OELO			
GOSSICK & STAFF			
BOSNAK			
PAWLICKI			
NOVAK			
EISENHUT			
SHAO			
BAER			
BUTLER			
ZECH			

EXTERNAL DISTRIBUTION			CONTROL NUMBER
IPDR: Miami, Fla			27170125
TIC:			
NSIC:			
ACRS 16 CYS HOLDING/SENT TO LA AS PART B			



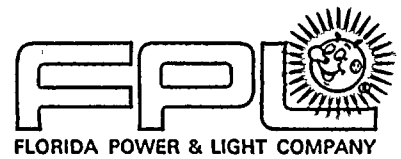

April 21, 1977
L-77-120

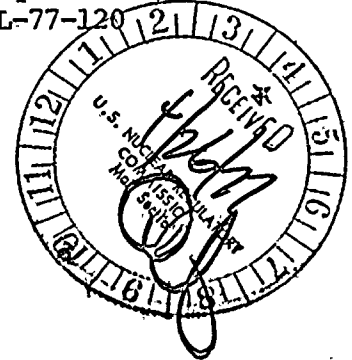

Office of Nuclear Reactor Regulation
Attention: Mr. George Lear, Chief
Operating Reactors Branch #3
Division of Operating Reactors
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

Dear Mr. Lear:

Re: Turkey Point Units 3 and 4
Docket Nos. 50-250 and 50-251
Overpressure Protection

Regulatory

File 023

In accordance with your letter of April 1, 1977, we have implemented the following procedural requirements at Turkey Point Units 3 and 4:

1. While in a solid condition, we will not unnecessarily start a Reactor Coolant Pump (RCP).
2. Prior to necessary RCP starts, we will take the following steps:

If RCS temperature is above 212 F, we will not start a RCP until we verify that steam generator pressure is less than or equal to the saturation pressure corresponding to the RCS temperature.

If RCS temperature is below 212 F, we will not start a RCP until we verify that there is no significant vapor flow from the atmospheric steam dump valves and that the recorded temperature between the hot leg and cold leg for each loop is less than 25 F.

These requirements are now a part of Operating Procedure 0202.1, "Reactor Startup, Cold Condition to Hot Shutdown Conditions".

Very truly yours,

J. A. De Mastry
or

Robert E. Uhrig
Vice President

REU/MAS/cpc

cc: Mr. Norman C. Moseley, Region II
Robert Lowenstein, Esquire



FLORIDA POWER & LIGHT COMPANY
April 21, 1977
L-77-120

Office of Nuclear Reactor Regulation
Attention: Mr. George Lear, Chief
Operating Reactors Branch #3
Division of Operating Reactors
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

Dear Mr. Lear:

Re: Turkey Point Units 3 and 4
Docket Nos. 50-250 and 50-251
Overpressure Protection

In accordance with your letter of April 1, 1977, we have implemented the following procedural requirements at Turkey Point Units 3 and 4:

1. While in a solid condition, we will not unnecessarily start a Reactor Coolant Pump (RCP).
2. Prior to necessary RCP starts, we will take the following steps:

If RCS temperature is above 212 F, we will not start a RCP until we verify that steam generator pressure is less than or equal to the saturation pressure corresponding to the RCS temperature.

If RCS temperature is below 212 F, we will not start a RCP until we verify that there is no significant vapor flow from the atmospheric steam dump valves and that the recorded temperature between the hot leg and cold leg for each loop is less than 25 F.


These requirements are now a part of Operating Procedure 0202.1, "Reactor Startup, Cold Condition to Hot Shutdown Conditions".

Very truly yours,

Robert E. Uhrig
Vice President

REU/MAS/cpc

cc: Mr. Norman C. Moseley, Region II
Robert Lowenstein, Esquire

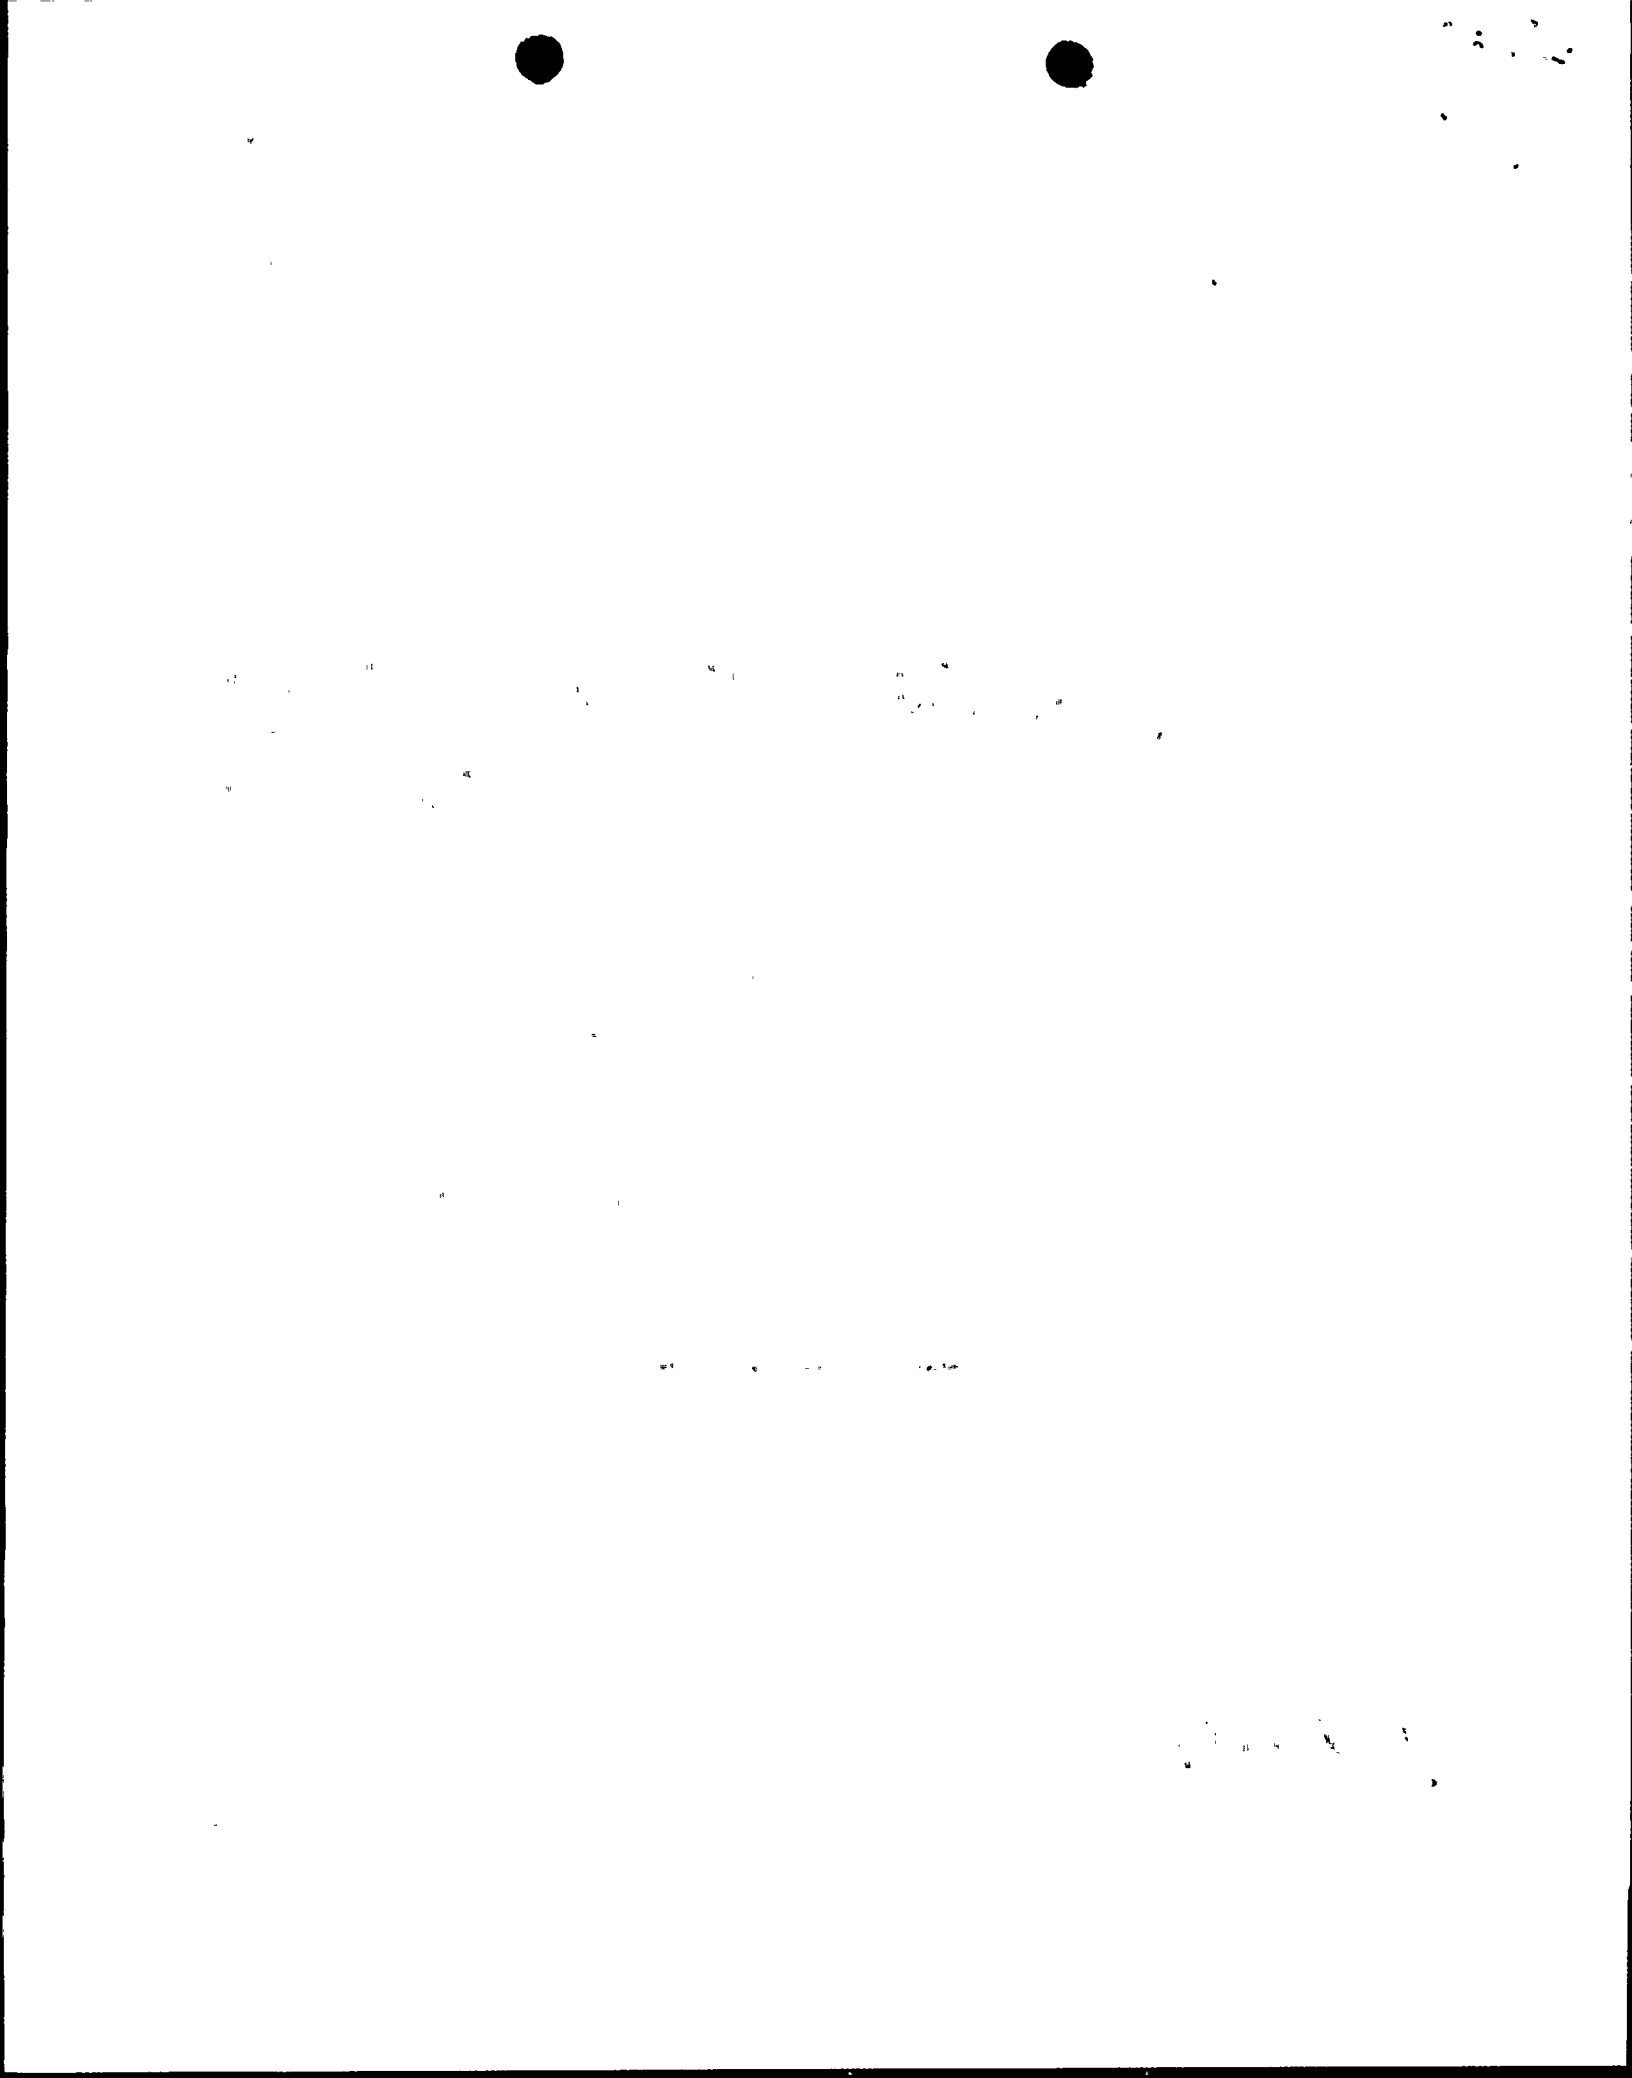



FLORIDA POWER & LIGHT COMPANY
April 21, 1977
L-77-120

APR 21 1977

Office of Nuclear Reactor Regulation
Attention: Mr. George Lear, Chief
Operating Reactors Branch #3
Division of Operating Reactors
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

Dear Mr. Lear:

Re: Turkey Point Units 3 and 4
Docket Nos. 50-250 and 50-251
Overpressure Protection

In accordance with your letter of April 1, 1977, we have implemented the following procedural requirements at Turkey Point Units 3 and 4:

1. While in a solid condition, we will not unnecessarily start a Reactor Coolant Pump (RCP).
2. Prior to necessary RCP starts, we will take the following steps:

If RCS temperature is above 212 F, we will not start a RCP until we verify that steam generator pressure is less than or equal to the saturation pressure corresponding to the RCS temperature.

If RCS temperature is below 212 F, we will not start a RCP until we verify that there is no significant vapor flow from the atmospheric steam dump valves and that the recorded temperature between the hot leg and cold leg for each loop is less than 25 F.

These requirements are now a part of Operating Procedure 0202.1, "Reactor Startup, Cold Condition to Hot Shutdown Conditions".

Very truly yours,

J. A. De Mastroy
or

Robert E. Uhrig
Vice President

REU/MAS/cpc

cc: Mr. Norman C. Moseley, Region II
Robert Lowenstein, Esquire

RECEIVED DOCUMENT
PROCESSING UNIT

1977 APR 25 PM 2.04