

50-251

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL

FILE NUMBER

TO: MR B C RUSCHE

FROM: FPL
MIAMI, FLA
R E UHRIG.....

DATE OF DOCUMENT
8-25-76

DATE RECEIVED
8-27-76

LETTER
 ORIGINAL
 COPY

NOTORIZED
 UNCLASSIFIED

PROP

INPUT FORM

NUMBER OF COPIES RECEIVED

1 Signed

DESCRIPTION

LTR TRANS THE FOLLOWING.....

566
RPT

PLANT NAME: Turkey Point # 4

ENCLOSURE

CONTAINMENT BUILDING INTEGRATED LEAK RATE TEST.....

(15 COPIES ENCLOSURE REC)

DO NOT REMOVE
ACKNOWLEDGED.

SAFETY

FOR ACTION/INFORMATION

ENVIRO

8-30-76 RB

ASSIGNED AD:	
<input checked="" type="checkbox"/> BRANCH CHIEF:	G. LEAR
PROJECT MANAGER:	
<input checked="" type="checkbox"/> LIC. ASST.:	K. PARRISH

ASSIGNED AD:	
BRANCH CHIEF:	
PROJECT MANAGER:	
LIC. ASST.:	

INTERNAL DISTRIBUTION


<input checked="" type="checkbox"/> REG FILE	SYSTEMS SAFETY	PLANT SYSTEMS	SITE SAFETY &
<input checked="" type="checkbox"/> NRC PDR	HEINEMAN	TEDESCO	ENVIRO ANALYSIS
<input checked="" type="checkbox"/> I & E (2)	SCHROEDER	BENAROYA	DENTON & MULLER
OELD		LAINAS	
GOSSICK & STAFF	ENGINEERING	IPPOLITO	ENVIRO TECH.
<input checked="" type="checkbox"/> MIPC (2)	MACCARRY	KIRKWOOD	ERNST
CASE	KNIGHT		BALLARD
<input checked="" type="checkbox"/> HANAUER	SIHWELL	OPERATING REACTORS	SPANGLER
HARLESS	PAWLICKI	STELLO	
			SITE TECH.
PROJECT MANAGEMENT	REACTOR SAFETY	OPERATING TECH.	GAMMILL
BOYD	ROSS	EISENHUT	STERR
P. COLLINS	NOVAK	SHAO	HULMAN
HOUSTON	ROSZTOCZY	BAER	
PETERSON	CHECK	BUTLER	SITE ANALYSIS
MELTZ		GRIMES	VOLLMER
HELTEMES	AT & I		BUNCH
SKOVHOLT	SALTZMAN		J. COLLINS
	RUTBERG		KREGER


EXTERNAL DISTRIBUTION

<input checked="" type="checkbox"/> LPDR: Miami, FL	NAT LAB:	BROOKHAVEN NAT LAB
<input checked="" type="checkbox"/> TIC:	REG. VIE	ULRIKSON(ORNL)
<input checked="" type="checkbox"/> NSIC:	LA PDR	
<input checked="" type="checkbox"/> ASLB:	CONSULTANTS	
<input checked="" type="checkbox"/> ACRS 1 CYS HOLDING SENT	To L. A. K. Parrish.....	

8718

CONTROL NUMBER

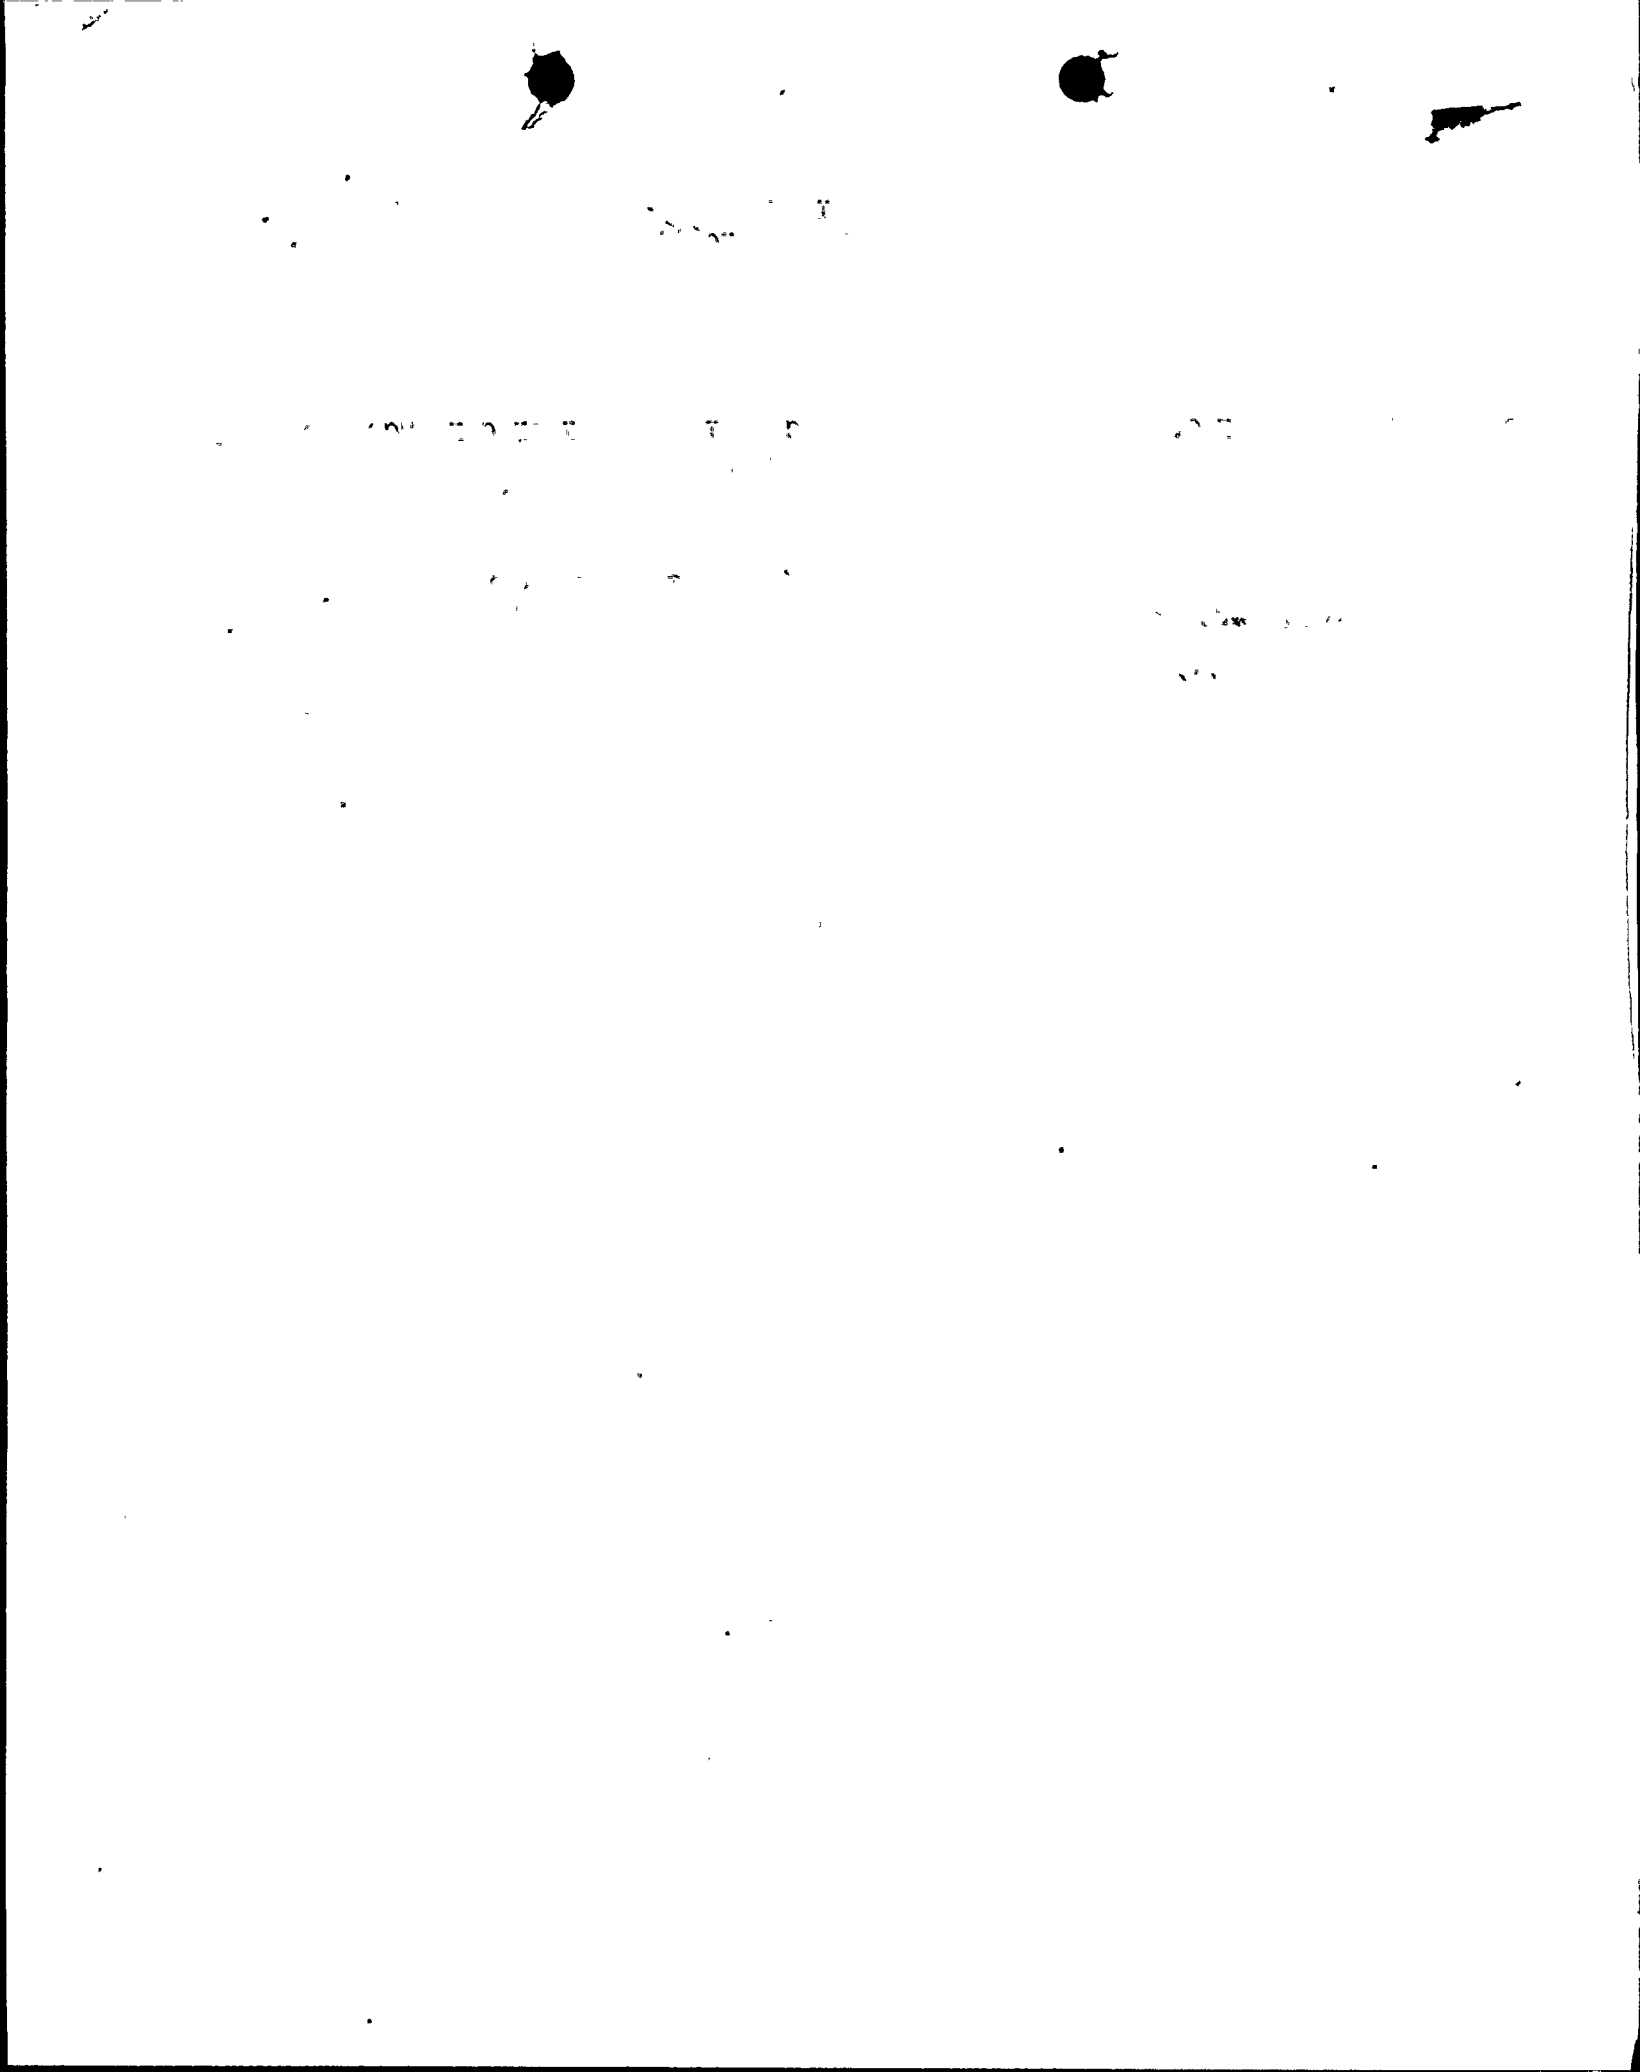

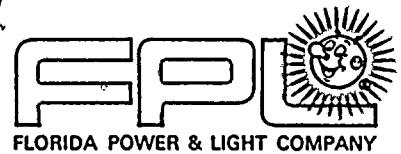


August 25, 1976
L-76-309

Regulatory

File Cya

Mr. Bernard C. Rusche, Director
Office of Nuclear Reactor Regulation
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

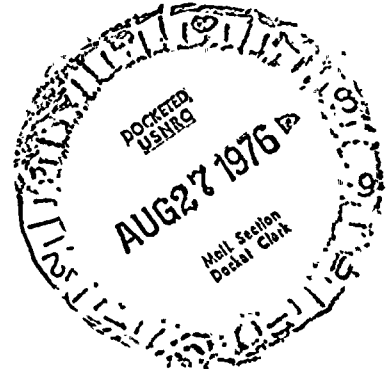

Dear Mr. Rusche:

Re: Turkey Point Unit 4
Docket No. 50-251
Containment Building
Integrated Leak Rate Test

In accordance with Appendix J to 10CFR50 (Primary Reactor Containment Leakage Testing for Water-Cooled Power Reactors) and Regulatory Guide 10.1 (Compilation of Reporting Requirements for Persons Subject to NRC Regulations), fifteen copies of the Summary Technical Report of the Turkey Point Unit 4 Reactor Containment Building Integrated Leak Rate Test are enclosed for your information.

Very truly yours,

J. A. De Mastry
jr

Robert E. Uhrig
Vice President

REU/MAS:mew

Encs.

cc: Jack R. Newman, Esq.
Mr. Norman C. Moseley
Director, Management Information
and Program Control (2)



8718

