

50-250/251

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL

FILE NUMBER

TO:
Mr. George Lear

FROM:
Florida Power & Light Co.
Miami, Florida
Robert E. Uhrig

DATE OF DOCUMENT
8/25/77

DATE RECEIVED
8/31/77

LETTER
 ORIGINAL
 COPY

NOTORIZED
 UNCLASSIFIED

PROP

INPUT FORM

NUMBER OF COPIES RECEIVED

3 SIGNED

DESCRIPTION

ENCLOSURE

Indicates that no chlorine was used at the facility during the period of January 1, 1976 through December 31, 1976.....

ACKNOWLEDGED

DO NOT REMOVE

PLANT NAME: Turkey Point Units 3 & 4
RJL 8/31/77

SAFETY

FOR ACTION/INFORMATION

ENVIRONMENTAL

ASSIGNED AD:

ASSIGNED AD: V. MOORE (LTR)

BRANCH CHIEF:

BRANCH CHIEF:

PROJECT MANAGER:

ELLIOTT

PROJECT MANAGER:

LICENSING ASSESTANT:

LICENSING ASSISTANT:

B. HARLESS

INTERNAL DISTRIBUTION


<input checked="" type="checkbox"/> REG ELLES	SYSTEMS SAFETY	PLANT SYSTEMS	SITE SAFETY &
<input checked="" type="checkbox"/> NRC PDR	R. MATTSON	TEDESCO	ENVIRON ANALYSIS
T & E	SCHROEDER	BENAROYA	DENTON & MULLER
OELD		LAINAS	CRUTCHFIELD
GOSSICK & STAFF	ENGINEERING	IPPOLITO	
HANAUER	KNIGHT	F. ROSA	ENVIRO TECH.
MTPC	BOSNAK		ERNST
CASE	SIHWELL	OPERATING REACTORS	BALLARD
ROYD	PAWLICKI	STELLO	YOUNGBLOOD
		EISENHUT	
PROJECT MANAGEMENT	REACTOR SAFETY	SHAO	SITE TECH.
SKOVHOLT	ROSS	BAER	
P. COLLINS	NOVAK	BUTLER	GAMMILL (2)
HOUSTON	ROSZTGCZY	GRIMES	
MELTZ	CHECK		SITE ANALYSIS
HELTEMES			VOLLMER
SK	AT&I		BUNCH
	SALTZMAN		J. COLLINS
	RUTBERG		KREGER

EXTERNAL DISTRIBUTION

CONTROL NUMBER

<input checked="" type="checkbox"/> LPDR: MIAMI FLA.			
TIC	NSIC		
NAT LAB			
REG IV (J. HANCHETT)			
16 CYS ACRS SENT CATEGORY			

13
772430304
MAY

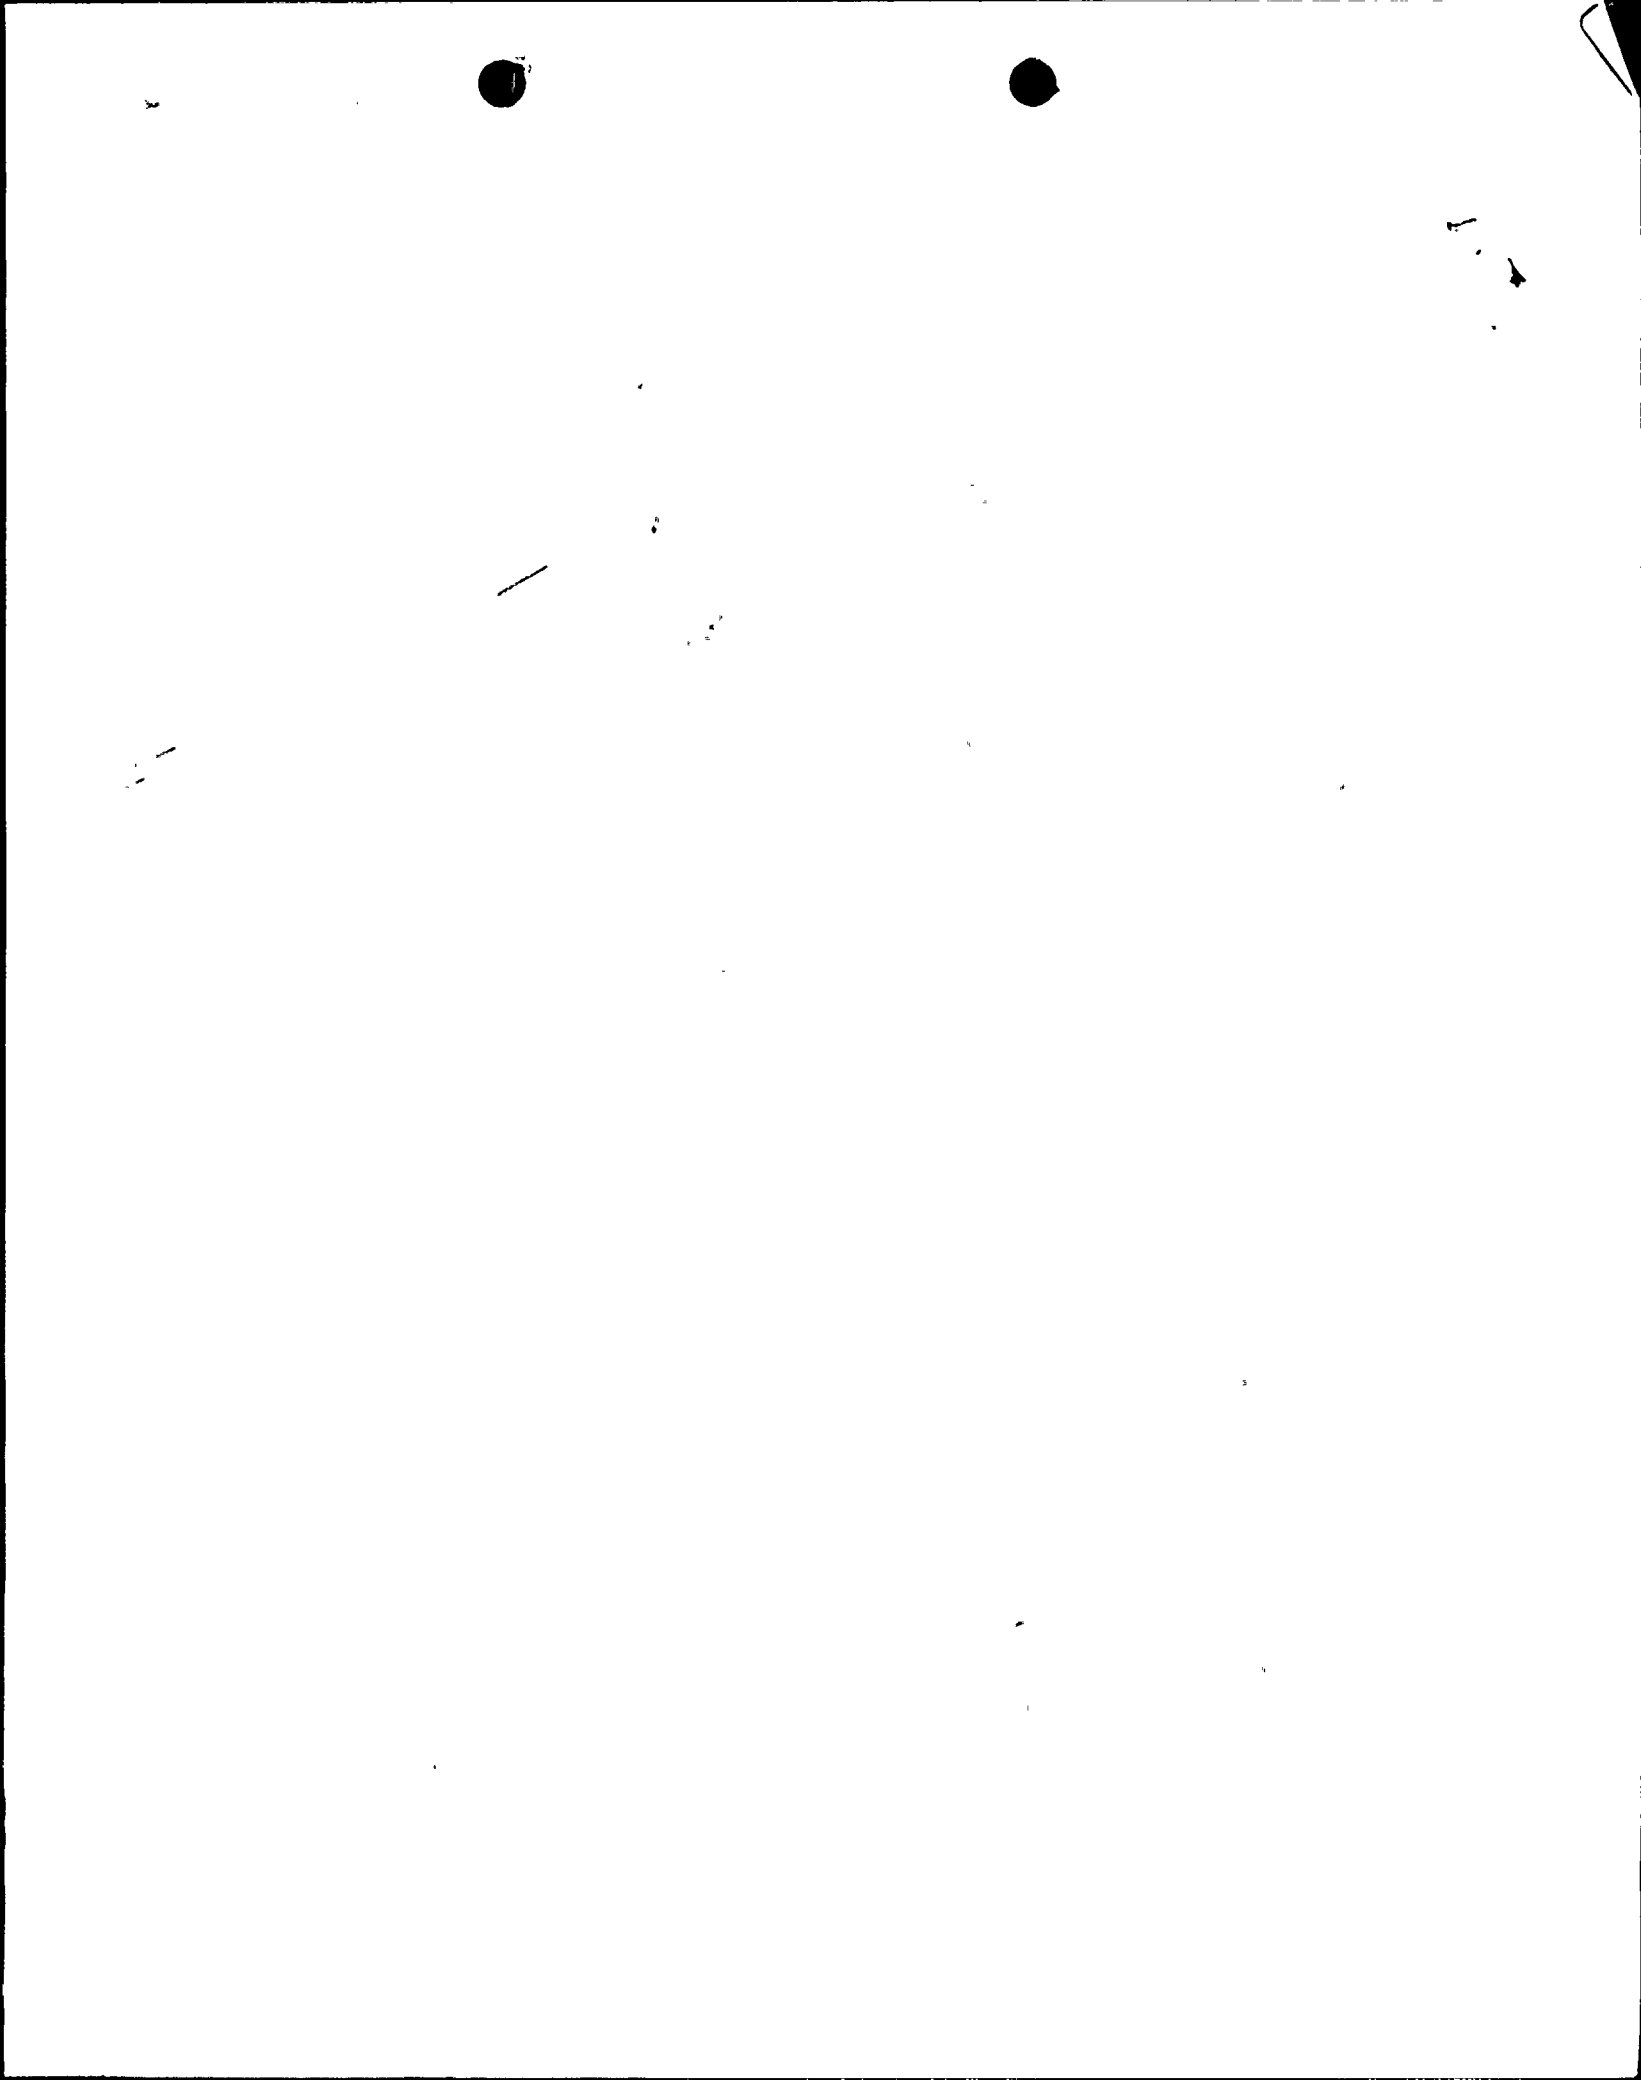




August 25, 1977
L-77-258

Regulatory FILE COPY

Office of Nuclear Reactor Regulation
Attention: Mr. George Lear, Chief
Operating Reactors Branch #3
Division of Operating Reactors
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

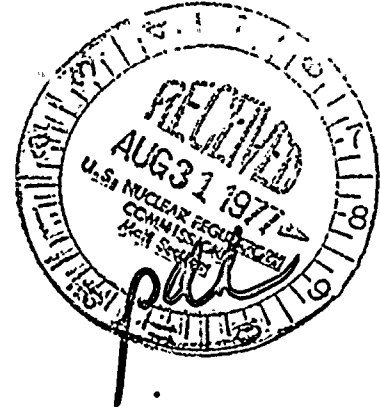

Dear Mr. Lear:

Re: Turkey Point Units 3 and 4
Docket Nos. 50-250 and 50-251
Chlorine Usage

Your letter of July 11, 1977 requested chlorine monitoring data from our Turkey Point nuclear power plant for the report period January 1, 1976 through December 31, 1976. No chlorine was used at the nuclear facility during that period.

Very truly yours,

Robert E. Uhrig
Robert E. Uhrig
Vice President

REU/MAS/cpc

cc: Mr. J. P. O'Reilly, Region II
Robert Lowenstein, Esquire

772430304

