

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL

FILE NUMBER

TO: Mr. V. Stello

FROM: FPL
Miami, Fla. 33101
R.E. Uhrig

DATE OF DOCUMENT
3-22-76
DATE RECEIVED
3-29-76

LETTER
 ORIGINAL
 COPY

NOTORIZED
 UNCLASSIFIED

PROP
INPUT FORM

NUMBER OF COPIES RECEIVED
3 Orig & 37 CC

DESCRIPTION Ltr requesting for amdt to ~~XXXX~~ App A of OL/DPR-31 & DPR-41 related to hydraulic snubbers & trans the following:

PLANT NAME: Turkey Pt. Units 3 & 4


ENCLOSURE Revised & addl pages to Proposed Change in re to hydraulic snubbers...

(40 cys encl rec'd)

SAFETY		FOR ACTION/INFORMATION		ENVIRO	
ASSIGNED AD :		ASSIGNED AD :		DHL 3-30-76	
BRANCH CHIEF :	(6) LEAR	BRANCH CHIEF :			
PROJECT MANAGER:	ELLIOTT	PROJECT MANAGER :			
LIC. ASST. :	PARRISH	LIC. ASST. :			

INTERNAL DISTRIBUTION				
REG FILE - LTR-251	SYSTEMS SAFETY	PLANT SYSTEMS	ENVIRO TECH	
NRC PDR - LTR-251	HEINEMAN	TEDESCO	ERNST	
I & E (2)	SCHROEDER	BENAROYA	BALLARD	
OELD		LAINAS	SPANGLER	
GOSSICK & STAFF	ENGINEERING	IPPOLITO		
MIPC	MACCARY		SITE TECH	
CASE	KNIGHT	OPERATING REACTORS	GAMMILL	
HANAUER	SIHWEIL	STELLO	STEPP	
HARLESS	PAWLICKI		HULMAN	
		OPERATING TECH		
PROJECT MANAGEMENT	REACTOR SAFETY	EISENHUT	SITE ANALYSIS	
BOYD	ROSS	SHAO	VOLLNER	
P. COLLINS	NOVAK	BAER	BUNCH	
HOUSTON	ROSZTOCZY	SCHWENCER	J. COLLINS	
PETERSON	CHECK	GRIMES	KREGER	
MELTZ				
HELTEMES	AT & I	SITE SAFETY & ENVIRO		
SKOVHOLT	SALTZMAN	ANALYSIS		
	RUTBERG	DENTON & MULLER		

EXTERNAL DISTRIBUTION			CONTROL NUMBER
LPDR: Miami, Fla.	NATL. LAB	BROOKHAVEN NATL LAB	3107
TIC	REG. V-IE	ULRIKSON(ORNL)	
NSIC	LA PDR		
ASLB	CONSULTANTS		
ACRS 16/16/76 SENT TO L.A.			

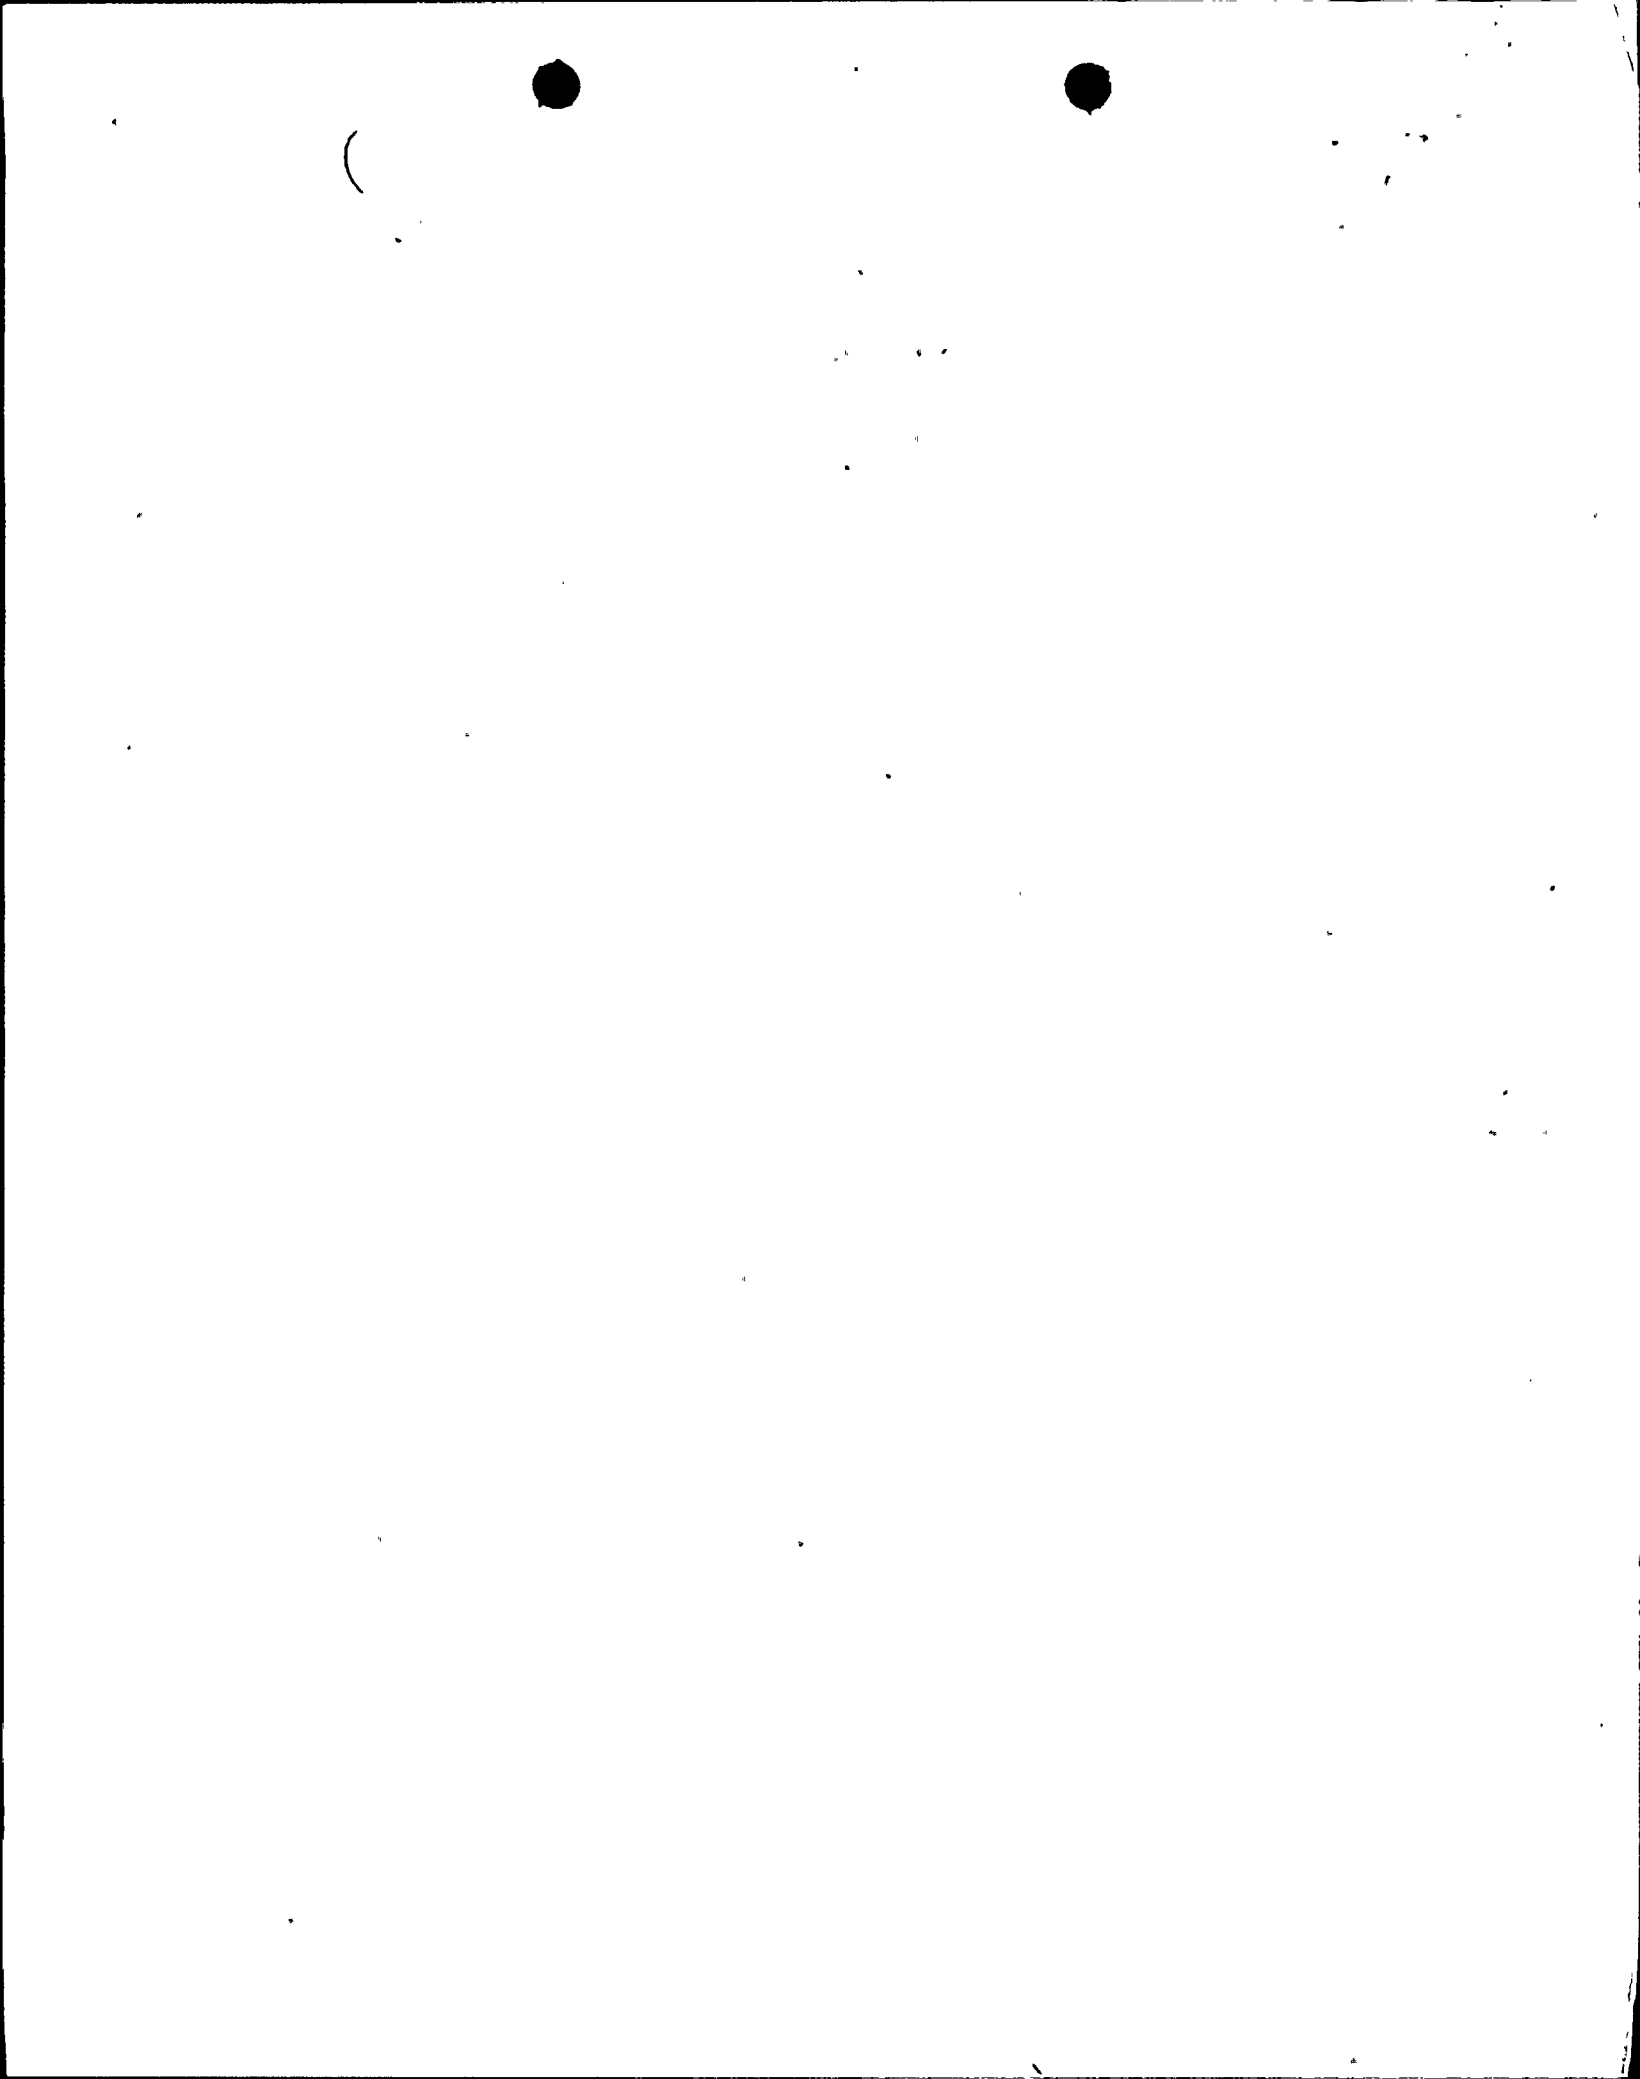



March 22 , 1976

L-76-119

Regulatory Docket File

Director of Nuclear Reactor Regulation
 Attention: Mr. Victor Stello, Jr., Director
 Division of Operating Reactors
 U. S. Nuclear Regulatory Commission
 Washington, D. C. 20555

Dear Mr. Stello:

Re: Turkey Point Units 3 and 4
 Docket Nos. 50-250 and 50-251
 Proposed Amendment to Facility
 Operating Licenses DPR-31 and DPR-41



In accordance with 10 CFR 50.30, Florida Power & Light Company submits herewith three (3) signed originals and forty (40) conformed copies of a request to amend Appendix A of Facility Operating Licenses DPR-31 and DPR-41.

This submittal proposes Technical Specification changes relating to the surveillance of safety-related hydraulic snubbers at Turkey Point Units 3 and 4. The proposal supplements and modifies our proposal of November 6, 1974 and is based on model Technical Specifications transmitted to Florida Power & Light Company by your staff on December 24, 1975.

The proposed Technical Specification changes are as described below and as shown in the accompanying Technical Specification pages bearing the date of this letter in the lower right hand corner.

Page ii

The Table of Contents is revised to include Sections 3.12 and 4.14.

Page iii

The Table of Contents is revised to include Sections B3.12 and B4.14.

Page iv

The List of Tables is revised to include Table 3.12-1.

3107

Page 3.12-1

A new specification 3.12 is added to define the limiting conditions for operation applied to the operability of safety-related hydraulic snubbers.

Table 3.12-1, Sheets 1 through 4

A new Table 3.12-1 is added to identify all safety-related hydraulic snubbers on Units 3 and 4. The table has four categories which identify snubbers that are (a) in high radiation areas, (b) especially difficult to remove, (c) inaccessible during normal operation, and (d) accessible during normal operation. There are currently no hydraulic snubbers which fall in three of the four categories, however, these categories are included for ease of future amendment should hydraulic snubbers ever be installed in such areas.

Although they are not inaccessible during power operation, it is proposed that hydraulic snubbers located inside containment be inspected independently from those outside containment in order to prevent unnecessary radiation exposure to those personnel who perform snubber inspections. Historically, most inoperable snubbers have been found outside containment, therefore, flexibility in this Technical Specification is considered advisable to preclude unnecessary containment entry during power operation.

Pages 4.14-1 and 4.14-2

A new specification 4.14 is added to designate the surveillance requirements applicable to safety-related hydraulic snubbers.

Pages B3.12-1 and B3.12-2

A new section B3.12 is added to provide bases for new specification 3.12.

Page B4.14-1

A new section B4.14 is added to provide bases for new specification 4.14.

The proposed amendment has been reviewed and the conclusion reached that it does not involve a significant hazards consideration, therefore, prenoticing pursuant to 10 CFR 2.105 should not be required.




[Faint, illegible handwritten mark]

Director of Nuclear Reactor Regulation
Page Three
March 22, 1976

We request that, upon approval of this proposed amendment, the snubber inspection reporting requirements of the Directorate of Licensing letter of November 8, 1973 from R. C. DeYoung to Robert E. Uhrig be eliminated.

Very truly yours,



Robert E. Uhrig
Vice President

REU/MAS/cpc

Attachment

cc: Mr. Norman C. Moseley
Jack R. Newman, Esquire

