


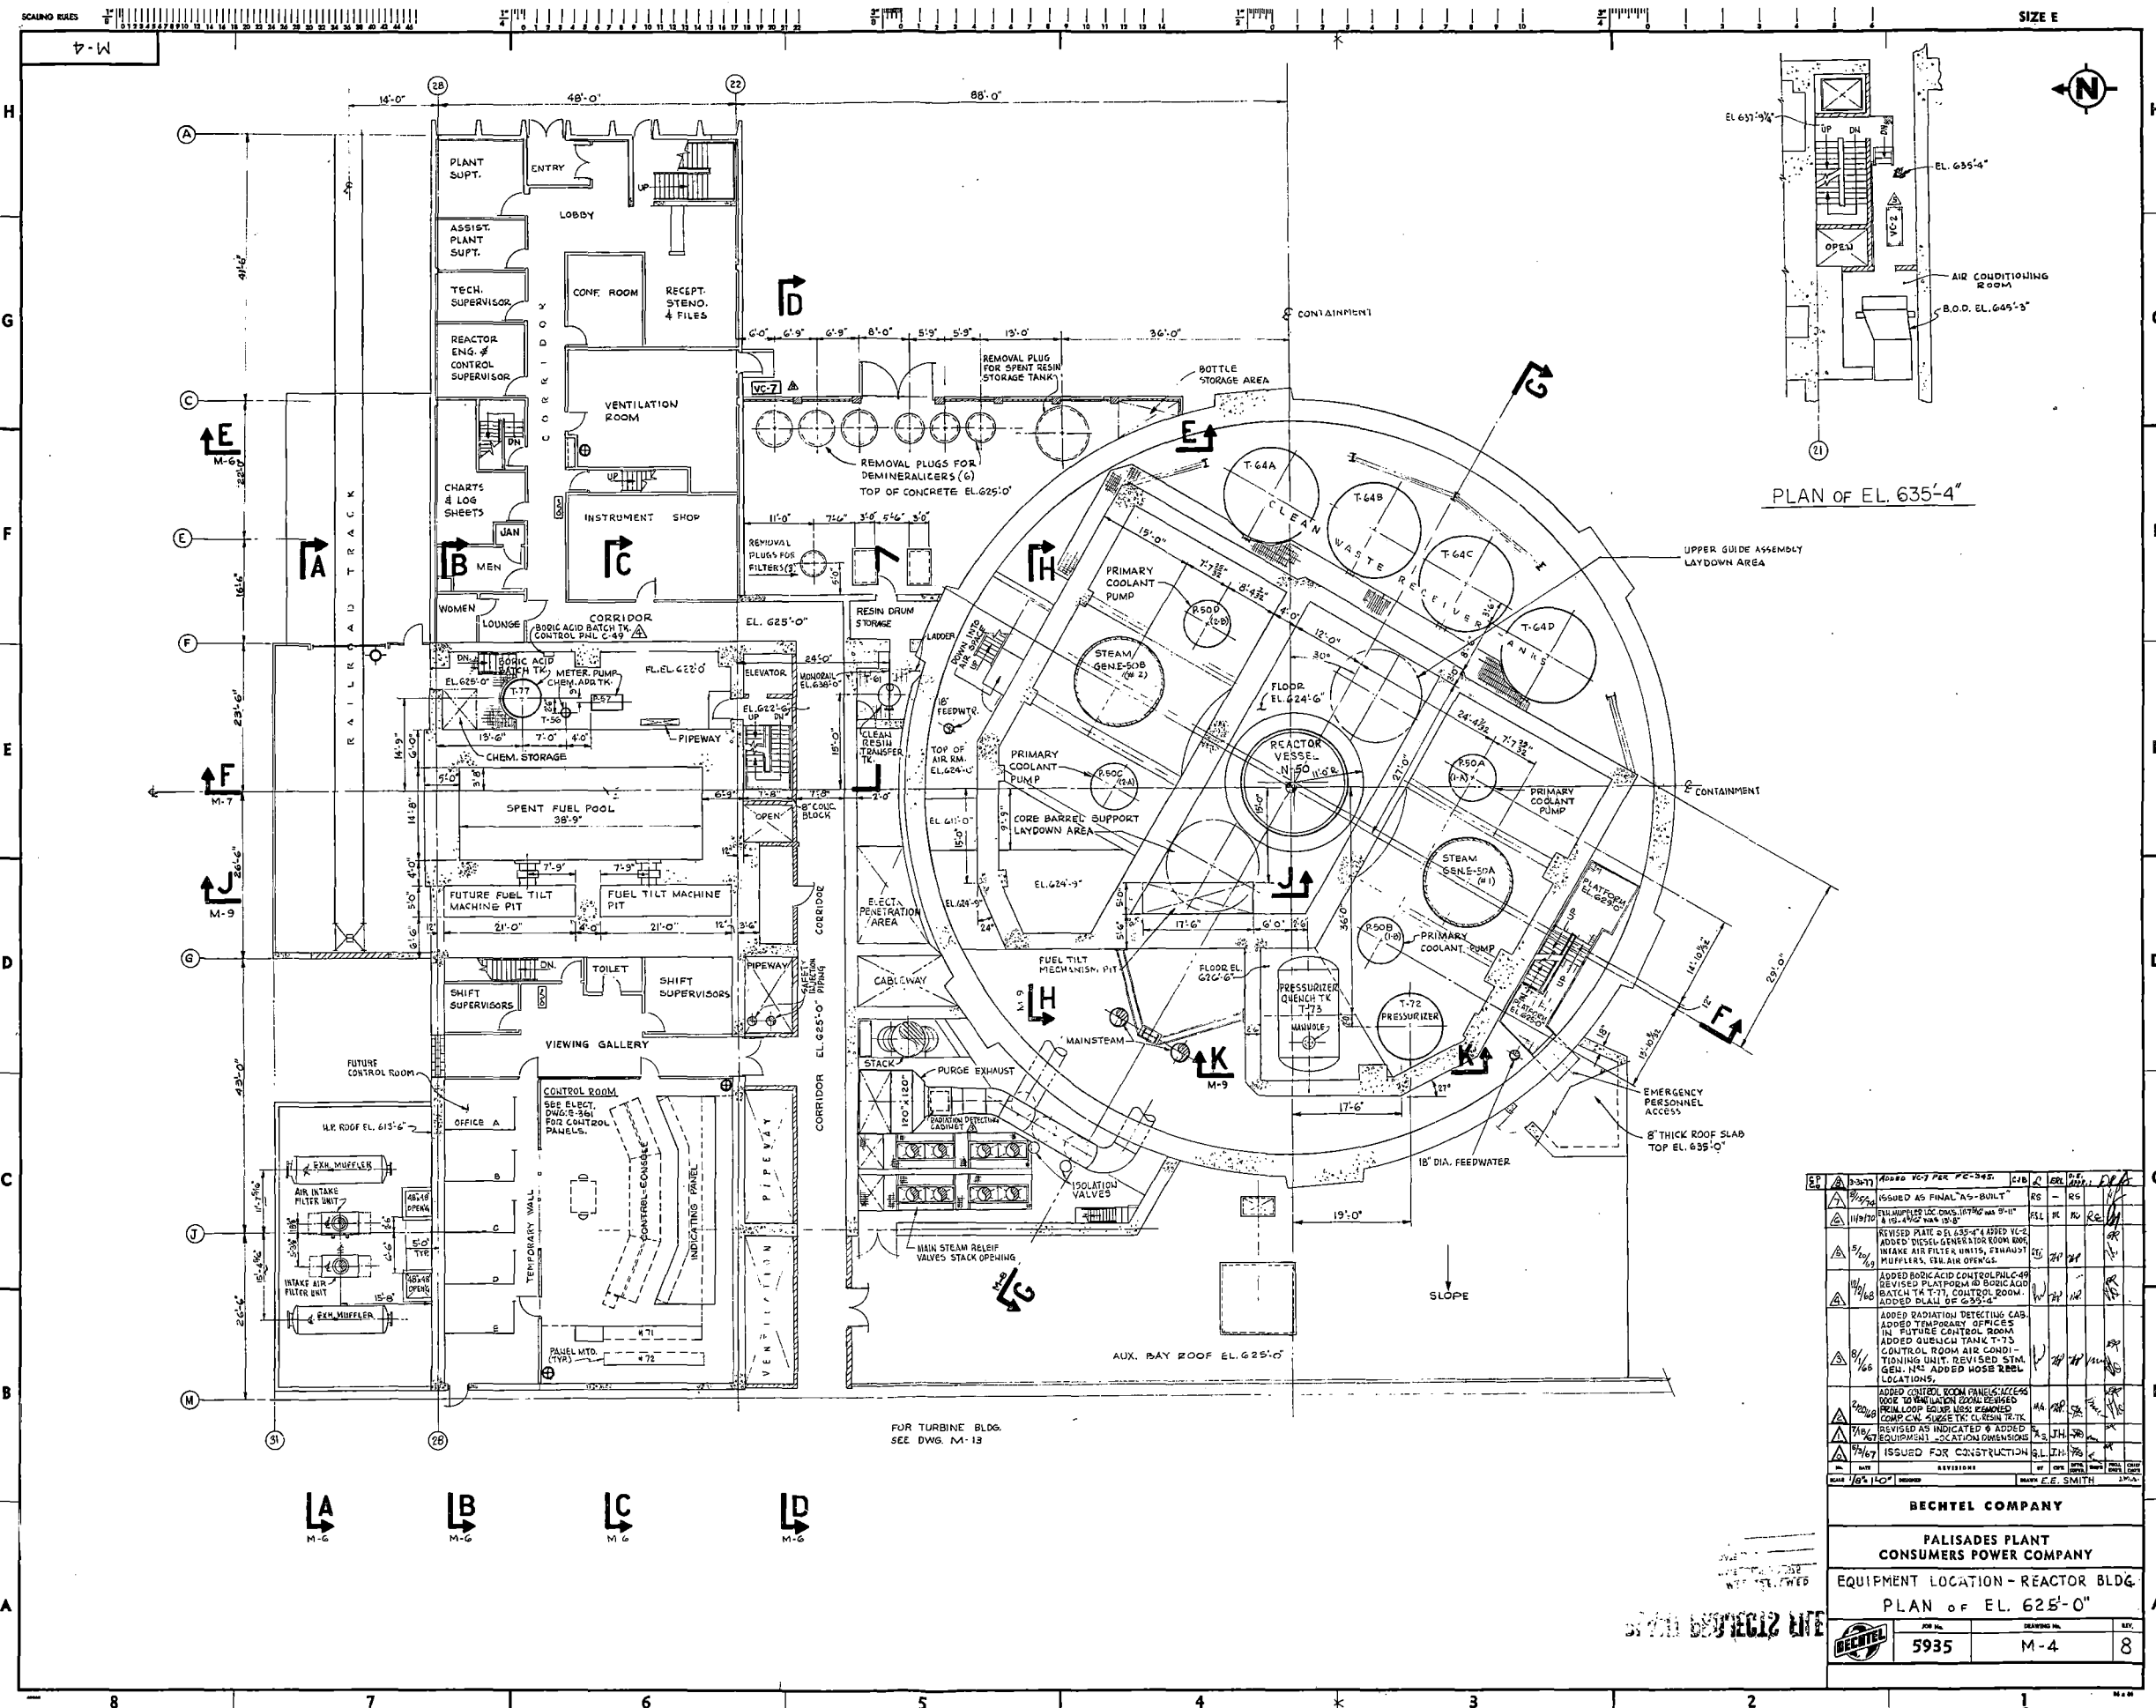

REV	DATE	DESCRIPTION	BY	CHKD	APP'D
1	10/1/67	ISSUED AS FINAL "AS-BUILT"	RS	RS	
2	11/1/70	EXHAUSTS LOC. CHG. 14790 WAS 9'-10" & 15'-4 1/2" WAS 15'-8"	SL	SL	RS
3	1/1/69	REVISED PLAT. 6 EL. 635'-4" (ADDED VC-2, ADDED DIESEL GENERATOR ROOM BING, WAKE AIR FILTER UNITS, EXHAUST MUFFLERS, 110 AIR OPEN'GS)	SL	SL	RS
4	11/1/68	ADDED BODIC ACID CONTROL PANEL C-49, REVISED PLATFORM 65 BODIC ACID BATCH TA T-71, CONTROL ROOM, ADDED PLAT. 65 65'-4"	SL	SL	RS
5	8/1/68	ADDED RADIATION DETECTING CAB., ADDED TEMPORARY OFFICES IN FUTURE CONTROL ROOM, ADDED QUENCH TANK T-73, CONTROL ROOM AIR CONDITIONING UNIT, REVISED SLM GEN. NO. ADDED HOSE REEL LOCATIONS.	SL	SL	RS
6	2/20/69	ADDED CONTROL ROOM PANELS, 110 REEL ROOM TO VENTILATION ROOM, REVISED FROM LOOP EQUIP. USED REMOVED COMP. C.W. PLUGS TO CLEAN TR. TK.	SL	SL	RS
7	7/1/67	REVISED AS INDICATED & ADDED EQUIPMENT LOCATIONS DIMENSIONS	SL	SL	RS
8	7/1/67	ISSUED FOR CONSTRUCTION	SL	SL	RS

BECHTEL COMPANY
PALISADES PLANT
CONSUMERS POWER COMPANY
EQUIPMENT LOCATION - REACTOR BLDG.
PLAN OF EL. 625'-0"

5935	M-4	8
------	-----	---