



**UNITED STATES
NUCLEAR REGULATORY COMMISSION**
WASHINGTON, D.C. 20555-0001

February 25, 2019

Mr. David B. Hamilton
Site Vice President
FirstEnergy Nuclear Operating Company
Mail Stop A-PY-A290
P.O. Box 97, 10 Center Road
Perry, OH 44081-0097

**SUBJECT: PERRY NUCLEAR POWER PLANT, UNIT NO. 1 – CORRECTION TO
AMENDMENT NO. 168 TO FACILITY OPERATING LICENSE CONCERNING
CHANGES TO PRESSURE AND TEMPERATURE CURVES**

Dear Mr. Hamilton:

On June 12, 2015, the U.S. Nuclear Regulatory Commission (NRC) issued Amendment No. 168 to Facility Operating License No. NPF-58 for Perry Nuclear Power Plant, Unit No. 1 (Agencywide Documents Access and Management System (ADAMS) Accession No. ML15141A482).

On January 15, 2019, the NRC staff identified an error on Technical Specification (TS) pages 3.4.-31, 3.4-31a, and 3.4-31b issued with Amendment No. 168. Specifically, on each pressure and temperature figure (Figures 3.4.11-1(a), 3.4.11-1(b), and 3.4.11-1(c)), the note box regarding the heatup/cooldown rate specified the rate as a temperature per hour. However, the license amendment request, dated June 23, 2014, specified the heatup/cooldown rate as a temperature limit "in any one hour period."

The NRC staff concludes that the error was inadvertently introduced during the preparation of the license amendment and is editorial in nature. The correction does not change any of the conclusions in the safety evaluation associated with the amendment and does not affect the associated notice to the public. Enclosed, please find the corrected replacement TS pages.

Sincerely,

A handwritten signature in black ink, appearing to read "Kimberly J. Green".

Kimberly J. Green, Senior Project Manager
Plant Licensing Branch III
Division of Operating Reactor Licensing
Office of Nuclear Reactor Regulation

Docket No. 50-440

Enclosure: Corrected TS pages

cc w/encl: ListServ

ENCLOSURE

PERRY NUCLEAR POWER PLANT, UNIT NO. 1

DOCKET 50-440
FACILITY OPERATING LICENSE NO. NPF-58

CORRECTED PAGES TO LICENSE AMENDMENT NO. 168

Technical Specification pages 3.4-31, 3.4-31a, and 3.4-31b

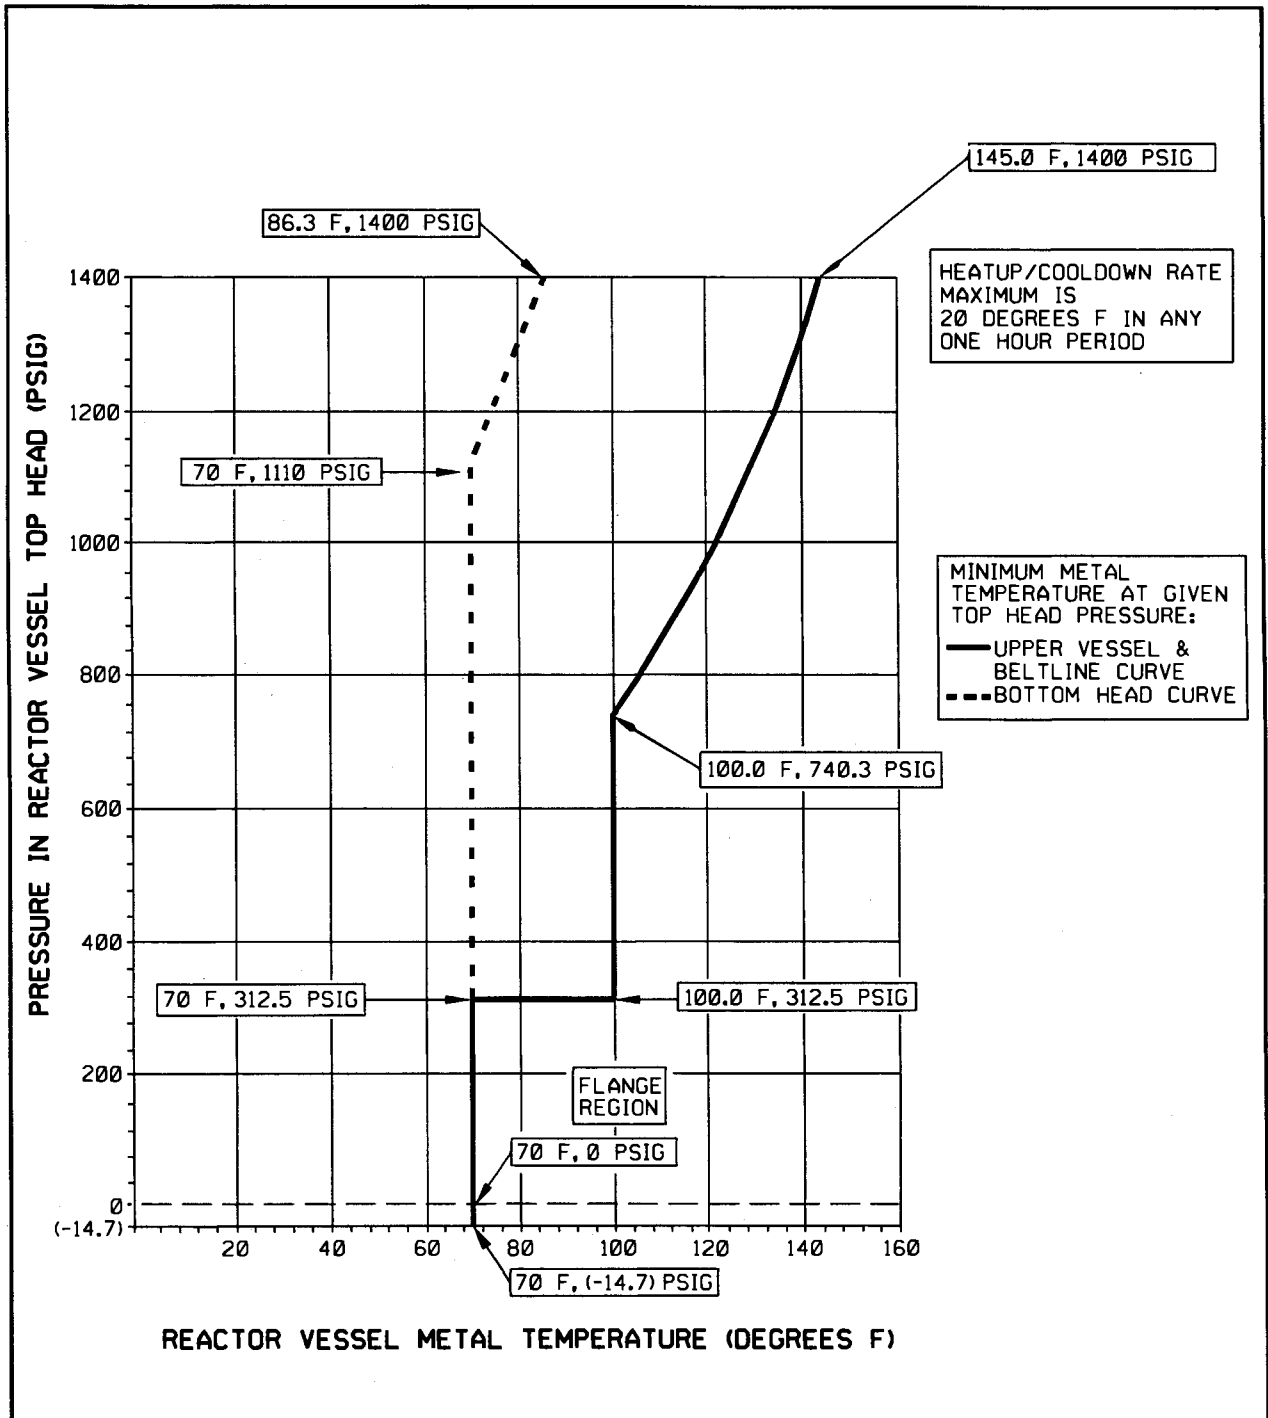


FIGURE 3.4.11-1(a): PRESSURE TEST CURVES (VALID UP TO 32 EFPY)

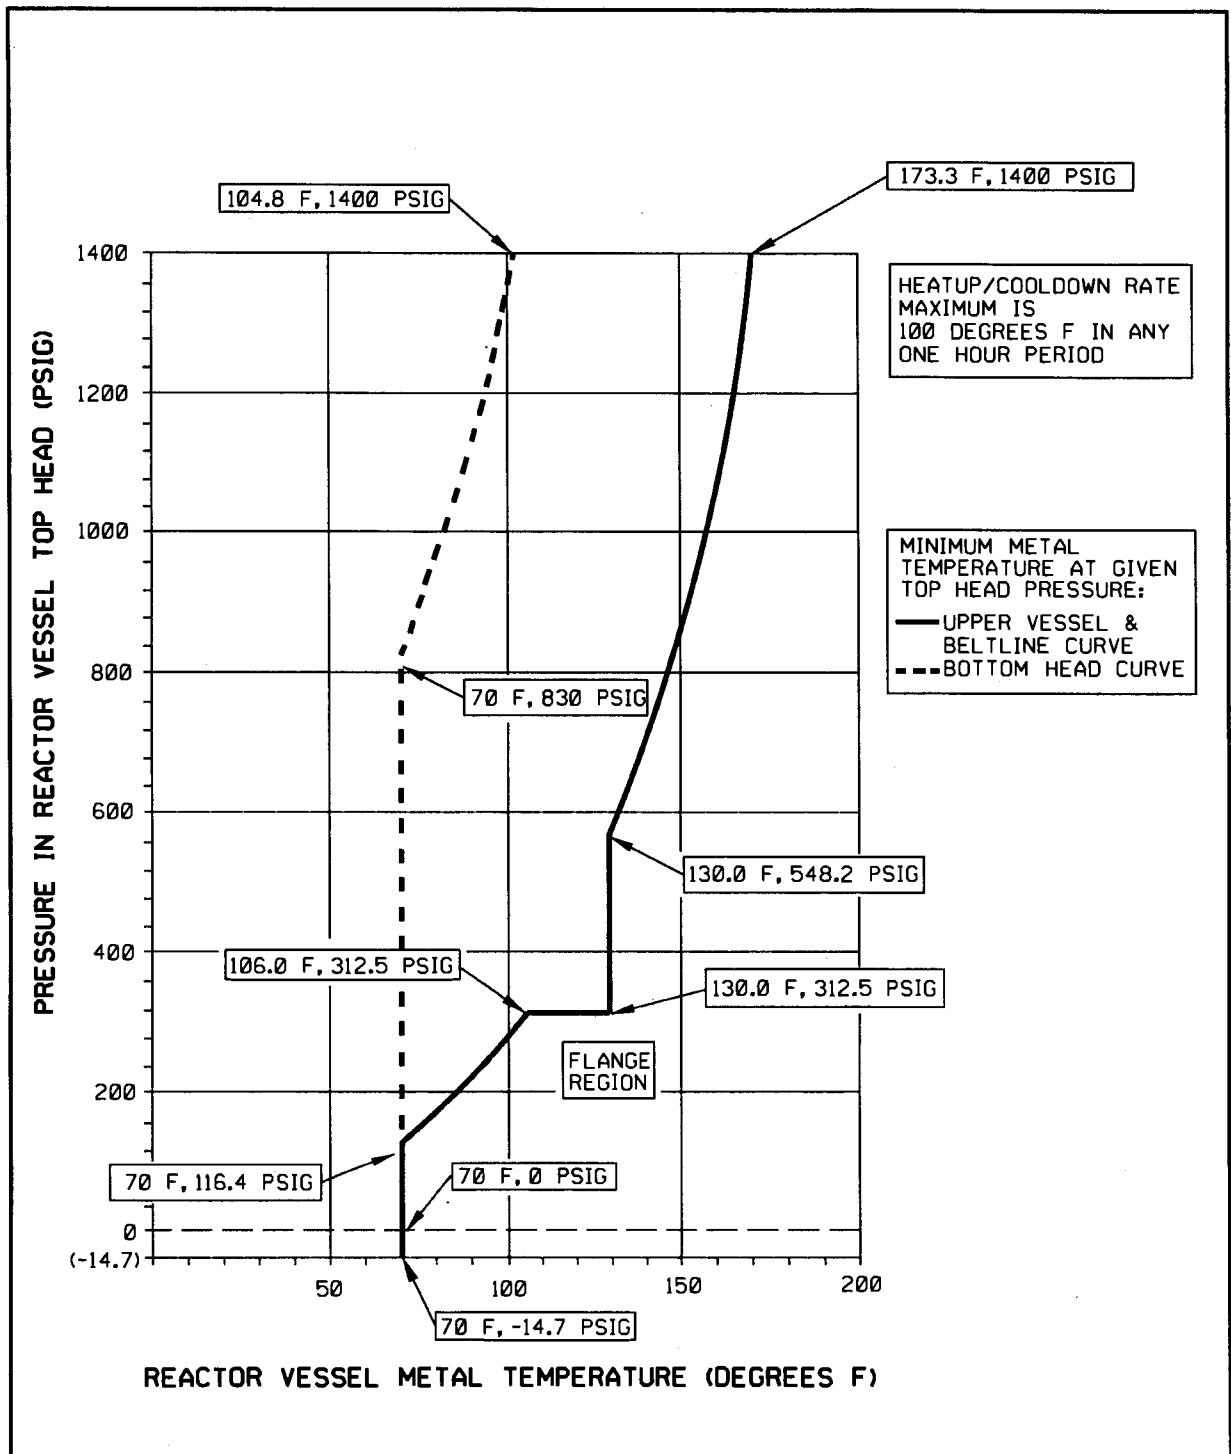


FIGURE 3.4.11-1(b): NON-NUCLEAR HEATUP/COOLDOWN CURVES (VALID UP TO 32 EFY)

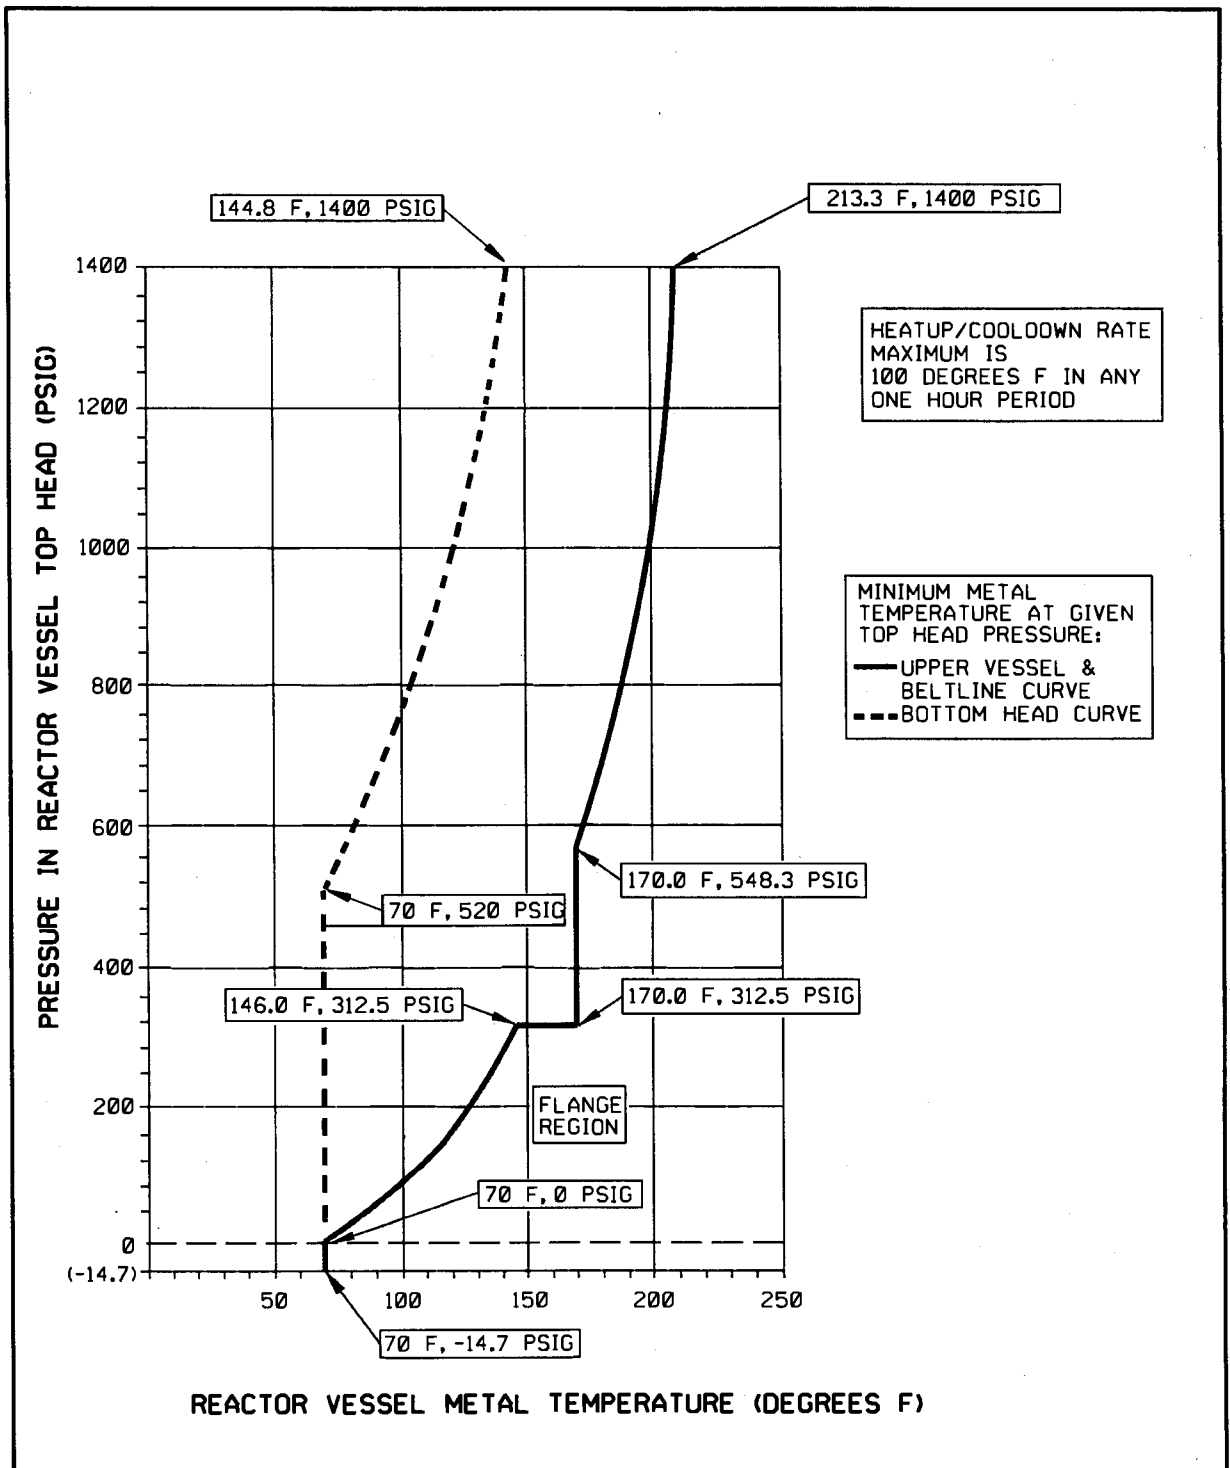


FIGURE 3.4.11-1(c): CORE CRITICAL OPERATION CURVES (VALID UP TO 32 EFPY)

SUBJECT: PERRY NUCLEAR POWER PLANT, UNIT NO. 1 – CORRECTION TO
AMENDMENT NO. 168 TO FACILITY OPERATING LICENSE CONCERNING
CHANGES TO PRESSURE AND TEMPERATURE CURVES
DATED FEBRUARY 25, 2019

DISTRIBUTION:

PUBLIC

RidsAcrs_MailCTR Resource

RidsNrrDssStsb Resource

RidsNrrDorlLpl3 Resource

RidsNrrDssSrxs Resource

RidsNrrDmlrMvib Resource

RidsNrrPMPerry Resource

RidsNrrLASRohrer Resource

RidsRgn3MailCenter Resource

ADAMS Accession No.: ML19016A008

OFFICE	NRR/DORL/LPL3/PM	NRR/DORL/LPL3/LA	NRR/DORL/LPL3/BC	NRR/DORL/LPL3/PM
NAME	KGreen	SRohrer	DWrona	KGreen
DATE	01/16/19	01/16/19	02/22/19	02/25/19

OFFICIAL RECORD COPY