

**NRC DISTRIBUTION FOR PART 50 DOCUMENT MATERIAL
(TEMPORARY FORM)**

CONTROL NO: 7857
FILE: _____

FROM: Virginia Electric Power Co Richmond, Virginia C.M. Stallings		DATE OF DOC 7-22-75	DATE REC'D 7-24-75	LTR XXX	TWX	RPT	OTHER
TO: K.R. Goller		ORIG 1 Signed	CC	OTHER	SENT NRC PDR <u>XXXX</u> SENT LOCAL PDR <u>XXXX</u>		
CLASS	UNCLASS XXXXX	PROP INFO	INPUT	NO CYS REC'D 1	DOCKET NO: 50-280/281		
DESCRIPTION: Re required certain modifications to ECCS as a condition of issuance of an amd't to our O/L following the refueling of Unit 2... Advising of changes proposed & the schedule for implementing them.....				ENCLOSURES:			
PLANT NAME: Surry 1 & 2				<p>ACKNOWLEDGED DO NOT REMOVE</p>			

FOR ACTION/INFORMATION

VCR 7-29-75

BUTLER (L) W/ Copies	SCHWENCER (L) W/ Copies	ZIEMANN (L) W/ Copies	REGAN (E) W/ Copies
CLARK (L) W/ Copies	STOLZ (L) W/ Copies	DICKER (E) W/ Copies	LEAR (L) W/ Copies
PARR (L) W/ Copies	VASSALLO (L) W/ Copies	KNIGHTON (E) W/ Copies	SPIES W/ Copies
KNIEL (L) W/ Copies	PURPLE (L) W/ Copies	YOUNGBLOOD (E) W/ Copies	LPM W/ Copies

INTERNAL DISTRIBUTION



REG FILE NRC PDR	TECH REVIEW SCHROEDER	DENTON GRIMES	LIC ASST R. DIGGS (L)	A/T IND. BRAITMAN
OGC, ROOM P-506A	MACCARY	GAMMILL	H. GEARIN (L)	SALTZMAN
GOSSICK/STAFF	KNIGHT	KASTNER	E. GOULBOURNE (L)	MELTZ
CASE	PAWLICKI	BALLARD	P. KREUTZER (E)	
GIAMBUSSO	SHAO	SPANGLER	J. LEE (L)	PLANS
BOYD	STELLO		M. RUJHBROOK (L)	MCDONALD
MOORE (L)	HOUSTON	ENVIRO	S. REED (E)	CHAPMAN
DEYOUNG (L)	NOVAK 3	MULLER	M. SERVICE (L)	DUBE (Ltr)
SKOVHOLT (L)	ROSS	DICKER	S. SHEPPARD (L)	E. COUPE
GOLLER (L) (Ltr)	IPPOLITO	KNIGHTON	M. SLATER (E)	PETERSON
P. COLLINS	TEDESCO	YOUNGBLOOD	H. SMITH (L)	HARTFIELD (2)
DENISE	J. COLLINS	REGAN	S. TEETS (L)	KLECKER
REG OPR	LAINAS	PROJECT LDR	G. WILLIAMS (E)	EISENHUT
FILE & REGION (2)	BENAROYA		V. WILSON (L)	WIGGINTON
MIPC	VOLLMER	HARLESS	R. INGRAM (L)	<i>- Targa</i>
			M. DUNCAN (E)	

EXTERNAL DISTRIBUTION

- | | | |
|--|--------------------------------|------------------------|
| 1 - LOCAL PDR <i>Williamsburg, Va.</i> | 1 - NATIONAL LABS | 1 - PDR-SAN/LA/NY |
| 1 - TIC (ABERNATHY) (1)(2)(10) | 1 - W. PENNINGTON, Rm E-201 GT | 1 - BROOKHAVEN NAT LAB |
| 1 - NSIC (BUCHANAN) | 1 - CONSULTANTS | 1 - G. ULRIKSON ORNL |
| 1 - ASLB | NEWARK/BLUME/AGBABIAN | |
| 1 - Newton Anderson | | |
| 1 - ACRS HOLDING SENT <i>Sheppard</i> | | |

VIRGINIA ELECTRIC AND POWER COMPANY
 RICHMOND, VIRGINIA 23261

July 22, 1975

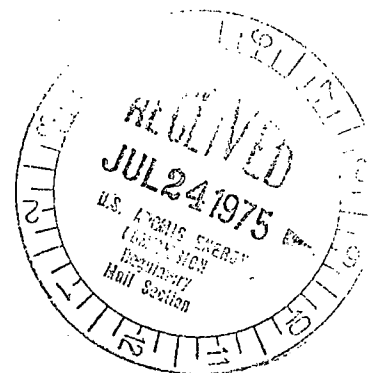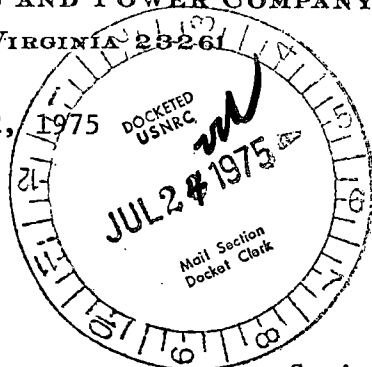

Mr. K. R. Goller, Assistant Director
 for Operating Reactors
 Division of Reactor Licensing
 Office of Nuclear Reactor Regulation
 U.S. Nuclear Regulatory Commission
 Washington, D. C. 20555

Serial No. 571/061675
 PO&M/JTB:clw

Docket Nos. 50-280
 50-281
 License Nos. DPR-32
 DPR-37

Dear Mr. Goller:

You recently required that certain modifications be made to the emergency core cooling system (ECCS) of the Surry Power Station, Unit Nos. 1 and 2, as a condition of issuance of an amendment to our operating license following the refueling of Unit No. 2. The purpose of this letter is to briefly describe the changes proposed and the schedule for implementing them.


To assure that the ECCS satisfies the criteria which you imposed as a condition for returning to power following refueling, we propose to make two modifications. First, we plan to remove the single motor operated valve and check valve, MOV 862 and CS-25, respectively, from the pipe line from the refueling water storage tank (RWST) to the suction of the low head safety injection (LHSI) pumps and to install a check valve and motor operated valve in each of the branch lines to the low head safety injection pumps after the single line from the RWST ties into them. As used above, remove does not necessarily mean the physical removal of the valve body from the pipe line, but may involve the removal of the valve internals which would prohibit them from functioning as valves. Secondly, the motor operated valves in the recirculation line from the LHSI pumps to the RWST will be made series valves in each line from each of the two pumps. This will involve the installation of an additional motor operated valve and piping changes.

The changes will be designed to the applicable requirements to assure they satisfy the single failure criterion. Upon the completion of the modifications described herein, the present interim measures in effect will be terminated. These interim measures to be terminated will be the de-energization of MOV's 1862, 2862, 1860A, 1860B, 2860A, 2860B, 1885C and 2885C.

The subject modifications are currently being engineered. A preliminary review of the modifications can be made during the next refueling outage of Unit Nos. 1 and 2, scheduled for October 1975 and April 1976, respectively. If material availability does not permit this schedule to be achieved, the work would be done at the next scheduled refueling outage of the unit or sooner if an outage of sufficient duration should occur.

We are proceeding with the subject modifications to assure timely material acquisition; therefore, any comments you have regarding the modification would be appreciated at an early date.

Very truly yours,

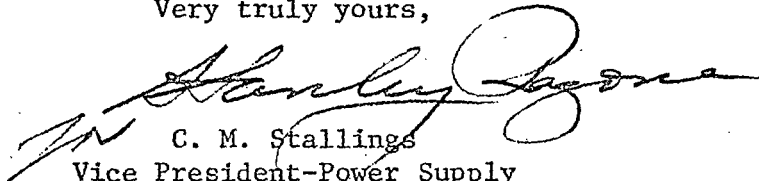

C. M. Stallings
Vice President - Power Supply
and Production Operations