


RACK A  
9 X 13

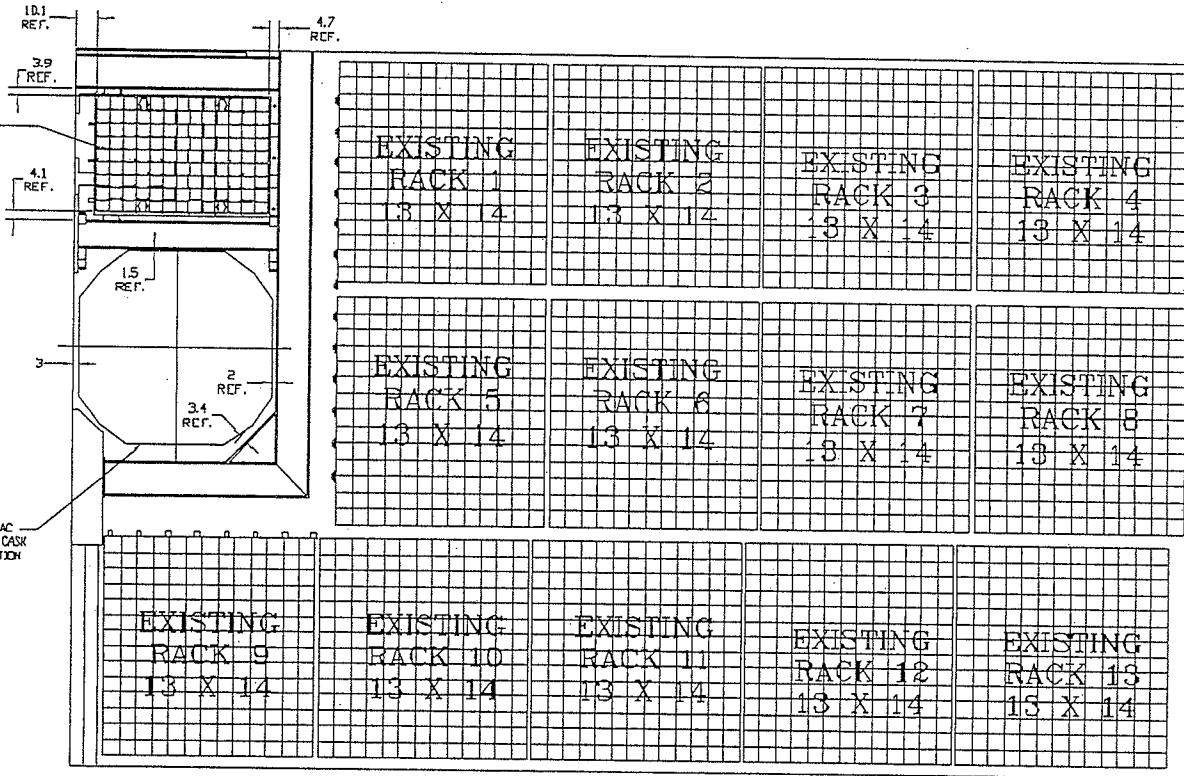

H1406

Nebraska Public Power District  
COOPER NUCLEAR STATION  
UPDATED SAFETY ANALYSIS REPORT (USAR)

Fuel Cask Area Holtec Rack A Layout  
Figure X-3-1  
06/03/08

RACK A  
9 X 13

62.5

13  
BEAM

6.3  
REF.

RACK B  
14 X 13

10.7  
REF.

6.3

RA 4  
REF.

4.0  
REF.



EXISTING  
RACK 1  
13 X 14

EXISTING  
RACK 2  
13 X 14

EXISTING  
RACK 3  
13 X 14

EXISTING  
RACK 4  
13 X 14

EXISTING  
RACK 5  
13 X 14

EXISTING  
RACK 6  
13 X 14

EXISTING  
RACK 7  
13 X 14

EXISTING  
RACK 8  
13 X 14

EXISTING  
RACK 9  
13 X 14

EXISTING  
RACK 10  
13 X 14

EXISTING  
RACK 11  
13 X 14


EXISTING  
RACK 12  
13 X 14

EXISTING  
RACK 13  
13 X 14

H1406


Nebraska Public Power District  
COOPER NUCLEAR STATION  
UPDATED SAFETY ANALYSIS REPORT (USAR)

Fuel Cask Area Holtec Rack B Layout  
Figure X-3-2  
06/03/08

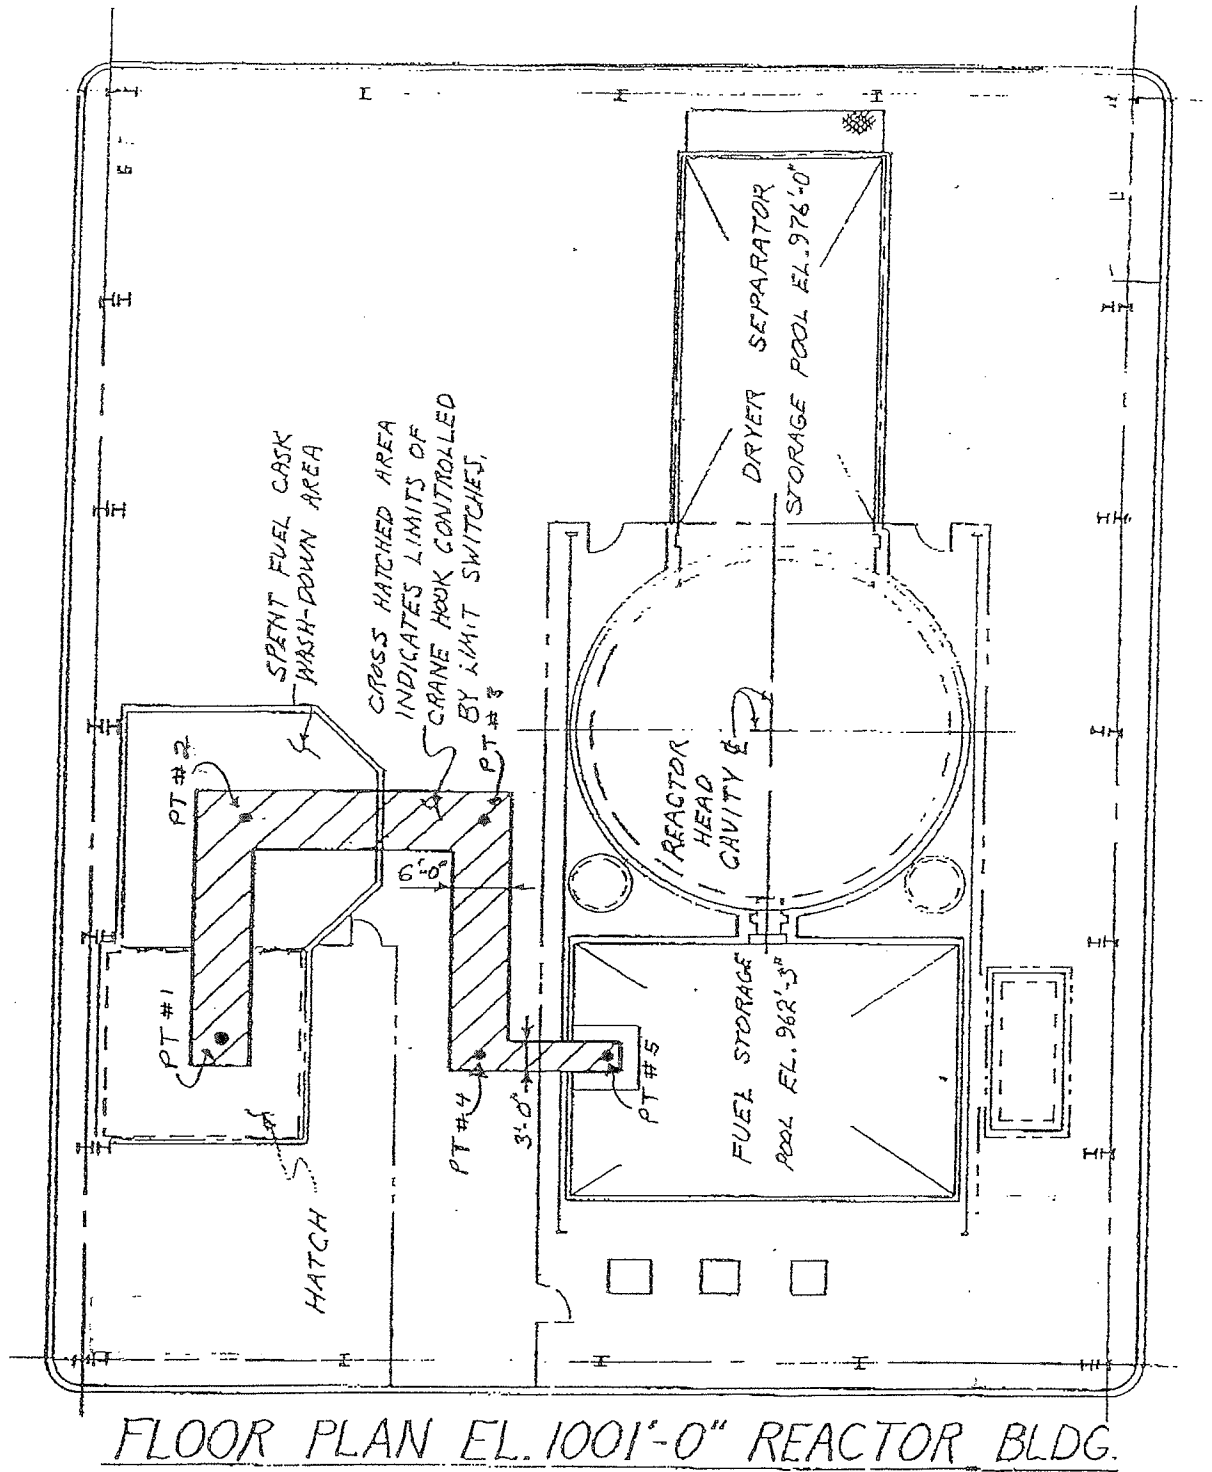

Nebraska Public Power District  
 COOPER NUCLEAR STATION  
 UPDATED SAFETY ANALYSIS REPORT (USAR)

Horizontal Controlled Path of  
 Spent Fuel Cask  
 Figure X-4-10  
 02/10/17

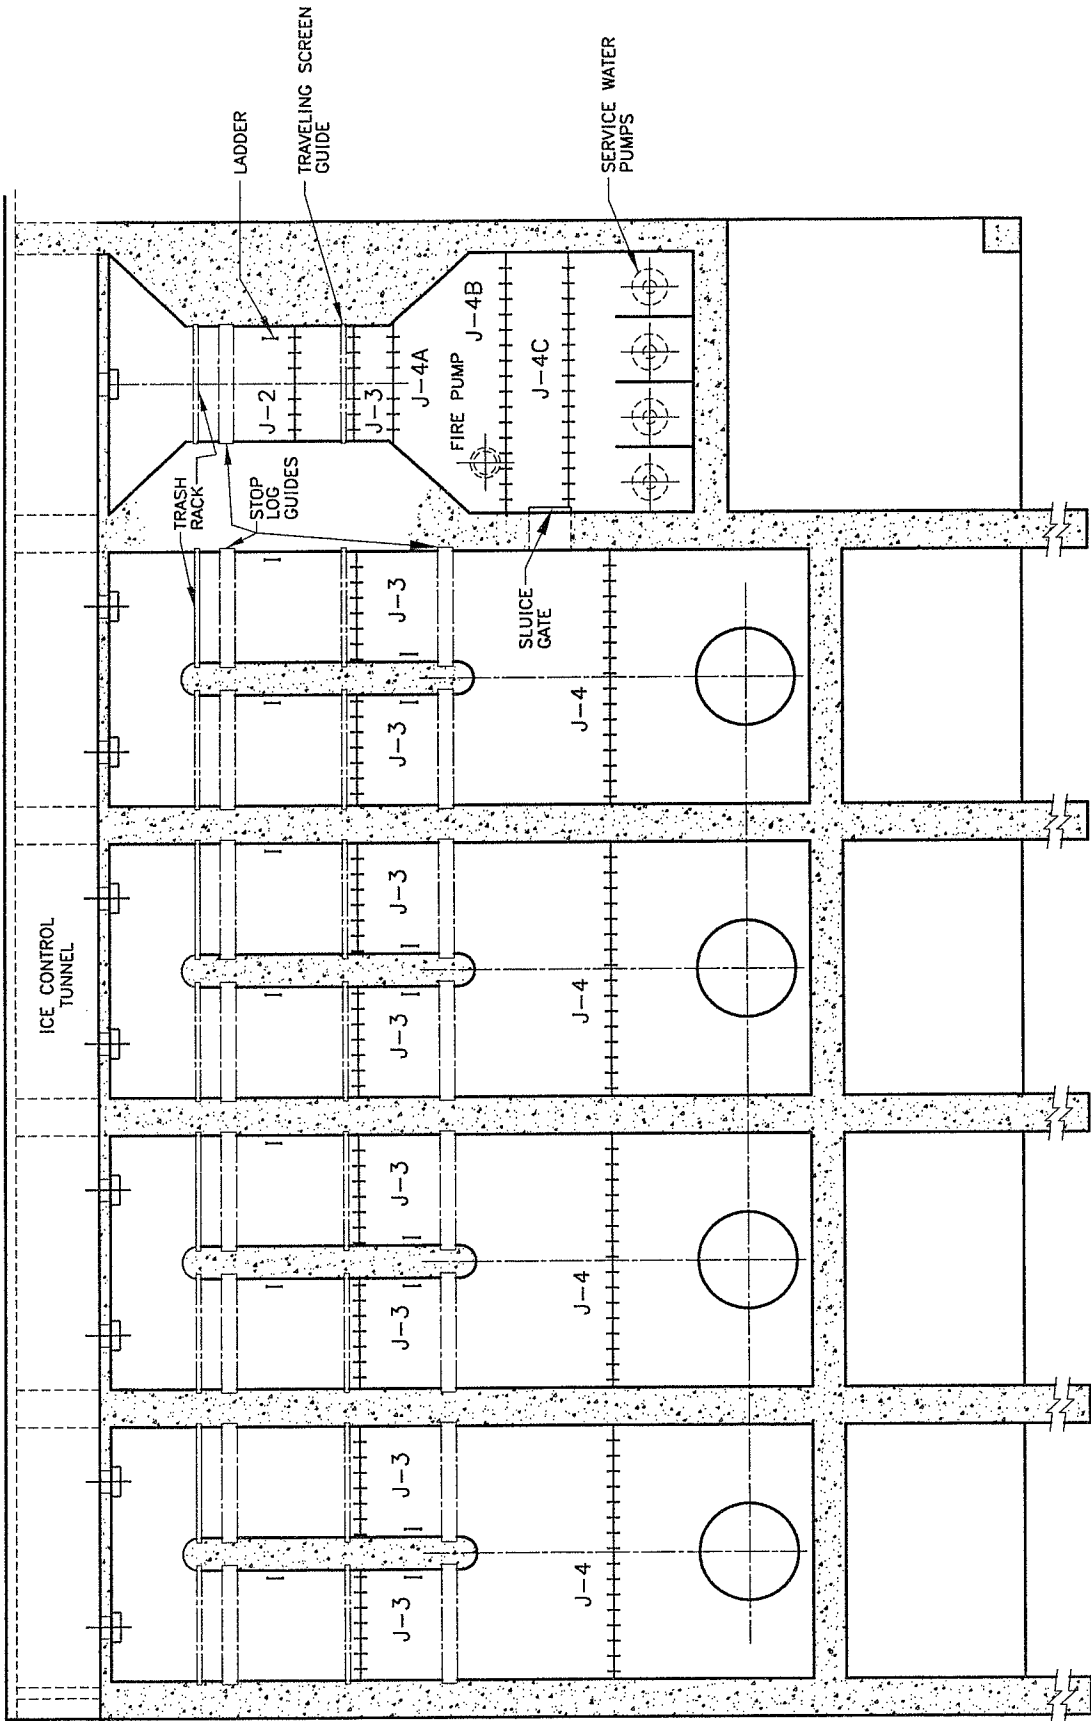

Nebraska Public Power District  
COOPER NUCLEAR STATION  
UPDATED SAFETY ANALYSIS REPORT (USAR)

**WATER JET SPRAYING SYSTEM AT  
BOTTOM OF INTAKE STRUCTURE**

FIGURE X-8-4  
11/23/11