

TTC
BBA

BALTIMORE GAS AND ELECTRIC COMPANY

P.O. BOX 1475
BALTIMORE, MARYLAND 21203

ARTHUR E. LUNDVALL, JR.
VICE PRESIDENT
SUPPLY

June 8, 1979

Office of Inspection and Enforcement
U.S. Nuclear Regulatory Commission
Region I
631 Park Avenue
King of Prussia, Pennsylvania 19406

Docket No. 50-317
50-318

Attention: Mr. Boyce H. Grier, Director

Gentlemen:


This letter is in reference to I.E. Bulletin 79-11, Faulty Overcurrent Trip Device in Circuit Breakers for Engineering Safety Systems.

Investigation of all Westinghouse breaker equipment presently in use at Calvert Cliffs revealed that the DB-50 and DB-75 breakers are not in use at this facility.

Our present Preventive Maintenance Program provides for checking all safety-related circuit breakers, on a refueling outage frequency, to confirm overcurrent time delay protection.

Should you have further questions regarding this matter, we would be pleased to discuss them with you.

Very truly yours,

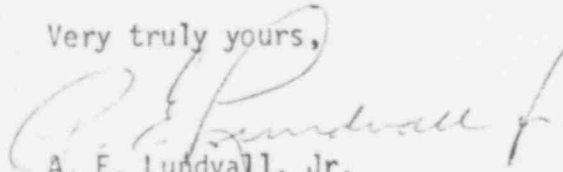

A. E. Lundvall, Jr.
Vice President - Supply

AEL/RDH/dds

Copies To: J. A. Biddison, Esquire
G. F. Trowbridge, Esquire
E. L. Conner, Jr., NRC
J. W. Brothers, Bechtel
Office of Inspection and Enforcement
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555
Attention: Director, Division of Reactor
Construction Inspection

463 344

7907300

091

Q