

FLORIDA POWER CORPORATION
CRYSTAL RIVER UNIT #3
NUCLEAR GENERATING PLANT

LOCAL LEAK RATE
TEST REPORT

Contract No. 37380

Prepared By A. J. DeGrasse Date 9/20/79
A. J. DeGrasse - Supervisory Startup Engr.

Reviewed By R. Nilsen Date 9/20/79
R. Nilsen - Project Manager

Catalytic, Inc.
1500 Market St.
Philadelphia, PA. 19102

1151 280

7910150787



CATALYTIC, INC.
Centre Square West, 1500 Market Street, Philadelphia, Pennsylvania 19102

Sheet 1 of

Rev

LOCAL LEAK RATE TEST REPORT

Date: 9/20/79

TABLE OF CONTENTS

I	INTRODUCTION
II	GENERAL DATA
III	DISCUSSION
IV	LOCAL LEAK RATE TEST RESULTS
V	ANALYSIS/ACCEPTANCE CRITERIA
VI	SUMMARY
APPENDIX A	LOCAL LEAK RATE TEST SUMMARY INDEX
APPENDIX B	LOCAL LEAK RATE TESTS PERFORMED BETWEEN REFUELING OUTAGES

1151 281



CATALYTIC, INC.
Centre Square West, 1500 Market Street, Philadelphia, Pennsylvania 19102

Sheet 1 of 16

Rev

LOCAL LEAK RATE TEST REPORT

Date: 9/20/79

I. Introduction

Type B and C test were conducted in accordance with FPC Surveillance Procedure SP179 at Pa, 49.6^{+0.5} - 0 psig in conformance with the criteria specified in Appendix J of 10CFR50 using the methods and provisions of ANSI N45.4-1972, "Leakage Rate Testing of Containment Structures for Nuclear Reactors."

Florida Power Corporation was responsible for conducting the tests. Catalytic, Inc. the contractor, prepared the surveillance test procedure and provided technical support during the performance of the tests.

1151 282



CATALYTIC, INC.
Centre Square West, 1500 Market Street, Philadelphia, Pennsylvania 19102

Sheet 2 of 16

Rev.

LOCAL LEAK RATE TEST REPORT

Date: 9/20/79

II. General Data

Owner: Florida Power Corporation

Docket No: 50-302

Location: Crystal River Nuclear Power Plant

Containment Description: Reinforced Concrete Cylinder
with Steel Liner.

Containment Net Free Volume: 2×10^6 cu. ft.

Design Pressure: 49.6 psig

Maximum Allowable Leak Rate: .6LA (248,656 scc/min.)

Recorded Total Leakage: .0678LA (28,098 scc/min.)

Test Start Date: April 13, 1979

Test Completion Date: June 19, 1979

1151 283



CATALYTIC, INC.
Centre Square West, 1500 Market Street, Philadelphia, Pennsylvania 19102

Sheet 3 of 16

Rev.

LOCAL LEAK RATE TEST REPORT

Date: 9/20/79

III. Discussion

The methods used to determine the leakage rates of containment isolation valves are as follows:

1. Out-Leakage
2. In-Leakage
3. Pressure Decay

The "Out-Leakage" method of testing consisted of applying test pressure to the upstream side of an isolation valve and measuring leakage with a rotometer or Leak Rate Monitor installed on the downstream side of the isolation valve.

The "In-Leakage" method of leak testing consisted of pressurizing a portion of system piping, bounded on at least one side by the isolation valves (and/or blind flanges) to be tested, and measuring the flow of compressed gas required to maintain the test pressure in the test volume using a rotometer or Leak Rate Monitor installed integrally with the pressurization rig.

The "Pressure Decay" method of leak rate testing consisted of pressurizing the test volume to $49.6^{+0.5}$ psig and measuring the pressure decay rate with a 1% accuracy pressure gauge.

The test method consisted of pressurizing the test section slowly, through a 'fast charge' line to approximately 45 psig, as indicated on the test rig pressure gauge. After the test section was charged to 45 psig the fast charge line was disconnected and the "Leak Rate Monitor" was cut in service. Pressure was increased with the Leak Rate Monitor to $49.6^{+0.5}$ psig. After a stabilization period of approximately 15-20 min., the leakage rate was directly read from the "Leak Rate Monitor".

(See Figure 1)

1151 284



CATALYTIC, INC.
Centre Square West, 1500 Market Street, Philadelphia, Pennsylvania 19102

Sheet 4 of 16

Rev.

Date: 9/20/79

LOCAL LEAK RATE TEST REPORT

During pressure decay measurements leakage rates were estimated using the 'decay mode' of the leak rate monitor or pressure gauge. All instrumentation used during the test was calibrated prior to commencement of the test in addition to certified calibration from the instrument supplier.

Appendix A was developed to show which penetrations are subject to Type B & C testing.

Appendix B shows valves/components tested between scheduled Local Leak Rate tests due to maintenance and increased surveillance.

1151 285




CATALYTIC, INC.
Centre Square West, 1500 Market Street, Philadelphia, Pennsylvania 19102

Sheet 5 of 16

Rev.

Date: 9/20/79

LOCAL LEAK RATE TEST REPORT

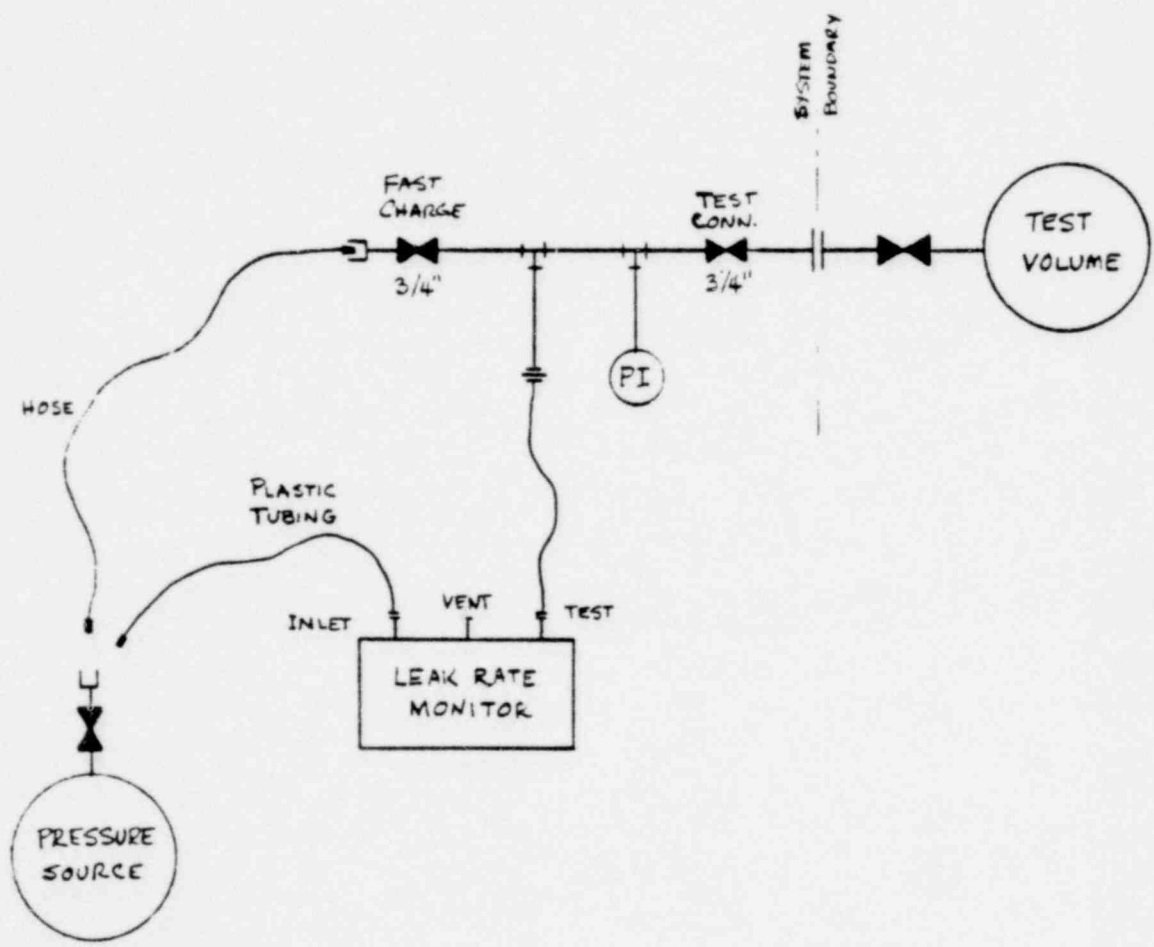

1151 286

Figure 1



CATALYTIC, INC.
Centre Square West, 1500 Market Street, Philadelphia, Pennsylvania 19102

Sheet 6 of 16

Rev.

LOCAL LEAK RATE TEST REPORT

Date: 9/20/79

IV. Local Leak Rate Test Results

1. Type B

<u>Description</u>	<u>As Found</u>	<u>Re-Test</u>	<u>As-Left</u>	<u>Acceptance Criteria</u>
Equipment Hatch Resilient Seals	2 cc/min	N/A	2 cc/min	< 500 cc/min
Fuel Transfer Tube Gasket-3B	2 cc/min	N/A	2 cc/min	< 100 cc/min
Fuel Transfer Tube Gasket-3A	2 cc/min	N/A	2 cc/min	< 100 cc/min
LRV-45 and Blind Flange	2 cc/min	N/A	2 cc/min	< 100 cc/min
LRV-44 and Blind Flange	20.3 cc/min	N/A	20.3 cc/min	< 100 cc/min
Chemical Cleaning Penetration Gaskets 119	57.0 cc/min	N/A	57.0 cc/min	< 100 cc/min
Chemical Cleaning Penetration Gaskets 120	11.0 cc/min	N/A	11.0 cc/min	< 100 cc/min

Total Measured Type B Leakage 96.3 cc/min

1151 287



CATALYTIC, INC.
Centre Square West, 1500 Market Street, Philadelphia, Pennsylvania 19102

Sheet 7 of 16

Rev

Date: 9/20/79

LOCAL LEAK RATE TEST REPORT

2. Type C

<u>Description</u>	<u>As Found</u>	<u>Re-Test</u>	<u>As-Left</u>	<u>Acceptance Criteria</u>
<u>Decay Heat Sys.</u>				
DHV-93	5.5 cc/min	N/A	5.5 cc/min	< 2740 cc/min
DHV-91	3.8 cc/min	N/A	3.8 cc/min	< 2740 cc/min
<u>Liquid Sampling Sys.</u>				
CAV-126	40 cc/min	N/A	40 cc/min	< 1370 cc/min
CAV-1	30.0 cc/min	N/A	30.0 cc/min	< 1370 cc/min
CAV-3	10.0 cc/min	N/A	10.0 cc/min	< 1370 cc/min
CAV-2	1680 cc/min	N/A	1680 cc/min	< 1370 cc/min
<u>Industrial Cooling Water</u>				
CIV-41	11.0 cc/min	N/A	11.0 cc/min	< 3425 cc/min
CIV-40	> 20,000 cc/min	27.1 cc/min	27.1 cc/min	< 3425 cc/min
CIV-34	20.9 cc/min	N/A	20.9 cc/min	< 3425 cc/min
CIV-35	4.8 cc/min	N/A	4.8 cc/min	< 3425 cc/min
<u>Demineralized Water</u>				
DWV-162	17,640 cc/min	36.7 cc/min	36.7 cc/min	< 4110 cc/min
DWV-160	10,230 cc/min	41.0 cc/min	41.0 cc/min	< 4110 cc/min
<u>Make & Purifi- cation System</u>				
MUV-40	219 cc/min	N/A	219 cc/min	< 3425 cc/min
MUV-41	30.2 cc/min	N/A	30.2 cc/min	< 3425 cc/min
MUV-49	100.0 cc/min	N/A	100.0 cc/min	< 3425 cc/min
MUV-260	230 cc/min	N/A	230 cc/min	< 1370 cc/min
MUV-261	10 cc/min	N/A	10 cc/min	< 1370 cc/min

1151 288



CATALYTIC, INC.
Centre Square West, 1500 Market Street, Philadelphia, Pennsylvania 19102

Sheet 8 of 16

Rev.

LOCAL LEAK RATE TEST REPORT

Date: 9/20/79

2. Type C (Continued)

<u>Description</u>	<u>As Found</u>	<u>Re-Test</u>	<u>As-Left</u>	<u>Acceptance Criteria</u>
<u>Make & Purification System</u>				
MUV-259	60 cc/min	N/A	60 cc/min	< 1370 cc/min
MUV-258	450 cc/min	N/A	450 cc/min	< 1370 cc/min
MUV-253	1890 cc/min	N/A	1890 cc/min	< 1370 cc/min
<u>Core Flood System</u>				
CFV-20	795 cc/min	N/A	795 cc/min	< 1370 cc/min
CFV-19	65 cc/min	N/A	65 cc/min	< 1370 cc/min
CFV-25	134 cc/min	N/A	134 cc/min	< 1370 cc/min
CFV-28	590 cc/min	N/A	590 cc/min	< 1370 cc/min
CFV-17	121 cc/min	N/A	121 cc/min	< 1370 cc/min
CFV-18	79.5 cc/min	N/A	79.5 cc/min	< 1370 cc/min
CFV-26	180 cc/min	N/A	180 cc/min	< 180 cc/min
CFV-27	45 cc/min	N/A	45 cc/min	< 1370 cc/min
CFV-15	3.9 cc/min	N/A	3.9 cc/min	< 1370 cc/min
CFV-16	2 cc/min	N/A	2.0 cc/min	< 1370 cc/min
CFV-29	2 cc/min	N/A	2.0 cc/min	< 2055 cc/min
CFV-11	3.0 cc/min	N/A	3.0 cc/min	< 1370 cc/min
CFV-12	2 cc/min	N/A	2 cc/min	< 1370 cc/min
CFV-42	16 cc/min	N/A	16 cc/min	< 1370 cc/min
<u>Nitrogen System</u>				
NGV-62	2 cc/min	N/A	2 cc/min	< 2055 cc/min
NGV-82	2 cc/min	N/A	2 cc/min	< 1370 cc/min

1151 289



CATALYTIC, INC.
Centre Square West, 1500 Market Street, Philadelphia, Pennsylvania 19102

Sheet 9 of 16

Rev

LOCAL LEAK RATE TEST REPORT

Date: 9/20/79

2. Type C (Continued)

<u>Description</u>	<u>As Found</u>	<u>Re-Test</u>	<u>As-Left</u>	<u>Acceptance Criteria</u>
<u>Station & Instrument Air System</u>				
SAV-24	49 cc/min	N/A	49 cc/min	< 4110 cc/min
IAV-28	19.6 cc/min	N/A	19.6 cc/min	< 2740 cc/min
IAV-29	381 cc/min	N/A	381 cc/min	< 2740 cc/min
<u>Spent Fuel Cooling System</u>				
SFV-18 and SFV-19	13,250 cc/min	N/A	13,250 cc/min	< 13,700 cc/min
<u>Waste Disposal System</u>				
WDV-3 & WDV-4	195.0 cc/min	N/A	195.0 cc/min	< 5480 cc/min
WDV-60 & WDV-61	2 cc/min	N/A	2.0 cc/min	< 2740 cc/min
WDV-406	117 cc/min	N/A	117 cc/min	< 2055 cc/min
WDV-405	156 cc/min	N/A	156 cc/min	< 2055 cc/min
WDV-94	4.8 cc/min	N/A	4.8 cc/min	< 4110 cc/min
WDV-62	18.4 cc/min	N/A	18.4 cc/min	< 2740 cc/min
<u>Containment Monitoring System</u>				
WSV-3	2.3 cc/min	N/A	2.3 cc/min	< 1370 cc/min
WSV-4	2 cc/min	N/A	2.0 cc/min	< 1370 cc/min
WSV-5	2 cc/min	N/A	2.0 cc/min	< 1370 cc/min
WSV-6	2 cc/min	N/A	2.0 cc/min	< 1370 cc/min
WSV-1	75 cc/min	N/A	75 cc/min	< 1370 cc/min
WSV-2	69 cc/min	N/A	69 cc/min	< 1370 cc/min

1151 290



CATALYTIC, INC.
Centre Square West, 1500 Market Street, Philadelphia, Pennsylvania 19102

Sheet 10 of 16

Rev.

LOCAL LEAK RATE TEST REPORT

Date: 9/20/79

2. Type C (Continued)

<u>Description</u>	<u>As Found</u>	<u>Re-Test</u>	<u>As-Left</u>	<u>Acceptance Criteria</u>
<u>R.B. Purge System</u>				
AHV-1C and AHV-1D	409 cc/min	N/A	409 cc/min	< 2500 cc/min
AHV-1A and AHV-1B	2.25 x 10 ⁶ cc/min		3.2 cc/min	< 2500 cc/min
	Retest 1	2.8 x 10 ⁵ cc/min		
	Retest 2	4.50 x 10 ⁵ cc/min		
	Retest 3	3.2 cc/min		
<u>Containment Leak Rate System</u>				
LRV-50	20 cc/min	N/A	20 cc/min	< 10,960 cc/min
LRV-36	2780 cc/min	N/A	2780 cc/min	< 10,960 cc/min
LRV-51	1585 cc/min	N/A	1585 cc/min	< 10,960 cc/min
LRV-35 & LRV-47	1920 cc/min	N/A	1920 cc/min	< 10,960 cc/min
LRV-49	2 cc/min	N/A	2 cc/min	< 10,960 cc/min
LRV-38 & LRV-52	2 cc/min	N/A	2 cc/min	< 10,960 cc/min

1151 291



CATALYTIC, INC.
Centre Square West, 1500 Market Street, Philadelphia, Pennsylvania 19102

Sheet 11 of 16

Rev.

LOCAL LEAK RATE TEST REPORT

Date: 9/20/79

Total number of Valves tested - 67

Total number of Valves re-tested - 4

Total number of Valves repaired - 4

Total as found leakage - 2.33×10^6 cc/min
(Type B&C) (5.62LA)

Total as left leakage (Type C) - 2.80×10^4 cc/min
(.0675LA)

Combined Type B and C leakage - 28,105 cc/min
(.0678LA)

Error adjusted total as left leakage - 2.86×10^4 cc/min
(Type C) (.0690LA)

Error adjusted combined Type B and
C Leakage - 28,667 cc/min
(.0692LA)

Note: Error adjusted leakages are based on a maximum instrument calibration accuracy of 2% applied in the conservative direction.

Note: A minimum sensitivity of 2.0 cc/min has been used for each test.

1151 292



CATALYTIC, INC.
Centre Square West, 1500 Market Street, Philadelphia, Pennsylvania 19102

Sheet 12 of 16

Rev.

LOCAL LEAK RATE TEST REPORT

Date: 9/20/79

V. Analysis and Interpretation

La = 0.25% by weight per 24 hrs. of the mass of containment air at 64.3 psia.

Mass of Containment Air = $\frac{PV}{RT}$, where:

P = Containment Pressure = 64.3 psia

V = Containment Free Volume = 2×10^6 cu ft

R = Gas Constant = $53.35 \frac{\text{ft} \cdot \text{lb}_f}{\text{lbm} \cdot ^\circ\text{R}}$

T = Containment Temperature, assumed 549.69°R (90°F)

$$\text{Mass of Containment Air} = \frac{(64.3 \text{ psia}) (2 \times 10^6 \text{ ft}^3) (144 \text{ in}^2/\text{ft}^2)}{\left(53.35 \frac{\text{ft} \cdot \text{lb}_f}{\text{lbm} \cdot ^\circ\text{R}} \right) (549.69^\circ\text{R})}$$

Mass of Containment Air = 631,467.8 lbm

$$\text{La} = \frac{(0.0025/\text{day}) (631,467.8 \text{ lbm})}{24 \text{ hrs/day}} = 65.78 \text{ lbm/hr}$$

$$= \frac{(65.78 \text{ lbm/hr}) 471.9 \frac{\text{scc/min}}{\text{SCFH}}}{0.0749 \text{ lbm/cu ft}} = 414,427 \text{ scc/min}$$

$$0.6 \text{ La} = 248,656 \text{ scc/min}$$

Exclud' g the type "B" penetrations and the 48" reactor building purge valves, the total number of "nominal inches of valve diameter" for all other valves to be leak tested is:

$$\text{Total D} = 169.5 \text{ Nominal Inches}$$

and

$$\frac{0.6 \text{ La}}{\text{Total D}} = \frac{248,656 \text{ scc/min}}{169.5 \text{ nominal inches}} = 1450 \text{ scc/min/nominal inch.}$$

1151 293



CATALYTIC, INC.
Centre Square West, 1500 Market Street, Philadelphia, Pennsylvania 19102

Sheet 13 of 16

Rev.

LOCAL LEAK RATE TEST REPORT

Date: 9/20/79

The action value was based on 95% of the 1450 scc/min/nominal inch.

$$(0.95 \times 1450 = 1370 \text{ scc/min/nominal inch})$$

The alert value was based on 70% of the 1450 scc/min/nominal inch.

$$(0.70 \times 1450 = 1000 \text{ scc/min/nominal inch})$$

<u>Value Size</u>	<u>Alert Value</u>	<u>Action Value</u>
1"	1000	1370
1½"	1500	2055
2"	2000	2740
2½"	2500	3425
3"	3000	4110
4"	4000	5480
6"	6000	8220
8"	8000	10,960
10"	10,000	13,700

(All leakage rates expressed in scc/min)

The remaining 5% was used to develop the Type "B" and Reactor building purge value acceptance criteria. The distribution was based on plant experience and input to LA. Type "B" penetrations and the 48" Reactor building purge valves action and alert values are as follows:

	<u>Alert Value</u>	<u>Action Value</u>
Equipment Hatch Resilient Seals	Zero Leakage	500 scc/min
Fuel Transfer Tubes Gaskets	Zero Leakage	100 scc/min
ILRT Gaskets	Zero Leakage	100 scc/min

1151 294



CATALYTIC, INC.
Centre Square West, 1500 Market Street, Philadelphia, Pennsylvania 19102

Sheet 14 of 16

Rev

Date: 9/20/79

LOCAL LEAK RATE TEST REPORT

	<u>Alert</u>	<u>Action</u>
Steam Generator Chemical Cleaning Gaskets	Zero Leakage	100 cc/min
Reactor Building Purge Valve	500 scc/min	2500 scc/min

DERIVATION OF PRESSURE DECAY EQUATION

The mass contained air at the beginning and end of the test is:

$$W_1 = P_1 V/RT_1 \quad \text{and} \quad W_2 = P_2 V/RT_2$$

where the test volume V is constant.

The mass loss is then given by:

$$\text{Mass loss} = W_1 - W_2 = \left(\frac{P_1}{T_1} - \frac{P_2}{T_2} \right) \frac{V}{R}$$

The mass loss can be converted to a volume loss rate at standard conditions since:

$$W = \frac{P_s V_s}{R T_s} \quad \text{or} \quad V_s = \frac{WRT_s}{P_s}$$

and thus the leakage rate in standard volume units becomes

$$L_L = \frac{V_{s1} - V_{s2}}{t} = \frac{1}{t} \left(\frac{W_1 RT_s}{P_s} - \frac{W_2 RT_s}{P_s} \right) = \frac{RT_s}{P_s t} (W_1 - W_2)$$

$$L_L = \frac{V_s}{P_s t} \left(\frac{P_1}{T_1} - \frac{P_2}{T_2} \right)$$

1151 295



CATALYTIC, INC.
Centre Square West, 1500 Market Street, Philadelphia, Pennsylvania 19102

Sheet 15 of 16

Rev.

LOCAL LEAK RATE TEST REPORT

Date: 9/20/79

Pressure Decay

The test volume was pressurized with air to at least PA (49.6 psig). The pressure change within the test volume was recorded as a function of time. The leakage rate was calculated from the pressure decay rate and the free air volume of the test volume. Temperature changes were considered.

L_L = Leakage rate, standard cubic centimeter per min, scc/min.

V = total test free air volume, cubic feet

t = test duration, hours

T_1, T_2 = test volume absolute temperature at start and end of test, respectively, Absolute Units

P_1, P_2 = test volume absolute pressure at start and end of test respectively, absolute units

T_s = standard temperature

P_s = standard pressure

The formula for computing leakage rate is:

$$L_L = \left(\frac{P_1}{T_1} - \frac{P_2}{T_2} \right) \left(\frac{V T_s}{t P_s} \right) \left(\frac{471.9 \text{ scc/min}}{\text{SCFH}} \right)$$

1151 296



CATALYTIC, INC.
Centre Square West, 1500 Market Street, Philadelphia, Pennsylvania 19102

Sheet 16 of 16

Rev.

LOCAL LEAK RATE TEST REPORT

Date: 9/20/79

VI. Summary

Local Leak Rate testing was performed on the containment isolation valves and penetrations listed in Technical Specification Table 3.6-1.

A total of 67 valves were tested with only 4 valves requiring maintenance and repair. The following valves had higher than acceptable as found leakage and were repaired and retested:

CIV-40
DWV-162
DWV-160
AHV-1A & 1B

Three retests were conducted on valves AHV-1A & 1B with only one retest on DWV-160, 162 and CIV-40. FPC will retest valves AHV-1A and 1B every six months.

The following valves were found to have leakage exceeding the alert and action value:

MUV-253
CAV-2

Maintenance was not performed on these valves due to lack of repair parts and of the overall low total leakage. A review and evaluation was conducted by FPC to determine overall total leakage and further disposition of subject valves for repair.

Eight penetrations were tested using rotometers (Penetrations: 116, 202, 119, 356, 113, 110, 111 and 112) under revision 6 of surveillance procedure SP-179. The remaining penetration tests were performed under revision 7 of surveillance procedure SP-179.

Most containment isolation valves were tested in the same direction that leakage would occur subsequent to a design basis loss of coolant accident. Valves tested in the reverse direction were determined to be more conservative (see Appendix A for valves tested in reverse direction).

The total as-found leakage was 5.62 La. As-left leakage was .0678 La. See Section IV for individual valve penetrations leakages.

1151 297



CATALYTIC, INC.
Centre Square West, 1500 Market Street, Philadelphia, Pennsylvania 19102

Sheet A1 of 23

Rev.

Date: 9/20/79

LOCAL LEAK RATE TEST REPORT

APPENDIX A
LOCAL LEAK RATE TEST SUMMARY INDEX

1151 298



CATALYTIC, INC.
Centre Square West, 1503 Market Street, Philadelphia, Pennsylvania 19102

Sheet A2 of 23

Rev.

LOCAL LEAK RATE TEST REPORT

Date: 9/20/79

NOTES

1. Valves are required to be open during post-accident conditions.
 2. Locked open.
 3. Not a containment boundary; does not "provide a direct connection".
 4. Connected to the secondary side of steam generator.
 5. Low Pressure Injection System.
 6. 10CFR50 Appendix J, II H-4, Main steam and Feedwater exclusion for PWR's.
 7. High Pressure Injection System.
 8. 10CFR50 Appendix J, III C-3, Seal water system pressure greater than 1.10 Pa.
 9. General Design Criteria #57.
 10. Tested in reverse direction, ASME Section XI, IWV-3420(c) "Exceptions".
 11. Not testable in direction of post-accident flow.
 12. These valves isolate to main steam piping only.
 13. Cannot be tested with fuel in core.
- # Symbol designates valves exempted from type "C" test per tech spec (table 3.6-1), and is followed by the applicable notes as the official reason for exemption.
- * Valve categorized per ASME, Section XI Article IWV-2100.

1151 299

FLORIDA POWER CORPORATION
CRYSTAL RIVER UNIT-3

PHILADELPHIA, PA.



LOCAL LEAK RATE TEST SUMMARY INDEX

PEHE NO	VALVE ID.	SIZE	VALVE TYPE	PIPING CLASS	ELEVATION	AZIMUTH	LEAKAGE CRITERIA	VALVE CATEGORY*	SP-179 Enclosure	REMARKS
439	CAV-1	1"	Globe	N-2	108'-2"	322°	1000/1370	A	9	Notes: 10
439	CAV-2	1"	Globe	N-2	108'-2"	322°	1000/1370	A	9	
439	CAV-3	1"	Globe	N-2	108'-2"	322°	1000/1370	A	9	Notes: 10
439	CAV-126	1"	Globe	N-1	108'-2"	322°	1000/1370	A	9	Notes: 10
440	CAV-4	1"	Globe	B31.1	104'-11"	322°		B		Notes: 3,4 #12
440	CAV-6	1"	Globe	B31.1	104'-11"	322°		B		Notes: 3,4 #12
441	CAV-5	1"	Globe	B31.1	104'-11"	317°		B		Notes: 3,4 #12
441	CAV-7	1"	Globe	B31.1	104'-11"	317°		B		Notes: 3,4 #12

FLORIDA POWER CORPORATION
CRYSTAL RIVER UNIT-3

PREPARED BY



PHILADELPHIA, PA.

LOCAL LEAK RATE TEST SUMMARY INDEX

PIENE NO	VALVE NO	SIZE	VALVE TYPE	PIPING CLASS	ELEVATION	AZIMUTH	LEAKAGE CRITERIA	VALVE CATEGORY *	SP-179 Enclosure	REMARKS
329	DHV-91	2"	Globe	N-1	133'-0"	217°	2000/2740	A	B	
329	DHV-93	2"	Check	N-2	133'-0"	217°	2000/2740	A,C	B	
342	DHV-2	10"	Check	N-1	106'-0"	205°		C		Notes: 1,5
342	DHV-6	10"	Gate	N-1	106'-0"	205°		B		Notes: 1,5 #1
343	DHV-1	10"	Check	N-1	106'-0"	220°		C		Notes: 1,5
343	DHV-5	10"	Gate	N-1	106'-0"	220°		B		Notes: 1,5 #1
344	DHV-4	12"	Gate	N-1	106'-0"	215°		B		Notes: 9 #1,13
344	DHV-41	12"	Gate	N-1	106'-0"	215°		B		Notes: 9 #1,13
345	DHV-63	14"	Gate	N-2	86'-3"			B		Notes: 1 #1,3
346	DHV-42	14"	Gate	N-2	86'-3"			B		Notes: 1 #1,3

FLORIDA POWER CORPORATION CRYSTAL RIVER UNIT-3

PREPARED BY



PHILADELPHIA, PA.

LOCAL LEAK RATE TEST SUMMARY INDEX

PENE NO.	VALVE NO.	SIZE	VALVE TYPE	PIPING CLASS	ELEVATION	AZIMUTH	LEAKAGE CRITERIA	VALVE CATEGORY	SP-179 Enclosure	REMARKS
117	DMV-160	3"	Gate	B31.1	112'-0"	40°	3000/4110	A	11	
117	DMV-162	3"	Check	B31.1	112'-0"	40°	3000/4110	A,C	11	

FLORIDA POWER CORPORATION
CRYSTAL RIVER UNIT-3

PREPARED BY



PHILADELPHIA, PA.

LOCAL LEAK RATE TEST SUMMARY INDEX

PENE NO	VALVE NO	SIZE	VALVE TYPE	PIPING CLASS	ELEVATION	AZIMUTH	LEAKAGE CRITERIA	VALVE CATEGORY #	SF-179 Enclosure	REMARKS
333	MUV-40	2 1/2"	Gate	N-1	108'-0"	267°	2500/3425	A	12	Notes: 1,7
333	MUV-41	2 1/2"	Gate	N-1	108'-0"	267°	2500/3425	A	12	Notes: 1,7
333	MUV-49	2 1/2"	Gate	N-1	108'-0"	267°	2500/3425	A	12	
336	MUV-25	2 1/2"	Globe	N-1	108'-0"	265°	—	B	—	Notes: 1,7
336	MUV-163	2 1/2"	Check	N-1	108'-0"	265°	—	C	—	Notes: 1,7
337	MUV-26	2 1/2"	Globe	N-1	108'-0"	262°	—	B	—	Notes: 1,7
337	MUV-164	2 1/2"	Check	N-1	108'-0"	262°	—	C	—	Notes: 1,7
338	MUV-18	4"	Gate	N-1	130'-0"	217°	—	B	—	Notes: 1,7
338	MUV-162	4"	Check	N-1	130'-0"	217°	—	C	—	Notes: 1,7
434	MUV-23	2 1/2"	Globe	N-1	108'-0"	275°	—	B	—	Notes: 1,7
434	MUV-20	2 1/2"	Check	N-1	108'-0"	275°	—	C	—	Notes: 1,7
435	MUV-24	2 1/2"	Gate	H-1	108'-0"	272°	—	B	—	Notes: 1,7
435	MUV-161	2 1/2"	Check	N-1	108'-0"	272°	—	C	—	Notes: 1,7
435	MUV-27	2 1/2"	Gate	N-1	108'-0"	272°	—	B	—	Notes: 1,7

FLORIDA POWER CORPORATION
CRYSTAL RIVER UNIT-3

PREPARED BY



PHILADELPHIA, PA.

LOCAL LEAK RATE TEST SUMMARY INDEX

PENE NO.	VALVE NO.	SIZE	VALVE TYPE	PIPING CLASS	ELEVATION	AZIMUTH	LEAKAGE CRITERIA	VALVE CATEGORY	SP-179 Enclosure	REMARKS
123	CFV-27	1"	Check	N-2	112'-0	30°	1000/1370	A	17	
123	CFV-28	1"	Globe	N-2	112'-0	30°	1000/1370	A	17	Notes: 10
124	CFV-17	1"	Check	N-2	112'-0	32°	1000/1370	A	17	
124	CFV-27	1"	Globe	N-2	112'-0	32°	1000/1370	A	17	Notes: 10
350	CFV-18	1"	Check	N-2	127'-0	225°	1000/1370	A	17	
350	CFV-26	1"	Globe	N-2	127'-0	225°	1000/1370	A	17	Notes: 10
373	CFV-19	1"	Check	N-2	127'-0	210°	1000/1370	A	17	
373	CFV-25	1"	Globe	N-2	127'-0	210°	1000/1370	A	17	Notes: 10
351	CFV-15	1"	Globe	N-2	127'-0	215°	1000/1370	A	17	Notes: 10
351	CFV-16	1"	Globe	N-2	127'-0	215°	1000/1370	A	17	Notes: 10
351	CFV-29	1 1/2"	Globe	N-2	127'-0	215°	1500/7055	A	17	
352	CFV-11	1"	Globe	N-2	127'-0	217°	1000/1370	A	17	Notes: 10
352	CFV-12	1"	Globe	N-2	127'-0	217°	1000/1370	A	17	Notes: 10
352	CFV-42	1"	Globe	N-2	127'-0	217°	1000/1370	A	17	

FLORIDA POWER CORPORATION
CRYSTAL RIVER UNIT-3

PREPARED BY



PHILADELPHIA, PA.

LOCAL LEAK RATE TEST SUMMARY INDEX

PENE NO.	VALVE NO.	SIZE	VALVE TYPE	PIPING CLASS	ELEVATION	AZIMUTH	LEAKAGE CRITERIA	VALVE CATEGORY *	SF-179 Enclosure	REMARKS
317	NCV-61	1 1/2"	Gate	B31.1	130'-0"	215°	—	B	—	Notes: 3, 4 #12
355	NCV-62	1 1/2"	Gate	B31.1	127'-0"	212°	500/2055	A	18	
372	NCV-82	1"	Gate	B31.1	133'-0"	225°	1000/1370	A	18	

1151 307

FLORIDA POWER CORPORATION
CRYSTAL RIVER UNIT-3

PREPARED BY



PHILADELPHIA, PA

LOCAL LEAK RATE TEST SUMMARY INDEX

PENE NO	VALVE NO	SIZE	VALVE TYPE	PIPING CLASS	ELEVATION	AZIMUTH	LEAKAGE CRITERIA	VALVE CATEGORY*	SP-179 Enclosure	REMARKS
110	SAV-23	3"	Gate	B31.1	139'-0"	20°	---	E	---	Notes: 10 #10
110	SAV-24	3"	Gate	B31.1	139'-0"	20°	3000/4110	A ₁ E	19	
111	IAV-61	2"	Gate	B31.1	136'-0"	30°	---	E	---	Notes: 10 #10
111	IAV-28	2"	Gate	B31.1	136'-0"	30°	2000/2740	A ₁ E	19	
112	IAV-62	2"	Gate	B31.1	136'-0"	32°	---	E	---	Notes: 10 #R
112	IAV-29	2"	Gate	B31.1	136'-0"	3°	2000/2740	A ₁ E	19	

SYSTEM Spent Fuel Pool Cooling

FLORIDA POWER CORPORATION CRYSTAL RIVER UNIT-3

PREPARED BY



PHILADELPHIA, PA.

LOCAL LEAK RATE TEST SUMMARY INDEX

PENE NO.	VALVE NO.	SIZE	VALVE TYPE	PIPING CLASS	ELEVATION	AZIMUTH	LEAKAGE CRITERIA	VALVE CATEGORY**	SP-179 Enclosure	REMARKS
347	SFV-18	10"	Gate	N-3	130'-0"	225°	10000/13700	A,E	20	Notes: 10, 11
347	SFV-19	10"	Gate	N-3	130'-0"	225°	10000/13700	A,E	20	
348	Flange	34"	---	N-3	125'-7"	---	0/100	---	5	
416	Flange	34"	---	N-3	125'-7"	---	0/100	---	5	

FLORIDA POWER CORPORATION
CRYSTAL RIVER UNIT-3

PREPARED BY



PHILADELPHIA, PA.

LOCAL LEAK RATE TEST SUMMARY INDEX

PENE NO.	VALVE NO.	SIZE	VALVE TYPE	PIPING CLASS	ELEVATION	AZIMUTH	LEAKAGE CRITERIA	VALVE CATEGORY *	SP-179 Enclosure	REMARKS
339	WDV-3	4"	Diaph	N-3	112'-0	225°	4000/5480	A	13	Notes: 10
339	WDV-4	4"	Diaph	N-3	112'-0	225°	4000/5480	A	13	
349	WDV-60	2"	Gate	N-3	112'-0	227°	2000/2740	A	13	Notes: 10, 11
349	WDV-61	2"	Diaph	N-3	112'-0	227°	2000/2740	A	13	
374	WDV-62	2"	Diaph	N-3	106'-0	227°	2000/2740	A	13	
374	WDV-94	3"	Globe	N-3	106'-0	227°	3000/4110	A	13	Notes: 10
354	WDV-405	1 1/2"	Globe	N-3	133'-0	215°	1500/2055	A	13	
354	WDV-406	1 1/2"	Globe	N-3	133'-0	215°	1500/2055	A	13	Notes: 10

FLORIDA POWER CORPORATION
CRYSTAL RIVER UNIT-3

PREPARED BY



PHILADELPHIA, PA.

LOCAL LEAK RATE TEST SUMMARY INDEX

PENE NO	VALVE NO	SIZE	VALVE TYPE	PIPING CLASS	ELEVATION	AZIMUTH	LEAKAGE CRITERIA	VALVE CATEGORY *	SP-179 Enclosure	REMARKS
340	BSV-3	8"	Globe	N-2	106'-0	225°	---	B	---	Notes: 1 01
340	BSV-27	8"	Check	N-2	106'-0	225°	---	C	---	Notes: 1 01
341	BSV-4	8"	Globe	N-2	106'-0	210°	---	B	---	Notes: 1 01
341	BSV-26	8"	Check	N-2	106'-0	210°	---	C	---	Notes: 1 01

FLORIDA POWER CORPORATION
CRYSTAL RIVER UNIT-3



LOCAL LEAK RATE TEST SUMMARY INDEX

PERM NO.	VALVE NO.	SIZE	VALVE TYPE	PIPING CLASS	ELEVATION	AZIMUTH	LEAKAGE CRITERIA	VALVE CATEGORY*	SP-179 Enclosure	REMARKS
319	BSV-132	1"	Gate	N-3	112'-0"	195°	---	E	---	Notes: 1,2,3
426	BSV-147	1"	Gate	N-3	104'-11"	342°	---	E	---	Notes: 1,2,3
429	BSV-130	2"	Gate	N-3	108'-2"	317°	---	E	---	Notes: 1,2,3
442	BSV-131	2"	Gate	N-3	108'-2"	345°	---	E	---	Notes: 1,2,3

FLORIDA POWER CORPORATION
CRYSTAL RIVER UNIT-3

PREPARED BY



PHILADELPHIA, PA.

LOCAL LEAK RATE TEST SUMMARY INDEX

PIPING CLASS	VALVE TYPE	SIZE	VALVE NO	ELEVATION	AZIMUTH	LEAKAGE CRITERIA	VALVE CATEGORY *	SP-179 Enclosure	REMARKS
N-3	Globe	2"	LRV-45	130'-0"	17°	2000/2740	A,E	16	
N-3	---	2"	Flange	130'-0"	17°	0/100	---	6	
N-3	Globe	2"	LRV-44	135'-0"	100°	2000/2740	A,E	16	
N-3	---	2"	Flange	135'-0"	100°	0/100	---	6	
N-3	Gate	8"	LRV-36	133'-0"	30°	8000/10960	---	16	
N-3	Gate	8"	LRV-50	133'-0"	30°	8000/10960	A,E	16	
N-3	Gate	8"	LRV-35	133'-0"	32°	8000/10960	A,E	16	
N-3	Gate	3"	LRV-47	133'-0"	32°	3000/4110	A,E	16	
N-3	Gate	8"	LRV-51	133'-0"	32°	8000/10960	A,E	16	
N-3	Gate	8"	LRV-49	123'-0"	75°	8000/10960	A,E	16	
N-3	Gate	8"	LRV-30	123'-0"	75°	8000/10960	A,E	16	
N-3	Gate	3"	LRV-52	123'-0"	75°	3000/4110	A,E	16	

FLORIDA POWER CORPORATION
CRYSTAL RIVER UNIT-3

PREPARED BY



PHILADELPHIA, PA.

LOCAL LEAK RATE TEST SUMMARY INDEX

PENE NO	VALVE NO	SIZE	VALVE TYPE	PIPING CLASS	ELEVATION	AZIMUTH	LEAKAGE CRITERIA	VALVE CATEGORY *	SP-179 Enclosure	REMARKS
119	Flange	20"	---	B31.1	106'-0	42 ⁰	0/100	---	7	
119	Flange	20"	---	B31.1	106'-0	42 ⁰	0/100	---	7	
120	Flange	20"	---	B31.1	106'-0	30 ⁰	0/100	---	7	
120	Flange	20"	---	B31.1	106'-0	30 ⁰	0/100	---	7	

FLORIDA POWER CORPORATION
CRYSTAL RIVER UNIT-3

PREPARED BY



PHILADELPHIA, PA.

LOCAL LEAK RATE TEST SUMMARY INDEX

PENE NO.	VALVE NO.	SIZE	VALVE TYPE	PIPING CLASS	ELEVATION	AZIMUTH	LEAKAGE CRITERIA	VALVE CATEGORY *	SP-179 Enclosure	REMARKS
108	PVV-46	18"	Check	B31.1	123'-0	80°	---	C	---	Notes: 4, 6 #6
109	PVV-43	6"	Check	B31.1ES	106'-0	40°	---	C	---	Notes: 4, 6 #6
423	PVV-45	18"	Check	B31.1	131'-0	342°	---	C	---	Notes: 4, 6 #6
424	PVV-132	1"	Globe	B31.1ES	108'-2"	342°	---	C	---	Notes: 4, 6 #6

FLORIDA POWER CORPORATION
CRYSTAL RIVER UNIT-3

PREPARED BY



PHILADELPHIA, PA

LOCAL LEAK RATE TEST SUMMARY INDEX

PENE NO	VALVE NO	SIZE	VALVE TYPE	PIPING CLASS	ELEVATION	AZIMUTH	LEAKAGE CRITERIA	VALVE CATEGORY*	SP-179 Enclosure	REMARKS
321	SWV-48	8"	BF	B31.1	106'-0	207°	---	B	---	Notes: B
322	SWV-49	8"	BF	B31.1	106'-0	202°	---	B	---	Notes: B
323	SWV-80	6"	BF	B31.1ES	133'-0	212°	---	B	---	Notes: B
324	SWV-84	6"	BF	B31.1ES	130'-0	212°	---	B	---	Notes: B
325	SWV-82	6"	BF	B31.1ES	133'-0	210°	---	B	---	Notes: B
326	SWV-86	6"	BF	B31.1ES	130'-0	210°	---	B	---	Notes: B
330	SWV-109	3"	Gate	B31.1ES	136'-0	210°	---	B	---	Notes: B
331	SWV-110	3"	Gate	B31.1ES	136'-0	212°	---	B	---	Notes: B
358	SWV-39	8"	BF	B31.1ES	106'-0	195°	---	B	---	Notes: B
359	SWV-45	8"	BF	B31.1ES	106'-0	200°	---	B	---	Notes: B
360	SWV-47	8"	BF	B31.1	112'-0	212°	---	B	---	Notes: B
361	SWV-50	8"	BF	B31.1	112'-0	210°	---	B	---	Notes: B
362	SWV-81	6"	BF	B31.1ES	133'-0	207°	---	B	---	Notes: B
363	SWV-85	6"	BF	B31.1ES	130'-0	207°	---	B	---	Notes: B
364	SWV-79	6"	BF	B31.1ES	133'-0	205°	---	B	---	Notes: B
365	SWV-83	6"	BF	B31.1ES	130'-0	205°	---	B	---	Notes: B

FLORIDA POWER CORPORATION
CRYSTAL RIVER UNIT-3

PREPARED BY



PHILADELPHIA, PA

LOCAL LEAK RATE TEST SUMMARY INDEX

PENE NO	VALVE NO	SIZE	VALVE TYPE	PIPING CLASS	ELEVATION	AZIMUTH	LEAKAGE CRITERIA	VALVE CATEGORY	SP-179 Enclosure	REMARKS
368	SWV-35	8"	BF	B31.1ES	109'-0"	197°	---	B	---	Note: 8 #1,3
369	SWV-41	8"	BF	B31.1ES	112'-0"	197°	---	B	---	Note: 8 #1,3
370	SWV-37	8"	BF	B31.1ES	106'-0"	197°	---	B	---	Note: 8 #1,3
371	SWV-43	8"	BF	B31.1ES	112'-0"	200°	---	B	---	Note: 8 #1,3



CATALYTIC, INC.
Centre Square West, 1500 Market Street, Philadelphia, Pennsylvania 19102

Sheet B1 of 2

Rev.

Date: 9/20/79

LOCAL LEAK RATE TEST REPORT

APPENDIX B

LLRT'S PERFORMED BETWEEN REFUELING OUTAGES

1151 321



CATALYTIC, INC.
Centre Square West, 1500 Market Street, Philadelphia, Pennsylvania 19102

Sheet B2 of 2

Rev.

LOCAL LEAK RATE TEST REPORT

Date: 9/20/79

LLRT'S PERFORMED BETWEEN REFUELING OUTAGES

<u>Description</u>	<u>As Found</u>	<u>Re-Test</u>	<u>As-Left</u>	<u>Date Tested</u>
CAV-1	0	N/A	0	9/2/78
CAV-2	534.6	N/A	534.6	9/2/78
CAV-3	0	N/A	0	9/2/78
CAV-126	534	N/A	534	9/2/78
Fuel Transfer Tube 3A	0	N/A	0	9/2/78
Fuel Transfer Tube 3B	0	N/A	0	9/2/78
Equipment Hatch	57.1	N/A	57.1	9/7/78

1151 322