



UNITED STATES
NUCLEAR REGULATORY COMMISSION
REGION I
631 PARK AVENUE
KING OF PRUSSIA, PENNSYLVANIA 19406

72

Docket No. 50-333

JAN 14 1980

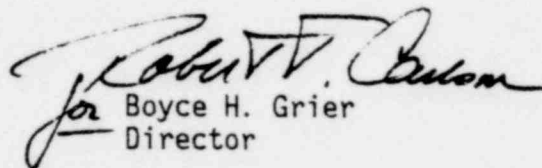
Power Authority of the State of New York
James A. FitzPatrick Nuclear Power Plant
ATTN: Mr. J. D. Leonard
Resident Manager
P. O. Box 41
Lycoming, New York 13093

Gentlemen:

Enclosed is IE Bulletin No. 80-01 which requires action by you with regard to your BWR power reactor facility with an operating license.

Should you have questions regarding this Bulletin or the actions required of you, please contact this office.

Sincerely,


for Boyce H. Grier
Director

Enclosures:

1. IE Bulletin No. 80-01 with Attachment
2. List of Recently Issued IE Bulletins

CONTACT: E. C. McCabe, Jr.
(215-337-5251)

cc w/encls:

George T. Berry, Executive Director
P. W. Lyon, Manager - Nuclear Operations
A. Klausmann, Director, Quality Assurance
M. C. Cosgrove, Quality Assurance Supervisor
J. F. Davis, Chairman, Safety Review Committee
C. M. Pratt, Assistant General Counsel
G. M. Wilverding, Licensing Supervisor

1819 228

Q 8001280 491

ENCLOSURE 1

UNITED STATES
NUCLEAR REGULATORY COMMISSION
OFFICE OF INSPECTION AND ENFORCEMENT
WASHINGTON, D.C. 20555

SSINS No.: 6870
Accessions No.:
7912190652

IE Bulletin No. 80-01
Date: January 14, 1980
Page 1 of 2

OPERABILITY OF ADS VALVE PNEUMATIC SUPPLY

On January 10, 1980, the NRC was informed by Philadelphia Electric Company that engineering evaluation for Peach Bottom 2 and 3 has disclosed that the Automatic Depressurization System (ADS) pneumatic supply (either nitrogen or air) may not be operable for all possible events because of a combination of misapplication of check valve, a lack of leak testing of the accumulator system backing up each ADS valve operator and questions about the continued operability of the pneumatic supply in a seismic event. Attached is a simplified schematic of the pneumatic supply. The check valve nearest to the accumulator is a PAL, three-quarter inch, stainless steel, socket welded check valve with a hard-seat (valve identification-B-1376 on the upper flange). Plant information at Peach Bottom shows substantial supports for the pneumatic supply inside the drywell, but seismic qualification has not been verified. The licensee has stated that the pneumatic supply is not seismically qualified outside the drywell.

Unit 2 was shutdown on 1/10/80 because of questions of ADS operability and Unit 3 has been provided a seismically qualified nitrogen supply at the containment penetration pending confirmation of seismic qualification of piping inside Unit 2 containment. The licensee is changing their valve to one with a soft seat to reduce leakage.

Actions to be taken by Licensees of GE BWR facilities with an operating license which use a pneumatic operator for ADS function:

1. Determine if your facility has installed hard-seat check valves to isolate the ADS accumulator system from the pneumatic supply system.
2. Determine if periodic leak tests have been performed on your ADS accumulator systems to assure emergency pneumatic supply for the FSAR-required number and duration of valve operations.
3. Review seismic qualifications of the ADS pneumatic supply system:
 - (a) from accumulator system isolation check valve to ADS valve operator,
 - (b) from isolation valve outside valve.
4. Based upon determination of items of the ADS for the conditions und including a seismic event. If op to appropriate Technical Specific

1819 229

DUPLICATE DOCUMENT

Entire document previously
entered into system under:

ANO 7912190652

No. of pages: 4