

METROPOLITAN EDISON COMPANY
JERSEY CENTRAL POWER & LIGHT COMPANY

AND

PENNSYLVANIA ELECTRIC COMPANY
THREE MILE ISLAND NUCLEAR STATION UNIT 1

Operating License No. DPR-50
Docket No. 50-289
Corrections To Technical Specification Change Request No. 39

This Technical Specification Change Request is submitted in support of Licensee's request to change Appendix A to Operating License No. DPR-50 for Three Mile Island Nuclear Station Unit 1. As a part of this request, proposed replacement pages for Appendix A are also included.

METROPOLITAN EDISON COMPANY

By /s/ R. C. Arnold
Vice President-Generation

Sworn and subscribed to me this 21st day of October, 1976.

/s/ L. L. Lawyer

Notary Public

1582 261

7911110 051

UNITED STATES OF AMERICA
NUCLEAR REGULATORY COMMISSION

IN THE MATTER OF

DOCKET NO. 50-289
LICENSE NO. DPR-50

METROPOLITAN EDISON COMPANY

This is to certify that a copy of corrections to Technical Specification Change Request No. 39 to Appendix A of the Operating License for Three Mile Island Nuclear Station Unit 1, has, on the date given below, been filed with the U. S. Nuclear Regulatory Commission and been served on the chief executives of Londonderry Township, Dauphin County, Pennsylvania and Dauphin County, Pennsylvania by deposit in the United States mail, addressed as follows:

Mr. Weldon B. Arehart,
Board of Supervisors of
Londonderry Township
R. D. #1, Geyers Church Road
Middletown, Pennsylvania 17057


Mr. Harry B. Reese, Jr.
Board of County Commissioners
of Dauphin County
Dauphin County Court House
Harrisburg, Pennsylvania 17120

METROPOLITAN EDISON COMPANY

By /s/ R. C. Arnold
Vice President-Generation

Dated: October 21, 1976

1582 262

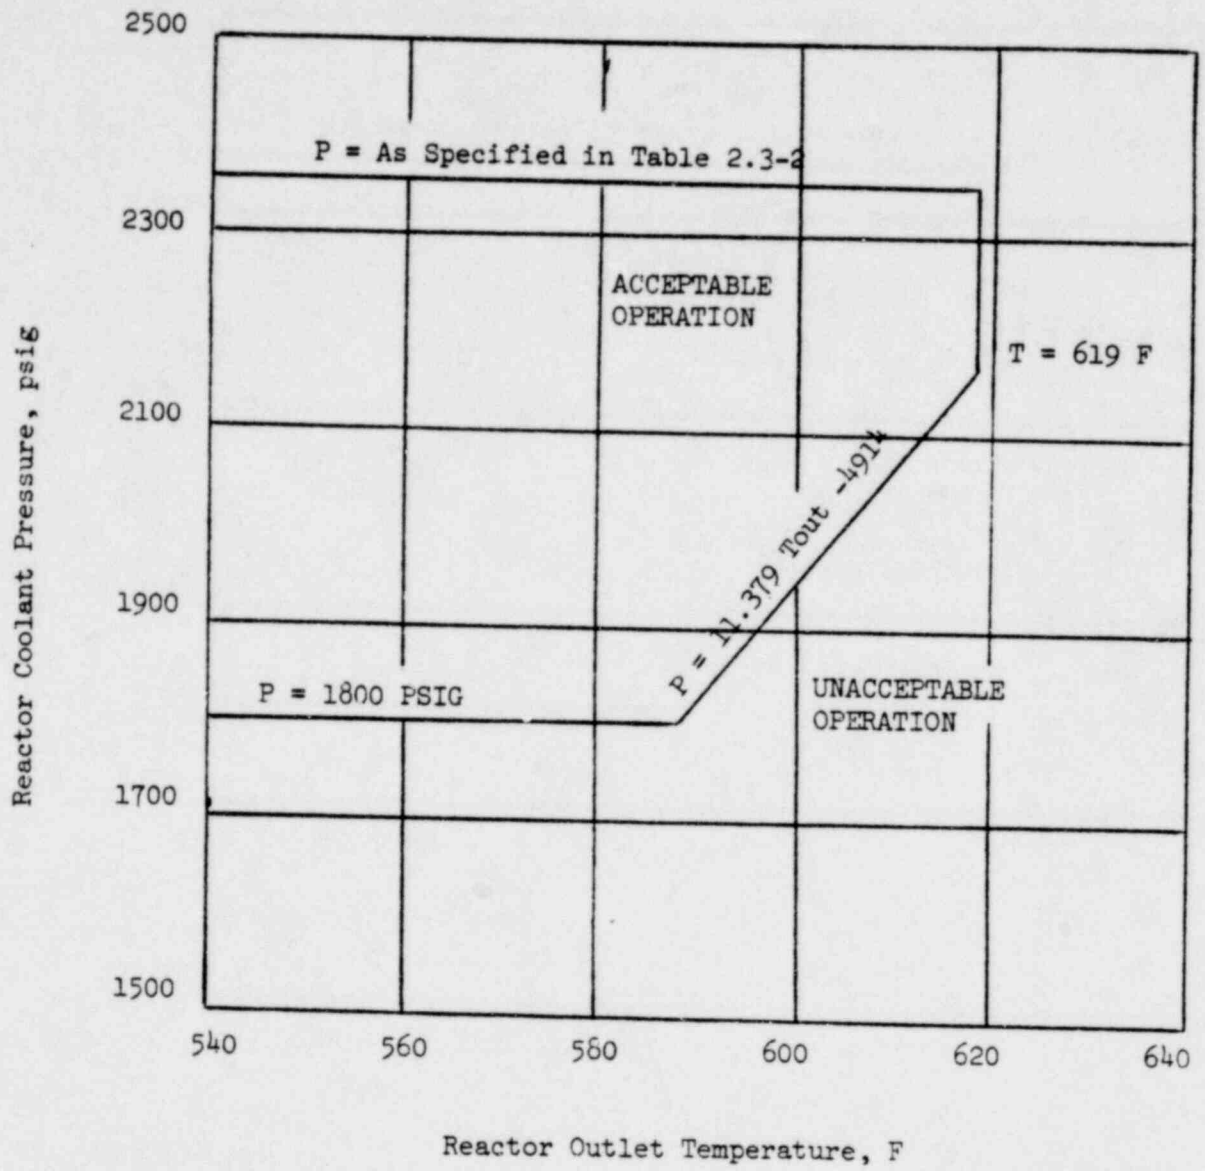

PROTECTION SYSTEM MAXIMUM
ALLOWABLE SET POINTS

Figure 2.3-1

TABLE 2.3-2

HIGH PRESSURE REACTOR TRIP AND PRESSURIZER CODE
SAFETY VALVES SETTING PAIRS

Alternate Pairs of Settings	High Pressure Reactor Trip Setting	Pressurizer Code Safety Valve Setting
A ¹ / _—	2375 psig	2435 psig
B ² / _—	2405 psig	2500 psig

Notes:

- 1/ The pair of settings denoted as A will be utilized until the pressurizer code safety valve setting can be increased from 2435 psig to 2500 psig.
—
- 2/ The pair of settings denoted as B will be utilized on a permanent basis following resetting of the pressurizer code safety valves.
—

1582 264