

Rec'd by Telecopy 6-10-80

NOTE TO: J. Shea S.  
THRU: R. Schott  
FROM: S. Mays

PROJECT MANAGER FOR LaCrosse  
SEP SECTION LEADER D. Allison  
TECHNICAL REVIEWER R. Schott

REQUEST FOR ADDITIONAL INFORMATION ON SEP TOPIC VII-3 SAFE SHUTDOWN

The SEPB reviewers have been unable to obtain the following information from the documents available to them:

1. P&ID for High Pressure Service Water, Low Pressure Service Water
2. Control Diagrams for Valves 60-25-003, 60-25-007, 64-30-001, 64-25-001, 50-25-002
3. Control Diagram for Pump 56-06-001
4. Power supplies for temperature, pressure, level, and flow for safe shutdown systems either in table format or a key diagram showing which bus(es) supply which system(s) instruments.


This information must be available by July 7, 1980 to maintain our review schedule. It is suggested that the information be obtained by:

1. Telephone conference
2. Written request for additional information
3. Meeting at \_\_\_\_\_

Copies:

Jousley  
Parkyn  
Brimer  
A-11, S-23  
Reading

8007080305

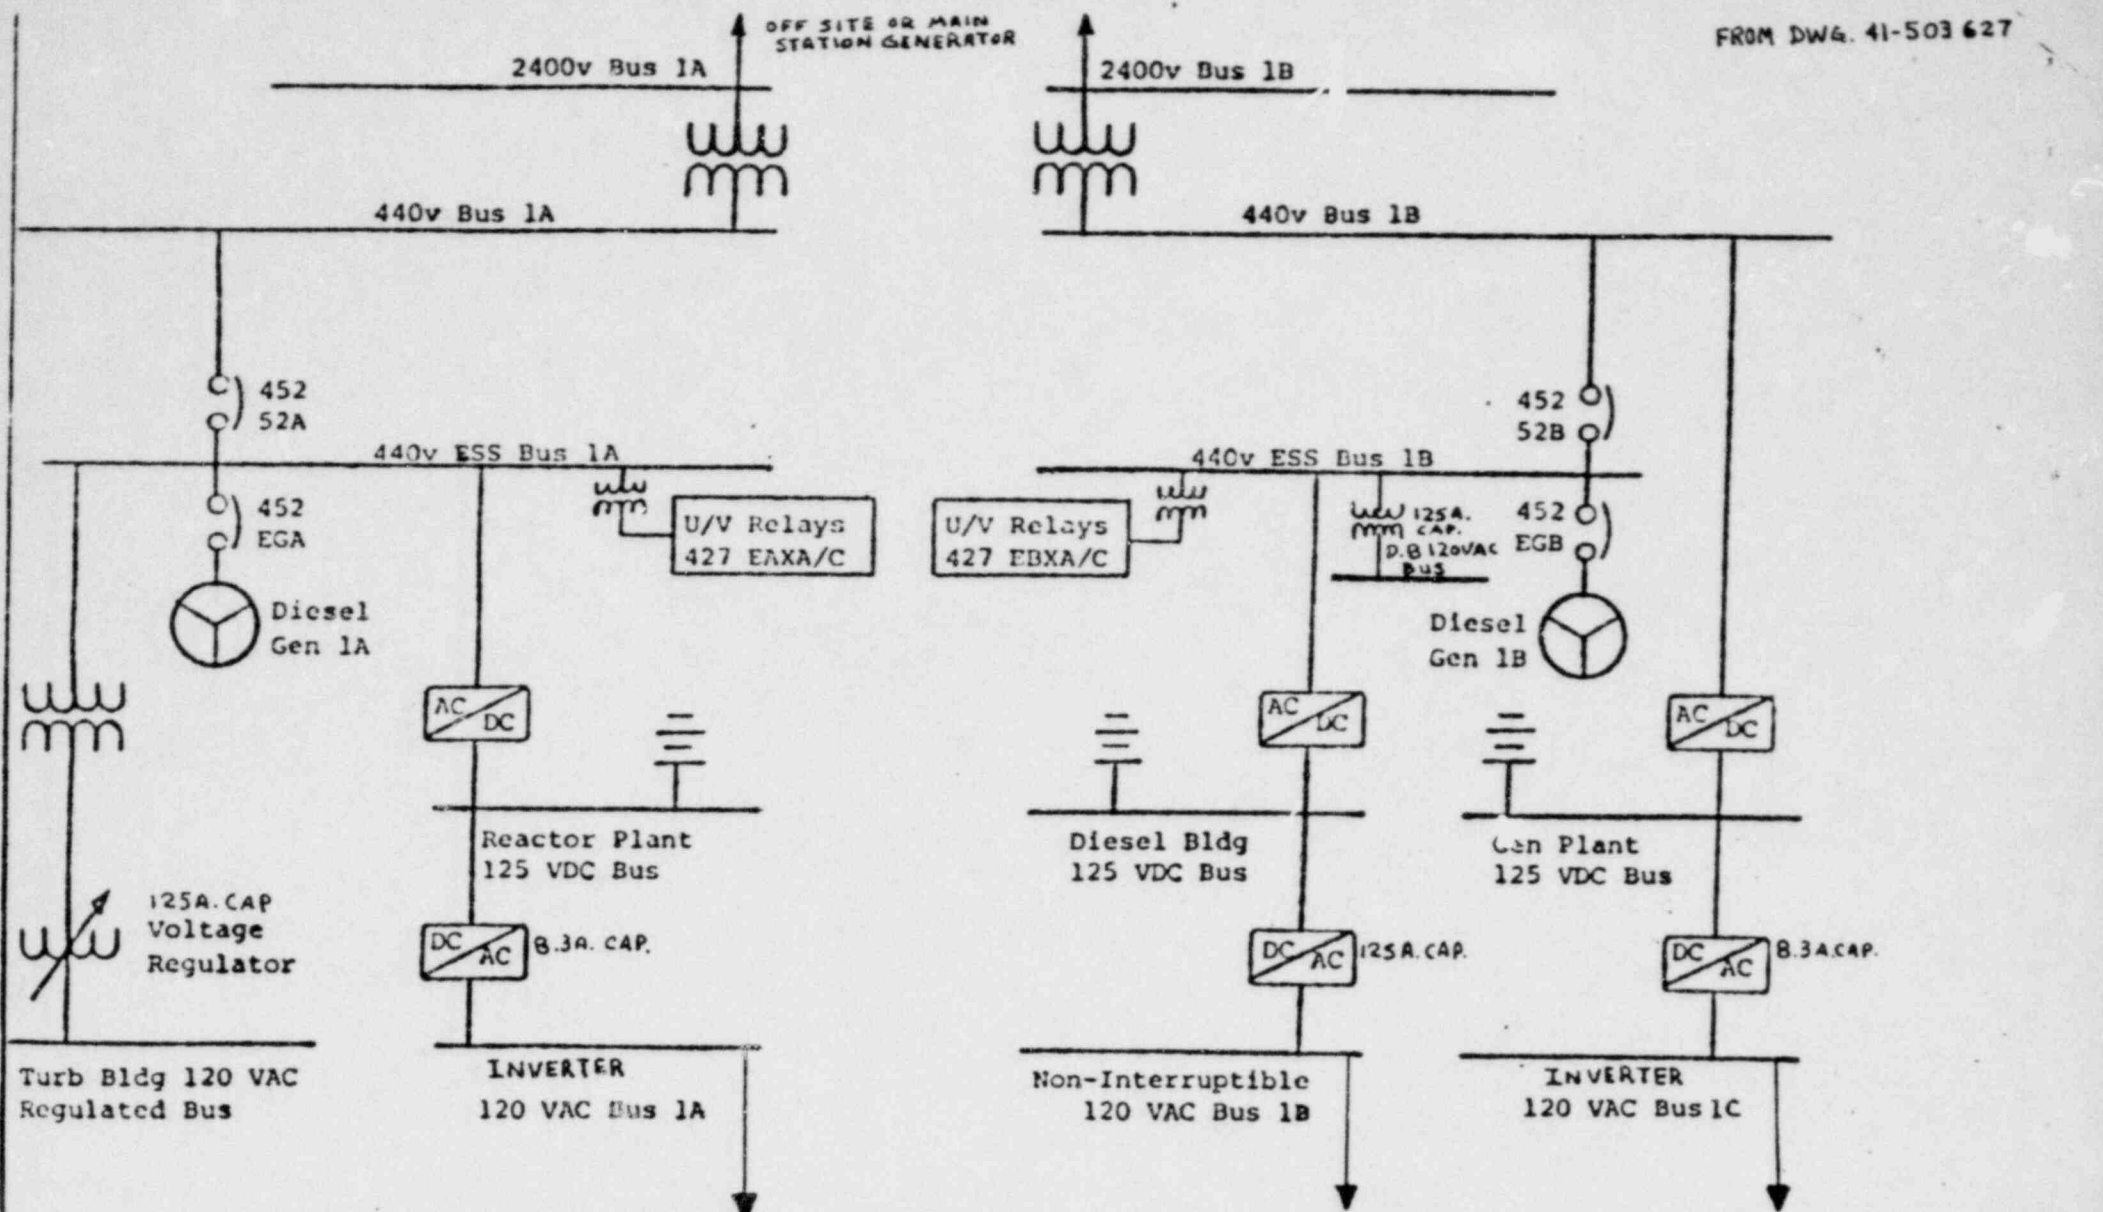

1. CONT. Bldg PRESS 37-35-401
2. CONT. Bldg. Level 37-42-401
3. R<sub>w</sub> water Level XMTR 50-42-401
4. R<sub>w</sub> water Level ch II SAFETY SYS. 50-42-502

1. All other SAFETY Related Equip. (PRESS., Level, Flow, Temp.)
2. R<sub>w</sub> water Level ch I SAFETY SYS.
3. All other NON-SAFETY Related Equip.
4. Post accident MONITORING ch II

1. R<sub>w</sub> water Level XMTR ch II