

CONSUMERS POWER COMPANY  
DOCKET NO. 50-155  
BIG ROCK POINT NUCLEAR PLANT  
AMENDMENT TO FACILITY OPERATING LICENSE

18  
 Amendment No. 20  
 License No. DPR-6

1. The Nuclear Regulatory Commission (the Commission) has found that:
  - A. The application for amendment by Consumers Power Company (the licensee) dated May 4, 1978, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's rules and regulations set forth in 10 CFR Chapter I;
  - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
  - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
  - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
  - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.



OFFICE ➤						
SURNAME ➤						
DATE ➤						

2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment and paragraph 2.C(2) of Facility License No. DPR-6 is hereby amended to read as follows:

(2) Technical Specifications

The Technical Specifications contained in Appendix A, as revised through Amendment No.18, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications.

3. This license amendment is effective as of the date of its issuance.

FOR THE NUCLEAR REGULATORY COMMISSION

Original signed by  
Dennis L. Zienann

Dennis L. Zienann, Chief  
Operating Reactors Branch #2  
Division of Operating Reactors

Attachment:  
Changes to the Technical  
Specifications

Date of Issuance: JUN 08 1978

OFFICE →						
SURNAME →						
DATE →						

ATTACHMENT TO LICENSE AMENDMENT NO. 40

FACILITY OPERATING LICENSE NO. DPR-6

DOCKET NO. 50-155

Revise Appendix A Technical Specifications by removing the pages identified below and inserting the enclosed pages. The revised pages are identified by the captioned amendment number and contain vertical lines indicating the area of change.

Remove

10-3

10-5

Insert


10-3

10-5

OFFICE →						
SURNAME →						
DATE →						

Figure 6.2-2

CONSUMERS POWER COMPANY  
BIG ROCK POINT ORGANIZATION

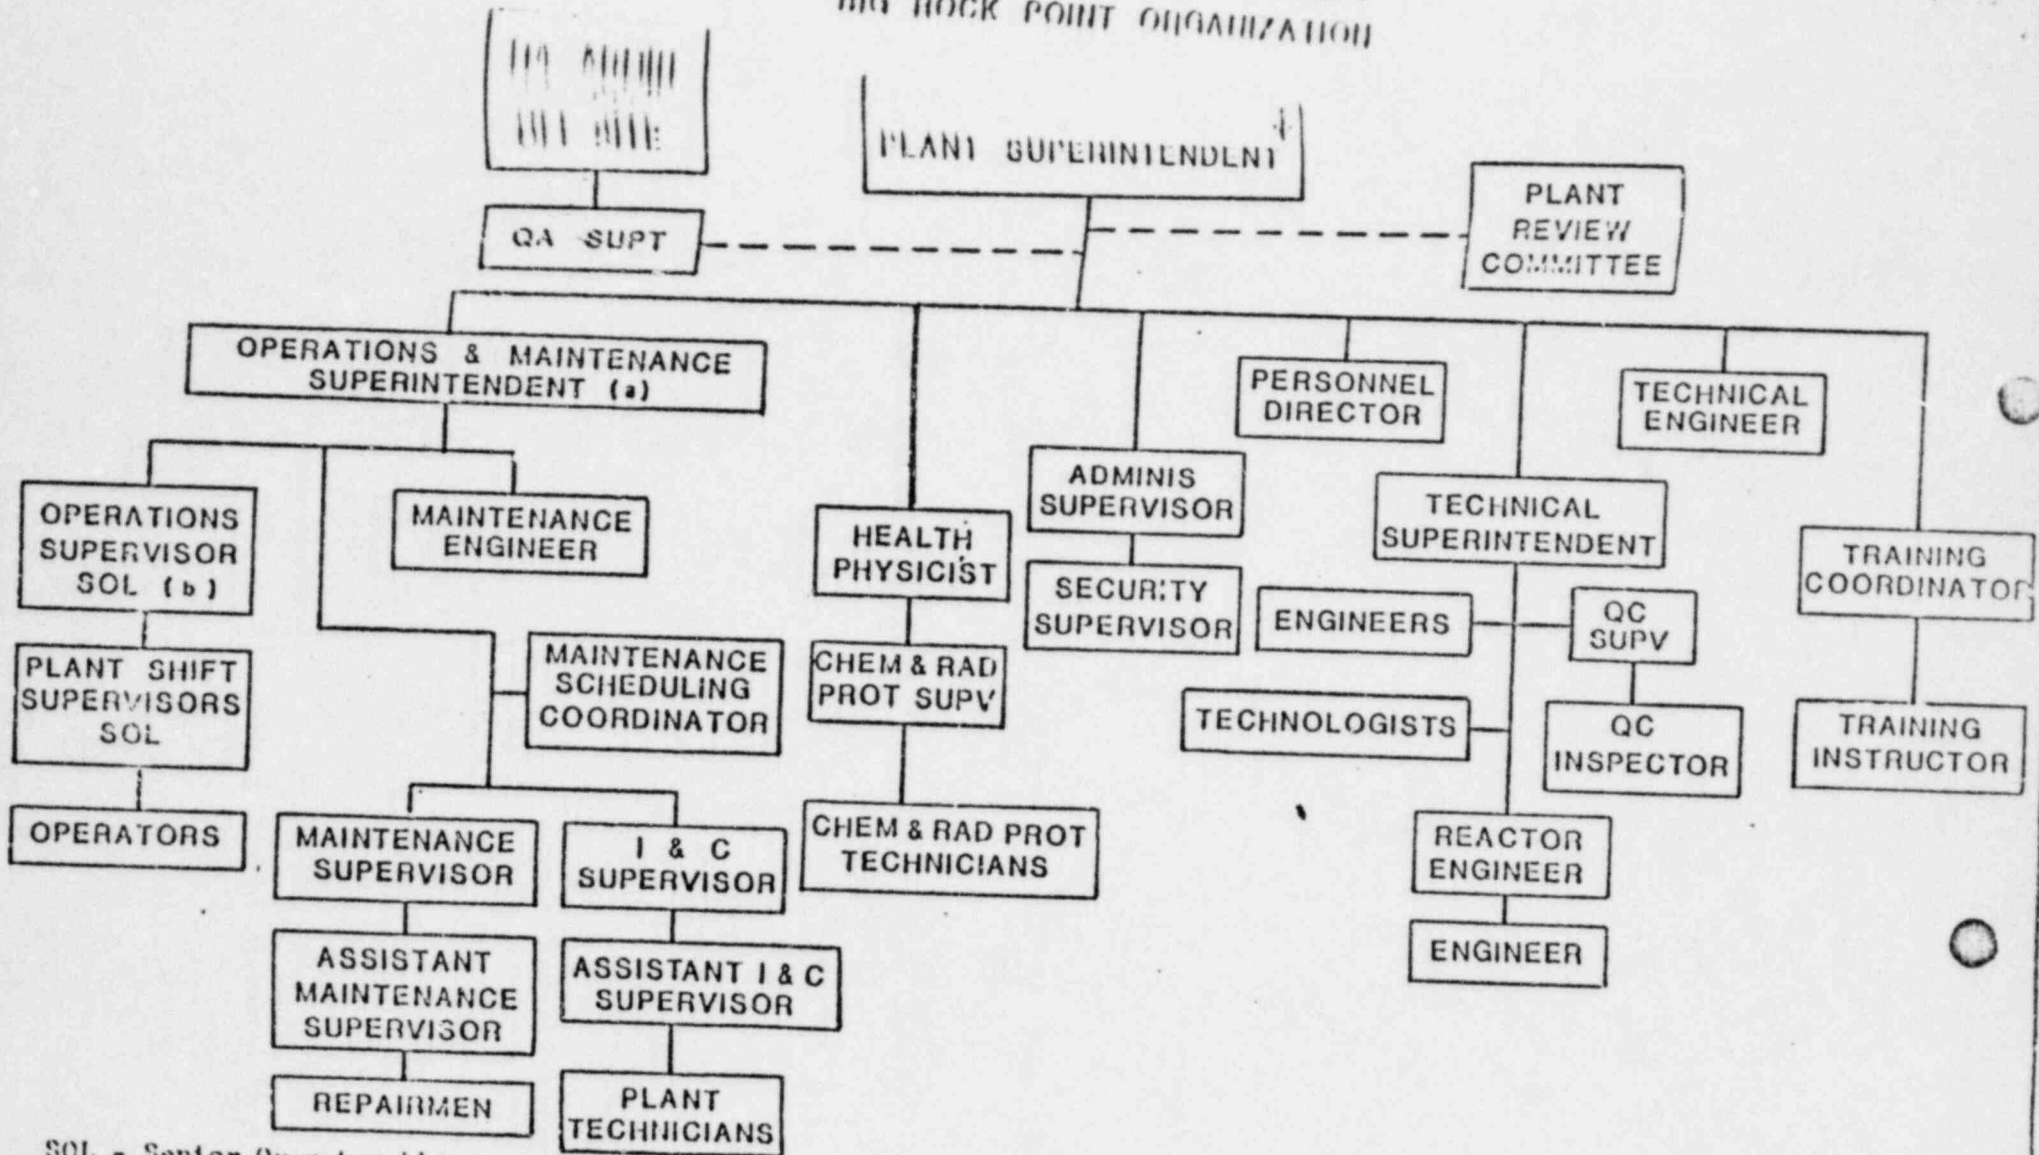

SOL - Senior Operator Licensee

- (a) The Operations & Maintenance Superintendent need not hold an SOL provided he meets the other requirements of 6.3.1 of these specifications and the position of "Operations Supervisor" is filled. Under these conditions, the Operations Supervisor shall be responsible for directing the activities of licensed operators.
- (b) This position need not be filled if the Operations & Maintenance Superintendent holds an SOL.

\*Responsible for overall implementation of the plant Fire Protection Program.

6.4 TRAINING

- 6.4.1 A retraining and replacement training program for the plant staff shall be maintained under the direction of the Plant Superintendent and shall meet or exceed the requirements and recommendations of Section 5.5 of ANSI N18.1-1971 and Appendix "A" of 10 CFR, Part 55.
- 6.4.2 A training program for the Fire Brigade shall be maintained under the direction of the Plant Training Coordinator and shall meet or exceed the requirements of Section 27 of the NFPA Code-1975 except for Fire Brigade training sessions which shall be held at least quarterly.

6.5 REVIEW AND AUDIT

6.5.1 PLANT REVIEW COMMITTEE (PRC)

- 6.5.1.1 The Plant Review Committee (PRC) shall function to advise the Plant Superintendent on all matters related to nuclear safety.

6.5.1.2 COMPOSITION

The PRC shall be composed of the:

Chairman: Plant Superintendent  
Member: Operations and Maintenance Superintendent  
Member: Technical Superintendent  
Member: Operations Supervisor  
Member: Instrument and Control Supervisor  
Member: Reactor Engineer  
Member: Health Physicist  
Member: Shift Supervisor  
Member: Maintenance Engineer

6.5.1.3 ALTERNATES

Alternate members shall be appointed in writing by the PRC Chairman to serve on a temporary basis; however, no more than two alternates shall participate in PRC activities at any one time.

CONSUMERS POWER COMPANY

DOCKET NO. 50-155

BIG ROCK POINT NUCLEAR PLANT

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 19  
License No. DPR-b

1. The Nuclear Regulatory Commission (the Commission) has found that:
  - A. The application for amendment by Consumers Power Company (the licensee) dated April 26, 1978, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's rules and regulations set forth in 10 CFR Chapter I;
  - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
  - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
  - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
  - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.

DUPLICATE DOCUMENT

Entire document previously entered into system under:

ANO 7809280153

No. of pages: 7

OFFICE →					
SURNAME →					
DATE →					