


ITEM NO	NO REQD	FART NO	SIZE	DESCRIPTION
1	1		W 8 x 20 2'-3 LG	
2	1		6" Ø PIPE STATIONION 1'-0" LG	
3	1	SP-2000	2B P.P. 2' 9 7/8" PIPE STRUT LESS PIPE X=8 Y=6	
4	1		R 1/2" x 10" x 0" 10"	
5	1		2 1/2" Ø SCH 80 PIPE 1'-7 1/8" LG	
6	1	2003	20 END ATTACHMENT	
7	1		R 1/2" x 6" x 0" 6"	
8	2		L 3 1/2" x 3 1/2" x 7/8" 2'-0" LG	
9	1		R 1/2" x 6" x 0" 6"	

FOR MSRV GENERAL NOTES AND DETAILS SEE DWG MSRV 1 & MSRV 2

FORCES lb	FX	FY	FZ
POS	---	9350	---
NEG	---	20000	---
MVMTS in	X	Y	Z
THERMAL	-.002	---	.8"
SEISMIC	.004	---	.001
CRV	.023	---	.010

Problem No. 224 Stress No. S-01  
 Issue 02  
 Data Pt. 48 Nuclear Class. N.A.

STRESS ISO H-1928H REV-B

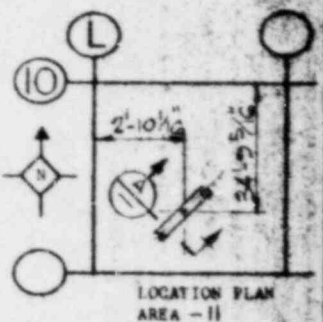

REV	DATE	REVISIONS	BY	CHK	DESIGN	ENGR	INSP	APPR
1		REV PER NEW Dwg. 1 AS NOTED	RW	HL	HL	HL	HL	NR
2		REV AS NOTED	RH	HL	HL	HL	HL	NR
3		ISSUED FOR CONSTRUCTION	HL	HL	HL	HL	HL	NR

MISSISSIPPI POWER & LIGHT COMPANY  
 GRAND GULF NUCLEAR STATION  
 UNIT - 1

PIPE SUPPORTS  
 CONTAINMENT  
 MSRV LINE-1G

JOB NO. 9645

DRAWING NO/MARK NO. NIB 21G 025 HOI

REV. 2

100 HL-1928H  
 REF DWGS PIPE M-1301  
 STEEL C-10858

SHEET 1 OF 1