


FGE Portland General Electric Company

Charles Goodwin, Jr. Assistant Vice President

June 24, 1980

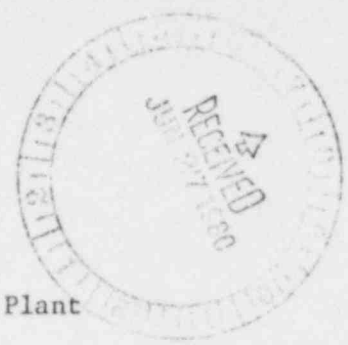

Trojan Nuclear Plant
Docket 50-344
License NPF-1

Mr. R. H. Engelken, Director
U. S. Nuclear Regulatory Commission
Region V
Suite 202, Walnut Creek Plaza
1990 N. California Blvd.
Walnut Creek, CA 94596

Dear Sir:

On December 31, 1979 we supplemented our letter of September 14, 1979 in response to IE Bulletin 79-01A concerning the use of ASCO solenoid valves in safety-related systems in nuclear power plants. In our response of December 31, we provided a list of ASCO valves that we intended to replace with functionally equivalent and environmentally qualified NP-1 Type ASCO solenoid valves. Furthermore, in our letter of December 31, we stated that "every effort will be made to procure and install these valves prior to startup of Cycle 3 refueling".

At the present time, all ASCO solenoid valves, with the exception of SV 8026 "pressurizer relief tank to auto gas analyzer" in the process sampling system, have been replaced with qualified valves of the NP-1 Type. Due to equipment and system layout, a replacement valve for SV 8026 could not be installed during this outage; another replacement valve has to be ordered for installation in this specific instance. We anticipate delivery of the necessary components in approximately 20 weeks; therefore, installation should be completed no later than startup after our next refueling shutdown which is tentatively scheduled for the spring of 1981. Should the schedule permit, the valve SV 8026 will be replaced sooner.

Sincerely,

C. Goodwin, Jr.
Assistant Vice President
Thermal Plant Operation and
Maintenance

CG/GAZ/4jcd6B14

c: Mr. Lynn Frank, Director
State of Oregon
Department of Energy

8007290 889

121 S.W. Salmon Street, Portland, Oregon 97204

80-151