



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

VIRGINIA ELECTRIC AND POWER COMPANY

DOCKET NO. 50-280

SURRY POWER STATION, UNIT NO. 1

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No.59
License No. DPR-32

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by Virginia Electric and Power Company (the licensee) dated May 16, 1980, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.

8008140 061

2. Revise paragraph 3.E as follows:

E. Steam Generator Inspection

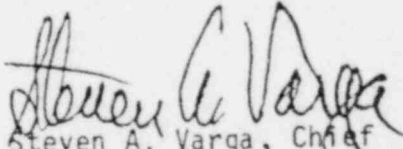
- (1) Unit No. 1 shall be brought to the cold shutdown condition in order to perform an inspection of the steam generators within six months of equivalent operation from May 11, 1980.

Nuclear Regulatory Commission (NRC) approval shall be obtained before resuming power operation following this inspection.

Equivalent operation is defined as operation with the reactor coolant at or above 350°F.

- (2) Reactor coolant leakage from the reactor coolant system (RCS) to the secondary system (SS) through the steam generator tubes shall be limited to 0.3 gpm per steam generator, as described in the NRC Safety Evaluation of May 6, 1977. With any steam generator tube leakage greater than this limit the reactor shall be brought to the cold shutdown condition within 24 hours. NRC approval shall be obtained before resuming reactor operation.
- (3) Reactor operation shall be terminated if RCS to SS leakage which is attributable to two or more steam generator tubes occurs during a 20 day period. NRC approval shall be obtained before resuming reactor operation.
- (4) The concentration of radioiodine in the reactor coolant shall be limited to 1 μ Ci/gram during normal operation and to 10 μ Ci/gram during transients as defined in Appendix A-1 to the Technical Specifications of the license. Appendix A-1 was issued with the May 6, 1977 Order and shall remain in effect for six equivalent months from May 11, 1980.

FOR THE NUCLEAR REGULATORY COMMISSION


Steven A. Varga, Chief
Operating Reactors Branch #1
Division of Licensing

Date of Issuance: July 28, 1980