

TIC

BALTIMORE GAS AND ELECTRIC COMPANY

P. O. BOX 1475
BALTIMORE, MARYLAND 21203

August 21, 1980

ARTHUR E. LUNDVALL, JR.
VICE PRESIDENT

SUPPLY

Mr. Boyce H. Grier, Director
Office of Inspection & Enforcement
Region I
U. S. Nuclear Regulatory Commission
631 Park Avenue
King of Prussia, PA 19406

Subject: Calvert Cliffs Nuclear Power Plant
Units Nos. 1 & 2, Dockets Nos. 50-317 & 50-318
IE Bulletin 80-15

Dear Mr. Grier:

The subject Bulletin identified a possible loss of the Emergency Notification System (ENS) with loss of off-site power.


Although Calvert Cliffs does not have a "station package requiring on-site power" as indicated in the Bulletin, we do have supplementary equipment which requires a local 110 volt power supply. It was determined that loss of off-site power would render this local equipment and the ENS system inoperable. The NRC Operations Center was notified of this finding via the ENS telephone on June 26 by our Operations personnel.

Subsequently, a Standing Instruction was issued to the control room operators directing them to notify the NRC Operations Center within one hour when the ENS is found to be inoperable for any reason. In addition, C&P Telephone Co. is presently modifying the on-site ENS equipment to be fed from our "Dimension" telephone power supply. This will provide a continuous DC supply with a battery backup as required by the subject Bulletin.

According to C&P Telephone officials, this modification will be completed by September 8, at which time we will conduct a test to simulate loss of off-site power to verify that the ENS telephones remain operable.

Should you have any questions regarding the actions outlined above, please call.

Very truly yours,

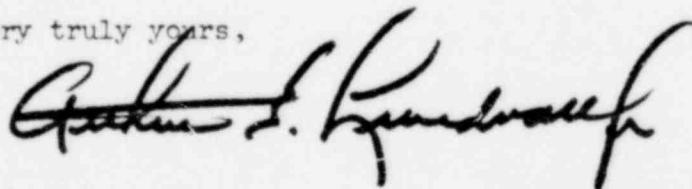

cc: J. A. Biddison, Esquire
G. F. Trowbridge, Esquire
Director, Inspection & Enforcement
Washington, D. C. 20555

8816020

211

