

8010080 340

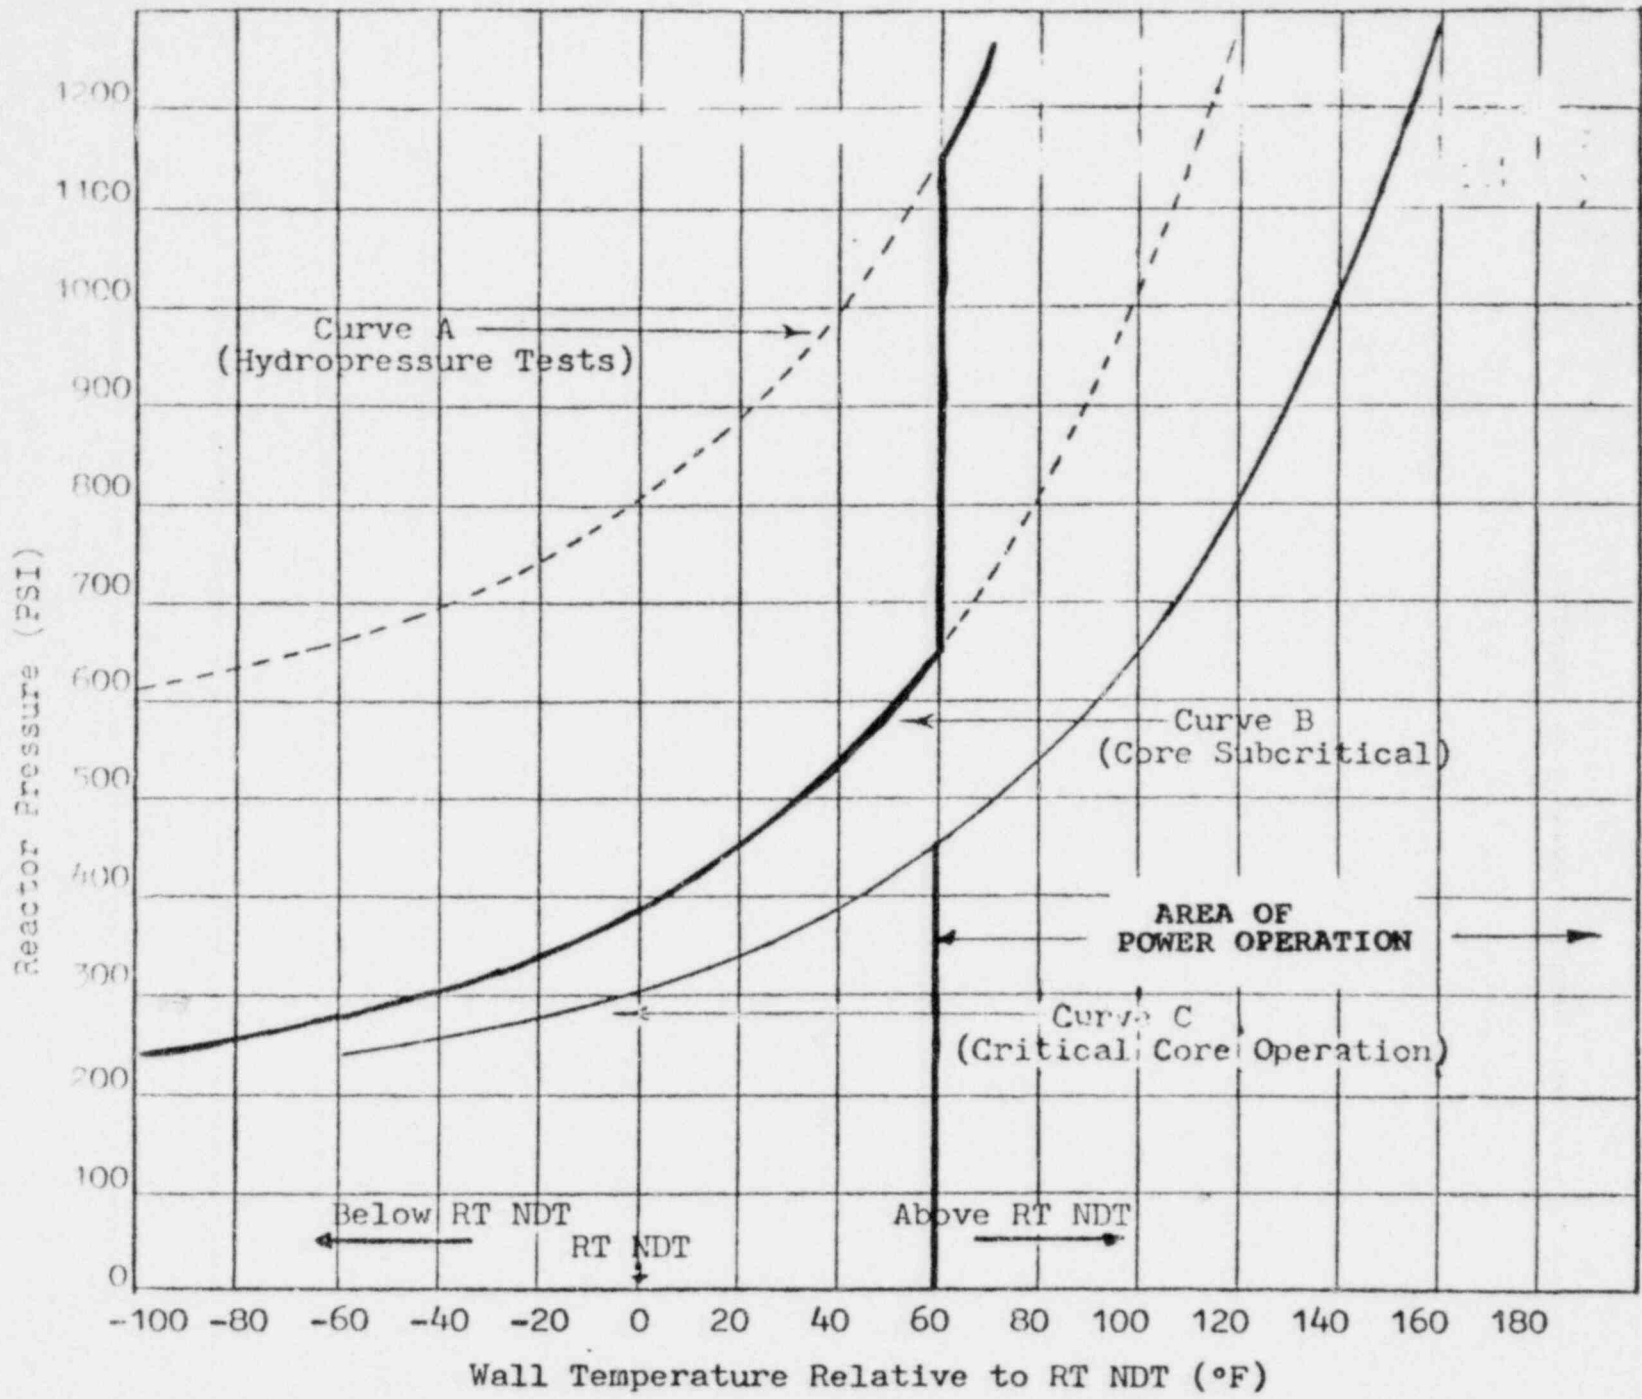


Figure 4.6.2 Pressure-Temperature Relationships for Dresden 1 Per 10CRF50 Appendix G

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL

FILE NUMBER

TO: Mr. Benard C. Rusche		FROM: Commonwealth Edison Chicago, Illinois R. L. Bolger		DATE OF DOCUMENT 8/19/76	
<input checked="" type="checkbox"/> LETTER <input checked="" type="checkbox"/> ORIGINAL <input type="checkbox"/> COPY		<input checked="" type="checkbox"/> NOTORIZED <input checked="" type="checkbox"/> UNCLASSIFIED	PROP	INPUT FORM	DATE RECEIVED 8/26/76
NUMBER OF COPIES RECEIVED Three signed 37 copies encl recvd.					

DESCRIPTION

Ltr. notorized 8/19/76 w/attached figure 4.6.2...re their 11/25/75 ltr & our 2/2/76 ltr....Amdt to ol/change to Appendix A tech specs....concerning operation at elevated minimum pressurization temperatures.

(3-P)

PLANT NAME:
Dresden #1

ENCLOSURE

ACKNOWLEDGED
DO NOT REMOVE

POOR ORIGINAL

SAFETY		FOR ACTION/INFORMATION		ENVIRO	8/26/76	RJL
ASSIGNED AD:				ASSIGNED AD:		
<input checked="" type="checkbox"/> BRANCH CHIEF:	Ziemann (6)			BRANCH CHIEF:		
<input checked="" type="checkbox"/> PROJECT MANAGER:	Converse			PROJECT MANAGER:		
<input checked="" type="checkbox"/> LIC. ASST.:	Diggs			LIC. ASST.:		

INTERNAL DISTRIBUTION			
<input checked="" type="checkbox"/> REG FILE	SYSTEMS SAFETY		PLANT SYSTEMS
<input checked="" type="checkbox"/> NRC PDR	HEINEMAN		TEDESCO
<input checked="" type="checkbox"/> I & E (2)	SCHROEDER		BENAROYA
<input checked="" type="checkbox"/> OELD			LAINAS
<input checked="" type="checkbox"/> GOSSICK & STAFF	ENGINEERING		IPPOLITO
MIPC	MACCARRY		KIRKWOOD
CASE	KNIGHT		
HANAUER	SIHWEIL		OPERATING REACTORS
HARLESS	PAWLICKI		STELLO
PROJECT MANAGEMENT	REACTOR SAFETY		OPERATING TECH.
BOYD	ROSS	<input checked="" type="checkbox"/>	EISENHUT (LTH.)
P. COLLINS	NOVAK	<input checked="" type="checkbox"/>	SHAO
HOUSTON	ROSZTOCZY	<input checked="" type="checkbox"/>	BAER
PETERSON	CHECK	<input checked="" type="checkbox"/>	BUTLER
MELTZ		<input checked="" type="checkbox"/>	GRIMES
HELTENES	AT & I		
SKOVHOLT	SALZMAN		
	RUTBERG		

EXTERNAL DISTRIBUTION:		CONTROL NUMBER
<input checked="" type="checkbox"/> NRC: NONE	NAT LAB:	
<input checked="" type="checkbox"/> AEC:	BEC, VIE	
<input checked="" type="checkbox"/> I&E:	LA PDR	
<input checked="" type="checkbox"/> ASST:	CONSULTANTS	
<input checked="" type="checkbox"/> CMS/6 BY	SENT: Diggs	8702