



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

DUQUESNE LIGHT COMPANY

OHIO EDISON COMPANY

PENNSYLVANIA POWER COMPANY

DOCKET NO. 50-334

BEAVER VALLEY POWER STATION, UNIT NO. 1

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 37
License No. DPR-66

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by Duquesne Light Company, Ohio Edison Company, and Pennsylvania Power Company (the licensees) dated November 17, 1977, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.

8102170475


2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and paragraph 2.C.(2) of Facility Operating License No. DPR-66 is hereby amended to read as follows:

(2) Technical Specifications

The Technical Specifications contained in Appendices A and B, as revised through Amendment No. 37, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications.

3. This license amendment is effective as of the date of its issuance.

FOR THE NUCLEAR REGULATORY COMMISSION

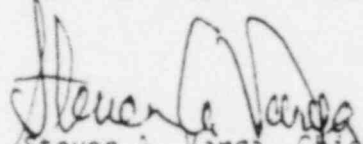
Steven A. Varga, Chief
Operating Reactors Branch #1
Division of Licensing

Attachment:
Changes to the Technical
Specifications

Date of Issuance: February 2, 1981

ATTACHMENT TO LICENSE AMENDMENT

AMENDMENT NO. 37 TO FACILITY OPERATING LICENSE NO. DPR-66

DOCKET NO. 50-334

Revise Appendix A as follows:

Remove Pages

3/4 6-7

3/4 6-8

3/4 6-9

Insert Pages

3/4 6-7

3/4 6-8

3/4 6-9

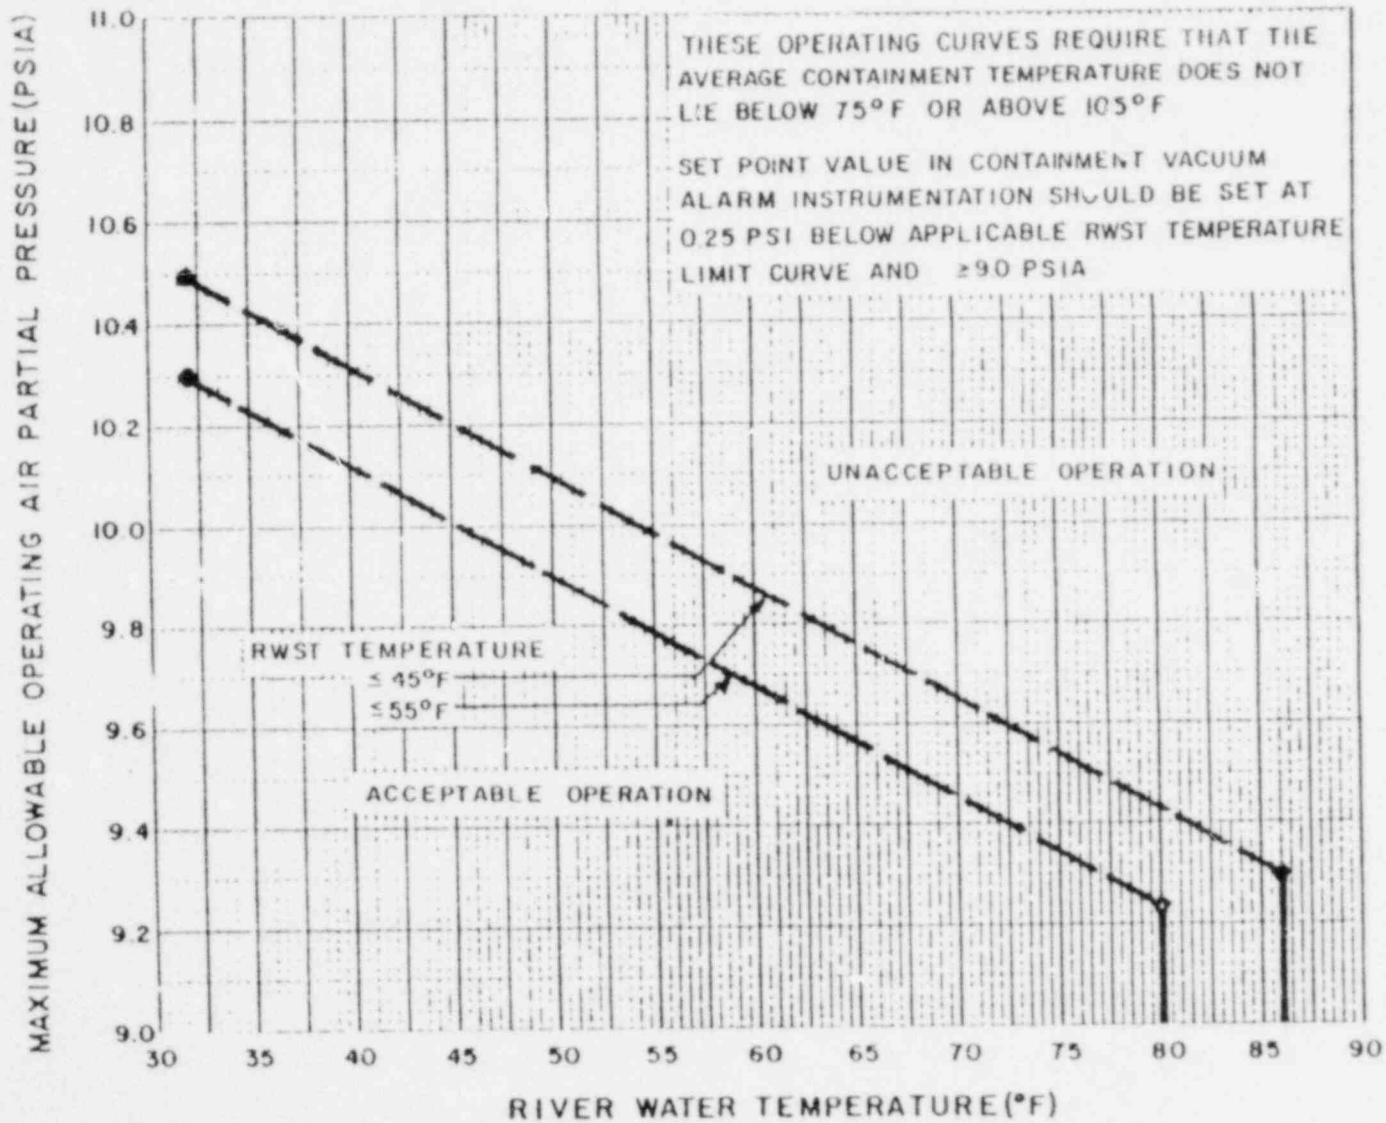


FIGURE 3.6-1 MAXIMUM ALLOWABLE PRIMARY CONTAINMENT AIR PRESSURE VERSUS RIVER WATER TEMPERATURE AND RWST WATER TEMPERATURE

CONTAINMENT SYSTEMS

AIR TEMPERATURE

LIMITING CONDITION FOR OPERATION

3.6.1.5 Primary containment average air temperature shall be maintained $\leq 105^{\circ}\text{F}$ and $\geq 75^{\circ}\text{F}$.

APPLICABILITY: MODES 1, 2, 3 and 4.

ACTION:

With the containment average air temperature $> 105^{\circ}\text{F}$ or $< 75^{\circ}\text{F}$ restore the average air temperature to within the limit within 8 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.6.1.5 The primary containment average maximum and minimum air temperatures shall be the arithmetical average of the temperatures at the following locations and shall be determined at least once per 24 hours. The nearest alternate thermocouple may be used for temperature determination up to a maximum of one per location.

Location

- a. Reactor Head Storage Area - Elev. 802
- b. Pressurizer Cubicle - Elev. 740
- c. Annulus - Elev. 777
- d. RHR Heat Exchanger - Elev. 730
- e. Annulus - Elev. 701

Figure 3.6-2

This Figure has been deleted.

The technical specification for Initial Average Containment Temperature has been incorporated into 3.6.1.5 (Page 3.6-8) and Figure 3.6-1 (Page 3.6-7).