


POOR ORIGINAL

480V. AC AUX. BLDG. E.S.S. M.C.C. 1372
COMPT. A2

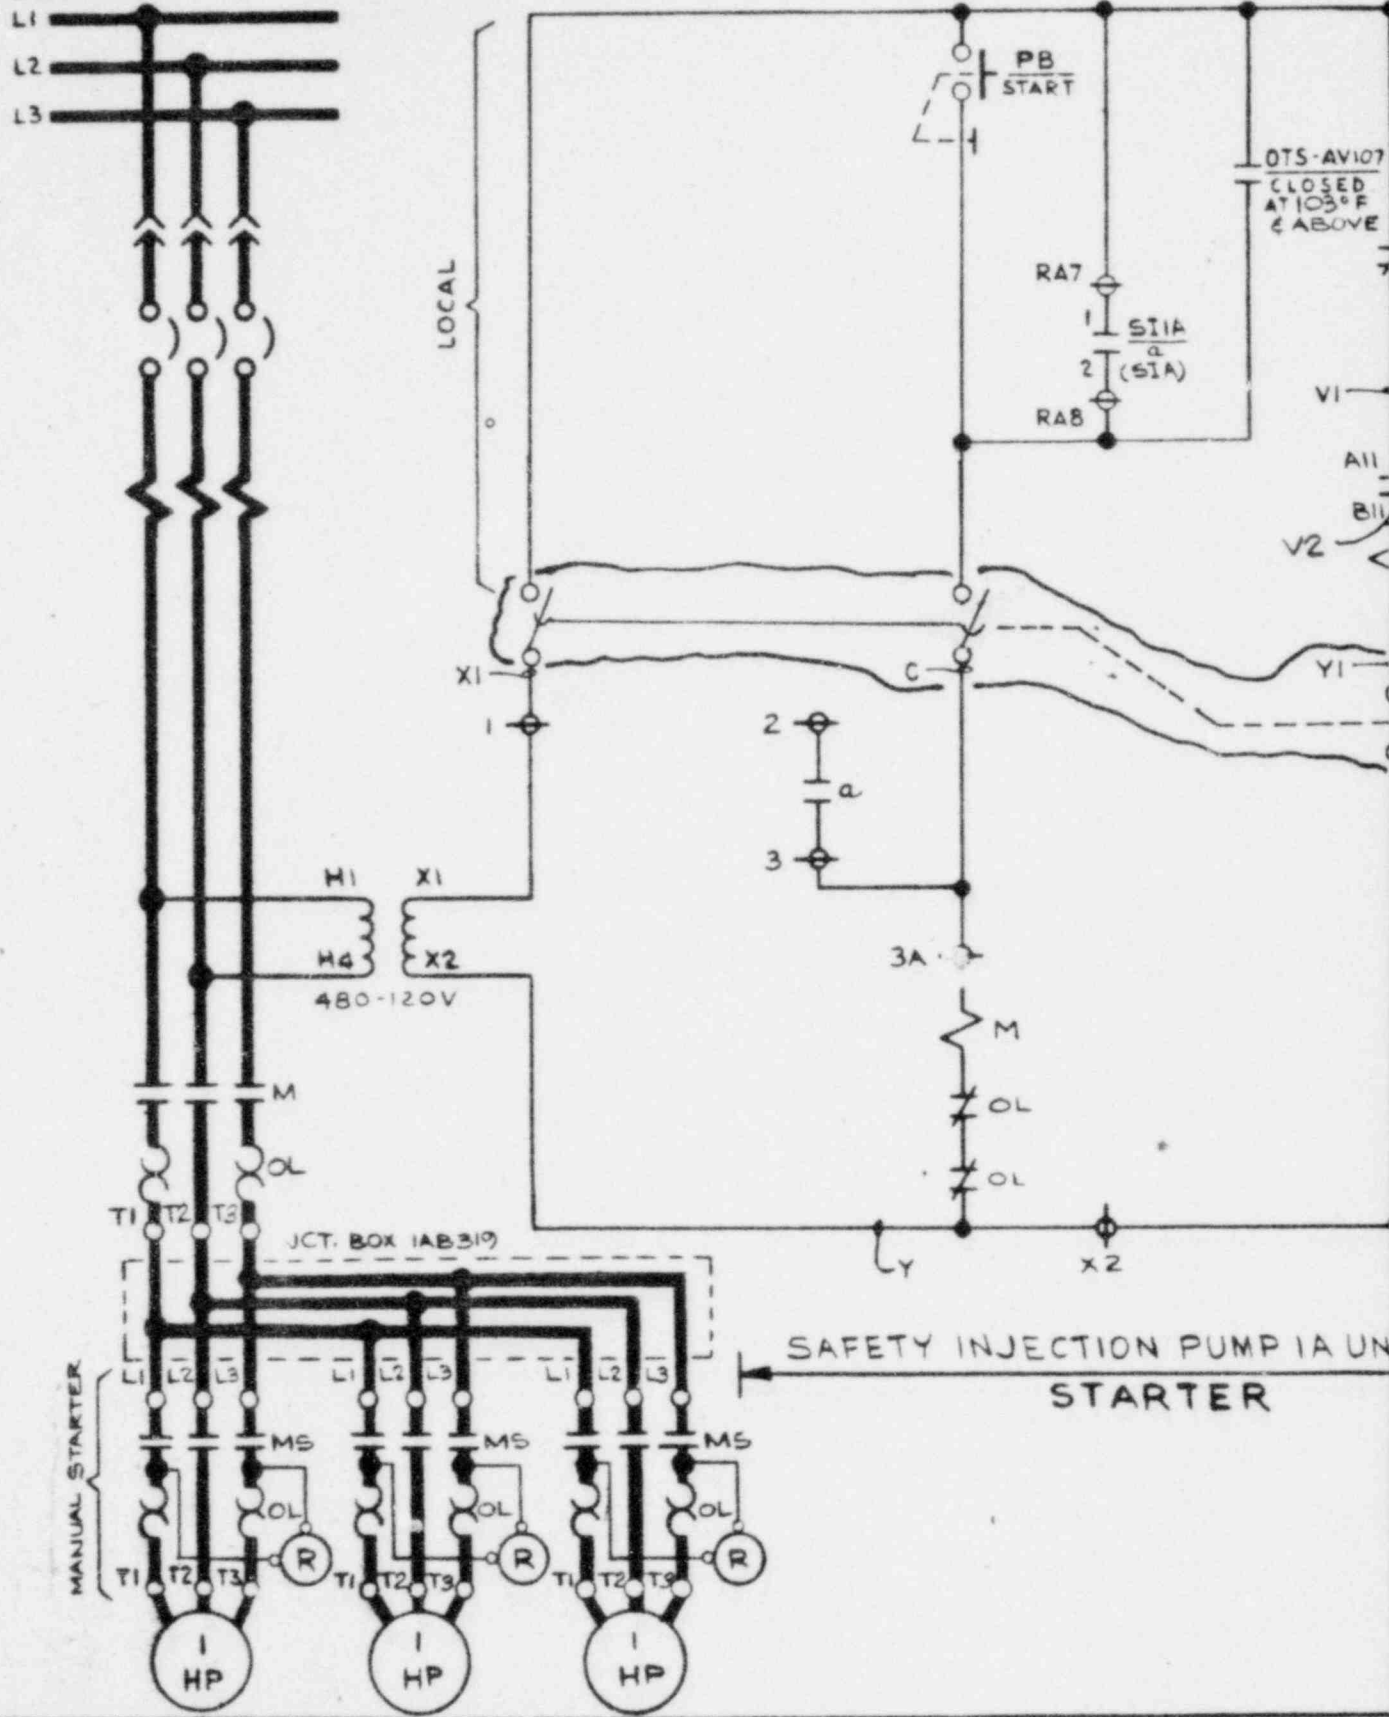

REVISIONS


A	9-10-71	J.S	FOR CONSTRUCTION SPEC. X 8229		
B	5-26-72	J.S	REVISED WIRE CODE		
C	6-16-72	J.S.	ADDED TEMP. SW. SETTING SHIELDS		
D	8-30-73	MM	REV. CONTACT SET POINT MAN. STARTER. ADPL. NOTES		

DRAWN F. HOF
CHECKED JRI SE
ENGINEER *B.R.*


8011260234

POOR ORIGINAL

INSTR. NO. OHS-AV107A



SEE P. AV100, DET. D15 FOR CS DEVELOPMENT

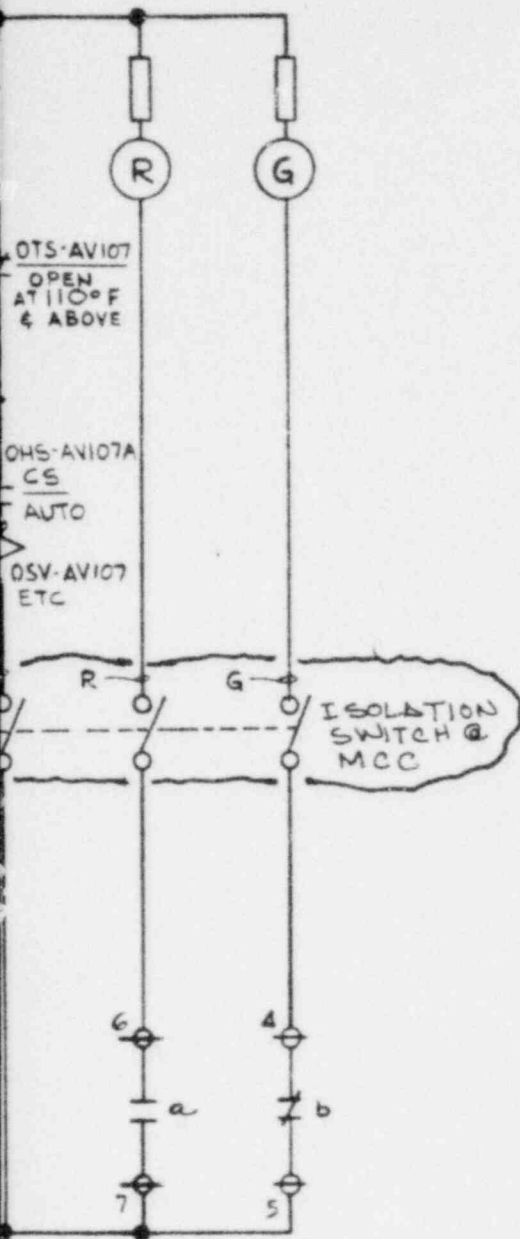

NOTES-

1. ETO - ENERGIZE TO OPEN
2. ETC - ENERGIZE TO CLOSE
- 3a. ENERGIZE REFERS TO SOL. VALVE COIL CONDITION
- 3b. "OPEN" OR "CLOSE" REFERS TO ACTION OF DEVICE CONTROLLED BY THE SOL. VALVE

PRELIMINARY

IAV007

DATE	SAFETY INJECTION PUMP IA UNIT COOLER		
8-31-71		SCHEMATIC DIAGRAM ZION STATION UNIT 1 COMMONWEALTH EDISON CO CHICAGO ILLINOIS	JOB NO.
9-10-71			3782
<i>Revised 9/10/71</i>			PAGE AV3

ERASE WITH WATER