


SOURCE

CONDITION

CONTROL ACTION

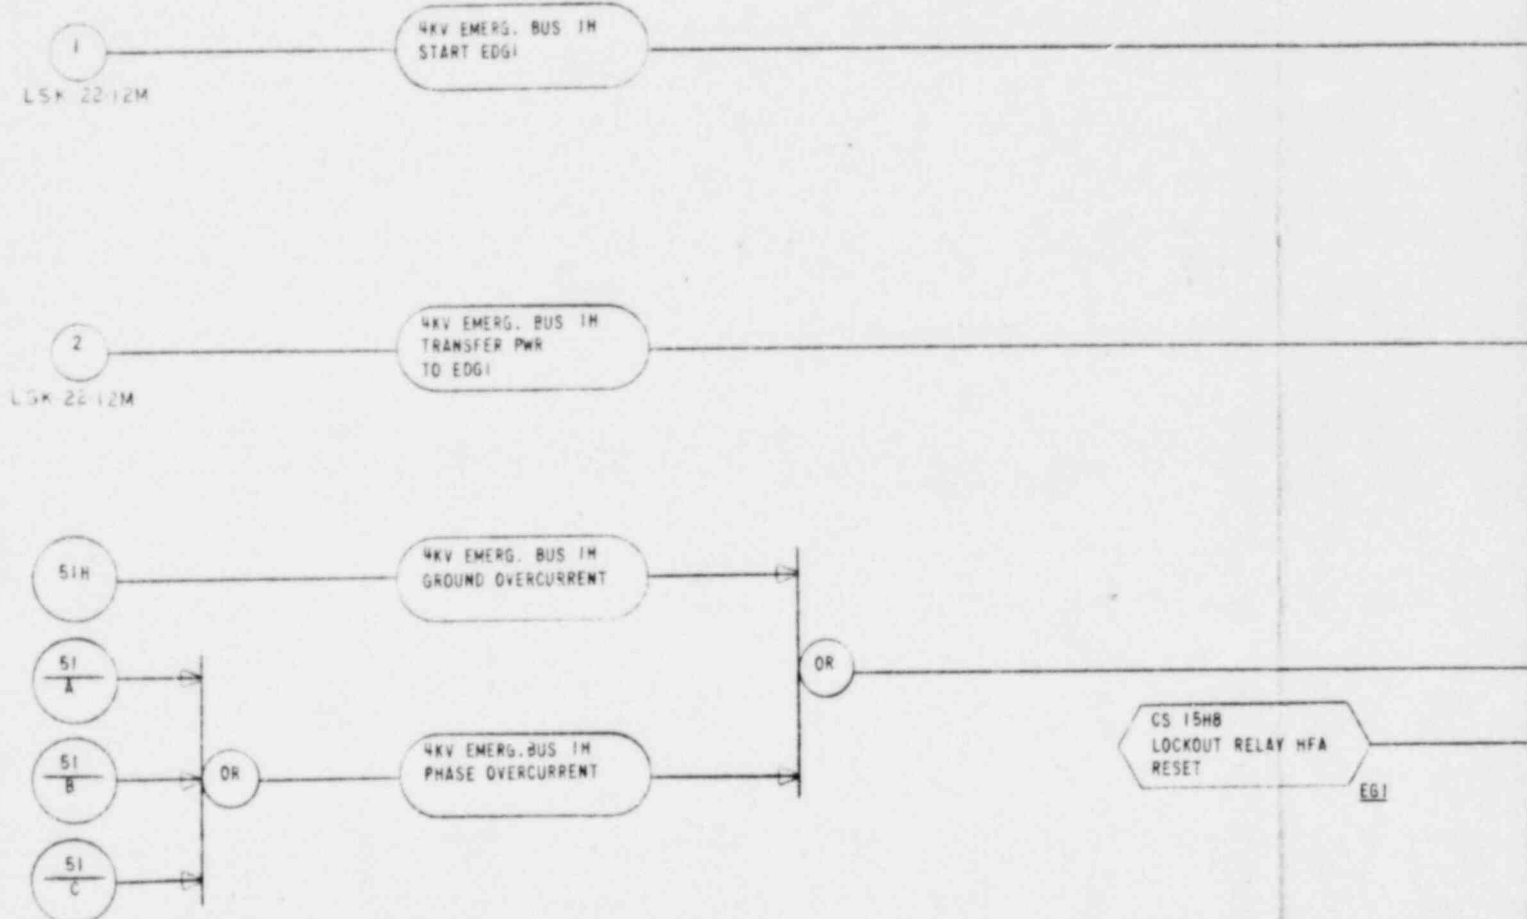

NOTE: 4KV EMERG. BUS 1H ACB 15HB SHOWN
 4KV EMERG. BUS 1J ACB 15JB SIMILAR
 ASSOCIATED EQUIPMENT MARK NOS.
 EMERG. GEN 3 & ACB 15J3
 RES CUP ACB 15D1
 STUB ACB 15J9, 15J10, 15J11

DATE	
C	
P	7
E	


A | B | C | D | E | F | G | H | J | K | L | M |

8105280306

POOR ORIGINAL

RESULTANT

MONITOR

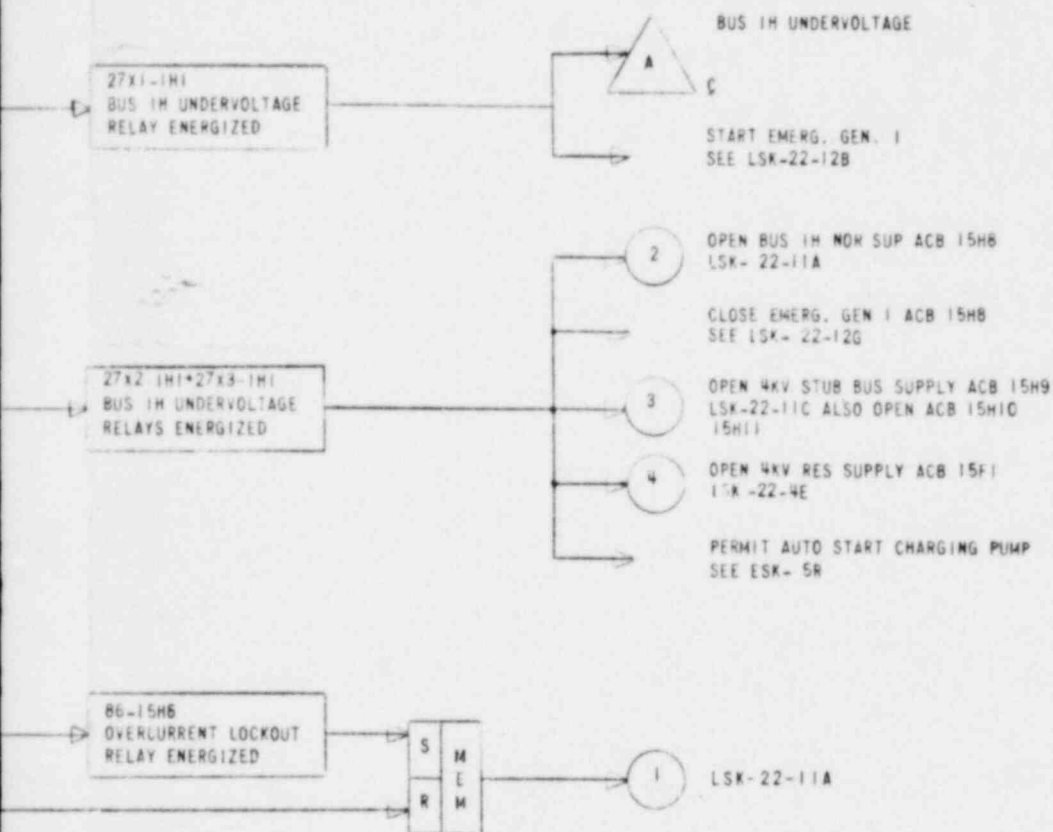

LOGIC DIAGRAM

4KV EMERG. BUS 1H & 1J ACB TRIPS

SURRY POWER STATION - UNIT NO. 1

VIRGINIA ELECTRIC AND POWER COMPANY

STONE & MEYER ENGINEERING CORPORATION



10-10-55 10-10-56

5 5 4 3 2 1
N P O R S T U V W

POOR ORIGINAL