


MATERIAL PROPERTY BASIS:

LCA 188
Attachment B
Page 1 of 1

CONTROLLING MATERIAL : R.V. LOWER SHELL
 COPPER CONTENT : 0.16 WT%
 PHOSPHORUS CONTENT : 0.012 WT%
 INITIAL RT_{NDT} : 10°F
 RT_{NDT} AFTER 10 EPFY : ¼T, 111°F
 : ¾T, 55°F

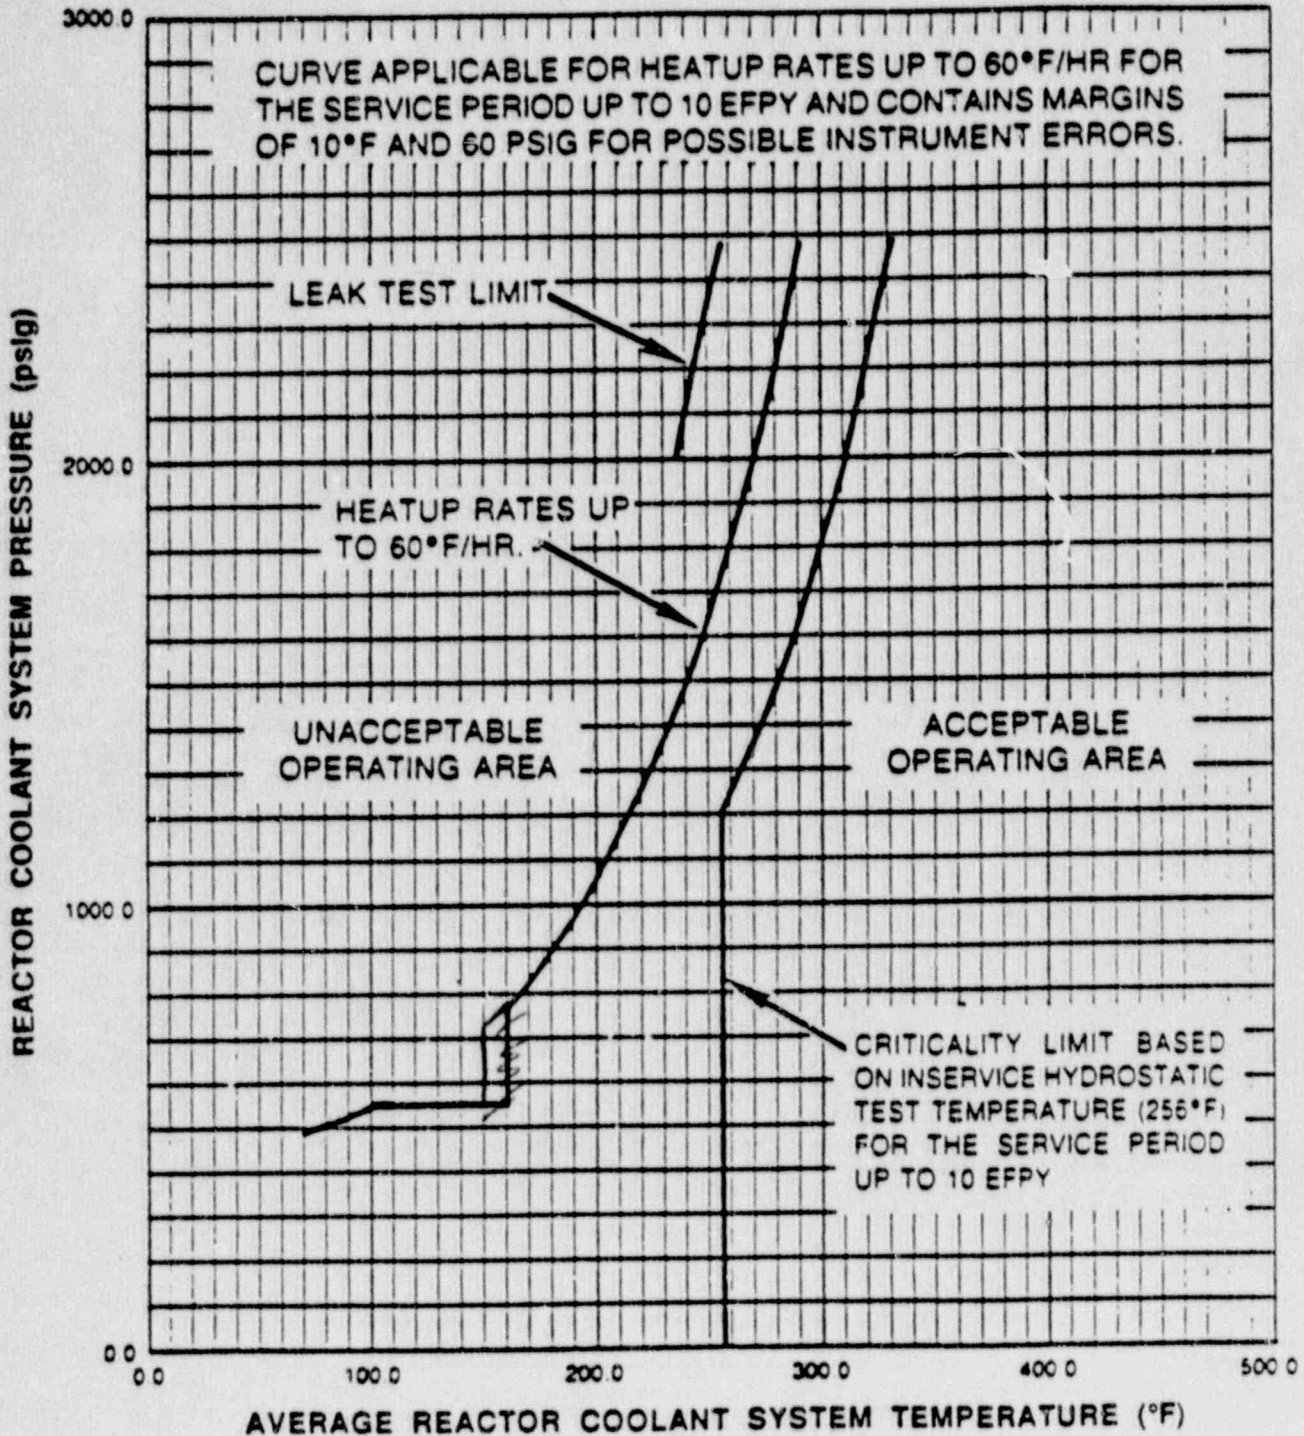

127

FIGURE 3.4-2 REACTOR COOLANT SYSTEM PRESSURE — TEMPERATURE LIMITS VERSUS 60°F/HOUR HEATUP RATE — CRITICALITY LIMIT AND HYDROSTATIC TEST LIMIT

9001040015 871220
PBR APOCK 05000344
EDC

UNITED STATES OF AMERICA
NUCLEAR REGULATORY COMMISSION


In the Matter of)
)
PORTLAND GENERAL ELECTRIC COMPANY,) Docket 50-344
THE CITY OF EUGENE, OREGON, AND) Operating License NPF-1
PACIFIC POWER & LIGHT COMPANY)
)
(TROJAN NUCLEAR PLANT))

CERTIFICATE OF SERVICE

I hereby certify that copies of License Change Application 188 to the Operating License for Trojan Nuclear Plant, dated December 20, 1989, have been served on the following by hand delivery or by deposit in the United States mail, first class, this 20th day of December 1989:

State of Oregon
Department of Energy
625 Marion St NE
Salem OR 97310


Mr. Michael J. Sykes
Chairman of County Commissioners
Columbia County Courthouse
St. Helens OR 97051



S. A. Bauer, Manager
Nuclear Regulation Branch
Nuclear Safety & Regulation

Subscribed and sworn to before me this 20th day of December 1989.




Notary Public of Oregon

My Commission Expires:

