




Arkansas Power & Light Company  
Arkansas Nuclear One  
Route 3, Box 137 G  
Russellville, AR 72801  
Tel 501 964 3100

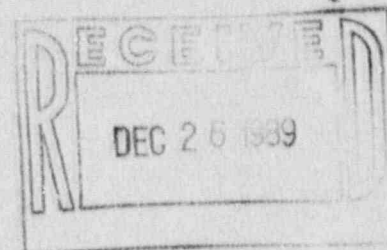

December 20, 1989

ØCAN128917

Mr. Sam Collins, Director  
Division of Reactor Projects  
Nuclear Regulatory Commission  
Region IV  
611 Ryan Plaza Drive, Suite 1000  
Arlington, Texas 76011

SUBJECT: Arkansas Nuclear One - Units 1 and 2  
Docket Nos. 50-313/50-368  
License Nos. DPR-51 and NPF-6  
T-95 Tape Splice Configuration for Limitorque  
Dual Voltage Motor Operators  
Inspection Report 50-313/89-37; 50-368/89-37

Dear Mr. Collins:

This letter provides the requested response to the subject inspection report and an update to previous discussions between your staff and Arkansas Power and Light Company (AP&L) management on December 19, 1989, regarding Okonite T-95 and Scotch 33 tape utilized in splicing electrical leads on Limitorque dual voltage motor operators.

Currently, startup operations activities are on hold until identified Okonite T-95 and Scotch 33 splicing configurations on environmentally qualified Limitorque dual voltage motor operators in high energy line break areas can be reworked. In a phone call on December 19, 1989, the NRC staff stated that an acceptable splicing configuration would be the application of Okonite T-95 and Okonite 35 tape if properly applied consistent with the Okonite NQRN-3 qualification report. AP&L currently considers its previous qualification documentation to be technically acceptable. However, the Scotch 33 tape will be removed and Okonite 35 applied to satisfy your staff questions. AP&L requests a formal reply regarding the verbal acceptance of Okonite T-95 and 35 tape configuration as discussed on December 19, 1989.

The subject inspection report, received on December 4, 1989, requested a response if stated commitments differed from our understanding of these commitments. No difficulties were noted with the commitments as stated, and the commitment to notify the NRC concerning actions to be taken regarding the taped splices is satisfied by this letter. However, clarification is needed concerning AP&L's reevaluation of the ANO 10CFR Part 21 program.

9001080051 891220  
PDR ADCK 05000313  
PDC

IC-89-731

An Entergy Company


10  
IEO

Mr. Sam Collins  
December 20, 1989  
Page 1

The intent is to reevaluate the program, implement changes as needed, and ensure that certain selected previously closed 10CFR Part 21 reports had received an acceptable level of consideration. The initial review is presently underway and is expected to be completed by January 15, 1990.

If further information is requested, please contact Mr. James Fisicaro at (501) 964-3228.

Very truly yours,



E. C. Ewing  
General Manager,  
Technical Support  
and Assessment

ECE/RJK/sgw

cc:

U. S. Nuclear Regulatory Commission  
Document Control Desk  
Mail Station P1-137  
Washington, DC 20555

Regional Administrator  
Region IV  
U. S. Nuclear Regulatory Commission  
611 Ryan Plaza Drive, Suite 1000  
Arlington, TX 76011