



UNITED STATES  
NUCLEAR REGULATORY COMMISSION  
WASHINGTON, D. C. 20555

DUKE POWER COMPANY

DOCKET NO. 50-369

McGUIRE NUCLEAR STATION, UNIT 1

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 103  
License No. NPF-9

1. The Nuclear Regulatory Commission (the Commission) has found that:
  - A. The application for amendment to the McGuire Nuclear Station, Unit 1 (the facility) Facility Operating License No. NPF-9 filed by the Duke Power Company (the licensee) dated October 30, 1989, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's rules and regulations as set forth in 10 CFR Chapter I;
  - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
  - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations set forth in 10 CFR Chapter I;
  - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
  - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.

9002260299 900214  
PDR ADDCK 05000369  
P PNU


2. Accordingly, the license is hereby amended by page changes to the Technical Specifications as indicated in the attachment to this license amendment, and Paragraph 2.C.(2) of Facility Operating License No. NPF-9 is hereby amended to read as follows:

Technical Specifications

The Technical Specifications contained in Appendix A, as revised through Amendment No. 103, are hereby incorporated into the license. The licensee shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan.

3. This license amendment is effective as of its date of issuance.

FOR THE NUCLEAR REGULATORY COMMISSION



David B. Matthews, Director  
Project Directorate II-3  
Division of Reactor Projects-I/II  
Office of Nuclear Reactor Regulation

Attachment:  
Technical Specification  
Changes

Date of Issuance: February 14, 1990



UNITED STATES  
NUCLEAR REGULATORY COMMISSION  
WASHINGTON, D. C. 20555

DUKE POWER COMPANY

DOCKET NO. 50-370

McGUIRE NUCLEAR STATION, UNIT 2

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 85  
License No. NPF-17

1. The Nuclear Regulatory Commission (the Commission) has found that:
  - A. The application for amendment to the McGuire Nuclear Station, Unit 2 (the facility) Facility Operating License No. NPF-17 filed by the Duke Power Company (the licensee) dated October 30, 1989, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's rules and regulations as set forth in 10 CFR Chapter I;
  - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
  - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations set forth in 10 CFR Chapter I;
  - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
  - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.


2. Accordingly, the license is hereby amended by page changes to the Technical Specifications as indicated in the attachment to this license amendment, and Paragraph 2.C.(2) of Facility Operating License No. NPF-17 is hereby amended to read as follows:

Technical Specifications

The Technical Specifications contained in Appendix A, as revised through Amendment No. 85, are hereby incorporated into the license. The licensee shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan.

3. This license amendment is effective as of its date of issuance.

FOR THE NUCLEAR REGULATORY COMMISSION



David B. Matthews, Director  
Project Directorate II-3  
Division of Reactor Projects-1/II  
Office of Nuclear Reactor Regulation

Attachment:  
Technical Specification  
Changes

Date of Issuance: February 14, 1990

ATTACHMENT TO LICENSE AMENDMENT NO. 103

FACILITY OPERATING LICENSE NO. NFF-9

DOCKET NO. 50-369

AND

TO LICENSE AMENDMENT NO. 85

FACILITY OPERATING LICENSE NO. NPF-17

DOCKET NO. 50-370

Replace the following pages of the Appendix "A" Technical Specifications with the enclosed pages. The revised pages are identified by Amendment number and contain vertical lines indicating the areas of change. The corresponding overleaf pages are also provided to maintain document completeness.

Amended Page

3/4 9-10  
3/4 9-11  
B 3/4 9-2

Overleaf Page

3/4 9-9  
3/4 9-12  
B 3/4 9-1

REFUELING OPERATIONS

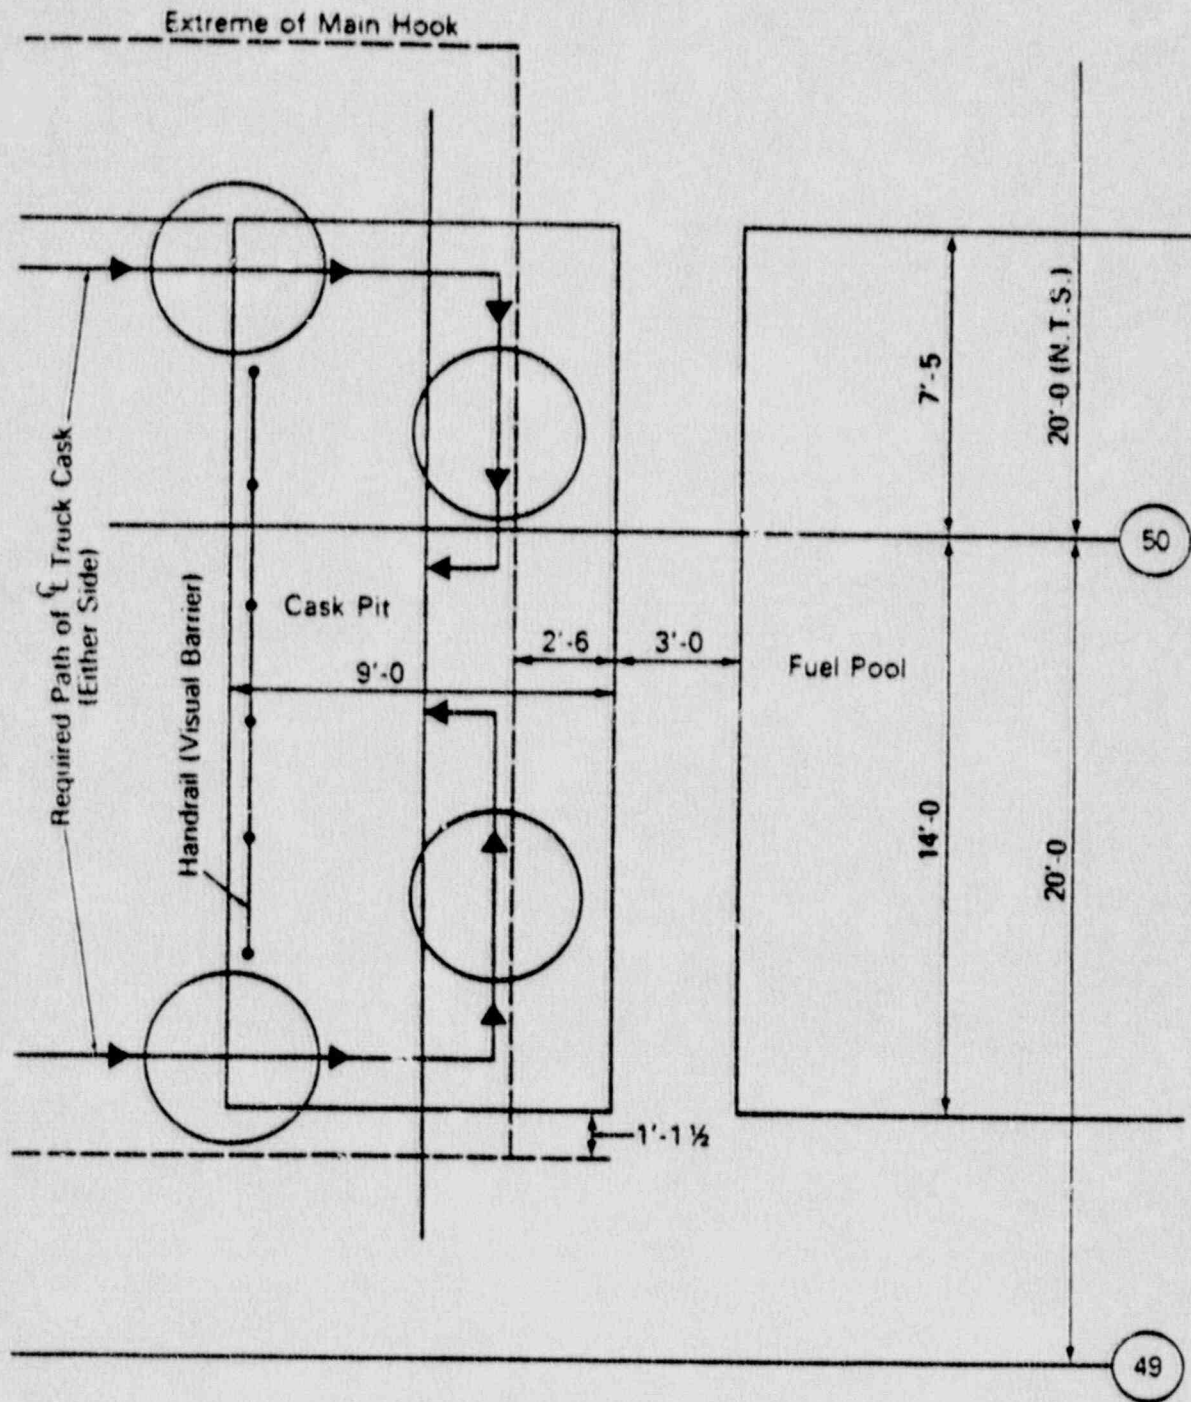


FIGURE 3.9-1  
REQUIRED PATH FOR MOVEMENT OF TRUCK CASKS

REFUELING OPERATIONS

3/4.9.8 RESIDUAL HEAT REMOVAL AND COOLANT CIRCULATION

HIGH WATER LEVEL

LIMITING CONDITION FOR OPERATION

---

---

3.9.8.1 At least one residual heat removal (RHR) loop shall be OPERABLE and in operation.\*

APPLICABILITY: MODE 6 when the water level above the top of the reactor vessel flange is greater than or equal to 23 feet.

ACTION:

With no RHR loop OPERABLE and in operation, suspend all operations involving an increase in the reactor decay heat load or a reduction in boron concentration of the Reactor Coolant System and immediately initiate corrective action to return the required RHR loop to OPERABLE and operating status as soon as possible. Close all containment penetrations providing direct access from the containment atmosphere to the outside atmosphere within 4 hours.

SURVEILLANCE REQUIREMENTS

---

---

4.9.8.1 At least once per 12 hours, one RHR loop shall be verified in operation and circulating reactor coolant at a flow rate:

- a. greater than or equal to 1000 gpm; and
- b. sufficient to maintain the RCS temperature at less than or equal to 140°F.

\*The RHR loop may be removed from operation for up to 1 hour per 8-hour period during the performance of CORE ALTERATIONS in the vicinity of the reactor vessel hot legs.

## REFUELING OPERATIONS

### LOW WATER

#### LIMITING CONDITION FOR OPERATION

---

---

3.9.8.2 Two independent residual heat removal (RHR) loops shall be OPERABLE, and at least one RHR loop shall be in operation.\*

APPLICABILITY: MODE 6 when the water level above the top of the reactor vessel flange is less than 23 feet.

#### ACTION:

- a. With less than the required RHR loops OPERABLE, immediately initiate corrective action to return the required RHR loops to OPERABLE status, or to establish greater than or equal to 23 feet of water above the reactor vessel flange, as soon as possible.
- b. With no RHR loop in operation, suspend all operations involving a reduction in boron concentration of the Reactor Coolant System and immediately initiate corrective action to return the required RHR loop to operation. Close all containment penetrations providing direct access from the containment atmosphere to the outside atmosphere within 4 hours.

#### SURVEILLANCE REQUIREMENTS

---

---

4.9.8.2 At least once per 12 hours, one RHR loop shall be verified in operation and circulating reactor coolant at a flow rate:

- a. greater than or equal to 1000 gpm; and
- b. sufficient to maintain the RCS temperature at less than or equal to 140°F.

\*Prior to initial criticality, the RHR loop may be removed from operation for up to 1 hour per 8-hour period during the performance of CORE ALTERATIONS in the vicinity of the reactor vessel hot legs.



## REFUELING OPERATIONS

### 3/4.9.9 WATER LEVEL - REACTOR VESSEL

#### LIMITING CONDITION FOR OPERATION

---

3.9.9 At least 23 feet of water shall be maintained over the top of the reactor vessel flange.

APPLICABILITY: During movement of fuel assemblies or control rods within the reactor vessel when either the fuel assemblies being moved or the fuel assemblies seated within the reactor vessel are irradiated.

#### ACTION:

With the requirements of the above specification not satisfied, suspend all operations involving movement of fuel assemblies or control rods within the reactor vessel.

#### SURVEILLANCE REQUIREMENTS

---

4.9.9 The water level shall be determined to be at least its minimum required depth within 2 hours prior to the start of and at least once per 24 hours thereafter during movement of fuel assemblies or control rods.

### 3/4.9 REFUELING OPERATIONS

#### BASES

---

#### 3/4.9.1 BORON CONCENTRATION

The limitations on reactivity conditions during REFUELING ensure that: (1) the reactor will remain subcritical during CORE ALTERATIONS, and (2) a uniform boron concentration is maintained for reactivity control in the water volume having direct access to the reactor vessel. These limitations are consistent with the initial conditions assumed for the boron dilution incident in the accident analyses. The value of 0.95 or less for  $K_{eff}$  includes a 1% delta k/k conservative allowance for uncertainties. Similarly, the boron concentration value of 2000 ppm or greater includes a conservative uncertainty allowance of 50 ppm boron.

#### 3/4.9.2 INSTRUMENTATION

The OPERABILITY of the Source Range Neutron Flux Monitors ensures that redundant monitoring capability is available to detect changes in the reactivity condition of the core.

#### 3/4.9.3 DECAY TIME

The minimum requirement for reactor subcriticality prior to movement of irradiated fuel assemblies in the reactor vessel ensures that sufficient time has elapsed to allow the radioactive decay of the short-lived fission products. This decay time is consistent with the assumptions used in the accident analyses.

#### 3/4.9.4 CONTAINMENT BUILDING PENETRATIONS

The requirements on containment building penetration closure and OPERABILITY of the Reactor Building Containment Purge Exhaust System HEPA filters and charcoal adsorbers ensure that a release of radioactive material within containment will be restricted from leakage to the environment or filtered through the HEPA filters and charcoal adsorbers prior to discharge to the atmosphere. The OPERABILITY and closure restrictions are sufficient to restrict radioactive material release from a fuel element rupture based upon the lack of containment pressurization potential while in the REFUELING MODE. Operation of the Reactor Building Containment Purge Exhaust System HEPA filters and charcoal adsorbers and the resulting iodine removal capacity are consistent with the assumptions of the accident analysis. The methyl iodide penetration test criteria for the carbon samples have been made more restrictive than required for the assumed iodine removal in the accident analysis because the humidity to be seen by the charcoal adsorbers may be greater than 70% under normal operating conditions.

## REFUELING OPERATIONS

### BASES

---

---

#### 3/4.9.5 COMMUNICATIONS

The requirement for communications capability ensures that refueling station personnel can be promptly informed of significant changes in the facility status or core reactivity conditions during CORE ALTERATIONS.

#### 3/4.9.6 MANIPULATOR CRANE

The OPERABILITY requirements for the manipulator cranes ensure that: (1) manipulator cranes will be used for movement of drive rods and fuel assemblies, (2) each crane has sufficient load capacity to lift a drive rod or fuel assembly, and (3) the core internals and reactor vessel are protected from excessive lifting force in the event they are inadvertently engaged during lifting operations.

#### 3/4.9.7 CRANE TRAVEL - SPENT FUEL STORAGE POOL BUILDING

The restriction on movement of loads in excess of the nominal weight of a fuel and control rod assembly and associated handling tool over other fuel assemblies in the storage pool ensures that in the event this load is dropped: (1) the activity release will be limited to that contained in a single fuel assembly, and (2) any possible distortion of fuel in the storage racks will not result in a critical array. This assumption is consistent with the activity release assumed in the accident analyses.

#### 3/4.9.8 RESIDUAL HEAT REMOVAL AND COOLANT CIRCULATION

The requirement that at least one residual heat removal (RHR) loop be in operation ensures that: (1) sufficient cooling capacity is available to remove decay heat and maintain the water in the reactor vessel below 140°F as required during the REFUELING MODE, and (2) sufficient coolant circulation is maintained through the core to minimize the effect of a boron dilution incident and prevent boron stratification.

The requirement to have two RHR loops OPERABLE when there is less than 23 feet of water above the reactor vessel flange ensures that a single failure of the operating RHR loop will not result in a complete loss of RHR capability. With the reactor vessel head removed and 23 feet of water above the reactor vessel flange, a large heat sink is available for core cooling. Thus, in the event of a failure of the operating RHR loop, adequate time is provided to initiate emergency procedures to cool the core.

To prevent vortexing in the suction of the RHR pumps, the flow rate requirements for the RHR system were lowered from 3000 gpm to 1000 gpm. A specific surveillance has been added to ensure the flow remains high enough to ensure the reactor coolant system temperature remains less than or equal to 140 degrees-F. The problems associated with vortexing and mid-loop operations is provided in Generic Letter 88-17, Loss of Decay Heat.