

1	N	Y	I	P	S	2	2	0	0	-	0	0	0	0	-	0	0	3	4	1	1	1	1	4					5							
8	9	LICENSEE CODE					14	15	LICENSE NUMBER										25	26	LICENSE TYPE					30	31	32	33	34	35	36	37	38	39	40

REPORT SOURCE L 6 0 5 0 0 0 2 4 7 7 0 4 2 0 8 3 8 0 5 2 0 8 3 9

EVENT DESCRIPTION AND PROBABLE CONSEQUENCES (10)

2 During surveillance testing of containment isolation valves, Valves No. 1702
3 did not fully close. Valve No. 1702 is one of the two valves in series between
4 the Reactor Coolant Drain Tank and the CVCS Hold-up tanks. Valve No. 1702 was
5 manually closed and the air supply to the operator was disconnected to prevent
6 opening of the valve (T.S. 3.6.A.5. b). The health and safety of the public were
7 unaffected. There have been no similar events.

8 L

SYSTEM CODE		CAUSE CODE		CAUSE SUBCODE		COMPONENT CODE				COMP. SUBCODE		VALVE SUBCODE	
C	I	E	B	V	A	L	V	O	P	D	Z		
EVENT YEAR		SEQUENTIAL REPORT NO.		OCCURRENCE CODE		REPORT TYPE		REVISION NO.					
8	3	0	1	3	0	3	L	0					
LER/RO REPORT NUMBER		SHUTDOWN METHOD		HOURS		ATTACHMENT SUBMITTED		NPRD-4 FORM SUB.		PRIME COMP. SUPPLIER		COMPONENT MANUFACTURER	
A	Z	Z	0	0	0	0	N	Y	N	G	2	5	5

CAUSE DESCRIPTION AND CORRECTIVE ACTIONS (27)

10 Cleaning the shaft and the inside of the actuator eliminated the

11 closing problem. The air motor diaphragm was replaced as part

12 of the Preventive Maintenance program and the valve was tested satisfactorily.

13 The actuator is a Grinnell Model 3250 air motor connected to a 3" diaphragm valve.

4

8 9 80

FACILITY STATUS		% POWER	OTHER STATUS	METHOD OF DISCOVERY	DISCOVERY DESCRIPTION
5	E (28)	10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30	NA	B (31)	Surveillance Test

ACTIVITY CONTENT
RELEASED OF RELEASE

6 2 33 2 34 NA

AMOUNT OF ACTIVITY (35)

LOCATION OF RELEASE (36)

PERSONNEL EXPOSURES			
NUMBER	TYPE	DESCRIPTION	
7	000	(37) Z (38) NA	(39)

8306130

PERSONNEL INJURIES			
NUMBER	DESCRIPTION	41	
000	NA	40	

8306170405 830520
PDR ADOCK 05000247
S PDR

8	9	11	12	13
	LOSS OF OR DAMAGE TO FACILITY			
	TYPE	DESCRIPTION		
9	Z	42	NA	

8	9	10	PRIORITY		NRC USE ONLY	
0	N	(44)	DESCRIPTION	(45)		
			NA			

John D. O'Toole
Vice President

Consolidated Edison Company of New York, Inc.
4 Irving Place, New York, NY 10003
Telephone (212) 460-2533

May 20, 1983

Re: Indian Point Unit No. 2
Docket No. 50-247
LER-83-013/03L-0


Dr. Thomas E. Murley,
Regional Administrator-Region I
U. S. Nuclear Regulatory Commission
631 Park Avenue
King of Prussia, Pa. 19406

Dear Dr. Murley:

The attached Licensee Event Report LER-83-013/03L-0 is hereby submitted in accordance with the requirements of Technical Specification 6.9.1.7. This event is of the type described in Technical Specification 6.9.1.7.2.b.

Three copies of this letter and attachment are enclosed as required.

Very truly yours,

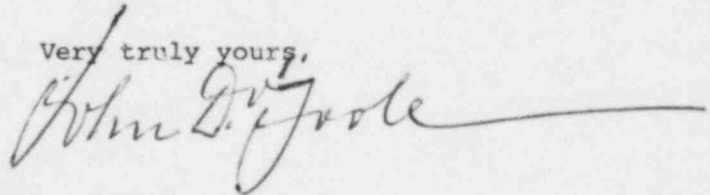

attach.

cc: Mr. Richard DeYoung, Director (30 copies)
Office of Inspection and Enforcement
c/o Distribution Services Branch, DDC, ADM
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Mr. William G. McDonald, Director (3 copies)
Office of Management Information and Program Control
c/o Distribution Services Branch, DDC, ADM
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Mr. Thomas Foley, Senior Resident Inspector
U. S. Nuclear Regulatory Commission
P. O. Box 38
Buchanan, New York 10511

IE22
11