

CONTAINMENT ANNULUS CONCRETE
DESIGN, CONSTRUCTION
and
TESTING
for the
PERRY NUCLEAR POWER PLANT
North Perry, Ohio
Rev. 1

The Cleveland Electric Illuminating Company
November 1, 1982

8211150179 821108
PDR ADOCK 05000440
A PDR

TABLE OF CONTENTS

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 1:00 | INTRODUCTION | 1 |
| 2:00 | MODELLING CONSIDERATIONS | 4 |
| | 2:01 Introduction | 4 |
| | 2:02 Containment Vessel - Annulus Concrete Interface | 4 |
| | 2:03 Basemat Foundation - Annulus Concrete Interface | 6 |
| | 2:04 Shield Building - Annulus Concrete Interface | 7 |
| 3:00 | DESIGN | 12 |
| | 3:01 Load Combinations | 12 |
| | 3:02 Vertical Reinforcement | 12 |
| | 3:03 Horizontal Reinforcement | 12 |
| | 3:04 Transverse (Radial) Shear Reinforcement | 13 |
| | 3:05 Tangential Shear Reinforcement | 13 |
| | 3:06 Reinforcing Steel Strain Limits | 20 |
| | 3:07 Concrete Strain Limits | 21 |
| 4:00 | MATERIAL, TESTING AND CONSTRUCTION CONSIDERATION | 22 |
| | 4:01 Reinforcing Steel | 22 |
| | 4:02 Concrete Supply | 22 |
| | 4:03 Testing | 23 |
| 5:00 | CONCLUSION | 24 |
| 6:00 | REFERENCES | 25 |
| 7:00 | LIST OF FIGURES | 27 |
| 8:00 | LIST OF TABLES | 28 |

APPENDIX A - Comparison of SRVD Response Spectra for the
Containment Vessel with and without the Annulus Concrete

CONTAINMENT ANNULUS CONCRETE DESIGN, CONSTRUCTION AND TESTING

1:00

INTRODUCTION

The Perry Nuclear Power Plant is located in North Perry, Ohio, 35 miles northeast of Cleveland, on the south shore of Lake Erie. The plant consists of two identical units, each powered by a Boiling Water Reactor (BWR), nominally rated at 1200 Megawatts, electrical output.

Each of the reactors is housed in a separate Reactor Building and contained by a steel Containment Vessel. The containment vessels are free-standing right cylindrical steel shells with ellipsoidal steel domes, designed and fabricated by Newport News Industrial Corporation of Ohio. The cylindrical steel shell and steel dome comprise the pressure boundary for the sides and top, and were designed and built in accordance with Section, III, Division 1 of the ASME Code⁽¹⁾; but, the bottom of the pressure boundary is formed by a reinforced concrete basemat. For this reason, the steel portion of the containment was not "N" stamped, even though it was built in accordance with the rules of ASME.

Originally, there was a five (5) foot wide annulus between the Containment Vessel and the Shield Building for the entire height. (See Figure 1.1). With the inclusion of safety relief valve (SRV) vibrations for the BWR Mark III, it was necessary to fill this annulus with concrete for a height of 23'-6" above the top of the basemat in order to dampen vibrations in the Containment Vessel due to the SRV actuations. Safety relief valve discharge response spectra are presented in Appendix A to this report for three locations on the containment vessel. Two sets of response spectra are provided for each location. The response spectra are shown for the containment vessel with and without the annulus concrete in order to provide an indication of the changes in response which are caused by the annulus concrete. Since the annulus concrete

was only required to provide stiffness to the Containment Vessel and was initially not required for strength, the design philosophy was to design the annulus concrete to ACI 318-71⁽²⁾. This was the same design criteria used for the concrete Shield Building. However, since the original design, several conditions have developed as a result of increased loads, the methods of applying load calculations and construction problems. These conditions have dictated that the annulus concrete be used for strength and that ASME Code Case N-258 "Design of Interaction Zones for Concrete Containments Section III, Division 2"⁽³⁾ be followed.

Accordingly, the annulus concrete has been evaluated against the ASME Code, Section III, Division 2, Subsection CC, 1980 edition with the Summer 1981 Addenda⁽⁴⁾. The design meets all Code provisions as interpreted by ASME Code Case N-258⁽³⁾ which states that the steel containment vessel shall be designed to Section III, Division 1 and the annulus concrete shall be designed to Section III, Division 2. The annulus concrete also complies with NUREG-0800, SRP 3.8.1 Concrete Containment⁽⁶⁾ with one exception. The exception pertains to the allowable tangential shear stress to be resisted by the concrete (v_c) which is limited to 40 psi and 60 psi, depending on the load category, in SRP 3.8.1. These allowable values for v_c are more stringent than the values in the ASME Code. Section 3:04 herein provides the justification for using the higher values for the Perry concrete. In Section 3:04 it is concluded that the present reinforced concrete design has sufficient strength and stiffness to resist the design tangential shear forces and that the acceptance criteria for concrete, reinforcement and the adjacent steel containment vessel are met.

The following discussion is divided into four sections:

Modelling considerations

Design

Materials, Testing and Construction Considerations

Conclusion

2:00 MODELLING CONSIDERATIONS

2:01 INTRODUCTION

One of the first steps in the design process is to define the model to be used for analysis. The model, to be complete, must include the Containment Vessel, Shield Building, basemat foundation, as well as the annulus concrete being designed. Because the annulus concrete is to be placed after all surrounding structures are complete, some unique modelling problems concerning the interface between these structures and this new concrete are introduced.

The manner in which each of these interfaces was considered is discussed below.

The annulus concrete was analyzed using two computer programs - ASHSD2 and ANSYS. The ASHSD2 program was used to analyze the Containment Vessel, annulus concrete, and Shield Building for static loads, suppression pool dynamic loads and seismic loads. The finite element model used for these analyses is shown in Figure 2.1. Because the ASHSD2 program does not have thermal load capability, a second finite element model was required to analyze the response to thermal loads. The ANSYS thermal analysis model is shown in Figure 2.2

2:02 CONTAINMENT VESSEL - ANNULUS CONCRETE INTERFACE

The interface between the Containment Vessel and the annulus concrete is represented in the ASHSD2 finite element model with common nodes for the axisymmetric solid elements and the axisymmetric shell elements. This representation is selected for the mechanical loads because these loads do not produce a tendency for significant slip at the interface, compared to the thermal loads discussed below. Some of these loads also are

non-axisymmetric or dynamic and ASHSD2 does allow these types of loads.

Because ASHSD2 did not have thermal load capability, an ANSYS model was developed for the thermal loads.

The interface between the Containment Vessel and the annulus concrete is represented in the ANSYS finite element model by modelling the vessel and adjacent annulus concrete with separate nodes which are connected by "gap" elements. The vessel is anchored in the annulus concrete at the embedded circumferential stiffeners. The gap elements are used because under the accident temperature condition, the vessel experiences a temperature increase while the concrete through most of its thickness does not. This discontinuous temperature distribution creates thermal forces and moments in the vessel and in the annulus concrete which depend on the degree of bond at the interface between the two structures. The Containment Vessel and annulus concrete are analyzed for this condition by using a feature of ANSYS which considers the vertical shear stress between the vessel and between the annulus concrete to be a function of the normal stress between the two structures at the interface (Gap Element). If the vertical shear stress is less than or equal to a constant multiplied by the normal stress, no slip occurs between the two structures. If the vertical shear stress is greater than a constant multiplied by the normal stress, the surfaces can slip and a sustained value of shear stress equal to the constant times the normal stress is developed. This constant is similar to the static coefficient of friction between concrete and steel. Two different values of the constant, 0.7 and 0.0, were used for the design. A parametric study indicated that for values of the constant as large as 2.0 the forces and moments in the annulus concrete did not change significantly from those corresponding to a 0.7 value for the constant. This approach conservatively bounds the actual degree of bond at the interface since a bond breaker is

applied to the Containment Vessel before the annulus concrete is placed. The analysis using each value of this constant produced different critical stress values; thus creating an envelope of maximum values for design.

As discussed above the design uses ANSYS model results with the non-linear "gap" element for the thermal loads and combines them with the linear ASHSD2 model results for the mechanical loads. To determine the acceptability of this approach, a study was made to evaluate the effect of combining the results from the two different finite element models used in the design. A finite element analysis was performed using the ANSYS model with gap elements and the dominant loads from the controlling load combination: pressure, seismic, and thermal. Since the model is limited to axisymmetric loads, an equivalent seismic load was used for this analysis. The results from the above approach were compared to a second approach which combine results from two ANSYS models. The first model did not include the gap elements and analyzed the pressure and equivalent seismic loads. The results from this model were combined with the thermal results from a second model with gap elements. This is the same approach used for the annulus concrete design.

Comparing the two approaches, reinforcing steel stresses⁵ at each section were calculated from element stresses generated by each approach. The maximum or design reinforcing steel stresses from each approach are within 11%. Observation of Table 3.1 indicates that these small differences will not effect the final design.

2:03

BASEMAT FOUNDATION - ANNULUS CONCRETE INTERFACE

The basemat had been placed without considering the annulus filled with concrete; therefore, there is no mechanical connection (dowels) between the basemat and the annulus concrete. The original ASHSD2 analysis for mechanical loads conservatively

modelled this condition with the base of the annulus concrete being independent of the basemat with no restraint against either upward or downward vertical movement. However, the Shield Building and vessel were fixed at the basemat. This model required the vessel and Shield Building to carry all the transverse shear forces. The results of this analysis indicated that the Shield Building was overstressed. The next logical step was to more realistically model this interface area; therefore, the basemat stiffness was added to the model removing the fixed conditions of the vessel and Shield Building. The results of this analysis indicated that the Shield Building was marginally within allowables for the shear forces. Although the shear stresses were within allowables, the decision was made to mechanically protect the Shield Building. To achieve this, the basemat was prepared for the new concrete by cutting a shear key to resist some of the radial shear being transferred through the annulus concrete. Therefore, in subsequent analyses this shear key was modelled as a radially fixed condition at the basemat.

The analysis for the thermal loads with ANSYS incorporated a "gap" element to create the effect of a compression with no tension capability boundary between the basemat and annulus concrete. The "gap" element accurately models the actual interface.

2:04

SHIELD BUILDING - ANNULUS CONCRETE INTERFACE

The Shield Building - annulus concrete interface was modelled as a monolithic section, in other words, no slip is assumed to occur along the interface. To evaluate this assumption, the interface shear and normal stresses were reviewed for the critical load combinations. The variation of these stresses along the height of the annulus concrete is shown in Figure 2.3 for the abnormal/extreme environmental condition, which is controlling. From this figure, it is seen that for the region starting above

section 1 and extending above section 7, a distance of approximately 12 feet, the normal stresses are entirely compressive. Over this region the maximum vertical shear stress is 108 psi with the average stress of 55 psi. For the region starting just above section 7 extending through 9 (4 feet), the normal stresses are tensile with a peak value of 60 psi accompanied by small values of shear stress (25 psi maximum). Above section 9, (5 feet) the shear stresses increase to a maximum of 227 psi, but these are accompanied by normal stresses at the interface which are compressive. In the lower portion, below section 2 (2.5 feet), the shear stresses increase to a maximum of 212 psi in conjunction with a tensile normal stress of 60 psi. The likelihood that these stresses would cause debonding at the annulus concrete - Shield Building interface is discussed below.

The Corps of Engineers' report "Investigation of Methods of Preparing Horizontal Construction Joints In Concrete"⁽⁵⁾ presents the results of an experimental research program on construction joints. This report presents individual test results of tension and shear capacity across a construction joint that is rough, clean and dry. The age of the specimens at the time of testing was 17 days, at which time the concrete had achieved a compressive strength of approximately 1300 psi. The specimens contained 1-1/2 inch crushed limestone coarse aggregate, which is the same size and type of coarse aggregate to be used for the annulus concrete. The tension values from nine tests ranged from 130 psi to 80 psi with an average of 105 psi. The shear values ranged from 150 psi to 240 psi with an average of 195 psi. The minimum test values were used to establish a reduced Mohr's failure envelope for the interface, and the combined shear and normal stresses from the curves in Figure 2.3 were evaluated with respect to this criteria. From this evaluation it is expected that debonding of the interface will not occur, except perhaps in a local region at the base of the annulus. However, the slip in

this area is expected to remain small due to restraint provided by the bonded joint above and the basemat below.

The Corps of Engineers' report⁽⁵⁾ also gives conclusions which are useful in defining the surface preparation of the Shield Building for the placement of the annulus concrete. The report concludes that the surface should be rough, clean and dry for best results. To obtain these conditions the Shield Building surface in the annulus was bush hammered to produce a roughened surface with a 1/4" amplitude which will be air cleaned before placement of the annulus concrete.

For composite flexural members, ACI 318-71⁽²⁾ contains design requirements for shear transfer across the interface of the components which comprise the member. Generally, these provisions permit a shear stress as large as 80 psi to be transferred across the interface without ties, if the interface is intentionally roughened and clean. An exception to this allowable is if tension normal to the interface exists. In this case ties are required to provide a normal clamping stress necessary to develop the shear stress. The interface between the annulus concrete and the Shield Building differs from the interface in a composite flexural member in several respects.

First, for a composite flexural member, if the calculated interface shear stresses exceed the shear strength of the joint, debonding occurs. Slip at the interface occurs and without ties, no clamping mechanism exists to limit the slip or to develop any significant portion of the calculated shear stress at the interface. Consequently, composite action between the components is lost across the entire width of the member and along its length where this condition exists. However, this condition would not occur at the untied interface of the annulus concrete and the Shield Building. The annulus concrete and Shield Building can be visualized as an inner cylinder contained within an outer

cylinder. If debonding of the interface occurs, vertical slippage at the roughened interface between the two cylinders will develop a compressive clamping stress at the interface due to the axisymmetric geometry of the cylinders. This condition will limit slip and transfer shear without ties across the interface.

Another difference between the composite flexural member and the annulus concrete is the variation of the calculated shear stress at the interface. The annulus concrete interface normal and shear stresses plotted in Figure 2.3 are peak values. These values may occur at one location around the circumference, and they decrease away from this location. This differs from a flexural member in that the maximum calculated stresses are uniform across the entire width of the member, and if these stresses exceed the joint capacity composite action for the entire cross section is lost.

Based on the above discussion it is concluded that significant slip at the annulus concrete - Shield Building interface is not expected to occur. Therefore, the assumption in the analysis model that the annulus concrete and Shield Building act as monolithic concrete is reasonable.

The preceding discussion provides the basis for the assumption in the finite element model that the Shield Building and annulus concrete act monolithically. However, an analysis was performed to demonstrate that the stresses in the Containment Vessel are not significantly influenced by this assumption. For the purpose of the analysis, the vessel stresses produced by the long term LOCA load combination were compared for the case of including the 3 ft. Shield Building as a monolithic part of the 5 ft annulus concrete and for the case where the Shield Building is removed from the model.

For the long term LOCA load combination the largest stresses are caused by the accident pressure and temperature loads. By

performing a plane stress analysis for these loads, the vessel stresses were obtained. The design pressure of 15 psig was used with a temperature of 115 °F applied to the vessel. The value of 115 °F corresponds to the vessel experiencing a temperature increase from its 70 °F stress free value to the maximum design LOCA temperature of 185 °F. For these combined loads, the net vessel stress in the hoop direction is compressive and was calculated as 17422 psi for the 8 ft monolithic model and 15693 psi for the model consisting only of the vessel and the annulus concrete. This represents a 10% reduction in vessel compressive stress, which is not significant. However, as seen from the above results, use of the monolithic model actually gives a greater calculated hoop stress in the vessel.

3:00 DESIGN

3:01 LOAD COMBINATIONS

The loading conditions used for the annulus concrete design were the containment loading combinations presented in the FSAR including Appendix 3A and 3B. However, the design has been evaluated using the load combinations specified in Table CC 3230-1 of the ASME Code⁽⁴⁾ and the Appendix to NUREG-0800⁽⁶⁾.

3:02 VERTICAL REINFORCEMENT

The vertical reinforcement was designed to carry the vertical forces and moments along with the tangential shear forces as defined by ASME Section III, Division 2, Subsection CC 3521.1.1 c. The final design is #18 Grade 60 reinforcing bars on 15 inch centers on both faces. To insure that the vessel and the annulus concrete act together and to spread the reinforcement, the vertical reinforcement next to the vessel is to be placed through holes in the horizontal stiffeners. Figure 3.1 is a copy of a reduced construction drawing of this steel layout.

Table 3.1 gives steel stress values for each section of the annulus concrete for the critical load combination. The table shows that the stresses in the vertical reinforcement range from small compression to 35.5 ksi in tension. These stress values do not include the tangential shear stress that is transferred to the orthogonal reinforcement. This is discussed later in Section 3:05.

3:03 HORIZONTAL REINFORCEMENT

The horizontal reinforcement was designed to carry the hoop forces and moments and the tangential shear force as defined in

ASME Code, Section III, Division 2, Subsection CC 3521.1.1 c. The final design is #18 Grade 60 reinforcing bars spaced from 6 to 12 inches on centers on both faces. See Figure 3.1.

Table 3.1 shows that the horizontal reinforcement stresses range from small compression to 50.8 ksi tension. Again the tangential shear stress has not been added.

3:04 TRANSVERSE (RADIAL) SHEAR REINFORCEMENT

The horizontal ties (shear reinforcement) were designed to carry the transverse shear force in excess of what the concrete can carry. Although the original design was to ACI-318, it meets the criteria of the ASME Code, Section III, Division 2, Subsection CC 3421.4.1. The ties are #7 bars spaced circumferentially at each vertical bar in the bottom and every other bar in the top section. The vertical distribution of shear ties is as follows:

| | |
|---|------------------|
| Below horizontal stiffener #1 - | 4 tie elevations |
| Between horizontal stiffeners #1 & #2 - | 4 tie elevations |
| Between horizontal stiffeners #2 & #3 - | 4 tie elevations |
| Between horizontal stiffeners #3 & #4 - | 3 tie elevations |
| Above horizontal stiffener #4 - | 3 tie elevations |

3:05 TANGENTIAL SHEAR REINFORCEMENT

3:05.1 Code and SRP Requirements

Using the shear friction provisions of ACI 318-71, the original design included tangential shear in determining the reinforcement requirements in the vertical and horizontal directions, and inclined reinforcement was not provided. However, based on SRP 3.8.1, inclined reinforcement is required if the tangential shear stress is greater than 40 psi for abnormal/severe

environmental loads and 60 psi for abnormal/extreme environmental loads. These limits are very conservative when compared with the ASME Code.

For the minimum reinforcement provided in the annulus concrete, CC3421.5.1(a) of the ASME Code allows 107 psi before inclined reinforcement would be required. However, the maximum calculated tangential shear stress is 83 psi, which occurs for the abnormal/extreme environmental condition; therefore, inclined reinforcement is not required by the Code. The SRP 3.8.1 requirements would result in inclined reinforcement consisting of #5 bars at a 12 inch center to center spacing. This amount of reinforcement seems rather inconsequential relative to the #18 bars provided in the vertical and horizontal directions. This conclusion is confirmed by the results of the analysis described in Section 3:05.3. Here it is shown that the stresses in the orthogonal reinforcement and the strains in the concrete are not significantly reduced by the addition of the #5 inclined bars.

The design of the annulus concrete for tangential shear was based on the shear allowable of the ASME Code rather than the reduced allowables presented in SRP 3.8.1 for two reasons. First, the magnitude of the tangential shear stresses are not as severe as those for a typical concrete containment subjected to the same seismic input. More importantly, the results of recent research indicates that the tangential shear allowables of the ASME Code are conservatively low considering the magnitude of the stresses in the orthogonal reinforcement in the annulus concrete, as discussed below.

3:05.2 Tangential Shear Research

Tests on reinforced concrete specimens containing orthogonal reinforcement and subjected to simultaneous loads creating biaxial tension and tangential shear stresses have been performed at the

Construction Technology Laboratories of the Portland Cement Association (PCA) and at Cornell University. The PCA tests were conducted on two (2) feet thick specimens containing #14 and #18 reinforcement. The Cornell test specimens were smaller than those tested by PCA. The results of the PCA tests are reported in Reference 7. The Cornell test results are presented in Reference 8 and summarized in a recent paper⁽⁹⁾. This paper compares the Cornell and PCA results with others performed in Toronto and Japan. Table 3.2 presents a comparison of the calculated tangential shear stresses occurring in the annulus concrete with tangential shear strengths based on the conclusions from the Cornell and PCA tests.

In Reference 9, the following expression is proposed as a conservative estimate of the allowable tangential shear stress in orthogonally reinforced concrete:

$$v_c = \sqrt{f'_c} (2.7 + 0.006 \rho f_y (1 - f_s/f_y)) \quad (1)$$

where v_c = allowable tangential shear strength (psi)

f'_c = compressive strength of concrete (psi)

ρ = minimum steel ratio of the two
orthogonal reinforcements.

f_y = reinforcement yield stress (psi)

f_s = reinforcement stress due to the biaxial forces
(psi)

This equation was developed from equal biaxial tension tests. Equation (1) was conservatively applied to the annulus concrete using the stresses and reinforcing ratios presented in Table 3.1. The largest reinforcement stress was taken to exist on both faces

and used as f_s in Equation (1). This resulted in the tangential shear strength values shown in columns 3 and 4 of Table 3.2. The tangential shear strength of the section is the minimum of these two values and is shown in column 5. By comparing this with the calculated tangential shear stress appearing in column 2, it is seen that the shear strengths are in excess of the calculated shear stresses by the factors shown in column 9. At the critical section 2, the strength exceeds the calculated shear stress by 172%.

Reference 7 (the PCA tests) concludes that the following expression provides a lower bound estimate of the shear strength of orthogonally reinforced concrete subjected to cyclic loads:

$$v_{s0} = 0.90 \rho f_y (1 \pm f_s / f_y) \quad (2)$$

where v_{s0} = lower bound tangential shear strength (psi)

ρ = minimum steel ratio of the two
orthogonal reinforcements

f_y = reinforcement yield stress (psi)

f_s = reinforcement stress due to the biaxial
forces (psi)

To limit shear distortions and strains in the reinforcement, a factor of 0.6 is recommended in place of the 0.9 appearing in equation (2).

The report also establishes an upper limit on shear stress resisted by orthogonal reinforcement as:

$$v_{s0} = \sqrt{f'_c} (7.5 - f_s/14300) \quad (3)$$

where v_{s0} = upper limit tangential shear strength (psi)

f'_c = compressive strength of concrete (psi)

f_s = reinforcement stress due to the biaxial forces (psi)

The shear strength for each section of the annulus concrete was calculated using the above expressions. These are presented in columns 6, 7 and 8 of Table 3.2. Column 6 represents the minimum directional shear strength determined by Equation (2). Column 8 presents the shear strength corresponding to limiting shear distortion. Column 7 is the upper bound on shear strength determined by Equation (3). The controlling limit on tangential shear stress is considered to be the distortion limit shown in Column 8. When these values are compared with the calculated shear stress values shown in Column 2, it is seen that, as a minimum, the shear strength exceeds the calculated shear stress by 63%.

The results of these tests reported in References 7 and 9 are considered to be applicable to the evaluation of the ability of the annulus concrete to resist the calculated tangential shear stresses without inclined reinforcement. From these test results it is concluded that sufficient shear strength exists and the shear distortions will be small using only orthogonal reinforcement in the annulus concrete. The conclusion that the shear distortions will remain small was confirmed by applying Duchon's⁽¹⁰⁾ analytical model to the stress conditions shown in Table 3.1. This is discussed in Section 3:05.3 below. The Duchon model was selected because the research (7) has concluded it to

be a reasonable approximation of the shear distortions experienced by completely cracked elements even for a large number of stress reversals.

3:05.3 Duchon Model

To confirm for the current design that the shear distortions remain small without inclined reinforcement, Duchon's (10) analytical model was applied to the stress conditions of the annulus concrete. The input to Duchon model includes the following:

Forces - Vertical
 Horizontal
 Shear
Concrete Area
Steel Modulus
Concrete Modulus
Reinforcing Ratio - Vertical
 Horizontal
 Inclined
Angle of Inclined Steel

The vertical and horizontal forces were input as the maximum of the inside or outside face reinforcing bar stress values at the section from Table 3.1, multiplied by the appropriate reinforcement area. At each section, the shear force was input as the product of the tangential shear stress from column (2) of Table 3.2, times the concrete section area.

The Duchon model was also used to evaluate the effect of the addition of the #5 inclined bars which would result from the requirements in SRP 3.8.1. The results from these analyses are shown in Table 3.3. Columns (2), (4), and (7) are the results for the current design with no inclined reinforcement. Columns (3), (5), (6), and (8) are the results with #5 bars at a spacing of

12 inches and inclined 45° in both directions. Adding the inclined reinforcement reduces the vertical and horizontal reinforcement stresses by an average of 7%. This reduction is not large enough to justify the addition of inclined reinforcement considering that the orthogonal reinforcement in the current design is not overstressed. For the #5 inclined bars in the model, some reach yield locally as shown in column (6) of Table 3.3. This means that the stress carried by the inclined reinforcement would not be as great as that indicated in Table 3.3 for sections where the inclined reinforcement yields. To be theoretically correct, the Duchon model would have to be revised to set all inclined reinforcement stress levels above yield (60 ksi) to 60 ksi, and then re-evaluate the equilibrium equations. This correction was not considered important and was not made for these analyses.

The lower allowable concrete shear stresses in SRP 3.8.1 produces a requirement for inclined reinforcement. This reinforcement is intended to control shear distortions, which in turn limits the strains in the reinforcement and containment liner. It is believed that this intent of the SRP is met by the current design. The distortional shear strains predicted by the Duchon model are shown in columns (7) and (8) of Table 3.3. The PCA test results from Reference 7 indicate that the Duchon model gives a reasonable approximation of the shear distortions experienced by completely cracked elements even for a large number of stress reversals. Column (7) shows that the distortional shear strain values range from 0.00147 rad to 0.00331 rad, with an average of 0.00217 rad for the current design. These values are small, and the 0.00217 rad average value is less than one-half of the ultimate values of shear distortion measured in the PCA tests in Reference 7. Comparing these results with those in column (8), it is seen that the effect of the #5 inclined reinforcement is to reduce the distortional shear strains by approximately 8%. This reduction is not significant considering that the distortional

shear strains in the current design are not large. The addition of the inclined steel would only slightly improve the distortional shear strains, but not enough to offset the problems associated with placing the inclined reinforcement.

3:05.4 Conclusion on Tangential Shear

As discussed above, the current annulus concrete design for tangential shear meets all of the requirements of ACI 318-71 and ASME Section III, Division 2. The design does not meet the reduced allowable shear provisions of SRP 3.8.1. However, it has been shown that the current annulus concrete design meets the intent of the SRP to require a design with adequate shear strength and limited shear strains. This was demonstrated from an evaluation of the design using tangential shear test results obtained by PCA (7) and Cornell (9), and by applying the Duchon analytical model (10).

3:06 REINFORCING STEEL STRAIN LIMITS

The ASME Code Section III, Division 2, Subsection CC 3410 generally limits reinforcement strains to the elastic range for factored loads, allowing the strains to go to twice yield only in specified cases. This constraint is more severe than ACI 318 which generally allows the steel to yield under factored loads. Even though the annulus concrete was originally designed to ACI-318, a check of the critical loads indicates that the strain limits of CC 3422 are not violated. Interaction diagrams were developed using the ASME strain limits. Service and factored load combinations were plotted for each section on the interaction diagrams. Figures 3.2 to 3.7 are interaction diagrams with only the critical sections plotted. They show that all strains are within ASME allowables.

3:07

CONCRETE STRAIN LIMITS

Table CC-3421-1 and CC-3431-1 define the concrete stress limits for the ASME Code for Section III, Division 2. The stresses in the annulus concrete are small and fall below the allowables presented. Figures 3.2 through 3.7 also show the concrete stresses to be less than ASME Code allowables.

4:00 MATERIAL, TESTING AND CONSTRUCTION CONSIDERATIONS

4:01 REINFORCING STEEL

Purchasing, placing, and the mechanical (Cadwell) splicing of reinforcing steel bars in the annulus area was performed utilizing the Safety-Related PNPP specifications for concrete and reinforcing steel, without consideration of the ASME Code, Section III, Division 2 rules. However, to demonstrate that essentially all ASME Code, Section III, Division 2, rules were met, a third party, an Authorized Nuclear Inspector, will be brought on-site by the Constructor. The ANI will review all material certification and construction procedures to confirm ASME Code compliance with the exception of several minor items delineated in Table 4 "Reinforcing Steel and Splicing Code Comparison." It will further be demonstrated that the requirements of ASME Section III, Division 2, NCA-3461, which requires the Constructor to survey, qualify and audit certain suppliers, has been met with respect to the Code's intent, as related to reinforcing steel and Cadweld splices. This will be accomplished by producing combined Owner and Contractor records showing numerous inspections and audits of these suppliers.

4:02 CONCRETE SUPPLY

The concrete supply, placement, and curing will be performed in compliance with ASME Section III, Division 2. Table 4.2, "Concrete Code Comparison," is a compilation section-by-section of comparisons between the ASME Code Section III, Division 2 rules and the present PNPP construction specification requirements. The last column in this comparison table shows the action required by CEI to meet Code rules. The concrete testing requirements are compared in Table 4.3. Additional review of Code sections including Quality Assurance, Personnel Qualifications, Vendor Surveillance, and third party Authorized Nuclear

Inspection, revealed CEI's ability to meet Code mandated practices.

4:03 TESTING

The Perry containment is scheduled to undergo a Structural Integrity Test (SIT) in accordance with the rules of ASME Section III, Division 1, Subsection NE-6000. There are currently no rules in the ASME Code for the structural testing of the annulus concrete portion of the containment shell. However, rules for such a test have been proposed as a revision to the ASME Code Case N-258, and the Perry Containment SIT will comply with these proposed rules in addition to those of NE-6000. The proposed provisions require that displacement measurements and concrete crack inspections be performed to a limited extent. The displacement requirements call for radial displacements to be measured on the vessel near the top of the annulus concrete at four azimuths. The crack inspections are to be performed on a 40 square ft. area of the annulus concrete. The acceptance criteria are to be in accordance with ASME Section III, Division 2, Subsection CC-6000. Also, strain measurements are required in the region of the annulus concrete near the base slab and in the vicinity of the largest penetration in the annulus concrete.

5:00

CONCLUSION

The concrete and reinforcing steel individually and collectively as a unit meet fully the ASME Code, Section III, Division 2(4), except purchasing, placing and the mechanical (Cadwell) splicing of reinforcing steel bars. As indicated in Section 4:01 the full intent of the Code has been followed with respect to these areas. The design approach presented here is the best possible considering the specifics of the Perry Containment Vessel, Shield Building and annulus concrete. The final design developed from this approach is a safe and economical structural system capable of safely carrying all postulated loads and load combinations.

6:00

REFERENCES

1. ASME Boiler and Pressure Vessel Code, 1974 Edition with Summer 1974 Addenda.
2. ACI 318-71 Building Requirements For Reinforced Concrete.
3. ASME Code Case N-258 - "Design of Interaction Zones for Concrete Containments Section III, Division 2" March, 1980.
4. ASME Boiler and Pressure Vessel Code, 1980 Edition with Summer 1981 Addenda.
5. U.S. Army Engineer Waterways Experiment Station - "Investigation of Methods of Preparing Horizontal Construction Joints for Concrete" Tech. Report No. 6-518 July 1959 - Corps of Engineers.
6. NUREG-0800 - SRP 3.8.1 "Concrete Containment" Rev 1, July 1981.
7. Oesterle, R.G. and Russell, H.G. - "Shear Transfer in Large Scale Reinforced Concrete Containment Elements." Construction Technology Laboratories, Portland Cement Association - NUREG/CR-2450, Dec 1981.
8. Perdikanis, P.C.; White, R.N.; Gergely, P. - "Strength and Stiffness of Tensional Reinforced Concrete Panels Subjected to Membrane Shear, Two-Way Reinforcing" - Department of Structural Engineering, Cornell University - NUREG/CR-1602 July 1980.
9. Cowley, White, Hilmy and Gergely - "Design Considerations for Concrete Nuclear Containment Structures Subjected to Simultaneous Pressure and Seismic Shear" presented at Session 53, 6th SMIRT Conf. Paris, 1981.

10. Duchon, N.B. - "Analysis of Reinforced Concrete Membrane Subject to Tension and Shear", ACI Journal, Proc. Vol. 69, No. 9, Sept 1972 pp 578-583.

7:00

LIST OF FIGURES

- 1.1 Containment - Shield Building

- 2.1 ASHSD2 Model
- 2.2 ANSYS Thermal Model
- 2.3 Factored Load - Shield Building/Annulus Interface Stresses

- 3.1 Annulus Concrete Reinforcing
- 3.2 Vertical Steel - Service Loads
Interaction Diagram
- 3.3 Horizontal Steel - Below Elevation 590'-6" Service
Loads - Interaction Diagram
- 3.4 Horizontal Steel - Above Elevation 590'-6" Service
Loads - Interaction Diagram
- 3.5 Vertical Steel - Factored Loads Interaction Diagram
- 3.6 Horizontal Steel - Below Elevation 590'-6" Factored
Loads - Interaction Diagram
- 3.7 Horizontal Steel - Above Elevation 590'-6" Factored
Loads - Interaction Diagram

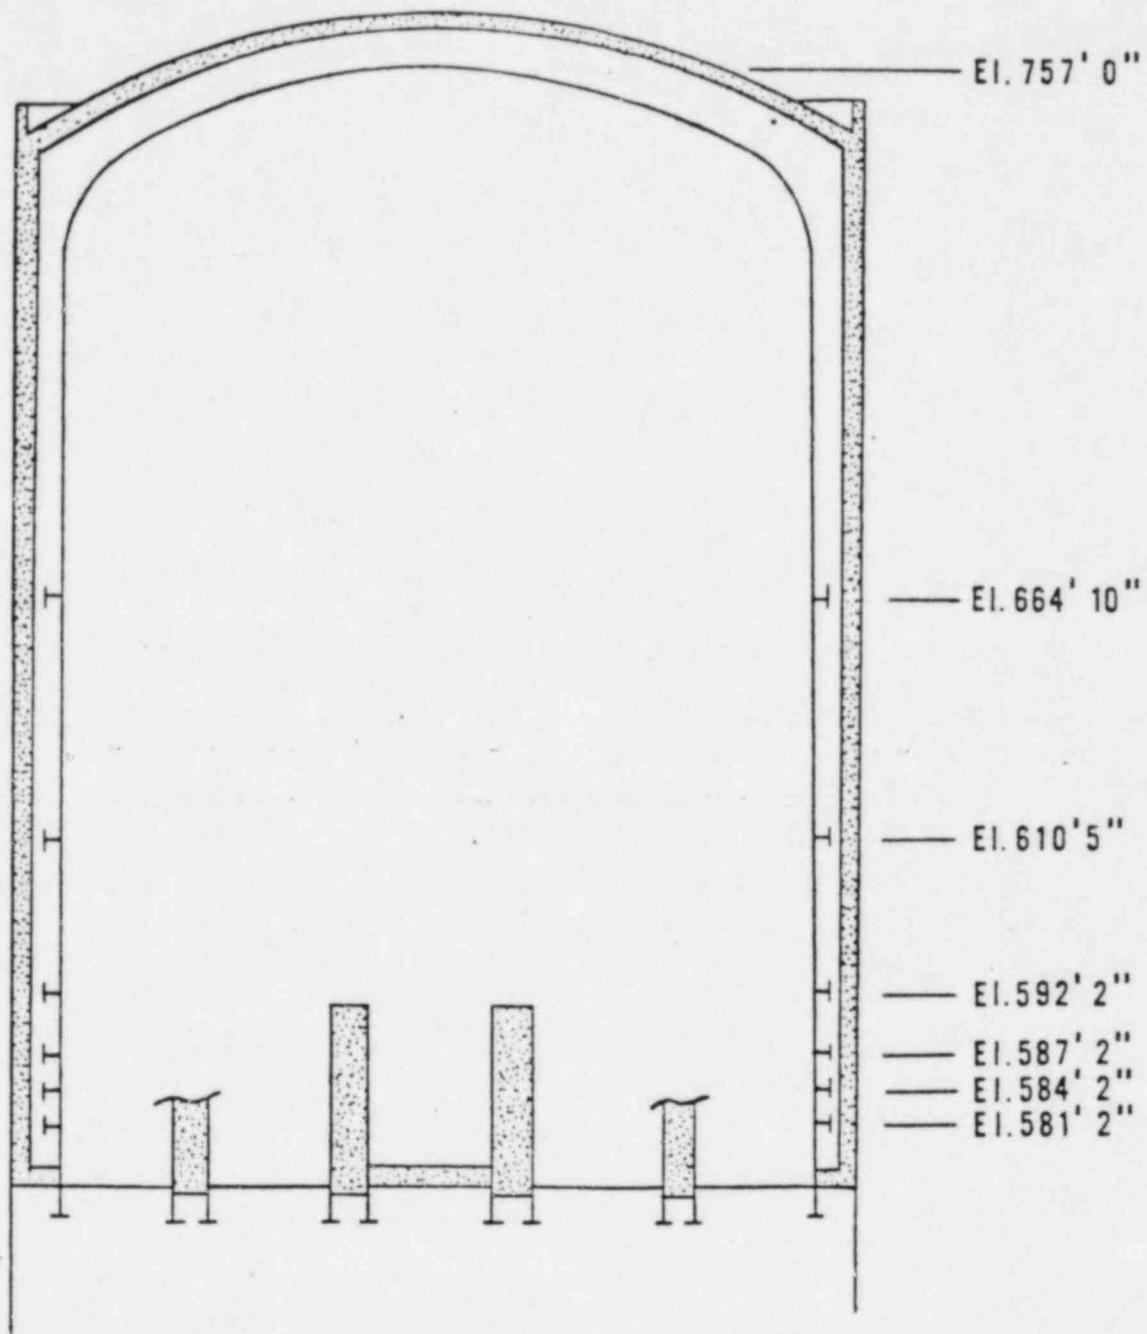


Figure 1.1 Containment - Shield Building

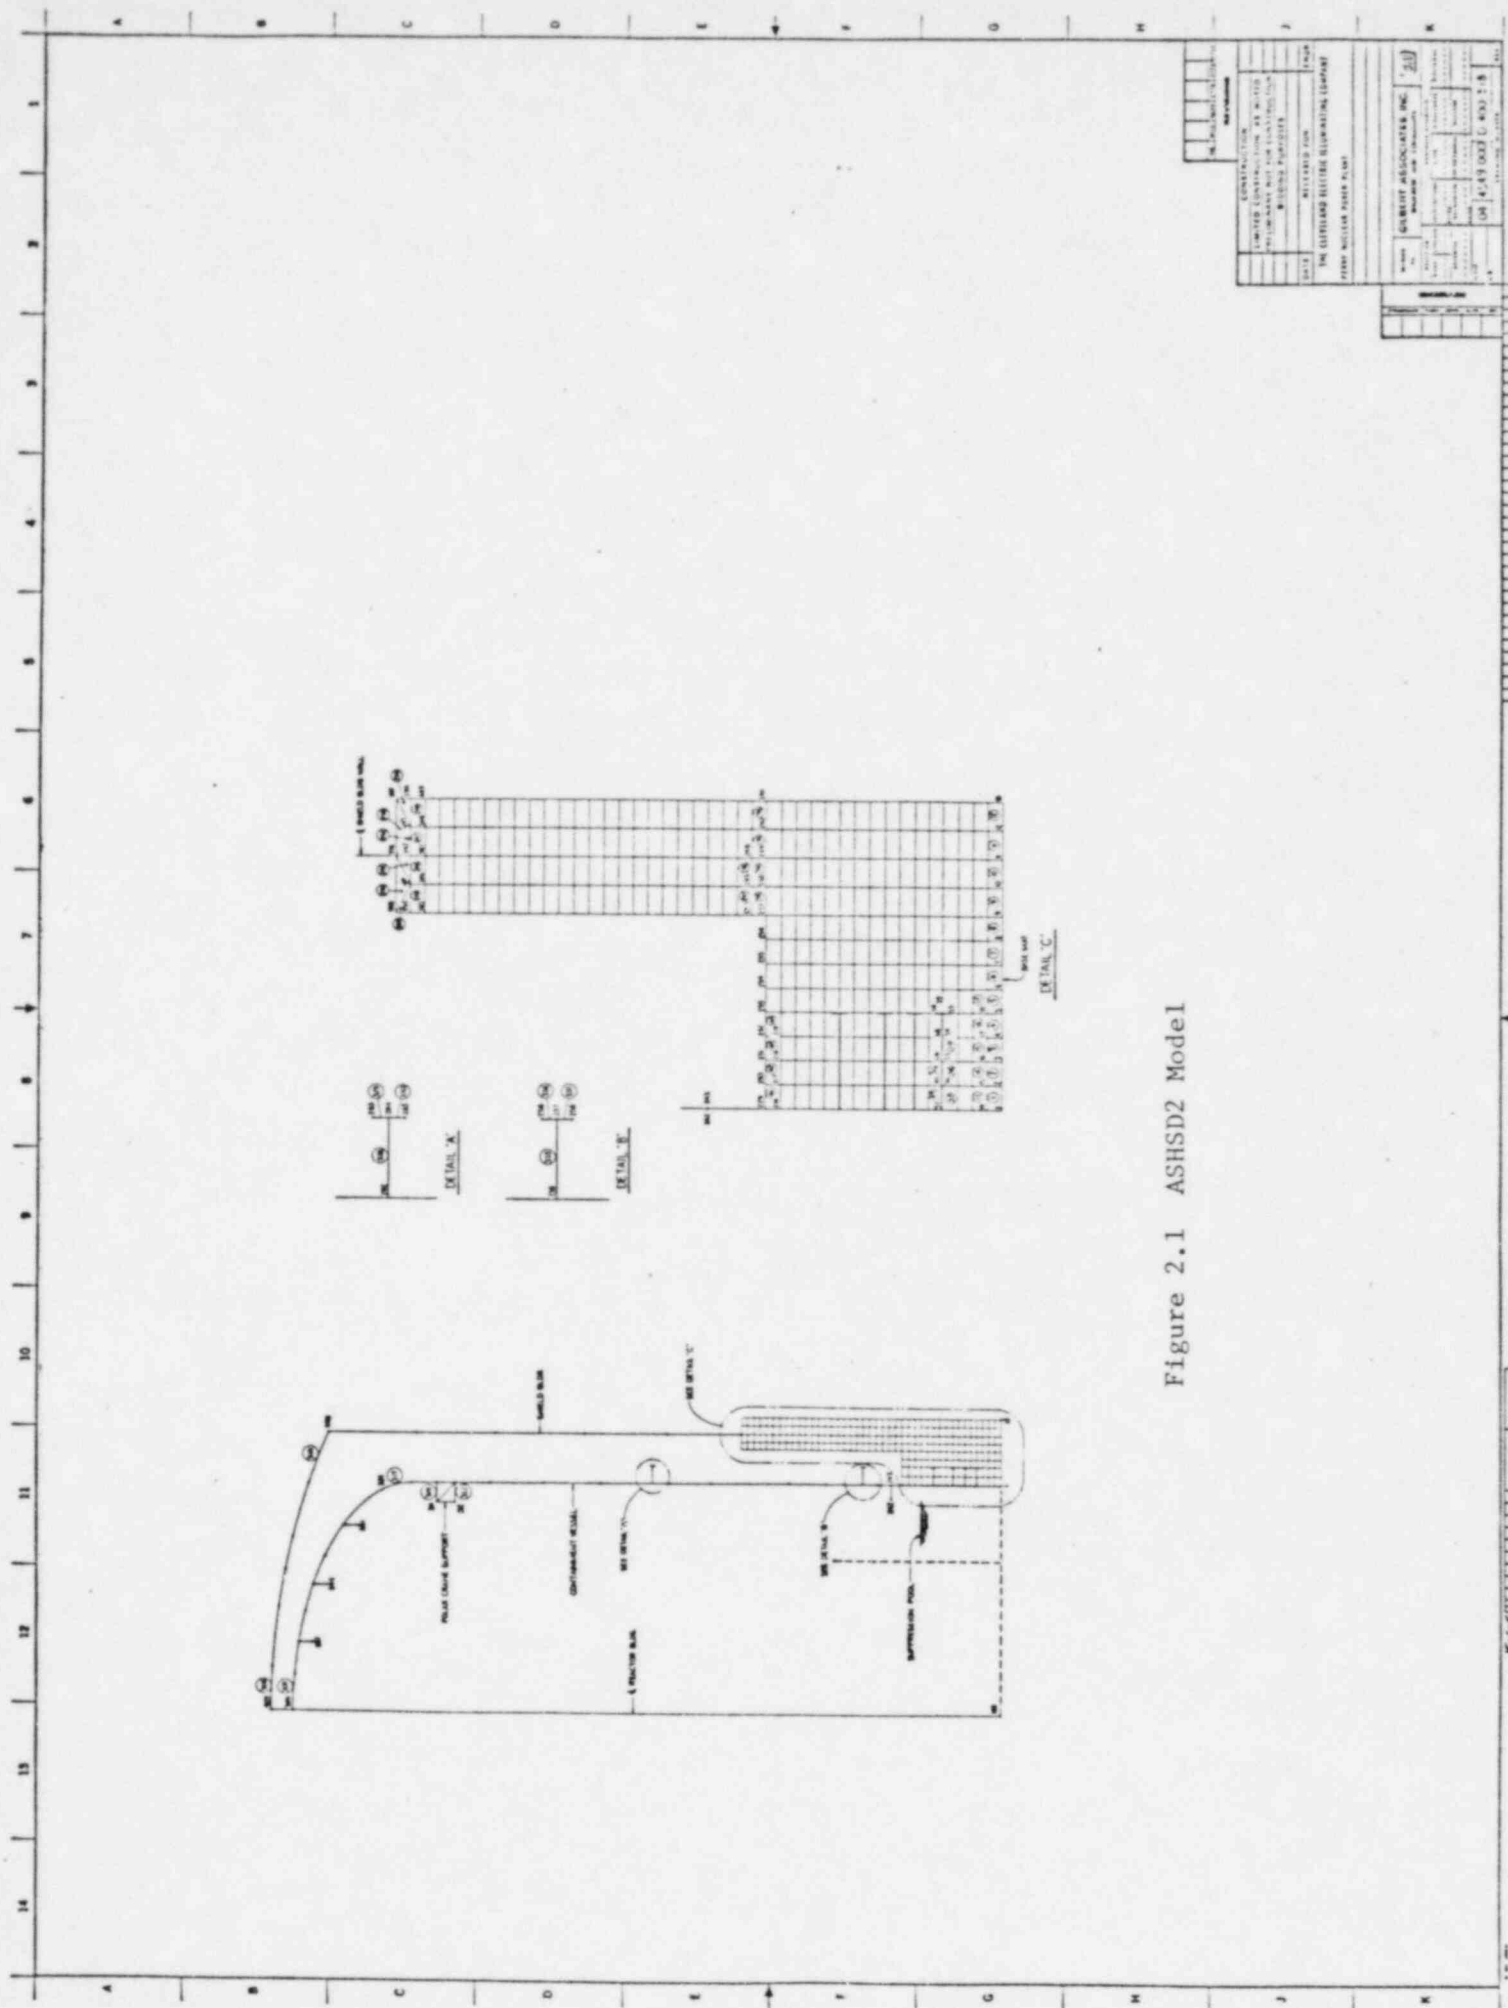


Figure 2.1 ASHSD2 Model 1

| | | | |
|----------------------------|--|------------------------------------|--|
| CONTRACTOR | | GIBSON ASSOCIATES INC. | |
| LIMITED LIABILITY BY STATE | | 210 | |
| PERFORMANCE GUARANTEE | | 100% | |
| BONDING POWER | | 100% | |
| DATE | | 10/1/77 | |
| PROJECT | | THE STEPHEN BUCKLE ELEVATING TOWER | |
| PROJECT NUMBER | | 1000 | |
| PROJECT ADDRESS | | 1000 | |
| PROJECT CITY | | 1000 | |
| PROJECT STATE | | 1000 | |
| PROJECT ZIP | | 1000 | |
| PROJECT PHONE | | 1000 | |
| PROJECT FAX | | 1000 | |
| PROJECT E-MAIL | | 1000 | |
| PROJECT WEBSITE | | 1000 | |
| PROJECT URL | | 1000 | |
| PROJECT SOCIAL MEDIA | | 1000 | |
| PROJECT OTHER | | 1000 | |

Section No. ○



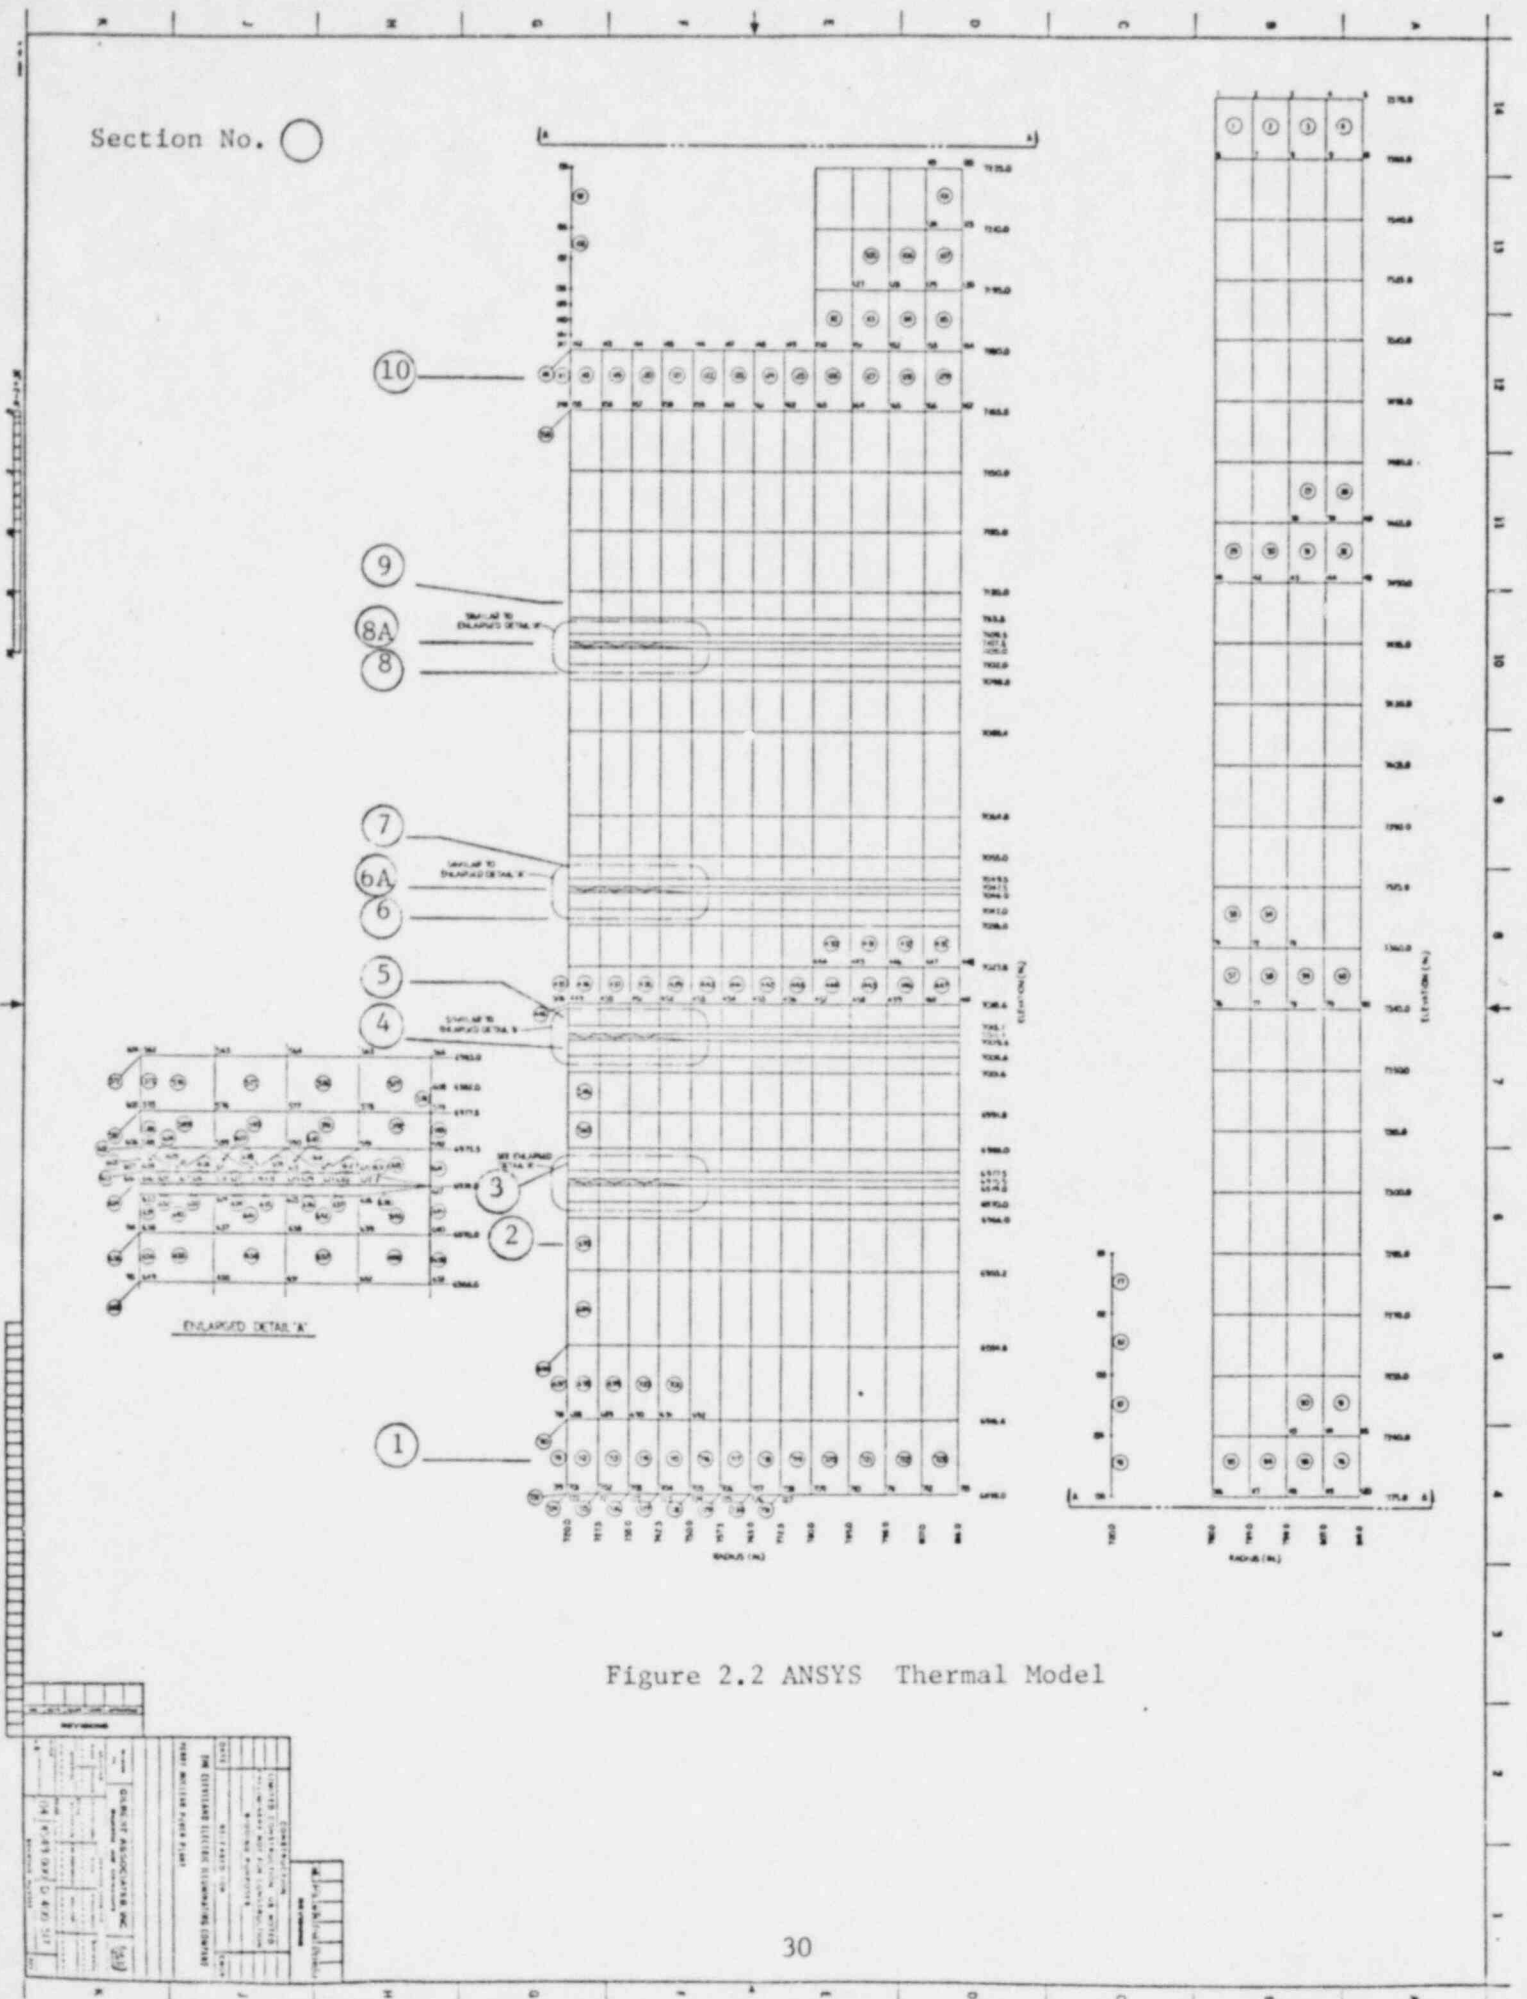


Figure 2.2 ANSYS Thermal Model

| | |
|-------------|--|
| DATE | 10/10/2011 |
| PROJECT | 10M CIVILIAN ELECTRIC SUBSTATION (CONTR) |
| DESIGNER | ... |
| CHECKER | ... |
| APPROVER | ... |
| SCALE | ... |
| DESCRIPTION | ... |
| REVISION | ... |
| ... | ... |

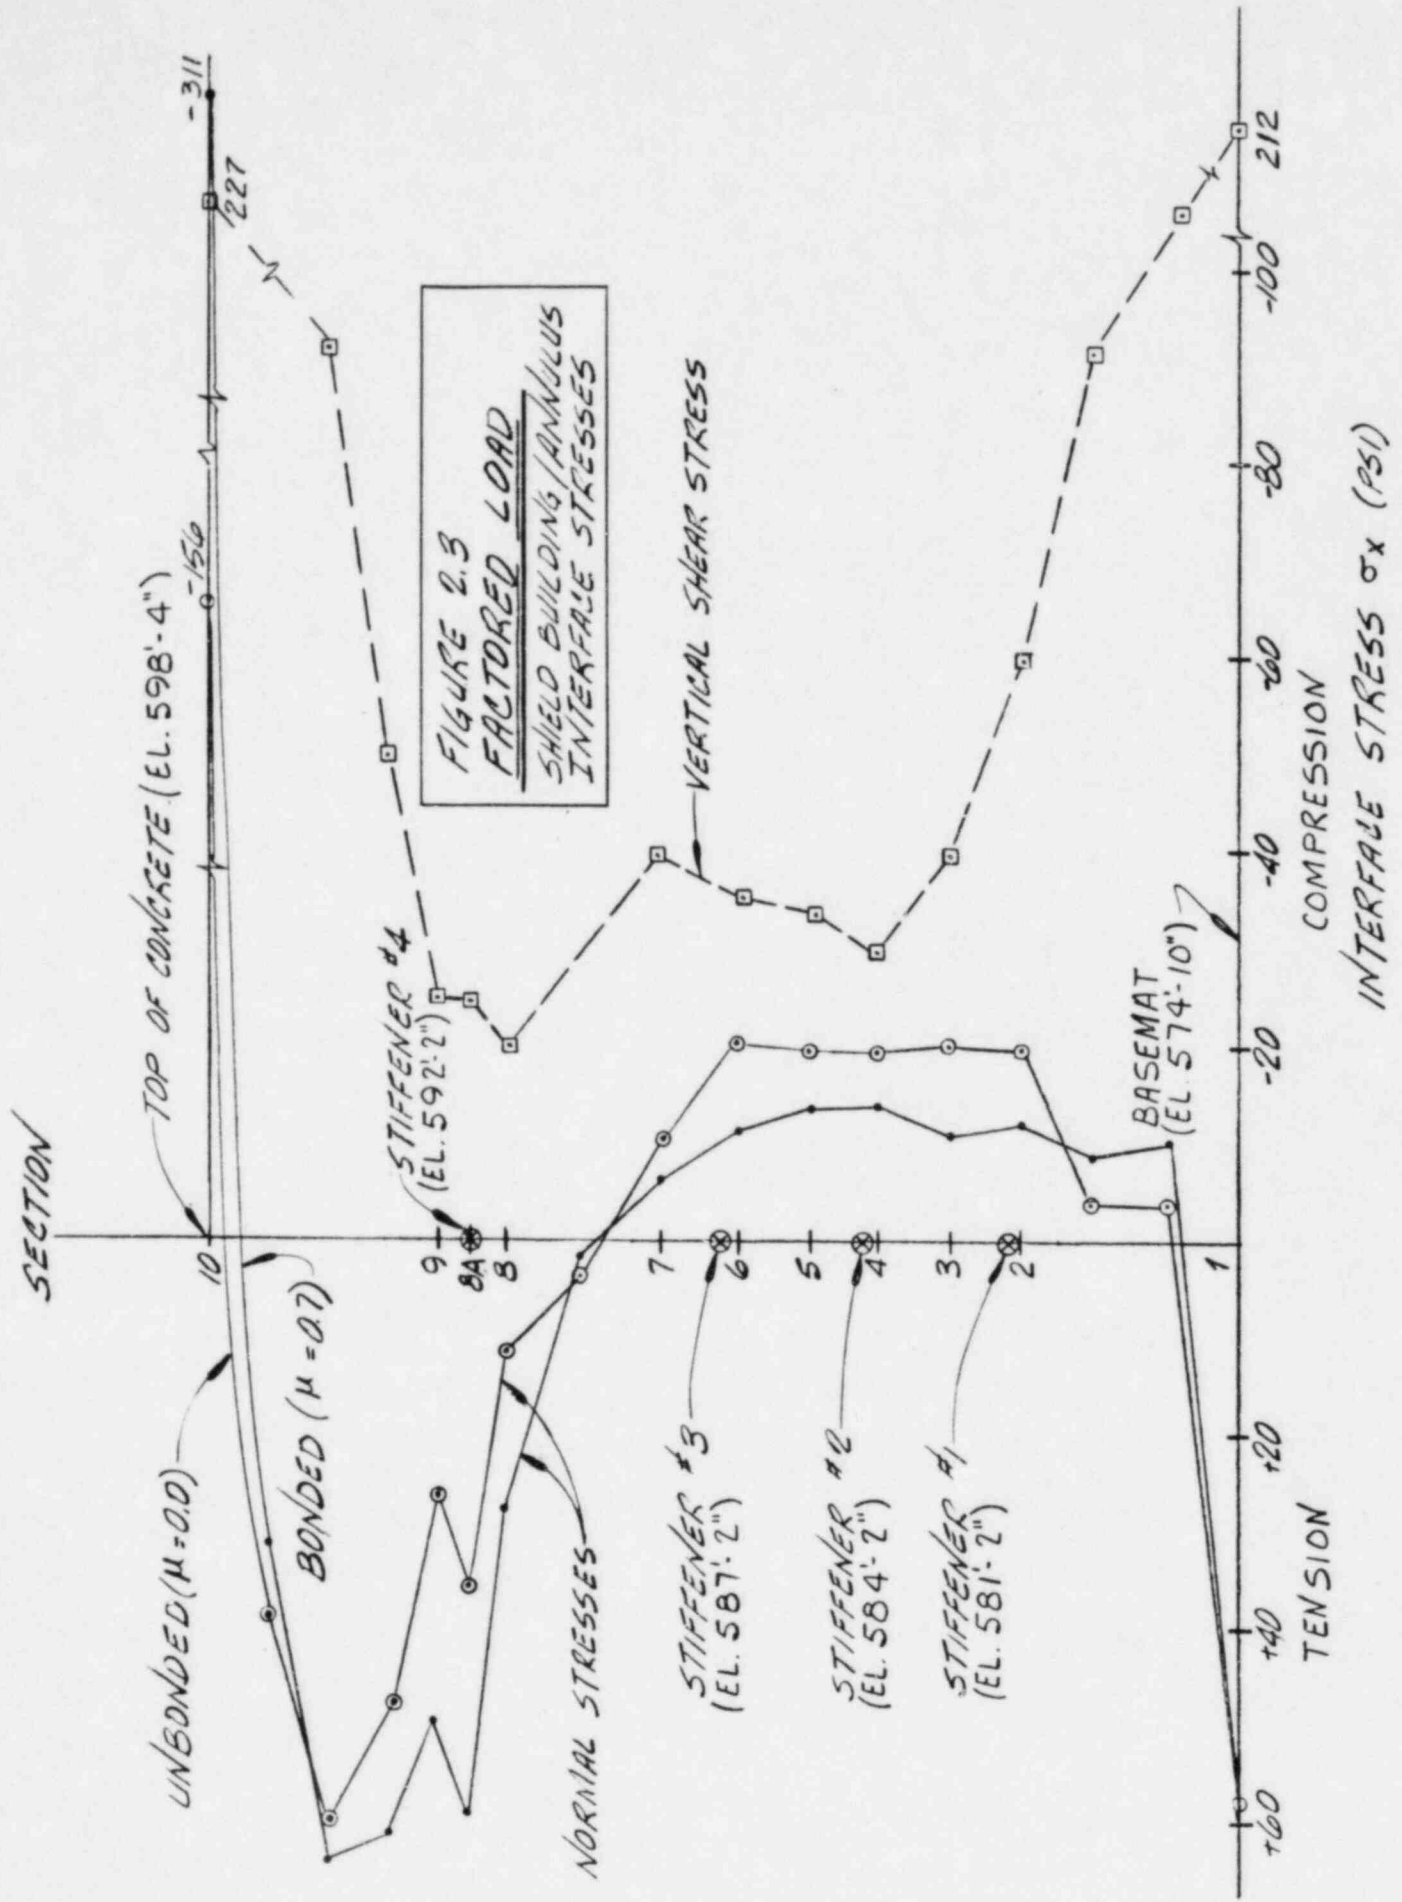

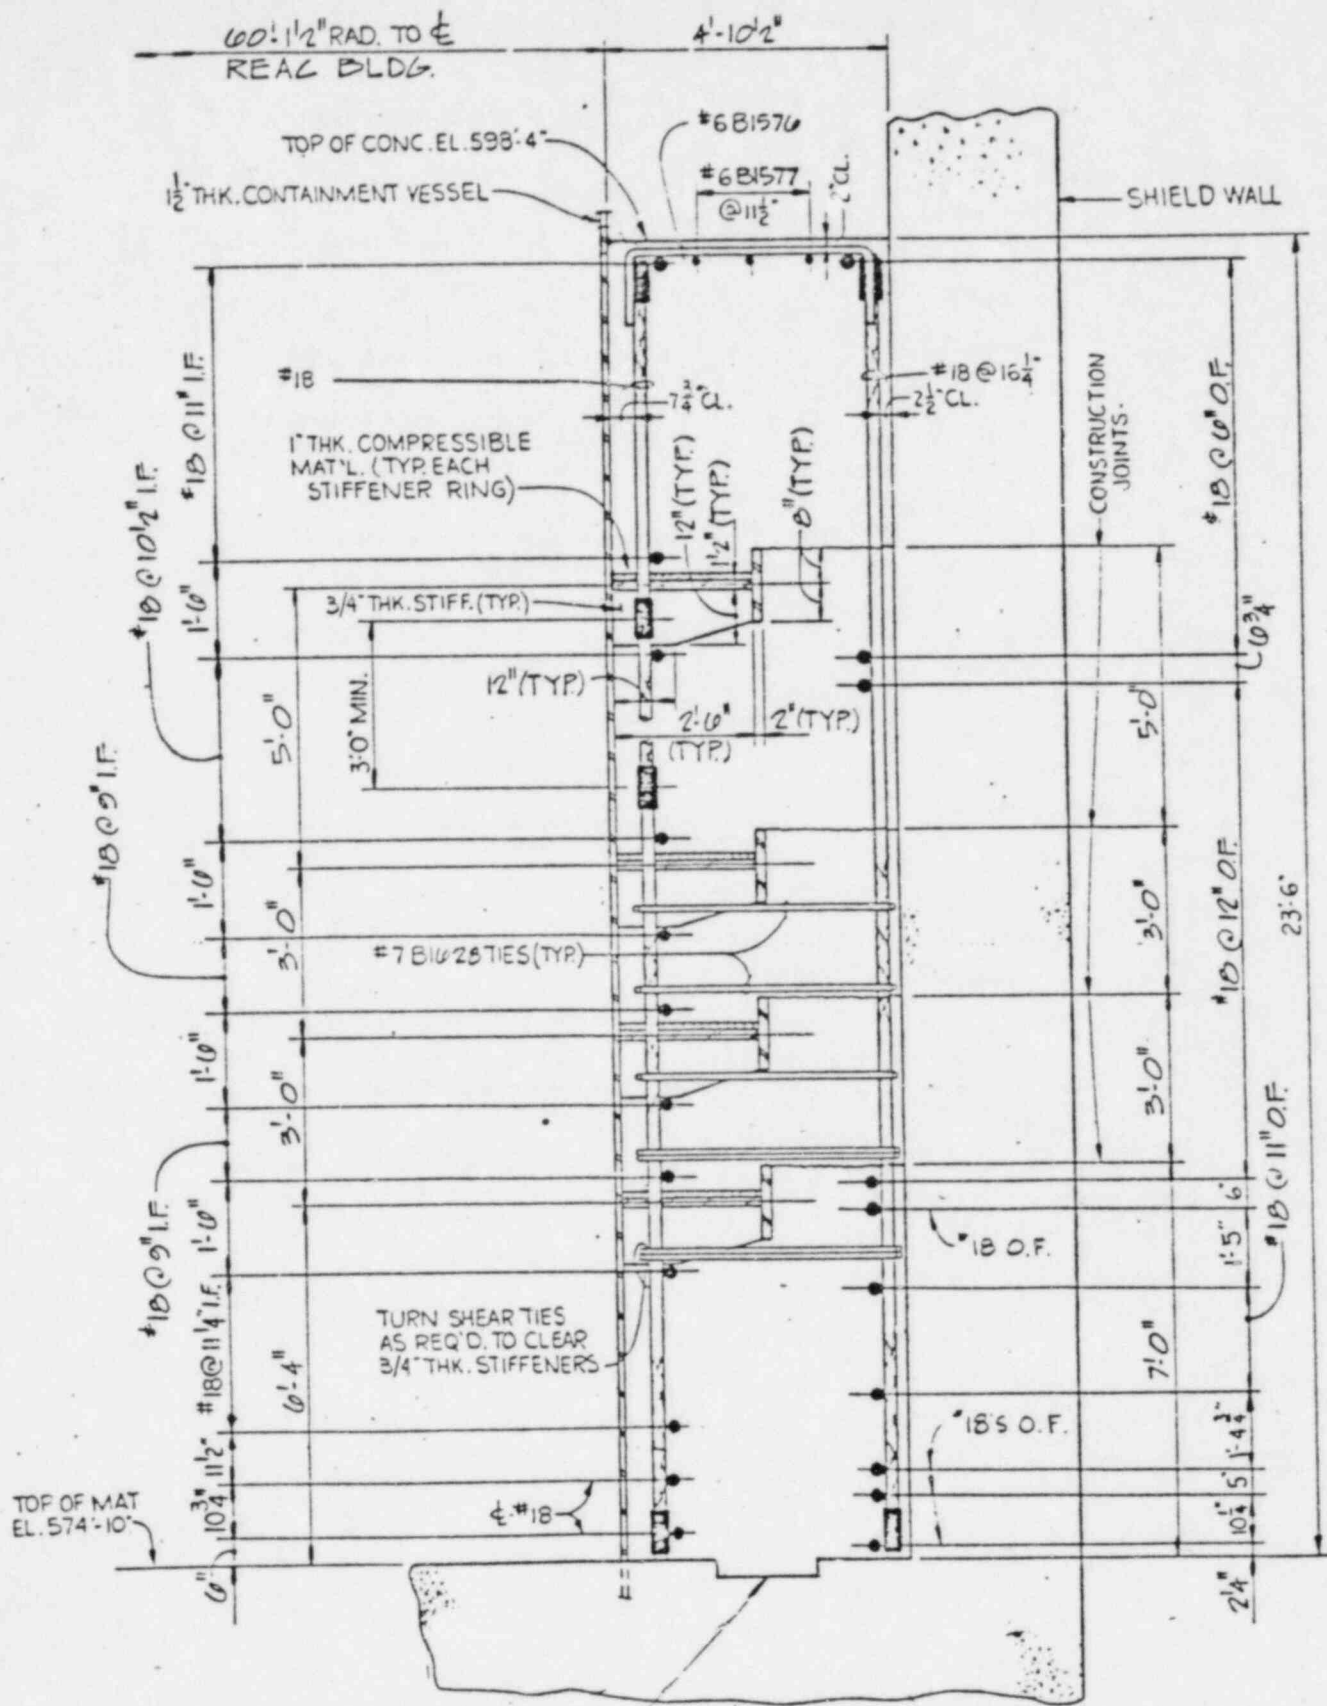

PROVIDE 21" WIDE \cdot 3 1/2" DP SHEAR KEY IN CONTAINMENT BASE MAT. SHEAR KEY TO BE CENTERED BETWEEN SHIELD WALL & CONT. VESSEL R FOR FULL CIRCUM-FERENCE OF REACTOR BLDG.

Figure 3.1
Annulus Concrete Reinforcing

NOTE: TWO POINTS ARE PLOTTED FOR EACH SECTION REPRESENTING THE COMBINATION OF + AXIAL AND ± MOMENTS

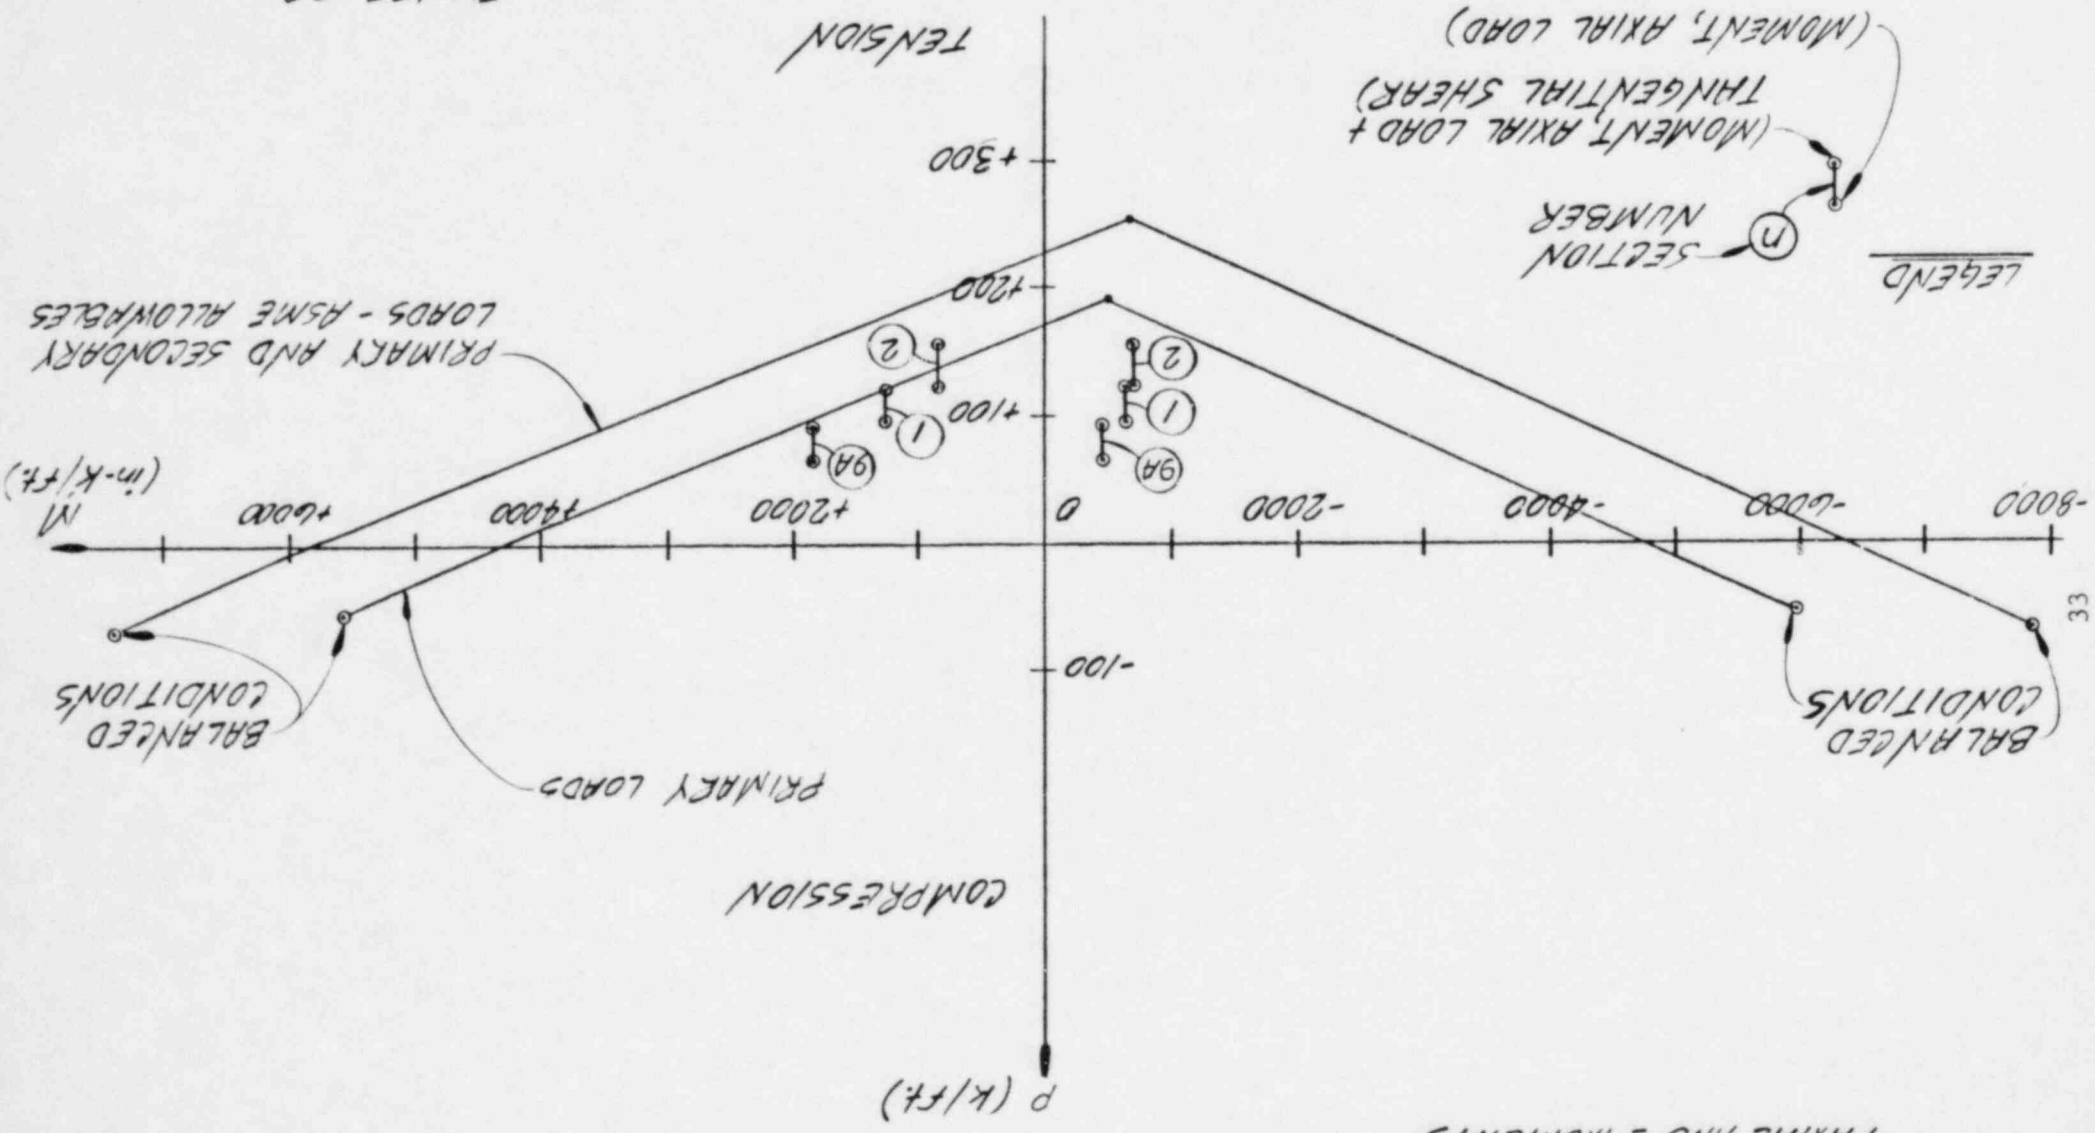


FIGURE 3.2
VERTICAL STEEL - SERVICE LOADS

PRIMARY AND SECONDARY
LOADS - ASME ALLOWABLES

BALANCED
CONDITIONS

PRIMARY LOADS

BALANCED
CONDITIONS

LEGEND
SECTION NUMBER
(MOMENT, AXIAL LOAD +
TANGENTIAL SHEAR)
(MOMENT, AXIAL LOAD)

COMPRESSION

TENSION

P (k/ft)

M (in-k/ft)

NOTE:

FOUR POINTS ARE PLOTTED FOR SECTION 7 REPRESENTING THE COMBINATIONS OF \pm AXIALS AND \pm MOMENTS.

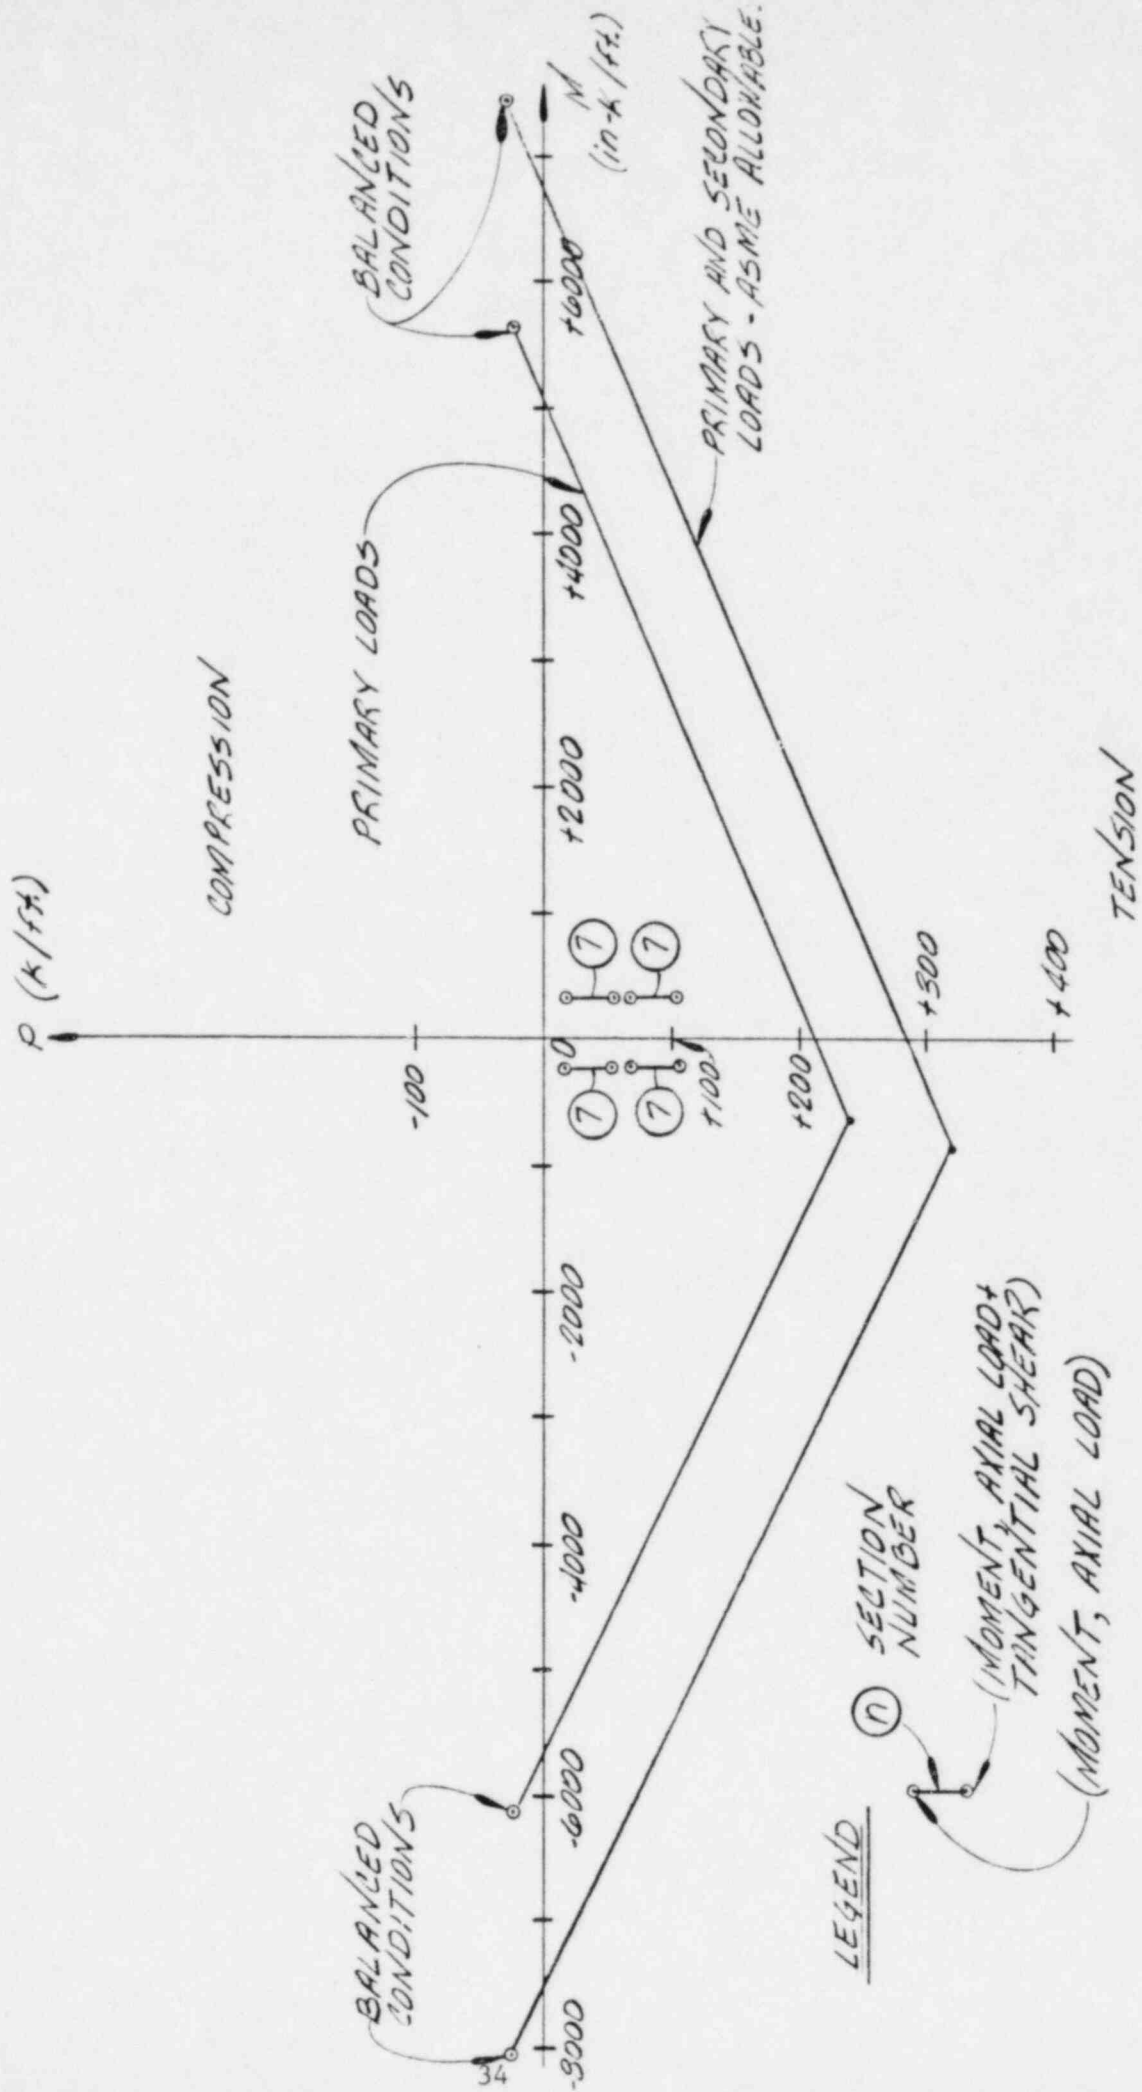


FIGURE 3.3

HORIZONTAL STEEL - BELOW ELEV. 570'-6" - SERVICE LOADS

NOTE: TWO POINTS ARE PLOTTED FOR SECTION 9A REPRESENTING TWO COMBINATIONS OF + AXIAL AND ± MOMENTS.

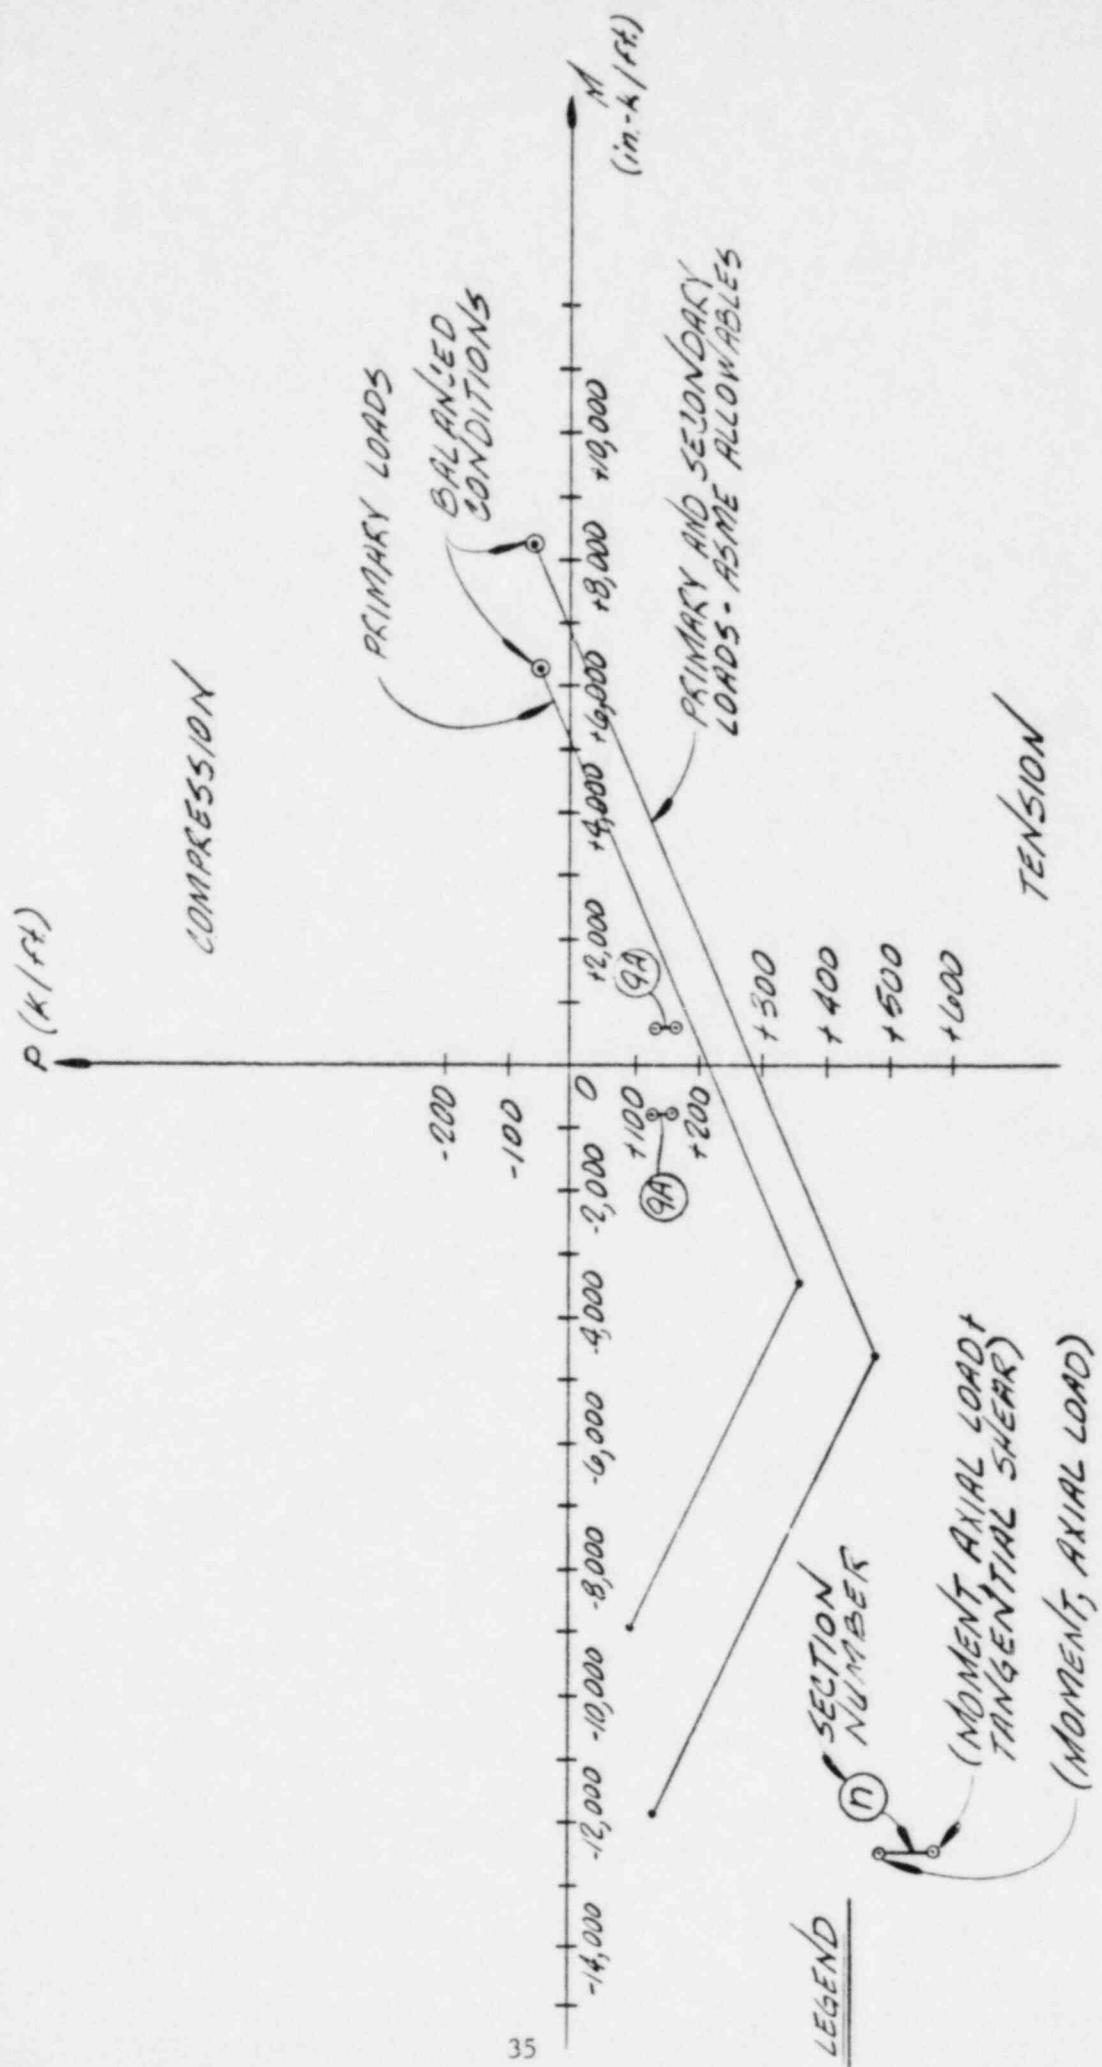


FIGURE 3.4
HORIZONTAL STEEL ABOVE ELEV. 590'-6" - SERVICE LOADS

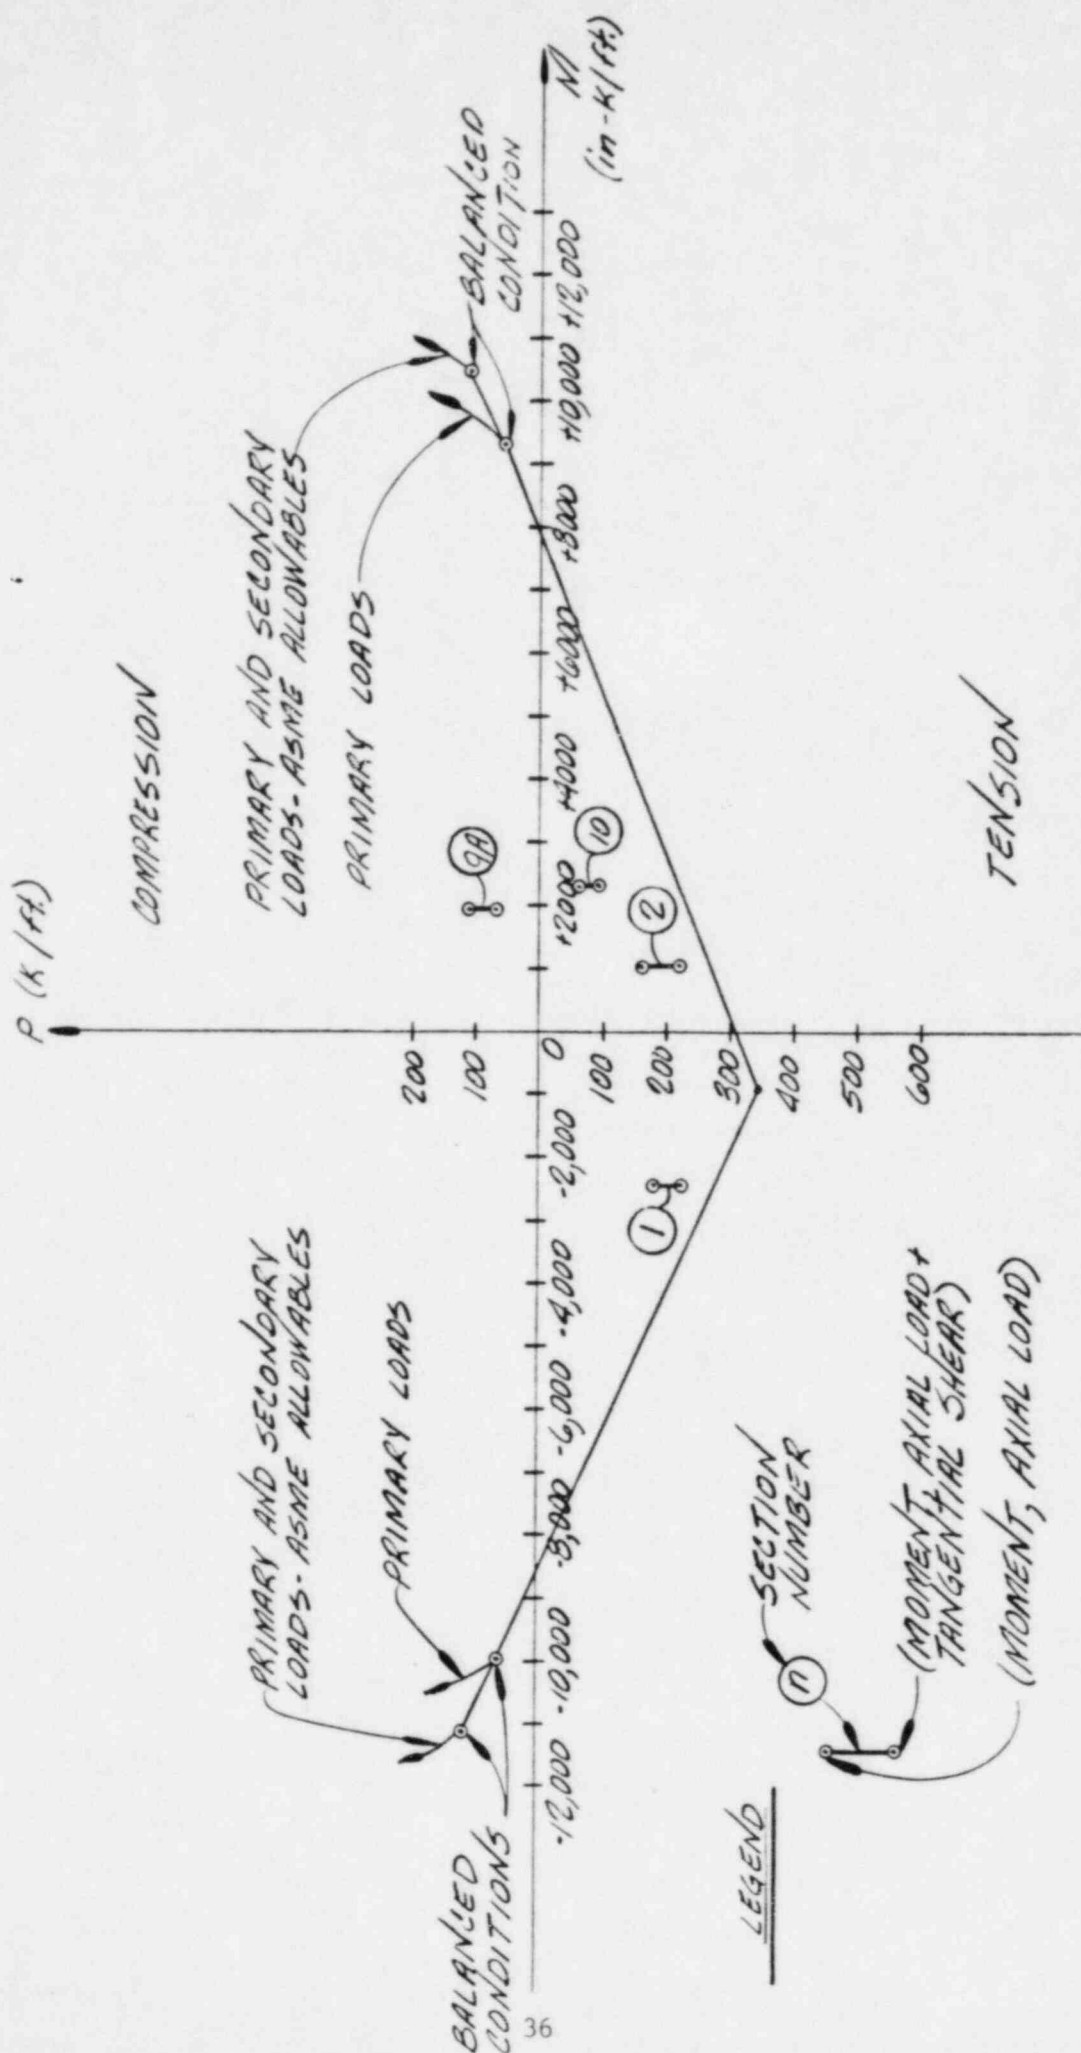


FIGURE 3.5
VERTICAL STEEL - FACTORED LOADS

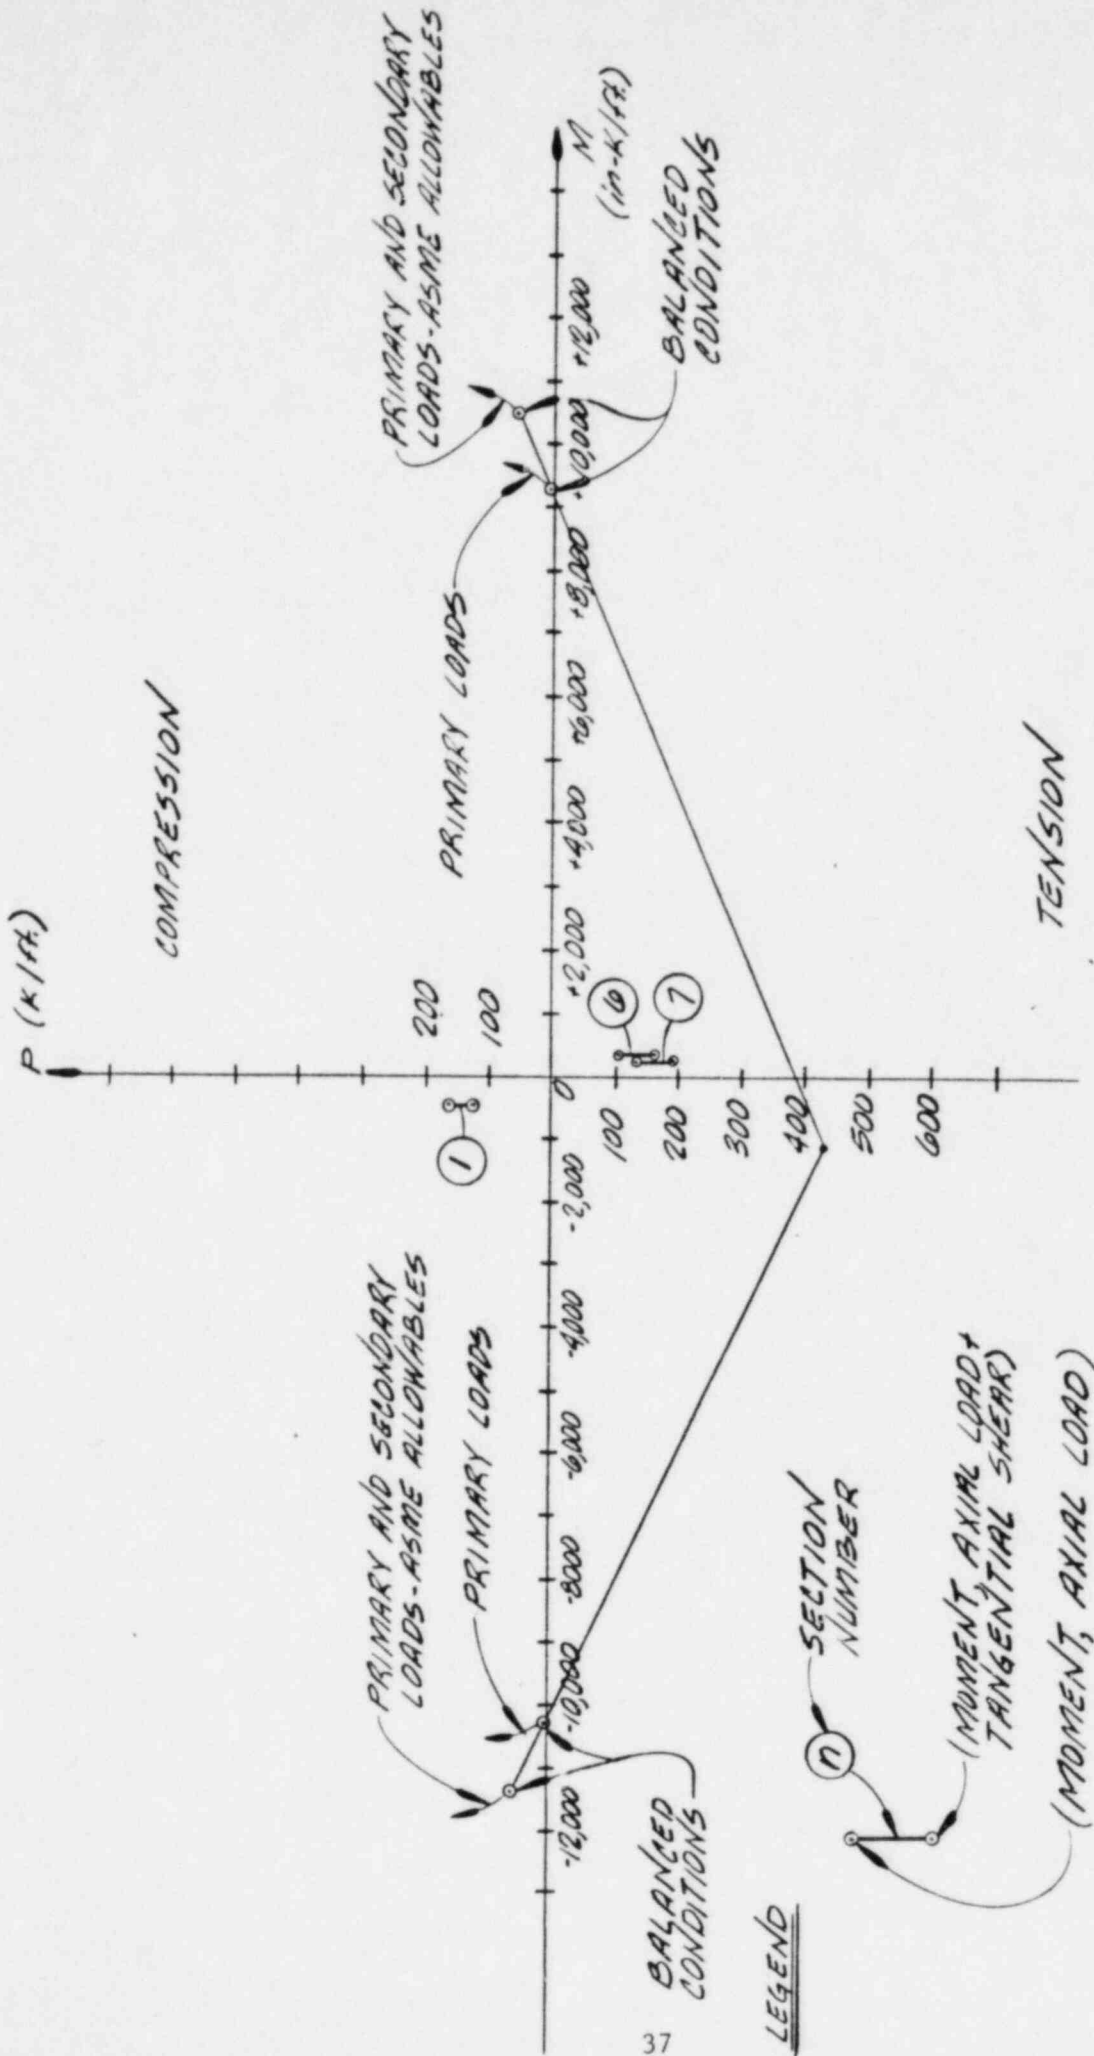


FIGURE 3.6

HORIZONTAL STEEL - BULLON ELEV. 590' 6" - FACTORED LOADS:

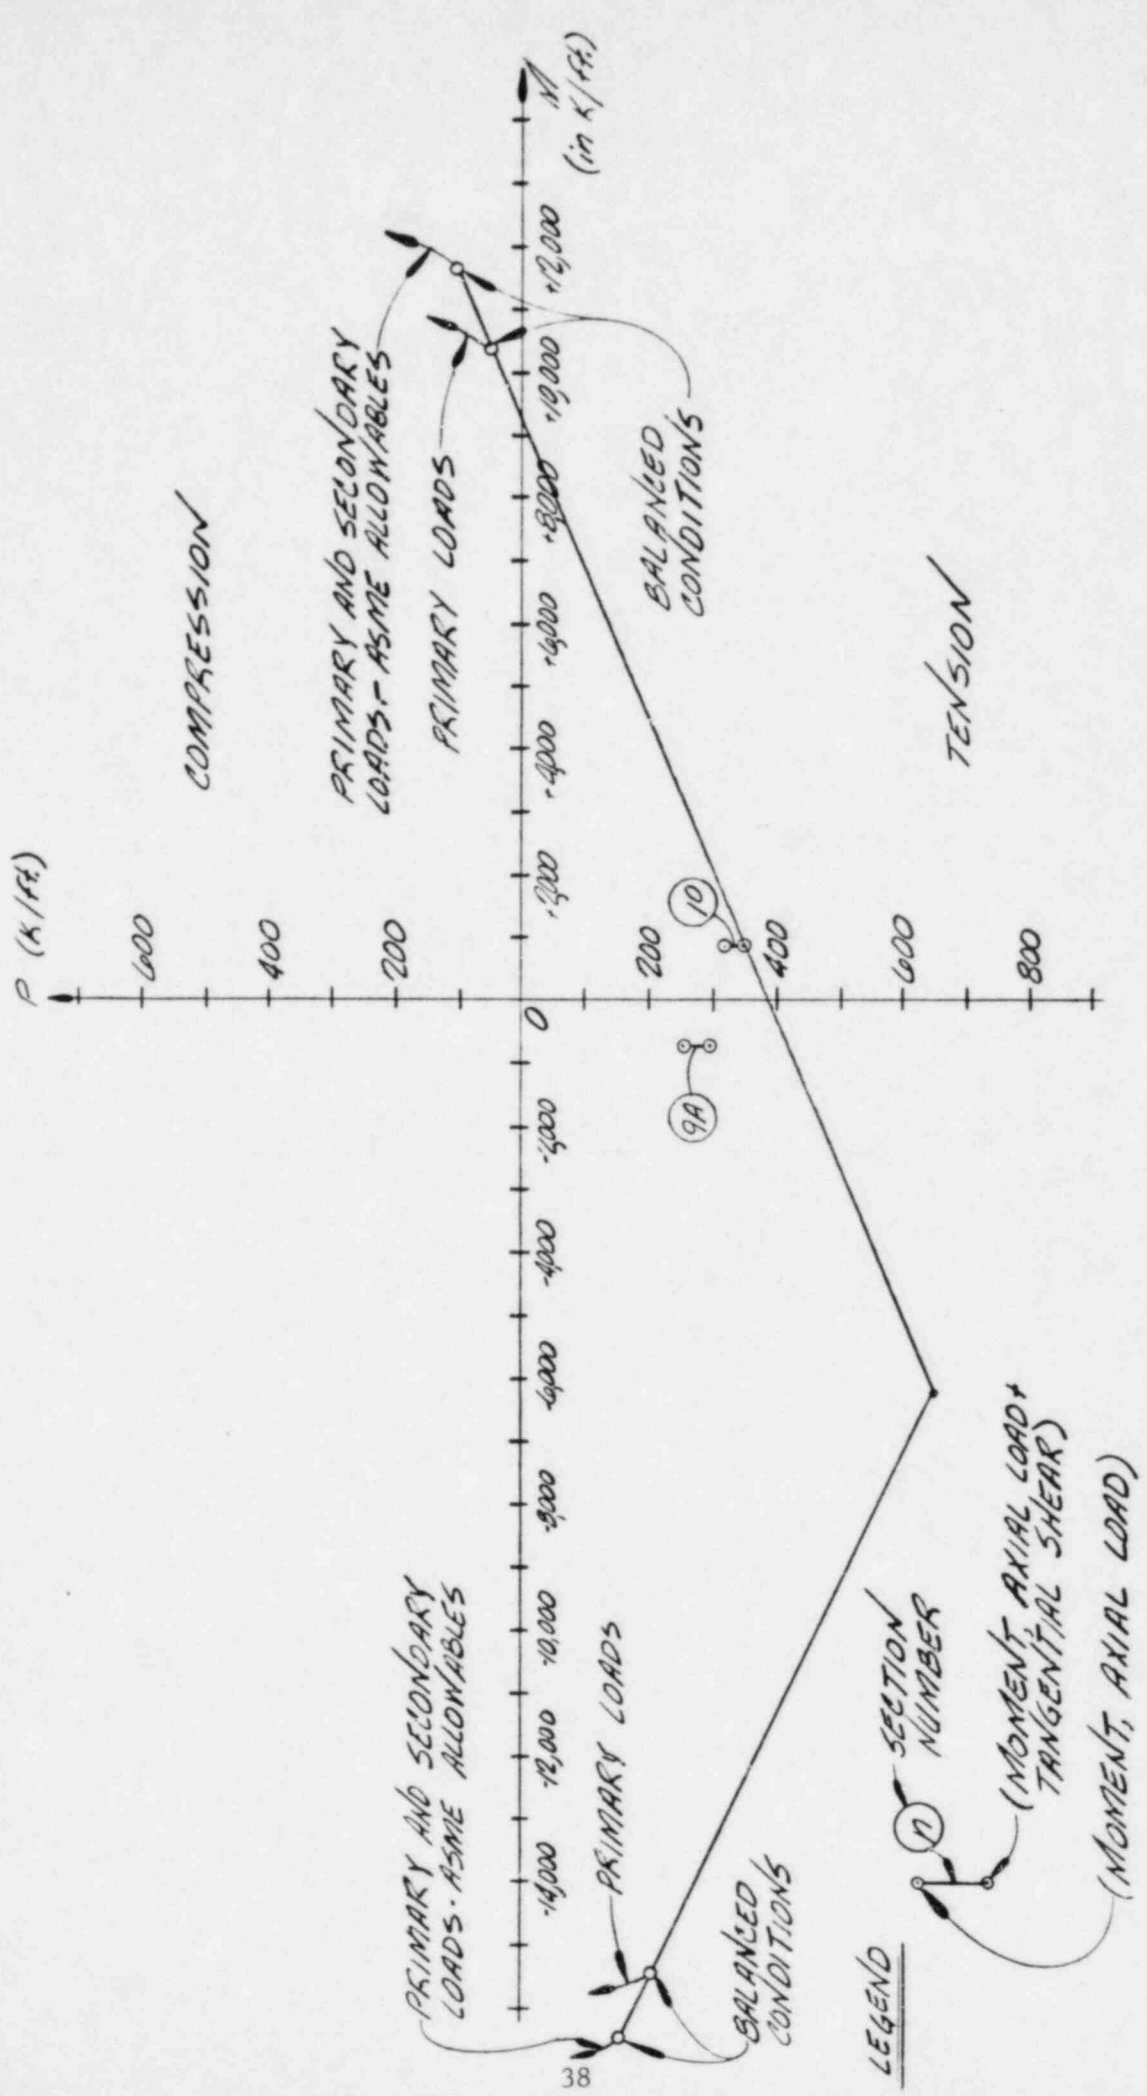


FIGURE 3.7
HORIZONTAL STEEL - ABOVE ELEV 590'-6" - FAULTED LOADS

8:00

LIST OF TABLES

- 3.1 Reinforcing Steel Stresses Excluding Tangential Shear
- 3.2 Calculated Tangential Shear Strength Based on Cornell⁽⁹⁾ and PCA⁽⁷⁾ Tests
- 3.3 Results of Duchon (10) Analyses with (w) and without (w/o) Inclined Reinforcement
- 4.1 Reinforcing Steel and Splicing Code Comparison
- 4.2 Concrete Code Comparison
- 4.3 Modified Table CC-5200-1
(ASME Code PNPP Spec. Comparison of Concrete Related Test Requirements)

Table 3.1 Reinforcing Steel Stresses
Excluding Tangential Shear

| Section No (1) | Reinforcing Stress - Tension (ksi) | | | |
|-------------------|------------------------------------|-----------------|----------------|-----------------|
| | Vertical (2) | | Horizontal (3) | |
| | Inside Face | Outside Face | Inside Face | Outside Face |
| 1 | 14.9 | 41.2 | C | C |
| 2 | 35.5 | 15.2 | 0 | 0 |
| 3 | 31.2 | 27.1 | 6.1 | 3.7 |
| 4 | 29.1 | 25.4 | 8.3 | 6.6 |
| 5 | 26.9 | 24.0 | 12.9 | 10.2 |
| 6 | 26.7 | 23.0 | 17.0 | 13.0 |
| 7 | 24.2 | 21.8 | 20.8 | 16.1 |
| 8 | 24.4 | 18.5 | 29.4 | 11.2 |
| 9 | 19.0 | 16.2 | 33.4 | 13.0 |
| 9A | 16.3 | C(4) | 40.1 | 16.0 |
| 10 | 26.3 | C | 50.8 | 14.6 |

Notes

- (1) See Figure 2.2.
- (2) Reinforcing ratio is 0.009.
- (3) Reinforcing ratio is 0.011 for Sections 1-7 and 0.017 for Sections 8-10.
- (4) Small compression.

Table 3.2 Calculated Tangential Shear Strength
Based on Cornell(9) and PCA(7) Tests

| Section No ^(a) | Perry Tangential Shear (b) psi | Cornell Tests Tangential Shear Strength - psi | | | PCA Tests Tangential Shear Strength - psi | | | Ratio-Tangential Shears Tests/Perry | |
|---------------------------|--------------------------------|---|------------|---------|---|------------------------------------|--------------------|-------------------------------------|------------------------|
| | | Vertical | Horizontal | Minimum | Minimum (c) | Minimum Upper Bound ^(d) | Limited Distortion | Cornell Minimum | PCA Limited Distortion |
| (1) | (2) | (3) | (4) | (5) | (6) | (7) | (8) | (9) | (10) |
| 1 | 57 | 203 | 365 | 203 | 152 | 253 | 102 | 3.56 | 1.79 |
| 2 | 81 | 220 | 365 | 220 | 199 | 275 | 132 | 2.72 | 1.63 |
| 3 | 81 | 233 | 343 | 233 | 233 | 291 | 156 | 2.88 | 1.93 |
| 4 | 82 | 239 | 335 | 239 | 250 | 299 | 167 | 2.91 | 2.04 |
| 5 | 82 | 246 | 318 | 246 | 268 | 308 | 179 | 3.00 | 2.18 |
| 6 | 83 | 246 | 303 | 246 | 270 | 309 | 180 | 2.96 | 2.17 |
| 7 | 83 | 254 | 290 | 254 | 290 | 318 | 193 | 3.06 | 2.33 |
| 8 | 82 | 253 | 319 | 253 | 288 | 298 | 192 | 3.08 | 2.34 |
| 9 | 78 | 269 | 296 | 269 | 332 | 283 | 222 | 3.45 | 2.85 |
| 9A | 62 | 277 | 259 | 259 | 305 | 257 | 203 | 4.18 | 3.27 |
| 10 | 41 | 248 | 199 | 199 | 141 | 216 | 94 | 4.85 | 2.29 |

Notes:

- (a) See Figure 2.2
- (b) Peak Values
- (c) Minimum value of vertical and horizontal
- (d) Conservative bound of minimum values

TABLE 3.3 - RESULTS OF DUCHON⁽¹⁰⁾ ANALYSES
WITH (W)* AND WITHOUT (W/O) INCLINED REINFORCEMENT

| Section ** | Vertical Reinforcement Stress (ksi) | | Horizontal Reinforcement Stress (ksi) | | Inclined Reinforcement Stress (ksi) | Concrete Distortional Shear Strain (Rad) | |
|---------------|--|-------------|--|-------------|--|---|-------------|
| | W/O (2) | W #5 (3) | W/O (4) | W #5 (5) | W #5 (6) | W/O (7) | W #5 (8) |
| (1) | | | | | | | |
| 1 | 49.6 | 47.2 | 14.4 | 12.8 | 87.3 | .00208 | .00192 |
| 2 | 39.6 | 37.9 | 9.16 | 7.97 | 66.1 | .00147 | .00134 |
| 3 | 37.3 | 35.3 | 14.5 | 13.1 | 65.1 | .00174 | .00161 |
| 4 | 35.2 | 33.2 | 15.7 | 14.3 | 64.9 | .00174 | .00161 |
| 5 | 33.2 | 31.1 | 19.0 | 17.6 | 56.5 | .00184 | .00170 |
| 6 | 34.4 | 32.0 | 23.3 | 21.8 | 54.7 | .00207 | .00192 |
| 7 | 32.7 | 30.2 | 26.6 | 25.1 | 49.1 | .00214 | .00199 |
| 8 | 33.7 | 30.7 | 34.6 | 32.9 | 47.2 | .00246 | .00228 |
| 9 | 29.6 | 26.4 | 40.3 | 37.8 | 47.5 | .00249 | .00227 |
| 9A | 26.6 | 23.3 | 45.6 | 43.2 | 42.4 | .00250 | .00227 |
| 10 | 37.5 | 33.1 | 57.5 | 54.3 | 57.8 | .00331 | .00301 |
| Avg. | 35.4 | 32.8 | 27.3 | 25.5 | 58.1 | .00217 | .00199 |
| % Decrease | - | 7.3 | - | 6.6 | - | - | 8.3 |

*Inclined reinforcement is at 45° and spaced 12" on centers, both directions. **See Figure 2.2 for location of sections.

TABLE 4.1

REINFORCING STEEL AND SPLICING - CODE COMPARISON

| CODE SECTION | SUBJECT | CORRESPONDING PNPP CONSTRUCTION SPEC. | + | = | - | REMARKS |
|-----------------|---|---------------------------------------|---|---|---|--|
| | CC-2300 Material (Reinforcing Systems). | | | | | |
| CC-2310(a) | Material used for reinforcing systems shall conform to ASTM A-615 | SP-663 2:05.1, 2:06 | | X | | |
| CC-2310(b) | Material to be used for bar to bar splices shall conform to ASTM A513, A519, A579 | SP-202 1:07.3 | | X | | |
| CC-2320 | Reinforcing system shall be traceable to CMTR during production and transit | SP-663 2:07 | | X | | |
| CC-2330 | Special material testing. | | | | | |
| CC-2331.1 | One full diameter tensile bar of each bar size shall be tested per each 50 tons or fraction | SP-663 2:06.1 | | X | | |
| CC-2331.2 | Acceptance standard is ASTM A615 | SP-663 2:06.1 | | X | | |
| | If specimen fails - two retest. | SP-663 2:06.3 | | | X | Single retest. Review of all material test reports show no failures. |
| CC-2332 | Bend test | | | | | |
| CC-2332.1(a) | Per ASTM 615 | SP-663 2:06.1 | | X | | |
| CC-2332.1(b)(1) | One full size specimen per heat | SP-663 2:06.1 | X | | | |
| CC-2332.1(b)(2) | Tested at ambient | ASTM A615 | | X | | |
| CC-2332.1(b)(3) | Tested around a 9d pin | Not Addressed | X | | | Tested around an 8d pin |
| CC-2332.2 | Acceptance standards | | | | | |
| CC-2332.2(b) | Absence of transverse cracking | SP-663 2:05.1 | X | | | |
| | If specimen fails - two retest. | SP-663 2:06.2.1 | | | X | Single retest - review shows no failures. |
| CC-2333 | Chemical analysis - reported in accordance with A615 | SP-663 2:05.1 | | X | | |

(+) Exceeds Section III, Division 2 Requirements

(=) Meets Code Requirements

(-) Construction Specification Insufficient

TABLE 4.1

REINFORCING STEEL AND SPLICING - CODE COMPARISON (Continued)

| CODE SECTION | SUBJECT | CORRESPONDING PNPP CONSTRUCTION SPEC. | + | = | - | REMARKS |
|--------------|---|---------------------------------------|---|---|---|--|
| | CC-4300 Fabrication and Construction (Reinforcing Systems). | | | | | |
| CC-4320 | Bending or reinforcing steel | SP-663 2:08.4 | | X | | |
| CC-4321.1 | Standard Hooks | | | | | |
| CC-4321.2 | Diameter | SP-663 2:08.4 | | X | | |
| CC-4322 | Stirups, tie hooks, and bend other than standard hooks | SP-663 2:08.4 | | X | | |
| CC-4324 | Bending | | | | | |
| CC-4323.1 | All bars shall be cold bent | SP-663 2:08.2 | | X | | |
| | Examination of bends | SP-663 2:08.6 | | X | | Inspected once per shift. |
| CC-4323.4 | Tolerances per Fig. CC-4323-2 or 3 | SP-663 2:08.4 | | | X | Final acceptance is based on as-built field condition. |
| 47 CC-4330 | Splicing or reinforcing bars | | | | | |
| CC-4331.1 | As required or permitted by designer | SP-202 1:07.1 | | X | | |
| CC-4331.2 | Permitted types of splices | SP-202 1:07.2 | | X | | |
| CC-4332 | Lap Splices | SP-202 1:07.2 | | X | | |
| CC-4333 | Mechanical Splices | | | | | |
| CC-4333.1.1 | Required qualification - splicers | SP-202 1:08.2 | | X | | |
| | Required qualification - splicing procedure | Not Addressed | | | X | PNPP utilized ERICO's proven splicing procedure |
| CC-4333.1.2 | Maintenance and certification of records | SP-202 1:08.1.10 | | X | | |
| CC-4333.1.3 | Splicing prior to qualification is not permitted | SP-202 1:08.2 | | X | | |
| CC-4333.2 | Splice system qualification requirements | Not Addressed | | | X | ERICO's long history of acceptable test results is an industry standard. |
| CC-4333.4 | Initial qualification test 2 per splice position | SP-202 1:08.2 | | X | | |
| CC-4333.5 | Continuing splice performance tests | | | | | |

(+) Exceeds Section III, Division 2 Requirements

(-) Meets Code Requirements

(-) Construction Specification Insufficient

TABLE 4.1

REINFORCING STEEL AND SPLICING - CODE COMPARISON (Continued)

| CODE SECTION | SUBJECT | CORRESPONDING PNPP CONSTRUCTION SPEC. | + | = | - | REMARKS |
|----------------|---|---------------------------------------|---|---|---|------------------------------------|
| CC-4333.5.1 | Continuing series of testing shall be performed | SP-202 1:09 | X | | | |
| CC-4333.5.2 | Splice samples | SP-202 1:09.1 & 1:09.2 | | X | | |
| CC-4333.5.3(a) | Frequency - 1 test per 100 splice | SP-202 1:09.3 | X | | | |
| CC-4333.5.4 | Tensile testing requirements | SP-202 1:09.4 | | X | | |
| CC-4333.5.4(a) | Tensile strength shall equal or exceed 125% yield | SP-202 1:09.4.1 | | X | | |
| CC-4333.5.4(b) | Running average of 15 shall equal or exceed minimum tensile | SP-202 1:09.4.2 | | X | | |
| CC-4333.5.5 | Substandard tensile test result | | | | | |
| CC-4333.5.5(a) | Failure in bar - investigate with fabricator | SP-202 1:09.5.1 | | | X | Report to owner - only difference. |
| CC-4333.5.5(b) | Failure in splice | SP-202 1:09.5.2 | X | | | |
| CC-4333.5.5(c) | Running average tensile strength failure | SP-202 1:09.5.3 | | X | | |
| CC-4333.5.5 | When splicing is resumed, frequency started anew | SP-202 1:09.5.4 | | X | | |
| CC-4333.6 | Recording of tensile test results | SP-202 1:08.1.10 | | X | | |
| CC-4340 | Placing reinforcing | | | | | |
| CC-4341 | Supports | SP-202 1:06.4 | | X | | |
| CC-4342 | Tolerances | SP-202 1:06.5 | | X | | |
| CC-4350 | Spacing of reinforcement | | | | | |
| CC-4351 | Layers | SP-14 5:07.2.3 & ACI 301 | | X | | |
| CC-4352 | Splices | SP-202 1:07 | | X | | |
| CC-4360 | Surface condition | SP-202 1:06.3 & 1:06.4.4 | | X | | |

(+) Exceeds Section III, Division 2 Requirements

(=) Meets Code Requirements

(-) Construction Specification Insufficient

TABLE 4.1

REINFORCING STEEL AND SPLICING - CODE COMPARISON (Continued)

| CODE SECTION | SUBJECT | CORRESPONDING PNPP CONSTRUCTION SPEC. | + | = | - | REMARKS |
|---------------|--|---------------------------------------|---|---|---|---|
| | CC-5300 Construction Testing and Examination (Reinforcing System) | | | | | |
| CC-5300 | Examination of reinforcing system | | | | | |
| CC-5320 | Acceptance criteria for mechanical splices | SP-202 1:07.3 & 1:08 | | X | | |
| CC-5321 | Sleeve with ferrous filler metal splices | | | | | |
| CC-5321(a) | One sleeve per crew visually examined daily for fit-up | Not Addressed | | | X | Const. Spec. to be revised. Contractor's procedure required at least one visual examination daily.. |
| CC-5321(b) | All completed sleeves shall be examined for: | | | | | |
| | - filler metal at end and tap hole | SP-202 1:08.1.9 | | X | | |
| | - check for allowable maximum void | SP-202 1:08.1.9 | | X | | |
| 46 CC-5340 | Examination of bends The bent or straightened surface of bars shall be visually examined for indication of cracks | SP-663 2:08.6 | | X | | Performed at fabricator facility. |

(+) Exceeds Section III, Division 2 Requirements

(-) Meets Code Requirements

(-) Construction Specification Insufficient

TABLE 4.2

CONCRETE - CODE COMPARISON

| CODE SECTION | SUBJECT | CORRESPONDING PNPP CONSTRUCTION SPEC. | + | = | - | REMARKS |
|--------------|--|---------------------------------------|---|---|---|---|
| | CC-2200 Material (Concrete and Concrete Constituents). | | | | | |
| CC-2220 | Concrete Constituents. | | | | | |
| CC-2221 | Cement | | | | | |
| CC-2221.1 | Material Requirement - shall conform to ASTM C-150, Type II | SP-14 5:06.1 | X | | | |
| CC-2222 | Aggregates. | | | | | |
| CC-2222.1 | Aggregates shall conform to ASTM C-33 | SP-14 5:07.1 & 5:07.2 | | | X | |
| CC-2222.1(b) | Flat and elongated particles - 15% CRD-C119 | SP-14 5:07.2.5 | | | X | |
| CC-2222.1(c) | Optional - Potential Alkali Reactivity of Cement Aggregate Combination Agg. ASTM C-227 | SP-14 5:07.2(c) | X | | | |
| | Optional - Potential Reactivity Aggregates ASTM C-289 | SP-14: 5:07.2(c) | X | | | |
| 47 | Optional - Potential Volume Change of Cement Aggregate Combination ASTM C-342 | SP-14 5:07.2(c) | X | | | |
| | Optional - Potential Alkali Reactivity of Carbonate Rocks for Concrete Aggregates ASTM C-586 | Not Addressed | | | X | Not Applicable - Code Optional Test. |
| | Required - Petrographic Examination | SP-14 5:07.2(c) | | | X | |
| CC-2222.1(d) | Water Soluble Chloride Content of Aggregates ASIM D-1411 | Not Addressed | | | X | Const. Spec. will be revised to include. |
| CC-2222.1(e) | Tangential Shear (L.A. Abrasion) Max. 40% ASTM C-131 | SP-14 5:18.3.3(1) | | | X | Const. Spec. Max. 50%, Const. Spec will be revised. Review of material Test Reports = Max. = 32%. |
| CC-2222.1(f) | Max. Size of Aggregate | SP-14 5:07.2.3 & ACI 301 | | | X | Revise Specification. Aggregate being used meets Requirements. |
| CC-2222.4 | Aggregate for Grout - Conforms to ASTM C-33 | SP-14 5:07.1.1 | | | X | |

(+) Exceeds Section III, Division 2 Requirements

(-) Meets Code Requirements

(-) Construction Specification Insufficient

TABLE 4.2

CONCRETE - CODE COMPARISON (Continued)

| CODE SECTION | SUBJECT | CORRESPONDING PNPP CONSTRUCTION SPEC. | + | = | - | REMARKS |
|----------------|---|---------------------------------------|---|---|---|--|
| CC-2223 | Mixing Water | | | | | |
| CC-2223.1 | Water Shall be Clean with Max. Total Solids of 2000 PPM. ASTM D-1888 | SP-14 5:09.1 | X | | | |
| | Water shall be tested for Chlorides ASTM 512 | SP-14 5:09.1.3 | | | X | |
| CC- 2223.2(a) | Time of setting ASTM C-191 | SP-14 5:09.2.1(b) | | | X | |
| CC-2223.2(b) | Compressive Strength | SP-14 5:09.2.1(c) | | | X | |
| CC-2224 | Admixtures | | | | | |
| CC-2224.1 | Construction Specification Shall Specify Type, Quantity, and Additional Limits. Each Admixture shall not contribute more than 5 PPM, by weight of Chloride Ions to total concrete constituent | Not Addressed | | | X | Const. Spec. will be revised. |
| 87 CC-2224.2.1 | Air Entraining Admixtures shall conform to ASTM C-260 | SP-14 5:08.1 | | | X | |
| CC-2224.2.3 | Chemical Admixtures shall conform to ASTM C-494 | SP-14 5:08.2 | | | X | |
| CC-2230 | Concrete Mix Design | | | | | |
| CC-2231.1 | Properties of Concrete which influence the Design shall be established in the Construction Specification | SP-14 | | | X | |
| CC-2231.2 | Chloride Content of Cement Paste shall not exceed 400 ppm by weight | Not Addressed | | | X | Const. Spec to be revised. |
| CC-2231.3 | Applicable Concrete Properties in Table CC-2231-1 shall be defined in Const. Spec. | Not Addressed | | | X | Const. Spec. to be revised. |
| CC-2231.4.1 | Mechanical Properties | Not Addressed | | | X | Code Option Testing not required. Const. Spec. to address. |
| CC-2231.4.2 | Physical Properties | Not Addressed | | | X | Code Option Testing not required. Const. Spec. to address. |
| CC-2231.4.3 | Thermal Properties | Not Addressed | | | X | Code Option Testing not required. Const. Spec. to address. |

(+) Exceeds Section III, Division 2 Requirements

(-) Meets Code Requirements

(-) Construction Specification Insufficient

TABLE 4.2

CONCRETE - CODE COMPARISON (Continued)

| CODE SECTION | SUBJECT | CORRESPONDING PNPP CONSTRUCTION SPEC. | | | | REMARKS |
|--------------|---|---------------------------------------|---|---|---|---|
| | | | + | = | - | |
| CC-2232 | Selection of Concrete Mix Proportions | | | | | |
| CC-2232.1 | Trial Mix Design Proportions | SP-14 5:04.2 | | X | | |
| CC-2232.2 | Strength Tests | SP-14 5:04.2 | | X | | |
| CC-2232.3 | Durability | | | | | |
| CC-2232.3.1 | W/C shall not be exceed 0.53 for Concrete Expose to Freezing Temperatures. | SP-14 5:10.1 | X | | | |
| CC-2240 | Cement Grout | | | | | |
| CC-2241 | Constituent for Cement Grout | | | | | |
| CC-2241.1 | Cement shall conform to ASTM C-150 | SP-14 5:06.1 | X | | | |
| CC-2241.2 | Aggregate shall conform to ASTM C-33 | SP-14 5:07.2 | | X | | |
| CC-2241.3 | Water shall conform to CC-2223 | SP-14 5:09 | | X | | |
| CC-2250 | Marking and Identification of Concrete Constituents Cement shall be sealed and tagged before leaving supplier showing lot number, specification, grind date and type | SP-14 5:06.5.4 | | | X | Const. Spec. to be revised. |
| CC-2252 | Aggregate shall be identified to size, source, and specification | Not Addressed | | | X | Presently, Addressed in nonmetallic material Manufacturer's QA Program. |
| CC-2253 | Admixture tanks shall be labeled with name, specification, and storage requirements. | Not Addressed | | | X | Nonmetallic material manufacturer's QA program will be revised to address labeling of storage requirements. |

(+) Exceeds Section III, Division 2 Requirements

(=) Meets Code Requirements

(-) Construction Specification Insufficient

TABLE 4.2

CONCRETE - CODE COMPARISON (Continued)

| CODE SECTION | SUBJECT | CORRESPONDING PNPP CONSTRUCTION SPEC. | + | = | - | REMARKS |
|--------------|--|--|---|---|---|---|
| | CC-4200 Fabrication and Construction (Concrete) | | | | | |
| CC-4220 | Storing, batching, mixing and transporting. | | | | | |
| CC-4221.1 | Stockpiling and storing aggregate. | SP-14 6:09.1 & 6:11.10 ACI 301 | | | X | |
| CC-4221.2 | Storage; Cement & Admixture. | SP-14 6:09.1 & 5:07.4 | | | X | |
| CC-4222 | Batching | | | | | |
| CC-4222.1 | Distribution | | | | | |
| | 1) Conform to ACI-304 | SP-14-6:11 | | | X | Per Const. Spec., ACI 301, not ACI 304 is used. Upgrade to ACI 304 requirements. |
| | 2) Only accepted material used | Not Addressed | | | X | Material must be accepted prior to use. Const. Spec. to be revised. |
| CC-4222.2 | Measuring | | | | | |
| | 1) By weight - Cement & Aggregates | SP-14 6:11.3 | | | X | |
| | 2) By volume - H ₂ O | SP-14 6:11.5 | | | X | |
| | 3) Free moisture correction shall be accounted for | SP-14 5:11.5 | | | X | |
| | 4) Tolerances per ASTM C-94 | SP-14 6:11.9 ACI-301-72 | | | X | Aggregate - ACI 301-72 gives 2% tolerance on all drops. ASTM C-94 gives 2% tolerance on 1st drop and 1% thereafter. Const. Spec. will be revised. |
| CC-4223.1 | Mixing - per ASTM C-94 | SP-14 6:11.10 per ASTM C-94 as modified by ACI-301 | | | X | Const. Spec. allows modification per ACI-301. Revise Const. Spec. to meet ASTM C-94 in it's entirety. |
| CC-4223.2 | Operation of mixer per ASTM C-94 | SP-14 6:11.10 | | | X | ACI-301 Sect. 7.2.2 gives same requirements as ASTM C-94. |
| CC-4224.1 | Conveying from mixer to point of placement | SP-14, SP-201 & ACI-301 | | | X | Specs satisfy code requirements. |
| CC-4224.2 | Conveying equipment | SP-201 1:12, SP-14 6:09 | | | X | Specs satisfy code requirements. |

(+) Exceeds Section III, Division 2 Requirements

(=) Meets Code Requirements

(-) Construction Specification Insufficient

TABLE 4.2

CONCRETE - CODE COMPARISON (Continued)

| CODE SECTION | SUBJECT | CORRESPONDING PNPP CONSTRUCTION SPEC. | + | = | - | REMARKS |
|--------------|--|---------------------------------------|---|---|---|--|
| CC-4225 | Depositing | | | | | |
| CC-4225.1 | General | SP-201 1:12.1 Ref. ACI-301 | | X | | |
| CC-4225.2 | Continuity | SP-201 1:09 | | X | | |
| CC-4226 | Consolidation | | | | | |
| CC-4226.1 | General per ACI-309 | SP-201 1:12.1 Ref ACI-301 | X | | | |
| CC-4240 | Curing | | | | | |
| | (A) Moisture cured through minimum curing period | SP-201 1:15 | | X | | |
| | (D) When mean daily temperature is below 40°F, concrete to be at least 50°F & moist for 7 days | SP-201 1:15.4 | | | X | Const. Spec to be revised. |
| CC-4250 | Formwork and Const. Joints | | | | | |
| CC-4251.1 | General - properly designed braced and tied | SP-201 1:07 | | X | | |
| CC-4251.2 | Design of formwork - ACI-347 | SP-201 1:07.3 Ref ACI-301-72 | | X | | ACI 301.72 Refs ACI-347. |
| CC-4251.3 | Use of liner as formwork | Not Addressed | | | X | Const. Spec to address this situation. |
| CC-4252 | Construction joints located as shown on drawings | SP-201 1:09.1.1 | | X | | |
| CC-4260 | Cold and hot weather conditions | SP-14 15:3.1 SP-201 1:06.3 | | X | | |
| CC-4270 | Repairs to concrete - as directed by designer and per CC-4252 of code. | SP-201 1:07.7.2 1:18 | | X | | |

(+) Exceeds Section III, Division 2 Requirements

(=) Meets Code Requirements

(-) Construction Specification Insufficient

TABLE 4.2

CONCRETE - CODE COMPARISON (Continued)

| CODE SECTION | SUBJECT | CORRESPONDING PNPP CONSTRUCTION SPEC. | + | = | - | REMARKS |
|--------------|--|---|---|---|---|---|
| | CC-5200 Construction Testing and Examination (Concrete). | | | | | |
| CC-5200 | Concrete examinations | | | | | |
| CC-5210 | General | Not Addressed | | | X | We will have an Authorized Inspector. |
| CC-5220 | Concrete Constituents | | | | | |
| CC-5221.1 | Cement Requirements | SP-14 5:18.3.7 | X | | | |
| CC-5221.2 | Testing frequency | See modified Table CC-5200-1 | | X | | |
| CC-5223.1 | Admixture requirements ASTM C-494 | SP-14 5:18.3.5 5:04.1c | | | X | Will revise Const. Spec. to address Code requirement. |
| CC-5223.2 | Testing frequency | See modified Table CC-5200-1 | | X | | |
| CC-5224.1 | Aggregate requirements prior to use | SP-14 5:04.1.8, 5:18.3.3 Not Addressed | | | X | Will revise Const. Spec to address passing agg. tests prior to use. |
| CC-5224 | Testing frequency | See modified Table CC-5200-1 | | | X | |
| CC-5225.1 | Mixing water requirements | Not Addressed | | | X | Will revise Const. Spec. to address this requirement. |
| CC-5225.2 | Testing frequency | See modified Table CC-5200-1 | | | X | Will revise Const. Spec. to address Code requirement. |
| CC-5231 | Concrete, sampled to ASTM C-172 | SP-14 5:18.3.1b | | | X | |
| CC-5232.1 | Slump requirements to ASTM C-143 | SP-14 5:18.3.1.E | | | X | |
| CC-5232.2 | Testing frequency | SP-14 5:17.2.1 | X | | | |
| CC-5233.1 | Temperature requirement | SP-14 5:18.3.1.G | | | X | |
| | Air content to ASTM C-173 or ASTM C-231 | SP-14 5:18.3.1.F | | | X | |
| | Unit weight to ASTM C-138 | SP-14 5:18.3.1.H | | | X | |
| CC-5233.2 | Testing frequency | See Modified Table CC-5200-1 | | | X | |
| CC-5234.1 | Compressive strength cylinders ASTM C-31 or ASTM C-39 | SP-14 5:18.3.D | | | X | |
| CC-5234.2 | Evaluation and acceptance | SP-14 5:18.5 | | | X | |

(+) Exceeds Section III, Division 2 Requirements

(=) Meets Code Requirements

(-) Construction Specification Insufficient

TABLE 4.3

 MODIFIED TABLE CC-5200-1
 ASME CODE/PNPP SPEC. COMPARISON OF CONCRETE RELATED TEST FREQUENCIES

| MATERIAL | REQUIREMENTS AND METHOD | FREQUENCY | CORRESPONDING PNPP CONSTRUCTION SPEC. | | | | REMARKS |
|------------------------------------|---|----------------------------------|--|---|---|----------------|--|
| | | | | + | = | - | |
| CEMENT | Standard chemical prop. ASTM C-114 | Each 1200T | SP-14 5:18.3.7 | X | | | |
| | Fineness ASTM C-204 or ASTM C-115 | Each 1200T | SP-14 5:18.3.7 | | X | | |
| | Auto clave expansion ASTM C-151 | Each 1200T | SP-14 5:18.3.7 | | X | | |
| | Compressive strength ASTM C-109 | Each 1200T | SP-14 5:18.3.7 | X | | | |
| | Time of setting ASTM C-266 or ASTM C-191 | Each 1200T | SP-14 5:18.3.7 | | X | | |
| AGGREGATE | Gradation ASTM C-136 | Each 1000 C.y. | SP-14 5:18.3.3.A | X | | | |
| | Moisture ASTM C-566 | Twice Daily during production | SP-14 5:18.3.3.B | | X | | |
| | Material finer than #200 ASTM C-117 | Each 1000 C.y. | SP-14 5:18.3.3.C | X | | | |
| | Organic impurities ASTM C-40 | Each 1000 C.y. | SP-14 5:18.3.3.D | X | | | |
| | ... and elongated particles CRD C-119 | Monthly | SP-14 5:18.3.3.I | | | X | SP-14 frequency; every 6 months. |
| | Friable particles ASTM C-142 | Monthly | SP-14 5:18.3.3.E | | X | | |
| | Light weight particles ASTM C-123 | Monthly | SP-14 5:18.3.3.F | | X | | |
| | Specific gravity and absorption ASTM C-127 or ASTM C-128 | Monthly | SP-14 5:18.3.3.M | | | X | Absorption not addressed Specific gravity meets code. |
| | L.A. Abrasion ASTM C-131 or ASTM C-535 | Every 6 months | SP-14 5:18.3.3.H | | X | | |
| | Potential reactivity ASTM C-289 | Every 6 months | SP-14 5:18.3.3.J | | X | | |
| | Soundness ASTM C-88 | Every 6 months | SP-14 5:18.3.3.K | | X | | |
| Water soluble chloride ASTM D-1411 | Every 6 months | | | | X | Not Addressed. | |
| WATER & ICE | Effect on compressive Str. ASTM C-109 | Every 6 months | Not Addressed | | | X | |
| | Effect on setting time ASTM C-191 | Every 6 months | Not Addressed | | | X | |
| | Total solids ASTM D-1888 | Every 6 months | Not Addressed | | | X | |
| | Chlorides ASTM D-512 | Monthly | Not Address | | | X | |

(+) Exceeds Section III, Division 2 Requirements

(=) Meets Code Requirements

(-) Construction Specification Insufficient

TABLE 4.3

 MODIFIED TABLE CC-5200-1
 ASME CODE/PNPP SPEC. COMPARISON OF CONCRETE RELATED TEST FREQUENCIES (Continued)

| MATERIAL | REQUIREMENTS AND METHOD | FREQUENCY | CORRESPONDING PNPP CONSTRUCTION SPEC. | + | = | - | REMARKS |
|-------------------------|---|---|--|---|---|---|------------------------------------|
| ADMIXTURE | Uniformity - infrared spectrophotometry, PH and solids per ASTM C-494 | Each load | SP-14 5:18.3.5 | | | X | |
| CONCRETE | Mixer uniformity ASTM C-94 | Initially and every 6 months | SP-14 5:18.3.1.A | | X | | |
| | Compressive strength ASTM C-39 or CRD C-84 | 1 set every 100 cy 1 set a day for each class | SP-14 5:6.1 | | X | | |
| | Slump ASTM C-143 | 1st batch & every 50 cy. | SP-14 5:17.2.1 | X | | | |
| | Air Content ASTM C-173 or C-231 | 1st batch & every 50 cy | SP-14 5:18.3.F | | | X | Code every 50 cy/spec every 100 cy |
| | Temperature | 1st batch & every 50 cy | SP-14 5:18.3.1.G | X | | | |
| Weight/Yield ASIM C-138 | Daily during production | SP-14 5:18.3.1.H | | | X | | |

54

(+) Exceeds Section III, Division 2 Requirements

(=) Meets Code Requirements


(-) Construction Specification Insufficient

APPENDIX A

Comparison of SRVD Response Spectra for the Containment Vessel with and without the Annulus Concrete

Response spectra are presented for Elevation 579'-5" (node 155), Elevation 664'-10" (node 272), and Elevation 749'-4" (node 311) in the radial (direction 1), vertical (direction 2), and tangential (direction 3) directions for the General Electric safety relief valve discharge (SRVD) random loading for 19 valves, load case 23. Figures 1-3 are the response spectra for the SRVD analysis which does not include the annulus concrete. These response spectra curves are envelopes of GE random loadings 19 valves - load case 23, 19 valves - load case 32, and 19 valves - load case 46. Load case 23 provided the largest response of the three load cases and therefore these curves can be compared to the response spectra curves presented in Figures 4-6 which are generated from random load 19 valves - load case 23. Some problems may arise since the response spectra from three enveloped load cases are being compared to one individual load case; however, the comparison provides a good indication of the changes caused by the addition of the annulus concrete. Node 155 is located in the suppression pool, node 272 is located on the cylindrical portion of the vessel above the pool, and node 311 is located on the dome.


As an example, if Figure 3a is compared to Figure 6a, it is observed that the peak acceleration response for the 1% damping curve was reduced from 10.7 g to 0.44 g. A frequency shift caused by the addition of the annulus concrete occurred. The center of the peak for the analysis which did not include annulus concrete is located at approximately 18.0 Hz (figure 3a) while the center of the peak for the analysis which did include the annulus concrete is located at approximately 25.0 Hz. The additional stiffness provided by the annulus concrete caused a substantial reduction in the acceleration response of the Containment Vessel and a frequency shift in the location of the peak response.

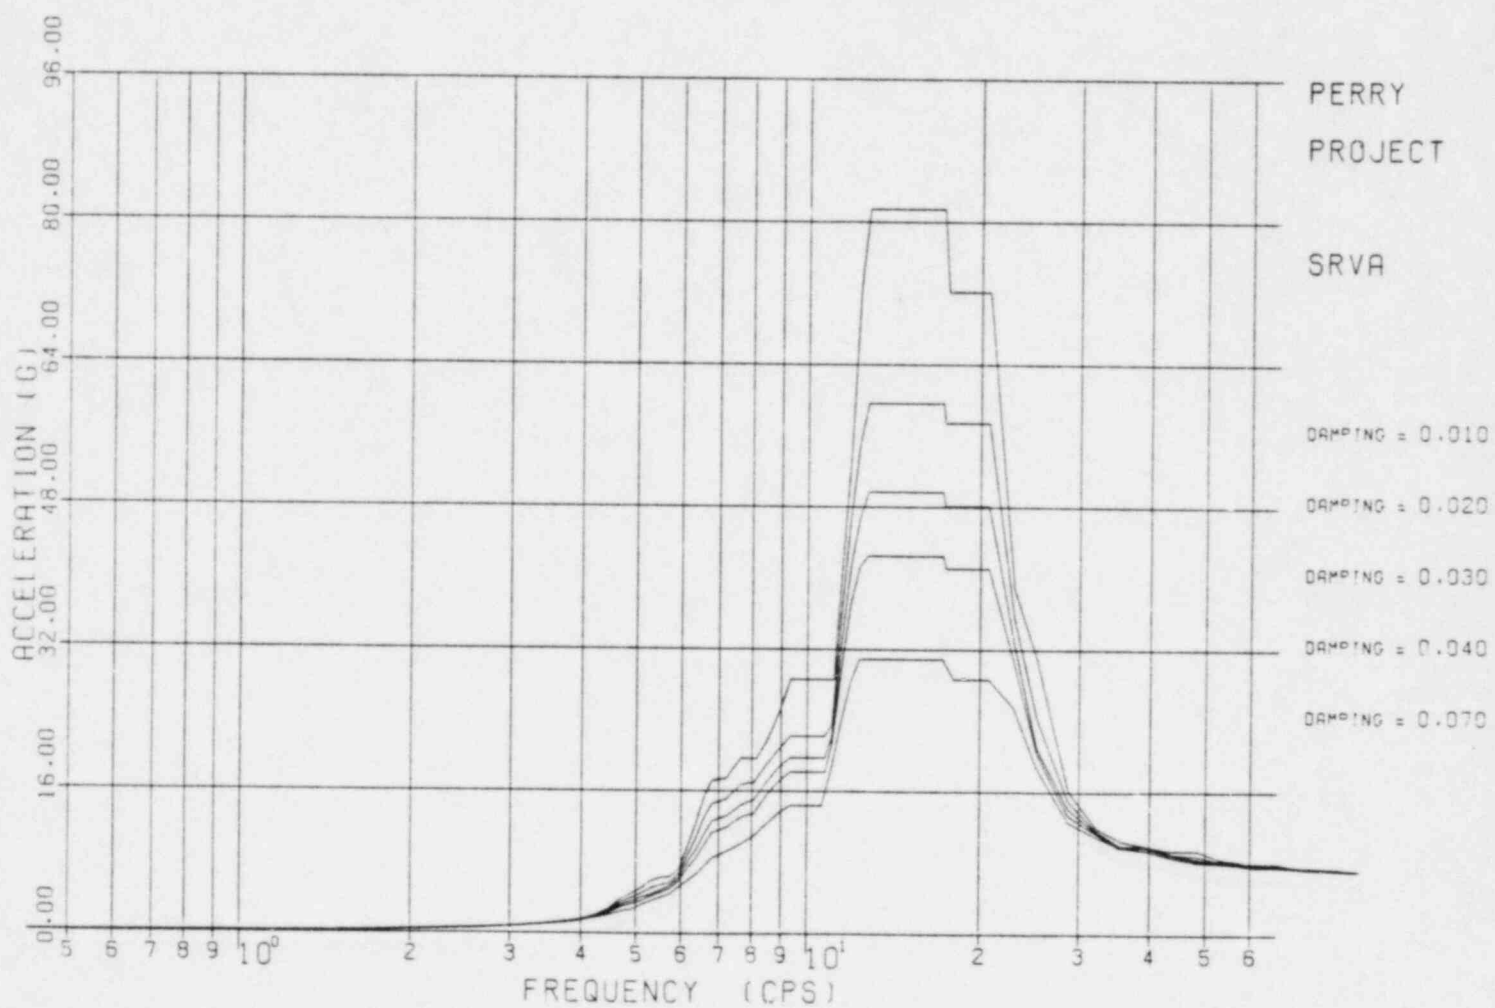

ENVELOPED SPECTRA FOR JOINT 155 IN DIRECTION 1
FOR LOAD CASES 19231, 19321, 19461

FIGURE 1a


RADIAL RESPONSE SPECTRA AT
EL. 579'-5"
NO ANNULUS CONCRETE

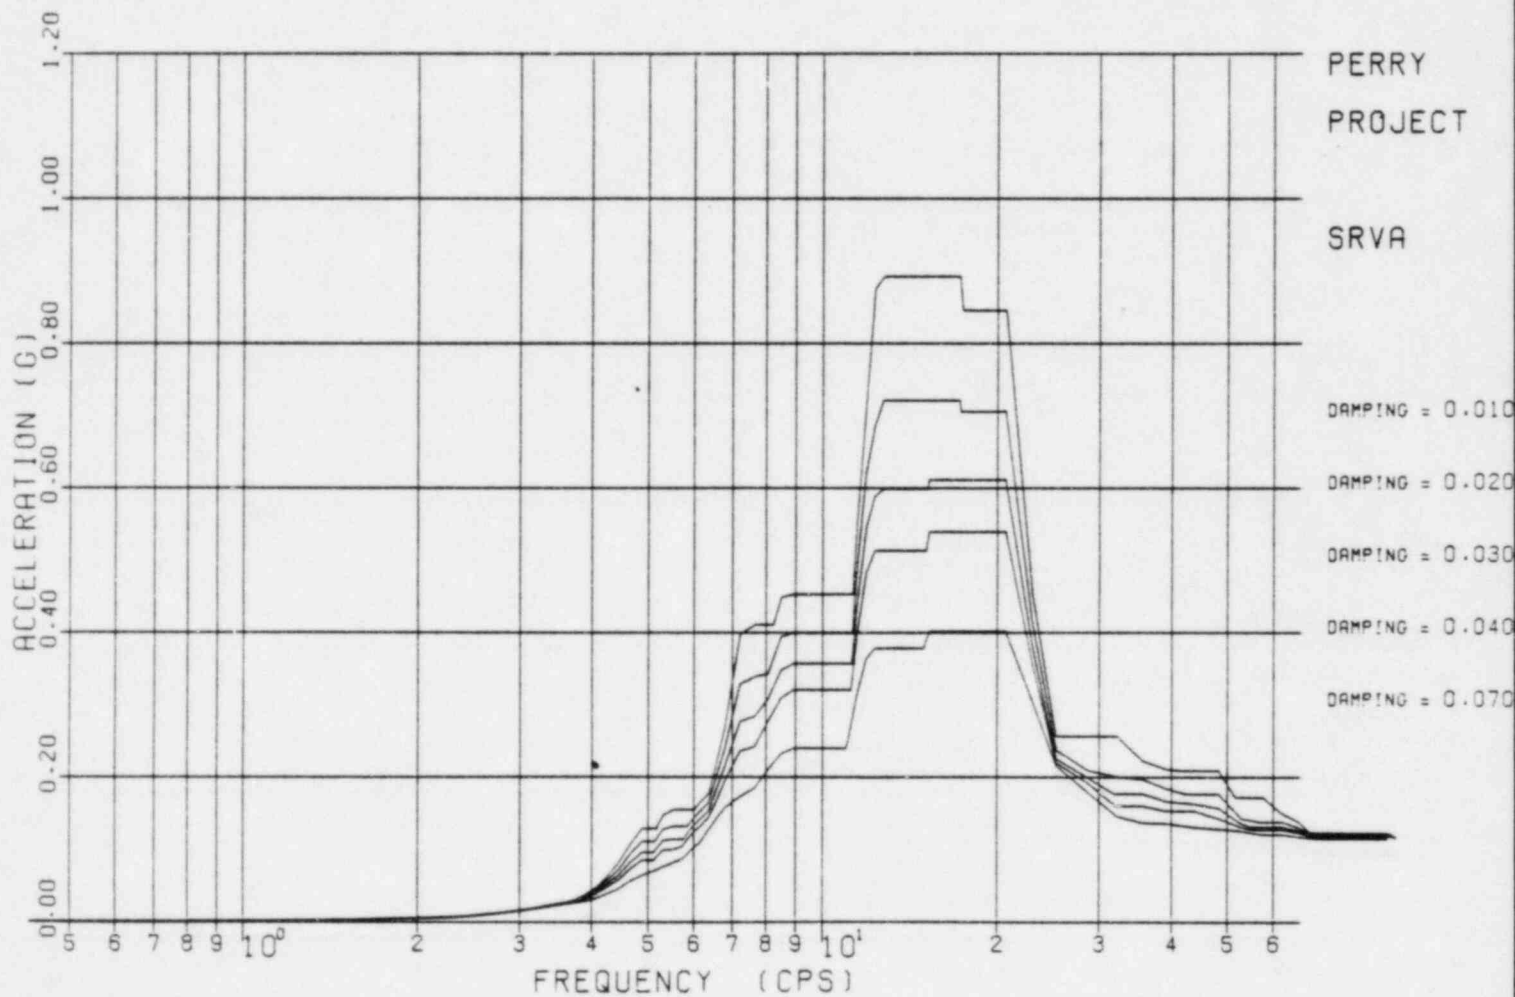

ENVELOPED SPECTRA FOR JOINT 155 IN DIRECTION 2
FOR LOAD CASES 19231, 19321, 19461

FIGURE 1b


VERTICAL RESPONSE SPECTRA AT
EL. 579'-5"
NO ANNULUS CONCRETE

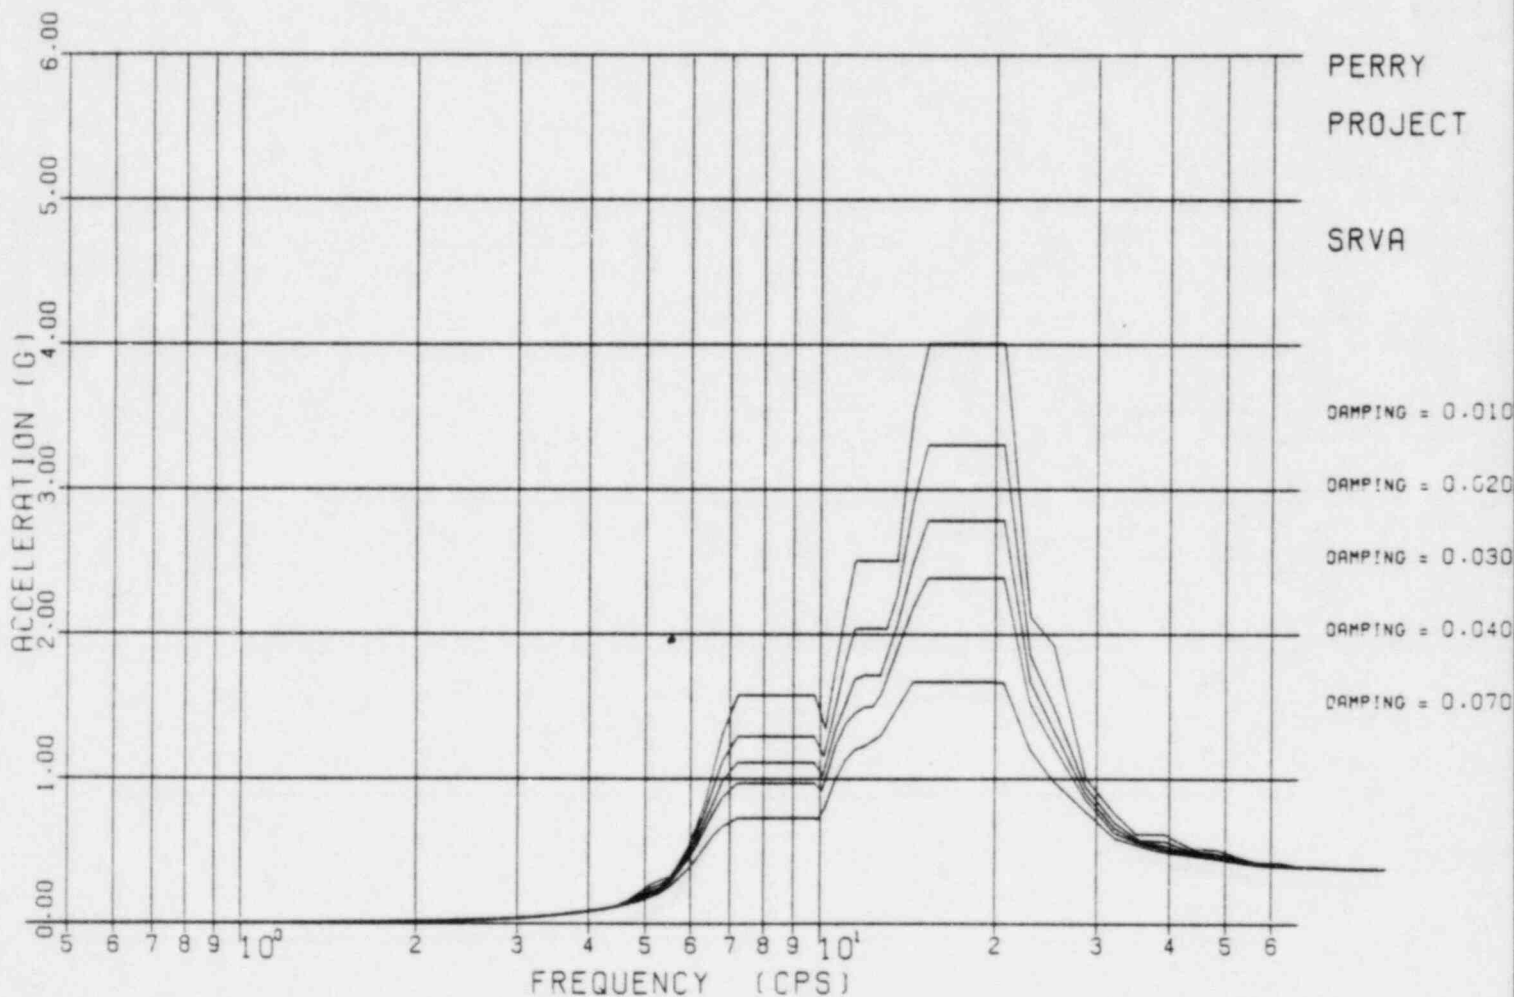

ENVELOPED SPECTRA FOR JOINT 155 IN DIRECTION 3
FOR LOAD CASES 19231, 19321, 19461

FIGURE 1c


TANGENTIAL RESPONSE SPECTRA AT
EL. 579'-5"
NO ANNULUS CONCRETE

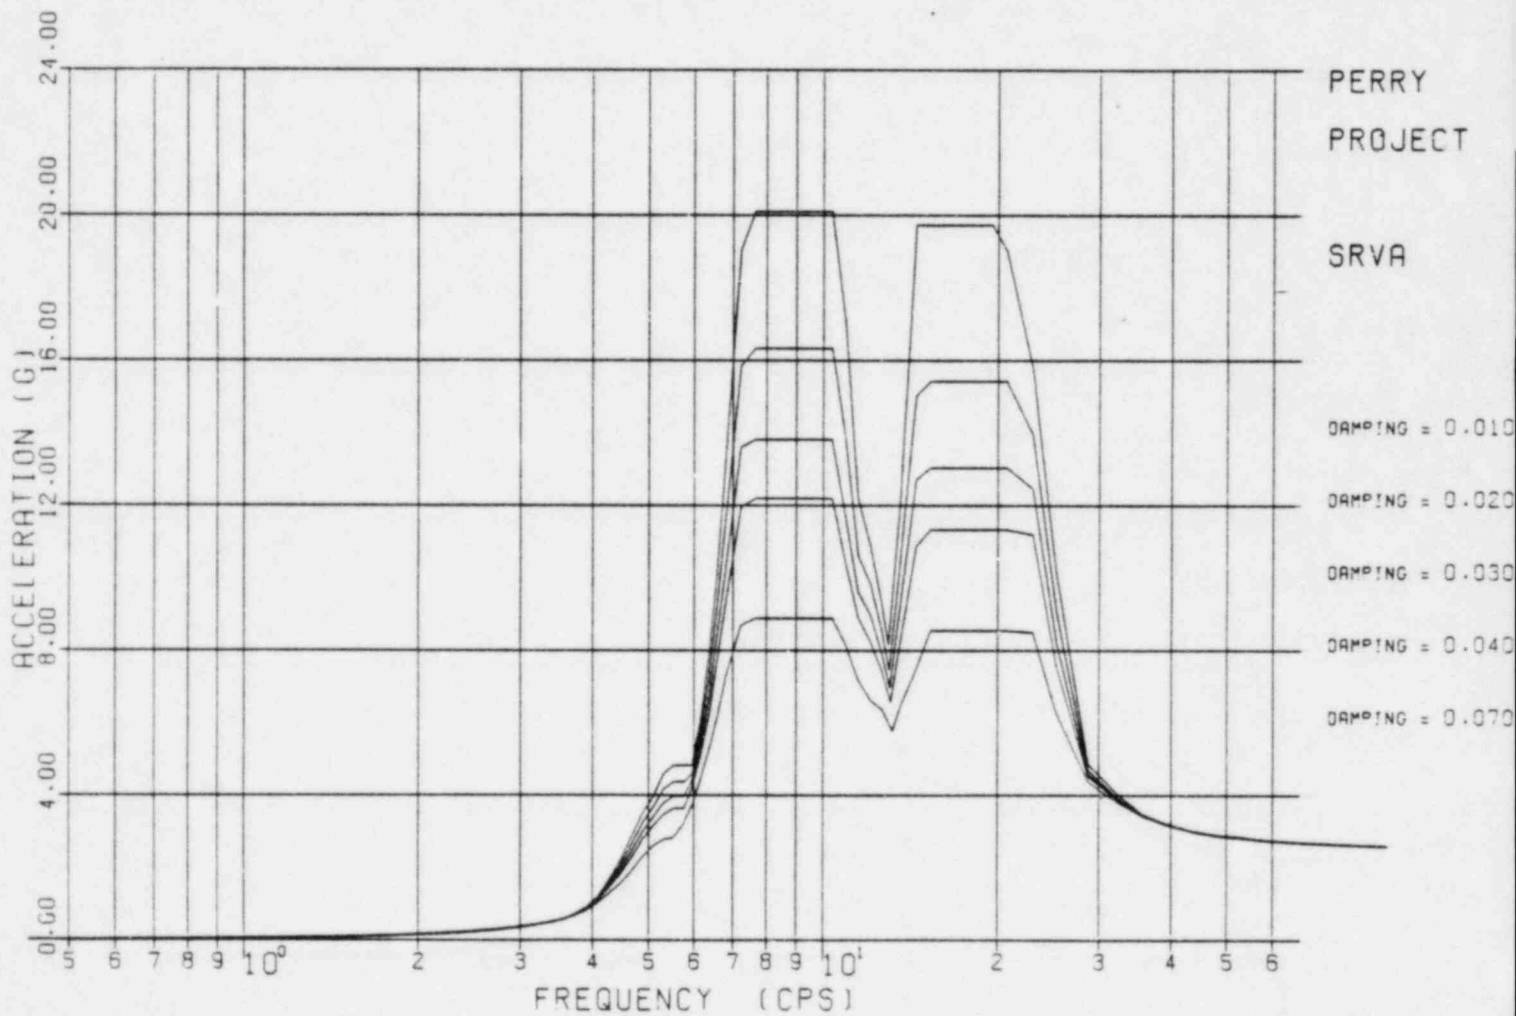

ENVELOPED SPECTRA FOR JOINT 272 IN DIRECTION 1
 FOR LOAD CASES 19231, 19321, 19461

FIGURE 2a


RADIAL RESPONSE SPECTRA AT
 EL. 664'-10"
 NO ANNULUS CONCRETE

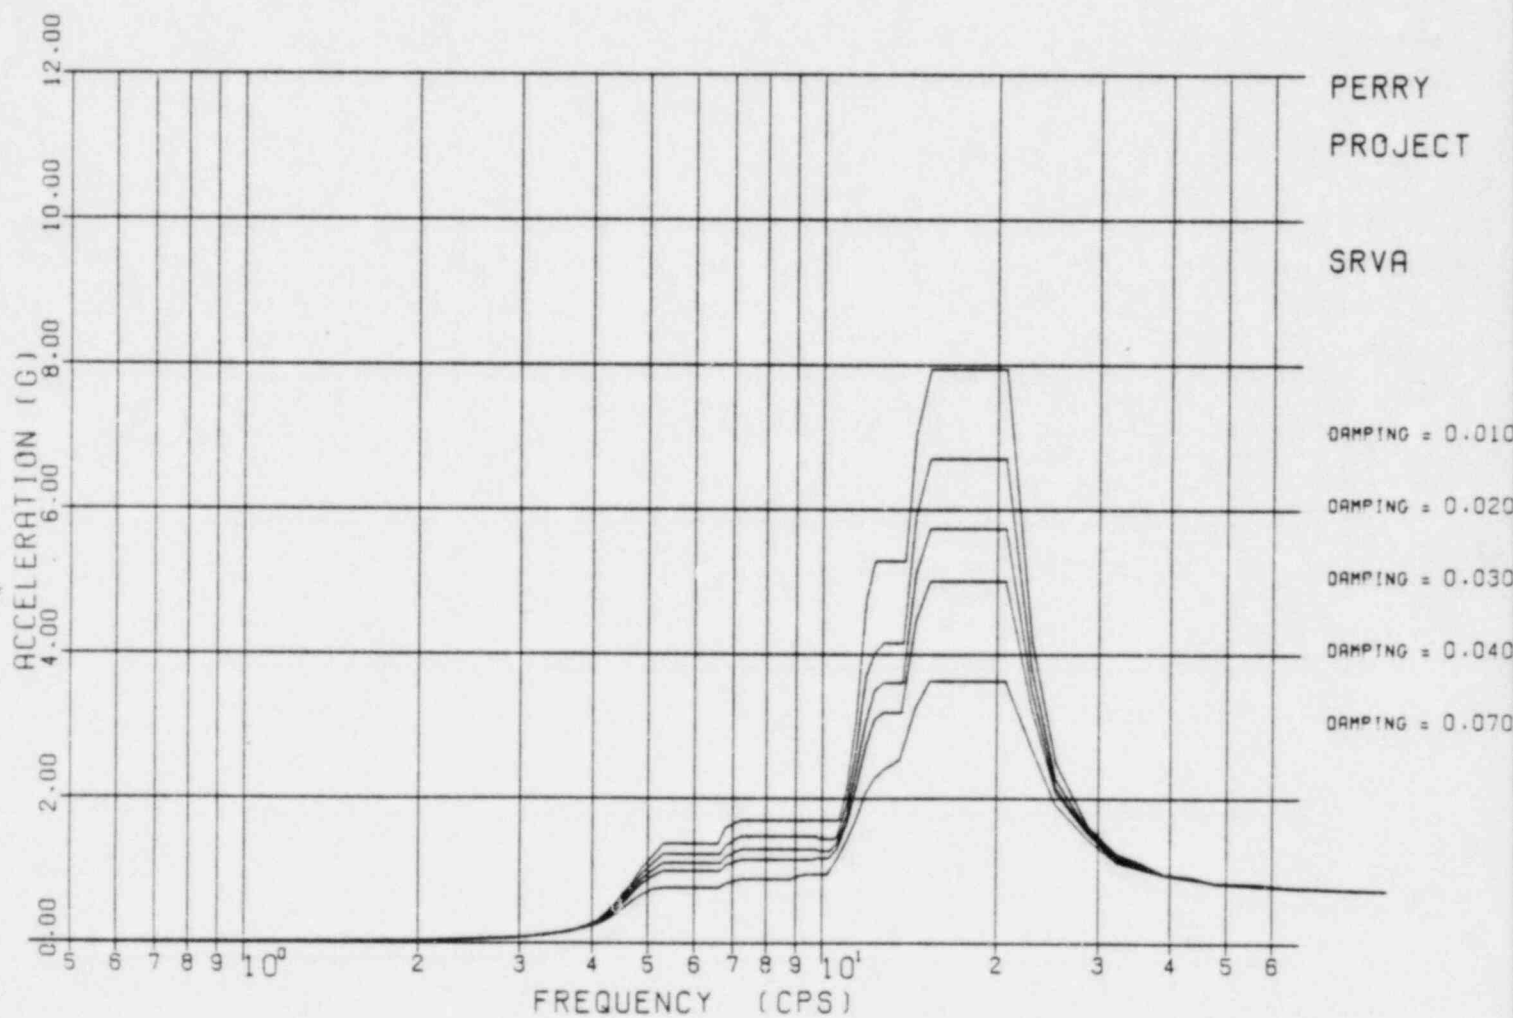

ENVELOPED SPECTRA FOR JOINT 272 IN DIRECTION 2
FOR LOAD CASES 19231, 19321, 19461

FIGURE 2b


VERTICAL RESPONSE SPECTRA AT
EL. 664'-10"
NO ANNULUS CONCRETE

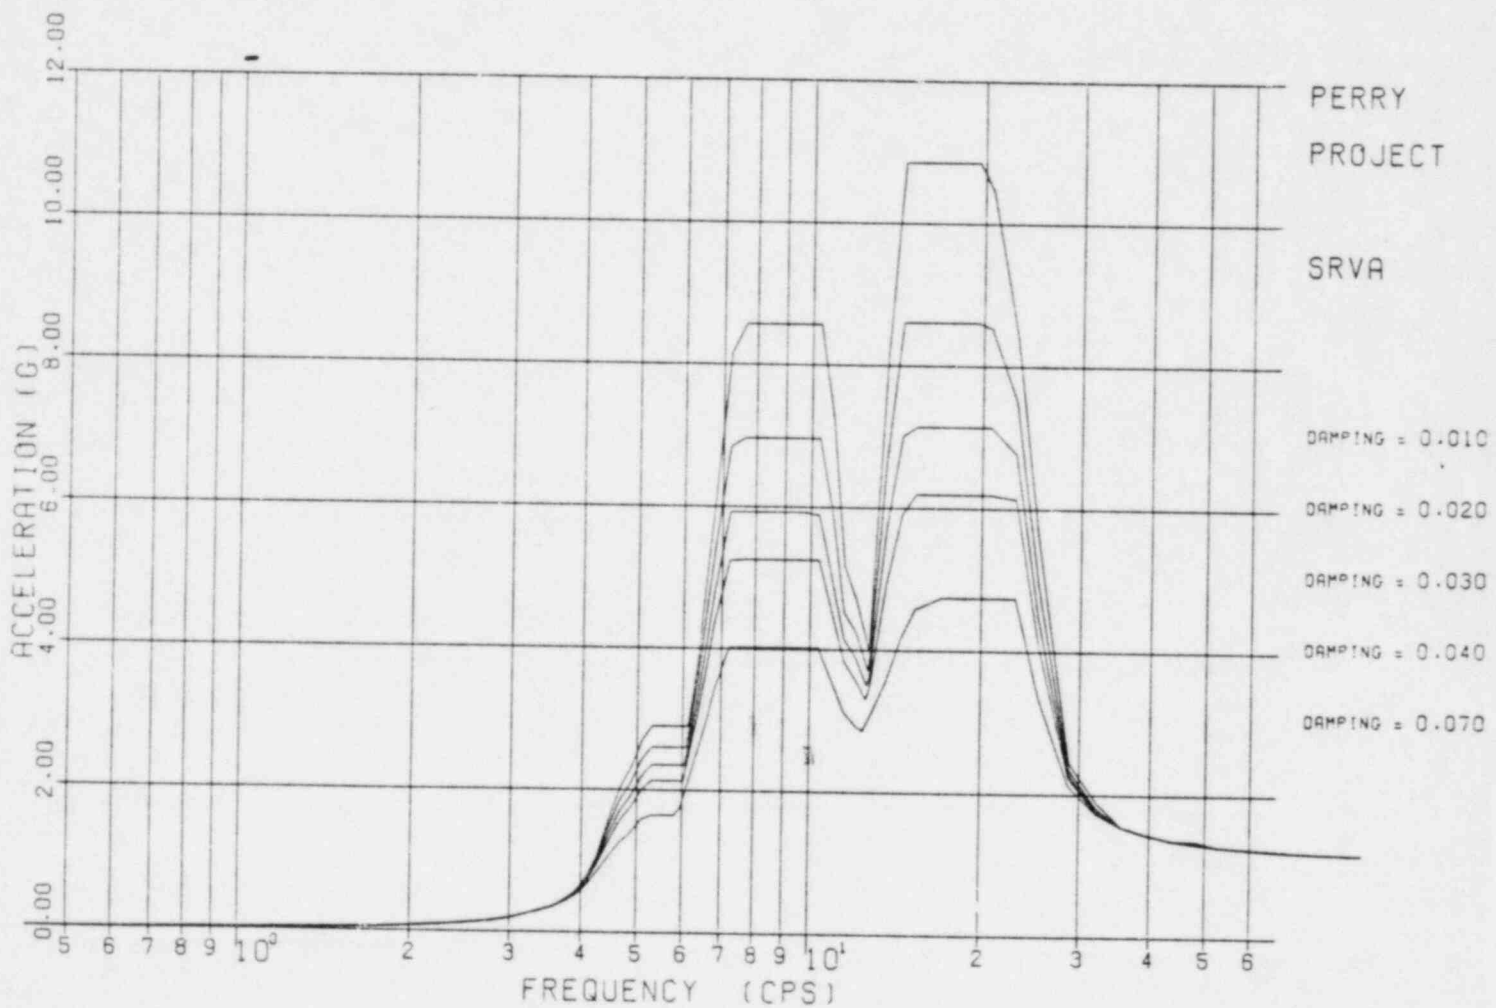

ENVELOPED SPECTRA FOR JOINT 272 IN DIRECTION 3
FOR LOAD CASES 19231, 19321, 19461

FIGURE 2c


TANGENTIAL RESPONSE SPECTRA AT
EL. 664'-10"
NO ANNULUS CONCRETE

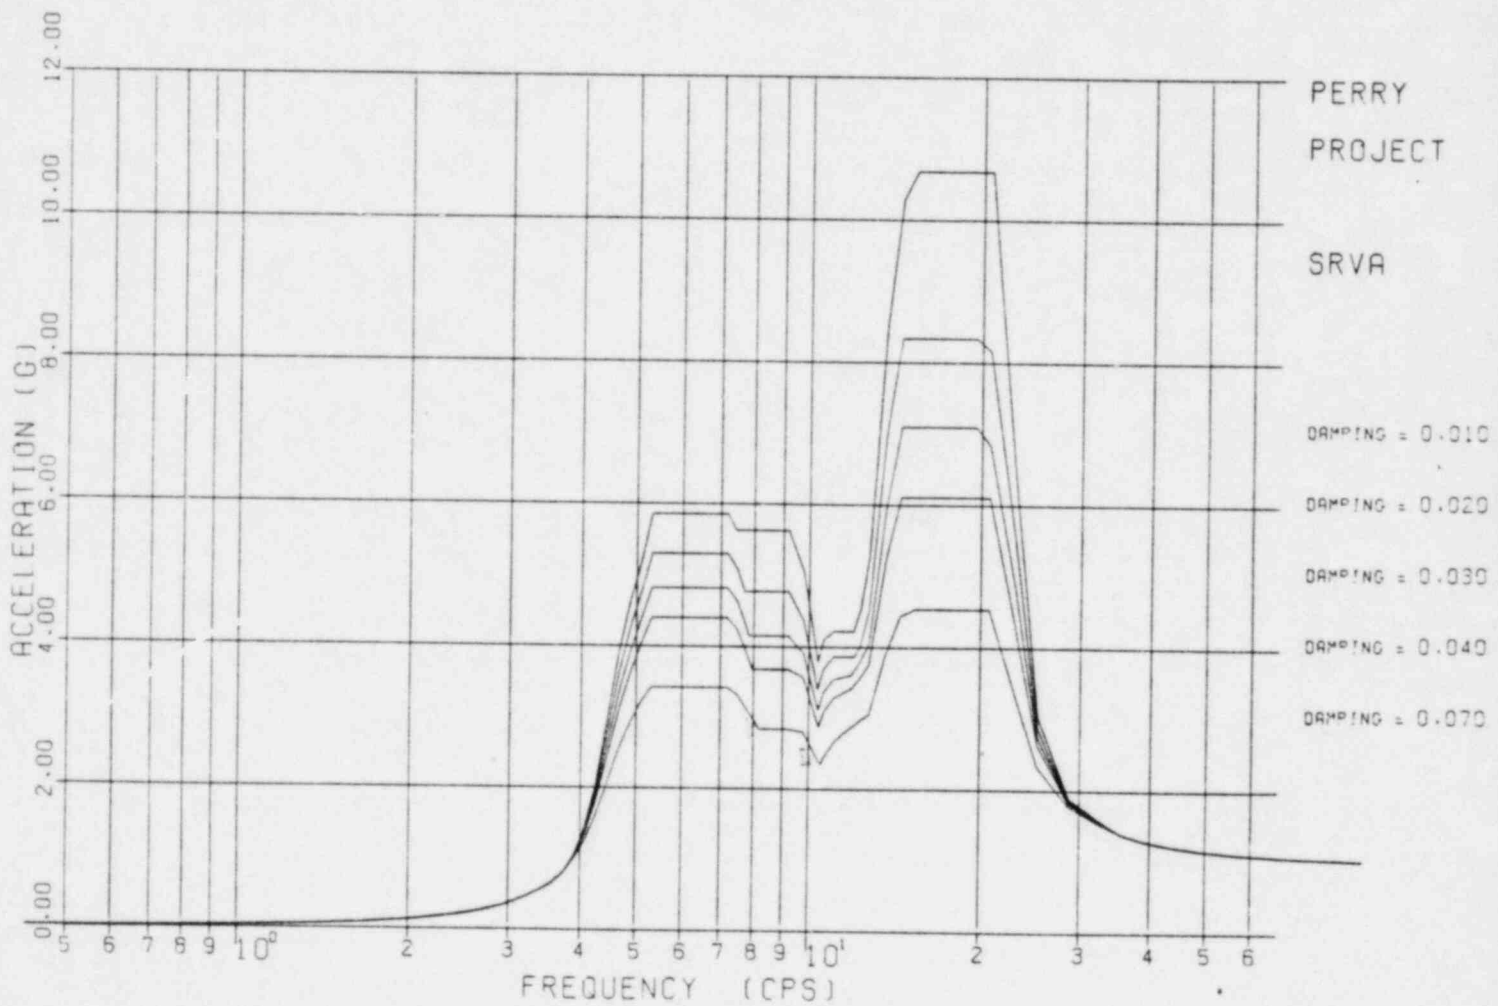

ENVELOPED SPECTRA FOR JOINT 311 IN DIRECTION 1
FOR LOAD CASES 19231, 19321, 19461

FIGURE 3a


RADIAL RESPONSE SPECTRA AT
EL. 749'-4"
NO ANNULUS CONCRETE

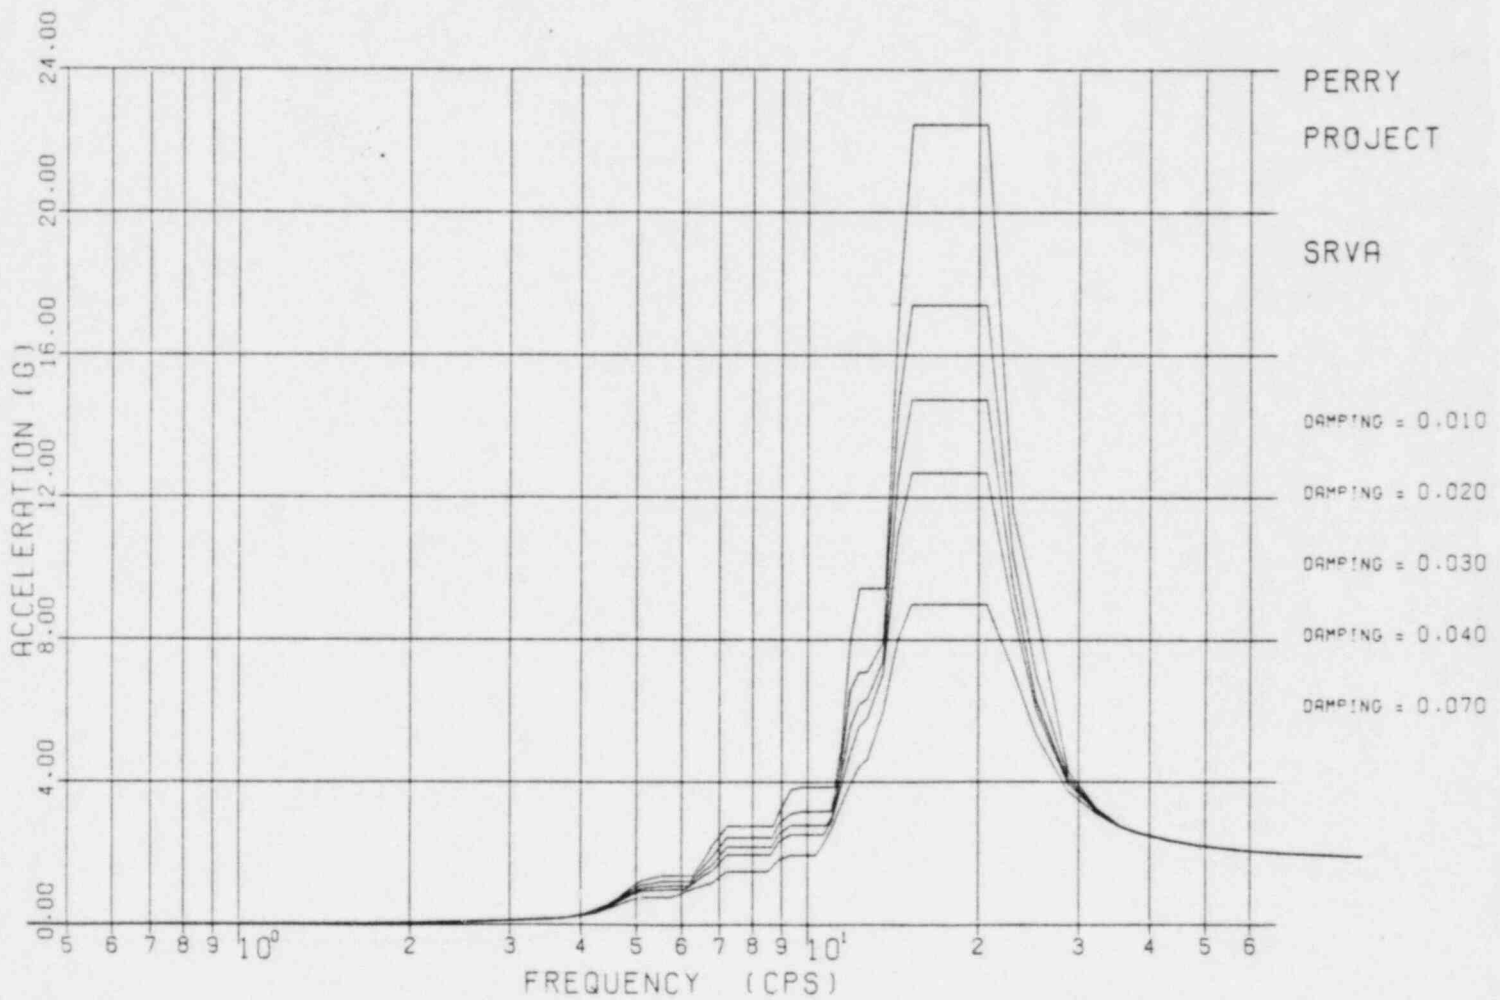

ENVELOPED SPECTRA FOR JOINT 311 IN DIRECTION 2
FOR LOAD CASES 19231, 19321, 19461

FIGURE 3b


VERTICAL RESPONSE SPECTRA AT
EL. 749'-4"
NO ANNULUS CONCRETE

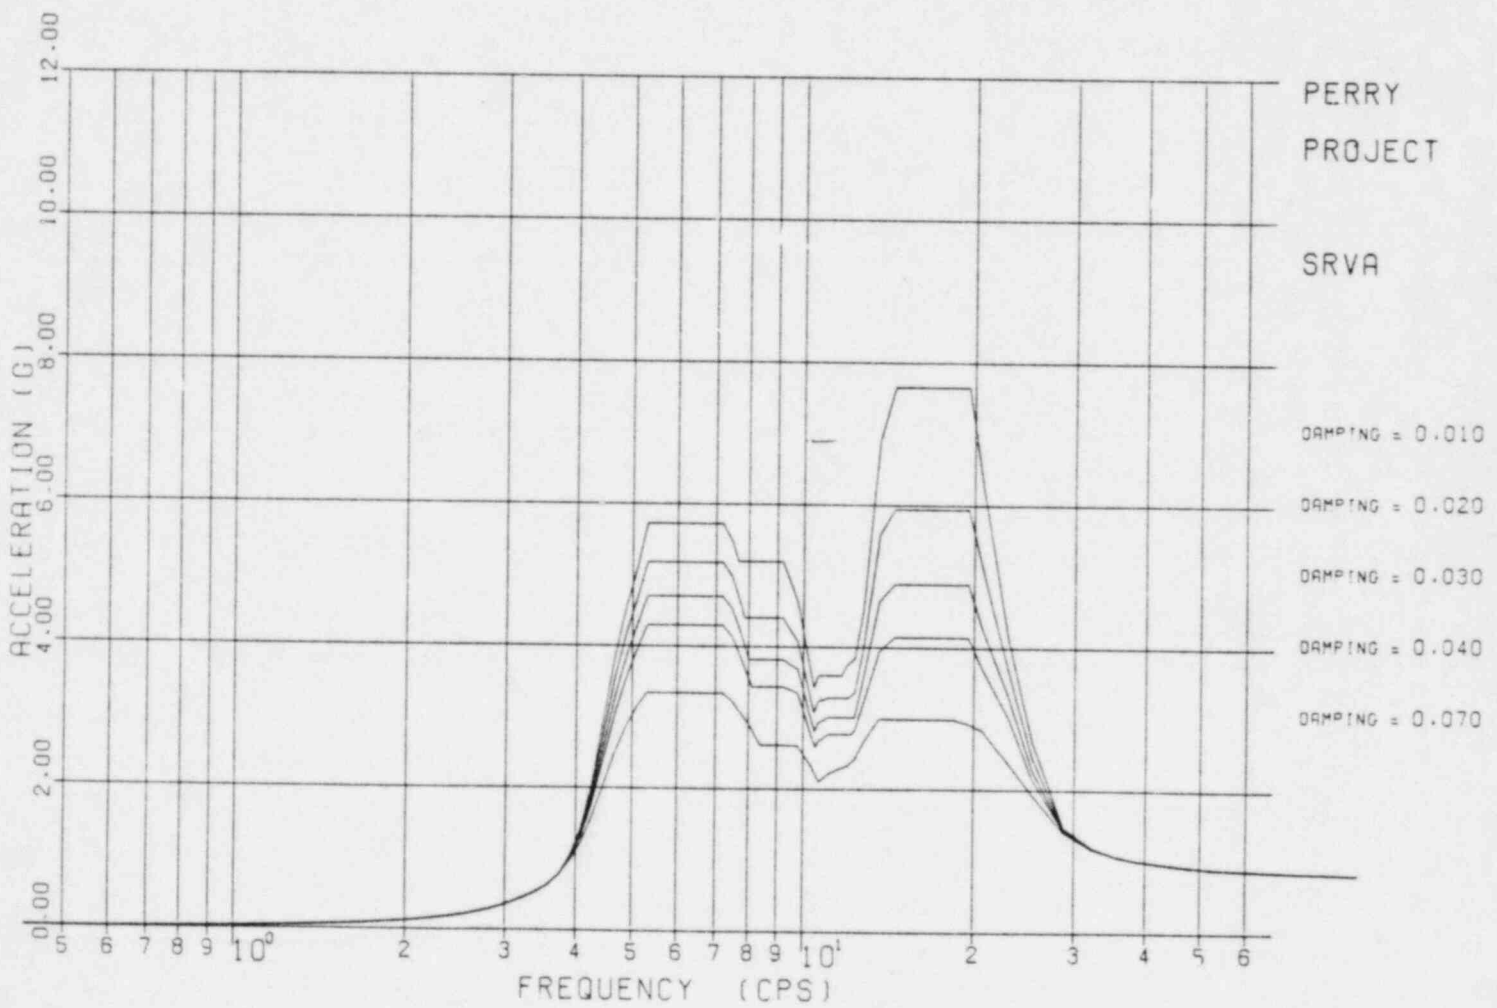

ENVELOPED SPECTRA FOR JOINT 311 IN DIRECTION 3
FOR LOAD CASES 19231, 19321, 19461

FIGURE 3c


TANGENTIAL RESPONSE SPECTRA AT
EL. 749'-4"
NO ANNULUS CONCRETE

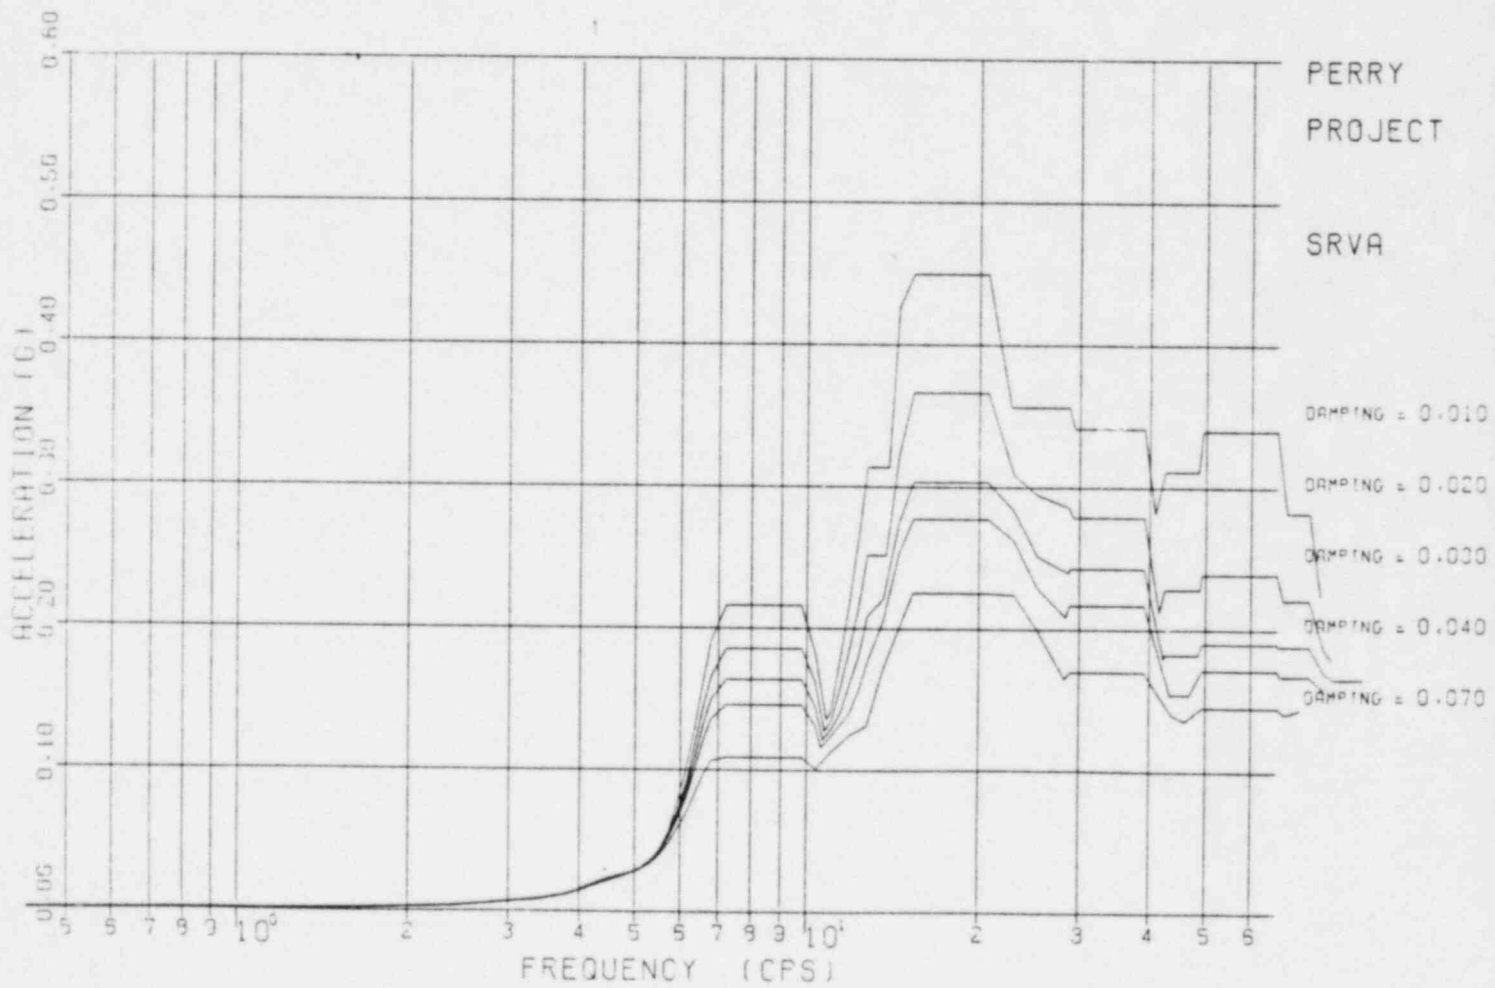

ENVELOPED SPECTRA FOR JOINT 155 IN DIRECTION 1
FOR LOAD CASES 22222

FIGURE 4a


RADIAL RESPONSE SPECTRA AT
EL. 579'-5"
ANNULUS CONCRETE

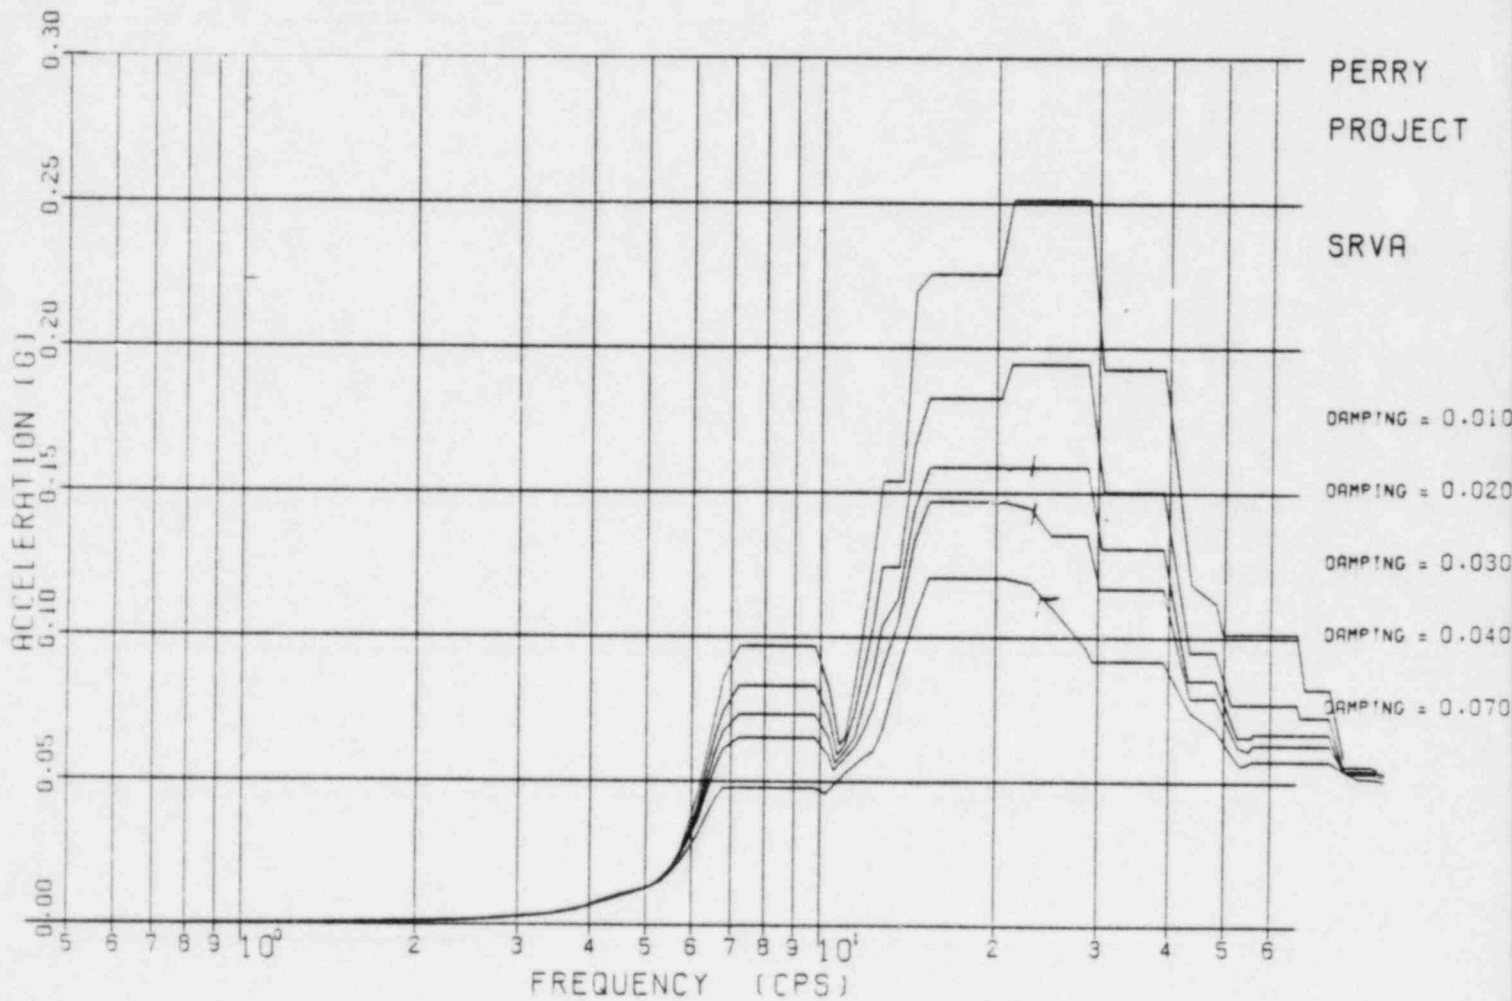

ENVELOPED SPECTRA FOR JOINT 155 IN DIRECTION 2
FOR LOAD CASES 22222

FIGURE 4b


VERTICAL RESPONSE SPECTRA AT
EL. 579'-5"
ANNULUS CONCRETE

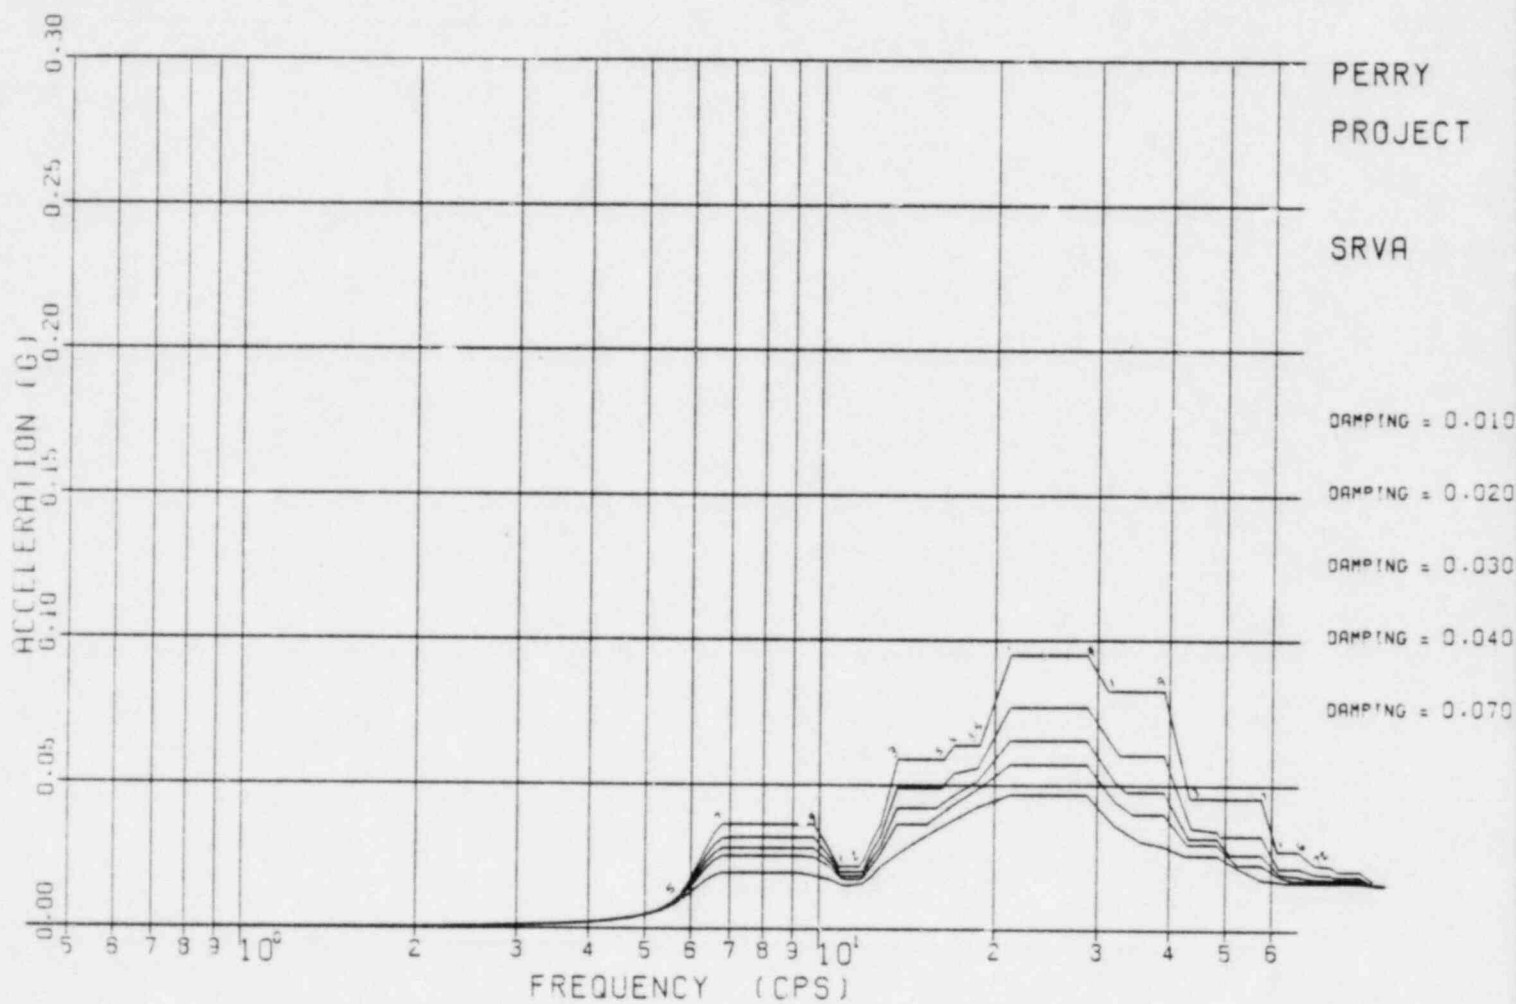

ENVELOPED SPECTRA FOR JOINT 155 IN DIRECTION 3
FOR LOAD CASES 22222

FIGURE 4c


TANGENTIAL RESPONSE SPECTRA AT
EL. 579'-5"
ANNULUS CONCRETE

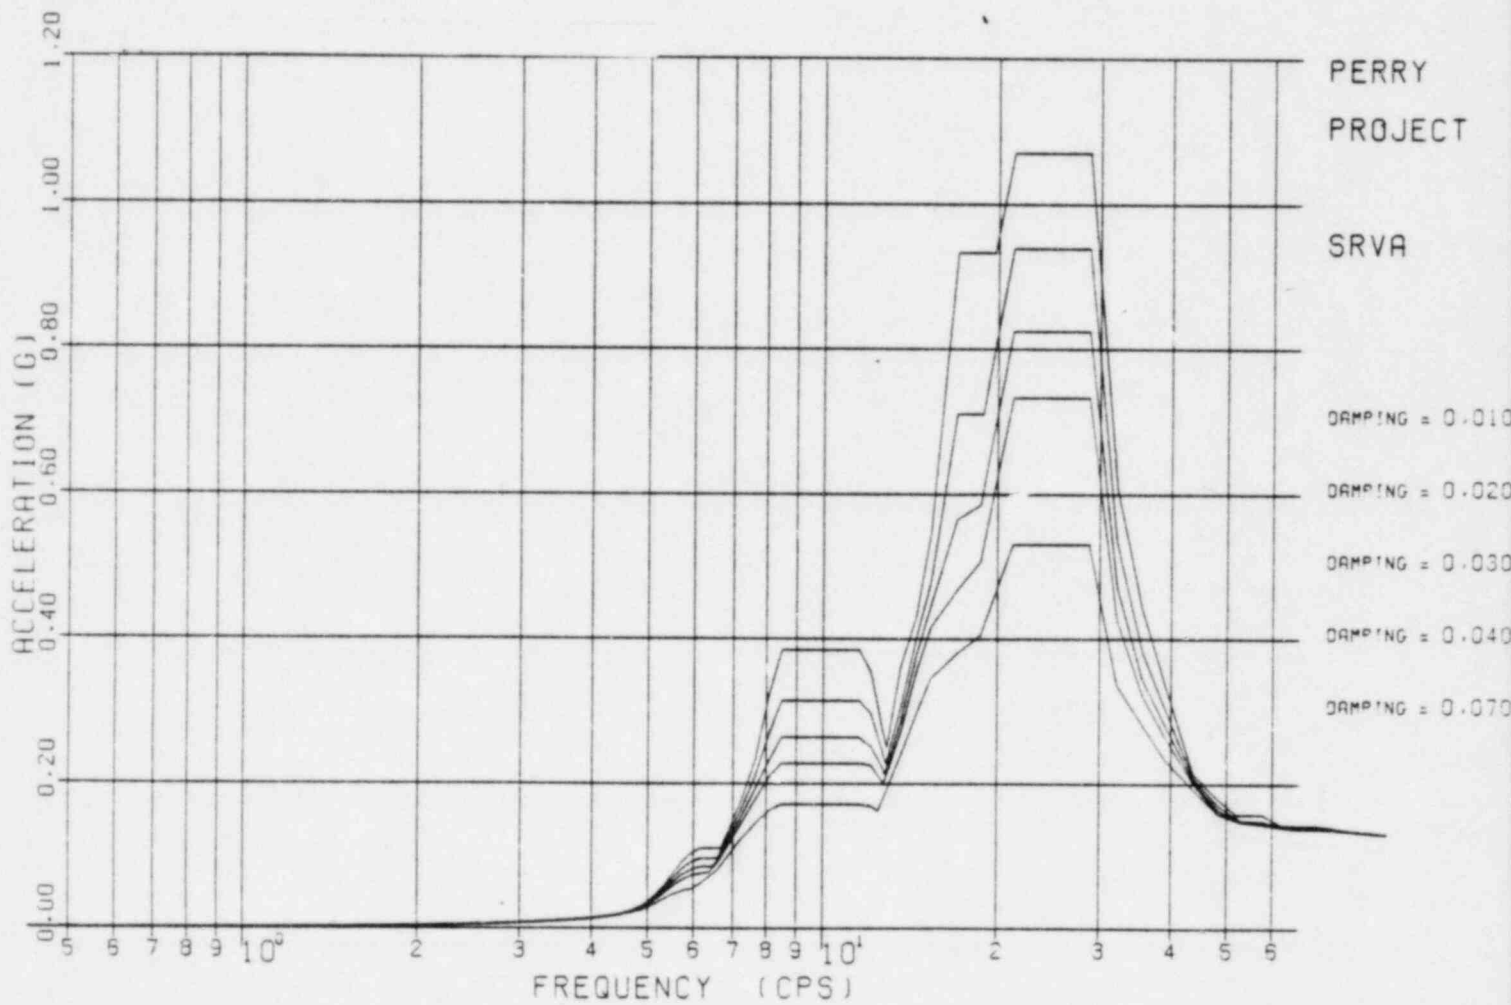

ENVELOPED SPECTRA FOR JOINT 272 IN DIRECTION 1
FOR LOAD CASES 22222

FIGURE 5a


RADIAL RESPONSE SPECTRA AT
EL. 664'-10"
ANNULUS CONCRETE

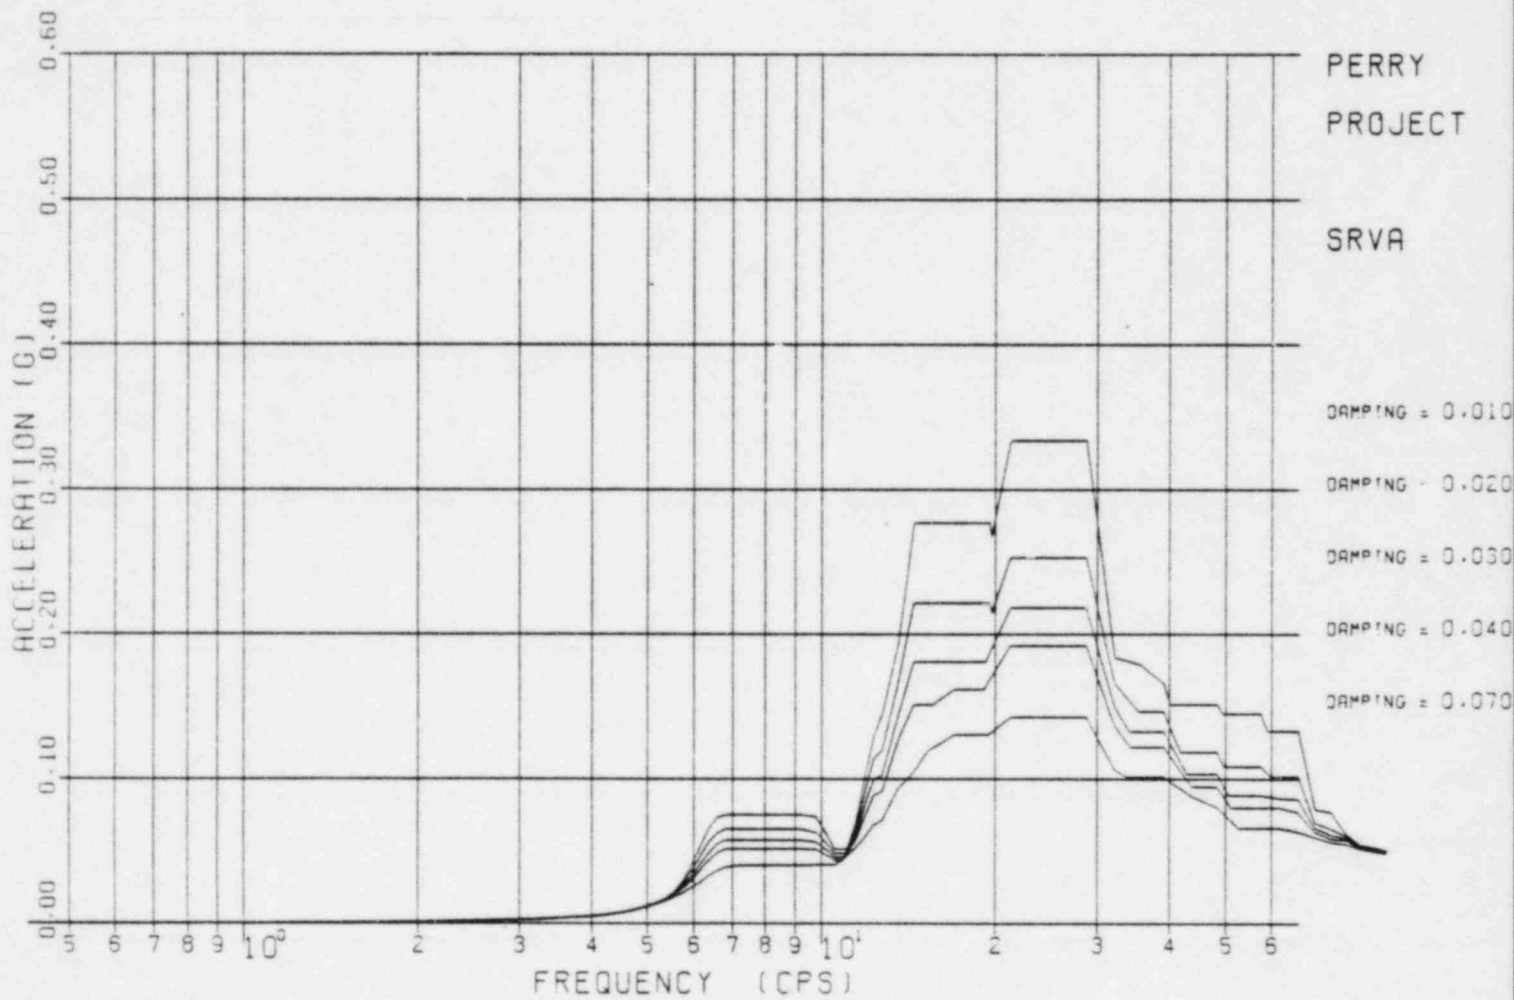

ENVELOPED SPECTRA FOR JOINT 272 IN DIRECTION 2
FOR LOAD CASES 22222

FIGURE 5b


VERTICAL RESPONSE SPECTRA AT
EL. 664'-10"
ANNULUS CONCRETE

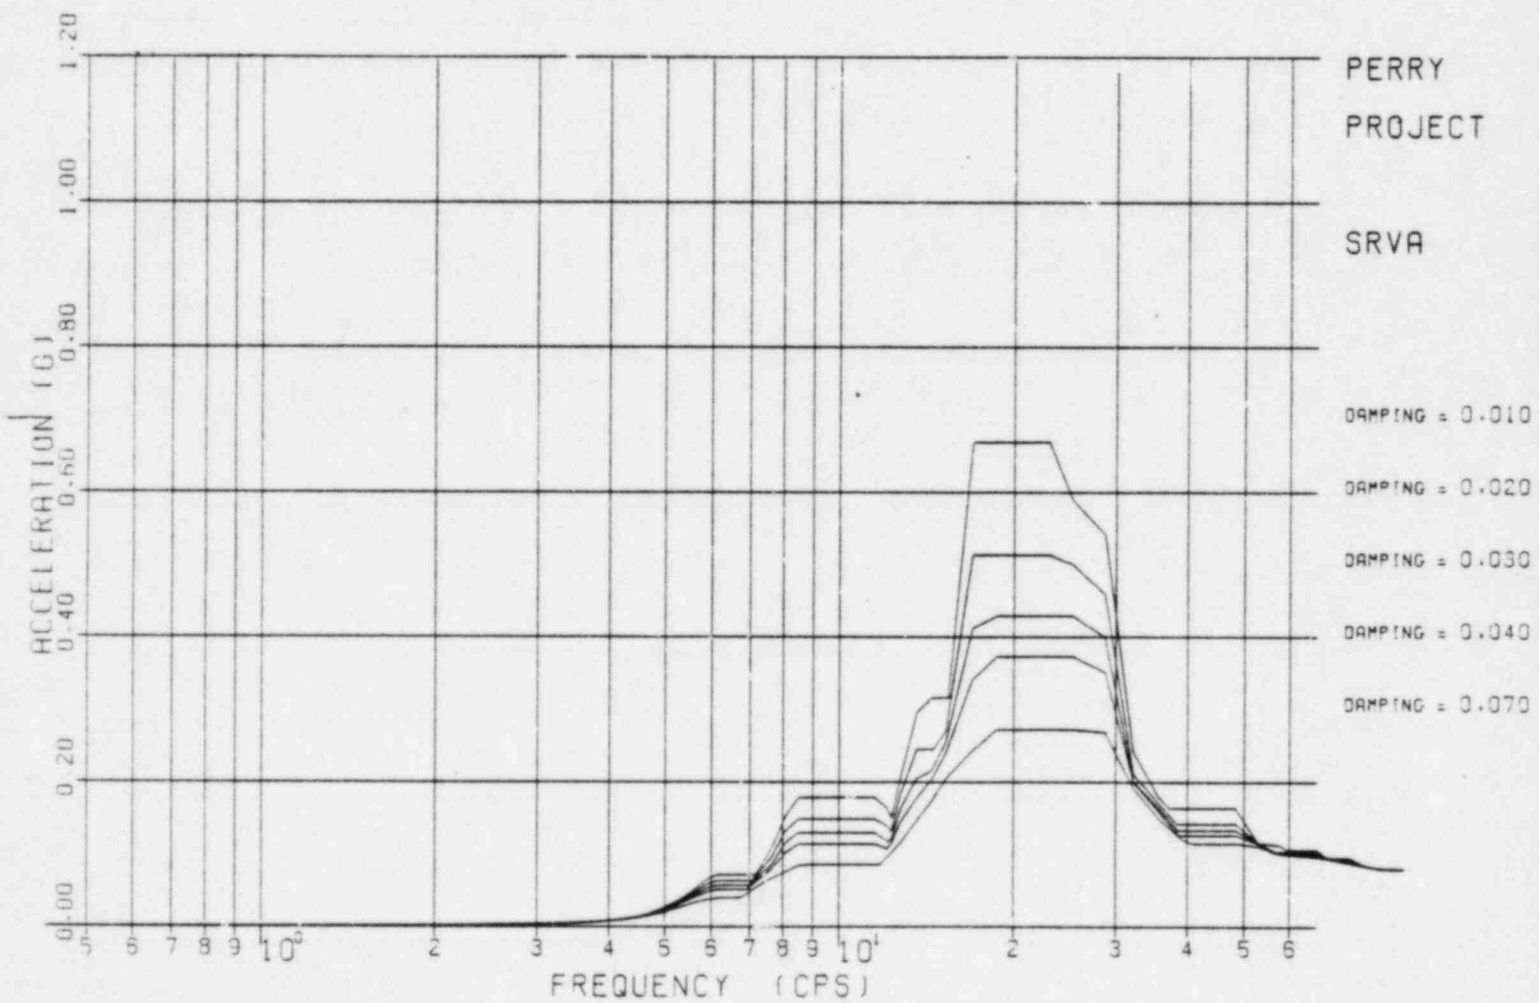

ENVELOPED SPECTRA FOR JOINT 272 IN DIRECTION 3
FOR LOAD CASES 22222

FIGURE 5c


TANGENTIAL RESPONSE SPECTRA AT
EL. 654'-10"
ANNULUS CONCRETE

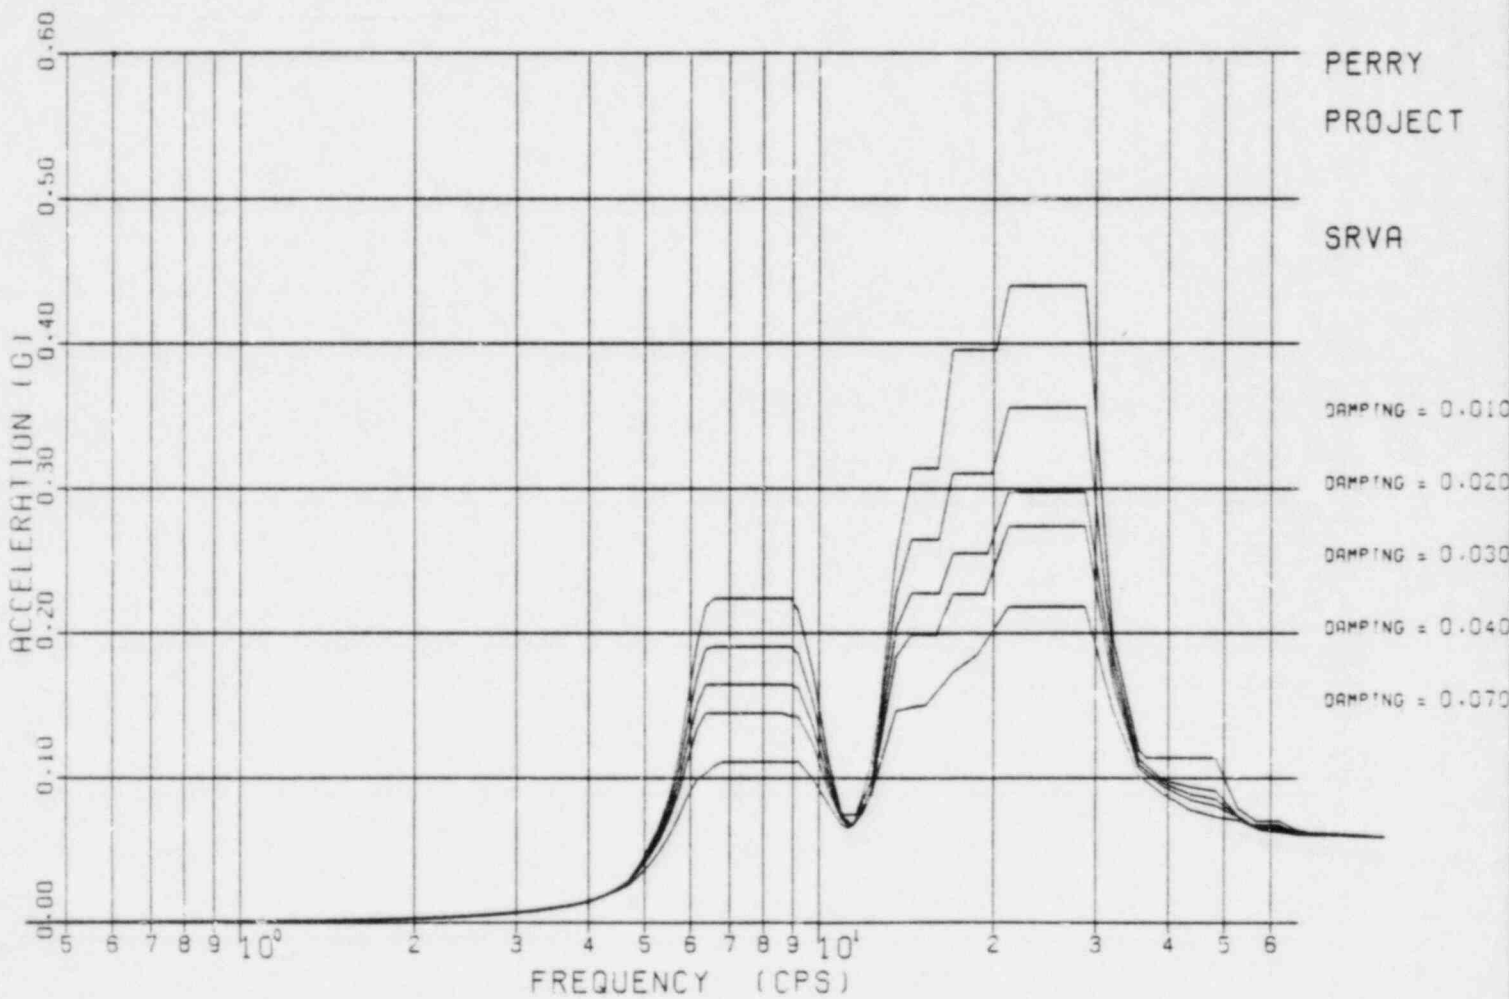

ENVELOPED SPECTRA FOR JOINT 311 IN DIRECTION 1
FOR LOAD CASES 22222

FIGURE 6a


RADIAL RESPONSE SPECTRA AT
EL. 749'-4"
ANNULUS CONCRETE

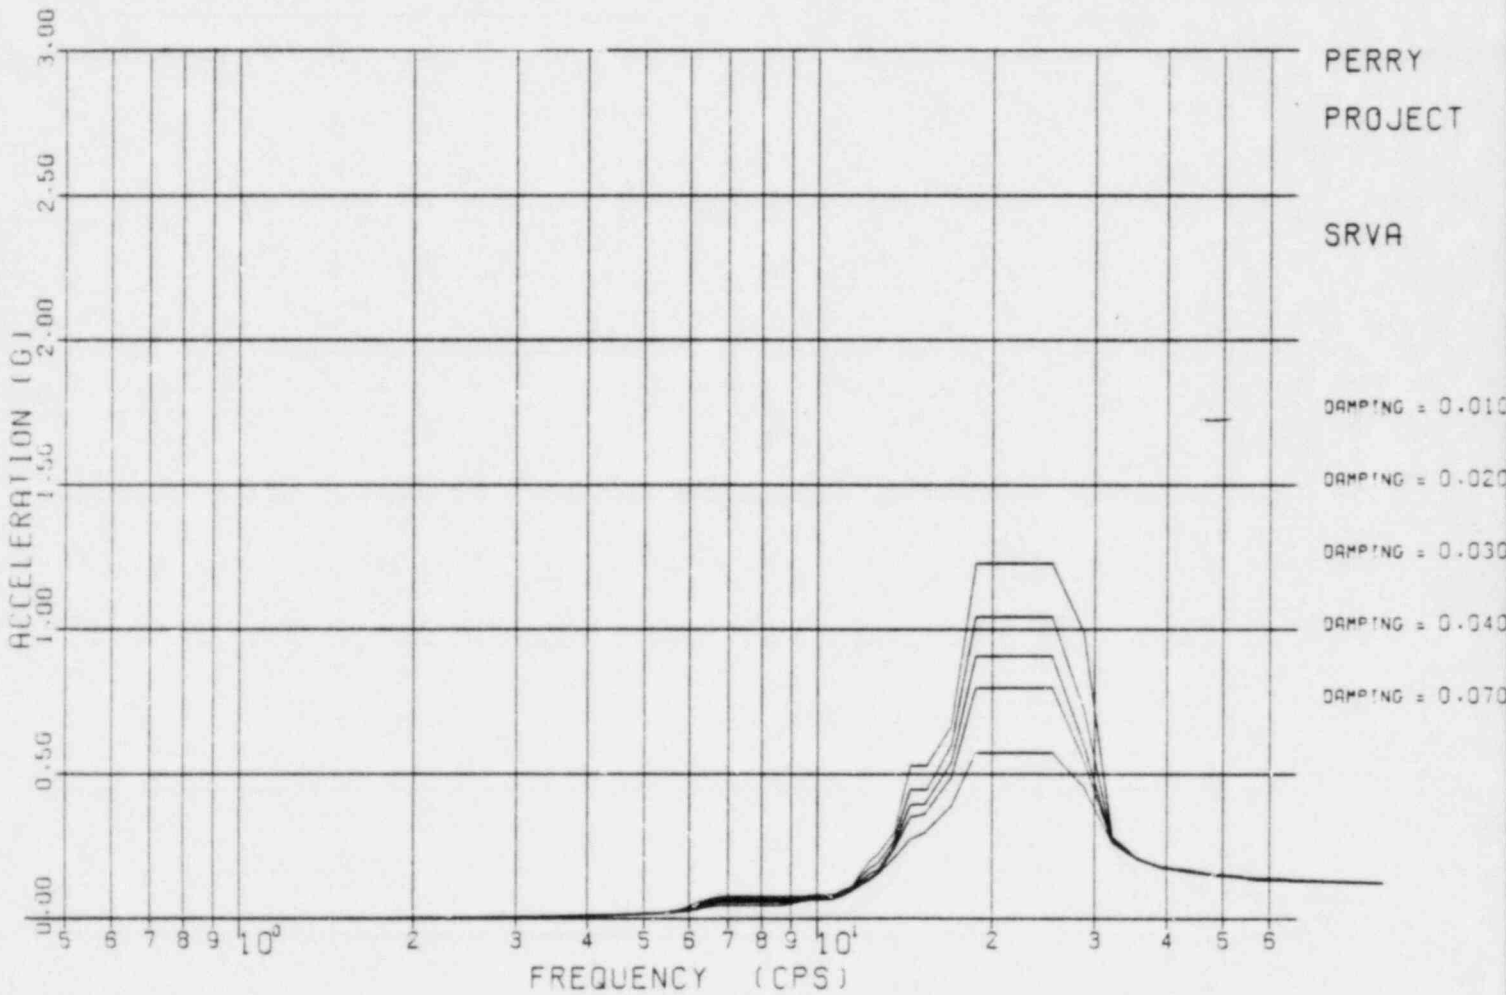

ENVELOPED SPECTRA FOR JOINT 311 IN DIRECTION 2
FOR LOAD CASES 22222

FIGURE 6b

VERTICAL RESPONSE SPECTRA AT
EL. 749'-4"
ANNULUS CONCRETE

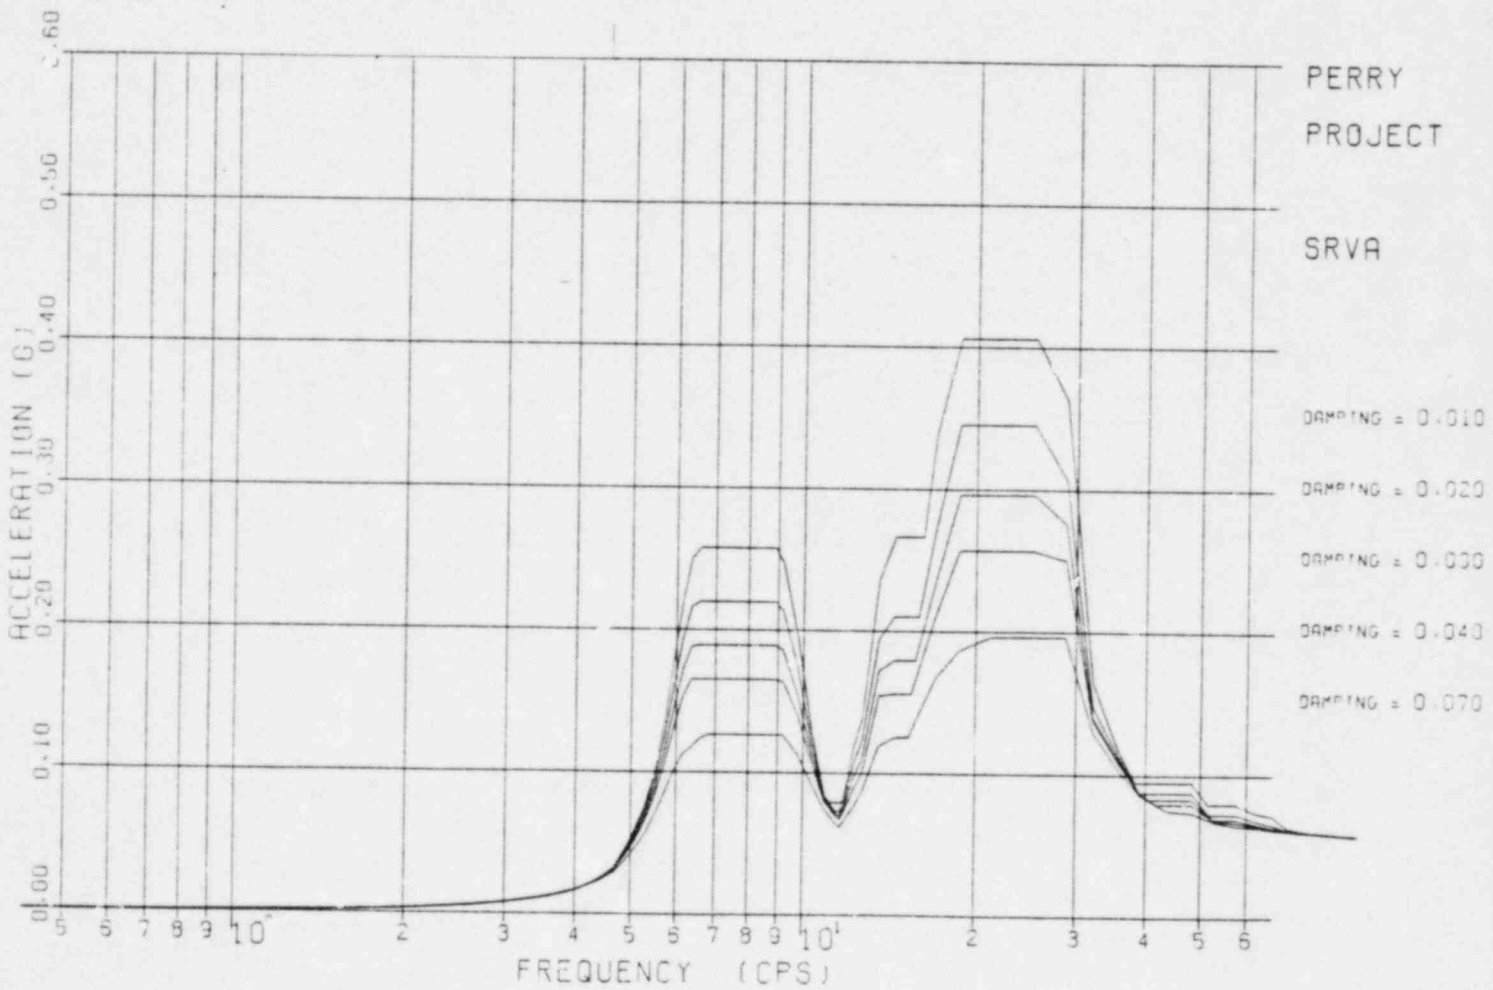

ENVELOPED SPECTRA FOR JOINT 311 IN DIRECTION 3
FOR LOAD CASES 22222

FIGURE 6c

TANGENTIAL RESPONSE SPECTRA AT
EL. 749'-4"
ANNULUS CONCRETE