

OYSTER CREEK



NUCLEAR GENERATING STATION

JCP&L GPU

Jersey Central Power & Light Company is a Member of the General Public Utilities System


(609) 693-6000 P.O. BOX 388 • FORKED RIVER • NEW JERSEY • 08731

November 24, 1981

Director, Nuclear Reactor Regulation  
Nuclear Regulatory Commission  
Washington, D. C. 20555

Dear Sir:

Subject: Oyster Creek Nuclear Generating Station  
Docket No. 50-219  
Technical Specification Change Request No. 101

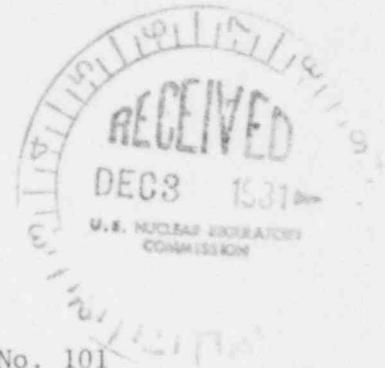

In accordance with 10 CFR 50.59 and 10 CFR 50.90 Jersey Central Power & Light Company, owner and operator of the Oyster Creek Nuclear Generating Station, Provisional Operating License No. DPR-16, requests changes to Appendix A of that license.

The subject Technical Specification Change Request involves Section 3.13 and the corresponding basis. This subject change request revises the requirements for the accident monitoring instrumentation.

The Technical Specification Change Request has been reviewed by the Plant Operations Review Committee and an Independent Safety Review Group in accordance with Section 6.5 of the Oyster Creek Technical Specifications.

We have determined that this submittal is Class III per 10 CFR 170.22 and a check for \$4,000.00 pursuant to that section will follow this submittal under a separate letter.

Very truly yours,

Shepard Bartnoff  
President  
Jersey Central Power & Light Company

lr

A001  
5  
1/1

8112040614 811124  
PDR ADOCK 05000219  
P PDR

JERSEY CENTRAL POWER & LIGHT COMPANY  
OYSTER CREEK NUCLEAR GENERATING STATION

PROVISIONAL OPERATING  
LICENSE NO. DPR-16

Technical Specification  
Change Request No. 101  
Docket No. 50-219

Applicant submits, by this Technical Specification Change Request No. 101 to the Oyster Creek Nuclear Generating Station Technical Specifications, a change to Specification 3.13 and basis.

By:

Shepard Bartney  
President

Jersey Central Power & Light Company

Sworn and subscribed to before me this 24th day of November 1981.

Phyllis A. Kabis

PHYLLIS A. KABIS  
NOTARY PUBLIC OF NEW JERSEY  
My Commission Expires Aug. 16, 1984


UNITED STATES OF AMERICA  
NUCLEAR REGULATORY COMMISSION

IN THE MATTER )  
 ) DOCKET NUMBER 50-219  
JERSEY CENTRAL POWER & LIGHT COMPANY )

CERTIFICATION OF SERVICE


This is to certify that a copy of Technical Specification Change Request No. 101 for the Oyster Creek Nuclear Generating Station Technical Specification, filed with the U.S. Nuclear Regulatory Commission on November 24, 1981 has this 24th day of November, been served on the Mayor of Lacey Township, Ocean County, New Jersey by deposit in the United States mail addressed as follows:

The Honorable Jorge A. Rod  
Mayor of Lacey Township  
818 W Lacey Road  
Forked River, NJ 08731

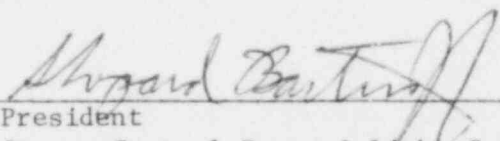By:   
\_\_\_\_\_  
President  
Jersey Central Power & Light Company

DATED: November 24, 1981

OYSTER CREEK



NUCLEAR GENERATING STATION



(609) 693-6000 P O BOX 388 • FORKED RIVER • NEW JERSEY • 08731

November 24, 1981

The Honorable Jorge A. Rod  
Mayor of Lacey Township  
818 W Lacey Road  
Forked River, NJ 08731

Dear Mayor Rod:

Enclosed herewith is one copy of Technical Specification  
Change Request No. 101 for the Oyster Creek Nuclear Generating  
Station Technical Specifications.

These documents were filed with the U. S. Nuclear  
Regulatory Commission on November 24, 1981.

Very truly yours,

A handwritten signature in cursive script that reads 'Shepard Bartnoff'.

Shepard Bartnoff  
President  
Jersey Central Power & Light Company

dls  
Enclosure

JERSEY CENTRAL POWER & LIGHT COMPANY  
OYSTER CREEK NUCLEAR GENERATING STATION  
(Docket No. 50-219)  
Provisional Operating License DPR-16

Applicant hereby requests the Commission to change Appendix A of the above captioned license as follows:

1. Section to be changed:

- a. Section 3.13 and basis

2. Extent of changes:

- a. Section 3.13 and basis

This change distinguishes between the requirements for relief valve position indicators and safety valves position indicators. The justification for this separation is contained in the revised basis.

3. Change requested:

The requested change is on the attached revised Technical Specification pages 3.13-1 and 3.13-2.

4. Discussion:

Section 3.13 cites the requirements for the Accident Monitoring Instrumentation. The purpose of this change is to separate the requirements for the relief valve position indicators from the safety valve position indicators.