


SOURCE

CONDITION

CONTROL ACTION

1  
2  
3  
4  
5  
6  
7  
8  
9  
10  
11  
12

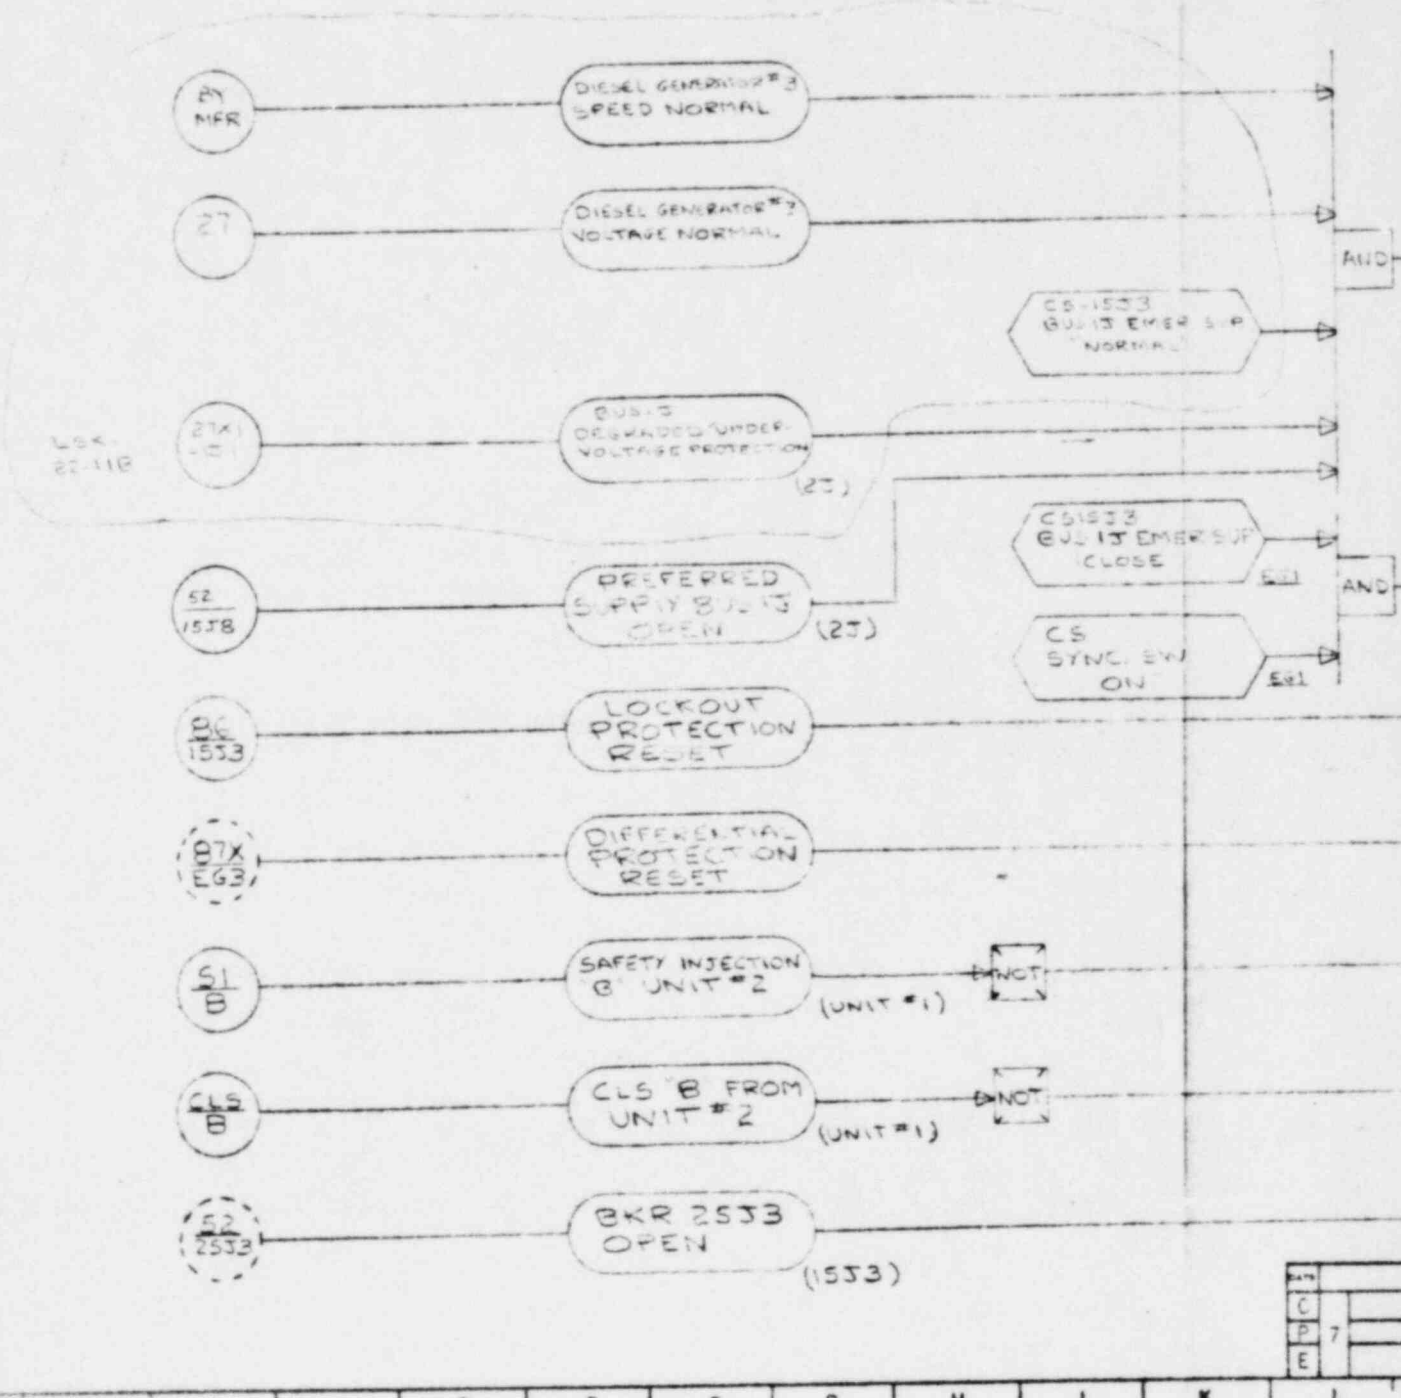

DATE	
C	
P	7
E	

POOR ORIGINAL


810528, 310

RESULTANT

MONITOR

NOTES

- 1 DIAGRAM SHOWS APPLICATION OF EMERG GEN #3 TO UNIT #1 CKT 1533
- 2 APPLICATION OF EMERG GEN #3 TO UNIT #3 CKT 2533 SIMILAR EXCEPT CLS + SI CONDITIONS WILL BE FOR UNIT #1
- 3 PANEL EG 2 ALSO HAS CS 1533

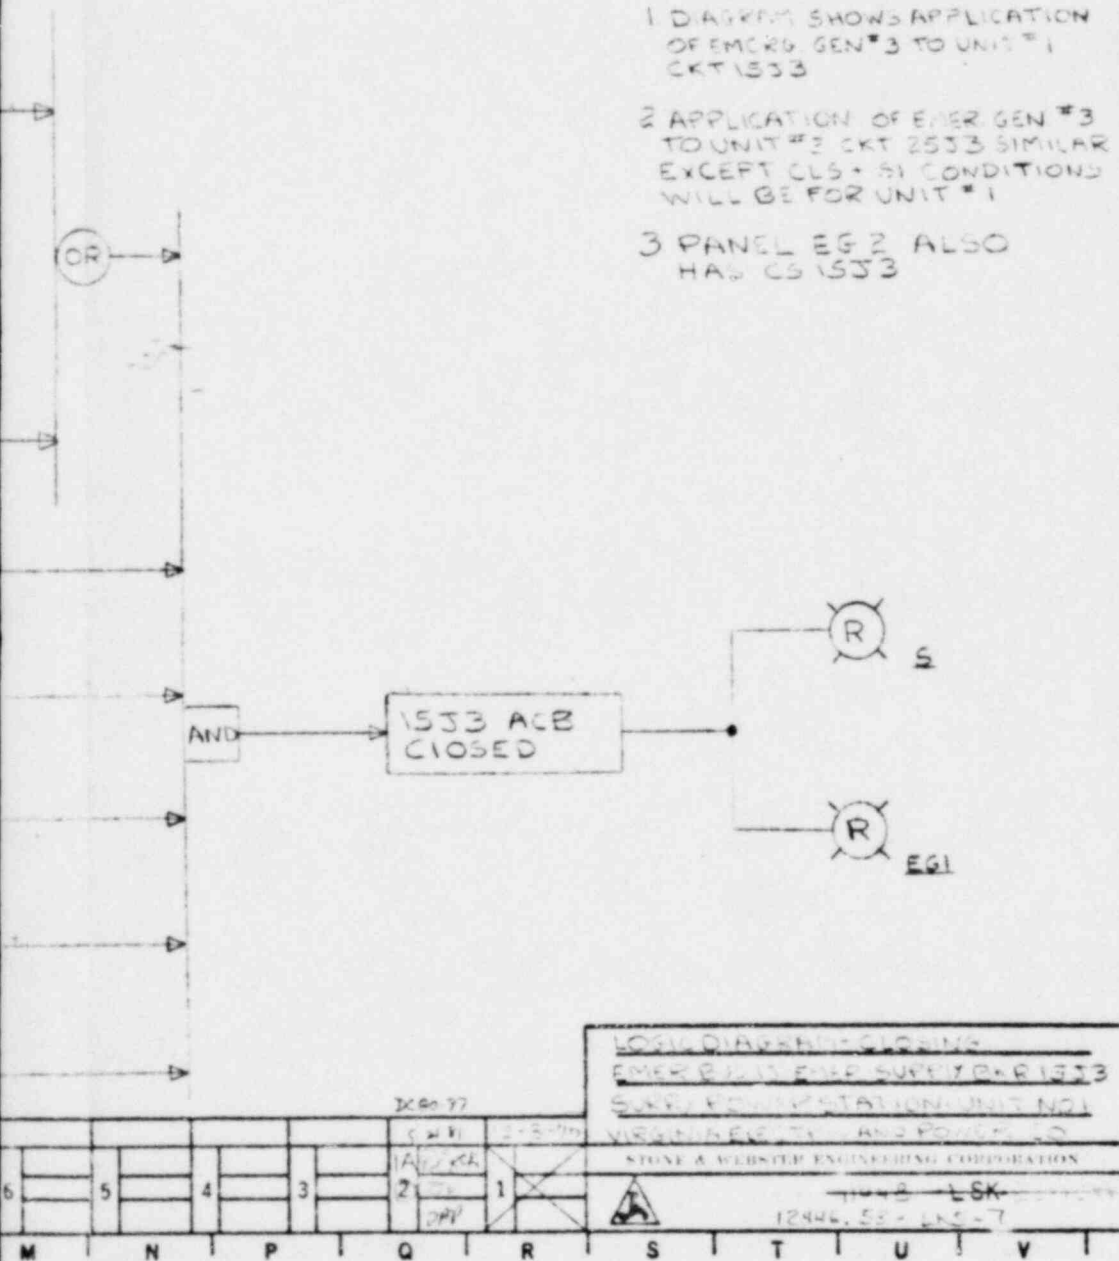

POOR ORIGINAL