

50-361
50-362

EVALUATION OF PRESSURIZED THERMAL SHOCK EFFECTS
DUE TO
SMALL BREAK LOCA'S WITH LOSS OF FEEDWATER
FOR
THE SAN ONOFRE 2 & 3 REACTOR VESSELS

Prepared for
THE SOUTHERN CALIFORNIA EDISON COMPANY

NUCLEAR POWER SYSTEMS DIVISION
DECEMBER, 1981

8201130 483

LEGAL NOTICE

THIS REPORT WAS PREPARED AS AN ACCOUNT OF WORK SPONSORED BY COMBUSTION ENGINEERING, INC. NEITHER COMBUSTION ENGINEERING NOR ANY PERSON ACTING ON ITS BEHALF:

A. MAKES ANY WARRANTY OR REPRESENTATION, EXPRESS OR IMPLIED INCLUDING THE WARRANTIES OF FITNESS FOR A PARTICULAR PURPOSE OR MERCHANTABILITY, WITH RESPECT TO THE ACCURACY, COMPLETENESS, OR USEFULNESS OF THE INFORMATION CONTAINED IN THIS REPORT, OR THAT THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THIS REPORT MAY NOT INFRINGE PRIVATELY OWNED RIGHTS; OR

B. ASSUMES ANY LIABILITIES WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF, ANY INFORMATION, APPARATUS, METHOD OR PROCESS DISCLOSED IN THIS REPORT.

ABSTRACT

This Appendix to CEN-189 provides the plant-specific evaluation of pressurized thermal shock effects due to small break LOCA's with extended loss of feedwater for the San Onofre 2 & 3 reactor vessels. It is concluded that crack initiation would not occur for the transients considered for more than 32 effective full power years, which is assumed to represent full plant life.

TABLE OF CONTENTS

<u>SECTION</u>	<u>TITLE</u>	<u>PAGE</u>
	ABSTRACT	
H1.	PURPOSE	H1
H2.	SCOPE	H1
H3.	INTRODUCTION	H1
H4.	THERMAL HYDRAULIC ANALYSES	H2
H5.	FLUENCE DISTRIBUTIONS	H2
H6.	MATERIAL PROPERTIES	H3
H7.	VESSEL INTEGRITY EVALUATIONS	H6
H8.	CONCLUSIONS	H10

H1.0 PURPOSE

This Appendix provides the plant-specific evaluation of pressurized thermal shock effects of the SB LOCA + LOFW transients presented in the main body of the CEN-189 report for the San Onofre 2 & 3 vessels.

H2.0 SCOPE

The scope of this Appendix is limited to the evaluation of the SB LOCA + LOFW transients presented in CEN-189, as applied to the San Onofre 2 & 3 reactor vessels.

Other C-E NSSS reactor vessels are reported in separate Appendices.

H3.0 INTRODUCTION

This Appendix to CEN-189 was prepared by C-E for Southern California Edison for their use in responding to Item II.K.2.13 of NUREG-0737 for the San Onofre 2 & 3 reactor vessels.

This Appendix is intended to be a companion to the CEN-189 report. The transients evaluated in this Appendix are those reported in Chapter 4.0 of the main report. Chapter H5 of this Appendix reports the plant-specific fluence distributions developed as described in Chapter 5.0 of the main report. Chapter H6 reports the plant-specific material properties and change of properties due to irradiation, based on the methods of Chapter 6.0 of the report. Chapter H7 reports the results of comparing the fracture mechanics results of Chapter 7.0 of the report, to a set of material properties which are conservative with respect to the plant specific properties reported in Chapter H6. This additional conservatism was not removed because of the favorable results.

H4.0 THERMAL HYDRAULIC ANALYSES

The pressure-temperature transients used to perform the plant-specific vessel evaluation reported in this Appendix are those reported in Chapter 4.0 of CEN-189. As discussed in the body of the report, there are several plant parameter conservatisms included in the analyses to develop these transients due to the reference plant approach used which could be eliminated by performing more detailed plant-specific thermal-hydraulic system analyses. Removal of these available conservatisms by additional analyses was not performed due to the favorable conclusion achieved.

H.5.0 FLUENCE DISTRIBUTION

The San Onofre 2 & 3 Units are not yet in operation and have not yet completed a surveillance capsule evaluation. Since the vessel beltline materials are low copper content, detailed fluence profiles were not necessary for demonstration of acceptable PTS capability. Accordingly, the FSAR end of life peak fluence prediction was used to estimate end of life material properties. Also, in order to evaluate the sensitivity of the fluence prediction value, material properties were also determined assuming an end of life fluence twice the FSAR prediction value.

APPENDIX H SAN ONOFRE UNITS #2 and #3

H.6 MATERIAL PROPERTIES

The chemistry and initial (pre-irradiation) toughness properties of the San Onofre Units #2 and #3 reactor vessel beltline materials are summarized in Tables H6-1 and H6-2, respectively. The most controlling material in terms of residual chemistry (copper and phosphorus) and initial RT_{NDT} is plate C-6404-2 from the intermediate shell course for Unit #2 and plate C-6802-1 from the intermediate shell course for Unit #3. The predicted RT_{NDT} shift based on the maximum design fluence, $3.68 \times 10^{19}n/cm^2$ ($E > 1MeV$) at the inside surface of the reactor vessel, is 134F for Unit #2 and 77F for Unit #3 using Regulatory Guide 1.99. This will result in an adjusted RT_{NDT} at end-of-life (32 effective full power years) of 150F and 117F at the vessel inside surface for Units #2 and #3, respectively. If the design fluence was increased by a factor of two to $7.36 \times 10^{19}n/cm^2$, the RT_{NDT} shift is predicted to be 190F and 109F, resulting in adjusted RT_{NDT} values of 206F and 149F for Units #2 and #3, respectively.

TABLE H6-1

SAN ONOFRE UNIT #2
REACTOR VESSEL MATERIALS

Product Form	Material Identification	Drop Weight NDTT (°F)	Initial RT _{NDT} (°F)	Chemical Content (%)		
				Nickel	Copper	Phosphorus
Plate	C-6404-1	-30	16	0.55	0.10	0.009
Plate	C-6404-2	-20	16	0.58	0.10	0.010
Plate	C-6404-3	-20	13	0.53	0.10	0.009
Plate	C-6404-4	-10	14	0.60	0.09	0.006
Plate	C-6404-5	-20	2	0.62	0.11	0.006
Plate	C-6404-6	-10	-10	0.57	0.10	0.007
Weld	2-203 A,B,&C ^a	-60	-60	0.95	0.03	0.010
Weld	3-203 A,B,&C ^b	-50	-50	0.12	0.06	0.011
Weld	9-203 ^c	-60	-50	0.29	0.07	0.009

a Intermediate shell course longitudinal seam welds

b Lower shell course longitudinal seam welds

c Intermediate to lower shell girth weld

TABLE H6-2

SAN ONOFRE UNIT #3
REACTOR VESSEL MATERIALS

Product Form	Material Identification	Drop Weight NDTT (°F)	Initial RT _{NDT} (°F)	Chemical Content (%)		
				Nickel	Copper	Phosphorus
Plate	C-6802-1	-20	+40	0.58	0.06	0.002
Plate	C-6802-2	-20	0	0.59	0.05	0.007
Plate	C-6802-3	-10	+20	0.59	0.06	0.002
Plate	C-6802-4	-30	+ 5	0.56	0.05	0.007
Plate	C-6802-5	0	+10	0.53	0.04	0.010
Plate	C-6802-6	-40	+20	0.61	0.06	0.006
Weld	2-203 A,B,&C ^a	-40	-40	0.21	0.05	0.011
Weld	3-203 A,B,&C ^b	-70	-10	0.21	0.04	0.012
Weld	9-203 ^c	-50	-50	0.05	0.06	0.010

a Intermediate shell course longitudinal seam welds

b Lower shell course longitudinal seam welds

c Intermediate to lower shell girth weld

H.7.0 SONGS 2 & 3 Vessel Integrity

The fracture mechanics analysis is performed using upper bound data for fluence and material properties in the SONGS 2 & 3 vessels. The peak vessel fluence is considered to occur at the point of maximum RT_{NDT} . The material toughness properties K_{IC} and K_{Ia} are determined from the calculated temperatures for the SBLOCA + LOFW transients using the method described in Section 7.3.3 and predicted RT_{NDT} values through the depth of the wall. Critical crack depth diagrams are constructed from the applied K_I vs crack depth curves at the mid-core level of the vessel and the calculated material toughness curves. In this manner the integrity of the SONGS 2 & 3 vessels are evaluated for the SBLOCA + LOFW transients.

H.7.1 Summary of Physics and Material Data Input to Fracture Mechanics Analysis

A nominal design fluence value of 3.68×10^{19} n/cm² ($E > 1$ MeV) was used to approximate the end-of-life fluence for the SONGS 2 & 3 vessels, as well as a conservative upper bound of 7.36×10^{19} n/cm² or double the predicted end-of-life value. The peak fluence is considered to be uniform around the vessel. A conservative radial fluence attenuation was used such that:

$$\begin{aligned}\frac{F}{F_0} &= \exp(-8.625 \text{ in.} \times .33 \text{ in.}^{-1}) \cdot (a/w) \\ &= \exp(-2.85) \cdot (a/w)\end{aligned}$$

where F = point fluence in wall
 F_0 = peak fluence at surface
 a/w = fractional wall depth

Upper bound materials data were used to conservatively envelope all plate and weld materials, which are as follows:

PCT.	Cu	=	.10
PCT.	P	=	.010
Initial RT_{NDT}		=	+40°F

The shift in the value of the RT_{NDT} was determined using the method of Reg. Guide 1.99. This produces an end-of-life prediction for the surface RT_{NDT} of $174^{\circ}F$ using the nominal design fluence. A predicted surface RT_{NDT} value of $230^{\circ}F$ is determined for a fluence double the nominal design fluence.

H.7.2 Results of Fracture Mechanics Analysis for SBLOCA + LOFW \longrightarrow Restoration of Feedwater (Case 5)


The stress analysis for this case is presented in Section 7.8.2 of the report. The fracture mechanics analyses were performed using upper bound properties for the SONGS 2 & 3 vessels and conservative end-of-life fluence levels. The critical crack depth diagram is constructed using the stresses in the transient at the mid-core level coincident with the peak fluence and material properties. Figure H.7-1 shows the critical crack depth diagram for a nominal design fluence of 3.68×10^{19} n/cm². The calculated shifts in RT_{NDT} are relatively low, and for this transient loading condition the initiation toughness level is not exceeded. Therefore, no crack initiation would occur for this combination of loading, fluence, and material properties.

Figure H.7-2 shows the critical crack depth diagram for the same transient loading and upper bound material properties, but twice the nominal design fluence. From the figure it is apparent that no crack initiation would occur for this transient even with fluence levels greatly exceeding the nominal design fluence.

H.7.3 Conclusion

These results demonstrate that the integrity of the SONGS 2 & 3 vessels would be maintained throughout the assumed life of the plant for SBLOCA + LOFW transient with recovery of feedwater.

CRITICAL CRACK DEPTH VS. TIME

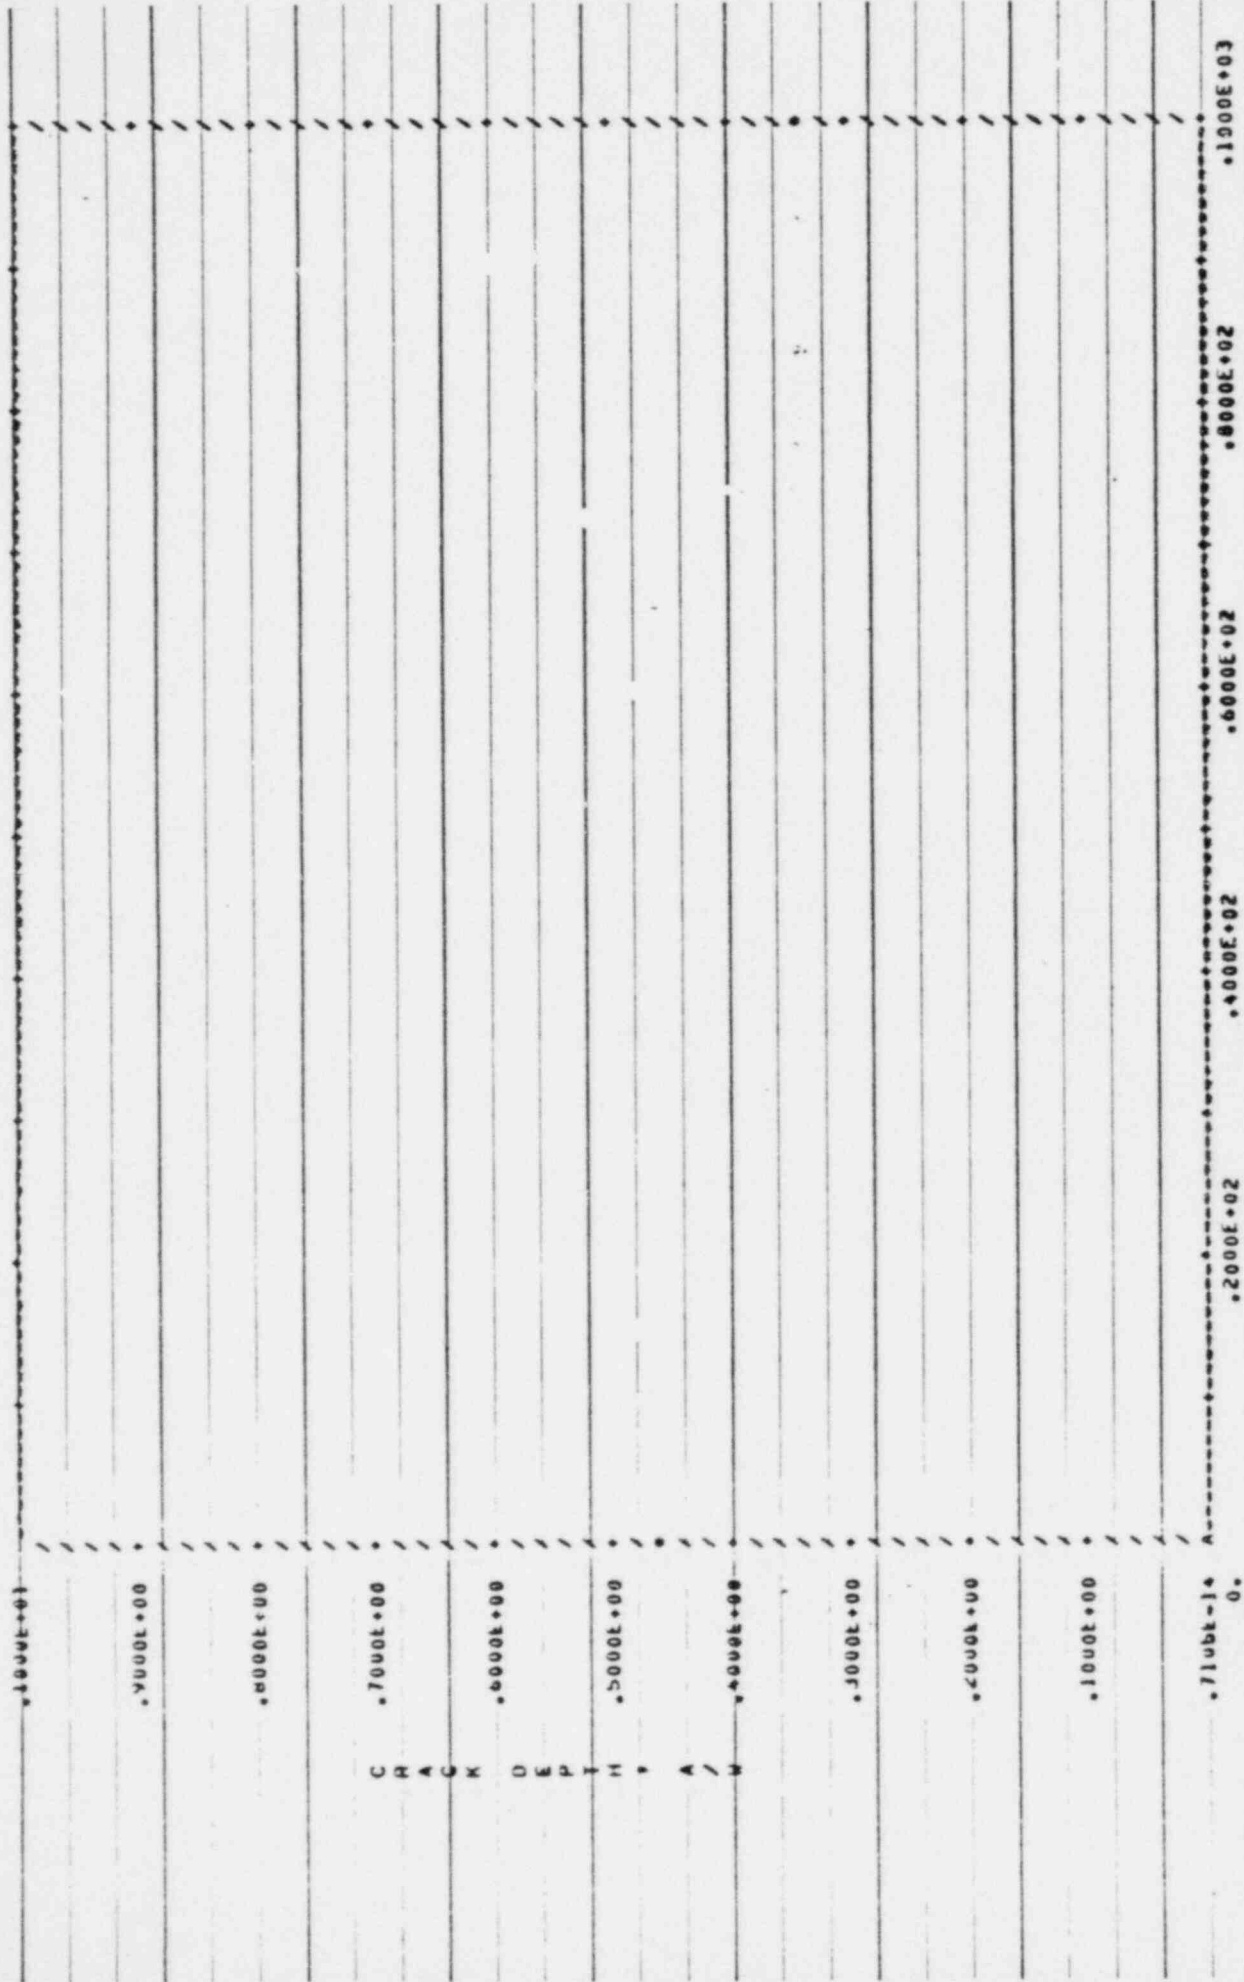

TIME (MIN)
SAN ONOFRE NOV 2 8 3

FLUENCE = 74E20 N/CM²
INIT RINDI = 40. DEG. F
PCI. CU = .10
PCI. P = .010
RINDIS = 230. DEG. F

Figure H.7-2

CONCLUSIONS

This Appendix to CEN-189 provides the results of analytical evaluations of pressurized thermal shock effects on the SONGS 2 + 3 reactor vessels for cases of a SBLOCA + LOFW, in response to the requirements of Item II.K.2.13 of NUREG-0737. Two different scenarios were chosen for evaluation based on remedial actions to prevent inadequate core cooling:

1. SBLOCA + LOFW + PORV's opened after 10 minutes
2. SBLOCA + LOFW + Aux. FW reinstated after 30 minutes

Thermal-hydraulic system transient calculations were performed on a reference-plant basis, as reported in CEN-189 with the parameter variations over the range representing all operating plants. Four different cases were analyzed for each of the two different scenarios defined above, for a total of eight cases. The most challenging of the two different scenarios was analyzed using linear elastic fracture mechanics methods to determine the critical crack tip stress intensity values for comparison to plant specific materials properties at various times in plant life. The effect of the warm prestress phenomenon is identified where applicable for each transient, and credited where appropriate.

In this Appendix, the results of plant specific peak neutron fluence predictions are superimposed on plant specific material properties to define vessel capability versus plant life. The results of the generic LEFM analyses were evaluated using the plant specific material properties. It is concluded that crack initiation would not occur due to the SBLOCA + LOFW transients considered, for more than 32 effective full power years of operation, which is assumed to represent full plant life.

COMBUSTION ENGINEERING, INC.