



Commonwealth Edison


Dresden Nuclear Power Station
R.R. #1
Morris, Illinois 60450
Telephone 815/942-2920

PRINCIPAL STAFF	
DIR	E&IS
D/D	PAO
A/D	SLO
DR&PI	TRW
DE&TI	
DEP&OS	File

January 6, 1982

DJS LTR: 82-1

Mr. James G. Keppler, Regional
Administrator
Directorate of Regulatory Operations
Region III
U.S. Nuclear Regulatory Commission
799 Roosevelt Road
Glen Ellyn, Illinois 60137

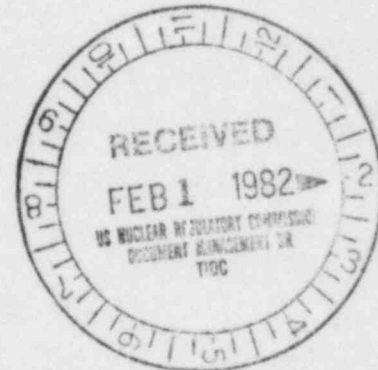

Dear Mr. Keppler:

As part of the Unit 3 preoutage work, a secondary containment leak rate test (SCLRT) was performed on the Unit 2/3 Reactor Building. According to Section 4.7.C.1.c. of the Dresden 2/3 Technical Specifications, the secondary containment must be capable of maintaining 0.25 inches of water vacuum with the Reactor Building ventilation system isolated and one Standby Gas Treatment train in operation.

On January 2, 1982, the test was performed in accordance with station procedures. The result was a 0.28 inches of water negative pressure in the secondary containment with respect to the atmosphere, which meets the Technical Specification requirement. This report is submitted in accordance with the requirements of Section 6.6.C.3. of the Unit 3 Technical Specifications.

Sincerely,

D. J. Scott
for D. J. Scott
Station Superintendent
Dresden Nuclear Power Station

DJS:RW:mt

cc: T. Rausch
M. Wright
R. Whalen
File/NRC
File/Numerical

8202020198 820106
PDR ADOCK 05000237
PDR
P

1824
5/10
JAN 12 1982