

SOUTH CAROLINA ELECTRIC & GAS COMPANY

POST OFFICE BOX 764

COLUMBIA, SOUTH CAROLINA 29218

T. C. NICHOLS, JR.
VICE PRESIDENT AND GROUP EXECUTIVE
NUCLEAR OPERATIONS

March 26, 1982



Mr. Harold R. Denton, Director
Office of Nuclear Reactor Regulation
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Subject: Virgil C. Summer Nuclear Station
Docket No. 50/395
Technical Specifications

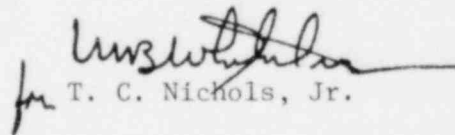
Dear Mr. Denton:

The December 29, 1981 memorandum from Mr. Butler of the Containment System Branch to Mr. Skovholt stated that all the valves listed in Table 6.2-53a of the V. C. Summer FSAR should be included in Table 3.6-1 of our Technical Specifications. We have reviewed the two tables and determined that it would be inappropriate to include all the valves in the FSAR Table. The list in the FSAR identifies all the valves that are subject to Type C leakage tests. Table 3.6-1 identifies all the valves that are needed to isolate the reactor building atmosphere from the outside environment in case of an accident. Some valves that are subject to Type C leakage tests, if isolated, would disable parts of engineered safety feature systems and, therefore, should not be included in Table 3.6-1.

However, during the review of the two tables, we did discover that all the valves needed for containment isolation had not been listed. Enclosed is a revised Table 3.6-1 which should replace the current Table 3.6-1 in our Technical Specifications.

Please contact Mr. Shealy if you have any questions.

Very truly yours,


for T. C. Nichols, Jr.

LDS:TCN,jr:jl
Attachments

ccs: Messrs. V. C. Summer (w/o att.)
G. H. Fischer (w/o att.)
H. N. Cyrus (w/o att.)
T. C. Nichols, Jr.
H. T. Babb
W. A. Williams, Jr.
M. B. Whitaker, Jr.
D. A. Nauman
O. S. Bradham
L. D. Shealy
R. B. Clary
W. R. Baehr
M. N. Browne

A. R. Koon
G. J. Braddick
J. L. Skolds
J. B. Knotts, Jr.
B. A. Bursey
M. J. Virgilio
C. L. Ligon (NSRC)
J. C. Ruoff
J. P. O'Reilly
J. R. Cookinham
W. F. Kane
NPCF
File

Boo1
5/11

8204050243 820326
PDR ADOCK 05000395
A PDR