

ILLINOIS POWER COMPANY



U-0458

L30-82(04-08)-6
B24

500 SOUTH 27TH STREET, DECATUR, ILLINOIS 62526

April 8, 1982



Mr. James R. Miller, Chief
Standardization & Special Projects Branch
Division of Licensing
Office of Nuclear Reactor Regulation
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

Ref: Letter 3/26/82 J. R. Miller, NRC to G. E. Wuller, IP
Subject: Clinton Masonry Walls

Dear Mr. Miller:

Clinton Power Station Unit 1
Docket No. 50-461

As requested by the NRC staff in a meeting on March 8, 1982 and in their letter dated March 26, 1982 Illinois Power Company is attaching the following material, relative to confirmatory issue number seven, for your consideration:

- a. A copy of the transparencies presented to the NRC at the meeting held on March 8, 1982 in Bethesda, Maryland.
- b. A copy of the proposed static test program on masonry walls to determine the modulus of rupture (transverse flexural strength) value of CPS safety related concrete block walls.
- c. A copy of the ASTM Standard E72-80 on "Conducting Strength Tests of Panels for Building Construction" which will be used in performing these tests for the Clinton masonry walls.

With reference to Item 1 of the NRC's March 26, 1982 letter, we will send the assessment of impact of using lower damping values and ignoring joint reinforcement on the walls in approximately two weeks.

Bool
5/1


Mr. James R. Miller

-2-

U-0458

Our current schedule requires a minimum of five months from the receipt of your review and approval of the test program, to initiate, construct, and, test and summarize the findings of this program.

Sincerely,

A handwritten signature in cursive script, appearing to read "G. E. Wuller".

G. E. Wuller
Supervisor-Licensing
Nuclear Station Engineering

HBP/lr

cc: J. H. Williams, NRC Clinton Project Manager
H. H. Livermore, NRC Resident Inspector
N. Chokshi, NRC SEB (w/att.)
Illinois Department of Nuclear Safety, (w/att.)

STATIC TESTING OF CONCRETE MASONRY WALLS
FOR
TRANSVERSE FLEXURAL STRENGTH
FOR CLINTON UNIT #1

1.0 General

Static tests shall be made on three like specimens constructed in accordance with procedures outlined below. The walls shall be tested to determine the transverse flexural strength at failure. See Fig. 1.

2.0 Construction of Walls

- a) The labor and materials required for construction of test panels shall be furnished by IPC.
- b) The construction materials shall meet the requirements of the Clinton Project Specification K-2944 Form CPS-1-MW.
- c) The construction of the test panels shall satisfy the requirements of the Clinton Project Specification No. K-2944 Form CPS-1-MW for Category 1 Concrete Masonry Walls and shall be built at Testing Contractor's test facility.
- d) The walls erected for testing shall have nominal dimensions of 8 feet long and 4 feet high. Effective span for the walls shall be 7'-6". They shall be built using two core hollow block units of nominal size 8"x8"x16" in running bond pattern with 3/8 thick mortar joints.
- e) The bottom course of masonry shall be laid on the concrete pad with a bond breaker.
- f) 3/16"Ø truss type masonry joint reinforcement meeting the Clinton project spec. requirements shall be placed in every second mortar bed joint resulting in 16" vertical spacing.
- g) The concrete masonry test panels shall be cured at 70°F + 5°F and 60 percent + 10 percent relative humidity for 28 days.

3.0 Testing of Concrete Masonry Walls

- a) The Testing Contractor shall furnish the labor and instrumentation to perform the tests.
- b) The tests shall be performed in accordance with ASTM E72-80 using a uniform load.

- c) The walls shall be tested to failure.
- d) Complete load-deflection-time records shall be maintained throughout the test.
- e) Lateral deflections of the wall shall be measured at mid-height of the wall at mid-span and 1/4 points of the span. The deflections shall be measured to the nearest 0.001 in.
- f) The contractor shall perform mortar cube tests, 3 tests per wall panel, in accordance with ASTM C270 to establish mortar compressive strength.
- g) The contractor shall determine the compressive strength of the masonry units by testing 1 block per wall panel in accordance with ASTM C140.
- h) Testing shall be performed under an approved quality assurance program in accordance with 10CFR50, Appendix B.

4.0 Reporting of Test Results

The following information shall be included in reporting the test results.

- a) Plot of all the test results in accordance with requirements of ASTM Standard E72-80.
- b) Dimensions, cross-sectional and strength properties of masonry units (Table 1).
- c) Tabulation of Test Results (Table 2).
- d) Information regarding the flexural strength of concrete masonry walls (Table 3).

TABLE 1

DIMENSIONS, CROSS-SECTIONAL AND STRENGTH
PROPERTIES OF CONCRETE MASONRY WALLS

- a. Wall designation
- b. Wall Dimensions
 - i) Length
 - ii) Height
 - iii) Thickness
- c. Concrete Masonry Unit Information
 - i) Type - hollow
 - ii) Width
 - iii) Span Length
 - iv) Height
 - v) Minimum face shell and web thickness
- d. Cross-Sectional Properties Per Foot of Wall
 - i) Gross Area
 - ii) Net Area
 - iii) Gross Moment of Inertia
 - iv) Net Moment of Inertia
- e. Strength Properties
 - i) Mortar compressive Strength, M_o in psi and mortar classification as per ASTM C270.
 - ii) Compressive strength of concrete masonry unit based on gross area, f'_c , psi as per ASTM C140.
 - iii) Compressive strength of concrete masonry unit based on net area, f'_c , psi

TABLE 2

TABULATION OF LOAD-DEFLECTION
 READINGS AT MID-HEIGHT OF WALL
 WALL DESIGNATION _____

Applied Load psf	Deflection or Perm. Set	Immediately After Load Application * or Load Release				End of 5-min Period After * Load Release or Load Application			
		1/4 Span	Mid-Span	3/4 Span	Remarks	1/4 Span	Mid-Span	3/4 Span	Remarks
	Deflection								
-	Perm. Set								
	Deflection								
-	Perm. Set								
	Deflection								
-	Perm. Set								
	Deflection								
-	Perm. Set								
	Deflection								
-	Perm. Set								
	Deflection								
-	Perm. Set								
	Deflection								
-	Perm. Set								
	Deflection								
-	Perm. Set								

*Readings as per ASTM E72-80

TABLE 3

TRANSVERSE FLEXURAL STRENGTH OF HORIZONTALLY
REINFORCED, HORIZONTALLY SPANNING HOLLOW CONCRETE
MASONRY WALLS

Wall Pattern	Wall Thickness in	Mortar Type & Strength (psi)	Ultimate Load (1) (psf)	Modulus (2) of Rupture based on Net Area at Ultimate Load (psi)	Remarks

(1) Ultimate load W_u is the maximum transverse load resisted by the wall indicated by point 1 in Fig. A.


(2) Modulus of rupture
$$F_r = \frac{12W_u L_w^2}{8S}$$


where

W_u = ultimate load, psf

L_w = wall span length, ft.

S = section modulus based on the net cross-section

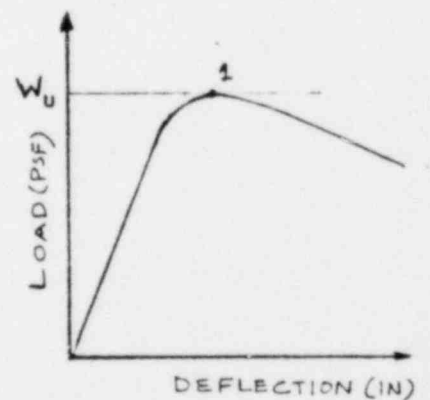

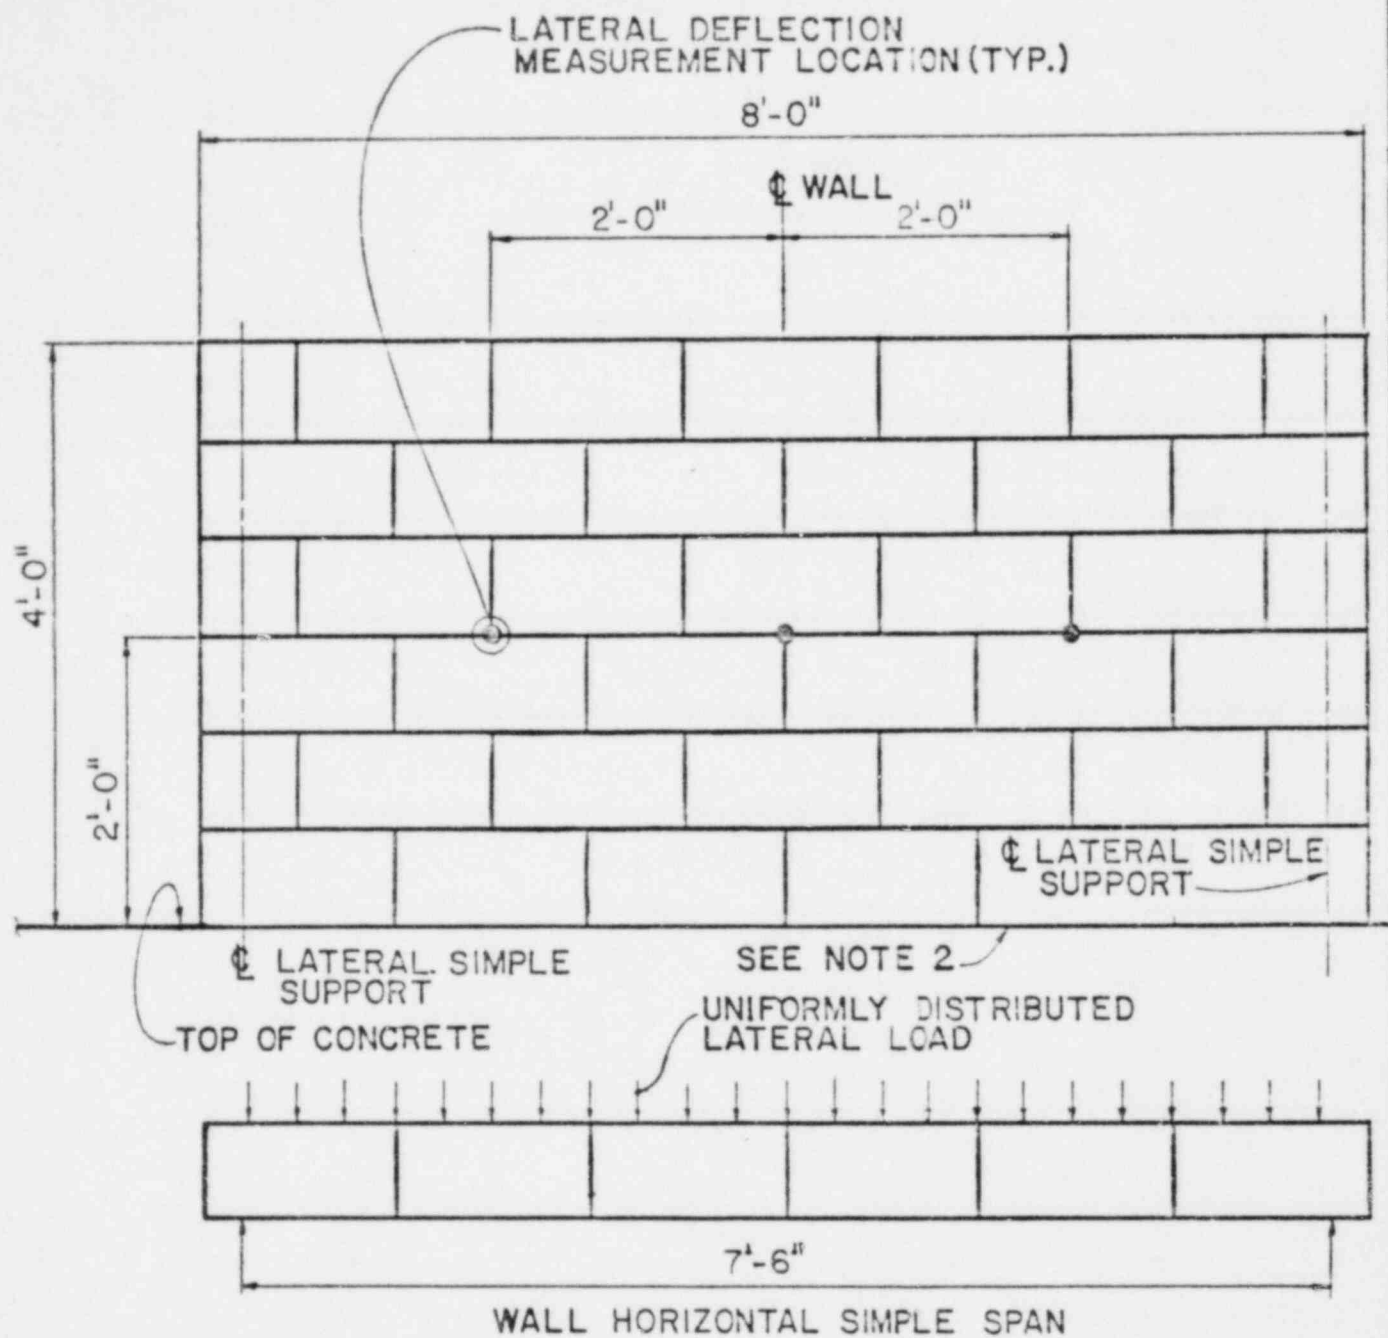

- NOTE: 1. WALL PANEL TO BE BUILT OF 2-CORE, 8"x8"x16" HOLLOW BLOCKS AND WITH FULL MORTAR BEDDING CONSTRUCTION.
2. PROVIDE BOND BREAKER FOR THE FULL LENGTH OF BOTTOM COURSE OF MASONRY WALL.

FIG. 1: CONCRETE MASONRY WALL
TEST PANEL

March 8, 1982

Procedure Used to Determine Concrete Masonry Wall
Self-Weight Acceleration for Clinton, Unit 1

- I Fundamental frequency for concrete masonry walls was determined using finite element techniques for all wall aspect ratios.
 - A. The analysis included the appropriate masonry wall boundary conditions and support stiffness (i.e., blockwall columns).
 - B. Variation in the masonry modulus, E_m , was taken between:
 1. $600 f'_m - 1,000 f'_m$ for hollow masonry walls
 2. $800 f'_m - 1,200 f'_m$ for solid masonry walls
 - C. Considered the effect of wall openings
 - D. Considered a reduced moment of inertia, $(I_m)_e$, when the masonry tensile stress exceeded the modulus of rupture, f_r , or when horizontal joint reinforcing was considered in design.
- II The following damping values were used:
 - A. 2% - OBE
 - B. 4% - SSE
- III The average of the floor and ceiling spectra was used in determining the self-weight acceleration, g .
- IV A factor of 1.05 was applied to the self-weight acceleration, g , to account for the participation of higher modes.
- V Peak acceleration levels at 2% and 4% damping for the OBE and SSE, respectively, were used in determining the seismic effect of attachment loads where a time history or response spectrum method of analysis was not utilized for the attachment design.

TABLE I
Comparison of Actual Maximum Concrete Masonry Stresses
vs.
SEB and Clinton Project Allowable Stresses for Clinton, Unit 1
Hollow Block Construction
 $f'_m = 1,350$ psi , $M_o = 2,500$ psi

Stress	Normal and OBE Load Combinations			SSE Load Combinations		
	Actual Maximum Stress (psi)	Clinton Project Allowable Stress (psi)	SEB Allowable Stress (psi)	Actual Maximum Stress (psi)	Clinton Project Allowable Stress (psi)	SEB Allowable Stress (psi)
Tension Parallel to Bed Joint $f_{t }$	24	46	50	36	77	75
Tension Perpendicular to Bed Joint $f_{t\perp}$	12	23	25	12	38	32
Shear f_v	12	34	40	12	57	52

Actual stresses are based upon the following:

(1) Wall Frequency Calculation

- Based upon finite element analysis for all aspect ratios.
- Actual support stiffness included, i.e., blockwall columns included in model.
- Variation in E_m between $1,000 f'_m$ - $600 f'_m$.
- Effects of openings included.

(2) Damping

- 2% - OBE
- 4% - SSE

(3) Participation of higher modes included.

(4) Reduced I_m when $M_a > M_{cr}$.

(5) Peak "g" values used for attachment loads.

TABLE II
Comparison of Actual Maximum Concrete Masonry Stresses
vs.
SEB and Clinton Project Allowable Stresses for Clinton, Unit 1
Solid Block Construction
 $f'_m = 1,350 \text{ psi}$, $M_o = 2,500 \text{ psi}$

Stress	Normal and OBE Load Combinations			SSE Load Combinations		
	Actual Maximum Stress (psi)	Clinton Project Allowable Stress (psi)	SEB Allowable Stress (psi)	Actual Maximum Stress (psi)	Clinton Project Allowable Stress (psi)	SEB Allowable Stress (psi)
Tension Parallel to Bed Joint $f_{t }$	24	78	75	36	130	112
Tension Perpendicular to Bed Joint $f_{t\perp}$	12	39	40	12	65	52
Shear f_v	12	34	40	12	57	52

Actual stresses are based upon the following:

(1) Wall Frequency Calculation

- Based upon finite element analysis for all aspect ratios.
- Actual support stiffness included, i.e., blockwall columns included in model.
- Variation in E_m between $1,200 f'_m$ - $800 f'_m$.
- Effects of openings included.

(2) Damping

- 2% - OBE
- 4% - SSE

(3) Participation of higher modes included.

(4) Reduced I_m when $M_a > M_{cr}$.

(5) Peak "g" values used for attachment loads.

Parametric Study to Determine Wall Frequency

I Fundamental wall frequency depends upon the following variables:

$$f, h, w, t, s, E_m, E_s, \rho_m, \rho_s, A_s, I_s$$

where

f = Fundamental frequency

h = Height of wall

w = Width of wall

t = Thickness of wall

s = Spacing of wall columns

E_m = Masonry modulus of elasticity

E_s = Steel modulus of elasticity

ρ_m = Masonry mass density

ρ_s = Steel mass density

A_s = Total area of steel columns

I_s = Total moment of inertia of steel columns

II From Theory of Dimensional Analysis, the following functional relationship is derived:

$$\frac{f}{\sqrt{\frac{E_m}{\rho_m} \frac{t}{h^2}}} = \phi \left[\frac{E_m w t^3}{E_s I_s}, \frac{\rho_m w t}{\rho_s A_s}, \frac{h}{w}, \frac{h}{s}, \frac{h}{t} \right]$$

III Normalized frequency may, therefore, be expressed as:

$$\frac{f}{\sqrt{\frac{E_m}{\rho_m} \frac{t}{h^2}}} = \phi \left[\frac{E_m w t^3}{E_s I_s}, \frac{\rho_m w t}{\rho_s A_s}, \frac{h}{w} \right]$$

- IV A family of curves may be generated for the frequency normalization factor which is a function of:

$$A^* = \frac{\rho_m w t}{s A_s} \quad , \quad I^* = \frac{E_m w t^3}{E_s I_s} \quad , \quad \frac{h}{w}$$

- V Fundamental wall frequency, therefore, reduces to:


$$f = \frac{1.64}{h^2} \left(\sqrt{\frac{E_m I_m}{W_w}} \right) \phi$$

where

I_m = Masonry moment of inertia

W_w = Weight of wall per square foot of wall area

March 8, 1982

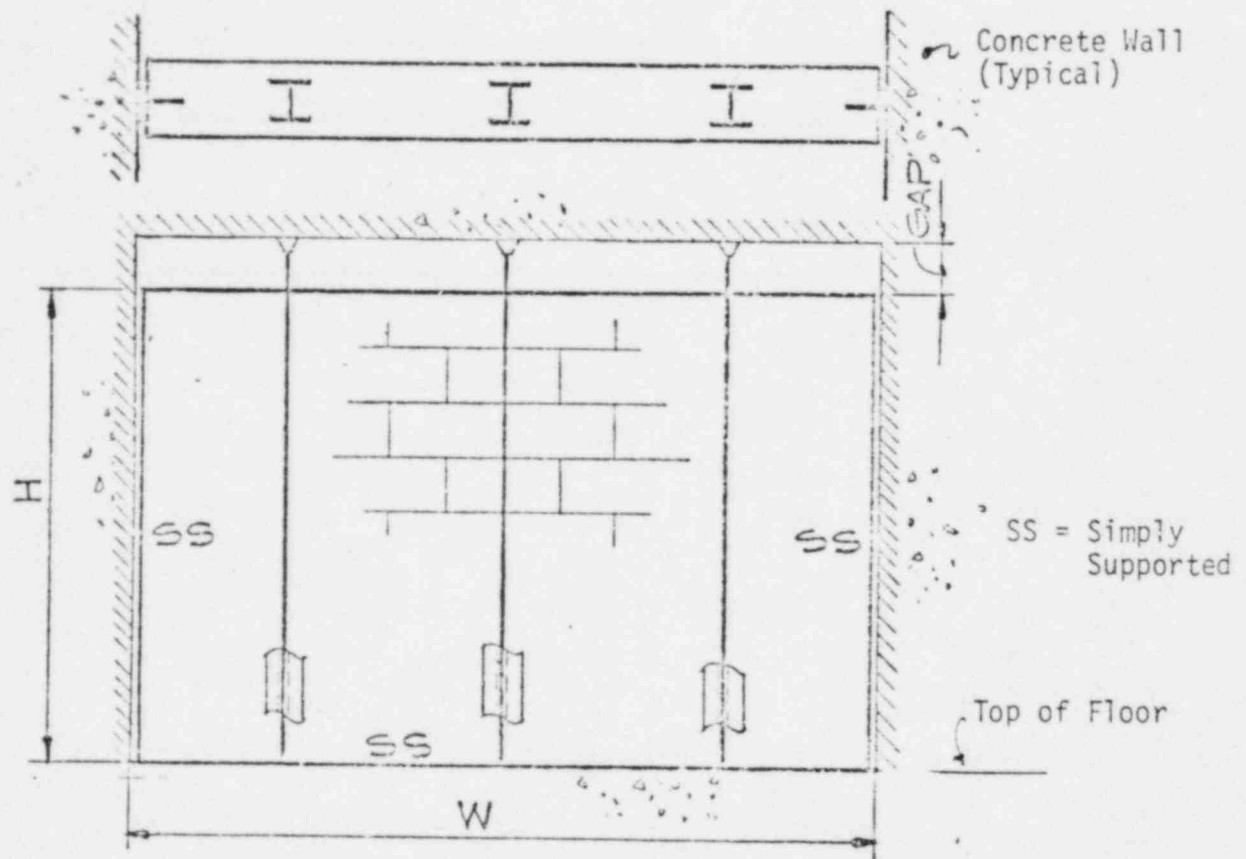


Boundary Condition SSS

I End supports non-yielding. Intermediate support flexible.

TYPICAL BOUNDARY AND SUPPORT STIFFNESS CONDITIONS

March 8, 1982

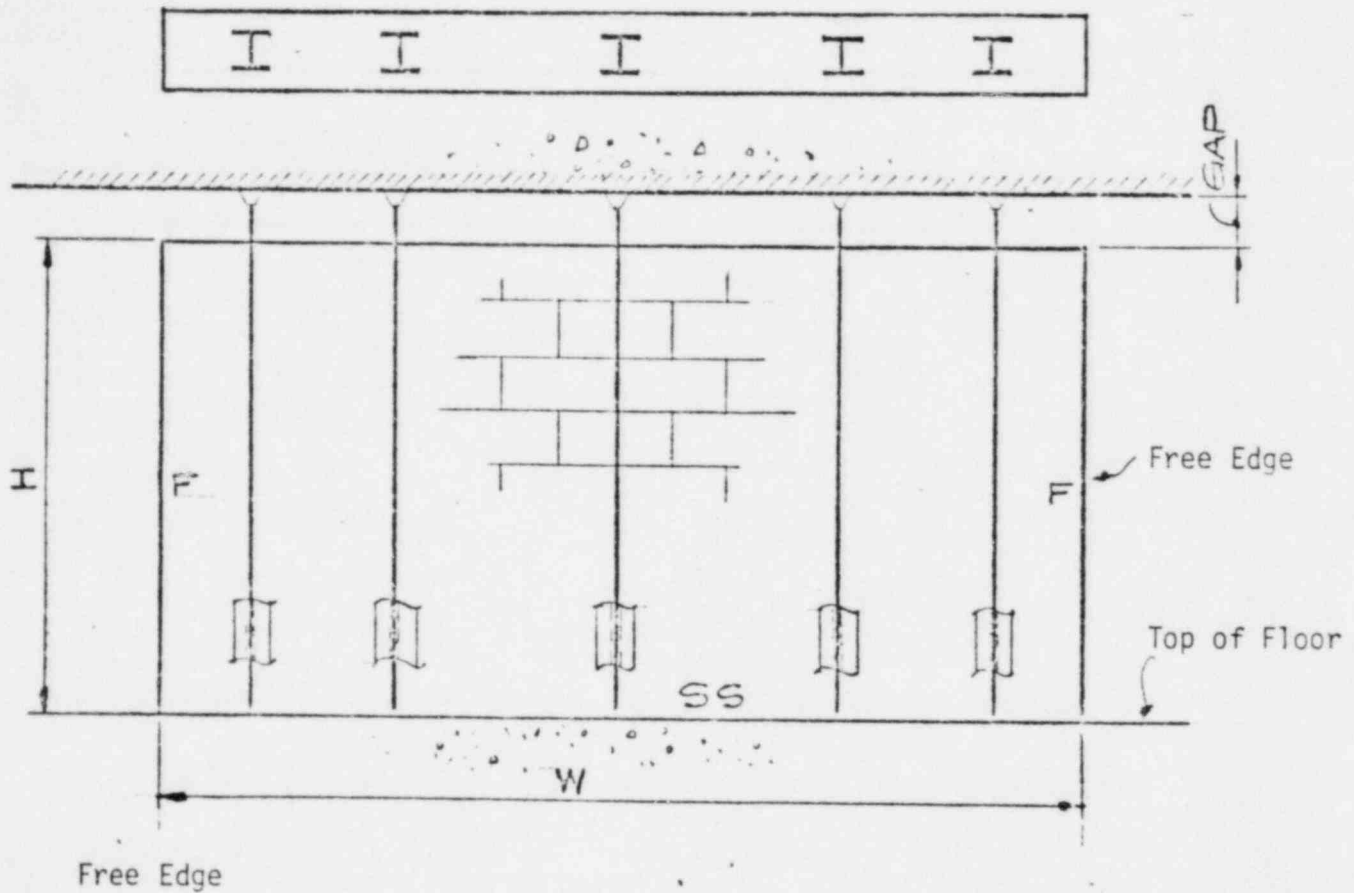


Boundary Condition FSF

II End supports flexible. Intermediate supports flexible.

TYPICAL BOUNDARY AND SUPPORT STIFFNESS CONDITIONS


March 8, 1982

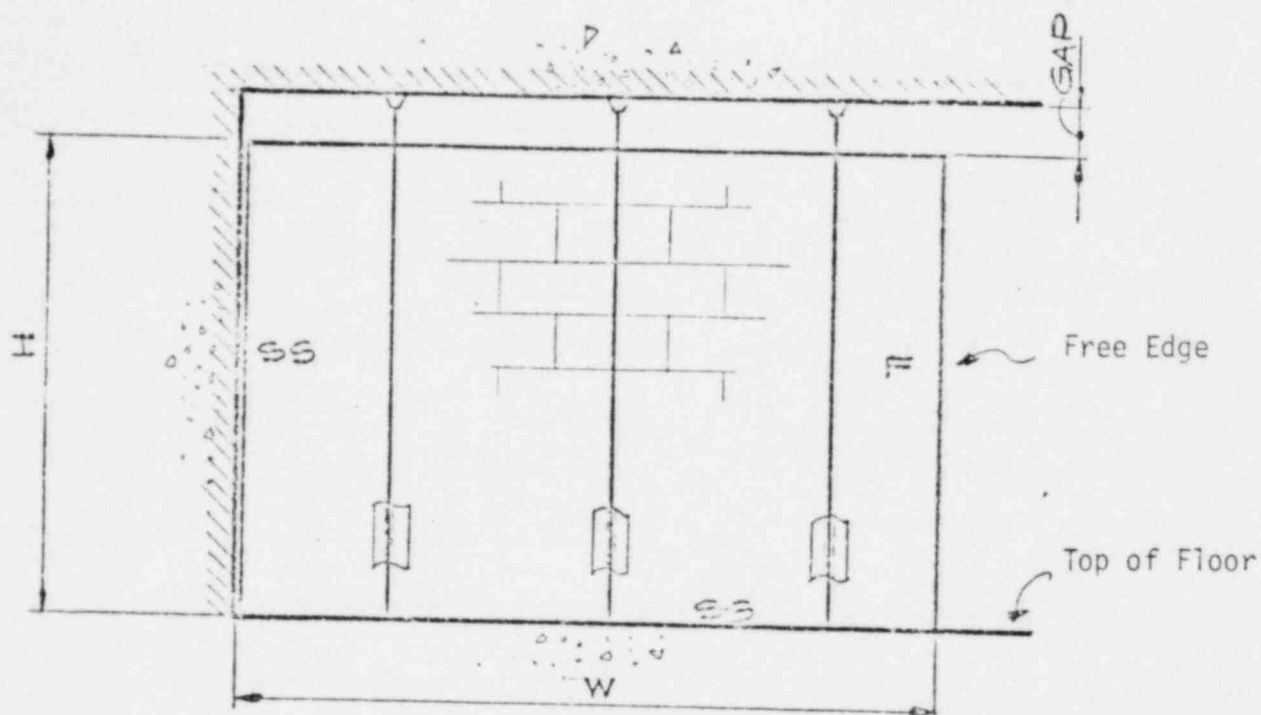


Boundary Condition SSF

III One end support non-yielding. All other supports flexible.

TYPICAL BOUNDARY AND SUPPORT STIFFNESS CONDITIONS

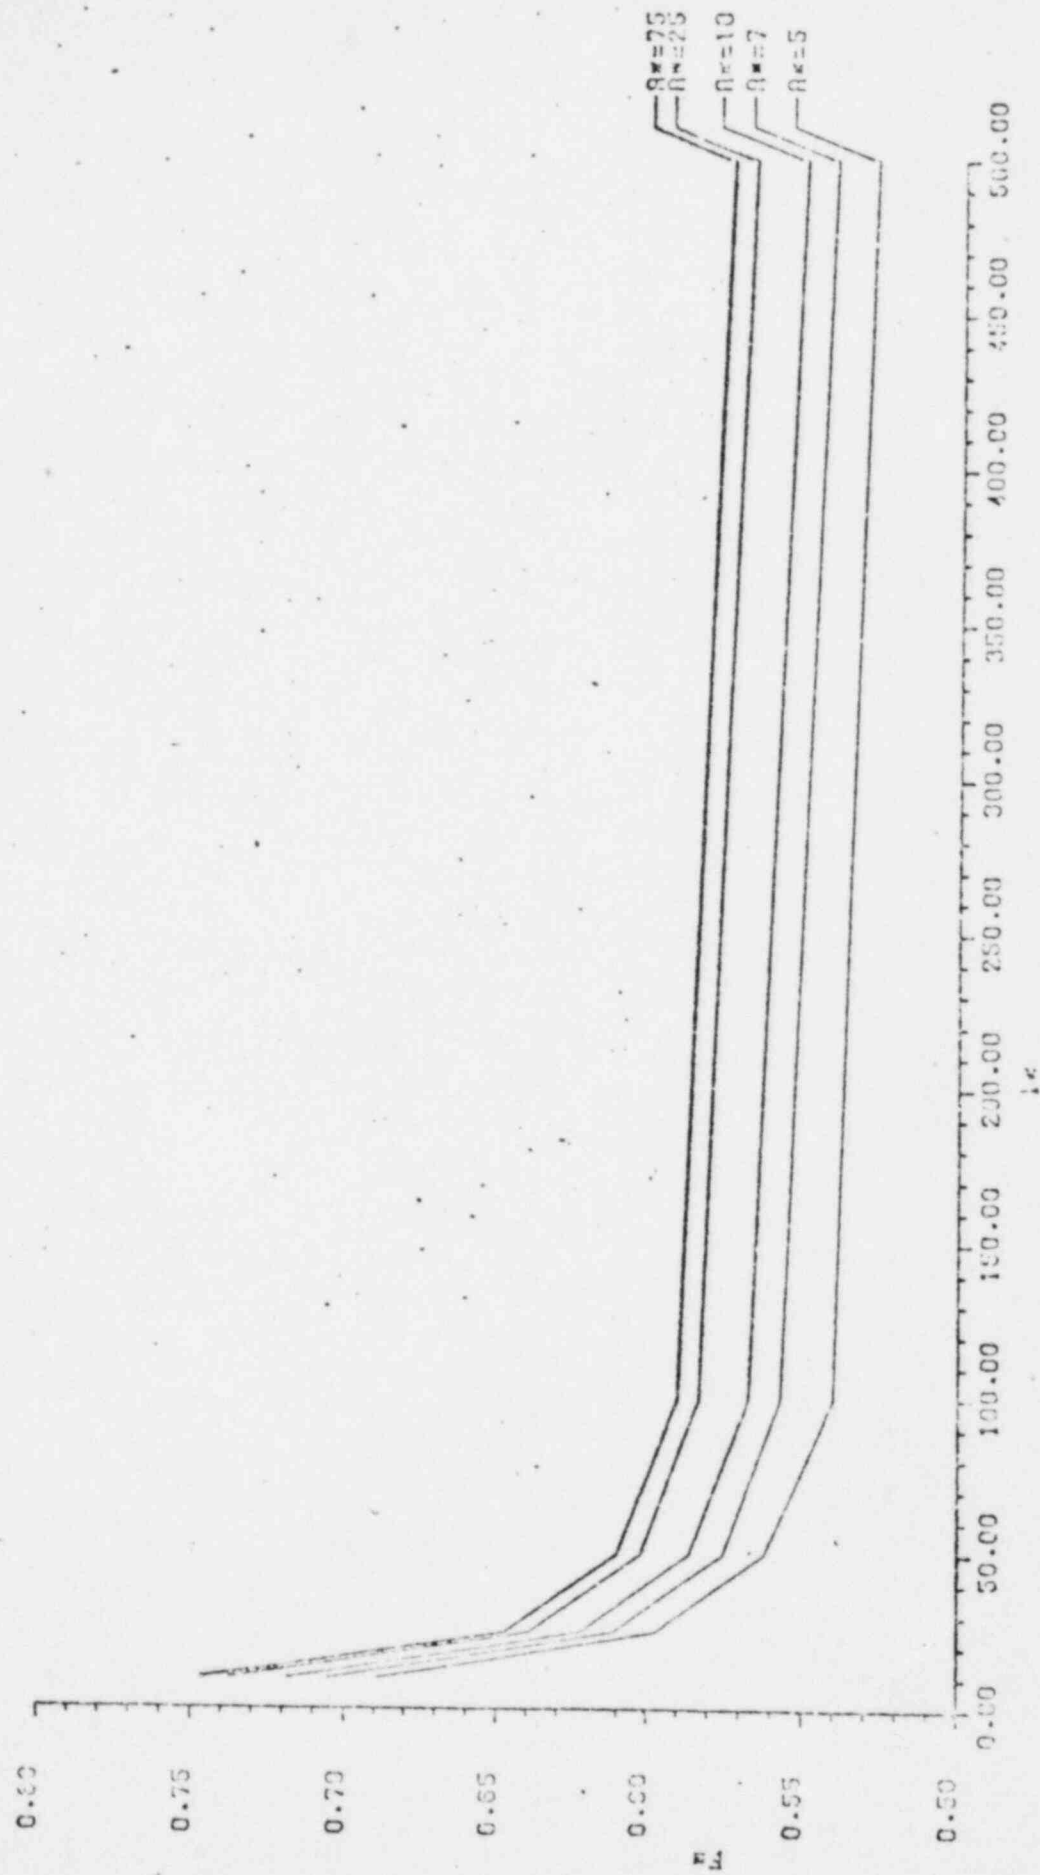

NORMALIZED FREQUENCY CURVE $H/W=0.5$ BOUNDARY COND.=SSS

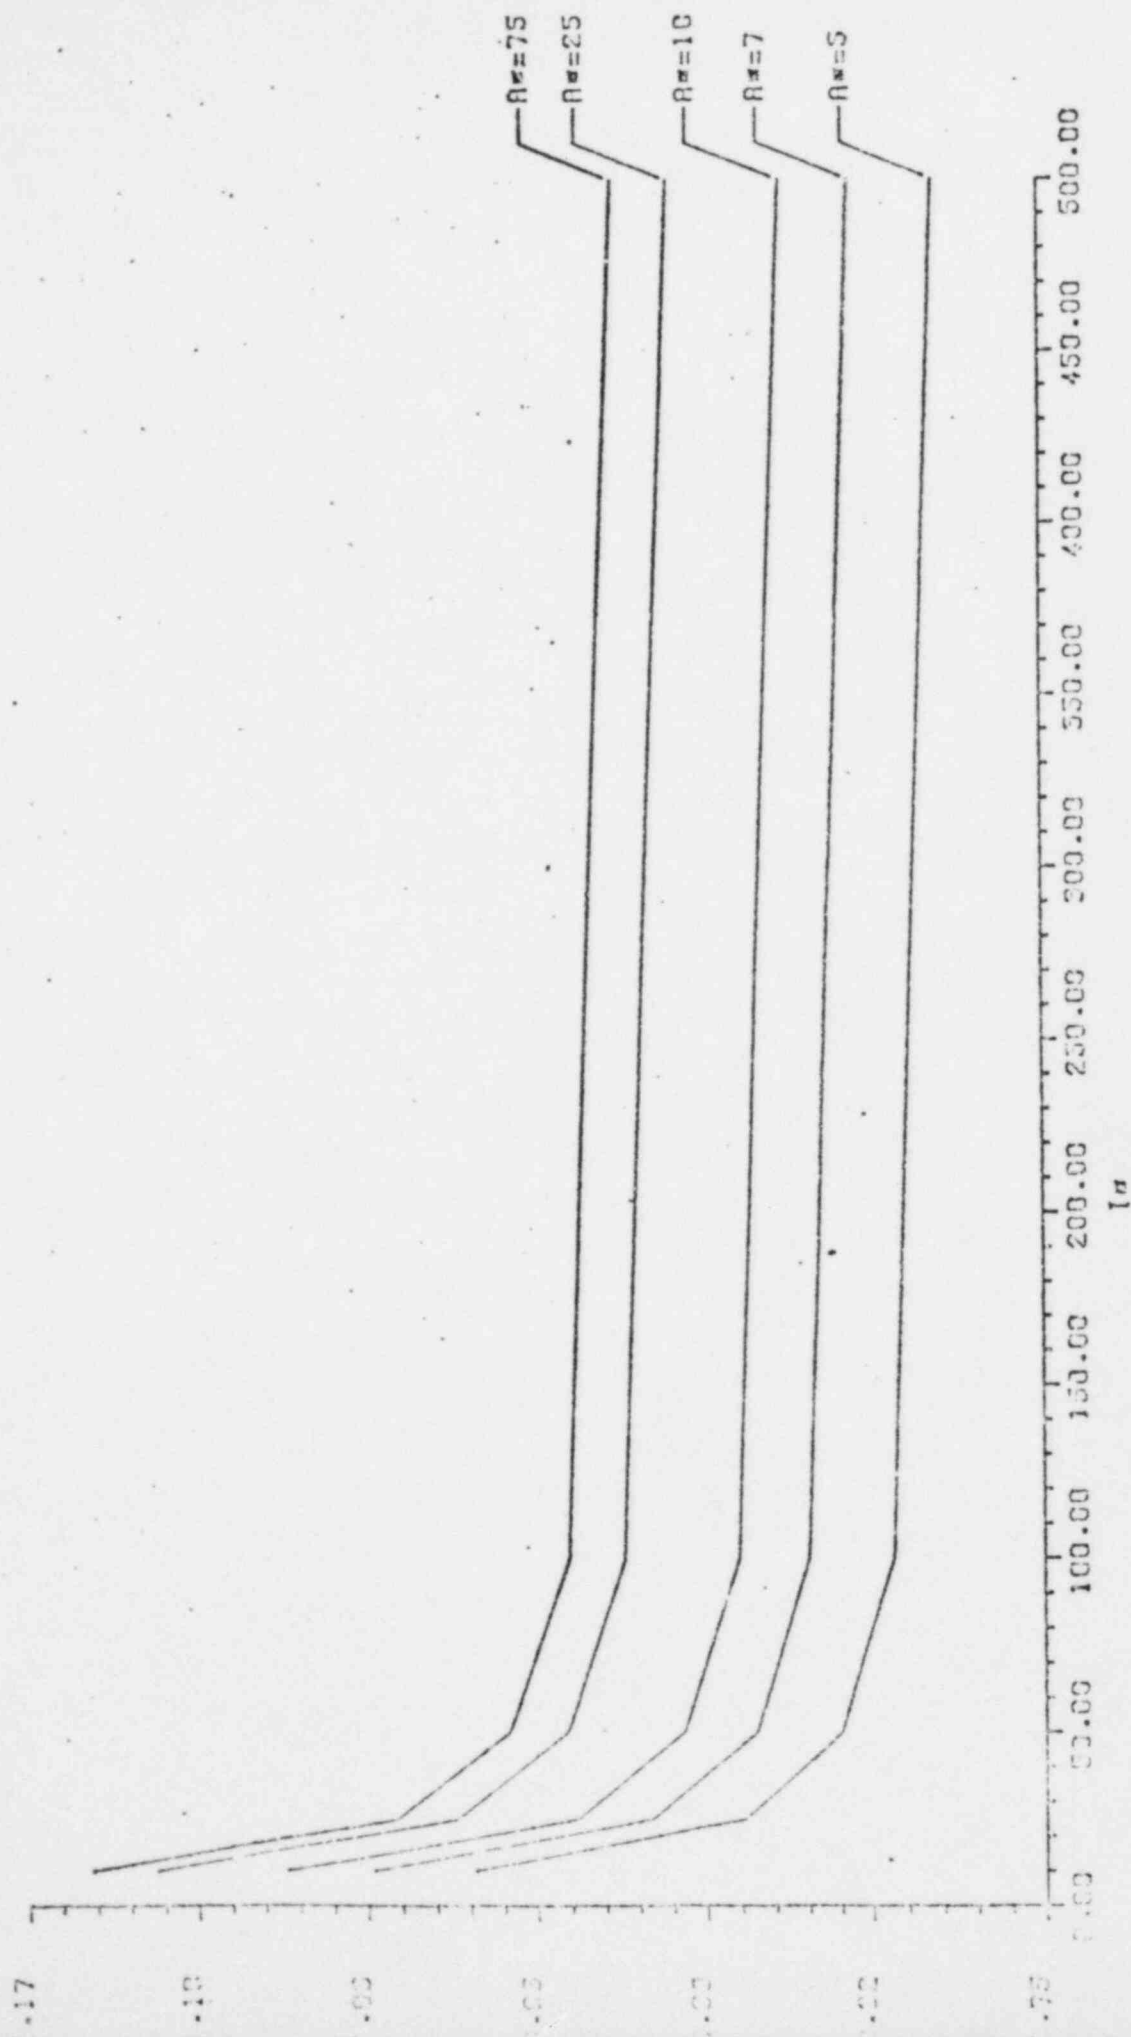

NORMALIZED FREQUENCY CURVE $H/N=1.00$ BOUNDARY COND.=SSS

March 8, 1982

Frequency Reduction Factors Used to Account for Wall Openings

<u>Opening Area in Percent of Total Wall Surface Area</u>	<u>Adjustment Factor</u>
0 - 10%	1.00
10 - 20%	0.95
20 - 35%	0.90
35 - 45%	0.85

March 8, 1982

Frequency Comparison for Wall Openings

$$h/w = 0.50$$

$$A^* = 7$$

$$I^* = 45$$

Opening Description	ϕ	$\frac{\phi \text{ With Opening}}{\phi \text{ Without Opening}}$
None	0.5271	1.00
0.17w x 0.6h, center span from bottom to 0.6h	0.5245	0.99
0.17w x 0.6h at end of span from bottom to 0.6h	0.5125	0.97
Five openings at mid-height 0.08w x 0.2h separated by 0.08w	0.5240	0.99

March 8, 1982

Variation in Masonry Modulus E_m

I Variation in E_m bounds recognized masonry code allowables

1,000 f'_m

{ UBC
NCMA
ACI-531

600 f'_m

ATC

II Tests substantiated by Hegemier¹

	STD	STD VIB	ADM	ADM VIB
<u>Elastic Modulus</u> f'_m	1129	1081	1192	1028
Standard Deviation	241	102	126	93

$$(E_m)_{95\%} = \bar{X} - 1.65\sigma = 1129 - 1.65 (241) = 731 f'_m$$

¹Hegemier, G., Nonn, R., Arya, S., "Behavior of Concrete Masonry Walls Under Biaxial Stresses," National Science Foundation Grant NSF ENU 74-14818, pp. 267 and 268.

March 8, 1982

Procedure for Reduction in Moment of Inertia, I_m

A reduced effective moment of inertia, $(I_m)_e$, is utilized when the masonry tensile stresses exceed the modulus of rupture, f_r .

$$(I_m)_e = \left(\frac{M_{cr}}{M_a} \right)^3 I_m + \left[1 - \left(\frac{M_{cr}}{M_a} \right)^3 \right] (I_m)_{cr}^1$$
$$\frac{(I_m)_e}{I_m} = \left(\frac{M_{cr}}{M_a} \right)^3 + \left[1 - \left(\frac{M_{cr}}{M_a} \right)^3 \right] \frac{(I_m)_{cr}}{I_m}$$

where

$(I_m)_e$ = Effective moment of inertia of cracked masonry

(I_m) = Gross masonry moment of inertia

$(I_m)_{cr}$ = Cracked moment of inertia (based upon truss bar joint reinforcing steel)

M_a = Applied moment

M_{cr} = Cracking moment

¹Equation used to estimate effective moment of inertia, $(I_m)_e$, is adopted from ACI 318-77 (Equation 9-7, Section 9.5.2.3) for reinforced concrete.

March 8, 1982

CRACKED MOMENT OF INERTIA ($I_{m\ cr}$) OF ONE FOOT

WIDE HORIZONTAL STRIP OF HORIZONTALLY
REINFORCED HOLLOW MASONRY WALL

TYPE M Mortar;

$$f_m' = 1350 \text{ psi}; E_m = 1000 f_m'$$

t in	Reinf.	Jt. Reinf. Spa.	A _s /FT in ²	d in	Kd in	jd in	(I _m) cr in ⁴	I _m in ⁴	(I _m) cr I _m
6	Joint Reinf. 3/16" Diameter Truss or Ladder Type	4"	0.0828	4.625	1.032	4.281	27.38	130.3	0.2101
		8"	0.0414		0.758	4.373	15.05		0.1155
		16"	0.0207		0.549	4.442	8.05		0.0618
8		4"	0.0828	6.625	1.261	6.205	59.24	308.7	0.1919
		8"	0.0414		0.920	6.318	32.08		0.1039
		16"	0.0207		0.665	6.403	16.97		0.0550
12		4"	0.0828	10.625	1.635	10.080	161.36	929.4	0.1736
		8"	0.0414		1.183	10.231	85.98		0.0925
		16"	0.0207		0.851	10.341	44.94		0.0484




March 8, 1982

Comparison of $\frac{(I_m)_e}{I_m}$ for

a Hollow Concrete Masonry Wall

$f'_m = 1,350 \text{ psi}$, $M_o = 2,500 \text{ psi}$

$\frac{M_{cr}}{M_a}$	$\frac{(I_m)_{cr}}{I_m}$	$\frac{(I_m)_e}{I_m}$
0.9	0.22	0.789
	0.18	0.778
	0.12	0.761
	0.08	0.751
	0.04	0.740
0.7	0.22	0.487
	0.18	0.461
	0.12	0.422
	0.08	0.395
	0.04	0.369
0.5	0.22	0.317
	0.18	0.282
	0.12	0.230
	0.08	0.195
	0.04	0.160

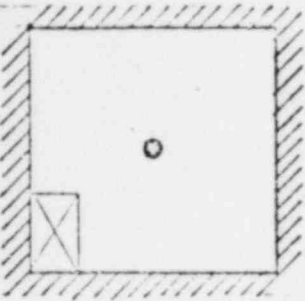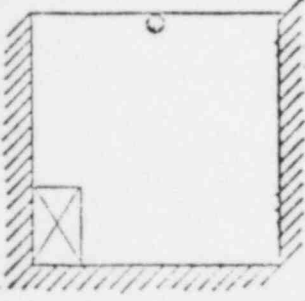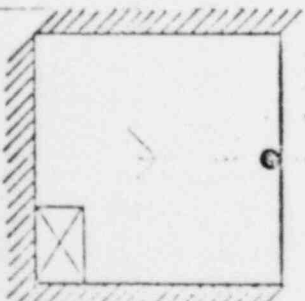Support Case	Type	Displacement (Inches)	
		Full $E I_m$	$1/5 E I_m$
	Mode 1	0.15970	0.23554
	Mode 2	0.00012	0.00014
	Mode 3	0.00000	0.00000
	Mode 4	0.00001	0.00014
	Mode 5	0.00298	0.00653
	Mode 6	0.00050	0.00002
	Mode 7	0.00008	0.00011
	Mode 8	0.00000	0.00000
	SRSS	0.15973	0.23563
	Mode 1	0.48266	0.53906
	Mode 2	0.03577	0.03387
	Mode 3	0.00008	0.00007
	Mode 4	0.00028	0.00295
	Mode 5	0.00365	0.00235
	Mode 6	0.00195	0.00228
	Mode 7	0.00043	0.00047
	Mode 8	0.00039	0.00007
	SRSS	0.48400	0.54014
	Mode 1	0.47807	0.53441
	Mode 2	0.03597	0.03393
	Mode 3	0.00004	0.00004
	Mode 4	0.00071	0.00369
	Mode 5	0.00300	0.00143
	Mode 6	0.00191	0.00229
	Mode 7	0.00057	0.00062
	Mode 8	0.00050	0.00001
	SRSS	0.47944	0.53551

MODAL DISPLACEMENTS FOR ASPECT RATIO 1.0



Designation: E 72 - 80

Standard Methods of CONDUCTING STRENGTH TESTS OF PANELS FOR BUILDING CONSTRUCTION¹

This standard is issued under the fixed designation E 72; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval.

INTRODUCTION

Sound engineering design of structures, using existing or new materials requires accurate technical data on the strength and rigidity of the basic elements employed in various construction systems. It is the purpose of these test methods to provide a systematic basis for obtaining engineering data on various construction elements and structural details of value to designers, builders, building officials, and others interested in this field. The results should closely approximate the performance in actual service.

1. Scope

1.1 These methods cover the following procedures for determining the structural properties of segments of wall, floor, and roof constructions:

Test Specimens
Loading
Deformation Measurements
Reports
Precision and Accuracy

TESTING WALLS

Significance
Compressive Load
Tensile Load
Transverse Load—Specimen Horizontal
Transverse Load—Specimen Vertical
Concentrated Load
Impact Load—See Methods E 695 and E 661
Racking Load—Evaluation of Sheathing Materials on a Standard Wood Frame
Racking Load—Evaluation of Sheathing Materials (Wet) on a Standard Wood Frame

TESTING FLOORS

Significance
Transverse Load
Concentrated Load
Impact Load—See Methods E 695 and E 661

TESTING ROOFS

Significance
Transverse Load
Concentrated Load

Section

19
20
21

APPENDIX

Technical Interpretation²
1.2 Metric units are to be considered as the primary standard units.
2. Applicable Documents
2.1 *ASTM Standards*:
E 4 Load Verification of Testing Machines²
E 73 Testing Truss Assemblies²
E 564 Static Load Test for Shear Resistance of Framed Walls for Buildings²
E 575 Recommended Practice for Reporting Data from Structural Tests of Building Constructions, Elements, Connections, and Assemblies²

¹ These methods are under the jurisdiction of ASTM Committee E-6 on Performance of Building Constructions and are the direct responsibility of Subcommittee E 06.12 on Structural Performance of Vertical Structures.

Current edition approved Nov. 6, 1980. Published March 1981. Originally published as E 72 - 47 T. Last previous edition E 72 - 77.

² *Annual Book of ASTM Standards*, Parts 10, 14, 32, 35, and 41.

³ *Annual Book of ASTM Standards*, Part 18.



E 661 Test for Performance of Wood and Wood-Based Floor and Roof Sheathing Under Concentrated Static and Impact Loads³

E 695 Measuring Relative Resistance of Wall, Floor, and Roof Constructions to Impact Loading⁴

3. Test Specimens

3.1 Size—The specimens shall be representative as to material and workmanship and shall be as large as practicable to minimize the effect of variations in the material and workmanship, in order to obtain results representative of the construction. Obviously, the size of the specimens shall be limited to the size that can be tested in the larger testing machines available in a well equipped laboratory, and which can be subjected to loads in accordance with good testing procedure, and for which the deformation can be measured with sufficient accuracy.

3.2 Length or Height—The length or height of specimen for each element shall be chosen to conform to the length or height of that element in actual use.

3.3 Width—The width of specimen shall be chosen, insofar as possible, to include several of the principal load-carrying members to ensure that the behavior under load will simulate that under service conditions. With the exception of specimens for the racking load test, the nominal width of wall specimens shall be 1.2 m (4 ft). The actual width of specimens shall be a whole number multiplied by the spacing of the principal load-carrying members except for prefabricated panels, for which the actual width shall be the width of panel used. If the structural properties of a particular construction are to be compared with another construction, there should not be a great difference in the actual widths of the specimens.

3.4 Age—Constructions, such as concrete and masonry (brick, structural clay tile, concrete block) for which the structural properties depend upon the age of the specimen, shall be tested not less than 25 days nor more than 31 days after fabrication. This age requirement applies also to plastered and stuccoed constructions.

4. Loading

4.1 Apparatus—The testing machine or load-measuring apparatus shall comply with

the requirements prescribed in Methods E 4.

4.2 Application of Load—Apply the load to all of the specimens in any test in increments so chosen that a sufficient number of readings will be obtained to determine definitely the load-deformation curve (see Section 6). Record the initial reading of the load and the reading of the deformation, either with no load on the specimen or under a small initial load. Increase the load to the first increment and record the deformation. Unless otherwise specified, decrease the load to the initial load and record the set (sometimes designated "permanent set"). Increase the load to two increments and record the set, when it is released to the initial load. Follow this sequence of readings for three increments, four increments, etc., of load. When for each specimen the behavior of the specimen under load indicates that the specimen might fail suddenly and damage the deformation-measuring apparatus, remove this apparatus from the specimen and increase the load continuously until the maximum load that can be applied to the specimen is determined.

4.3 Duration of Load Application—Except for racking tests, after each increment of load is applied, maintain the load level as constant as possible for a period of 5 min (see Note 1). Take deformation readings as soon as practical after load application, at the end of the 5-min period under constant load, and immediately and at the end of the 5-min period after any partial or complete load release. Plot initial and 5-min readings in the form of load-deformation curves. Maintain complete load-deformation-time records throughout the test. If application of a given load is required for a certain period, such as 24 h, take deformation readings at the beginning, at intervals during this period, and at the end of this period, to allow the satisfactory plotting of a time-deformation curve for the complete period.

NOTE 1—Reasons for the 5-min application of constant-level increment loads are as follows:

(1) To permit the assembly to come to a substantial rest prior to taking the second set of readings (Depending on the method employed for applying the test load, it may be necessary to continue, at a reduced rate, the motion of the loading device in order to maintain the constant load level during the 5-min period.)

(2) To provide sufficient time for making all observations. (Longer time intervals may be required under certain conditions.)

(3) To observe any time-dependent deformation

or load reduction. The load should not start to decrease and should remain constant under bearing on the specimen.

(4) To be able to determine the load level with sufficient accuracy.

(5) To avoid any possibility of damage to the specimen.

5. Deformation

5.1 Measurement—The deformation-measuring apparatus shall be of such design that it can be used on specimens of any size and shape. The deformation-measuring apparatus shall be placed on the specimen in such a manner that it will not damage the specimen or the apparatus.

6. Report

6.1 Summary—The report shall include a graphical representation of the load-deformation curve for all test specimens. The load-deformation curve shall be plotted on a grid with the load on the horizontal axis and the deformation on the vertical axis. The load-deformation curve shall be plotted on a grid with the load on the horizontal axis and the deformation on the vertical axis. The load-deformation curve shall be plotted on a grid with the load on the horizontal axis and the deformation on the vertical axis.

7. Precision

7.1 General—The precision of the test results shall be determined by the standard deviation of the test results.

TESTING WALLS

scribed in Methods E 4.

Load—Apply the load to in any test in increments sufficient number of readings to determine definitely the curve (see Section 6). Record the load and the reading either with no load on the small initial load. Increase increment and record the otherwise specified, define initial load and record designated "permanent load" to two increments and it is released to the initial sequence of readings for three increments, etc., of load. Observe the behavior of the specimen and damage the testing apparatus, remove the specimen and increase the load until the maximum load that the specimen is determined.

Load Application—Except for each increment of load, the load level as constant load of 5 min (see Note 1). Readings as soon as practical, at the end of the 5-min load, and immediately after the 5-min period after any load release. Plot initial and complete load-deformation curve without the test. If application required for a certain period, deformation readings at the intervals during this period, and record, to allow the satisfactory load-deformation curve for

for the 5-min application of load are as follows:

1. Immediately to come to a substantial second set of readings (Deflection) employed for applying the necessary to continue, at a reduced loading device in order to maintain load level during the 5-min

2. Sufficient time for making all observations intervals may be required (3.)

3. time-dependent deformation

or load redistribution, or both, and to record accurately the load level when time-dependent deformation starts, that is, at the divergence of the immediate and delayed load-deformation curves. This load level may, under certain conditions, have an important bearing on the design load.

(4) To be able to stop the test, if this should be desirable, prior to total failure, after initial failure has been anticipated as a result of the observations.

(5) To assure uniformity in test performance and consistency in test results.

5. Deformation Measurements

5.1 Measure the deformations with sufficient precision to define the load-deformation relationship, and report at least to the nearest 0.25 mm (0.01 in.). The deformation-measuring apparatus specified for any loading may be replaced by other apparatus, provided that it permits readings of deformation that are equivalent in accuracy to those from the specified apparatus.

6. Reports

6.1 Show the results of each of the tests graphically, as illustrated in Fig. 1. Plot loads as ordinates and the deformations as abscissas for all tests. There shall be at least three specimens for each test, and the results for each test shall be shown on the same graph. Show the points for deformation under load by open circles and those for set by solid circles. Average the three values for either the deformation or the set and plot this average value in pencil on the graph. Draw a smooth curve among the average points to show the average behavior of the construction. The load-deformation curves shall be continuous lines and the load-set curves shall be dashed lines. Although the particular specimen for each point on the graph is not designated, record it on the laboratory data sheets. If readings are obtained under greater loads for some specimens than for others, plot all the values, but draw the curves only to the average values for which there are three values.

6.2 Prepare the test report in accordance with Recommended Practice E 575.

7. Precision and Accuracy

7.1 No statement is made either on the precision or on the accuracy of these methods due to the variety of materials and combinations of materials involved.

8. Significance

8.1 The procedures described are those that will test the behavior of segments of wall construction under conditions representative of those encountered in service. Performance criteria based on data from those procedures can ensure structural adequacy and service life.

9. Compressive Load

9.1 **Test Specimens**—Tests shall be made on three like specimens, each having a height equal to the length of the element and a nominal width of 1.2 m (4 ft) (see Section 3).

9.2 **Apparatus**—The apparatus shall be assembled as shown in Fig. 2 and shall conform to the detailed requirements for component parts prescribed in 9.2.1 and 9.2.2, or the equivalent.

9.2.1 **Compressor**—A bracket shall be attached to the specimen near the upper end, supporting a mirror. A bracket shall also be attached to the specimen near the lower end, supporting a dial micrometer. The spindle up and the gage length shall be recorded. The conical end of the rod shall seat in a hole in the end of the spindle and the rod and spindle shall be held in contact by stretched rubber bands. The dial shall be graduated to 0.025 mm (0.001 in.).

9.2.2 **Deflectometer**—A fine wire shall be attached to a clamp near the upper end of the specimen. The free end connected to stretched rubber bands shall be attached to a clamp near the lower end of the specimen. A mirror having a paper scale one-half the width of the mirror shall be attached horizontally to the edge of the specimen at midheight. The scale shall be graduated to 2.5 mm (0.1 in.).

9.3 Procedure

9.3.1 **Loading**—Test the specimen as a column having a flat end at the bottom (Fig. 2). Apply compressive loads to a steel plate covering the upper end of the specimen. Apply the load uniformly along a line parallel to the inside face, and one-third the thickness of the specimen from the inside face. For wood construction, a rate of loading corresponding to a movement of the testing machine crosshead of nominally 0.8 mm/min (0.03 in./min) has been found satisfactory.

9.3.2 Load-Deformation Data—Attach four compressometers to the faces of the specimen, one near each corner of the specimen as shown in Fig. 2, to measure the shortening of the specimen. Record the readings to the nearest 0.025 mm (0.001 in.).

9.3.3 Lateral Deflection—Attach two deflectometers, one to each edge of the specimen, as shown in Fig. 2. Record the readings, when the image of the wire coincides with the wire, to the nearest 0.25 mm (0.01 in.).

9.4 Calculations and Report:

9.4.1 Deformation—For each compressometer, calculate the shortening under each load as the difference between the reading of the compressometer when the load is applied and the initial reading. Calculate the shortening of the specimen as the average of the shortenings for each of the four compressometers multiplied by the ratio: specimen length divided by the compressometer gage length. Obtain the sets in a similar manner.

9.4.2 Lateral Deflection—Calculate the lateral deflection and the lateral set under each load for each deflectometer as the difference between the reading of the deflectometer when the load is applied and the initial reading. Calculate the lateral deflection and lateral set for the specimen as the average of the lateral deflection and lateral set of the two deflectometers.

9.4.3 Data Presentation—Record the maximum load for each specimen and report the results of load-deformation and load-deflection measurements in the form of a graph in accordance with Section 6. Report gage lengths of all deflection or deformation gages.

10. Tensile Load

10.1 Test Specimens—Tests shall be made on three like specimens, each having a height equal to the length of the element and a nominal width of 1.2 m (4 ft) (see Section 3).

10.2 Apparatus—The apparatus preferably shall be assembled in a vertical testing machine and shall conform to the detailed requirements for component parts prescribed in 9.2.1 and 9.2.2, or the equivalent, with the exception that the compressometers prescribed in 9.2.1 shall be replaced by extensometers which shall be like the compressometers but so adjusted before

load is applied that the stretch of the specimen can be measured.

10.3 Procedure:

10.3.1 Loading—Test the specimen as a tension specimen by uniform application of tensile forces along the line of the fastenings at the top and the bottom of the wall in a building. The top and bottom pulling fixtures may be attached to the specimen by fastenings similar to those used in a building, provided that, under the maximum load, failure of the specimen occurs between the top and the bottom of the specimen, not in either the pulling fixtures or the fastenings. If, under the tensile load, failure occurs either in a pulling fixture or in a fastening, the results of the test determine only the properties of the fixtures or the fastenings, not of the wall construction. When the failure occurs in fastenings, the tensile load indicates the maximum tensile strength of the construction that can be realized in actual service unless improved fastenings are provided.

10.3.1.1 Masonry Constructions—The construction may be continued upward beyond the top of the specimen and downward below the bottom of the specimen to enclose attachments for the pulling fixtures.

10.3.1.2 Framed Wall Constructions—If the construction has studs (either of wood or metal) the studs may be extended upward and downward beyond the top and bottom of the specimen and attached to the pulling fixtures. If the framed wall has plates at the top and the bottom, attach the pulling fixtures to the plates in the specimen.

10.3.2 Load-Deformation Data—Attach four extensometers to the faces of the specimen, one near each corner, as shown in Fig. 2, to measure the stretch of the specimen. Record the readings to the nearest 0.025 mm (0.001 in.).

10.3.3 Lateral Deflection—Attach two deflectometers, one to each edge of the specimen, as shown in Fig. 2. Record the readings, when the image of the wire coincides with the wire, to the nearest 0.25 mm (0.01 in.). Lateral deflection (if any) may be caused by nonaxial loading of the specimen.

10.4 Calculations and Report—For tensile loads, the calculations and report shall be similar to those required for compressive loads (see 9.4).

ch of the specimen

specimen as a ten-
plication of tensile
astenings at the top
in a building. The
stures may be at-
astenings similar to
rovided that, under
e of the specimen
the bottom of the
pulling fixtures or
tensile load, failure
ixture or in a fasten-
determine only the
r the fastenings, not
When the failure oc-
le load indicates the
of the construction
actual service unless
rovided.

structions—The con-
d upward beyond the
downward below the
enclose attachments

Constructions—If the
her of wood or metal)
d upward and down-
bottom of the speci-
pulling fixtures. If the
the top and the bot-
tures to the plates in

tion Data—Attach
faces of the specimen,
is shown in Fig. 2, to
the specimen. Record
rest 0.025 mm (0.001

tion—Attach two de-
edge of the specimen.
ord the readings, when
oincides with the wire,
(0.01 in.). Lateral de-
e caused by nonaxial

d Report—For tensile
ind report shall be sim-
compressive loads (see

11. Transverse Load—Specimen Horizontal

11.1 *Test Specimens*—Tests shall be made on three like specimens on symmetrical assemblies and six like specimens on unsymmetrical assemblies, each having a length equal to the length of the element and a nominal width of 1.2 m (4 ft) (see Section 3).

11.2 *Apparatus*—The apparatus shall be assembled as shown in Fig. 3 and shall conform to the detailed requirements for component parts prescribed in 11.2.1 through 11.2.3, or the equivalent.

11.2.1 *Supports*—Two steel rollers with a steel plate between each supporting roller and the specimen.

11.2.2 *Loading Assembly*—Two steel rollers with a steel plate between each loading roller and the specimen.

11.2.3 *Deflection Gage*—A frame shall be placed on the upper face of the specimen. To prevent stresses deforming the frame as the specimen deforms under load, this frame shall rest on three hardened steel balls each supported by a steel block on the face of the specimen. Two of the balls shall be placed in a line vertically above one support and the third ball vertically above the other support. Two dial micrometers, one near each longitudinal edge of the specimen, shall be attached to the frame at midspan. The spindles shall rest on the upper face of the specimen. The micrometers shall be graduated to 0.025 mm (0.001 in.).

11.3 Procedure:

11.3.1 *Loading*—Use "two-point" loading for transverse load tests. Test the specimen as a simple beam (Fig. 3) on a span 150 mm (approximately 6 in.) less than the specimen length. Apply two equal loads, each at a distance of one quarter of the span from the supports, toward the middle of the span. For wall specimens tested horizontally (Fig. 3), the load on the specimen shall include the weight of specimen between the supports. Apply the transverse loads to the outside face for three of the specimens and to the inside face for three of the specimens. For symmetrical assemblies, test only three specimens.

11.3.1.1 Uniformly distributed loading may be used instead of quarter-point loading, if a satisfactory method is available. The transverse strength for any span may be greater for some constructions under uniformly distributed load

than under loads applied at the quarter-points of the span. Transverse load, uniformly distributed, may be applied by air pressure, or in a bag or in a chamber having the specimen as one face. Support specimens tested under uniform loading by rollers as for quarter-point loading.

11.3.1.2 The bag method of loading is shown schematically in Fig. 4. Connect a reaction platform parallel to the face to be loaded and wider than the specimen to the supports by tie rods. Place an airtight bag of rubberized cloth as wide as the specimen and as long as the span between the specimen and the reaction platform. Apply transverse load to the specimen by increasing the air pressure in the bag. Measure the pressure by means of a manometer. Water is usually the liquid in the manometer, but the specific gravity of the liquid shall be such that the error in pressure readings does not exceed 1 %.

11.3.1.3 When the chamber method of loading is used with the specimen horizontal, place the specimen near the floor, which should be practically airtight. An airtight frame or curb shall surround the specimen closely and be about flush with the upper surface of the specimen. A rubber blanket covers the specimen, overlaps the frame, and is sealed so that it is reasonably airtight. Use a small vacuum pump or positive action exhaust blower to reduce air pressure between the specimen and floor. Measure the difference in pressure above and below the specimen by means of a manometer.

11.3.2 *Strength on Short Span*—The transverse strength of any construction increases as the span is shortened. If the strength of the construction for a shorter span is desired, do not compute it, but test the construction on the short span.

11.4 Calculations and Report:

11.4.1 *Load-Deflection Data*—For each micrometer, calculate the deflection under a given load as the difference between the reading to the nearest division of the micrometer when the load is applied and the initial reading. Calculate the deflection of the specimen for the span as the average of the deflections obtained from each of the two micrometers. Calculate the sets under the initial load by using a similar method. Record the maximum load for each specimen.

11.4.2 *Data Presentation*—Report the results in the form of a graph in accordance with Section 6.

12. Transverse Load—Specimen Vertical

12.1 *Test Specimens*—Tests shall be made on three like specimens on symmetrical assemblies and six like specimens on unsymmetrical assemblies each having a length equal to the length of the element and a nominal width of 1.2 m (4 ft) (see Section 3).

12.2 *Apparatus*—The apparatus shall be assembled as shown in Fig. 3 and shall conform to the requirements for component parts prescribed in 12.2.1 through 12.2.5, or the equivalent.

12.2.1 *Steel Channel*.

12.2.2 *Rollers*—Cylindrical rollers, two supporting rollers, two loading rollers.

12.2.3 *Screw Jack*.

12.2.4 *Ring Dynamometer*.

12.2.5 *Deflectometers*—Two taut-wire mirror-scale deflectometers similar to those described in 9.2.2.

12.3 *Procedure*—Transverse loads cannot be applied satisfactorily to some wall constructions, such as masonry, with the specimen in a horizontal position. For such constructions, apply the loads with the specimen in a vertical position, as shown in Fig. 3, thus simulating service conditions. The specimen, on a steel channel, shall rest on cylindrical rollers to prevent restrained end conditions. The axes of the rollers shall be parallel to the faces of the specimen. The two supporting rollers shall be in contact with the vertical surface of the frame and each roller shall rest horizontally on sponge rubber about 10 mm (0.4 in.) thick to prevent longitudinal restraint. Each of the two loading rollers shall also rest on sponge rubber. Apply the loads horizontally by a screw jack and measure by a ring dynamometer between the jack and the specimen. The error in the load indicated by the dynamometer shall not exceed 1 %. Attach two taut-wire mirror-scale deflectometers to the specimen, one to each vertical edge.

12.3.1 Apply the transverse load to the outside face for three of the specimens, and to the inside face for three of the specimens. For symmetrical assemblies, test only three specimens.

12.3.2 When the Chamber method of loading is used with the specimen vertical, the specimen forms one face of an airtight chamber from which the air is exhausted. If all four edges of the specimen bear on the chamber, this loading determines the strength of the specimen as a plate supported at the four edges, not the transverse strength as defined in these methods.

12.3.3 If a specimen tested by the chamber method, either horizontally or vertically, has an airtight cavity, vent each cavity to the low-pressure face by a hole in the face of the specimen not less than 5 mm (0.2 in.) in diameter, located where it will least affect the transverse strength of the specimen.

12.4 *Calculations and Report*—Calculate the results of test and report as described in 11.4, and report deflectometer readings to the nearest 0.25 mm (0.01 in.).

13. Concentrated Load

13.1 *Test Specimens*—Concentrated load tests shall be made on each transverse specimen after the transverse load tests, the concentrated load being applied to the same face to which the transverse load was applied.

13.2 *Apparatus*—The apparatus shall be assembled as shown in Fig. 5 and shall conform to the requirements for component parts prescribed in 13.2.1 through 13.2.3, or the equivalent.

13.2.1 *Steel Bar*—Steel bar having a diameter of 25.4 mm (1 in.) and the edge of the face contacting the specimen rounded to a radius of 1.3 mm (0.05 in.).

13.2.2 *Depth Gage*—The depth gage shall consist of a dial micrometer graduated to 0.025 mm (0.001 in.) mounted on a three-legged support. The support shall be notched to permit placing the micrometer directly adjacent to the bar and shall be long enough to permit placing the supporting legs on undisturbed areas of the face of the specimen.

13.2.3 *Loading Device*—Any convenient means for applying a compressive load up to 5 kN (1100 lbf) and means for measuring the load within 1 %.

13.3 *Procedure*:

13.3.1 *Loading*—Place the entire specimen or portion of the specimen on a horizontal support and properly level. Place the steel bar on the face of the specimen at what is judged

ber Method of load-cummen vertical, the (an airtight chamber chausted. If all four ear on the chamber, strength of the spec-at the four edges, not as defined in these

sied by the chamber y or vertically, has an : cavity to the low- in the face of the mm (0.2 in.) in di- will least affect the specimen.

port—Calculate the as described in 11.4. adings to the nearest

Concentrated load ransverse specimen sts the concentrated same face to which plied. apparatus shall be as- 5 and shall conform omponent parts pre- 13.2.3, or the equiv-

bar having a diam- the edge of the face ounded to a radius of

ie depth gage shall r graduated to 0.025 a three-legged sup- y notched to permit ectly adjacent to the gh to permit placing isturbed areas of the

Any convenient ressive load up to 5 for measuring the

the entire specimen on on a horizontal . Place the steel bar n at what is judged

to be the weakest place and, also, at what is judged to be the strongest place. Apply a load vertically downward to the upper surface of the bar. Continue loading until maximum load or 4.45 kN (1000 lbf) is attained.

13.3.2 *Depth of Indentation*—Measure the depth of indentation, by means of the depth gage, and record the reading of the micrometer to the nearest 0.025 mm (0.001 in.).

13.4 *Calculations and Report*:

13.4.1 *Depth of Indentation*—Calculate the depth of indentation (set) after a given load has been applied and the bar removed to the nearest 0.025 mm (0.001 in.) as the difference between the depth for that load and the initial reading of the micrometer before a load has been applied to the specimen.

13.4.2 *Data Presentation*—Report the results in the form of a graph in accordance with Section 6.

14. Racking Load—Evaluation of Sheathing Materials on a Standard Wood Frame

NOTE 2—If the test objective is to measure the performance of the complete wall, Method E 564 is recommended.

14.1 *Scope*—This test method measures the resistance of panels, having a standard wood frame, and sheathed with sheet materials such as structural insulating board, plywood, gypsum board, transite, etc., to a racking load such as would be imposed by winds blowing on a wall oriented at 90° to the panel. It is intended to provide a reliable, uniform procedure for determining the resistance to racking load provided by these sheet materials as commonly employed in building construction. Since a standard frame is employed, the relative performance of the sheathing is the test objective.

14.1.1 This test is conducted with standardized framing, loading procedures, and method of measuring deflection, as detailed in the method to ensure reproducibility. Provision is made for following the sheathing manufacturers' recommendations for attaching the sheathing to the frame, and for reporting the behavior of the specimen over its entire range of use.

14.1.2 In applying the results, due allowance shall be made for any variation in construction details or test conditions from those in actual service.

14.2 Test Specimens:

14.2.1 *Size and Number*—The test specimen shall be 2.4 by 2.4 m (8 by 8 ft) and the framing shall be constructed as shown in Fig. 6 and a minimum of three panels of each construction shall be tested. It is the intent of this test procedure to evaluate the stiffening effect of the sheathing material; therefore, the frame shall be constructed as nearly like the frames shown in Fig. 6 as possible. Frames shall be newly constructed for each test. All individual framing members shall be continuous. The moisture content of framing material shall be between 12 and 15 % when the panel is fabricated, and shall not vary by more than 3 % from the initial moisture content when the panel is tested.

14.2.2 *Application of Sheathing*—The method of applying the sheathing shall be exactly as specified by the manufacturer. The spacing of fasteners shall be as recommended. Fasteners shall be driven through the sheathing into only the outside stud of each corner post shown in Fig. 6. The importance of the attachment of sheathing to the framing cannot be overemphasized. Slight differences in edge clearances, angle of fastener, and amounts of penetration of heads of fasteners into the sheathing have appreciable effects on the results of test. Unless otherwise specified, fasteners shall be driven perpendicular to the surface of the sheathing with the center of each fastener the specified distance from the edge of the sheathing. Fasteners shall be driven so that the head of the fastener contacts the surface of the sheathing but not so deep as to crush the surface, unless specified differently by the manufacturers.

14.3 *Apparatus*—The apparatus shall be assembled as shown in Fig. 7. Load shall be measured by means of a testing machine, or a dynamometer attached to cables that load the specimen, or in linkage with a hydraulic jack used to apply load. The essential parts of the testing apparatus, exclusive of the loading frame, are as described in 14.3.1 through 14.3.5.

14.3.1 *Base and Loading Frame*—The test panel shall be attached to a timber or steel plate that is in turn attached rigidly to the base of the loading frame in such a manner that when the panel is racked, the sheathing will not bear on the loading frame. This member may be of

any convenient cross section, but it shall be at least as long as the panel and not greater in width than the thickness of the frame, 89 mm (3½ in.). Means shall be provided to bolt or otherwise attach the sole plate of the panel firmly to this member. For illustrative purposes, two bolts are shown in Fig. 7. More may be used if required.

14.3.2 Hold-Down—A hold-down shall be provided as shown in Fig. 7 to overcome the tendency of one end of the panel to rise as the racking load is applied. Plates and rollers shall be provided between the test specimen and the hold-down so that the top of the specimen can deflect horizontally with respect to the bottom without unnecessary interference from the hold-down. Because the amount of tension in the rods of the hold-down may have an effect on the results of the test, nuts on the hold-down rods shall be tightened prior to load application so that the total force in each rod does not exceed 90 N (20 lbf) at the beginning of test as determined by previous calibration.

14.3.3 Loading Apparatus—Load shall be applied to the specimen through an 89 by 89-mm (3.5 by 3.5-in.) timber firmly bolted to the upper plates of the panel. Loading shall be a compressive force against the end of the timber attached to the upper plate. When a testing machine is used, pulleys and cables may be used to transmit the vertical movement of the tension head of the machine to the horizontal movement in the specimen.

14.3.4 Lateral Guides—Lateral guides shall be provided so that the specimen will deflect in a plane. The rollers should be bearing-supported to reduce friction to a minimum. The lateral guides shall be firmly attached to the loading frame. Plates for the rollers may be up to 300 mm (12 in.) in length as required.

14.3.5 Indicating Dials—Indicating dials, or scales and wires, shall be provided to measure the displacement of the different parts of the panel during test. The readings shall be recorded to the nearest 0.25 mm (0.01 in.). The locations of the dials shall be as shown in the lower left, lower right, and upper right corners of the side view of the test assembly in Fig. 7. The dial at the lower left, which is attached to the stud, measures any rotation of the panel, the dial at the lower right measures any slip-page of the panel, and the dial at the upper right measures the total of the other two plus

the deformation of the panel. Therefore, the horizontal deflection of the panel at any load is the reading of the dial at the upper right less the sum of the readings of the other two.

14.4 Procedure:

14.4.1 Loading—Apply the load continuously throughout test at a uniform rate of motion of the loading device used. The recommended speed of testing shall be such that the loading to 3.5 kN (790 lbf) total load shall be completed in not less than 2 min from the start of the test. The loading to 7.0 to 10.5 kN (1570 to 2360 lbf) total load and to failure shall employ the same rate of travel of the loading device as for the loading to 3.5 kN. Give the speed of testing used in the report of test.

14.4.2 Loading Procedure—Load the specimen in three stages to 3.5, 7.0, and 10.5 kN (790, 1570, and 2360 lbf) total load at a uniform rate.

14.4.2.1 To provide data to meet performance requirements, other values of total load may be included in the test procedure. Use the same rate of loading as for the loadings specified and indicate additional loadings evaluated and the results obtained in the report.

14.4.2.2 After the total load of 3.5 kN (790 lbf) is placed on the specimen, remove all of the load and any residual deflection (set) in the panel noted. Then load the specimen to 7.0 kN (1570 lbf) and again remove the load and note any additional set; after this increase the loading to 10.5 kN (2360 lbf), remove the load again, and note the set. Apply load continuously for each of the increment loads specified above and obtain load-deflection data. Obtain these data for at least each 900 N (200 lbf) of loading. Obtain deflections during the loading cycle and, if desired, during the unloading cycle as well.

14.4.2.3 After the specimen is loaded as specified to 3.5, 7.0, and 10.5 kN (790, 1570, and 2360 lbf) load it again to failure or until the total deflection of the panel becomes 100 mm (4 in.). Obtain readings of deflection for the same intervals of load as were used for the other loadings.

14.5 Calculations and Report:

14.5.1 Deformation—For each dial, or other measuring device, calculate the movement under each racking load as the difference between the readings when load is applied and the initial readings at the start of the test. Calculate set

panel. Therefore, the panel at any load at the upper right less of the other two.

ly the load continue a uniform rate of movement used. The recommended shall be such that the (lbf) total load shall be an 2 min from the start to 7.0 to 10.5 kN (1570 d and to failure shall of travel of the loading ng to 3.5 kN. Give the the report of test.

cedure—Load the speci- 3.5, 7.0, and 10.5 kN (lbf) total load at a uniform

data to meet perform- er values of total load test procedure. Use the s for the loadings speci- onal loadings evaluated d in the report.

ad of 3.5 kN (790 lbf) is n, remove all of the load action (set) in the panel specimen to 7.0 kN (1570 e the load and note any is increase the loading to move the load again, and ad continuously for each ds specified above and data. Obtain these data N (200 lbf) of loading. uring the loading cycle g the unloading cycle as

specimen is loaded as and 10.5 kN (790, 1570, again to failure or until f the panel becomes 100 eadings of deflection for load as were used for the

and Report:

—For each dial, or other calculate the movement un- as the difference between d is applied and the initial of the test. Calculate set

readings as the difference between the readings when the load is removed and the initial readings.

14.5.2 Data Presentation—Report the deflections at 3.5, 7.0, and 10.5 kN (790, 1570, and 2360 lbf) and the set after loading to these amounts. Present load-deflection curves obtained during loading to failure and to 3.5, 7.0, and 10.5 kN in the form of a graph as prescribed in Section 6. Include maximum load and any observations on the behavior of the panel during test and at failure. Express residual deflections (sets) as percentages of the deflections that produced the sets as well as in millimetres or inches. If the specimen fails, describe the visible failure. If the specimen has been subjected to any special conditioning prior to test, describe this treatment in detail. Describe in the report the sheathing used, the method of applying the sheathing, the type and spacing of fasteners, and the method and rate of loading employed.

15. Racking Load—Evaluation of Sheathing Materials (Wet) on a Standard Wood Frame

15.1 Scope—This test has been developed to simulate the degree of wetting possible during construction of a structure when, because of rain, the framing and sheathing may be wetted on one or both sides. Both sides of the wall panel are wetted because this represents the maximum exposure possible during the stage of construction before the structure is roofed.

15.2 Test Specimens—The test specimens shall conform in size and fabrication details to the requirements of 14.2.

15.3 Specimen Conditioning—Mount the fabricated test specimens or suspend them in a vertical position in such a manner as to prevent continuous immersion of the bottom edge of the specimen. Expose both sides of the test specimen to a water spray applied at or near the top along the entire length to ensure that the top of the specimen is being wetted. The spray shall have no jet action that cuts into the sheathing material, and the spray areas shall overlay sufficiently so that a continuous sheet of water flows down both surfaces of the specimen. Maintain the temperature of the water in the line to the spray nozzle at $24 \pm 3^\circ\text{C}$ ($75 \pm 5^\circ\text{F}$). Wet the specimens for a period of 6 h

and then allow to dry for a period of 18 h. Dry in laboratory air, preferably at a temperature of $24 \pm 3^\circ\text{C}$ ($75 \pm 5^\circ\text{F}$). Make no attempt to increase the air movement over the specimens by fans or blowers. Subject the test specimens to two complete wetting and drying cycles and then a third wetting cycle.

15.3.1 No more than 2 h shall elapse between the completion of the third wetting cycle and the start of the racking test.

15.4 Procedure—Test the specimens in accordance with the procedure described in 14.4.

15.5 Moisture Content Determination—After the racking test is completed, cut moisture samples from the sheathing material, and determine moisture content on a weight basis with the moisture content expressed as a percentage of the oven dry weight in accordance with 15.5.1. Preferably, take five moisture content samples at least 100 by 150 mm (4 by 6 in.) in size from each 1.2 by 2.4-m (4 by 8-ft) sheathing panel of the test specimen: one from the center of each sheathing panel at the top and bottom edges, one from midlength on each side, and one from the panel center. Weigh the moisture content samples immediately upon being cut from the test specimen to an accuracy of not less than $\pm 0.2\%$. Carefully remove all loose particles from the sample before weighing. Then dry the samples to constant weight in an oven at $103 \pm 2^\circ\text{C}$ ($217 \pm 4^\circ\text{F}$). If large amounts of volatile matter or substances other than free water are removed from the sheathing material by drying at $103 \pm 2^\circ\text{C}$, the sheathing material may be dried to constant weight at a lower temperature and the drying time and temperature given in the report.

15.5.1 Calculation—Calculate the moisture content as follows:

$$M = 100 [(W - F)/F]$$

where:

M = moisture content, %.

W = initial weight, and

F = final weight when oven dry.

15.6 Calculations and Report—The report shall include the racking test data as specified in 14.5. It shall also include the line temperature of the water sprayed on the test specimens; the air temperature and relative humidity during the drying portion of the cycle; and the location of the moisture content samples and the moisture content of each.



TESTING FLOORS

16. Significance

16.1 The procedures outlined will serve to evaluate the performance of floor segments under conditions representative of those sustained in service. Performance criteria based on data from these procedures can ensure structural adequacy and effective service.

17. Transverse Load

17.1 *Test Specimens*—Tests shall be made on three like specimens, each having a length equal to the length of the floor panel and a nominal width of 1.2 m (4 ft) (see Section 3).

17.2 *Apparatus*—The apparatus shall conform to the requirements of 11.2.

17.3 *Procedure*—Conduct the test in accordance with 11.3 on transverse load tests of walls, except apply the loads only to the upper (finish floor) face of the specimen. If practicable, test floor specimens in the horizontal position. If tested in the vertical position, conduct the test in accordance with 12.1 through 12.4 on transverse load tests on walls in the vertical position. If tested in the vertical position, deduct transverse load equal to the weight of the specimen from each recorded load to obtain the applied load on the specimen.

17.3.1 *Strength on Short Span*—The transverse strength of any floor construction increases as the span is shortened. If the strength of the construction for a shorter span is desired, do not compute it, but test the construction on the shorter span.

17.4 *Calculations and Report*—Report the results as indicated in 11.4.

18. Concentrated Load

18.1 *Test Specimens*—Tests shall be made on each of the transverse specimens after the transverse tests are completed.

18.2 *Apparatus*—The apparatus shall conform to the requirements of 13.2.

18.3 *Procedure*—Conduct the test in accordance with 13.3 on concentrated load tests on walls, except apply the loads only to the upper (finish floor) face of the specimen.

18.4 *Calculations and Report*—Report the results as indicated in 13.4.

TESTING ROOFS

19. Significance

19.1 These procedures will serve to evaluate performance of roof segments under simulated service conditions. Roof trusses shall be evaluated under Methods E 73.

20. Transverse Load

20.1 *Test Specimens*—Tests shall be made on three like specimens, each having a length equal to the length of the roof panel and a nominal width of 1.2 m (4 ft) (see Section 3).

20.2 *Apparatus*—The apparatus shall conform to the requirements of 11.2.

20.3 *Procedure*—Conduct the test in accordance with 11.3 on transverse load tests of walls, except normally apply the loads only to the upper (weatherproofed) face of the specimen. The transverse strength of a roof construction under loads acting outward may appear to be less than the strength under loads acting inward. For such constructions, apply loads acting outward to specimens.

20.3.1 *Strength on Short Span*—The transverse strength of any roof construction increases as the span decreases. If the strength of the construction for a shorter span is desired, do not compute it, but test the construction on the shorter span.

20.4 *Calculations and Report*—Report the results as indicated in 11.4.

21. Concentrated Load

21.1 *Test Specimens*—Tests shall be made on each of the transverse specimens after the transverse tests are completed.

21.2 *Apparatus*—The apparatus shall conform to the requirements of 13.2.

21.3 *Procedure*—Conduct the test in accordance with 13.3 on concentrated load tests of walls, except apply the loads only to the upper (weatherproofed) face of the specimen.

21.4 *Calculations and Report*—Report the results as indicated in 13.4.

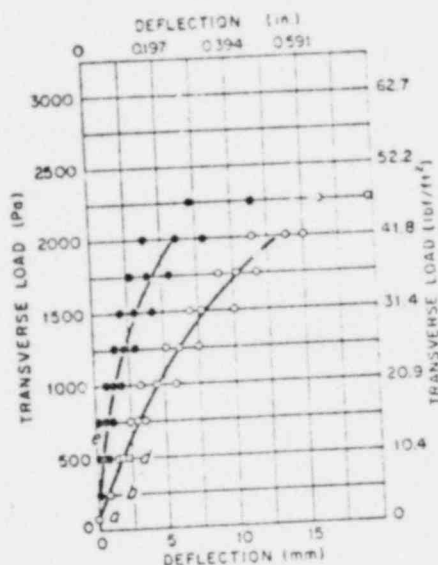


FIG. 1 Typical Graph Showing Results

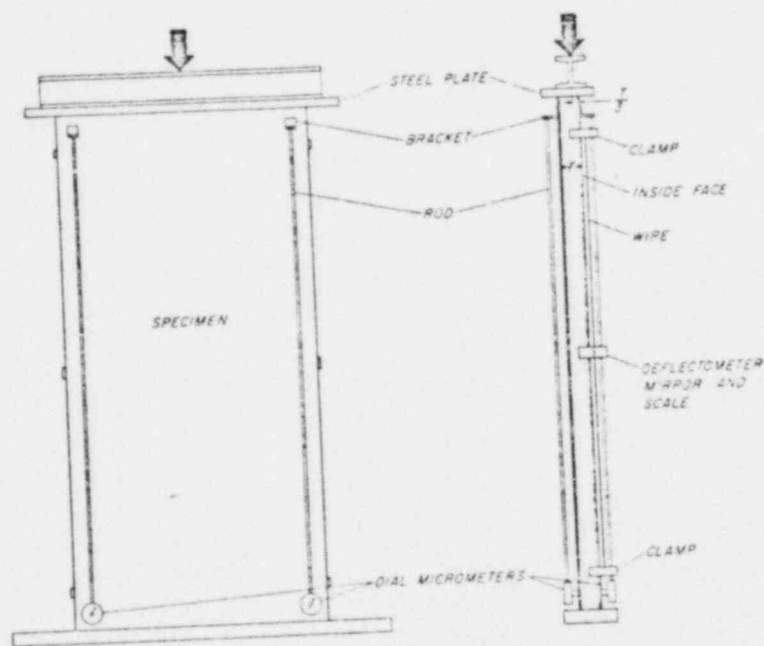


FIG. 2 Compressive Load Test on Wall Specimen

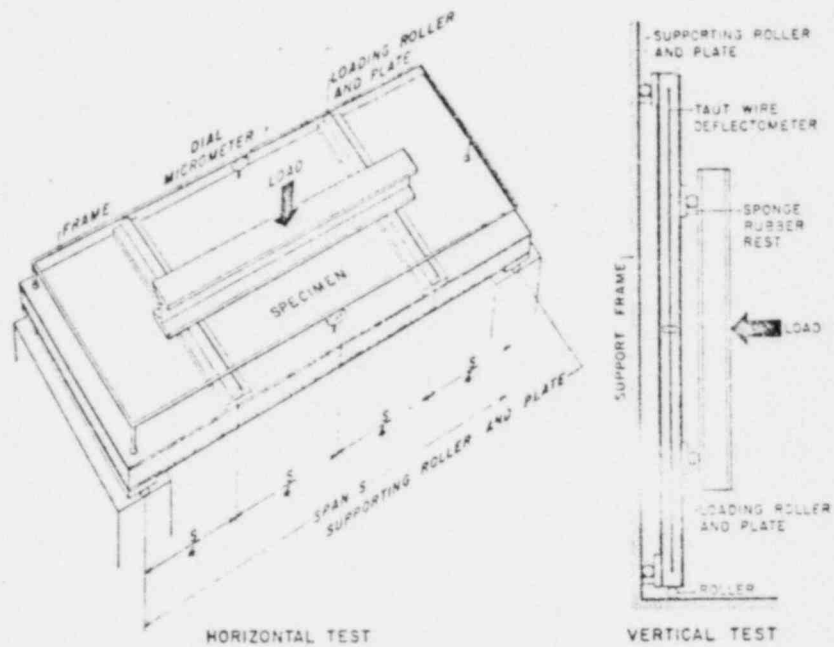


FIG. 3 Transverse Load Test on Wall Specimen

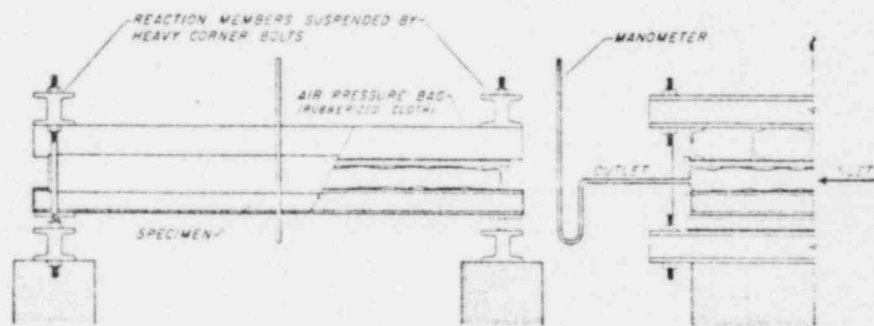


FIG. 4 Apparatus for Uniformly Distributed Transverse Load (Bag Method)

E 72

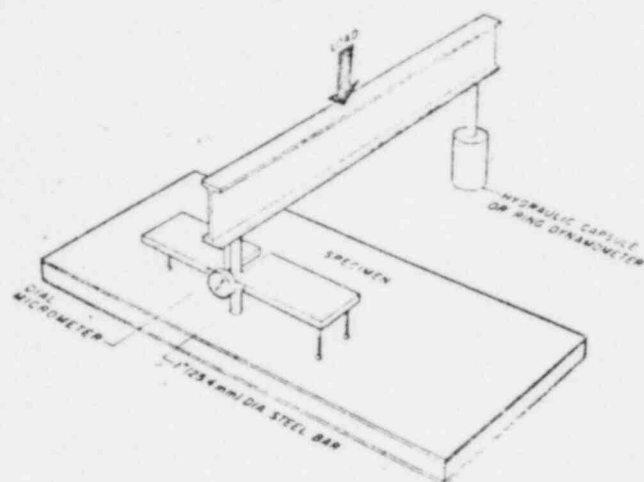


FIG. 5 Concentrated Load Test

WIRE ROLLER


WIRE
EXTENSOMETER

SPONGE
RUBBER
REST


LOAD

LOADING ROLLER
PLATE

TEST



od)

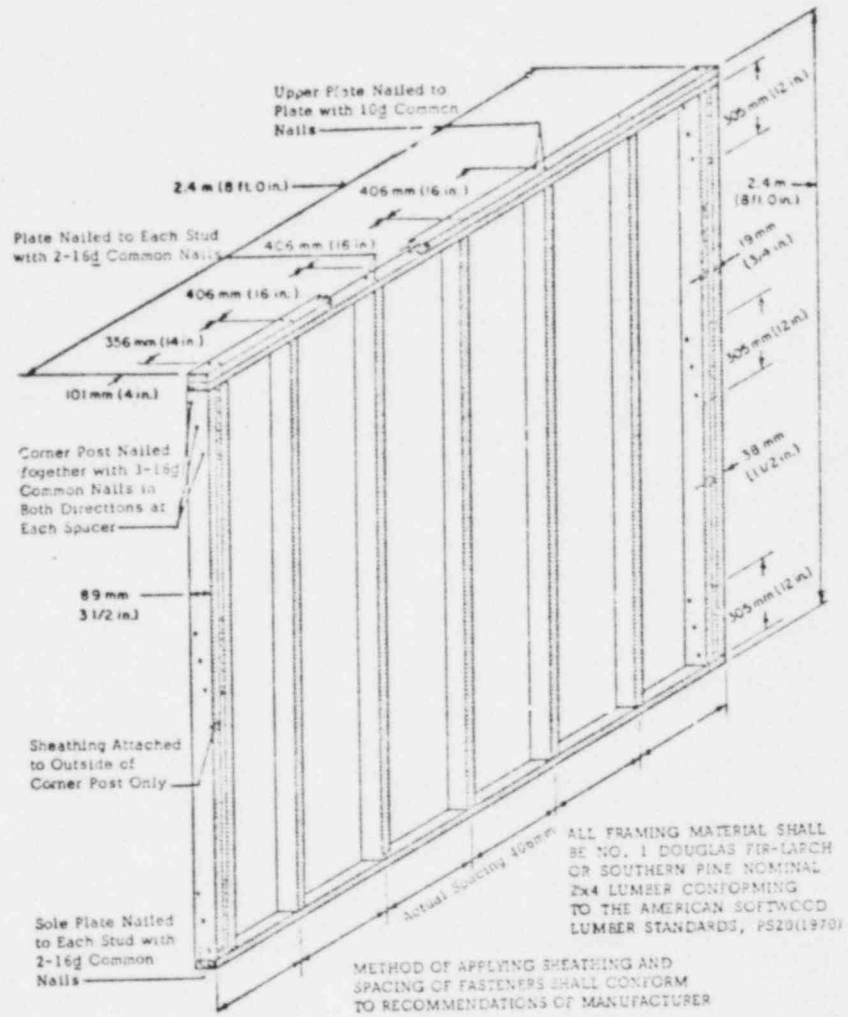

NOTE—To eliminate test data that may be misleading, use lumber of average density for the species involved.

FIG. 6 Standard Wood Frame

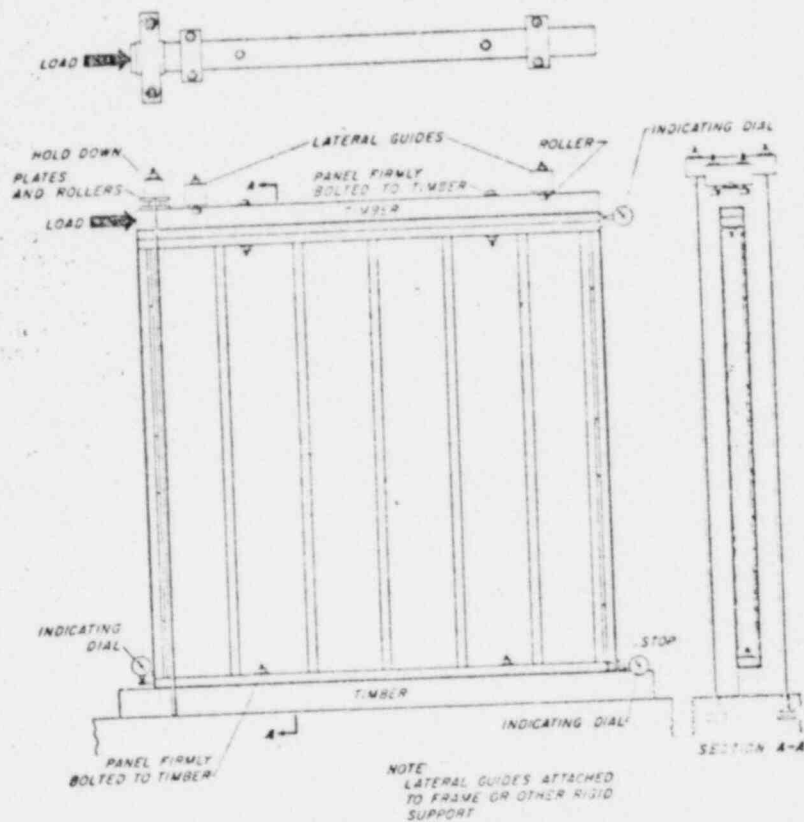


FIG. 7 Racking Load Assembly

APPENDIX (Non-Mandatory)

XI. TECHNICAL INTERPRETATION

XI.1 It is the purpose of these test methods to provide a systematic basis for obtaining comparable engineering data on various construction elements and structural details of value to designers, builders, building officials, and others interested in this field.

XI.2 Subjecting complete structures to known loads is very expensive and requires much time; therefore, that method of carrying out investigations to establish structural properties is not likely to be used to any great extent. Such tests have the further disadvantage that only the strength of the weakest elements of a particular structure could be measured.

XI.3 For these reasons, it seems more practicable to apply loads to specimens that accurately reproduce a structural portion of a finished building. These portions of a building have been designated as "elements", for example, floor, wall, roof, etc. For the procedure described in these methods, the elements

have been restricted to those most important structurally. For each element, methods of loading are described that simulate the loads to which the element would be subjected under service conditions. It is believed that the results of these measurements on the structural elements will be more useful to architects and engineers than the results of tests on specimens of the materials from which the structure was fabricated, or the results of tests of the individual structural members. Although it may be impracticable to determine all of the structural properties of each element of a building, it is believed that the more important properties may be determined by tests described in these methods.

XI.4 The test method, involving the application of the loads in increments and the concurrent measurement of deformation and set, simulates, to some extent, the conditions of repeated loading under ser-



vice conditions. Therefore, results by such a method of loading may be more useful than those obtained by increasing the load continuously throughout the test. The results from increment loading tests may show whether different portions of a construction act as a unit under load, whether the fastenings or bonds have adequate strength, or whether they rupture under repeated loads. For any engineering structure, including small houses, it is necessary not only that the strength be adequate, but also that the deformation under load shall not appreciably decrease the usefulness of the structure. If the working load and the allowable deformation for an element for a structure are known, constructions complying with these requirements may be selected by inspection of the graphs from tests of such constructions.

X1.5 A structure is elastic if, after a load has been

applied and then removed, the set is not appreciable. If the set is small for an element of a building, it may be assumed that the construction has neither been damaged nor appreciably deformed by the load. The set, therefore, is another property that may be used when comparing different constructions and may be useful when selecting a construction for a particular purpose.

X1.6 The variations in the properties of a construction as used commercially for buildings, in all probability, will be greater than the variations for the three specimens tested as directed in these methods because these specimens will be all fabricated at the same time by the same workmen and from the same lot of material. This fact should be clearly indicated in any general report based on these test procedures.

The American Society for Testing and Materials takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, 1916 Race St., Philadelphia, Pa. 19103, which will schedule a further hearing regarding your comments. Failing satisfaction there, you may appeal to the ASTM Board of Directors.