

ornl

NUREG/CR-0733
ORNL/NUREG/TM-304

OAK
RIDGE
NATIONAL
LABORATORY

UNION
CARBIDE

**PWR Blowdown Heat Transfer
Separate-Effects Program—
Thermal-Hydraulic Test
Facility Experimental Data
Report for Test 163**

V. D. Clemons
W. G. Craddick
R. M. Flanders

OPERATED BY
UNION CARBIDE CORPORATION
FOR THE UNITED STATES
DEPARTMENT OF ENERGY

Prepared for the U.S. Nuclear Regulatory Commission
Office of Nuclear Regulatory Research
Under Interagency Agreements DOE 40-551-75 and 40-552-75

8205030663

Printed in the United States of America. Available from
National Technical Information Service
U.S. Department of Commerce
5285 Port Royal Road, Springfield, Virginia 22161

Available from
GPO Sales Program
Division of Technical Information and Document Control
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof.

NUREG/CR-0733
ORNL/NUREG/TM-304
Dist. Category R2

Contract No. W-7405-eng-26

Engineering Technology Division

PWR BLOWDOWN HEAT TRANSFER SEPARATE-EFFECTS
PROGRAM - THERMAL-HYDRAULIC TEST FACILITY
EXPERIMENTAL DATA REPORT FOR TEST 163

V. D. Clemons W. G. Craddick R. M. Flanders

Manuscript Completed - May 5, 1980
Date Published - June 1980

NOTICE: This document contains information of a preliminary nature. It is subject to revision or correction and therefore does not represent a final report.

Prepared for the
U.S. Nuclear Regulatory Commission
Office of Nuclear Regulatory Research
Under Interagency Agreements DOE 40-551-75 and 40-552-75

NRC FIN No. B0125

Prepared by the
OAK RIDGE NATIONAL LABORATORY
Oak Ridge, Tennessee 37830
operated by
UNION CARBIDE CORPORATION
for the
DEPARTMENT OF ENERGY

CONTENTS

	<u>Page</u>
ACKNOWLEDGMENTS	xix
ABSTRACT	1
I. INTRODUCTION	1
II. SYSTEM, PROCEDURES, CONDITIONS, AND EVENTS FOR TEST 163	2
1. System Configuration and Test Procedure	2
2. Initial Test Conditions and Sequence of Events	4
III. DATA PRESENTATION	7
TABLES	
1. Desired vs actual prerupture conditions for test 163	4
2. Prerupture primary-coolant temperature and pressure distribution - test 163	5
3. Sequence of events during test 163	5
4. Precision of experimental measurements for test 163	12
5. Data presentation for test 163	13
FIGURES	
1. Thermal-Hydraulic Test Facility (THTF) - MOD1	3
2. Prerupture loop energy balance	6
3. Prerupture primary side heat exchanger summary	6
4. Prerupture secondary side heat exchanger summary	7
5. Identification of THTF heater rod and subchannel locations in bundles 1 and 2	8
6. Location of thermocouples in THTF bundle 1	9
7. THTF instrument identification and location	10
[Figures 8 through 507 are in microfiche at the back of this report.]	
8. TE-301AD, sheath thermocouple, rod 1, level D	
9. TE-304AD, sheath thermocouple, rod 4, level D	
10. TE-309AD, sheath thermocouple, rod 9, level D	
11. TE-310AD, sheath thermocouple, rod 10, level D	
12. TE-312AD, sheath thermocouple, rod 12, level D	
13. TE-313AD, sheath thermocouple, rod 13, level D	
14. TE-317AD, sheath thermocouple, rod 17, level D	

15. TE-318AD, sheath thermocouple, rod 18, level D
16. TE-320AD, sheath thermocouple, rod 20, level D
17. TE-322AD, sheath thermocouple, rod 22, level D
18. TE-323AD, sheath thermocouple, rod 23, level D
19. TE-325AD, sheath thermocouple, rod 25, level D
20. TE-326AD, sheath thermocouple, rod 26, level D
21. TE-331AD, sheath thermocouple, rod 31, level D
22. TE-338AD, sheath thermocouple, rod 38, level D
23. TE-339AD, sheath thermocouple, rod 39, level D
24. TE-341AD, sheath thermocouple, rod 41, level D
25. TE-349AD, sheath thermocouple, rod 49, level D
26. TE-301AE, sheath thermocouple, rod 1, level E
27. TE-304AE, sheath thermocouple, rod 4, level E
28. TE-309AE, sheath thermocouple, rod 9, level E
29. TE-312AE, sheath thermocouple, rod 12, level E
30. TE-313AE, sheath thermocouple, rod 13, level E
31. TE-317AE, sheath thermocouple, rod 17, level E
32. TE-318AE, sheath thermocouple, rod 18, level E
33. TE-320AE, sheath thermocouple, rod 20, level E
34. TE-322AE, sheath thermocouple, rod 22, level E
35. TE-323AE, sheath thermocouple, rod 23, level E
36. TE-324AE, sheath thermocouple, rod 24, level E
37. TE-325AE, sheath thermocouple, rod 25, level E
38. TE-326AE, sheath thermocouple, rod 26, level E
39. TE-331AE, sheath thermocouple, rod 31, level E
40. TE-333AE, sheath thermocouple, rod 33, level E
41. TE-338AE, sheath thermocouple, rod 38, level E
42. TE-339AE, sheath thermocouple, rod 39, level E
43. TE-341AE, sheath thermocouple, rod 41, level E
44. TE-349AE, sheath thermocouple, rod 49, level E
45. TE-301BF, sheath thermocouple, rod 1, level F
46. TE-304BF, sheath thermocouple, rod 4, level F
47. TE-309BF, sheath thermocouple, rod 9, level F
48. TE-310BF, sheath thermocouple, rod 10, level F

49. TE-312BF, sheath thermocouple, rod 12, level F
50. TE-313BF, sheath thermocouple, rod 13, level F
51. TE-317BF, sheath thermocouple, rod 17, level F
52. TE-320BF, sheath thermocouple, rod 20, level F
53. TE-322BF, sheath thermocouple, rod 22, level F
54. TE-323BF, sheath thermocouple, rod 23, level F
55. TE-324BF, sheath thermocouple, rod 24, level F
56. TE-325BF, sheath thermocouple, rod 25, level F
57. TE-326BF, sheath thermocouple, rod 26, level F
58. TE-331BF, sheath thermocouple, rod 31, level F
59. TE-333BF, sheath thermocouple, rod 33, level F
60. TE-338BF, sheath thermocouple, rod 38, level F
61. TE-341BF, sheath thermocouple, rod 41, level F
62. TE-349BF, sheath thermocouple, rod 49, level F
63. TE-301BG, sheath thermocouple, rod 1, level G
64. TE-304BG, sheath thermocouple, rod 4, level G
65. TE-309BG, sheath thermocouple, rod 9, level G
66. TE-310BG, sheath thermocouple, rod 10, level G
67. TE-312BG, sheath thermocouple, rod 12, level G
68. TE-313BG, sheath thermocouple, rod 13, level G
69. TE-317BG, sheath thermocouple, rod 17, level G
70. TE-318BG, sheath thermocouple, rod 18, level G
71. TE-320BG, sheath thermocouple, rod 20, level G
72. TE-322BG, sheath thermocouple, rod 22, level G
73. TE-323BG, sheath thermocouple, rod 23, level G
74. TE-325BG, sheath thermocouple, rod 25, level G
75. TE-326BG, sheath thermocouple, rod 26, level G
76. TE-331BG, sheath thermocouple, rod 31, level G
77. TE-333BG, sheath thermocouple, rod 33, level G
78. TE-338BG, sheath thermocouple, rod 38, level G
79. TE-339BG, sheath thermocouple, rod 39, level G
80. TE-341BG, sheath thermocouple, rod 41, level G
81. TE-349BG, sheath thermocouple, rod 49, level G
82. TE-301CH, sheath thermocouple, rod 1, level H

83. TE-302AH, sheath thermocouple, rod 2, level H
84. TE-303AH, sheath thermocouple, rod 3, level H
85. TE-304CH, sheath thermocouple, rod 4, level H
86. TE-305AH, sheath thermocouple, rod 5, level H
87. TE-306AH, sheath thermocouple, rod 6, level H
88. TE-307AH, sheath thermocouple, rod 7, level H
89. TE-308AH, sheath thermocouple, rod 8, level H
90. TE-309CH, sheath thermocouple, rod 9, level H
91. TE-310CH, sheath thermocouple, rod 10, level H
92. TE-311AH, sheath thermocouple, rod 11, level H
93. TE-312CH, sheath thermocouple, rod 12, level H
94. TE-313CH, sheath thermocouple, rod 13, level H
95. TE-314AH, sheath thermocouple, rod 14, level H
96. TE-315AH, sheath thermocouple, rod 15, level H
97. TE-316AH, sheath thermocouple, rod 16, level H
98. TE-317CH, sheath thermocouple, rod 17, level H
99. TE-318CH, sheath thermocouple, rod 18, level H
100. TE-320CH, sheath thermocouple, rod 20, level H
101. TE-321AH, sheath thermocouple, rod 21, level H
102. TE-322CH, sheath thermocouple, rod 22, level H
103. TE-323CH, sheath thermocouple, rod 23, level H
104. TE-324CH, sheath thermocouple, rod 24, level H
105. TE-325CH, sheath thermocouple, rod 25, level H
106. TE-326CH, sheath thermocouple, rod 26, level H
107. TE-327AH, sheath thermocouple, rod 27, level H
108. TE-331CH, sheath thermocouple, rod 31, level H
109. TE-333CH, sheath thermocouple, rod 33, level H
110. TE-336AH, sheath thermocouple, rod 36, level H
111. TE-337AH, sheath thermocouple, rod 37, level H
112. TE-338CH, sheath thermocouple, rod 38, level H
113. TE-339CH, sheath thermocouple, rod 39, level H
114. TE-341CH, sheath thermocouple, rod 41, level H
115. TE-342AH, sheath thermocouple, rod 42, level H
116. TE-343AH, sheath thermocouple, rod 43, level H

117. TE-344AH, sheath thermocouple, rod 44, level H
118. TE-345AH, sheath thermocouple, rod 45, level H
119. TE-346AH, sheath thermocouple, rod 46, level H
120. TE-348AH, sheath thermocouple, rod 48, level H
121. TE-349CH, sheath thermocouple, rod 49, level H
122. TE-301CI, sheath thermocouple, rod 1, level I
123. TE-302AI, sheath thermocouple, rod 2, level I
124. TE-303AI, sheath thermocouple, rod 3, level I
125. TE-304CI, sheath thermocouple, rod 4, level I
126. TE-305AI, sheath thermocouple, rod 5, level I
127. TE-306AI, sheath thermocouple, rod 6, level I
128. TE-307AI, sheath thermocouple, rod 7, level I
129. TE-308AI, sheath thermocouple, rod 8, level I
130. TE-309CI, sheath thermocouple, rod 9, level I
131. TE-310CI, sheath thermocouple, rod 10, level I
132. TE-311AI, sheath thermocouple, rod 11, level I
133. TE-312CI, sheath thermocouple, rod 12, level I
134. TE-313CI, sheath thermocouple, rod 13, level I
135. TE-314AI, sheath thermocouple, rod 14, level I
136. TE-315AI, sheath thermocouple, rod 15, level I
137. TE-316AI, sheath thermocouple, rod 16, level I
138. TE-317CI, sheath thermocouple, rod 17, level I
139. TE-318CI, sheath thermocouple, rod 18, level I
140. TE-320CI, sheath thermocouple, rod 20, level I
141. TE-321AI, sheath thermocouple, rod 21, level I
142. TE-322CI, sheath thermocouple, rod 22, level I
143. TE-323CI, sheath thermocouple, rod 23, level I
144. TE-324CI, sheath thermocouple, rod 24, level I
145. TE-325CI, sheath thermocouple, rod 25, level I
146. TE-326CI, sheath thermocouple, rod 26, level I
147. TE-327AI, sheath thermocouple, rod 27, level I
148. TE-328AI, sheath thermocouple, rod 28, level I
149. TE-331CI, sheath thermocouple, rod 31, level I
150. TE-333CI, sheath thermocouple, rod 33, level I

151. TE-336AI, sheath thermocouple, rod 36, level I
152. TE-337AI, sheath thermocouple, rod 37, level I
153. TE-338CI, sheath thermocouple, rod 38, level I
154. TE-339CI, sheath thermocouple, rod 39, level I
155. TE-341CI, sheath thermocouple, rod 41, level I
156. TE-342AI, sheath thermocouple, rod 42, level I
157. TE-343AI, sheath thermocouple, rod 43, level I
158. TE-344AI, sheath thermocouple, rod 44, level I
159. TE-345AI, sheath thermocouple, rod 45, level I
160. TE-346AI, sheath thermocouple, rod 46, level I
161. TE-348AI, sheath thermocouple, rod 48, level I
162. TE-349CI, sheath thermocouple, rod 49, level I
163. TE-301DJ, sheath thermocouple, rod 1, level J
164. TE-302CJ, sheath thermocouple, rod 2, level J
165. TE-304DJ, sheath thermocouple, rod 4, level J
166. TE-305CJ, sheath thermocouple, rod 5, level J
167. TE-306CJ, sheath thermocouple, rod 6, level J
168. TE-307CJ, sheath thermocouple, rod 7, level J
169. TE-308CJ, sheath thermocouple, rod 8, level J
170. TE-309DJ, sheath thermocouple, rod 9, level J
171. TE-310DJ, sheath thermocouple, rod 10, level J
172. TE-312DJ, sheath thermocouple, rod 12, level J
173. TE-313DJ, sheath thermocouple, rod 13, level J
174. TE-314CJ, sheath thermocouple, rod 14, level J
175. TE-316CJ, sheath thermocouple, rod 16, level J
176. TE-317DJ, sheath thermocouple, rod 17, level J
177. TE-318DJ, sheath thermocouple, rod 18, level J
178. TE-320DJ, sheath thermocouple, rod 20, level J
179. TE-321CJ, sheath thermocouple, rod 21, level J
180. TE-322DJ, sheath thermocouple, rod 22, level J
181. TE-323DJ, sheath thermocouple, rod 23, level J
182. TE-324DJ, sheath thermocouple, rod 24, level J
183. TE-325DJ, sheath thermocouple, rod 25, level J
184. TE-326DJ, sheath thermocouple, rod 26, level J

185. TE-327CJ, sheath thermocouple, rod 27, level J
186. TE-328CJ, sheath thermocouple, rod 28, level J
187. TE-331DJ, sheath thermocouple, rod 31, level J
188. TE-333DJ, sheath thermocouple, rod 33, level J
189. TE-336CJ, sheath thermocouple, rod 36, level J
190. TE-337CJ, sheath thermocouple, rod 37, level J
191. TE-338DJ, sheath thermocouple, rod 38, level J
192. TE-339DJ, sheath thermocouple, rod 39, level J
193. TE-340CJ, sheath thermocouple, rod 40, level J
194. TE-341DJ, sheath thermocouple, rod 41, level J
195. TE-342CJ, sheath thermocouple, rod 42, level J
196. TE-343CJ, sheath thermocouple, rod 43, level J
197. TE-344CJ, sheath thermocouple, rod 44, level J
198. TE-345CJ, sheath thermocouple, rod 45, level J
199. TE-346CJ, sheath thermocouple, rod 46, level J
200. TE-349DJ, sheath thermocouple, rod 49, level J
201. TE-301DK, sheath thermocouple, rod 1, level K
202. TE-304DK, sheath thermocouple, rod 4, level K
203. TE-309DK, sheath thermocouple, rod 9, level K
204. TE-310DK, sheath thermocouple, rod 10, level K
205. TE-312DK, sheath thermocouple, rod 12, level K
206. TE-313DK, sheath thermocouple, rod 13, level K
207. TE-317DK, sheath thermocouple, rod 17, level K
208. TE-318DK, sheath thermocouple, rod 18, level K
209. TE-320DK, sheath thermocouple, rod 20, level K
210. TE-322DK, sheath thermocouple, rod 22, level K
211. TE-323DK, sheath thermocouple, rod 23, level K
212. TE-324DK, sheath thermocouple, rod 24, level K
213. TE-325DK, sheath thermocouple, rod 25, level K
214. TE-326DK, sheath thermocouple, rod 26, level K
215. TE-331DK, sheath thermocouple, rod 31, level K
216. TE-333DK, sheath thermocouple, rod 33, level K
217. TE-338DK, sheath thermocouple, rod 38, level K
218. TE-339DK, sheath thermocouple, rod 39, level K

- 219. TE-341DK, sheath thermocouple, rod 41, level K
- 220. TE-349DK, sheath thermocouple, rod 49, level K
- 221. TE-301EL, sheath thermocouple, rod 1, level L
- 222. TE-302CL, sheath thermocouple, rod 2, level L
- 223. TE-303CL, sheath thermocouple, rod 3, level L
- 224. TE-304EL, sheath thermocouple, rod 4, level L
- 225. TE-305CL, sheath thermocouple, rod 5, level L
- 226. TE-306CL, sheath thermocouple, rod 6, level L
- 227. TE-307CL, sheath thermocouple, rod 7, level L
- 228. TE-308CL, sheath thermocouple, rod 8, level L
- 229. TE-309EL, sheath thermocouple, rod 9, level L
- 230. TE-310EL, sheath thermocouple, rod 10, level L
- 231. TE-311CL, sheath thermocouple, rod 11, level L
- 232. TE-312EL, sheath thermocouple, rod 12, level L
- 233. TE-313EL, sheath thermocouple, rod 13, level L
- 234. TE-316CL, sheath thermocouple, rod 16, level L
- 235. TE-317EL, sheath thermocouple, rod 17, level L
- 236. TE-318EL, sheath thermocouple, rod 18, level L
- 237. TE-320EL, sheath thermocouple, rod 20, level L
- 238. TE-321CL, sheath thermocouple, rod 21, level L
- 239. TE-322EL, sheath thermocouple, rod 22, level L
- 240. TE-323EL, sheath thermocouple, rod 23, level L
- 241. TE-324EL, sheath thermocouple, rod 24, level L
- 242. TE-325EL, sheath thermocouple, rod 25, level L
- 243. TE-326EL, sheath thermocouple, rod 26, level L
- 244. TE-327CL, sheath thermocouple, rod 27, level L
- 245. TE-328CL, sheath thermocouple, rod 28, level L
- 246. TE-331EL, sheath thermocouple, rod 31, level L
- 247. TE-333EL, sheath thermocouple, rod 33, level L
- 248. TE-336CL, sheath thermocouple, rod 36, level L
- 249. TE-337CL, sheath thermocouple, rod 37, level L
- 250. TE-338EL, sheath thermocouple, rod 38, level L
- 251. TE-339EL, sheath thermocouple, rod 39, level L
- 252. TE-341EL, sheath thermocouple, rod 41, level L

- 253. TE-342CL, sheath thermocouple, rod 42, level L
- 254. TE-343CL, sheath thermocouple, rod 43, level L
- 255. TE-344CL, sheath thermocouple, rod 44, level L
- 256. TE-345CL, sheath thermocouple, rod 45, level L
- 257. TE-346CL, sheath thermocouple, rod 46, level L
- 258. TE-348CL, sheath thermocouple, rod 48, level L
- 259. TE-349EL, sheath thermocouple, rod 49, level L
- 260. TE-301EM, sheath thermocouple, rod 1, level M
- 261. TE-304EM, sheath thermocouple, rod 4, level M
- 262. TE-309EM, sheath thermocouple, rod 9, level M
- 263. TE-325EM, sheath thermocouple, rod 25, level M
- 264. TE-301FN, sheath thermocouple, rod 1, level N
- 265. TE-304FN, sheath thermocouple, rod 4, level N
- 266. TE-325FN, sheath thermocouple, rod 25, level N
- 267. TE-301FO, sheath thermocouple, rod 1, level O
- 268. TE-304FO, sheath thermocouple, rod 4, level O
- 269. TE-309FO, sheath thermocouple, rod 9, level O
- 270. TE-310EO, sheath thermocouple, rod 10, level O
- 271. TE-312EO, sheath thermocouple, rod 12, level O
- 272. TE-317EO, sheath thermocouple, rod 17, level O
- 273. TE-318EO, sheath thermocouple, rod 18, level O
- 274. TE-320EO, sheath thermocouple, rod 20, level O
- 275. TE-322EO, sheath thermocouple, rod 22, level O
- 276. TE-323EO, sheath thermocouple, rod 23, level O
- 277. TE-324EO, sheath thermocouple, rod 24, level O
- 278. TE-325FO, sheath thermocouple, rod 25, level O
- 279. TE-326EO, sheath thermocouple, rod 26, level O
- 280. TE-331EO, sheath thermocouple, rod 31, level O
- 281. TE-333EO, sheath thermocouple, rod 33, level O
- 282. TE-338EO, sheath thermocouple, rod 38, level O
- 283. TE-339EO, sheath thermocouple, rod 39, level O
- 284. TE-341EO, sheath thermocouple, rod 41, level O
- 285. TE-349EO, sheath thermocouple, rod 49, level O
- 286. TE-301ME, middle thermocouple, rod 1, level E

287. TE-304ME, middle thermocouple, rod 4, level E
288. TE-318ME, middle thermocouple, rod 18, level E
289. TE-322ME, middle thermocouple, rod 22, level E
290. TE-326ME, middle thermocouple, rod 26, level E
291. TE-331ME, middle thermocouple, rod 31, level E
292. TE-338ME, middle thermocouple, rod 38, level E
293. TE-349ME, middle thermocouple, rod 49, level E
294. TE-301MF, middle thermocouple, rod 1, level F
295. TE-304MF, middle thermocouple, rod 4, level F
296. TE-322MF, middle thermocouple, rod 22, level F
297. TE-326MF, middle thermocouple, rod 26, level F
298. TE-338MF, middle thermocouple, rod 38, level F
299. TE-349MF, middle thermocouple, rod 49, level F
300. TE-301MG, middle thermocouple, rod 1, level G
301. TE-310MG, middle thermocouple, rod 10, level G
302. TE-313MG, middle thermocouple, rod 13, level G
303. TE-317MG, middle thermocouple, rod 17, level G
304. TE-318MG, middle thermocouple, rod 18, level G
305. TE-322MG, middle thermocouple, rod 22, level G
306. TE-323MG, middle thermocouple, rod 23, level G
307. TE-325MG, middle thermocouple, rod 25, level G
308. TE-326MG, middle thermocouple, rod 26, level G
309. TE-338MG, middle thermocouple, rod 38, level G
310. TE-349MG, middle thermocouple, rod 49, level G
311. TE-304MH, middle thermocouple, rod 4, level H
312. TE-309MH, middle thermocouple, rod 9, level H
313. TE-318MH, middle thermocouple, rod 18, level H
314. TE-322MH, middle thermocouple, rod 22, level H
315. TE-338MH, middle thermocouple, rod 38, level H
316. TE-301MJ, middle thermocouple, rod 1, level J
317. TE-310MJ, middle thermocouple, rod 10, level J
318. TE-317MJ, middle thermocouple, rod 17, level J
319. TE-323MJ, middle thermocouple, rod 23, level J
320. TE-324MJ, middle thermocouple, rod 24, level J

321. TE-326MJ, middle thermocouple, rod 26, level J
322. TE-338MJ, middle thermocouple, rod 38, level J
323. TE-162, test section inlet line thermocouple
324. TE-150, test section bottom flange thermocouple
325. TE-151, test section bottom flange thermocouple
326. TE-152, test section bottom flange thermocouple
327. TE-153, test section bottom flange thermocouple
328. TE-175, bundle shroud thermocouple, .142L/LMAX
329. TE-176, bundle shroud thermocouple, .142L/LMAX
330. TE-177, bundle shroud thermocouple, .142L/LMAX
331. TE-178, bundle shroud thermocouple, .142L/LMAX
332. TE-179, bundle shroud thermocouple, .388L/LMAX
333. TE-180, bundle shroud thermocouple, .388L/LMAX
334. TE-181, bundle shroud thermocouple, .388L/LMAX
335. TE-182, bundle shroud thermocouple, .388L/LMAX
336. TE-183, bundle shroud thermocouple, .633L/LMAX
337. TE-184, bundle shroud thermocouple, .633L/LMAX
338. TE-185, bundle shroud thermocouple, .633L/LMAX
339. TE-186, bundle shroud thermocouple, .633L/LMAX
340. TE-187, bundle shroud thermocouple, .875L/LMAX
341. TE-189, bundle shroud thermocouple, .875L/LMAX
342. TE-190, bundle shroud thermocouple, .875L/LMAX
343. TE-212, test section outlet line thermocouple
344. TE-30B, heat exchanger A outlet thermocouple
345. TE-32B, heat exchanger B outlet thermocouple
346. TE-34B, heat exchanger C outlet thermocouple
347. TE-5203, RBT 4-in. demineralized water header thermocouple
348. TE-5B, heat exchanger D outlet thermocouple
349. TE-1, pressurizer tank top thermocouple
350. TE-2, pressurizer tank exit thermocouple
351. TE-29, inlet blowdown plenum thermocouple
352. TE-45, outlet blowdown plenum thermocouple
353. TE-4B, base primary steady-state temperature, RTD

- 354. FE-620, HX B secondary cooling-water flow
- 355. FE-720, HX C secondary cooling-water flow
- 356. FE-550, HX D secondary cooling-water flow
- 357. FE-1A, primary side pump flow
- 358. FE-19, turbine flowmeter, horizontal inlet spool piece
- 359. DE-20, gamma densitometer, horizontal inlet spool piece
- 360. PE-26, transient pressure, horizontal inlet spool piece
- 361. FMFE-22, drag disk, horizontal inlet spool piece
- 362. PDE-21, transient DP, horizontal inlet spool piece
- 363. TE-24, thermocouple, horizontal inlet spool piece
- 364. FE-166, turbine flowmeter, vertical inlet spool piece
- 365. DE-168, gamma densitometer, vertical inlet spool piece
- 366. PDE-204, transient DP between vertical spool pieces
- 367. FMFE-170, drag disk, vertical outlet spool piece
- 368. PDE-167, transient DP, vertical inlet spool piece
- 369. TE-172, thermocouple, vertical inlet spool piece
- 370. FE-216, turbine flowmeter, vertical outlet spool piece
- 371. DE-218, gamma densitometer, vertical outlet spool piece
- 372. Zero calibration input, channels 0-127, gain 0
- 373. FMFE-220, drag disk, vertical outlet spool piece
- 374. PDE-217, transient DP, vertical outlet spool piece
- 375. TE-222, thermocouple, vertical outlet spool piece
- 376. FE-34, turbine flowmeter, horizontal outlet spool piece
- 377. DE-36, gamma densitometer, horizontal outlet spool piece
- 378. PE-42, transient pressure, horizontal outlet spool piece
- 379. FMFE-38, drag disk, horizontal outlet spool piece
- 380. PDE-35, transient DP, horizontal outlet spool piece
- 381. TE-40, thermocouple, horizontal outlet spool piece
- 382. PE-156, test section inlet plenum transient pressure
- 383. PE-201, test section outlet plenum transient pressure
- 384. PE-44, upstream main HX transient pressure
- 385. PE-76, primary pump suction transient pressure
- 386. PT-102, pressurizer steady-state pressure
- 387. PE-106, pressurizer vapor transient pressure

- 388. PE-412, pressure suppression receiver transient pressure
- 389. TE-615, demineralized water 6-in. header steady-state temp.
- 390. PDT-199, test section shroud box steady-state DP
- 391. PDE-200, test bundle transient DP
- 392. TE-627, HX B secondary discharge steady-state temp., RTD
- 393. PDT-48, main HX steady-state DP
- 394. PDE-78, primary pump transient DP
- 395. PE-425, PSS inlet blowdown line transient pressure
- 396. PE-427, PSS outlet blowdown line transient pressure
- 397. TE-727, HX C secondary discharge steady-state temp., RTD
- 398. TE-28B, main HX mixing tee steady-state temp., RTD
- 399. PDE-46, main HX bypass transient DP
- 400. PE-526, HX A secondary inlet pressure
- 401. PE-16, downstream HCV-2 transient pressure
- 402. PE-27, test section inlet plenum bottom transient pressure
- 403. PE-43, test section outlet plenum bottom transient pressure
- 404. PDT-30, test section steady-state DP
- 405. PT-32, test section outlet steady-state pressure
- 406. SE-72, primary pump speed
- 407. XM-4000I, breakwire detector, inlet break
- 408. XM-4000Ø, breakwire detector, outlet break
- 409. LT-100, steady state pressurizer liquid level
- 410. FE-522, HX A secondary cooling-water flow
- 411. TE-557, HX D secondary discharge steady-state temp., RTD
- 412. TE-525, HX A secondary discharge steady-state temp., RTD
- 413. TE-210A, test section outlet line steady-state temp., RTD
- 414. EIM-1001B, RTD power supply current
- 415. EIE-11S6, rod 1 heater current
- 416. EIE-12S6, rod 2 heater current
- 417. EIE-11S7, rod 3 heater current
- 418. EIE-12S7, rod 4 heater current

- 419. EIE-9S6, rod 5 heater current
- 420. EIE-9S8, rod 6 heater current
- 421. EIE-9S5, rod 7 heater current
- 422. EIE-11S5, rod 8 heater current
- 423. EIE-11S8, rod 9 heater current
- 424. EIE-12S8, rod 10 heater current
- 425. EIE-9S7, rod 11 heater current
- 426. EIE-9S4, rod 12 heater current
- 427. EIE-9S3, rod 13 heater current
- 428. EIE-9S11, rod 14 heater current
- 429. EIE-11S4, rod 15 heater current
- 430. EIE-11S9, rod 16 heater current
- 431. EIE-12S5, rod 17 heater current
- 432. EIE-9S9, rod 18 heater current
- 433. EIE-9S10, rod 19 heater current
- 434. EIE-9S2, rod 20 heater current
- 435. EIE-9S12, rod 21 heater current
- 436. EIE-11S11, rod 22 heater current
- 437. EIE-11S10, rod 23 heater current
- 438. EIE-11S3, rod 24 heater current
- 439. EIE-9S13, rod 25 heater current
- 440. EIE-10S6, rod 26 heater current
- 441. EIE-9S1, rod 27 heater current
- 442. EIE-10S7, rod 28 heater current
- 443. EIE-11S2, rod 29 heater current
- 444. EIE-11S12, rod 30 heater current
- 445. EIE-12S2, rod 31 heater current
- 446. EIE-12S1, rod 32 heater current
- 447. EIE-10S12, rod 33 heater current
- 448. EIE-10S5, rod 34 heater current
- 449. EIE-10S8, rod 35 heater current
- 450. EIE-11S1, rod 36 heater current
- 451. EIE-12S4, rod 37 heater current
- 452. EIE-12S3, rod 38 heater current

- 453. EIE-12S12, rod 39 heater current
- 454. EIE-10S11, rod 40 heater current
- 455. EIE-10S10, rod 41 heater current
- 456. EIE-10S9, rod 42 heater current
- 457. EIE-12S9, rod 43 heater current
- 458. EIE-12S10, rod 44 heater current
- 459. EIE-12S11, rod 45 heater current
- 460. EIE-10S1, rod 46 heater current
- 461. EIE-10S2, rod 47 heater current
- 462. EIE-10S3, rod 48 heater current
- 463. EIE-10S4, rod 49 heater current
- 464. EIE-9, generator 9 current
- 465. EIE-10, generator 10 current
- 466. EIE-11, generator 11 current
- 467. EIE-12, generator 12 current
- 468. EEE-9, generator 9 voltage
- 469. EEE-10, generator 10 voltage
- 470. EEE-11, generator 11 voltage
- 471. EEE-12, generator 12 voltage
- 472. Zero calibration input, channels 0-127, gain 8
- 473. Zero calibration input, channels 128-255
- 474. Zero calibration input, channels 256-383
- 475. Zero calibration input, channels 384-511
- 476. Full-scale calibration input, channels 0-127
- 477. Full-scale calibration input, channels 128-255
- 478. Full-scale calibration input, channels 256-383
- 479. Full-scale calibration input, channels 384-511
- 480. TE-S1, subchannel 1 thermocouple
- 481. TE-S2, subchannel 2 thermocouple
- 482. TE-S3, subchannel 3 thermocouple
- 483. TE-S5, subchannel 5 thermocouple
- 484. TE-S9, subchannel 9 thermocouple
- 485. TE-S10, subchannel 10 thermocouple

- 486. TE-S11, subchannel 11 thermocouple
- 487. TE-S14, subchannel 14 thermocouple
- 488. TE-S16, subchannel 16 thermocouple
- 489. TE-S33, subchannel 33 thermocouple
- 490. TE-S34, subchannel 34 thermocouple
- 491. TE-S36, subchannel 36 thermocouple
- 492. TE-S38, subchannel 38 thermocouple
- 493. TE-S39, subchannel 39 thermocouple
- 494. TE-S40, subchannel 40 thermocouple
- 495. TE-S41, subchannel 41 thermocouple
- 496. TE-S42, subchannel 42 thermocouple
- 497. TE-S44, subchannel 44 thermocouple
- 498. TE-S45, subchannel 45 thermocouple
- 499. TE-S49, subchannel 49 thermocouple
- 500. TE-S50, subchannel 50 thermocouple
- 501. TE-S51, subchannel 51 thermocouple
- 502. TE-S54, subchannel 54 thermocouple
- 503. TE-S55, subchannel 55 thermocouple
- 504. TE-S57, subchannel 57 thermocouple
- 505. TE-S59, subchannel 59 thermocouple
- 506. TE-S63, subchannel 63 thermocouple
- 507. TE-S64, subchannel 64 thermocouple

ACKNOWLEDGMENTS

In the conduct of a large experimental and analytical program, there are always a great many individuals whose contributions should be recognized. The dedicated efforts of the entire BDHT program staff are reflected in this report. The authors express their appreciation to the following personnel:

M. C. Adair	R. C. Hagar	W. Ragan, Jr.
J. L. Bartley	R. A. Hedrick	J. L. Redford
W. E. Baucum	R. E. Helms	M. J. Roberts
R. E. Bohanan	C. R. Hyman	L. I. Schlemper
S. B. Cliff	P. A. Jallouk	A. N. Smith
R. D. Dabbs	A. F. Johnson	R. D. Stulting
C. E. Davis	D. M. Leon	R. E. Textor
E. D. Drennen	G. S. Massengill	D. G. Thomas
B. G. Eads	G. M. Maxwell	K. G. Turnage
G. G. Fee	C. B. Mullins	J. D. White
D. J. Fraysier	L. J. Ott	M. D. White
C. A. Gifford	H. R. Payne	J. E. Wolfe
R. H. Greene		

PWR BLOWDOWN HEAT TRANSFER SEPARATE-EFFECTS
PROGRAM - THERMAL-HYDRAULIC TEST FACILITY
EXPERIMENTAL DATA REPORT FOR TEST 163

V. D. Clemons W. G. Craddick R. M. Flanders

ABSTRACT

Reduced instrument responses are presented for Thermal-Hydraulic Test Facility (THTF) test 163, which is part of the Oak Ridge National Laboratory Pressurized-Water Reactor (ORNL-PWR) Blowdown Heat Transfer Separate-Effects Program. The objective of the program is to investigate the thermal-hydraulic phenomenon governing the energy transfer and transport processes that occur during a loss-of-coolant accident (LOCA) in a PWR system.

Test 163 was conducted to determine the effect of moving the pressurizer surge line from downstream to upstream of the main heat exchangers.

The primary purpose of this report is to make the reduced instrument responses during test 163 available. The responses are presented in graphical form in engineering units and have been analyzed only to the extent necessary to assure reasonableness and consistency.

I. INTRODUCTION

The Oak Ridge National Laboratory Pressurized-Water Reactor (ORNL-PWR) Blowdown Heat Transfer Program is a separate-effects study of the relations among the principal variables that can alter the rate of blowdown, the presence of flow reversal and rereversal, time delay to critical heat flux (CHF), the rate at which dryout progresses, and similar time- and space-related functions that are important in loss-of-coolant accident (LOCA) analyses. Primary test results are obtained from the Thermal-Hydraulic Test Facility (THTF), a large nonnuclear pressurized-water loop incorporating a 49-rod electrically heated bundle in a 7×7 geometry.

THTF test 163 (conducted August 23, 1977) was the twentieth test conducted in the facility with bundle 1 in place. This test was performed to determine the effect of moving the pressurizer surge line from downstream to upstream of the main heat exchangers.

The purpose of this report is to provide the reduced instrument responses during test 163 in a readily usable form to the nuclear community in advance of detailed analyses and interpretations. These data are presented on microfiche attached to the back cover of the report. Final analyses and interpretations are scheduled for publication six months after the completion of the test series. The program and the experimental facilities are described in Ref. 1.

II. SYSTEM, PROCEDURES, CONDITIONS, AND EVENTS FOR TEST 163

1. System Configuration and Test Procedure

The Thermal-Hydraulic Test Facility (THTF), shown in Fig. 1, consists of a test section with a 49-rod, 3.66-m-long (12-ft) electrically heated core; a circulation loop comprised of three parallel heat exchangers with bypass, a pressurizer, a pump with bypass, and associated control valves; two rupture assemblies; and a pressure-suppression system. For test 163 the break configuration was a 40% inlet-60% outlet break with a total break area of 12.54 cm^2 (0.0135 ft^2). The THTF experimental system is described further in Ref. 1.

The electric core was taken to the preblowdown power (100 kW/rod) in ~ 20 -kW/rod steps to provide steady-state calibration information. The main heat exchangers were operated to match the core power input. The primary coolant pump was tripped coincident with break initiation, but the electric core was operated at the preblowdown power for ~ 2 sec into the transient. Rods 19, 24, 39, and 47 were unpowered. Closure of the secondary side main heat exchanger valves was initiated at the trip from 100 kW/rod.

In preparation for the test, the loop was filled with demineralized water and the system pressure checked. Instrumentation and data acquisition checks were performed. During the warmup, data were taken for use in flow and pressure calibrations.

1. *Project Description: ORNL-PWR Blowdown Heat Transfer Separate-Effects Program - Thermal-Hydraulic Test Facility (THTF)*, ORNL/NUREG/TM-2 (February 1976).

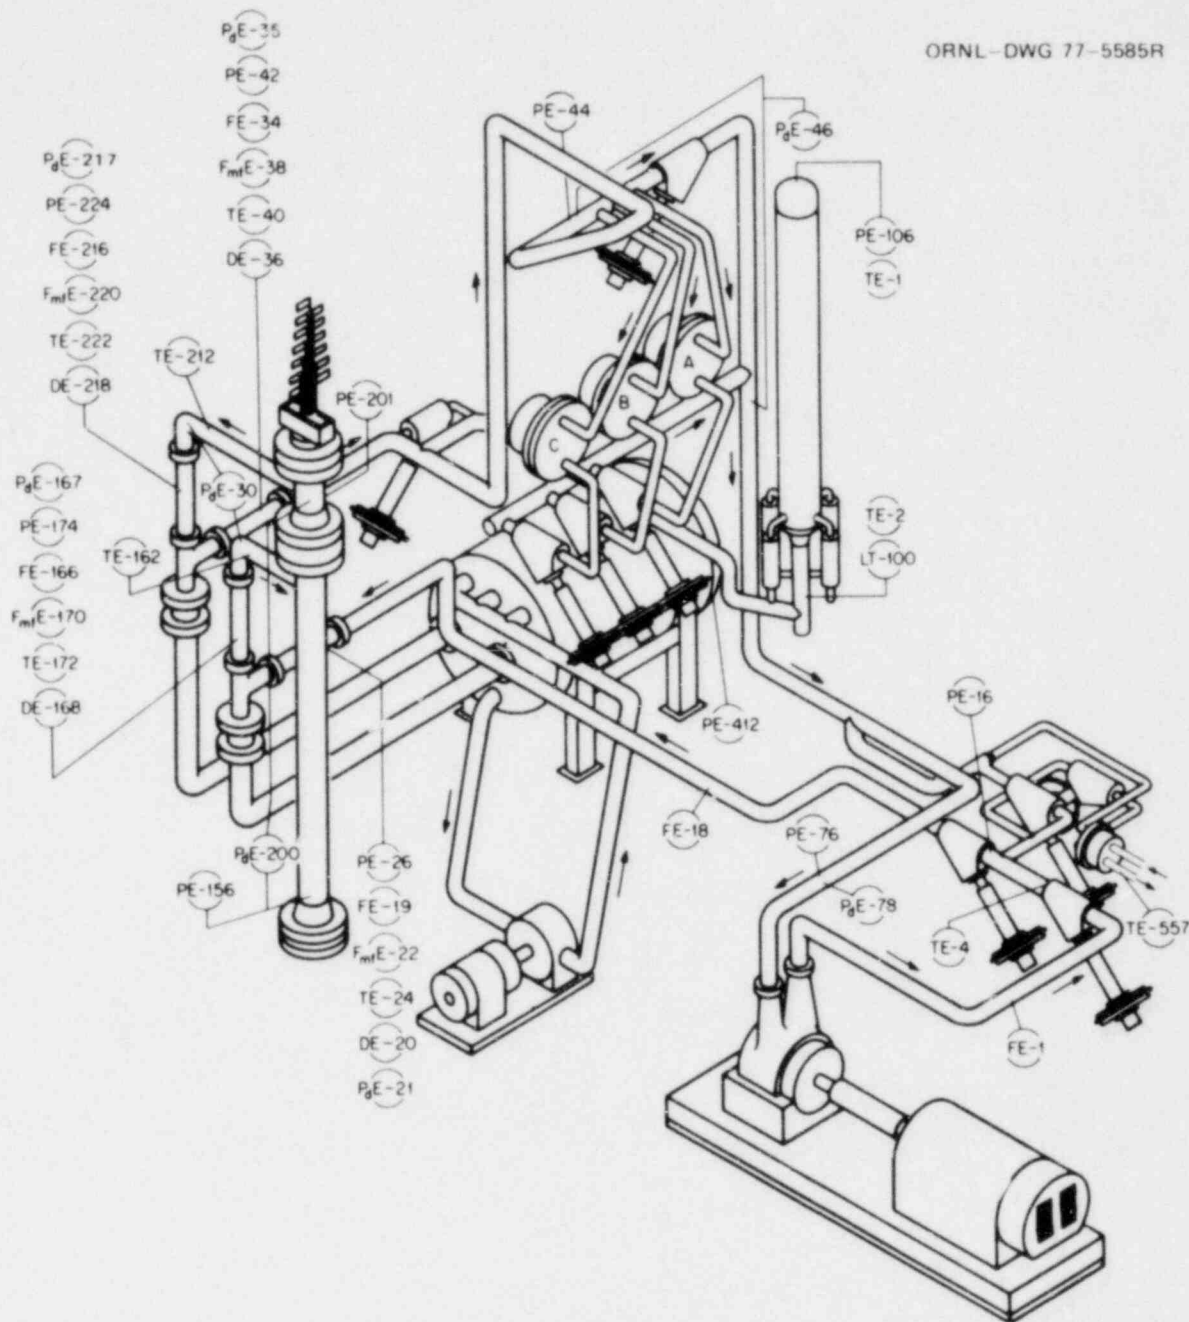


Fig. 1. Thermal-Hydraulic Test Facility (THTF) - MOD1.

During the test, the THTF was successfully subjected to a double-ended pipe break through the rupture assemblies containing the orifice plates. The effluent from the primary system was injected into the pressure-suppression system, which was maintained at atmospheric pressure.

2. Initial Test Conditions and Sequence of Events

The THTF conditions immediately preceding rupture are given in Tables 1 and 2. The prerupture steady-state primary and secondary energy balances are shown in Figs. 2 through 4. The sequence of events relative to the rupture is given in Table 3.

Table 1. Desired vs actual prerupture conditions for test 163

Parameters	Instrument	Desired ^a	Actual ^b
System pressure	PE-201		
MN/m ²		16.161	15.969
psig		2344	2316
Core power	EIE-9, EIE-10, EIE-11, EIE-12		
MW	EEE-9, EEE-10, EEE-11, EEE-12	4.500	4.494
Number of unpowered rods		4	4
Core volumetric flow rate	FE-19		
m ³ /sec		0.0337	0.0321
gpm		534	509
Test section inlet temperature	TE-162		
K		557.6	556.8
°F		544	543
Test section outlet temperature	TE-212		
K		588.2	588.9
°F		599	600
Pressurizer			
Pressure	PE-106		
MN/m ²		15.672	15.735
psig		2273	2282
Mass liquid water			
kg		63.50	89.54
lb _m		140	197
Coolant pump			
Speed	SE-72		
rps		60.38	60.30
rpm		3623	3618
Pressure differential	P _d E-78		
MN/m ²		4.441	4.650
psid		644.1	674
Pressure between HCV-2 and FCV-18	PE-16		
MN/m ²		17.733	18.241
psig		2572	2646
Pressure differential across main heat exchangers	P _d E-46		
MN/m ²		0.330	0.322
psid		47.8	46.6

^a Desired prerupture conditions are based on programmatic requirements.

^b Actual prerupture conditions are based on instrument signals recorded within 10 sec of primary system rupture.

Table 2. Prerupture primary-coolant temperature and pressure distribution^a - test 163

Location	Instrument	Temperature [K (°F)]	Pressure [MN/m ² (psig)]
Vertical inlet spool piece	TE-172	557.3 (544)	
Test section inlet	TE-162	556.8 (543)	
Lower plenum	TE-150	558.7 (546)	
Lower plenum	PE-156		16.225 (2353)
Upper plenum	PE-201		15.969 (2316)
Test section outlet	TE-212	588.9 (600)	
Vertical outlet spool piece	TE-222	588.4 (599)	
Pressure differential between vertical spool pieces	P _d E-204		0.431 (62.53)
Heat exchanger inlet header	PE-44		15.658 (2271)
Mixed mean temperature downstream heat exchangers	TE-28B	557.8 (544)	
Pressurizer surge line	TE-2	618.4 (653)	
Pressurizer	PE-106		15.735 (2282)
Primary pump suction	PE-76		15.370 (2229)
Between main control valves HCV-2, FCV-18	TE-4B	558.0 (545)	
Between main control valves HCV-2, FCV-18	PE-16		18.241 (2646)

^aPrerupture distribution is based on instrument signals recorded within 10 sec of primary system rupture.

Table 3. Sequence of events during test 163

Event	Time relative to rupture (sec)
Core power level established	-1380
Core temperature rise established	-1140
Analog tapes and CCDAS fast scan started	-23
Blowdown initiated	0
Pump power tripped	0
Heat exchanger secondary valves closure initiated	+2
Core power tripped to decay	+2
Core power tripped	+3.4

PRE-BLOWDOWN NO. 163 STEADY-STATE POINTS 8/23/77

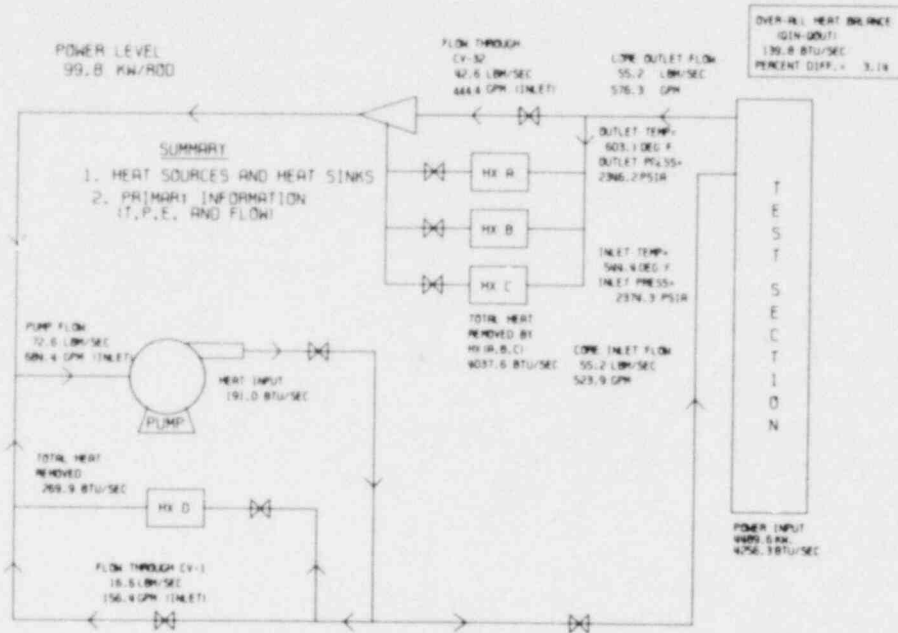


Fig. 2. Prerupture loop energy balance.

PRE-BLOWDOWN NO. 163 STEADY-STATE POINTS 8/23/77

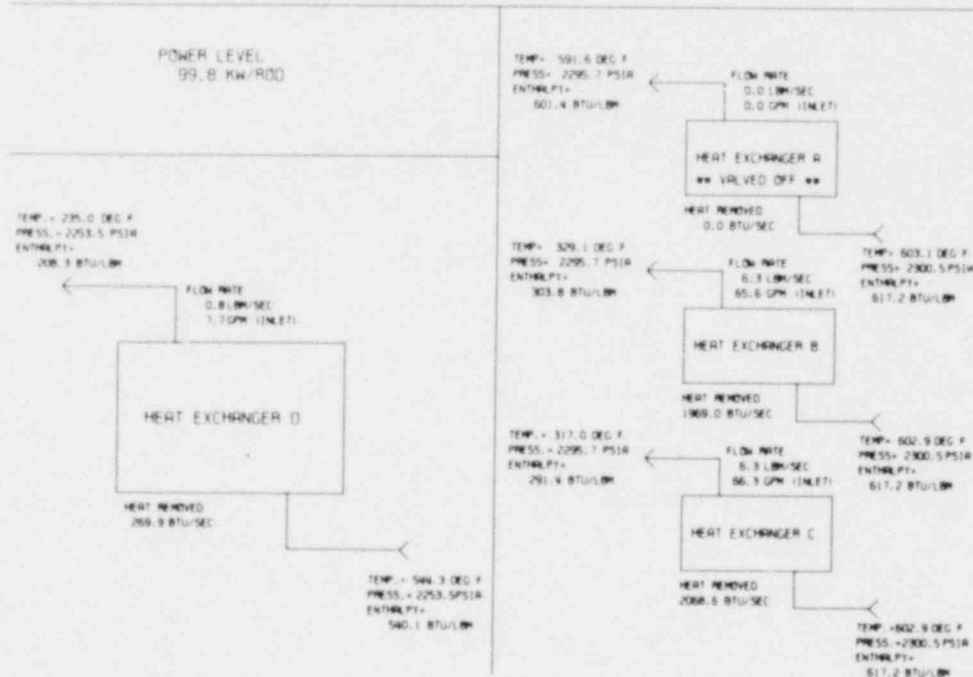


Fig. 3. Prerupture primary side heat exchanger summary.

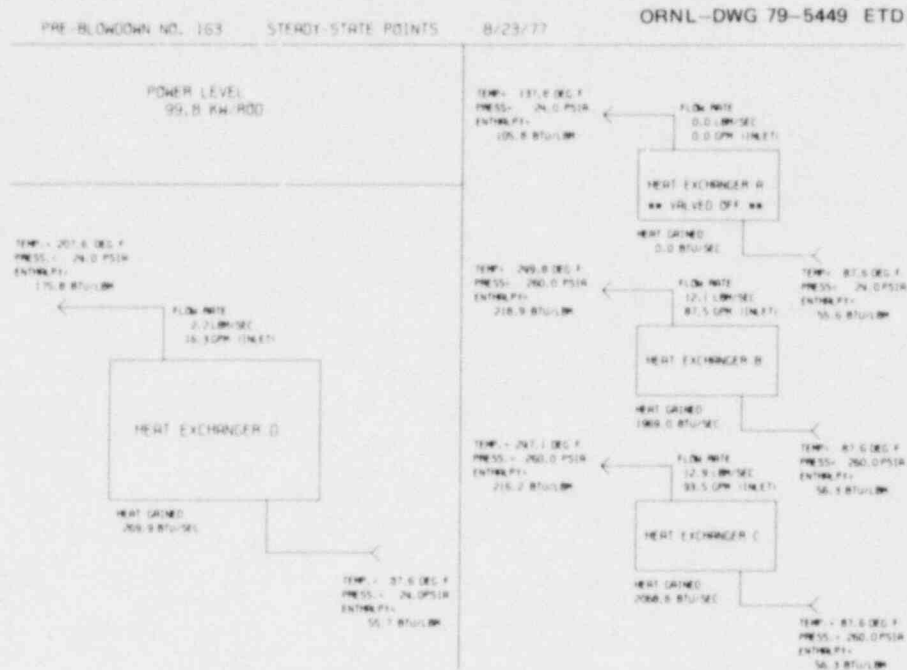


Fig. 4. Prerupture secondary side heat exchanger summary.

III. DATA PRESENTATION

The recorded instrument responses for THTF test 163 have been processed only to the extent necessary to obtain appropriate engineering units and to ensure reasonableness and consistency. In converting the instrument responses to engineering units, a homogeneous fluid has been assumed. Therefore, interpretation or analysis of the data must account for the fact that the instruments may have been subjected to nonhomogeneous fluid conditions during the transient.

The reduced instrument responses presented in this report were recorded by a computer-controlled digital data acquisition system (CCDAS). Further information on this system may be found in Ref. 1.

Figures 5 through 7 provide supportive information for the instrument responses and indicate the relative locations of the detectors in the THTF. Table 4 gives the precision of the recorded instrument responses, and Table 5 groups the measurements by location and provides brief comments regarding the detectors and the recorded responses. Time zero on all graphs is the time of break initiation.

ORNL-DWG 76-19894

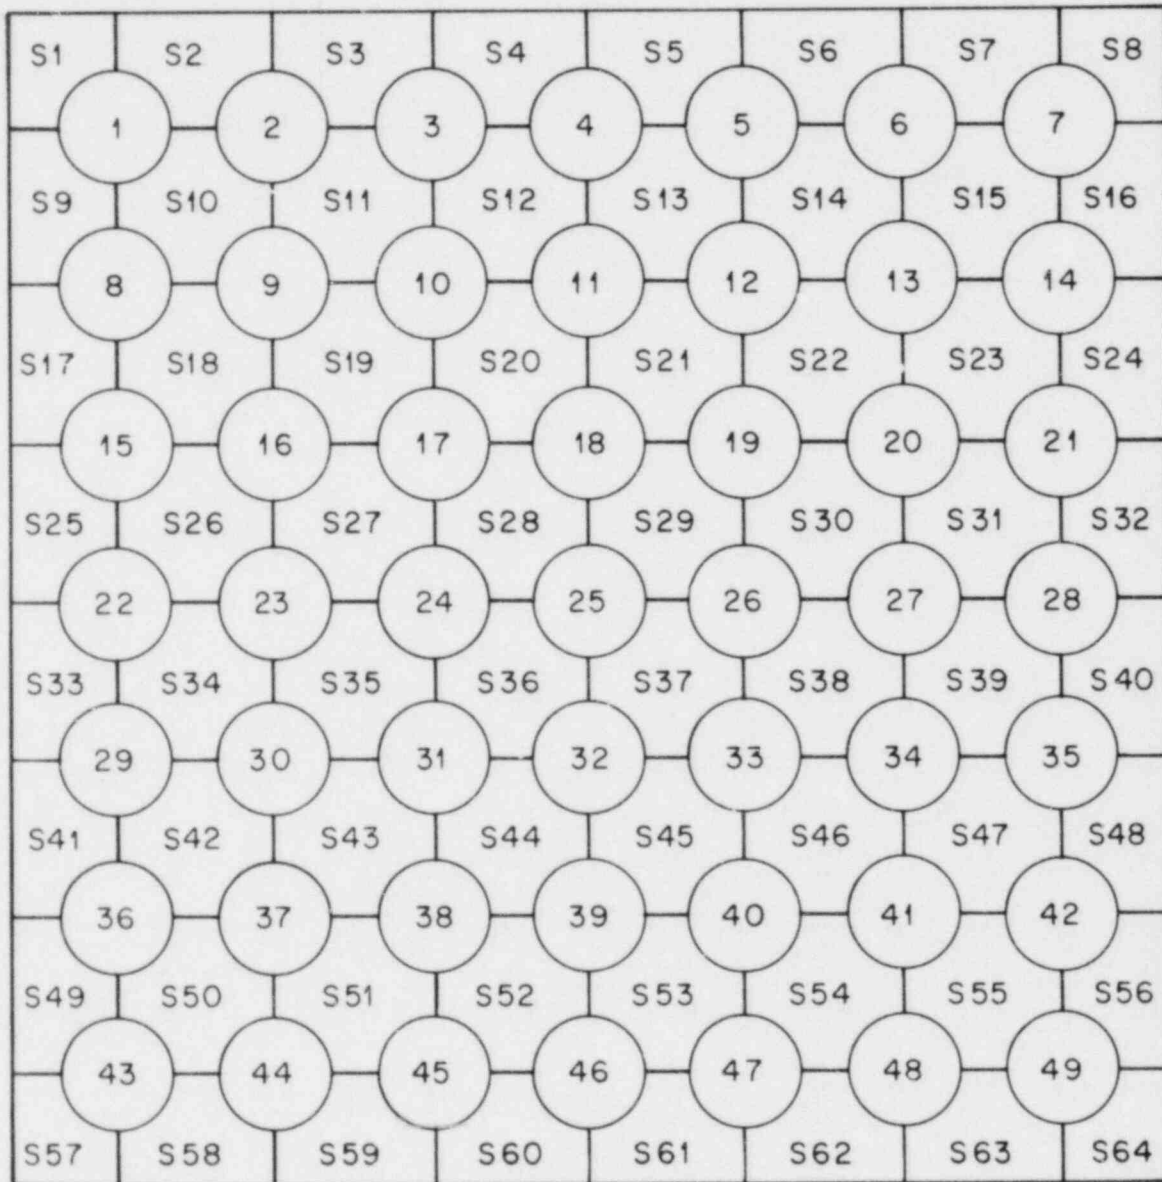


Fig. 5. Identification of THTF heater rod and subchannel locations in bundles 1 and 2.

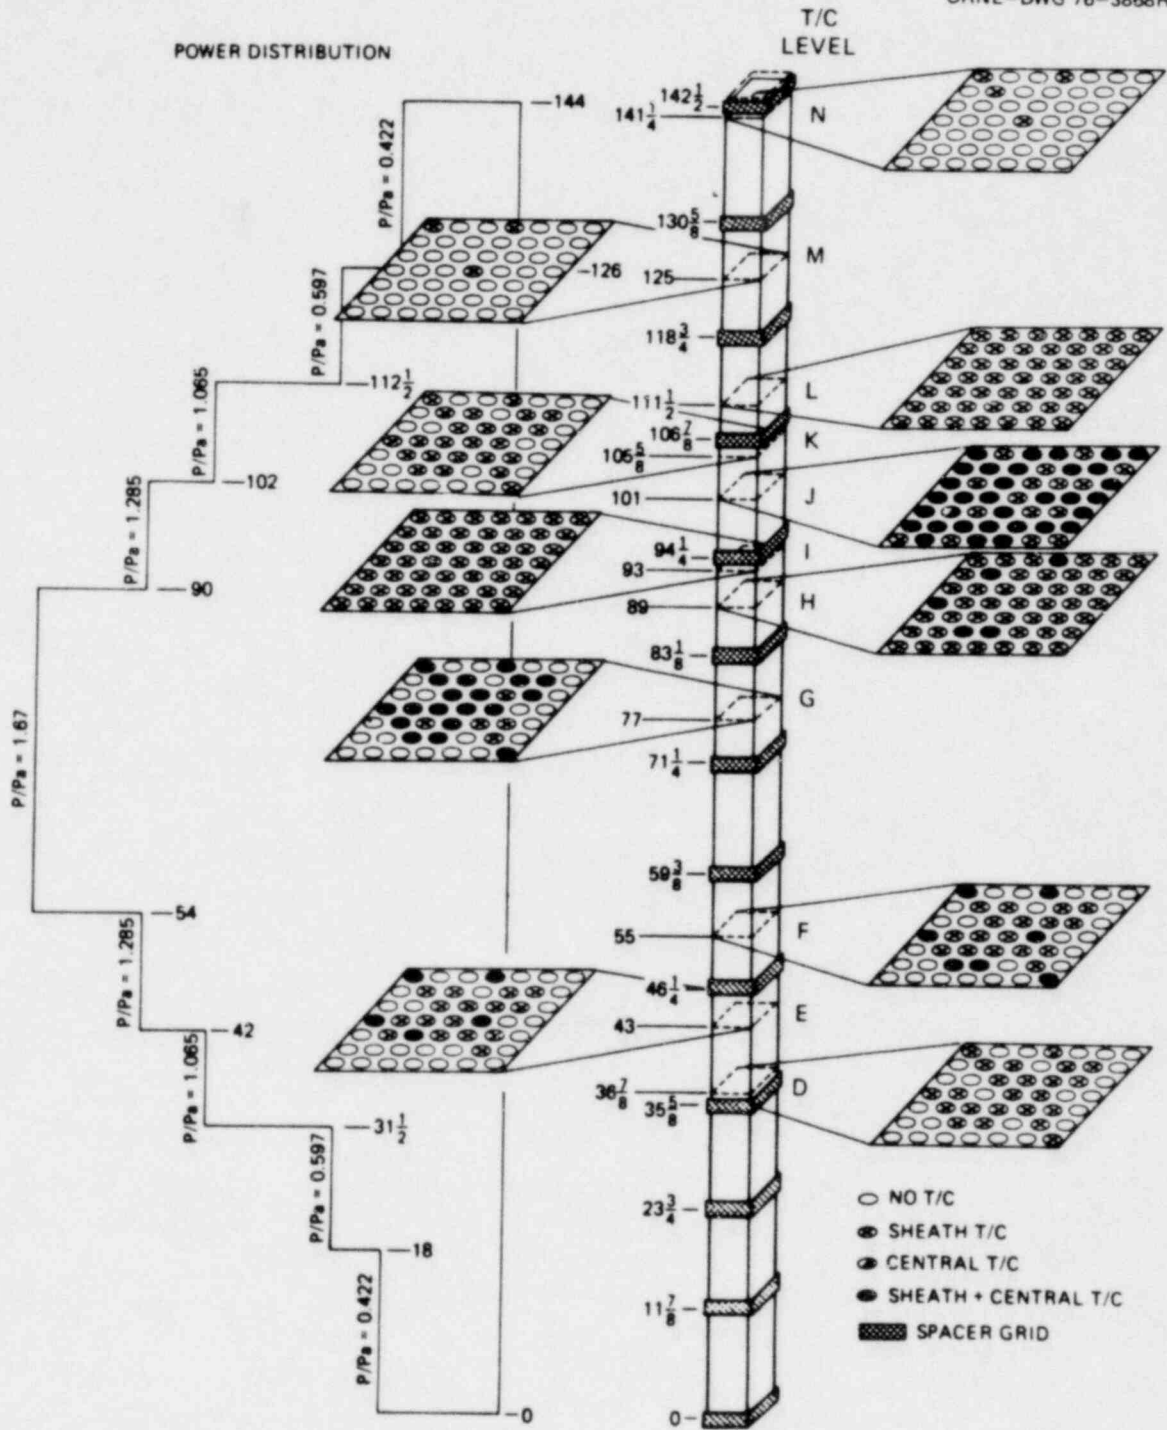


Fig. 6. Location of thermocouples in THTF bundle 1.

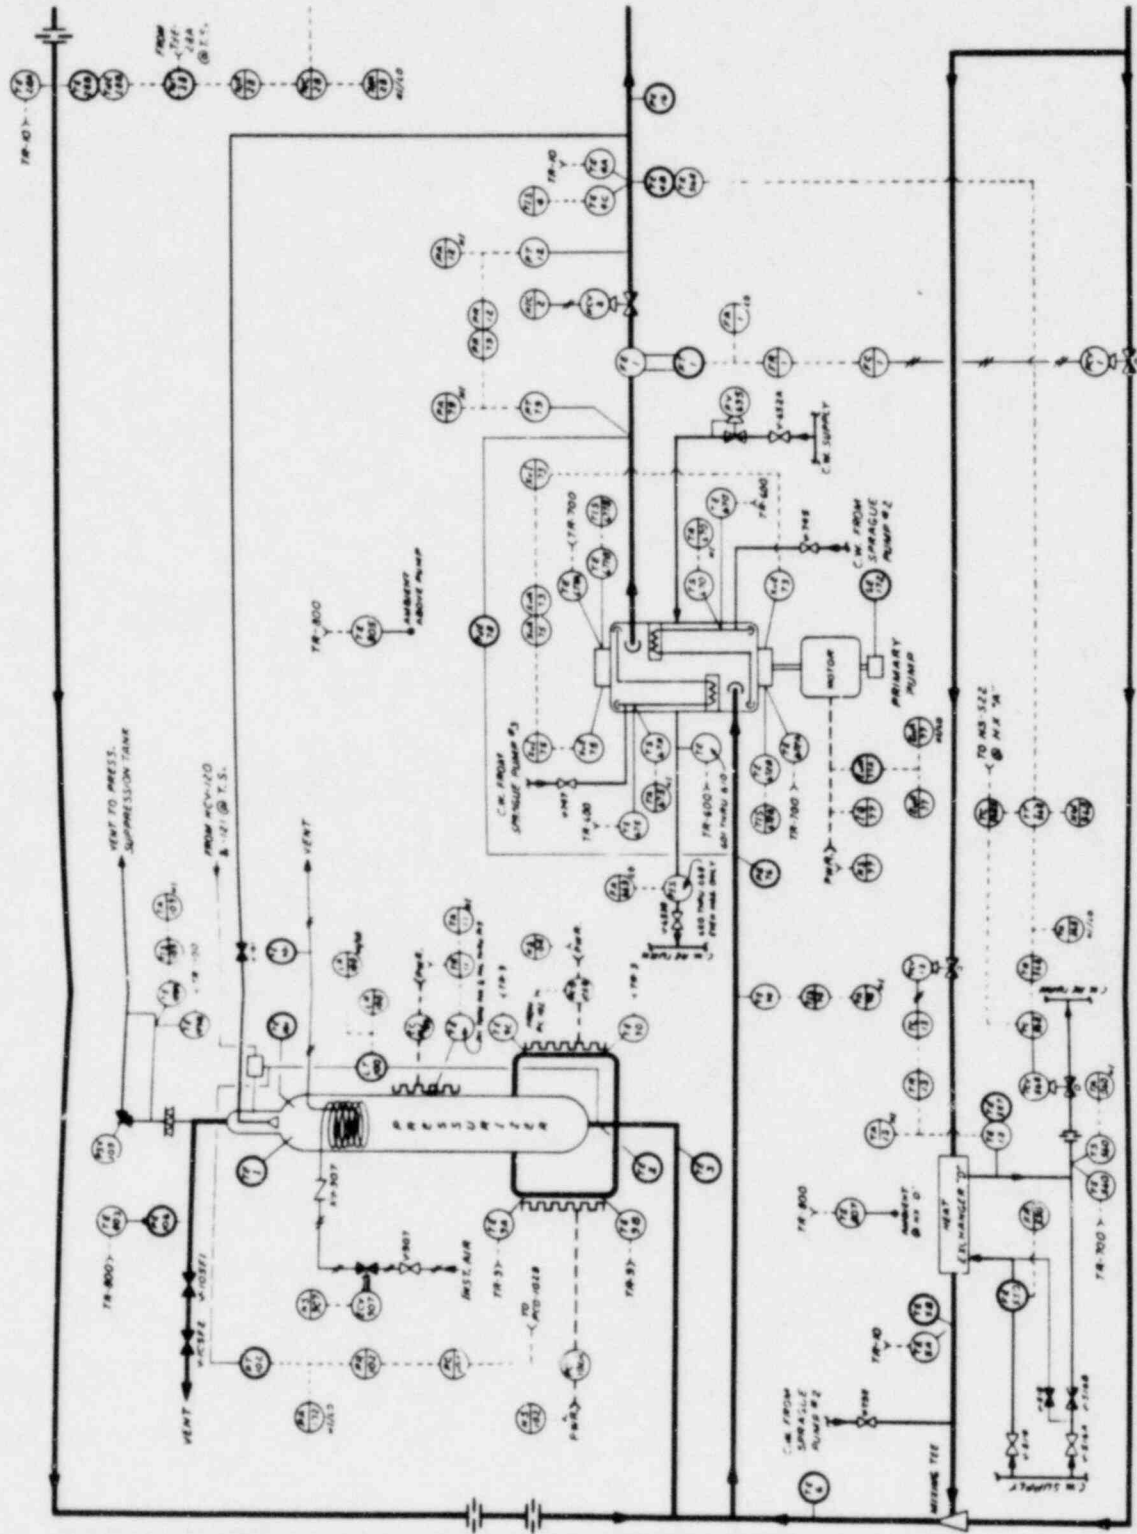
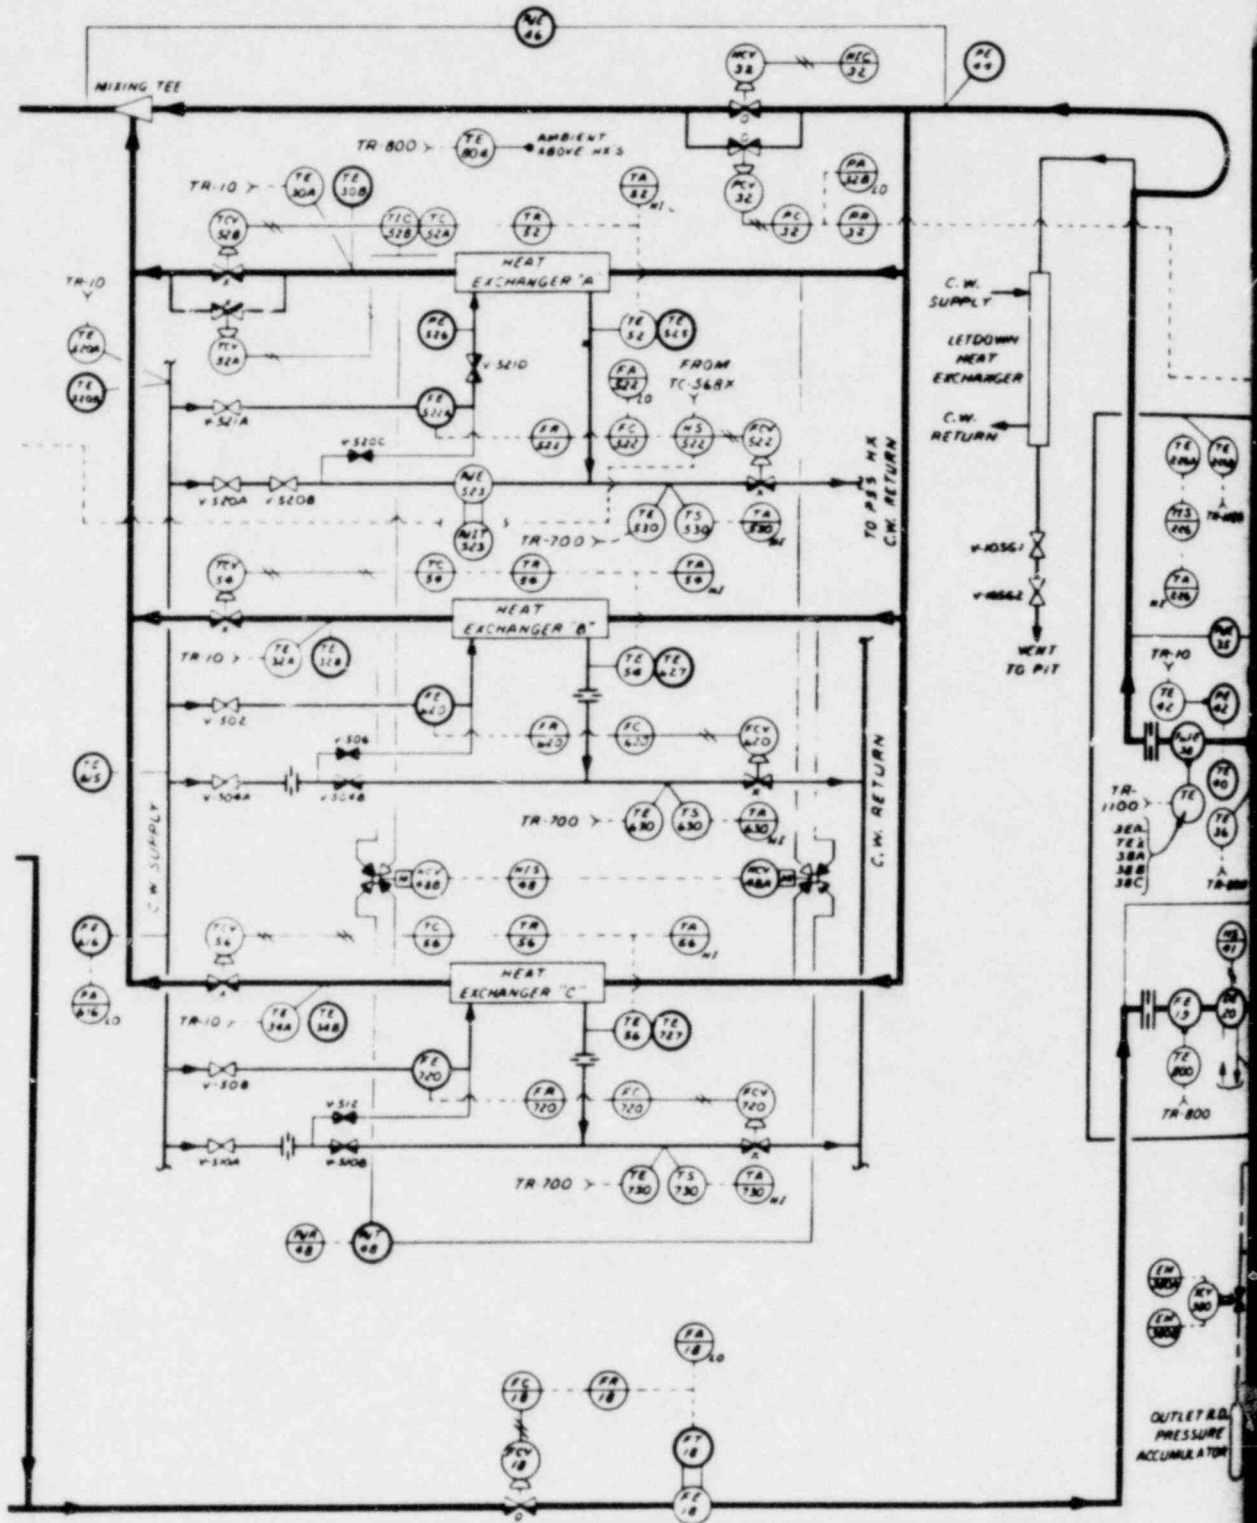


Fig. 7. THIF instrument identification and location.



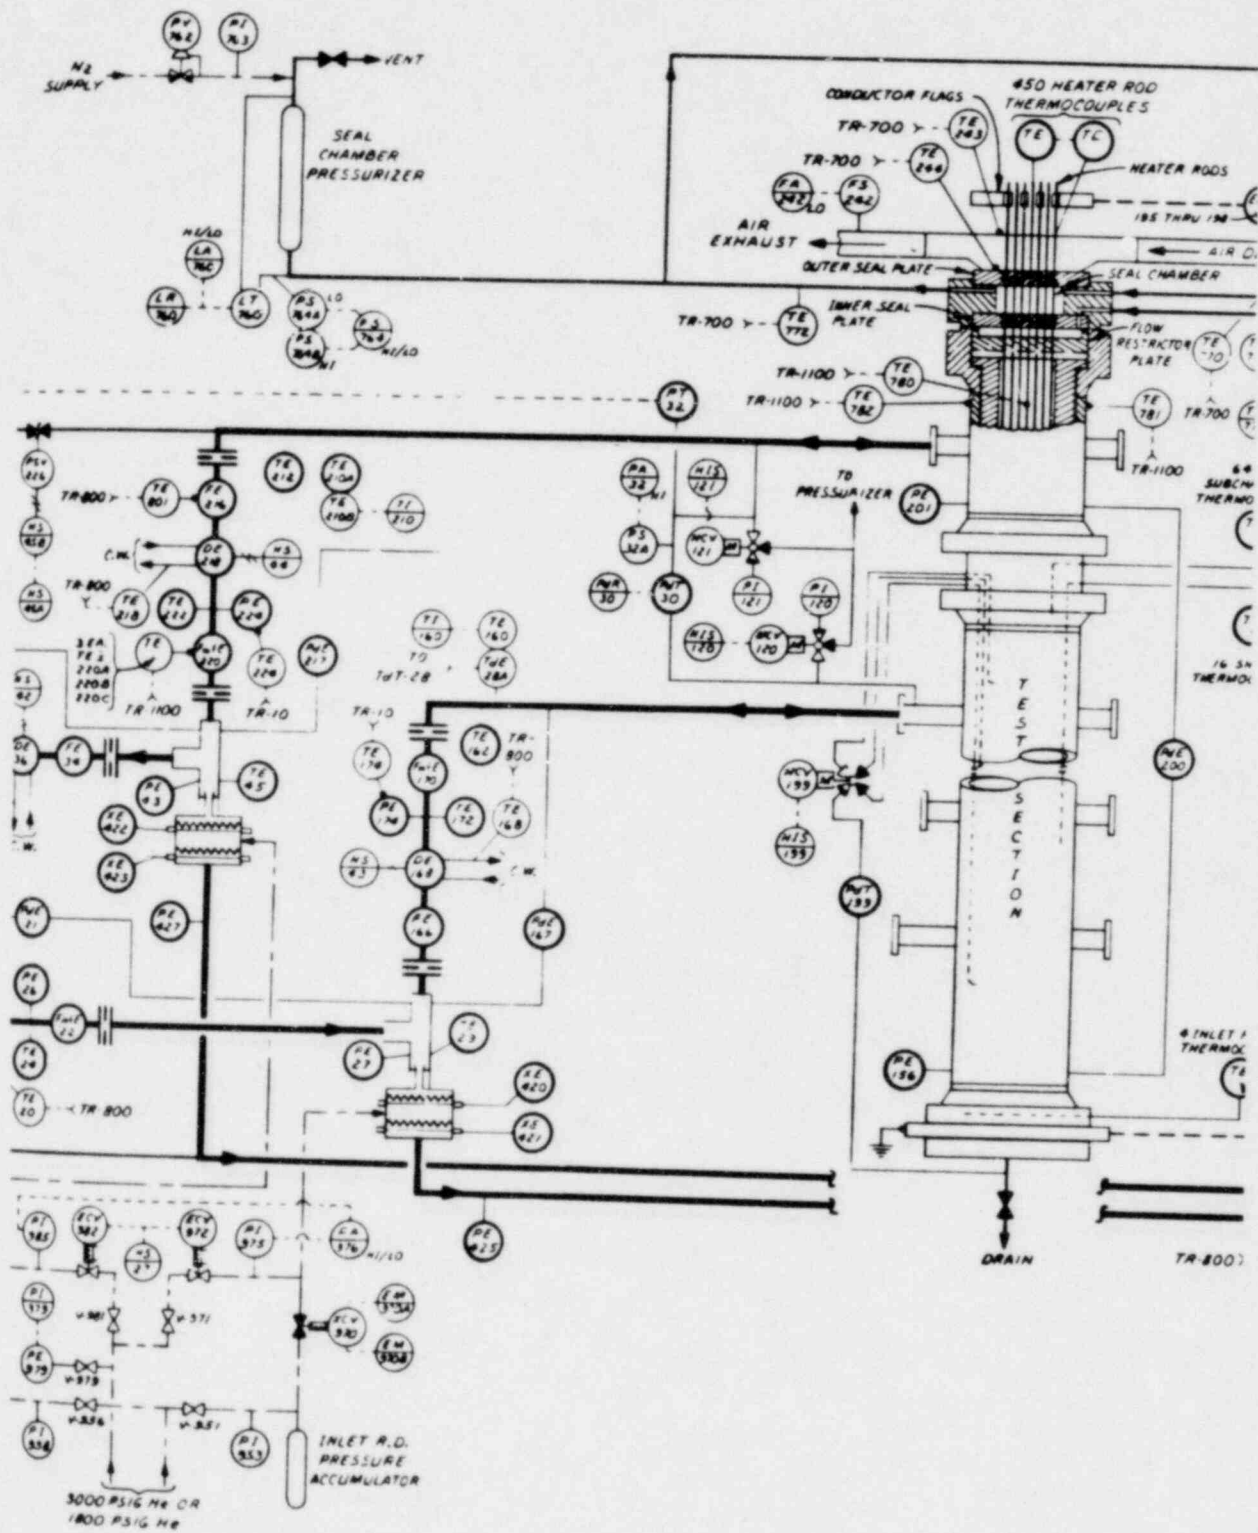


Fig. 7 (continued)

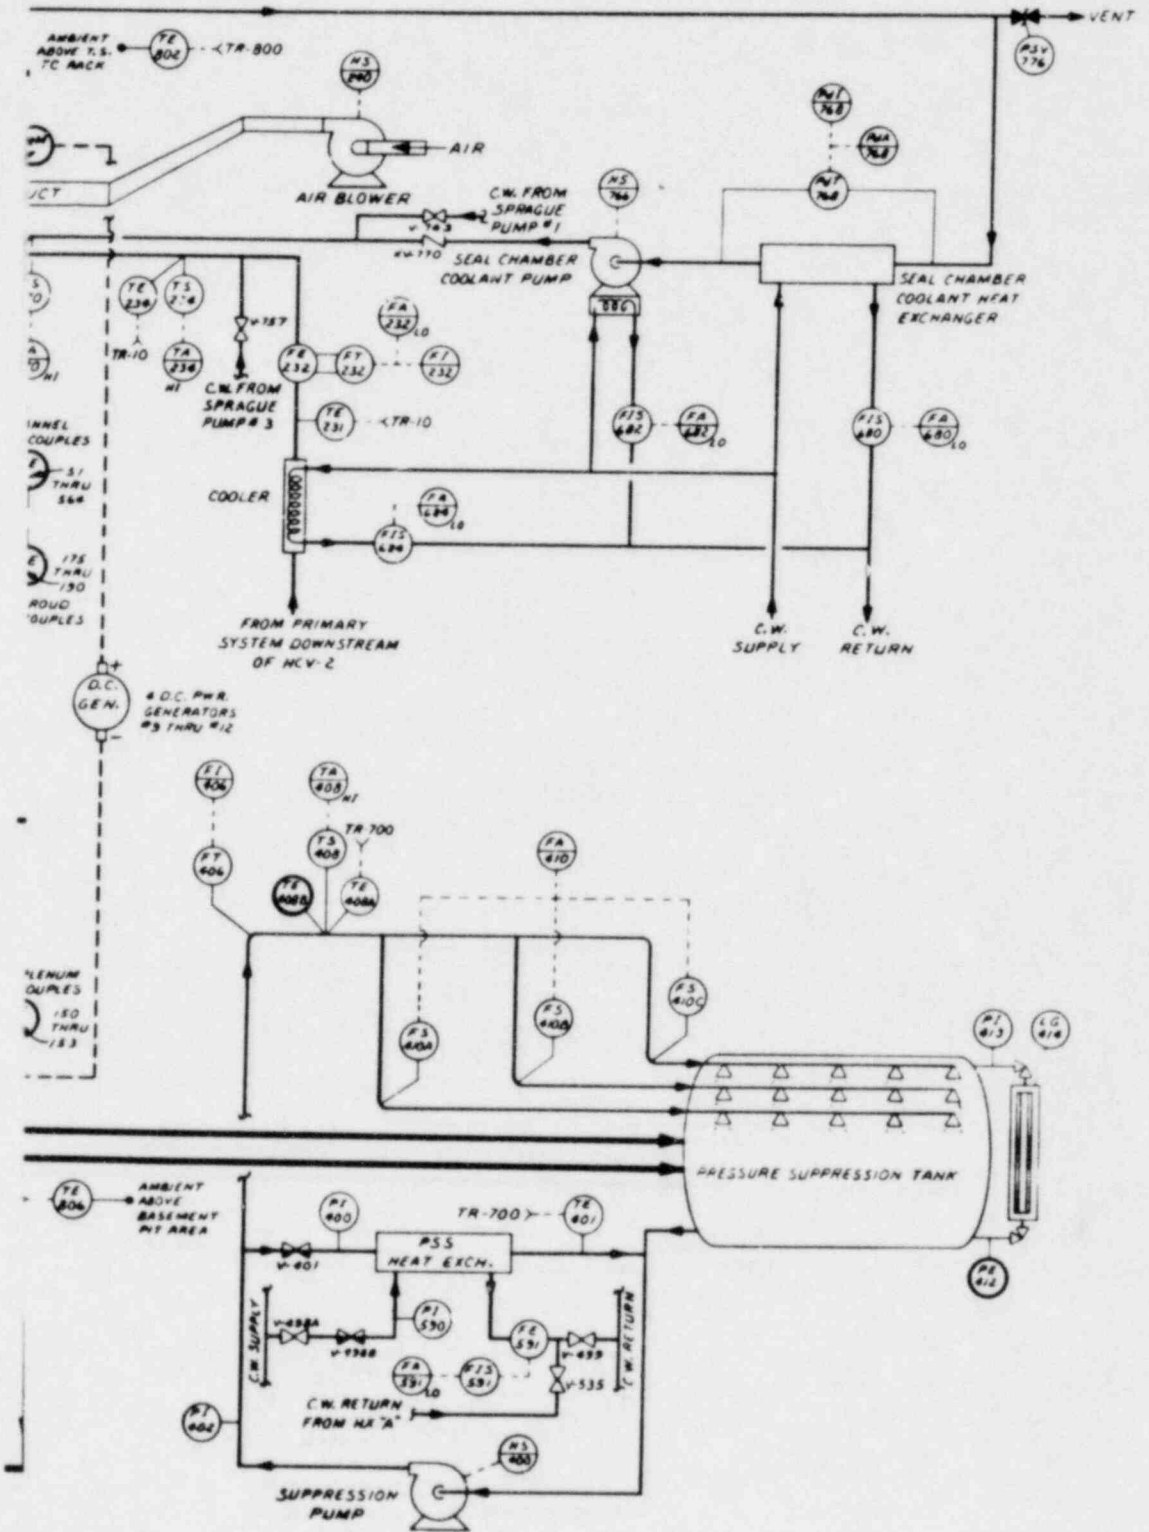


Table 4. Precision of experimental measurements for test 163

System	Standard deviation
Pressure measurement, MN/m ² (psig)	
CCDAS	0.055 (8.0)
Analog tape system	0.197 (28.5)
Pressure difference measurement, MN/m ² (psid)	
CCDAS	
6.89-MN/m ² (1000-psid) span	0.025 (3.6)
1.38-MN/m ² (200-psid) span	0.005 (0.72)
0.34-MN/m ² (50-psid) span	0.001 (0.18)
Analog tape system	
6.89-MN/m ² (1000-psid) span	0.033 (4.8)
1.38-MN/m ² (200-psid) span	0.007 (0.95)
0.34-MN/m ² (50-psid) span	0.002 (0.24)
Temperature measurement, K (°F)	2.4 (4.3)
Electric core power measurement	
Rod current, A	0.877
Rod voltage, V	0.304
Flow measurement, m ³ /sec (gpm)	
FE-19	
Forward	+0.0009 -0.0002 (+13.97) (-2.90)
Reverse	+0.0011 -0.0004 (+16.77) (-5.70)
FE-166	
Forward	+0.0011 -0.0004 (+17.49) (-6.43)
Reverse	+0.0009 -0.0002 (+14.14) (-3.07)
FE-216	
Forward	+0.0008 -0.0001 (+12.88) (-1.81)
Reverse	+0.0009 -0.0002 (+14.46) (-3.39)
FE-34	
Forward	+0.0019 -0.0005 (+30.71) (-8.58)
Reverse	+0.0019 -0.0005 (+29.54) (-7.41)
Momentum flux measurement, kg/m-sec ² (lb _m /ft-sec ²)	
CCDAS	2264 (1522)
Analog tape system	2554 (1716)
Density measurement @ 961 kg/m ³ (60 lb _m /ft ³), kg/m ³ (lb _m /ft ³)	12.9 (0.81)

Table 5. Data presentation for test 163

Measurement	Location and comments	Range		Figure	Measurement comments
		Detector	Data acquisition system		
BUNDLE TEMPERATURE	Chromel-Alumel thermocouples	+32 to +1897°F (all)	-0.0027 to +0.0400 V (all)		
Heater Rod Sheath					
LEVEL D					
TE-301AD	Rod 1			8	Inst., questionable
TE-304AD	Rod 4			9	
TE-309AD	Rod 9			10	
TE-310AD	Rod 10			11	
TE-312AD	Rod 12			12	
TE-313AD	Rod 13			13	
TE-317AD	Rod 17			14	
TE-318AD	Rod 18			15	
TE-320AD	Rod 20			16	
TE-322AD	Rod 22			17	
TE-323AD	Rod 23			18	
TE-325AD	Rod 25			19	
TE-326AD	Rod 26			20	
TE-331AD	Rod 31			21	
TE-338AD	Rod 38			22	
TE-339AD	Rod 39			23	Unpowered rod
TE-341AD	Rod 41			24	
TE-349AD	Rod 49			25	
LEVEL E					
TE-301AE	Rod 1			26	Instrument failed
TE-304AE	Rod 4			27	
TE-309AE	Rod 9			28	
TE-312AE	Rod 12			29	
TE-313AE	Rod 13			30	
TE-317AE	Rod 17			31	
TE-318AE	Rod 18			32	
TE-320AE	Rod 20			33	
TE-322AE	Rod 22			34	
TE-323AE	Rod 23			35	Unpowered rod
TE-324AE	Rod 24			36	
TE-325AE	Rod 25			37	Small spurious spike early in transient
TE-326AE	Rod 26			38	
TE-331AE	Rod 31			39	
TE-333AE	Rod 33			40	
TE-338AE	Rod 38			41	

Table 5 (continued)

Measurement	Location and comments	Range		Figure	Measurement comments
		Detector	Data acquisition system		
BUNDLE TEMPERATURE (continued)					
LEVEL E (continued)					
TE-339AE	Rod 39			42	Unpowered rod and spurious spike
TE-341AE	Rod 41			43	
TE-349AE	Rod 49			44	
LEVEL F					
TE-301BF	Rod 1			45	Small spurious spike early in transient
TE-304BF	Rod 4			46	
TE-309BF	Rod 9			47	Small spurious spike early in transient
TE-310BF	Rod 10			48	
TE-312BF	Rod 12			49	Small spurious spike early in transient
TE-313BF	Rod 13			50	
TE-317BF	Rod 17			51	Unpowered rod
TE-320BF	Rod 20			52	
TE-322BF	Rod 22			53	Unpowered rod
TE-323BF	Rod 23			54	
TE-324BF	Rod 24			55	Unpowered rod
TE-325BF	Rod 25			56	
TE-326BF	Rod 26			57	Unpowered rod
TE-331BF	Rod 31			58	
TE-333BF	Rod 33			59	Unpowered rod
TE-338BF	Rod 38			60	
TE-341BF	Rod 41			61	Small spurious spike early in transient
TE-349BF	Rod 49			62	
LEVEL G					
TE-301BG	Rod 1			63	Instrument failed
TE-304BG	Rod 4			64	
TE-309BG	Rod 9			65	Erratic
TE-310BG	Rod 10			66	
TE-312BG	Rod 12			67	Erratic
TE-313BG	Rod 13			68	
TE-317BG	Rod 17			69	Erratic
TE-318BG	Rod 18			70	
TE-320BG	Rod 20			71	Small spurious spike early in transient
TE-322BG	Rod 22			72	
TE-323BG	Rod 23			73	Small spurious spike early in transient
TE-325BG	Rod 25			74	

Table 5 (continued)

Measurement	Location and comments	Range		Figure	Measurement comments
		Detector	Data acquisition system		
BUNDLE TEMPERATURE (continued)					
LEVEL G (continued)					
TE-326BG	Rod 26			75	
TE-331BG	Rod 31			76	
TE-333BG	Rod 33			77	Small spurious spike early in transient
TE-338BG	Rod 38			78	Spurious spike early in transient
TE-339BG	Rod 39			79	Unpowered rod and spurious spike
TE-341BG	Rod 41			80	Spurious spike early in transient
TE-349BG	Rod 49			81	Instrument failed
LEVEL H					
TE-301CH	Rod 1			82	Spurious spikes
TE-302AH	Rod 2			83	Small spurious spike early in transient
TE-303AH	Rod 3			84	Small spurious spike early in transient
TE-304CH	Rod 4			85	
TE-305AH	Rod 5			86	
TE-306AH	Rod 6			87	Small spurious spike in transient
TE-307AH	Rod 7			88	
TE-308AH	Rod 8			89	
TE-309CH	Rod 9			90	
TE-310CH	Rod 10			91	
TE-311AH	Rod 11			92	
TE-312CH	Rod 12			93	Small spurious spike
TE-313CH	Rod 13			94	
TE-314AH	Rod 14			95	Small spurious spike
TE-315AH	Rod 15			96	
TE-316AH	Rod 16			97	Small spurious spike
TE-317CH	Rod 17			98	
TE-318CH	Rod 18			99	
TE-320CH	Rod 20			100	
TE-321AH	Rod 21			101	
TE-322CH	Rod 22			102	
TE-323CH	Rod 23			103	
TE-324CH	Rod 24			104	Unpowered rod
TE-325CH	Rod 25			105	
TE-326CH	Rod 26			106	
TE-327AH	Rod 27			107	
TE-331CH	Rod 31			108	
TE-333CH	Rod 33			109	Spurious spike
TE-336AH	Rod 36			110	
TE-337AH	Rod 37			111	
TE-338CH	Rod 38			112	

Table 5 (continued)

Measurement	Location and comments	Range		Figure	Measurement comments
		Detector	Data acquisition system		
BUNDLE TEMPERATURE (continued)					
LEVEL H (continued)					
TE-339CH	Rod 39			113	Unpowered rod and spurious spike
TE-341CH	Rod 41			114	Spurious spike
TE-342AH	Rod 42			115	Spurious spike
TE-343AH	Rod 43			116	Spurious spike
TE-344AH	Rod 44			117	Spurious spike
TE-345AH	Rod 45			118	Spurious spike
TE-346AH	Rod 46			119	Spurious spike
TE-348AH	Rod 48			120	Spurious spike
TE-349CH	Rod 49			121	Spurious spike
LEVEL I					
TE-301CI	Rod 1			122	Spurious spike
TE-302AI	Rod 2			123	Spurious spike
TE-303AI	Rod 3			124	Spurious spike
TE-304CI	Rod 4			125	Small spurious spikes
TE-305AI	Rod 5			126	
TE-306AI	Rod 6			127	Instrument failed
TE-307AI	Rod 7			128	Small spurious spikes
TE-308AI	Rod 8			129	Small spurious spikes
TE-309CI	Rod 9			130	
TE-310CI	Rod 10			131	Small spurious spike
TE-311AI	Rod 11			132	
TE-312CI	Rod 12			133	
TE-313CI	Rod 13			134	
TE-314AI	Rod 14			135	
TE-315AI	Rod 15			136	Small spurious spike
TE-316AI	Rod 16			137	Small spurious spike
TE-317CI	Rod 17			138	
TE-318CI	Rod 18			139	
TE-320CI	Rod 20			140	
TE-321AI	Rod 21			141	
TE-322CI	Rod 22			142	
TE-323CI	Rod 23			143	
TE-324CI	Rod 24			144	Instrument failed
TE-325CI	Rod 25			145	
TE-326CI	Rod 26			146	
TE-327AI	Rod 27			147	
TE-328AI	Rod 28			148	
TE-331CI	Rod 31			49	Instrument failed
TE-333CI	Rod 33			150	

Table 5 (continued)

Measurement	Location and comments	Range		Figure	Measurement comments
		Detector	Data acquisition system		
BUNDLE TEMPERATURE (continued)					
LEVEL I (continued)					
TE-336AI	Rod 36			151	
TE-337AI	Rod 37			152	
TE-338CI	Rod 38			153	
TE-339CI	Rod 39			154	Unpowered rod
TE-341CI	Rod 41			155	
TE-342AI	Rod 42			156	
TE-343AI	Rod 43			157	
TE-344AI	Rod 44			158	
TE-345AI	Rod 45			159	
TE-346AI	Rod 46			160	
TE-348AI	Rod 48			161	
TE-349CI	Rod 49			162	
LEVEL J					
TE-301DJ	Rod 1			163	
TE-302CJ	Rod 2			164	
TE-304DJ	Rod 4			165	
TE-305CJ	Rod 5			166	
TE-306CJ	Rod 6			167	
TE-307CJ	Rod 7			168	
TE-308CJ	Rod 8			169	
TE-309DJ	Rod 9			170	
TE-310DJ	Rod 10			171	
TE-312DJ	Rod 12			172	
TE-313DJ	Rod 13			173	
TE-314CJ	Rod 14			174	
TE-316CJ	Rod 16			175	
TE-317DJ	Rod 17			176	
TE-318DJ	Rod 18			177	
TE-320DJ	Rod 20			178	
TE-321CJ	Rod 21			179	
TE-322DJ	Rod 22			180	
TE-323DJ	Rod 23			181	
TE-324DJ	Rod 24			182	Unpowered rod
TE-325DJ	Rod 25			183	
TE-326DJ	Rod 26			184	
TE-327CJ	Rod 27			185	
TE-328CJ	Rod 28			186	
TE-331DJ	Rod 31			187	
TE-333DJ	Rod 33			188	

Table 5 (continued)

Measurement	Location and comments	Range		Figure	Measurement comments
		Detector	Data acquisition system		
BUNDLE TEMPERATURE (continued)					
LEVEL J (continued)					
TE-336CJ	Rod 36			189	
TE-337CJ	Rod 37			190	
TE-338DJ	Rod 38			191	
TE-339DJ	Rod 39			192	Unpowered rod
TE-340CJ	Rod 40			193	
TE-341DJ	Rod 41			194	
TE-342CJ	Rod 42			195	
TE-343CJ	Rod 43			196	Questionable
TE-344CJ	Rod 44			197	
TE-345CJ	Rod 45			198	
TE-346CJ	Rod 46			199	
TE-349DJ	Rod 49			200	
LEVEL K					
TE-301DK	Rod 1			201	
TE-304DK	Rod 4			202	
TE-309DK	Rod 9			203	
TE-310DK	Rod 10			204	
TE-312DK	Rod 12			205	
TE-313DK	Rod 13			206	
TE-317DK	Rod 17			207	
TE-318DK	Rod 18			208	
TE-320DK	Rod 20			209	Spurious spikes
TE-322DK	Rod 22			210	Spurious spikes
TE-323DK	Rod 23			211	
TE-324DK	Rod 24			212	Unpowered rod
TE-325DK	Rod 25			213	
TE-326DK	Rod 26			214	
TE-331DK	Rod 31			215	
TE-333DK	Rod 33			216	Spurious spikes
TE-338DK	Rod 38			217	Spurious spikes
TE-339DK	Rod 39			218	Unpowered rod
TE-341DK	Rod 41			219	
TE-349DK	Rod 49			220	

Table 5 (continued)

Measurement	Location and comments	Range		Figure	Measurement comments
		Detector	Data acquisition system		
BUNDLE TEMPERATURE (continued)					
LEVEL L					
TE-301EL	Rod 1			221	
TE-302CL	Rod 2			222	
TE-303CL	Rod 3			223	
TE-304EL	Rod 4			224	
TE-305CL	Rod 5			225	
TE-306CL	Rod 6			226	
TE-307CL	Rod 7			227	Instrument failed
TE-308CL	Rod 8			228	
TE-309EL	Rod 9			229	
TE-310EL	Rod 10			230	
TE-311CL	Rod 11			231	
TE-312EL	Rod 12			232	
TE-313EL	Rod 13			233	
TE-316CL	Rod 16			234	
TE-317EL	Rod 17			235	
TE-318EL	Rod 18			236	
TE-320EL	Rod 20			237	
TE-321CL	Rod 21			238	
TE-322EL	Rod 22			239	
TE-323EL	Rod 23			240	
TE-324EL	Rod 24			241	Unpowered rod
TE-325EL	Rod 25			242	
TE-326EL	Rod 26			243	
TE-327CL	Rod 27			244	
TE-328CL	Rod 28			245	
TE-331EL	Rod 31			246	
TE-333EL	Rod 33			247	Noisy
TE-336CL	Rod 36			248	
TE-337CL	Rod 37			249	
TE-338EL	Rod 38			250	
TE-339EL	Rod 39			251	Unpowered rod and spurious spike
TE-341EL	Rod 41			252	Spurious spike
TE-342CL	Rod 42			253	Spurious spike
TE-343CL	Rod 43			254	Spurious spike
TE-344CL	Rod 44			255	
TE-345CL	Rod 45			256	Small spurious spike early in transient
TE-346CL	Rod 46			257	Spurious spikes
TE-348CL	Rod 48			258	Spurious spike early in transient
TE-349EL	Rod 49			259	Spurious spike early in transient

Table 5 (continued)

Measurement	Location and comments	Range		Figure	Measurement comments
		Detector	Data acquisition system		
BUNDLE TEMPERATURE (continued)					
LEVEL M					
TE-301EM	Rod 1			260	Spurious spikes
TE-304EM	Rod 4			261	Small spurious spike early in transient
TE-309EM	Rod 9			262	Small spurious spikes
TE-325EM	Rod 25			263	
LEVEL N					
TE-301FN	Rod 1			254	Spurious spikes
TE-304FN	Rod 4			265	Small spurious spike early in transient
TE-325FN	Rod 25			266	
LEVEL O					
TE-301FO	Rod 1			267	Spurious spike
TE-304FO	Rod 4			268	
TE-309FO	Rod 9			269	
TE-310EO	Rod 10			270	Spurious spike
TE-312EO	Rod 12			271	
TE-317EO	Rod 17			272	Spurious spike
TE-318EO	Rod 18			273	
TE-320EO	Rod 20			274	
TE-322EO	Rod 22			275	
TE-323EO	Rod 23			276	
TE-324EO	Rod 24			277	
TE-325FO	Rod 25			278	
TE-326EO	Rod 26			279	
TE-331EO	Rod 31			280	
TE-333EO	Rod 33			281	Small spurious spikes
TE-338EO	Rod 38			282	Small spurious spikes
TE-339EO	Rod 39			283	Unpowered rod and spurious spike
TE-341EO	Rod 41			284	
TE-349EO	Rod 49			285	Spurious spike
<u>Heater Rod Center</u>					
LEVEL E					
TE-301ME	Rod 1			286	Spurious spike
TE-304ME	Rod 4			287	Spurious spike
TE-318ME	Rod 18			288	Spurious spike
TE-322ME	Rod 22			289	Spurious spike
TE-326ME	Rod 26			290	Large spurious spike

Table 5 (continued)

Measurement	Location and comments	Range		Figure	Measurement comments
		Detector	Data acquisition system		
BUNDLE TEMPERATURE (continued)					
Heater Rod Center (continued)					
LEVEL E (continued)					
TE-331ME	Rod 31			291	Small spurious spike
TE-338ME	Rod 38			292	Small spurious spike
TE-349ME	Rod 49			293	Spurious spike
LEVEL F					
TE-301MF	Rod 1			294	Spurious spike
TE-304MF	Rod 4			295	Small spurious spike
TE-322MF	Rod 22			296	Small spurious spike
TE-326MF	Rod 26			297	
TE-338MF	Rod 38			298	
TE-349MF	Rod 49			299	Spurious spike
LEVEL G					
TE-301MG	Rod 1			300	
TE-310MG	Rod 10			301	
TE-313MG	Rod 13			302	
TE-317MG	Rod 17			303	Instrument failed
TE-318MG	Rod 18			304	
TE-322MG	Rod 22			305	
TE-323MG	Rod 23			306	
TE-325MG	Rod 25			307	
TE-326MG	Rod 26			308	
TE-338MG	Rod 38			309	
TE-349MG	Rod 49			310	
LEVEL H					
TE-304MH	Rod 4			311	
TE-309MH	Rod 9			312	
TE-318MH	Rod 18			313	
TE-322MH	Rod 22			314	
TE-338MH	Rod 38			315	

Table 5 (continued)

Measurement	Location and comments	Range		Figure	Measurement comments
		Detector	Data acquisition system		
BUNDLE TEMPERATURE (continued)					
Heater Rod Center (continued)					
	LEVEL J				
TE-301MJ	Rod 1			316	
TE-310MJ	Rod 10			317	
TE-317MJ	Rod 17			318	
TE-323MJ	Rod 23			319	
TE-324MJ	Rod 24			320	Unpowered rod
TE-326MJ	Rod 26			321	
TE-338MJ	Rod 38			322	
SPOOL PIECE INSTRUMENTS					
<u>Temperature</u>	Chromel-Alumel thermocouples	+32 to +1897°F	-0.0027 to +0.0400 V		
TE-24	Horizontal inlet			363	
TE-172	Vertical inlet			369	
TE-222	Vertical outlet			375	Spurious spike
TE-40	Horizontal outlet			381	
<u>Pressure</u>		0 to +3000 psig	0.0 to +5.0 V		
PE-26	Horizontal inlet			360	
PE-224	Vertical outlet			481	
PE-42	Horizontal outlet			378	
<u>Pressure Drop</u>		-200 to +200 psid	-5.0 to +5.0 V		
PDE-21	Horizontal inlet			362	
PDE-167	Vertical inlet			368	
PDE-217	Vertical outlet			374	
PDE-35	Horizontal outlet			380	
PDE-204	Transient pressure difference between vertical spool pieces			366	
<u>Flow</u>					
FE-19	Horizontal inlet	-2000 to +2000 gpm	-5.0 to +5.0 V	358	Noisy prior to transient start
FE-166	Vertical inlet	-2000 to +2000 gpm	-5.0 to +5.0 V	364	
FE-216	Vertical outlet	-2000 to +2000 gpm	-5.0 to +5.0 V	370	
FE-34	Horizontal outlet	-4000 to +4000 gpm	-5.0 to +5.0 V	376	

Table 5 (continued)

Measurement	Location and comments	Range		Figure	Measurement comments
		Detector	Data acquisition system		
<u>SPOOL PIECE INSTRUMENTS (continued)</u>					
<u>Momentum Flux</u>		-250,000 to +250,000 $\text{lb}_m/\text{ft-sec}^2$	-5.0 to +5.0 V		
FMFE-22	Horizontal inlet			361	Erratic
FMFE-170	Vertical inlet			367	Zero shifted, erratic
FMFE-220	Vertical outlet			373	Erratic
FMFE-38	Horizontal outlet			379	Erratic
<u>Fluid Density</u>		0 to +62.4 lb_m/ft^3	0.0 to +10.0 V		
DE-20	Horizontal inlet			359	Spike
DE-168	Vertical inlet			365	
DE-218	Vertical outlet			371	Spike
DE-36	Horizontal outlet			377	
<u>TEST SECTION TEMPERATURE</u>		Chromel-Alumel thermocouples	+32 to +1897°F	-0.0027 to +0.0400 V	
<u>Bundle Shroud</u>					
TE-175	0.142L/LMAX			328	Instrument failed
TE-176	0.142L/LMAX			329	Instrument failed
TE-177	0.142L/LMAX			330	Instrument failed
TE-178	0.142L/LMAX			331	Instrument failed
TE-179	0.388L/LMAX			332	Erratic
TE-180	0.388L/LMAX			333	Instrument failed
TE-181	0.388L/LMAX			334	Instrument failed
TE-182	0.388L/LMAX			335	Erratic
TE-183	0.633L/LMAX			336	Instrument failed
TE-184	0.633L/LMAX			337	Instrument failed
TE-185	0.633L/LMAX			338	Instrument failed
TE-186	0.633L/LMAX			339	Instrument failed
TE-187	0.875L/LMAX			340	Instrument failed
TE-189	0.875L/LMAX			341	
TE-190	0.875L/LMAX			342	Erratic
<u>Bundle Subchannel</u>					
TE-S1	Subchannel 1			480	
TE-S2	Subchannel 2			481	
TE-S3	Subchannel 3			482	
TE-S5	Subchannel 5			483	Instrument failed
TE-S9	Subchannel 9			484	Instrument failed

Table 3 (continued)

Measurement	Location and comments	Range		Figure	Measurement comments
		Detector	Data acquisition system		
TEST SECTION TEMPERATURE (continued)					
<u>Bundle Subchannel (continued)</u>					
TE-S10	Subchannel 10			485	
TE-S11	Subchannel 11			486	
TE-S14	Subchannel 14			487	Instrument failed
TE-S16	Subchannel 16			488	
TE-S33	Subchannel 33			489	Instrument failed
TE-S34	Subchannel 34			490	Instrument failed
TE-S36	Subchannel 36			491	Instrument failed
TE-S38	Subchannel 38			492	Instrument failed
TE-S39	Subchannel 39			493	
TE-S40	Subchannel 40			494	
TE-S41	Subchannel 41			495	Instrument failed
TE-S42	Subchannel 42			496	Instrument failed
TE-S44	Subchannel 44			497	Instrument failed
TE-S45	Subchannel 45			498	
TE-S49	Subchannel 49			499	
TE-S50	Subchannel 50			500	
TE-S51	Subchannel 51			501	
TE-S54	Subchannel 54			502	
TE-S55	Subchannel 55			503	
TE-S57	Subchannel 57			504	
TE-S59	Subchannel 59			505	
TE-S63	Subchannel 63			506	Instrument failed
TE-S64	Subchannel 64			507	Questionable
<u>Test Section</u>					
TE-162	Inlet line T/C			323	
TE-150	Bottom flange T/C			324	
TE-151	Bottom flange T/C			325	
TE-152	Bottom flange T/C			326	
TE-153	Bottom flange T/C			327	Instrument failed
TE-212	Outlet line T/C			343	
TE-210A	Outlet line RTD (steady state)	+32 to +800°F	+0.2 to +0.52 V	413	Small spurious spikes
TEST SECTION PRESSURE					
PE-156	Inlet plenum	0 to +3000 psig	0.0 to +5.0 V	382	
PE-201	Outlet plenum	0 to +3000 psig	0.0 to +5.0 V	383	
PE-27	Inlet plenum bottom	0 to +3000 psig	0.0 to +5.0 V	402	
PE-43	Outlet plenum bottom	0 to +3000 psig	0.0 to +5.0 V	403	
PT-32	Outlet steady state	+500 to +2500 psig	+1.0 to +5.0 V	405	

Table 5 (continued)

Measurement	Location and comments	Range		Figure	Measurement comments
		Detector	Data acquisition system		
TEST SECTION					
PRESSURE DROP					
PDT-199	Shroud box steady-state differential pressure	0 to +50 psid	+1.0 to +5.0 V	390	
PDE-200	Bundle transient differential pressure	-200 to +200 psid	-5.0 to +5.0 V	391	
PDT-30	Test section steady-state differential pressure	0 to +50 psid	+1.0 to +5.0 V	404	
PRESSURIZER INSTRUMENTS					
<u>Temperature</u>					
TE-1	Tank top T/C	+32 to +1897°F	-0.0027 to +0.0400 V	349	
TE-2	Tank exit T/C	+32 to +1897°F	-0.0027 to +0.0400 V	350	
<u>Pressure</u>					
PT-102	Steady-state pressure	+500 to +2500 psig	+1.0 to +5.0 V	386	
PE-106	Vapor transient pressure	0 to +3000 psig	0 to +5.0 V	387	
<u>Level</u>					
LT-100	Steady-state liquid level	0 to +150 in.	+1.0 to +5.0 V	409	
HEATER ROD POWER					
<u>Heater Current</u>					
EIE-11S6	Rod 1	0 to +800 A	0.0 to +5.0 V	415	
EIE-12S6	Rod 2			416	
EIE-11S7	Rod 3			417	
EIE-12S7	Rod 4			418	
EIE-9S6	Rod 5			419	
EIE-9S8	Rod 6			420	
EIE-9S5	Rod 7			421	
EIE-11S5	Rod 8			422	
EIE-11S8	Rod 9			423	
EIE-12S8	Rod 10			424	
EIE-9S7	Rod 11			425	
EIE-9S4	Rod 12			426	
EIE-9S3	Rod 13			427	
EIE-9S11	Rod 14			428	
EIE-11S4	Rod 15			429	

Table 5 (continued)

Measurement	Location and comments	Range		Figure	Measurement comments
		Detector	Data acquisition system		
HEATER ROD POWER (continued)					
<u>Heater Current (continued)</u>					
EIE-11S9	Rod 16			430	
EIE-12S5	Rod 17			431	
EIE-9S9	Rod 18			432	
EIE-9S10	Rod 19			433	Unpowered rod
EIE-9S2	Rod 20			434	
EIE-9S12	Rod 21			435	
EIE-11S11	Rod 22			436	
EIE-11S10	Rod 23			437	
EIE-11S3	Rod 24			438	Unpowered rod
EIE-9S13	Rod 25			439	
EIE-10S6	Rod 26			440	
EIE-9S1	Rod 27			441	
EIE-10S7	Rod 28			442	
EIE-11S2	Rod 29			443	
EIE-11S12	Rod 30			444	
EIE-12S2	Rod 31			445	
EIE-12S1	Rod 32			446	
EIE-10S12	Rod 33			447	
EIE-10S5	Rod 34			448	
EIE-10S8	Rod 35			449	
EIE-11S1	Rod 36			450	
EIE-12S4	Rod 37			451	
EIE-12S3	Rod 38			452	
EIE-12S12	Rod 39			453	Unpowered rod
EIE-10S11	Rod 40			454	
EIE-10S10	Rod 41			455	
EIE-10S9	Rod 42			456	
EIE-12S9	Rod 43			457	
EIE-12S10	Rod 44			458	
EIE-12S11	Rod 45			459	
EIE-10S1	Rod 46			460	
EIE-10S2	Rod 47			461	Unpowered rod
EIE-10S3	Rod 48			462	
EIE-10S4	Rod 49			463	
GENERATOR POWER					
<u>Generator Current</u>		0 to +10,000 A	0.0 to +5.0 V		
EIE-9	Generator 9 current			464	
EIE-10	Generator 10 current			465	Spurious spike

Table 5 (continued)

Measurement	Location and comments	Range		Figure	Measurement comments
		Detector	Data acquisition system		
GENERATOR POWER (continued)					
<u>Generator Current (continued)</u>					
EIS-11	Generator 11 current			466	Spurious spike
EIE-12	Generator 12 current			467	Spurious spike
<u>Generator Voltage</u>		0 to +285 V	0.0 to +10.0 V		
EEE-9	Generator 9 voltage			468	
EEE-10	Generator 10 voltage			469	
EEE-11	Generator 11 voltage			470	
EEE-12	Generator 12 voltage			471	
HEAT EXCHANGER INSTRUMENTS					
<u>Primary Side</u>		Outlet Line Thermocouples	+32 to +1897°F	-0.0027 to +0.0400 V	
TE-30B	Heat exchanger A			344	
TE-32B	Heat exchanger B			345	
TE-34B	Heat exchanger C			346	
TE-5B	Heat exchanger D			348	
TE-29B	Main HX mixing tee steady-state temp., RTD	+2 to +800°F	+0.032 to +0.800 V	398	
<u>Secondary Side</u>		Secondary discharge steady-state temp., RTD	+32 to +500°F	+0.2 to +0.4 V	
TE-525	Heat exchanger A			412	Spikes
TE-627	Heat exchanger B			392	
TE-727	Heat exchanger C			397	
TE-557	Heat exchanger D			411	Small spikes
<u>Heat Exchanger Secondary Flow</u>					
FE-522	Heat exchanger A	0 to +150 gpm	+0.2 to +1.0 V	410	Valved off
FE-620	Heat exchanger B	0 to +150 gpm	+0.2 to +1.0 V	354	
FE-720	Heat exchanger C	0 to +150 gpm	+0.2 to +1.0 V	355	
FE-550	Heat exchanger D	0 to +50 gpm	+0.2 to +1.0 V	356	
<u>Heat Exchanger Pressure</u>					
PE-44	Upstream main HX transient pressure	0 to +3000 psig	0.0 to +5.0 V	384	
PE-526	HX A secondary inlet pressure	0 to +350 psig	0.0 to +5.0 V	400	Instrument failed

Table 5 (continued)

Measurement	Location and comments	Range		Figure	Measurement comments
		Detector	Data acquisition system		
HEAT EXCHANGER INSTRUMENTS (continued)					
<u>Pressure Drop</u>					
PDT-48	Main HX steady-state pressure drop	0 to +24 psid	+1.0 to +5.0 V	393	
PDE-46	Main HX bypass transient pressure drop	-200 to +200 psid	-5.0 to +5.0 V	399	
PRIMARY PUMP INSTRUMENTS					
FE-1A	Primary side pump flow	0 to +800 gpm	+1.0 to +5.0 V	357	
PE-76	Pump suction transient pressure	0 to +3000 psig	0 to +5.0 V	385	
PDE-78	Primary pump transient pressure drop	-1000 to +1000 psid	-5.0 to +5.0 V	394	
SE-72	Primary pump speed	+100 to +5400 rpm	0 to +5.0 V	406	
TE-4B	Base primary steady-state temp., RTD	+32 to +800°F	+0.2 to +0.52 V	353	Small spurious spikes
PE-16	Downstream HCV-2 transient pressure	0.0 to +3000 psig	0.0 to +5.0 V	401	
PRESSURE SUPPRESSION SYSTEM INSTRUMENTS					
PE-412	Pressure suppression receiver transient pressure	0 to +200 psig	0 to +5.0 V	388	
PE-425	PSS inlet blowdown line transient pressure	0 to +3000 psig	0 to +5.0 V	395	
PE-427	PSS outlet blowdown line transient pressure	0 to +3000 psig	0 to +5.0 V	396	
TE-29	Inlet blowdown plenum T/C	+32 to +1897°F	-0.0027 to +0.0400 V	351	Small spurious spikes
TE-45	Outlet blowdown plenum T/C	+32 to +1897°F	-0.0027 to +0.0400 V	352	
DEMINERALIZED WATER SYSTEM					
TE-520B	RBT 4-in. demineralized water header T/C	+32 to +1897°F	-0.0027 to +0.0400 V	347	
TE-615	Demineralized water 6-in. header steady-state temp., RTD	+32°F to +500°F	+0.2 to +0.4 V	389	Spurious spikes
GENERAL INSTRUMENTATION (ELECTRICAL)					
<u>Breakwire Detectors</u>					
XM-40001	Inlet break	0.0 to +5.0 V	0.0 to +5.0 V	407	
XM-40000	Outlet break	0.0 to +5.0 V	0.0 to +5.0 V	408	

Table 5 (continued)

Measurement	Location and comments	Range		Figure	Measurement comments
		Detector	Data acquisition system		
GENERAL INSTRUMENTATION (ELECTRICAL) (continued)					
<u>RTD Power</u>					
EIM-1001B	RTD power supply current	2.0 mA	0.400 V	414	
<u>Data Acquisition</u>					
<u>Calibration Signals</u>					
Zero cal. input	Channels 0-127, gain 0	5.0 mV	5.0 mV	372	Erratic
Zero cal. input	Channels 0-127, gain 8	0.0 mV	0.0 mV	472	
Zero cal. input	Channels 128-255, gain 8	0.0 mV	0.0 mV	473	
Zero cal. input	Channels 256-383, gain 8	0.0 mV	0.0 mV	474	
Zero cal. input	Channels 384-511, gain 8	0.0 mV	0.0 mV	475	
Full-scale cal. input	Channels 0-127, gain 8	35.00 mV	35.00 mV	476	
Full-scale cal. input	Channels 128-255, gain 8	35.00 mV	35.00 mV	477	
Full-scale cal. input	Channels 256-383, gain 8	35.00 mV	35.00 mV	478	
Full-scale cal. input	Channels 384-511, gain 8	35.00 mV	35.00 mV	479	

NUREG/CR-0733
 ORNL/NUREG/TM-304
 Dist. Category R2

Internal Distribution

- | | |
|-----------------------|--------------------------------------|
| 1. T. M. Anklam | 19. C. B. Mullins |
| 2. M. Bender | 20. F. R. Mynatt |
| 3. R. E. Bohanan | 21. L. J. Ott |
| 4. V. D. Clemons | 22. J. L. Rich |
| 5. S. B. Cliff | 23. A. N. Smith |
| 6. S. K. Combs | 24. R. E. Textor |
| 7. W. B. Cottrell | 25. D. G. Thomas |
| 8. W. G. Craddick | 26. H. E. Trammell |
| 9. R. D. Dabbs | 27. D. B. Trauger |
| 10. H. L. Falkenberry | 28. B. J. Veazie |
| 11. R. M. Flanders | 29-30. J. D. White |
| 12. M. H. Fontana | 31. M. D. White |
| 13. R. C. Hagar | 32. Patent Office |
| 14. H. W. Hoffman | 33-34. Central Research Library |
| 15. C. R. Hyman | 35. Document Reference Section |
| 16. A. F. Johnson | 36-37. Laboratory Records Department |
| 17. B. F. Maskewitz | 38. Laboratory Records (RC) |
| 18. G. M. Maxwell | |

External Distribution

- 39-40. Director, Division of Reactor Safety Research, Nuclear Regulatory Commission, Washington, D.C. 20555
41. Office of Assistant Manager, Energy Research and Development, DOE, ORO
- 42-43. Technical Information Center, DOE
- 44-403. Given distribution as shown under category R2 (10 copies - NTIS)

NUREG/CR-0733
ORNL/NUREG/TM-304

PWR BLOWDOWN HEAT TRANSFER SEPARATE-EFFECTS PROGRAM — THERMAL-HYDRAULIC
TEST FACILITY EXPERIMENTAL DATA REPORT FOR TEST 163

V. D. Clemons W. G. Craddick R. M. Flanders

Microfiche  Enclosed

