



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON D.C. 20555-0001

ENTERGY OPERATIONS, INC.

DOCKET NO. 50-368

ARKANSAS NUCLEAR ONE, UNIT NO. 2

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 156
License No. NPF-6

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by Entergy Operations, Inc. (the licensee) dated February 24, 1993, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance: (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this license amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.

9402140120 940203
PDR ADDOCK 05000368
P PDR


2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and Paragraph 2.C.(2) of Facility Operating License No. NPF-6 is hereby amended to read as follows:

2. Technical Specifications

The Technical Specifications contained in Appendix A, as revised through Amendment No. 156, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications.

3. The license amendment is effective 30 days from the date of issuance.

FOR THE NUCLEAR REGULATORY COMMISSION



for William D. Beckner, Director
Project Directorate IV-1
Division of Reactor Projects - III/IV/V
Office of Nuclear Reactor Regulation

Attachment:
Changes to the Technical
Specifications

Date of Issuance: February 3, 1994

ATTACHMENT TO LICENSE AMENDMENT NO. 156

FACILITY OPERATING LICENSE NO. NPF-6

DOCKET NO. 50-368

Revise the following page of the Appendix "A" Technical Specifications with the attached page. The revised page is identified by Amendment number and contains a vertical line indicating the area of change. The corresponding overleaf page is also provided to maintain document completeness.

REMOVE PAGE

3/4 6-7

INSERT PAGE

3/4 6-7

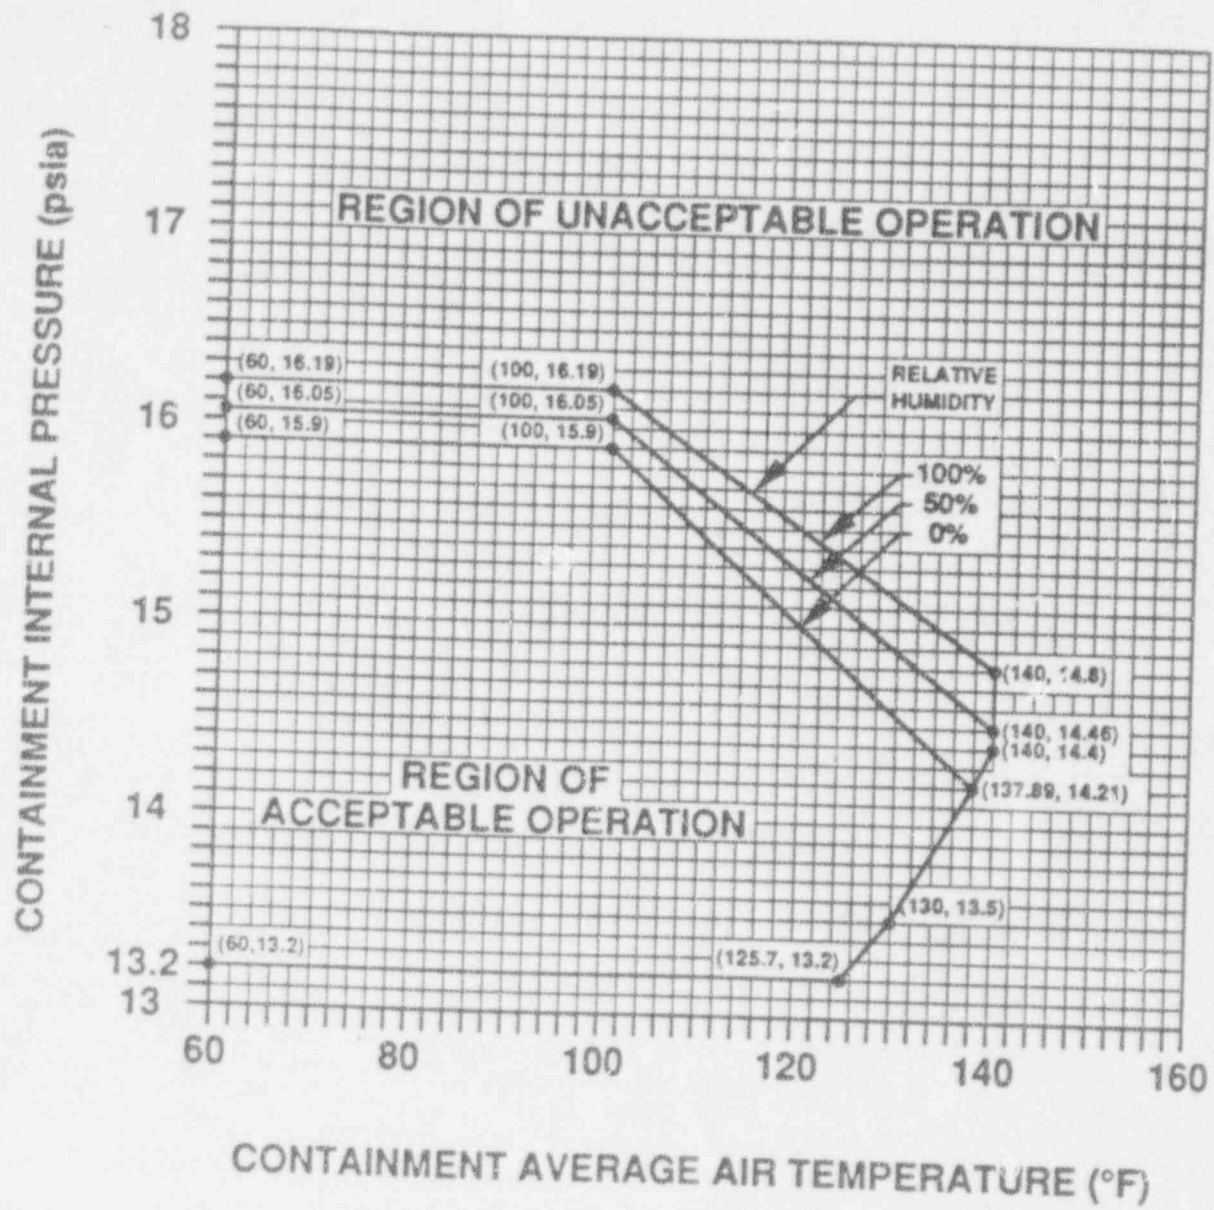


FIGURE 3.6 - 1

CONTAINMENT INTERNAL PRESSURE
 VS.
 CONTAINMENT AVERAGE AIR
 TEMPERATURE

NOTE: Instrument Error is not Included on Curve

CONTAINMENT SYSTEMS

CONTAINMENT STRUCTURAL INTEGRITY

LIMITING CONDITION FOR OPERATION

3.6.1.5 The structural integrity of the containment shall be maintained at a level consistent with the acceptance criteria in Specification 4.6.1.5.

APPLICABILITY: MODES 1, 2, 3 and 4.

ACTION:

With the structural integrity of the containment not conforming to the above requirements, restore the structural integrity to within the limits within 24 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.6.1.5.1 Containment Tendons The containment tendons' structural integrity shall be demonstrated at the end of one, three and five years following the initial containment structural integrity test and at five year intervals thereafter. The tendons' structural integrity shall be demonstrated by a visual examination (to the extent practical and without dismantling load bearing components of the anchorage) of a representative sample* of at least 21 tendons (6 dome, 5 vertical, and 10 hoop) and verifying no abnormal degradation. Unless there is evidence of abnormal degradation of the containment tendons during the first three tests of the tendons, the number of tendons examined during subsequent tests may be reduced to a representative sample of at least 9 tendons (3 dome, 3 vertical and 3 hoop).

*For each inspection, the tendons shall be selected on a random but representative basis so that the sample group will change somewhat for each inspection; however, to develop a history of tendon performance and to correlate the observed data, one tendon from each group (dome, vertical, and hoop) may be kept unchanged after the initial selection.