

DATA SEARCH AND SCREENING REVIEW
ROSEMOUNT TRANSMITTERS - LOSS OF FILL-OIL FAILURES

JANUARY 1994

Prepared By:

James R. Houghton

Trends and Patterns Analysis Branch
Division of Safety Programs
Office for Analysis and Evaluation of Operational Data
U. S. Nuclear Regulatory Commission

9403110145 940217
PDR GA999 EMVROSM
99900271 PDR

CONTENTS

1. INTRODUCTION 1

 1.1 Purpose of Work 1

 1.2 Background 1

2. SCOPE OF WORK 1

 2.1 Description of Components 1

 2.2 Data Sources 2

3. APPROACH AND METHODOLOGY 3

 3.1 Number of Components 3

 3.2 Number of Fill-Oil Failures for Selected Models of Rosemount Transmitters 3

 3.3 Average Number of Failures Per Component per Year for Selected Models of Rosemount Transmitters 4

 3.4 Candidate Plants for More Detailed Review 4

4. RESULTS 4

 4.1 Number of Fill-Oil Failures for Selected Models of Rosemount Transmitters 4

 4.2 Average Number of Failures per Component per Year for Selected Models of Rosemount Transmitters 5

 4.3 Listing of Candidate Plants for More Detailed Review 5

5. SUMMARY 5

6. REFERENCES 5

FIGURES

| FIGURE NO. | DESCRIPTION | PAGE |
|------------|---|------|
| 1 | Rosemount Transmitters - Loss of Fill-Oil Failures | 6 |
| 2 | Rosemount Transmitters - Loss of Fill-Oil Failures Average Number of Failures per Component per Year | 7 |

TABLES

| TABLE NO. | DESCRIPTION | PAGE |
|-----------|--|------|
| I | Rosemount Transmitters - Loss of Fill-Oil Failures and Average Number of Failures per Component per Year | 8 |
| II | Rosemount Transmitters - Loss of Fill-Oil Failures and Average Number of Failures per Component per Year - Candidate Plants for More Detailed Review | 9 |

DATA SEARCH AND SCREENING REVIEW
ROSEMOUNT TRANSMITTERS - LOSS OF FILL-OIL FAILURES

1. INTRODUCTION

1.1 Purpose of Work

This work was performed as the first semi-annual search and screening review of Nuclear Plant Reliability Data System (NPRDS) data related to fill-oil leakage (i.e., loss of silicon fill-oil) in selected models of Rosemount transmitters, subsequent to the industry response to NRC Bulletin 90-01, Supplement 1 (Reference 1). In addition to this review, other follow-on reviews will be performed about every six months for the next two years to identify: (1) whether or not a significant increase in the number of reported fill-oil failures has occurred and (2) whether specific plants have experienced a significant number of failures.

1.2 Background

On March 9, 1990, the NRC issued Bulletin 90-01, in which it requested that licensees take appropriate corrective actions for Model 1153, Series B and D and Model 1154 transmitters manufactured by Rosemount, that may have a potential for leaking fill-oil.

On December 22, 1992, the NRC issued Bulletin 90-01, Supplement 1 (Reference 1) as an update to Bulletin 90-01. This supplement identified actions for replacement or monitoring of the specific Model 1153 and Model 1154 transmitters, manufactured before July 11, 1989, that are used or may be used in the future in either safety-related systems or systems installed in accordance with 10 CFR 50.62 (the ATWS rule).

Subsequently, the "Rosemount Transmitter Review Group Report (RTRG) on the Loss-of-Fill-Oil Issue" issued recommendations for a semi-annual review of fill-oil leakage failures for the selected Model 1153 and Model 1154 Rosemount transmitters. On November 22, 1993, the Office of Nuclear Reactor Regulation (NRR) requested AEOD assistance in addressing the RTRG recommendations (Reference 2). During a subsequent meeting with AEOD staff, similar information was requested by NRR staff for Rosemount Models 1151, 1152, and 1153, Series A. The NRR staff also agreed that all data requested for the update review start on 04/01/91.

2. SCOPE OF WORK

2.1 Description of Components

The Rosemount transmitters, Models 1153 series B and D and 1154 are pressure transmitter assemblies made up of a silicon oil-filled sensing module mounted in a pressure retaining housing, with an attached electronic housing containing circuit boards. The process pressure is translated through an isolating diaphragm and silicon oil fill fluid to a sensing diaphragm in the center of the sensing module cell. The

reference pressure is transmitted in like manner to the other side of the sensing diaphragm. Displacement of the sensing diaphragm, a maximum motion of 0.004 inches, is proportional to the pressure differential across it. The position of the sensing diaphragm is detected by the capacitor plates on both sides of the sensing diaphragm. Differential capacitance between the sensing diaphragm and capacitor plates is converted electronically to a 2 wire 4-20 MADC signal.

According to published vendor information, the Models 1153, Series A and D and 1154 transmitters were designed, but not specifically limited to, the following safety-related applications (IEEE standards are included to identify the environmental and seismic qualification requirements):

- 1153, Series B: IEEE 323-1974 and IEEE 344-1975; designed for boiling water reactor (BWR) and outside containment installation for pressurized water reactor (PWR) plants.
- 1153, Series D: IEEE 323-1974 and IEEE 344-1975; designed for in-containment use for PWR plants (transmitter has stainless steel housing).
- 1154: IEEE 323-1974 and IEEE 344-1975; designed to improve performance under high radiation and high temperature conditions.

Similarly, the second group of Rosemount transmitter models, which were also included in the scope of this study, were designed to earlier editions of industry standards and for the following applications:

- 1153, Series A: IEEE 323-1971 and IEEE 344-1975; PWR use, obsolete June 1, 1984.
- 1151: Nonsafety-related applications; no nuclear qualification; 10 CFR 21 not applicable.
- 1152: IEEE 323-1971 and IEEE 344-1975; used mostly where only seismic qualification is required

2.2 Data Sources

The NPRDS was used as the data source for identifying: (1) the number of safety-related Rosemount transmitters in two groups as requested by NRR: (a) Models 1151, 1152, and 1153, Series A and (b) Models 1153, Series B and D and 1154 and (2) the failures due to fill-oil leakage for all of the models in both groups during a 5 year period [(a) 07/01/88 - 03/31/91 and (b) 04/01/88 - 06/30/93].

The NRR request specified a desire for the following data items, most of which are contained in the NPRDS database and reported in the failure master: (1) model number, (2) transmitter serial number, (3) module serial number, (4) system in which installed, (5) safety classification,

(6) application description, (7) normal operating pressure, (8) pressure times time in service (psi-months) when failure was discovered, (9) age of transmitter, (10) installation date, (11) discovery date, (12) licensee and utility name, (13) failure symptoms observed, (14) whether suspected failure due to fill oil leakage was/was not confirmed, (15) corrective actions, and (16) disposition of the failed transmitter. Of the requested data items, items (2), (3), (6), and (7) are optional NPRDS data fields for which information may not have been provided by the licensee in the specific failure report. In addition, under current NPRDS reporting guidance, the age of a component at failure cannot be accurately determined from the data. However, the need for this information was discussed with cognizant NRR staff, and how it might be approximated using the installation date and the discovery date.

Operating event data in the form of Licensee Event Reports (LERs) was obtained from the Oak Ridge National Laboratory's (ORNL) Sequence Coding and Search System (SCSS) database for identifying the number of failures due to fill-oil leakage, but limited to Models 1153, Series B and D and 1154 for the shorter period 04/01/91 through 06/30/93.

3. APPROACH AND METHODOLOGY

3.1 Number of Components

To determine the number of failures per component per year for the selected models, the determination of the number of components used in each of the plants was necessary. This determination was performed using the NPRDS database for the following model groups: (a) Models 1151 and 1152, 1153, Series A, and (b) Models 1153, Series B and D and 1154. The results obtained allowed calculation of the number of failures per component for each specific group of transmitter model/series. The following exclusions were made for all models to determine the number of components in each group:

- (1) Three units were excluded: Shoreham, Fort St. Vrain, and Rancho Seco.
- (2) "Non-safety-related" class and "Other" class were excluded from the NPRDS safety class category.

The number of components for each model group was assumed constant for this review, using the latest NPRDS database counts.

3.2 Number of Fill-Oil Failures for Selected Models of Rosemount Transmitters

The number of loss of fill-oil failures due to leakage was determined through the NPRDS database, using the following and NPRDS General Report 5 (the Component Master Failure Report with Unit information):

- (1) Three units were excluded: Shoreham, Fort St. Vrain, and Rancho Seco.
- (2) "Non-safety-related" class and "Other" class were excluded from the NPRDS safety class category.
- (3) The selected severity levels were immediate and degraded.

From the SCSS database, all LERs were reviewed for applicability to failure of Rosemount transmitters due to fill-oil leakage for the latter (update) period 04/01/91 through 06/30/93.

3.3 Average Number of Failures per Component per Year for Selected Models of Rosemount Transmitters

The number of failures per component was determined during the 5 year period, using the failures for each group of transmitter models and total number of components for each model group on a yearly basis. Both the number of failures and the average number of failures per component per year were plotted over the 5 year period.

3.4 Candidate Plants for More Detailed Review

Candidate plants which experienced a higher number of failures, both prior to and subsequent to 04/01/91 were identified, with the latter period specifically applicable to the NRR request, and the former period - 07/01/88 through 03/31/91 - included for consistency over the 5 year period.

4. RESULTS

4.1 Number of Fill-Oil Failures for Selected Models of Rosemount Transmitters

- The total number of failures due to fill-oil leakage over the 5 year period (07/01/88 - 06/30/93) was 73, with 23 of these failures occurring during the update period (04/01/91 - 06/30/93).
- All of the failures during the 5 year period involved one model group only: Models 1153, Series B and D, and 1154.
- No fill-oil leakage failures were identified from the review of LER data over the update period.
- The number of failures sharply decreased subsequent to 1990. (see Figure 1 and Table I).

4.2 Average Number of Failures per Component per Year for Selected Models of Rosemount Transmitters

- The plot of the average number of failures per component per year is a corollary of the number of failures plot, but also

provides identification of issue dates for NRC Bulletin 90-01; 90-01, Supplement 1; and the start date for the subsequent review (04/01/91) (see Figure 2 and Table I).

- The average number of failures per component per year over the 5 year period was $3.6E-3$. The peak of $5E-3$ occurred in 1990, with the lowest value ($9E-4$) occurring in the first quarter of 1993.

4.3 Listing of Candidate Plants for More Detailed Review

- For the updated portion of the 5 year period (i.e., 04/01/91 - 06/30/93), only one plant (No. 77) exhibited an increase in the number of failures. The average number of failures per component per year for that plant was $.020$ ($2E-2$) or more than a decade higher than the average for all plants over the 5 year period (see Table II). For this plant, no failures were reported prior to 04/01/91, while 4 failures (of the total of 23 for all plants during this period) were reported subsequent to 04/01/91.

- Between 07/01/88 and 03/31/91, there were 3 plants (Nos 5, 69, and 102) that had a relatively high number of failures and a corollary high average number of failures per component per year. However, the average number of failures per component per year for these plants decreased significantly during the period subsequent to 04/01/91 (see Table II).


5. SUMMARY

- Since 1990, there has been a significant decrease in the number of failures and corollary number of failures per component of Rosemount transmitters due to leakage of fill oil.
- With the exception of one plant, there was no increase in the plant-specific value of the average number of failures per component per year for Rosemount transmitters due to fill oil leakage subsequent to 04/01/91. The value for this one plant was 2%, which is approximately a decade higher than the 5 year average for all plants. No failures were reported for this plant prior to 04/01/91.

6. REFERENCES

- NRC Bulletin No. 90-01, Supplement 1, "Loss of Fill-Oil in Transmitters Manufactured by Rosemount," dated December 22, 1992.
- USNRC Memorandum from Bruce A. Boger to Gary M. Holahan, "Request for AEOD Assistance Regarding the Rosemount Transmitter Issue," dated November 22, 1993.

ROSEMOUNT TRANSMITTERS LOSS OF FILL-OIL FAILURES

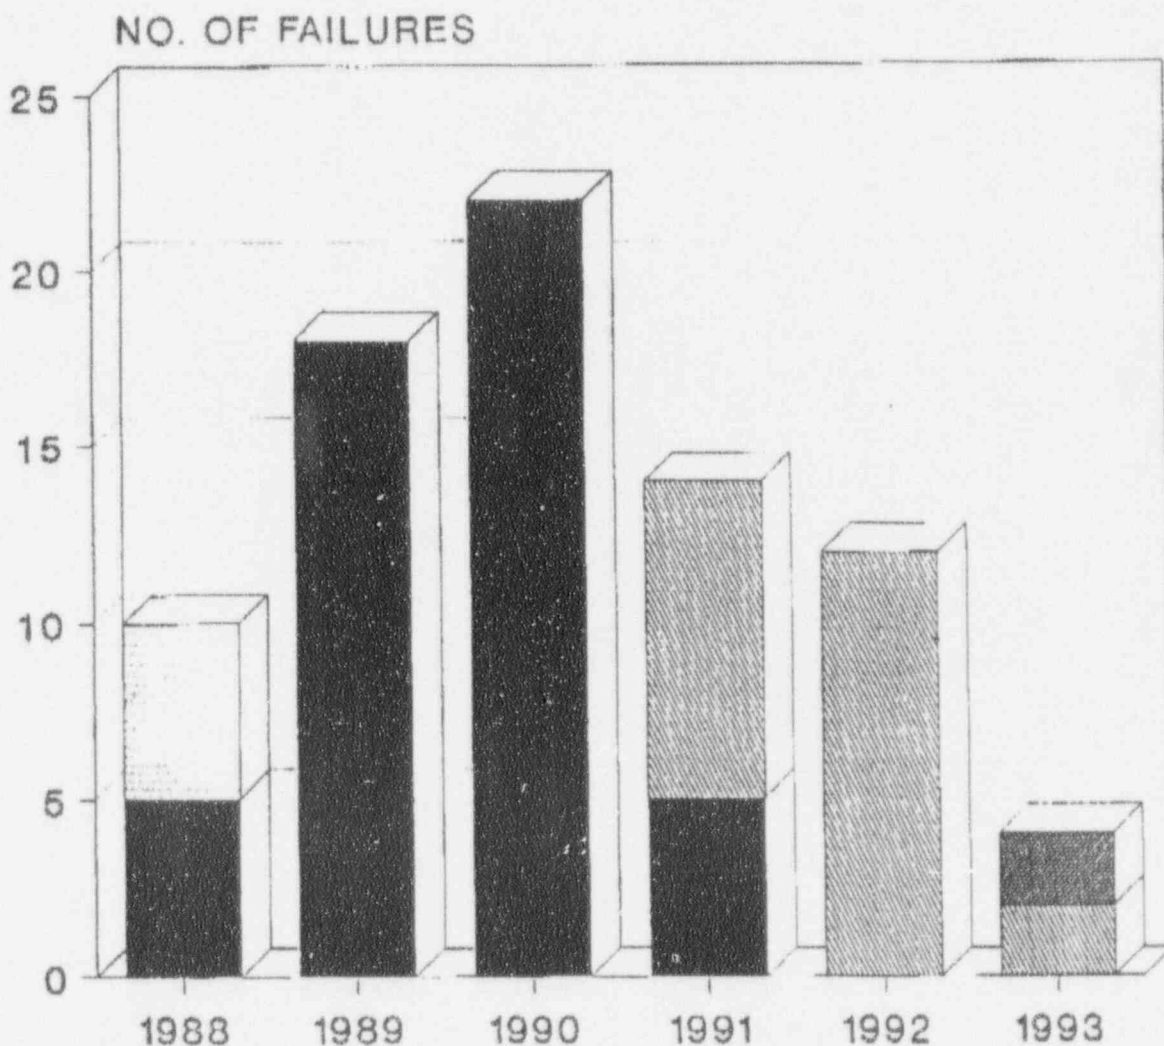


■ 7/1/88-3/31/91-ACT. ▨ 4/1/91-6/30/93-ACT.
□ 1/1/88-6/30/88-EXT. ▩ 7/1/93-12/31/93-EXT.

TOTAL NO. FAILURES: 73
EXT signifies extrapolated data

FIGURE 1

ROSEMOUNT TRANSMITTERS LOSS OF FILL-OIL FAILURES

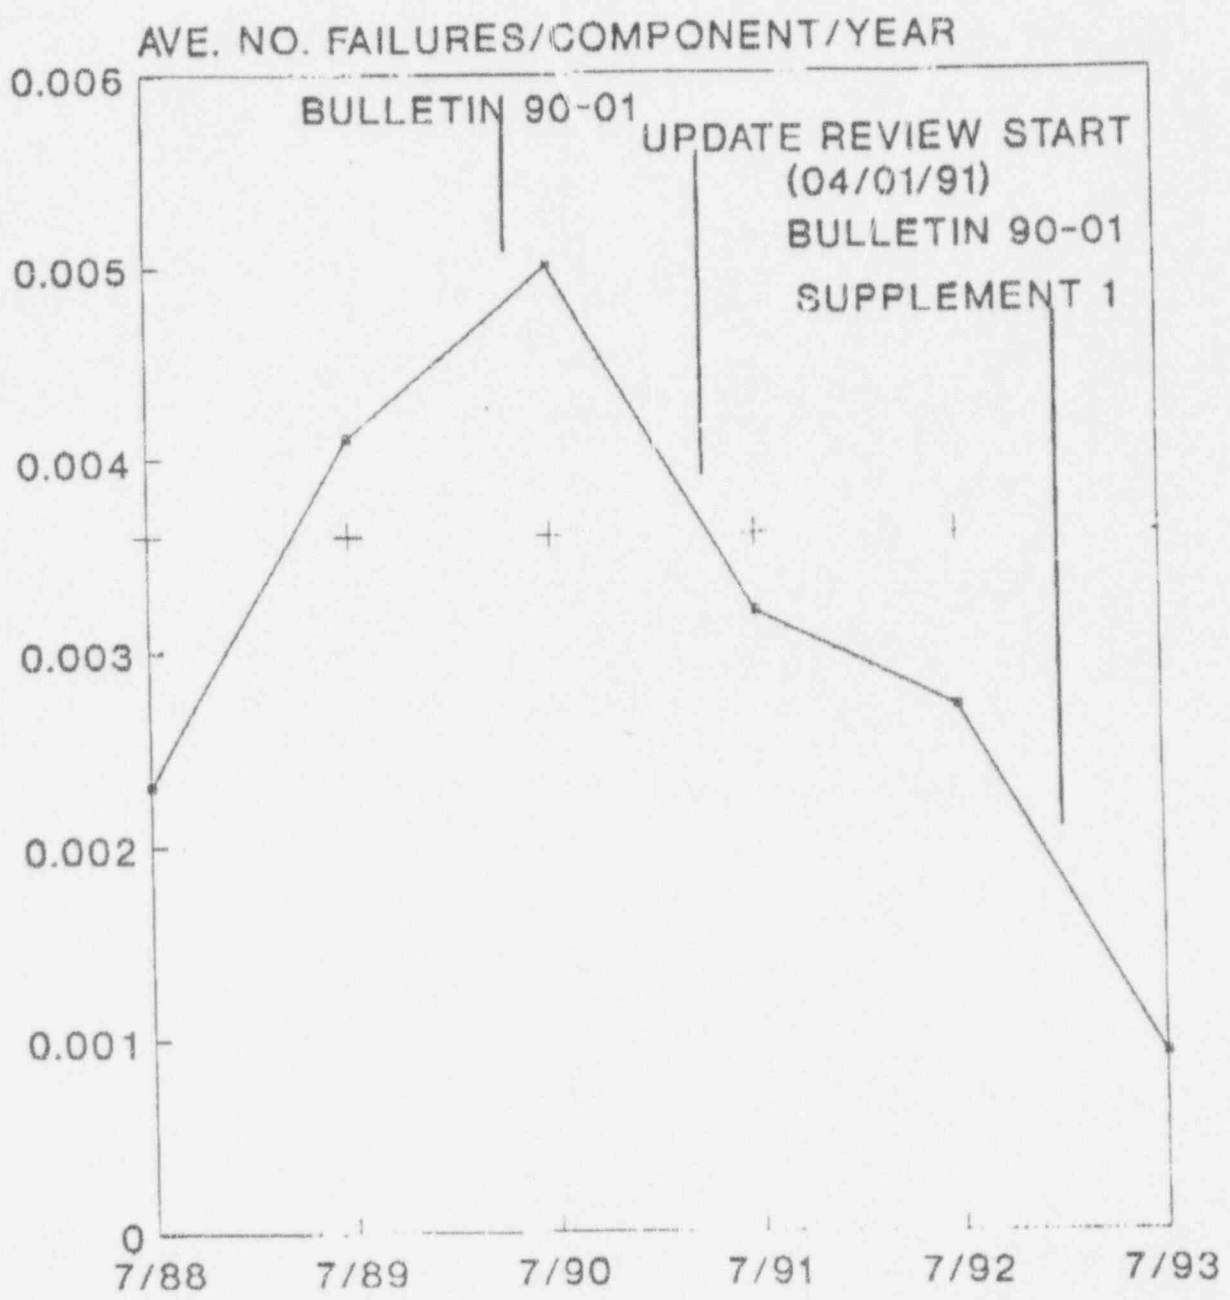

5 YR Period: 07/01/88-06/30/93
No. Failures: 73

FIGURE 2

TABLE I
Rosemount Transmitters - Loss of Fill-Oil Failures and Average Number of Failures per Component per Year

| <u>MODELS 1153, "B" & "D" and 1154</u> | <u>1988</u> | <u>1989</u> | <u>1990</u> | <u>1991</u> | <u>1992</u> | <u>1993</u> | <u>Totals</u> |
|--|----------------------------|-------------|-------------|-------------|-------------|-------------|---------------|
| No. NPRDS Failures: | | | | | | | |
| 1) 07/01/88-03/31/91: | 5 | 18 | 22 | 5 | - | - | 50 |
| 2) 04/01/91-06/30/93: | - | - | - | 9 | 12 | 2 | 23 |
| No. LER Failures: | - | - | - | 0 | 0 | 0 | 0 |
| Total No. Failures: | 5 | 18 | 22 | 14 | 12 | 2 | 73 |
| No. Transmitters: | -----4369----- | | | | | | |
| Failures Per Component | .0023 | .0041 | .0050 | .0032 | .0027 | .0009 | |
| Average Failures Per Component | ----- .0036 (3.6E-3) ----- | | | | | | |

Notes:

- (1) See Figures 1 and 2
- (2) The number of transmitters in the other model group (e.g., Models 1151, 1152, and 1153, Series A) is 2252.

TABLE II
Rosemount Transmitters - Loss of Fill-Oil Failures and Average Number of
Failures per Component per Year
Candidate Plants for More Detailed Review

| <u>Plant No.</u> | <u>PERIOD</u> | <u>NO. FAILURES</u> | <u>NO. COMPONENTS</u> | <u>AVERAGE NO. OF FAILURES/COMPONENT /YR</u> |
|------------------|------------------------|---------------------|-----------------------|--|
| 77 | 04/01/91 - 06/30/93 | 4 | 90 | .020 (2%) |
| 102 | 07/01/88 - 03/31/91 | 7 | 167 | .015 (1.5%) |
| 102 | 04/01/91 - 06/30/93 | 2 | 167 | .005 (0.5%) |
| 69 | 07/01/88 - 03/31/91 | 4 | 122 | .012 (1.2%) |
| 69 | 04/01/91 06/30/93 | 2 | 122 | .007 (0.7%) |
| 5 | 07/01/88 - 03/31/91 | 11 | 28 | .143 (14.3%) |
| 5 | 04/01/91 - 06/30/93 | 0 | 28 | 0 |

NOTES:

- (1) Only Plant No. 77 showed a higher average number of failures per component per year subsequent to 04/01/91.
- (2) This table is for transmitters in the model group for Models 1153, Series B and D, and Model 1154.